Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

September 22, 2021

Mr. Bryon Ward, President
DANA POINT HARBOR PARTNERS, LLC
c/o BURNHAM-WARD PROPERTIES
1100 Newport Center Drive, Suite 200
Newport Beach, CA 92660

GMU Project 17-206-02
Permit No. PKG21-0490

Subject: Response to County of Orange Geotechnical Review Comments Pertaining to Precise Grading Plans, Dana Point Harbor Revitalization, Buildings 1 through 12, Commercial Component, City of Dana Point, California

References: Listed on Page 12

Dear Mr. Ward:

This correspondence presents our response to the reference (1) County of Orange Review Comments, attached to this response as Appendix A, pertaining to the submittal of the precise grading plans and details for the subject site.

RESPONSES TO GEOTECHNICAL COMMENTS

RESPONSE TO COMMENT 1.001

Geotechnical consultant must review the Precise Grading Plans and applicable details submitted to the County that will be utilized during construction of the project. Provide additional geotechnical recommendations as necessary. The approved precise grading plans and applicable details must be reviewed and signed/stamped by the geotechnical engineer and engineering geologist prior to permit issuance. Note – The currently submitted precise grading plans are incomplete and do not include the recommended Deep Soil Mixing (DSM) and Load Transfer Platform (LTP) ground improvement plans/details. Please coordinate w/ project team to ensure the geotechnical ground improvement recommendations/details are included as part of the project precise grading plans.

Acknowledged. The final precise grading plans and applicable details will be reviewed from a geotechnical perspective and signed. We will coordinate w/ project team to ensure the AGI DSM and LTP geotechnical ground improvement recommendations/details are included as part of the project precise grading plans as “For Reference Only”.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

RESPONSE TO COMMENT 1.002

Multiple Building Permits and Plans (Commercial Core Buildings, site walls/retaining walls, etc.) are required for completion of this project. The approved project building and structural plans and applicable details must be reviewed and signed/stamped by the project geotechnical engineer and engineering geologist prior to the applicable permit issuance.

Acknowledged. The approved project building and structural plans and applicable details will be reviewed from a geotechnical perspective and signed/stamped.

RESPONSE TO COMMENT 1.003

The approved Ground Improvement Plans (Deep Soil Mixing (DSM) and Load Transfer Platform (LTP)) and details (from GRD21-0090) must be included as a reference in the approved project building and structural plan sets.

Acknowledged. AGI sheets GI-1 through GI-5 will be included in the building and structural plan sets as reference only.

RESPONSE TO COMMENT 1.004

The submitted geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) indicates that liquefaction analysis was performed on the SPT exploratory data as a cross-check to the CPT liquefaction analysis and yielded similar results. Please provide a copy of the completed SPT liquefaction analysis as discussed in the submitted report. Provide additional recommendations as needed.

Results of the liquefaction analysis performed on SPT data of six (6) exploratory borings (DH-12, DH-17, DH-18, DH-19, DH-26, DH-51) are included as Appendix B. As stated in the submitted geotechnical report, CPT-based liquefaction analyses provide a more reliable, accurate and continuous database from which to calculate liquefaction magnitude. The SPT-based analysis was generally consistent with the results of the CPT-based analysis, but it does include a few isolated cases indicating a larger magnitude of settlement, which is not uncommon using SPT-based analysis. We do not believe these aberrations are accurate predictions of the expected earthquake-induced settlements under the considered ground motions.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

RESPONSE TO COMMENT 1.005

Provide additional comment/discussion to confirm the geotechnical recommendations with respects to infiltration design and bioretention areas from the submitted project geotechnical report (GMU, Inc., report dated 5/27/21) have been incorporated into the submitted project plans. Provide additional recommendations as necessary.

The typical modular wetland systems (precast concrete structures) detailed in the submitted project plans are completely impermeable (confirmed by Tait), and satisfy the geotechnical recommendations provided.

RESPONSE TO COMMENT 1.006

At a minimum, the geotechnical site drainage recommendations should be in accordance with CBC requirements. Please confirm the report recommendations for site drainage are in accordance with CBC requirements and that the submitted project plans have incorporated your geotechnical recommendations. Provide additional geotechnical site drainage recommendations as necessary.

Page 31 of our report recommends that positive drainage of at least 2% away from the perimeters of the structures and site pavements should be incorporated into the design. The submitted project plans generally meet this recommendation. Tait Engineering should verify that site drainage is in conformance with 2019 CBC requirements beyond the recommendations within our report.

RESPONSE TO COMMENT 1.007

The submitted geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) indicates groundwater is anticipated to impact DSM columns and deep utility excavations. Please provide additional comment/discussion to confirm geotechnical recommendations to mitigate groundwater impact on construction based on review of the currently submitted project plans. Also provide comment/discussion to confirm project dewatering operations anticipated means of disposing of pumped water. Provide additional recommendations as necessary.

Shallow groundwater a common condition in projects including DSM construction is not expected to impact the DSM construction process. The DSM construction process consists of advancing a hollow stem into the ground while rotating mixing blades assist advancement by loosening the soil. As the hollow stem is advanced into and ultimately withdrawn from the DSM column location under construction, a grout slurry (consisting of cement and water) is pumped through the tip of the tooling. The rotation of the mixing blades on the tooling aim to homogenize a “soilcrete” mixture of the in-situ soils and the injected grout. Because the on-site soils are mixed-in-place, no

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

"open holes" are ever created, eliminating the concerns for caving soils which can be caused by shallow groundwater when using other geotechnical construction processes (drilled shafts, micropiles, etc.).
The DSM construction process will generate spoils of the "soilcrete" mixture, which are to be mixed with site soils and processed for use as onsite fill after curing, or potentially incorporated into the proposed LTP. The DSM construction process will not generate any pumped water requiring disposal.

The project general contractor, Snyder Langston, is in the process of applying for a groundwater discharge permit and will be responsible for storage and disposal of any pumped groundwater, which may be required during excavation and installation of site utilities.

RESPONSE TO COMMENT 1.008

The submitted geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) indicates estimated groundwater levels based on high tides were determined and provided in an effort to aid the project in designing underground utilities and give contractors an idea of what conditions may be encountered. Please provide additional comment/discussion on historic high groundwater elevation and high tide groundwater elevation with respects to the project stability analyses included in the submitted project documents (GMU and AGI). Provide additional data and/or updated analysis as necessary. Provide additional recommendations as necessary.

Attached as Appendix G are additional stability/lateral spread analyses of the AGI design with a groundwater level of 5' below ground surface (in reference to ground surface at the time of the investigations, and not of proposed ground surface) as described in our report, which is based on historic high groundwater at the project site. The high tide groundwater elevations shown on Plate 5 are intended to aid underground utility design and to provide estimated groundwater levels that may be encountered by contractors, but not for use in stability analyses.

The results of these additional AGI analyses do not substantially change the results (in fact the maximum estimated slope deformations in these additional analyses is 0.1" **less** than the previously provided values), and as such there is no impact on the AGI design.

In addition, the following additional items should be noted: 1) only the AGI analysis is relevant for the proposed conditions as the GMU analyses simply identified the need for lateral spreading mitigation, 2) the lateral spreading mitigation is based on an MCE earthquake which is an earthquake with a return period of 2500 years, 3) the mitigation is extremely robust.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

RESPONSE TO COMMENT 1.009

The submitted geotechnical report indicates the lateral extents of the subsurface riprap in the vicinity of the proposed buttress DSM columns is uncertain and that areas of rip rap may be encountered during construction. Please provide additional comment/discussion on the potential impact of greater than anticipated rip rap section in this area on the proposed buttress DSM column construction and layout/design, including minimum 4-foot embedment into bedrock. Provide additional recommendations as necessary.

The DSM configuration included an approximately 20-feet offset from the quay walls to the nearest DSM elements. The as-built details of the quay walls provided, namely Sections A and B of Sheet 23 (by Koebig & Koebig, Inc., attached as Appendix C) indicate that the DSM column locations as configured are laterally at least 15' clear of any placed riprap/revetment stone, and will be installed through compacted fill. The 20-feet offset was intended as a conservative buffer in the event that the actual limits of placed rip rap differ from the as-built drawings.

AGI has provided an exhibit, attached as Appendix D, to illustrate potential mitigation options in the event that an isolated riprap obstruction is encountered.

RESPONSE TO COMMENT 1.01

Provide additional comment/discussion on the existing condition/performance of Buildings 2 through 5 at the subject site. Include confirmation of subsurface conditions/foundation conditions and proposed mitigation (i.e., no required mitigation/deep soil mixing columns/load transfer platform, etc.) for the proposed "minor improvements" as discussed in the submitted project geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) and submitted project plans. Provide additional recommendations as necessary.

We understand that the renovation of Buildings 2-4, 5A and 5B will generally consist of remodeling the existing buildings (constructed in the early to mid-1970's) with new doors and windows and, on some of the buildings, removing some interior and exterior walls along with new interior slab-on-grade to reconstruct their layout. In addition, some ramp and stair footings will be included in the remodel.

These buildings have performed satisfactorily since the original development with no signs of visible or no reports of significant distress. Consequently, there is no practical or economically viable way to improve the resistance of these buildings to liquefaction related deformations. It is our understanding that based on meetings between the county and the design team and the developer at the start of 2020, there was agreement reached between all parties that the modifications to the existing buildings would not require anything beyond localized strengthening of existing framing, walls, and footings (i.e., the buildings would not be subject to

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

2019 liquefaction criteria). However should the County require resistance to liquefaction related deformations, then these buildings would likely need to razed, ground improvement implemented and new foundations constructed.

RESPONSE TO COMMENT 1.011

Provide additional comment/discussion to confirm the basis of the geotechnical recommendations for allowable bearing value for the proposed project (i.e., 5,000 psf for Buildings 1 and 6-12 and 2,500 psf for Buildings 2-5). Specifically, address subsurface conditions, proposed mitigation, existing improvements and proposed improvements at the different locations/different allowable bearing recommendations. Include additional data (e.g. plot plan/map, subsurface data, analysis/evaluation, etc.) as necessary to support your comment/discussion. Provide additional recommendations as necessary.

The bearing value for Buildings 1 and 6-12 are based on the presence of DSM columns below the building foundations and slabs while the bearing value for Buildings 2-5 are based on locally "improved" existing soils (i.e., per our recommendations). Consequently, there is a significant difference between the two design bearing values. See AGI Calculations for DSM column supported bearing calculations (See Section 4.2 and Appendices C1 and C21 of the AGI submittal package).

RESPONSE TO COMMENT 1.012

The submitted geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) discusses the anticipated ground improvement (i.e., deep soil mixing columns/load transfer platform) construction schedule and grading pad release for construction of the proposed structure(s). In addition to the information discussed in the submitted geotechnical report, the project will also be required to provide final letter/report from geotechnical consultant of record (GMU Geotechnical, Inc.) prior to pad release for construction to confirm the preliminary recommendation for allowable bearing value (5,000 psf) for the proposed structure(s) remains valid based on the as-graded building pad conditions and DSM/LTP installation.

Acknowledged. As-graded reports during construction will confirm the validity of the recommendation of the 5,000 psf allowable bearing value.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

RESPONSE TO COMMENT 1.013

The project must update the AGI, Inc., Ground Improvement Plans General Notes and Details Section 3.4 Quality Control and Quality Assurance (Sheet GI-2) must be updated to include note that written confirmation from project geotechnical consultant of record will be provided upon completion of site grading and deep soil mixing columns/load transfer platform installation to confirm preliminary recommendation for proposed structure(s) allowable bearing value of 5,000 psf remains valid. Additional recommendations shall be provided as necessary.

Acknowledged. AGI sheet GI-2 has been revised to incorporate this note, within their updated design package, attached as Appendix E.

RESPONSE TO COMMENT 1.014

Provide additional comment/discussion on the lateral spread analysis presented in the GMU Geotechnical, Inc., report dated 5/27/21 (Appendix E). Please include confirmation of location cross-sections analyzed and additional discussion on data/input values utilized for analysis. Include additional data as necessary to support your comment/discussion. Provide additional recommendations as necessary.

The cross-section labels (A-A', C-C'), labeled on the second line in the top left of the analysis sheets, correspond to the cross-sections of the same labels on GMU Plates 2 and 3 (and also correspond to the AGI cross-sections.

The basic soil parameters (unit weight, cohesion', φ') used in the analyses were derived from the extensive lab testing performed on sampled site soils, and are intended to be conservative but representative values. GMU's liquefaction analysis evaluated both CPT data (Appendix D of our report) and SPT data (Appendix B of this letter) in order to A) identify the liquefiable zones under the design seismic loading, and B) estimate the residual shear strength of the liquefied zones post-earthquake. To provide clarity, these residual strengths of liquefied zones are labeled as:

- "Liquefied Su/Sig'v" in our CPT liquefaction analysis
- "S_r/σ'_{vo}" in our SPT liquefaction analysis
- "Tau/Sigma Ratio" in our lateral spread analyses
- "Vertical Strength Ratio" in AGI's lateral spread analyses

It should be noted that the GMU lateral spreading analyses simply concludes that remediation is required. The ground modification design is based upon the AGI analyses.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

RESPONSE TO COMMENT 1.015

Provide additional comment/discussion to confirm the location of the pseudostatic slope stability analysis cross-sections presented in Appendix B1 of the AGI, Inc., report dated 5/27/21. Provide updated Plates/Details as necessary to indicate the confirmed cross-section locations. Provide additional recommendations as necessary.

The cross sections AGI used in this analysis (Plate GI-5) correspond to the GMU cross-sections (Plate 2, 3). The sections are named in the bottom right corner of AGI's analysis sheets ("Section A" = the A-A' cross-section). AGI has incorporated additional section labels in the top left corners of the analysis sheets of their revised design package (Appendix E) for clarity.

RESPONSE TO COMMENT 1.016

Provide additional comment/discussion on the pseudostatic slope stability analysis presented in Appendix B1 of the AGI, Inc., report dated 5/27/21. Please include additional discussion on data/input values utilized for analysis, including Kh values, etc. Include additional data as necessary to support your comment/discussion. Provide additional recommendations as necessary.

Kh values were not selected parameters in AGI's analyses but rather result from AGI's analyses. Based on the site geometry, static loading conditions, and soil properties in the model, the Kh values were iterated until achieving a factor of safety result approximately equal to unity to represent the yield coefficient (Ky) value (by definition) for input into the lateral deformation analysis provided in Appendix B3 of the AGI design package.

RESPONSE TO COMMENT 1.017

Provide additional comment/discussion to confirm the geotechnical recommendation for the anticipated magnitude of vertical settlement (total and differential) that should be taken into account during design and construction of the proposed improvements at the completion of the proposed remedial grading/ground improvement operations. Include the geotechnical recommendation for the horizontal distance over which the anticipated magnitude of remaining vertical differential settlement will occur. Provide additional recommendations as necessary.

The magnitudes of settlement provided in the submitted geotechnical report for Buildings 1 and 6-12 were intended as conservative estimates. Actual estimated settlements as described in the AGI design submittal are 0.5" of static settlement and 0.1" of seismically induced settlement. It should also be noted that all foundations will be founded on DSM columns embedded into bedrock while the slab will be supported on a load transfer platform that is designed to span between the

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM columns. Consequently, the potential for significant adverse settlements to affect Buildings 1 and 6-12 are very small to negligible.

Static settlements for the minor improvements associated with Buildings 2-5 are contained in our report standard and minor – i.e., less than 1' total and ½ inch differential as long as our footing subgrade recommendations are followed. Seismic settlements and lateral deformations due to spreading will be significant (similar to those calculated for Buildings 1 and 6-12). It is our understanding that based on meetings between the county and the design team and the developer at the start of 2020, there was agreement reached between all parties that the modifications to the existing buildings would not require anything beyond localized strengthening of existing framing, walls, and footings (i.e., the buildings would not be subject to 2019 liquefaction criteria). However, if it is required by the County that in order to construct the minor modifications, that the buildings must be able to stand liquefaction related deformations, then the buildings will need to demolished and ground improvement as well as new foundations will be required.

RESPONSE TO COMMENT 1.018

Update/revise the geotechnical cross-sections and plan view exhibits from the GMU Geotechnical, Inc., report dated 5/27/21 and the AGI, Inc., Design Submittal Package (or provide new exhibits if preferred) to indicate the location/limit of the recommended Load Transfer Platform (LTP) beneath Buildings 1 and 6-12 at the subject project. Provide additional recommendations as necessary.

See Plates 2 and 3 for revised plan view and cross sections, attached as Appendix F.

RESPONSE TO COMMENT 1.019

Provide updated/additional geotechnical cross-section(s) as necessary based on your review of the currently submitted project plans and your responses the review comments contained herein. At a minimum, cross-section(s) should extend beyond property lines/limits of permit as necessary to accurately depict site conditions that may impact the proposed grading and construction. Cross-section/exhibit/detail should indicate the proposed site grading/improvements, as-graded site conditions/existing improvements, anticipated subsurface conditions (e.g., geologic contacts/structure, existing improvement foundations, etc.), and the geotechnical remedial grading/ground improvement, temporary excavation and foundation recommendations from your submitted report(s).

Cross section A-A' extends beyond property lines, and collectively the cross sections provided accurately depict site conditions that may impact the proposed grading and construction. The cross

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

sections provided indicate the proposed site grading/improvements, existing grades, and anticipated subsurface geologic conditions.

The cross sections were revised (included in attached Appendix F) to show the limits of the proposed LTP within Buildings 1 and 6-12. Plate 7 – DSM & LTP Installation Detail illustrates the remedial grading recommended at the building locations.

Given the scale of the cross sections, existing improvement foundations and other features not addressed above were excluded to avoid confusion and overcrowding.

RESPONSE TO COMMENT 1.02

Provide updated plot plan/map to indicate the location of any new cross-sections/exhibits/details prepared in response to the review comments contained herein.

Updated plan and cross-sections have been included in attached Appendix F.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Please do not hesitate to contact us if you have any questions regarding this response.

Respectfully submitted,

David R. Atkinson
Project Manager / Senior Engineer

Scott Ward, EIT
Project Engineer

REGISTERED PROFESSIONAL ENGINEER
GREGORY P. SILVER
GE 2336
GEOTECHNICAL
STATE OF CALIFORNIA

Gregory P. Silver, M.Sc., PE, GE 2336
President / CEO
Principal Geotechnical Engineer

Attachments

Appendix A – County of Orange Geotechnical Report Review Comments
Appendix B – GMU SPT-Based Liquefaction Analyses
Appendix C – Quay Wall As-built Drawings
Appendix D – Riprap Obstruction Mitigation Exhibit
Appendix E – Revised AGI Design Package
Appendix F – Revised GMU Plates 2 and 3
Appendix G – Additional AGI Stability/Lateral Spread Analyses

(Electronic copy submitted)

cc: SMS Architects
Attn: Mr. Brandon Dedmon (electronic copy)

Tindall Consulting
Attn: Mr. John Tindall (electronic copy)

Tait Engineering
Attn: Mr. Jake Vandervis (electronic copy)

sw/17-206-02 PKG21-0490 DPH Commercial Component Response Letter (9-22-21)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

REFERENCES

(1) County of Orange Geotechnical Comments, PKG21-0490– Dana Point Harbor Revitalization: Buildings 1 through 12 – Commercial Component, City of Dana Point, California, First Submittal, submittal date June 18, 2021, plan check date July 26, 2021, prepared by Ryan Rose of OC Public Works.

(2) Our "Geotechnical Foundation Investigation Report, Dana Point Harbor Revitalization: Commercial Component, City of Dana Point, California," dated May 27, 2021 (GMU Project 17-206-02).

(3) "Dana Point Harbor Revitalization – Buildings 6-12 and Surface Parking Lot Precise Grading Plans, Dana Point, California 92629," prepared by Tait Engineering, dated May 28, 2021.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A

County of Orange Geotechnical Report Review Comments

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

OC Public Works
Integrity, Accountability, Service, Trust

OC DEVELOPMENT SERVICES

PLAN CHECK COMMENTS	
Permit Application No.	**PKG21-0490**
Plan Check No.	**First Submittal-PKG21-0490**
Plan Check Date	**07-26-2021**
Applicant	**Junior Mazariegos**
Submittal Date	**06-18-2021**

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
1.001	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Geotechnical consultant must review the Precise Grading Plans and applicable details submitted to the County that will be utilized during construction of the project. Provide additional geotechnical recommendations as necessary. The approved precise grading plans and applicable details must be reviewed and signed/stamped by the geotechnical engineer and engineering geologist prior to permit issuance. Note – The currently submitted precise grading plans are incomplete and do not include the recommended Deep Soil Mixing (DSM) and Load Transfer Platform (LTP) ground improvement plans/details. Please coordinate w/project team to ensure the geotechnical ground improvement recommendations/details are included as part of the project precise grading plans.		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the OC Development Services Director. The issuance of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
1.002	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Multiple Building Permits and Plans (Commercial Core Buildings, site walls/retaining walls, etc.) are required for completion of this project. The approved project building and structural plans and applicable details must be reviewed and signed/stamped by the project geotechnical engineer and engineering geologist prior to the applicable permit issuance.		Required	
1.003	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	The approved Ground Improvement Plans (Deep Soil Mixing (DSM) and Load Transfer Platform (LTP) and details (from GRD21-0090) must be included as a reference in the approved project building and structural plan sets.		Required	
1.004	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	The submitted geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) indicates that liquefaction analysis was performed on the SPT exploratory data as a cross-check to the CPT liquefaction analysis and yielded similar results. Please provide a copy of the completed SPT liquefaction analysis as discussed in the submitted report. Provide additional recommendations as necessary.		Required	
1.005	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide additional comment/discussion to confirm the geotechnical recommendations with respects to infiltration design and bioretention areas from the submitted project geotechnical report (GMU, Inc., report dated 5/27/21) have been incorporated into the submitted project plans. Provide additional recommendations as necessary.		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
1.006	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	At a minimum, the geotechnical site drainage recommendations should be in accordance with CBC requirements. Please confirm the report recommendations for site drainage are in accordance with CBC requirements and that the submitted project plans have incorporated your geotechnical recommendations. Provide additional geotechnical site drainage recommendations as necessary.		Required	
1.007	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	The submitted geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) indicates groundwater is anticipated to impact DSM columns and deep utility excavations. Please provide additional comment/discussion to confirm geotechnical recommendations to mitigate groundwater impact on construction based on review of the currently submitted project plans. Also provide comment/discussion to confirm project dewatering operations anticipated means of disposing of pumped water. Provide additional recommendations as necessary.		Required	
1.008	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	The submitted geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) indicates estimated groundwater levels based on high tides were determined and provided in an effort to aid the project in designing underground utilities and give contractors an idea of what conditions may be encountered. Please provide additional comment/discussion on historic high groundwater elevation and high tide groundwater elevation with respects to the project stability analyses included in the		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the OC Development Services Director. Approval of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
			submitted project documents (GMU and AGI). Provide additional data and/or updated analysis as necessary. Provide additional recommendations as necessary.			
1.009	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	The submitted geotechnical report indicates the lateral extents of the subsurface riprap in the vicinity of the proposed buttress DSM columns is uncertain and that areas of rip rap may be encountered during construction. Please provide additional comment/discussion on the potential impact of greater than anticipated rip rap section in this area on the proposed buttress DSM column construction and layout/design, including minimum 4-foot embedment into bedrock. Provide additional recommendations as necessary.		Required	
1.01	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide additional comment/discussion on the existing condition/performance of Buildings 2 through 5 at the subject site. Include confirmation of subsurface conditions/foundation conditions and proposed mitigation (i.e. no required mitigation/deep soil mixing columns/load transfer platform, etc.) for the proposed “minor improvements” as discussed in the submitted project geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) and submitted project plans. Provide additional recommendations as necessary.		Required	
1.011	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide additional comment/discussion to confirm the basis of the geotechnical recommendations for allowable bearing value for the proposed project (i.e. 5,000 psf for Buildings 1 and 6-12 and 2,500 psf		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
			for Buildings 2-5). Specifically, address subsurface conditions, proposed mitigation, existing improvements and proposed improvements at the different locations/different allowable bearing recommendations. Include additional data (e.g. plot plan/map, subsurface data, analysis/evaluation, etc.) as necessary to support your comment/discussion. Provide additional recommendations as necessary.			
1.012	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	The submitted geotechnical report (GMU Geotechnical, Inc., dated 5/27/21) discusses the anticipated ground improvement (i.e. deep soil mixing columns/load transfer platform) construction schedule and grading pad release for construction of the proposed structure(s). In addition to the information discussed in the submitted geotechnical report, the project will also be required to provide final letter/report from geotechnical consultant of record (GMU Geotechnical, Inc.,) prior to pad release for construction to confirm the preliminary recommendation for allowable bearing value (5,000 psf) for the proposed structure(s) remains valid based on the as-graded building pad conditions and DSM/LTP installation.		Required	
1.013	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	The project must update the AGI, Inc., Ground Improvement Plans General Notes and Details Section 3.4 Quality Control & Quality Assurance (Sheet GI-2) must be updated to include Note that written confirmation from project geotechnical consultant of record will be provided upon completion of site grading and deep soil mixing columns/load		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
			transfer platform installation to confirm preliminary recommendation for proposed structure(s) allowable bearing value of 5,000 psf remains valid. Additional recommendations shall be provided as necessary.			
1.014	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide additional comment/discussion on the lateral spread analysis presented in the GMU Geotechnical, Inc., report dated 5/27/21 (Appendix E). Please include confirmation of location of cross-sections analyzed and additional discussion on data/input values utilized for analysis. Include additional data as necessary to support your comment/discussion. Provide additional recommendations as necessary.		Required	
1.015	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide additional comment/discussion to confirm the location of the pseudostatic slope stability analysis cross-sections presented in Appendix B1 of the AGI, Inc., report dated 5/27/21. Provided updated Plates/Details as necessary to indicate the confirmed cross-section locations. Provide additional recommendations as necessary.		Required	
1.016	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide additional comment/discussion on the pseudostatic slope stability analysis presented in Appendix B1 of the AGI, Inc., report dated 5/27/21. Please include additional discussion on data/input values utilized for analysis, including Kh values, etc. Include additional data as necessary to support your comment/discussion. Provide additional recommendations as necessary.		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
1.017	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide additional comment/discussion to confirm the geotechnical recommendation for the anticipated magnitude of vertical settlement (total and differential) that should be taken into account during design and construction of the proposed improvements at the completion of the proposed remedial grading/ground improvement operations. Include the geotechnical recommendation for the horizontal distance over which the anticipated magnitude of remaining vertical differential settlement will occur. Provide additional recommendations as necessary.		Required	
1.018	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Update/revise the geotechnical cross-sections and plan view exhibits from the GMU Geotechnical, Inc., report dated 5/27/21 and the AGI, Inc., Design Submittal Package (or provide new exhibits if preferred) to indicate the location/limit of the recommended Load Transfer Platform (LTP) beneath Buildings 1 and 6/12 at the subject project. Provide additional recommendations as necessary.		Required	
1.019	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide updated/additional geotechnical cross-section(s) as necessary based on your review of the currently submitted project plans and your responses the review comments contained herein. At a minimum, cross-section(s) should extend beyond property lines/limits of permit as necessary to accurately depict site conditions that may impact the proposed grading and construction. Cross-section/exhibit/detail should indicate the proposed site grading/improvements, as-		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services [illegible] These plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
			graded site conditions/existing improvements, anticipated subsurface conditions (e.g. geologic contacts/structure, existing improvement foundations, etc.), and the geotechnical remedial grading/ground improvement, temporary excavation and foundation recommendations from your submitted report(s).			
1.02	Geotechnical Review-PKG21-0490 Ryan Rose	Geotechnical/Geology Check List	Provide updated plot plan/map to indicate the location of any new cross-sections/exhibits/details prepared in response to the review comments contained herein.		Required	
2.001	ADA Review-PKG21-0490 Chi Yang	Miscellaneous Plan Check List	Amphitheater as shown on Sheet 12 must be accessible. Please provide wheelchair spaces with dispersion per Section 11B221 of 2019 CBC.		Required	
2.002	ADA Review-PKG21-0490 Chi Yang	Miscellaneous Plan Check List	Curved walkways shown on Sheet 12 must comply with ramp requirements with handrails if slope exceeds 5%.		Required	
2.003	ADA Review-PKG21-0490 Chi Yang	Miscellaneous Plan Check List	It appears that ramp is required at right side of Sheet 14.		Required	
2.004	ADA Review-PKG21-0490 Chi Yang	Miscellaneous Plan Check List	Sloped walkway shown on right side of Sheet 15 needs to comply with ramp requirements with handrails if slope exceeds 5%.		Required	
2.005	ADA Review-PKG21-0490 Chi Yang	Miscellaneous Plan Check List	It appears that directional accessible signage are required at many locations. Please add these on Architectural site		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the OC Development Services Director. Approval of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
			plans			
2.006	ADA Review-PKG21-0490 Chi Yang	Miscellaneous Plan Check List	As EV spaces are shown, some of these must be accessible and comply with Sections 11B228.3 and 11B-812. Please identify.		Required	
2.007	ADA Review-PKG21-0490 Chi Yang	Miscellaneous Plan Check List	Detectable warning dimensions shown on Sheet 32 must comply with 2010 ADA Standards and 2019 CBC. As these two requirements are not exactly the same, please revise detail to comply with the most restrictive dimensions.		Required	
3.001	Grading Review-PKG21-0490 Jung-Tsun Yean		All Sheets: Show Permit No. GRD21-0090.		Required	/First Submittal/PKG21-0490.grading plan.pdf 1.0
3.002	Grading Review-PKG21-0490 Jung-Tsun Yean		Details Sheets: Add Construction Note Numbers to the detail views.		Required	/First Submittal/PKG21-0490.grading plan.pdf 34.0
3.003	Grading Review-PKG21-0490 Jung-Tsun Yean		Provide site data: project area, disturbed area, square footage of the total impervious and the pervious areas.		Required	/First Submittal/PKG21-0490.grading plan.pdf 1.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.004	Grading Review-PKG21-0490 Jung-Tsun Yean		Indicate Property Lines, Limits of grading/permit, and Limits of off-site grading.		Required	/First Submittal/PKG21-0490.grading plan.pdf 3.0
3.005	Grading Review-PKG21-0490 Jung-Tsun Yean		Indicate Property Lines, Limits of grading/permit, and Limits of off-site grading.		Required	/First Submittal/PKG21-0490.grading plan.pdf 8.0
3.006	Grading Review-PKG21-0490 Jung-Tsun Yean		Check the Grade %		Required	/First Submittal/PKG21-0490.grading plan.pdf 10.0
3.007	Grading Review-PKG21-0490 Jung-Tsun Yean		Show PAD Elevatioin		Required	/First Submittal/PKG21-0490.grading plan.pdf 12.0
3.008	Grading Review-PKG21-0490 Jung-Tsun Yean		Show PAD Elevatioin		Required	/First Submittal/PKG21-0490.grading plan.pdf 12.0
3.009	Grading Review-PKG21-0490 Jung-Tsun Yean		Show PAD Elevatioin		Required	/First Submittal/PKG21-0490.grading plan.pdf 13.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.01	Grading Review-PKG21-0490 Jung-Tsun Yean		Show PAD Elevatioin		Required	/First Submittal/PKG21-0490.grading plan.pdf 14.0
3.011	Grading Review-PKG21-0490 Jung-Tsun Yean		Show PAD Elevatioin		Required	/First Submittal/PKG21-0490.grading plan.pdf 15.0
3.012	Grading Review-PKG21-0490 Jung-Tsun Yean		Typical lot drainage: Minimum 2% for impervious area, 5% for pervious area, and 2% for swale draining away from a building pad (per 2016CBC Sec.1804.4).		Required	/First Submittal/PKG21-0490.grading plan.pdf 16.0
3.013	Grading Review-PKG21-0490 Jung-Tsun Yean		%grade may be reduced if supported by a geotechnical evaluation and approved by Building Official. Geotechnical consultant shall file a Request of Variance.		Required	/First Submittal/PKG21-0490.grading plan.pdf 16.0
3.014	Grading Review-PKG21-0490 Jung-Tsun Yean		Show Pad elevation		Required	/First Submittal/PKG21-0490.grading plan.pdf 16.0
3.015	Grading Review-PKG21-0490 Jung-Tsun Yean		Show Pad elevation		Required	/First Submittal/PKG21-0490.grading plan.pdf 17.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the OC Development Services Director. Approval of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.016	Grading Review-PKG21-0490 Jung-Tsun Yean		Obtain Encroachment Permits for all off-site improvements.		Required	/First Submittal/PKG21-0490.grading plan.pdf 21.0
3.017	Grading Review-PKG21-0490 Jung-Tsun Yean		Show street center line, R/W and width.		Required	/First Submittal/PKG21-0490.grading plan.pdf 21.0
3.018	Grading Review-PKG21-0490 Jung-Tsun Yean		Obtain Encroachment Permits for all off-site improvements.		Required	/First Submittal/PKG21-0490.grading plan.pdf 22.0
3.019	Grading Review-PKG21-0490 Jung-Tsun Yean		Provide Section Views: 1. Show property lines or grading limits. 2. Show horizontal distances / setbacks / slopes / % grade. 3. Show vertical dimensions including the structural heights. 4. Show existing / proposed grade lines and earthwork (cut/fill/over-excavation per soil report).		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0
3.02	Grading Review-PKG21-0490 Jung-Tsun Yean		Show PAD Elevations of all Building Pad.		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.021	Grading Review-PKG21-0490 Jung-Tsun Yean		Show actual grade % per plan.		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0
3.022	Grading Review-PKG21-0490 Jung-Tsun Yean		Typical lot drainage: Minimum 2% for impervious area, 5% for pervious area, and 2% for swale draining away from a building pad (per 2016CBC Sec.1804.4).		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0
3.023	Grading Review-PKG21-0490 Jung-Tsun Yean		%grade may be reduced if supported by a geotechnical evaluation and approved by Building Official. Geotechnical consultant shall file a Request of Variance.		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0
3.024	Grading Review-PKG21-0490 Jung-Tsun Yean		Show the proposed earthwork as indicated in the soil report.		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0
3.025	Grading Review-PKG21-0490 Jung-Tsun Yean		Show actual grade % per plan.		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0
3.026	Grading Review-PKG21-0490 Jung-Tsun Yean		?%		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.027	Grading Review-PKG21-0490 Jung-Tsun Yean		Show PAD Elevation		Required	/First Submittal/PKG21-0490.grading plan.pdf 24.0
3.028	Grading Review-PKG21-0490 Jung-Tsun Yean		Provide a Hydraulic Table listing Pipe size, S, Q, V, Dn, Dc, etc.		Required	/First Submittal/PKG21-0490.grading plan.pdf 26.0
3.029	Grading Review-PKG21-0490 Jung-Tsun Yean		Show HGL on Profile		Required	/First Submittal/PKG21-0490.grading plan.pdf 26.0
3.03	Grading Review-PKG21-0490 Jung-Tsun Yean		Show Q and V on Profile		Required	/First Submittal/PKG21-0490.grading plan.pdf 26.0
3.031	Grading Review-PKG21-0490 Jung-Tsun Yean		The comments on this sheet shall apply to all storm drain plans.		Required	/First Submittal/PKG21-0490.grading plan.pdf 26.0
3.032	Grading Review-PKG21-0490 Jung-Tsun Yean		Provide detail views of all Construction Notes except pipe lines and OC STD plans.		Required	/First Submittal/PKG21-0490.grading plan.pdf 26.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.033	Grading Review-PKG21-0490 Jung-Tsun Yean		Show trench and backfill details of HDPE pipes.		Required	/First Submittal/PKG21-0490.grading plan.pdf 26.0
3.034	Grading Review-PKG21-0490 Jung-Tsun Yean		Show HGL on Profile		Required	/First Submittal/PKG21-0490.grading plan.pdf 27.0
3.035	Grading Review-PKG21-0490 Jung-Tsun Yean		Show Q and V on Profile		Required	/First Submittal/PKG21-0490.grading plan.pdf 27.0
3.036	Grading Review-PKG21-0490 Jung-Tsun Yean		The comments on this sheet shall apply to all storm drain plans.		Required	/First Submittal/PKG21-0490.grading plan.pdf 27.0
3.037	Grading Review-PKG21-0490 Jung-Tsun Yean		Typical: Show max. velocity in each reach on Storm Drain Profile per WSPG.		Required	/First Submittal/PKG21-0490.grading plan.pdf 27.0
3.038	Grading Review-PKG21-0490 Jung-Tsun Yean		Provide a normal flow hydraulic data table listing Line ID, Size, Sta., Q, V, S%,Dn and Dc.		Required	/First Submittal/PKG21-0490.grading plan.pdf 27.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.039	Grading Review-PKG21-0490 Jung-Tsun Yean		All sheets: Stamped and singed by both CE and GE.		Required	/First Submittal/PKG21-0490.grading plan.pdf 1.0
3.04	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Provide Hydraulics Table on Storm Drain Design Sheets		Required	/First Submittal/PKG21-0490.H&H Report.pdf 143.0
3.041	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Provide Complete Information of Appendix E.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 149.0
3.042	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Show HGL on the Storm Drain Profiles		Required	/First Submittal/PKG21-0490.H&H Report.pdf 143.0
3.043	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		The Stationing of WSPG shall be consistent with the stationing of Storm Drain Plan in Grading Plan Set.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 133.0
3.044	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Show HGL on Storm Drain Profiles.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 133.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.045	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Provide Complete Input and Output Data of WSPG.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 133.0
3.046	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Provide Complete Information of Appendix C		Required	/First Submittal/PKG21-0490.H&H Report.pdf 133.0
3.047	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Indicate the drainage facilities to be built under different permits or were built by others.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 14.0
3.048	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Distinguish the drainage facilities to be constructed under GRD21-0090.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 14.0
3.049	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Hydrology Maps: Provide Existing and proposed Hydrology Maps for Permit GRD21-0090 Condition with the following format: a.Show project boundaries, drainage boundaries, grading limits and permit limits. b.Delineate the major drainage boundary for each outlet point, and sub-drainage boundaries for concentration points. c.Show off-site runoff patterns (with arrow heads). d.Show on-site runoff patterns (with arrow		Required	/First Submittal/PKG21-0490.H&H Report.pdf 14.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services [illegible] specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
			heads). e. Show the existing site drainage and how it ties into drainage of surrounding or adjacent areas. f. Show the proposed site drainage and how it ties into drainage of surrounding or adjacent areas. g. Highlight the proposed drain lines, catch basins and outlets in the hydrology map. h. Indicate the pipe sizes and slopes. i. Show design discharge (Q) and drainage area (A) at each outlet point.			
3.05	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Distinguish the facilities to be constructed under this permit and the facilities to be built or were built by others.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 2.0
3.051	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Incomplete submittal. Appendices C, E, and F were missing.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 2.0
3.052	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Provide Complete Information of Appendix F.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 150.0
3.053	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		GRD21-0090		Required	/First Submittal/PKG21-0490.H&H Report.pdf 1.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.054	Hydrology & Hydraulics Review-PKG21-0490 Jung-Tsun Yean		Show permit number on the cover page and the hydrology maps.		Required	/First Submittal/PKG21-0490.H&H Report.pdf 1.0
3.055	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Show Grading Permit No. GRD21-0090		Required	/First Submittal/PKG21-0490.wqmp.pdf 1.0
3.056	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Provide Complete Information		Required	/First Submittal/PKG21-0490.wqmp.pdf 2.0
3.057	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Owner's Certification: Signed and dated by the owner.		Required	/First Submittal/PKG21-0490.wqmp.pdf 2.0
3.058	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Show WQMP ID: WQ21-0033 on the O&M Plan		Required	/First Submittal/PKG21-0490.wqmp.pdf 198.0
3.059	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Provide PA application number and GRD permit number.		Required	/First Submittal/PKG21-0490.wqmp.pdf 5.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.06	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Copy [WQ01] attached to this section.		Required	/First Submittal/PKG21-0490.wqmp.pdf 5.0
3.061	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Pervious/Impervious areas shall be consistent with what shown in the grading plan.		Required	/First Submittal/PKG21-0490.wqmp.pdf 7.0
3.062	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Pervious/Impervious areas shall be consistent with what shown in the grading plan.		Required	/First Submittal/PKG21-0490.wqmp.pdf 11.0
3.063	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Pervious/Impervious areas shall be consistent with what shown in the grading plan.		Required	/First Submittal/PKG21-0490.wqmp.pdf 15.0
3.064	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Describe LID BMP design criteria and provide sizing details of LID BMPs including volumes and flow rates of DCV.		Required	/First Submittal/PKG21-0490.wqmp.pdf 31.0
3.065	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Provide a Summary Table of LID BMPs listing DMA, Area, C value, Q(required), Q(proposed), BMP model number, dimensions and footprints (a simplified table from Attachment E).		Required	/First Submittal/PKG21-0490.wqmp.pdf 31.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.066	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Show WQMP ID: WQ21-0033		Required	/First Submittal/PKG21-0490.wqmp.pdf 1.0
3.067	Water Quality Review-PKG21-0490 Jung-Tsun Yean		WQ21-0033 GRD21-0090.		Required	/First Submittal/PKG21-0490.wqmp.pdf 1.0
3.068	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Those page numbers don't match.		Required	/First Submittal/PKG21-0490.wqmp.pdf 4.0
3.069	Traffic Engineering Review-PKG21-0490 Tony Small		Attach WQMP Site Plan and Maintenance Access Plan to Grading Plan Set.		Required	/First Submittal/PKG21-0490.grading plan.pdf 1.0
3.07	Traffic Engineering Review-PKG21-0490 Tony Small		Sht 6 Add construction note #11 (see plan)		Required	/First Submittal/PKG21-0490.grading plan.pdf 6.0
3.071	Traffic Engineering Review-PKG21-0490 Tony Small		Sht 6 striping not per Accessible stalls (see plan)		Required	/First Submittal/PKG21-0490.grading plan.pdf 6.0

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without the written permission of the OC Development Services Director. The approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

#	Review	Category	Comment	Applicant Response	Status	File Name & Page
3.072	Traffic Engineering Review-PKG21-0490 Tony Small		Construction note #5 to read OCPW Std Plan 1201		Required	/First Submittal/PKG21-0490.grading plan.pdf 12.0
3.073	Water Quality Review-PKG21-0490 Jung-Tsun Yean		Attach WQMP Exhibit and Maintenance Access Plan to the Grading Plan Set.		Required	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B

GMU SPT-Based Liquefaction Analyses

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The issuance of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

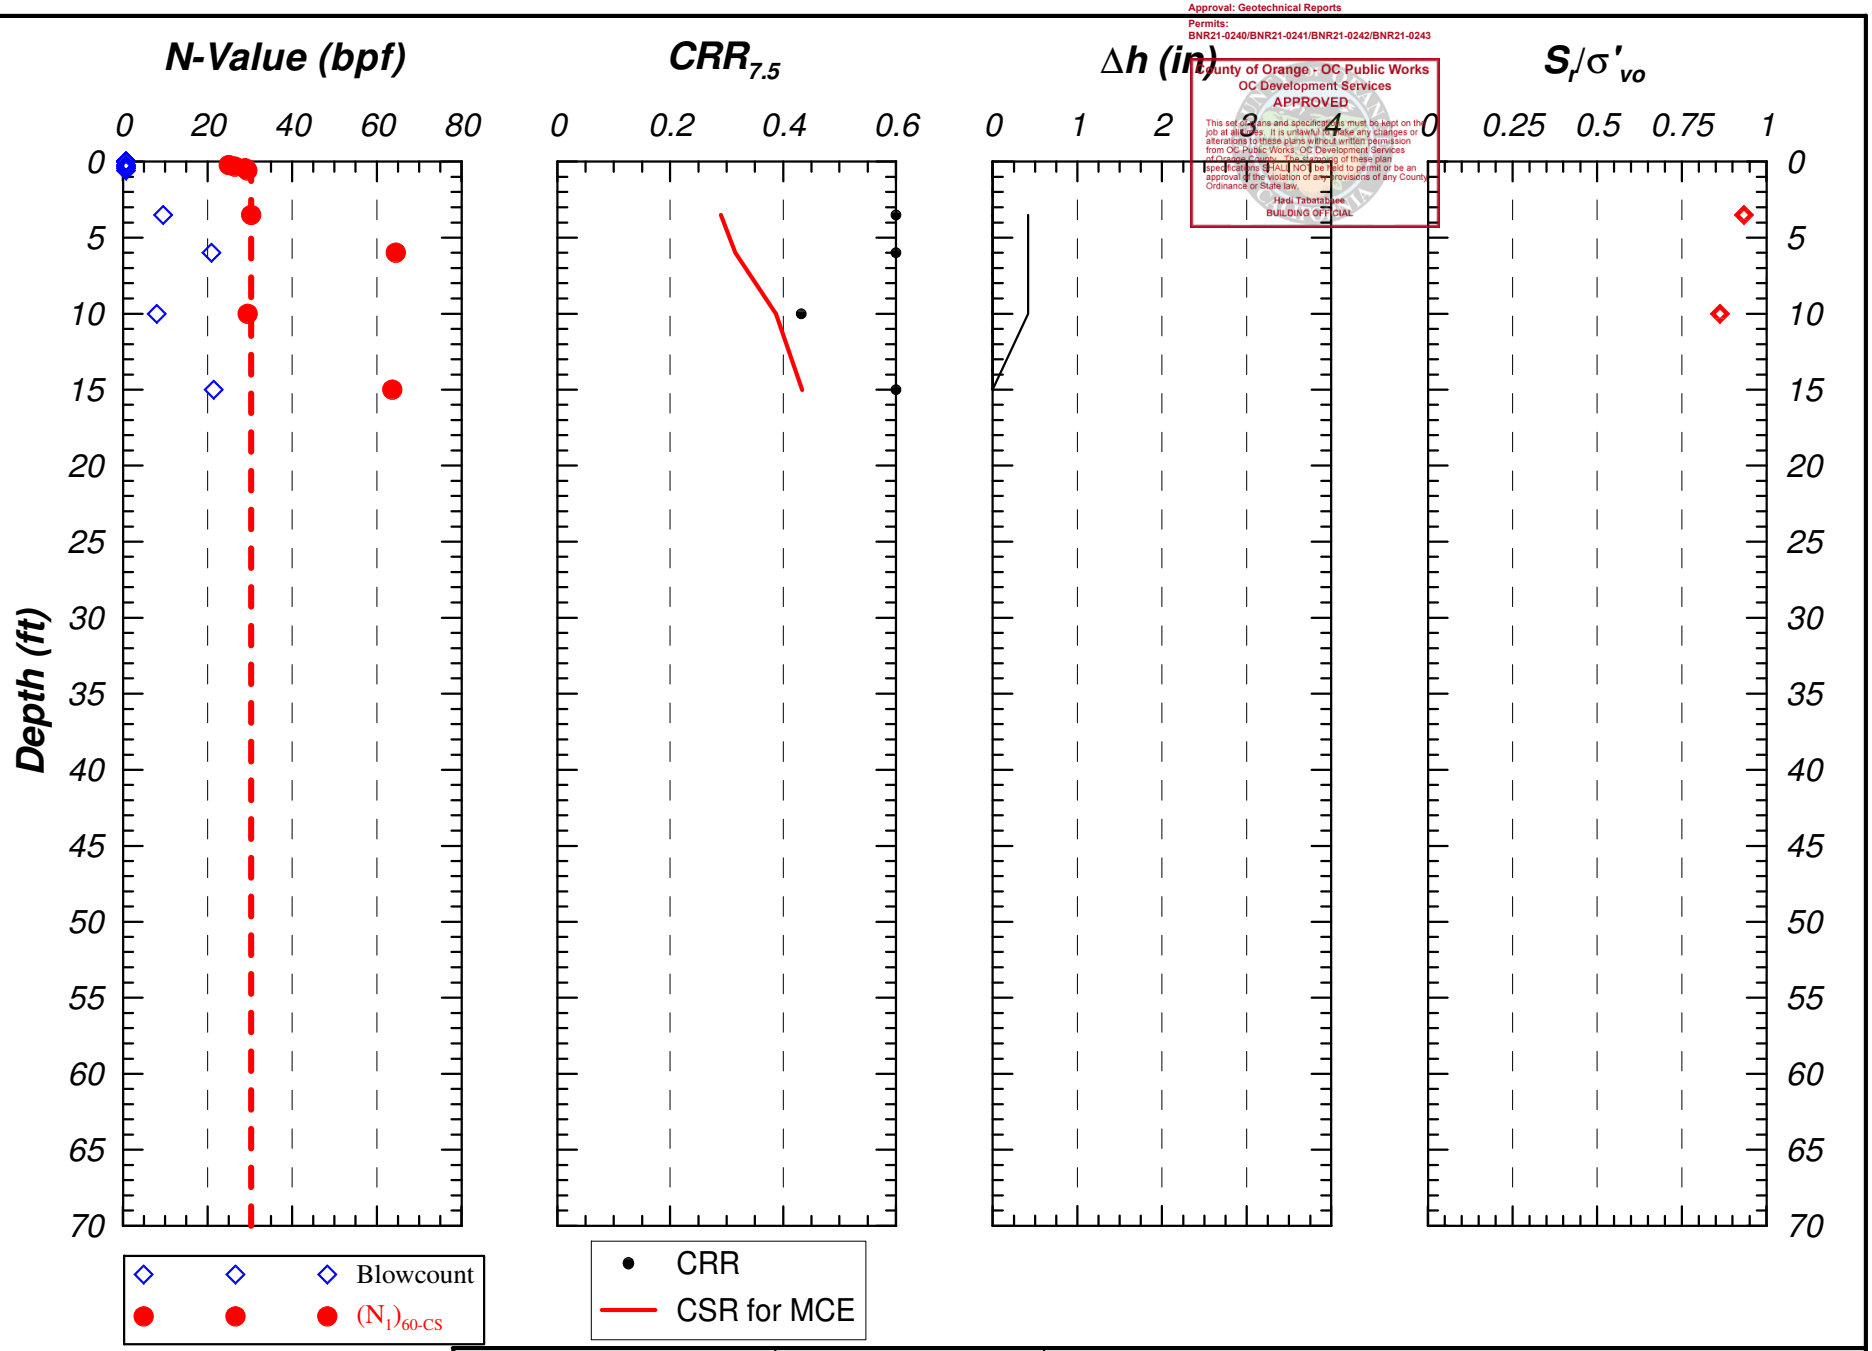

GMU	Project Name Dana Point Harbor Commercial Component Project No. 11-161-00	**Integrated SPT Method for Estimating Subsurface Stratification & Liquefaction** **Drill Hole DH-12**

Figure D-2

DH-1.xls, DH-1.grf

Date: Oct. 2013

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The issuance of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

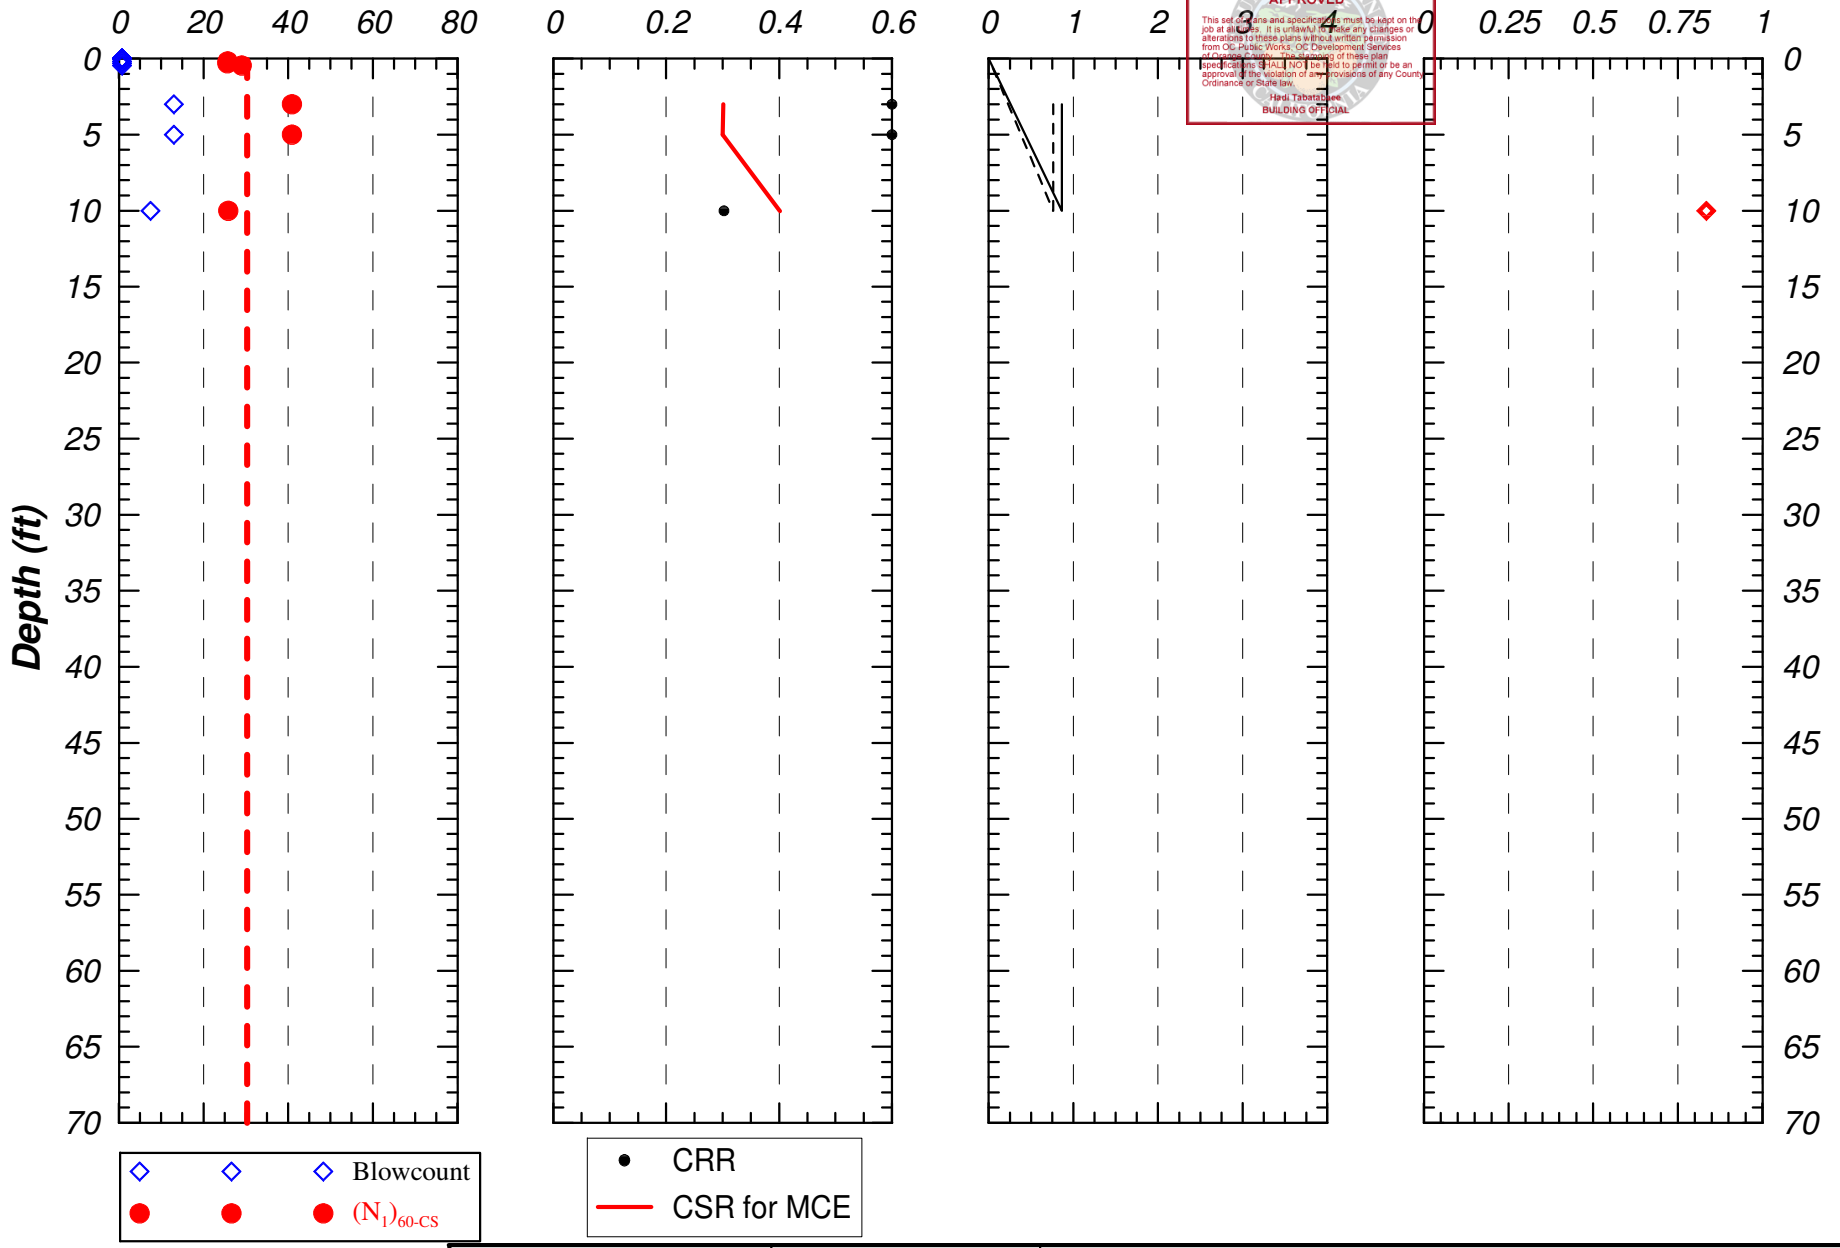

GMU	Project Name Dana Point Harbor Commercial Component Project No. 11-161-00	**Integrated SPT Method for Estimating Subsurface Stratification & Liquefaction** **Drill Hole DH-17**

Figure D-3

DH-1.xls, DH-1.grf

Date: Oct. 2013

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hani Tahtabaee
BUILDING OFFICIAL

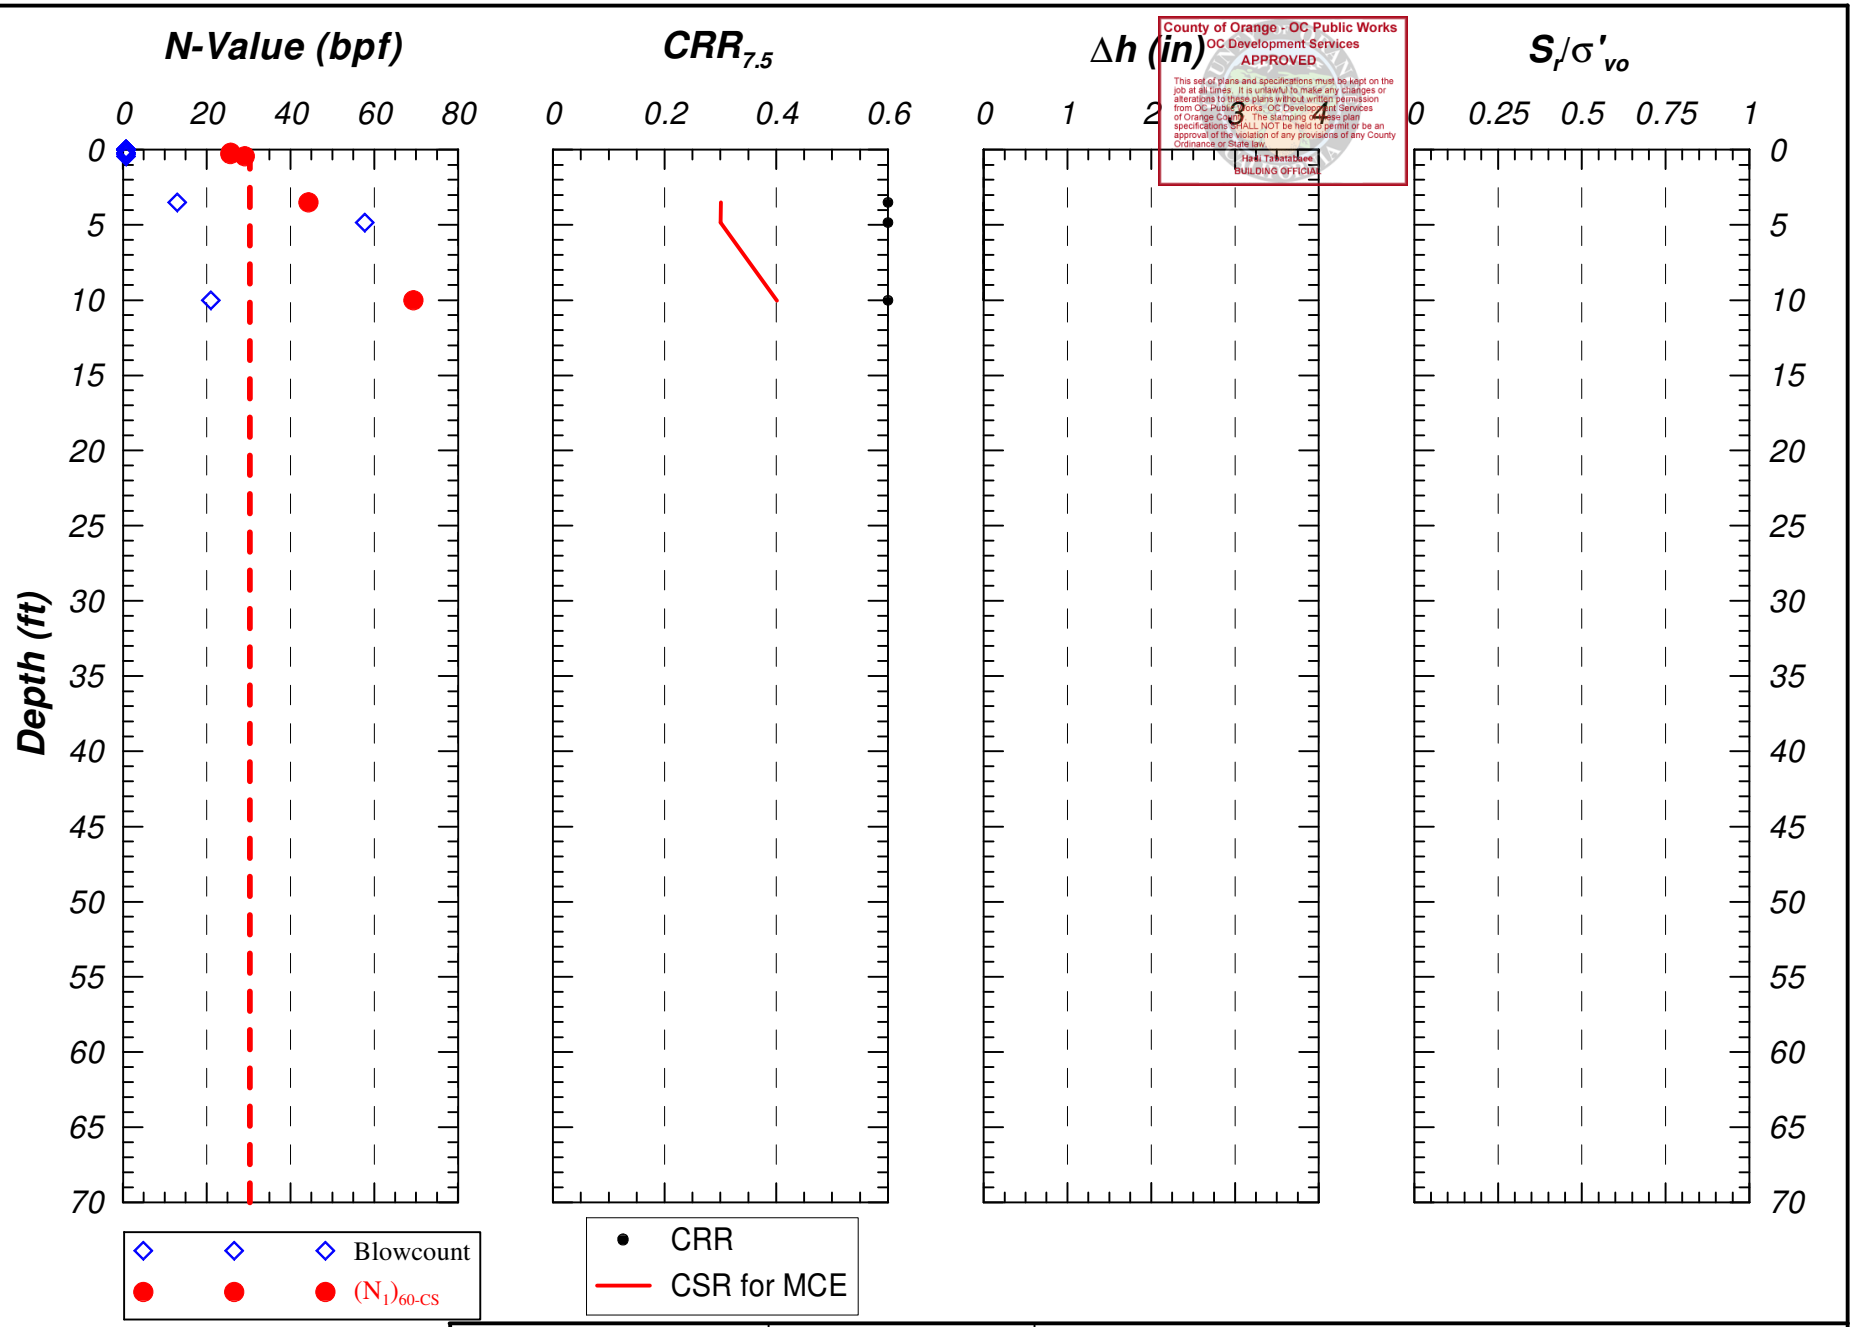

GMU	Project Name Dana Point Harbor Commercial Component Project No. 17-206-02	Integrated SPT Method for Estimating Subsurface Stratification & Liquefaction Drill Hole DH-18 Figure D-4

DH-1.xls, DH-1.grf

Date: Oct. 2013

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations on these plans without written permission from OC Public Works' OC Development Services in Orange, California. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance.
Hadi Tabatabaee
BUILDING OFFICIAL

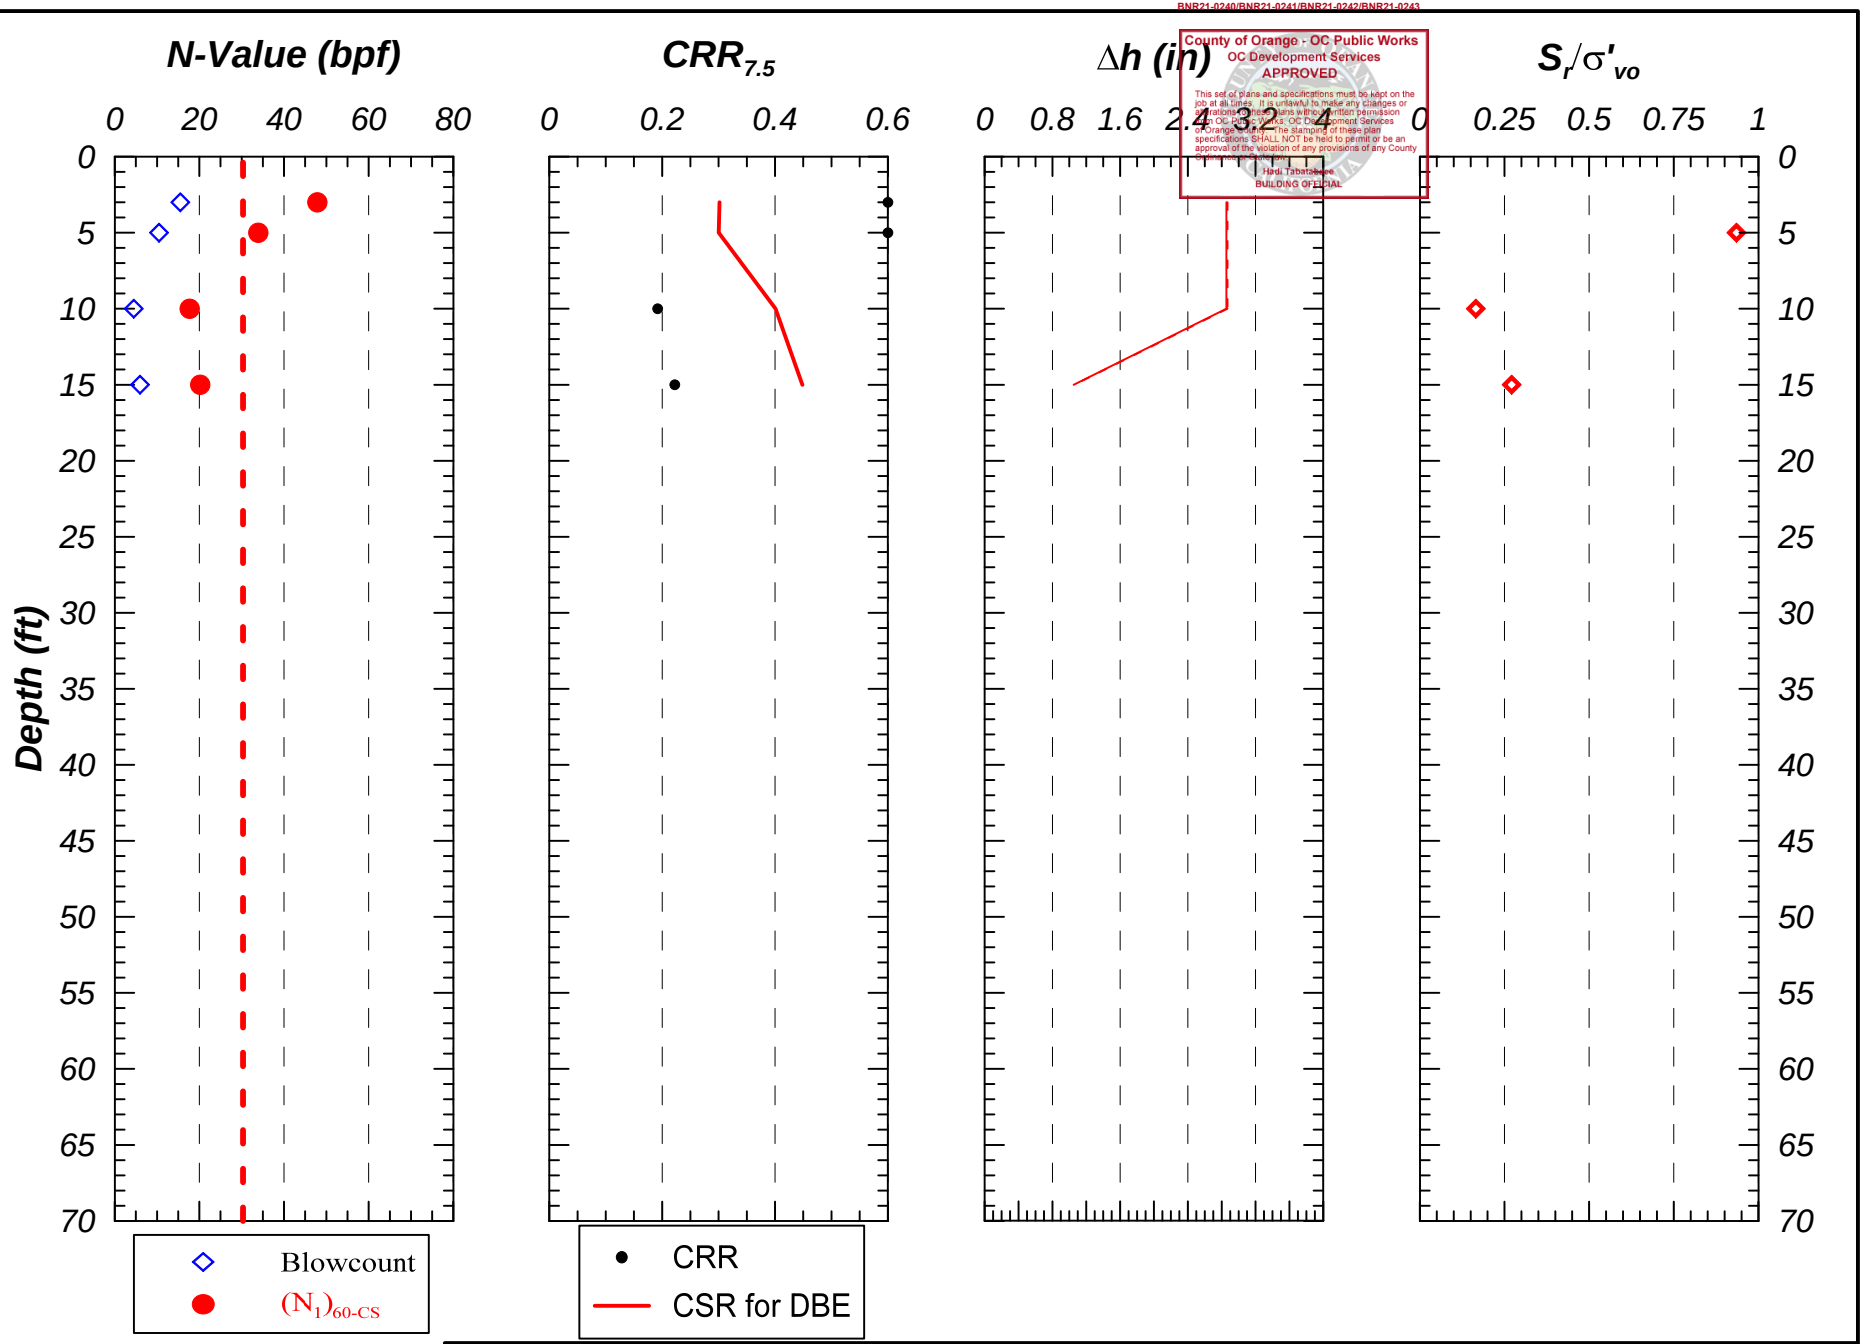

GMU	Project Name Dana Point Harbor Commercial Component Project No. 11-161-00	**Integrated SPT Method for Estimating Subsurface Stratification & Liquefaction** **Drill Hole DH-19**

Figure D-16

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The issuance of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

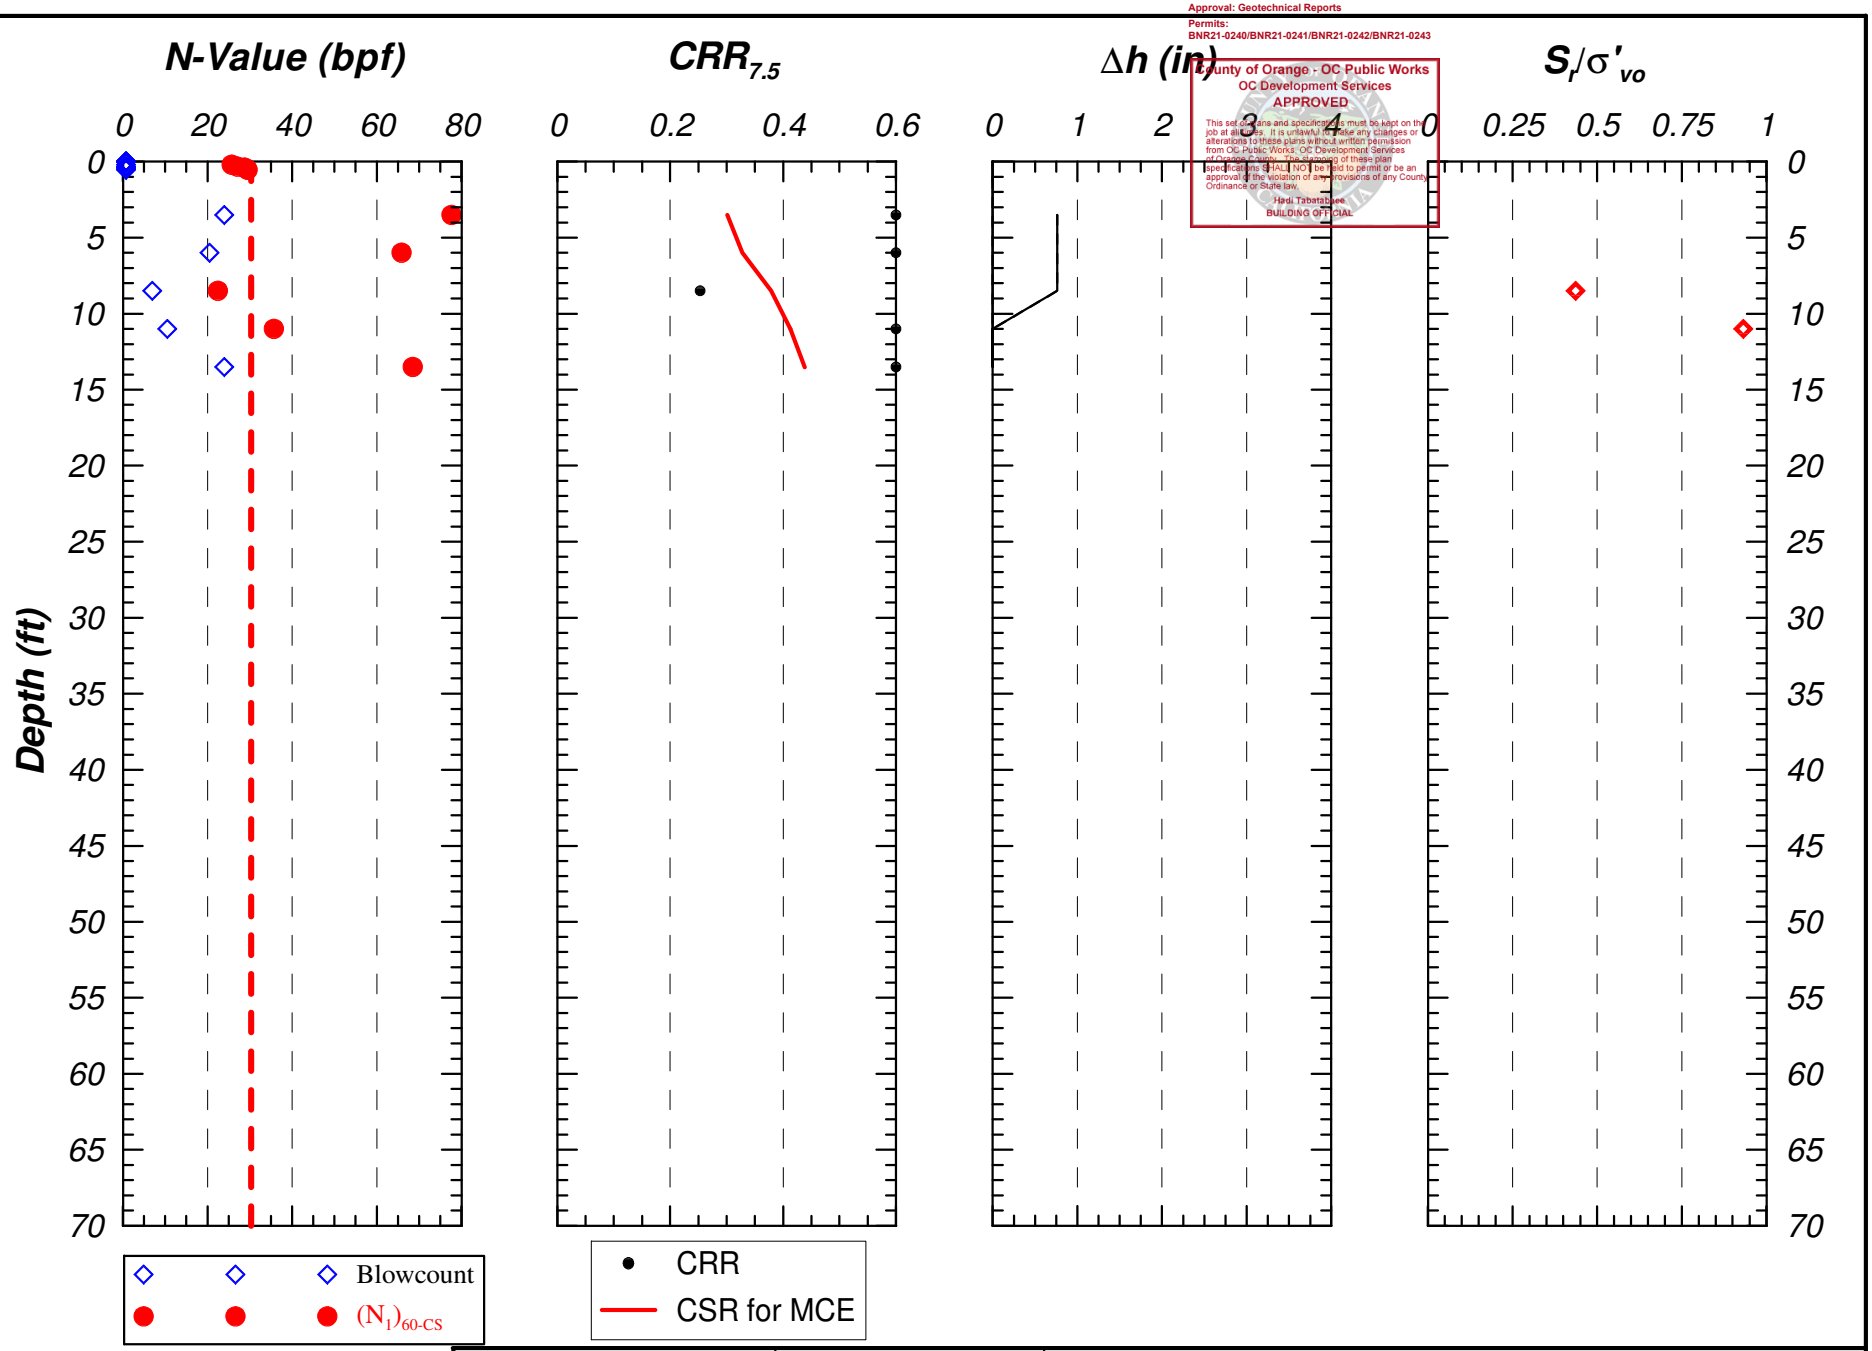

GMU

Project Name
Dana Point Harbor
Commercial Component

Project No.
17-206-02

Integrated SPT Method for Estimating Subsurface Stratification & Liquefaction
Drill Hole DH-26

Figure D-7

DH-1.xls, DH-1.grf

Date: Oct. 2013

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Ford Takatabee
BUILDING OFFICIAL

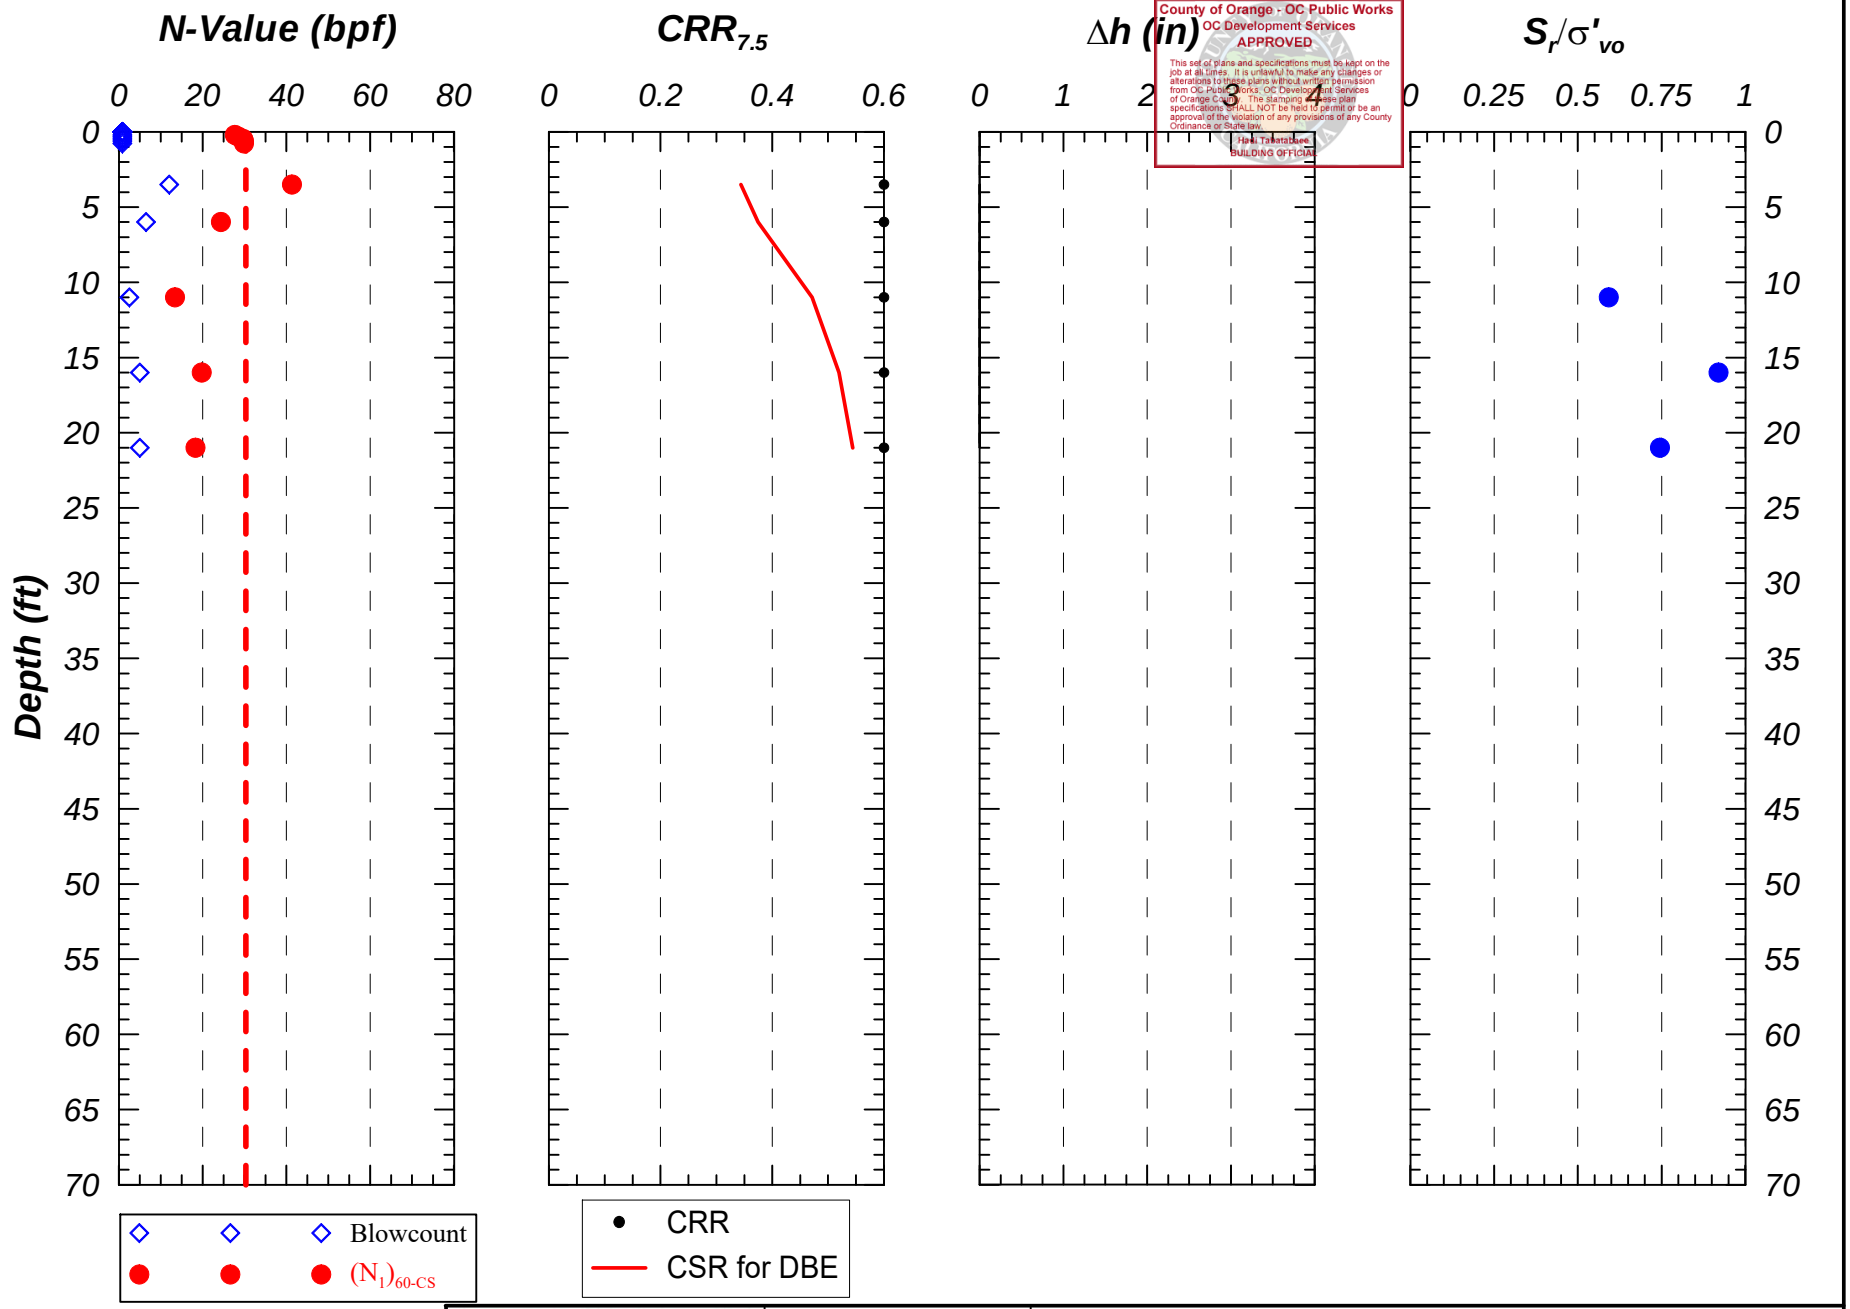

GMU GEOTECHNICAL, INC.	Project Name Dana Point Harbor Commercial Component Project No. 17-206-02	**Integrated SPT Method for Estimating Subsurface Stratification & Liquefaction** **Drill Hole DH-51**

Figure D-12

DH-1.xls, DH-1.grf

Date: Oct. 2013

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C

Quay Wall As-Built Drawings

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to the plans and specifications without approval from OC Public Works' OC Development Services of Orange County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

ORANGE COUNTY HARBOR DISTRICT

DANA POINT HARBOR

DANA POINT, CALIFORNIA

HEAVY CONSTRUCTION

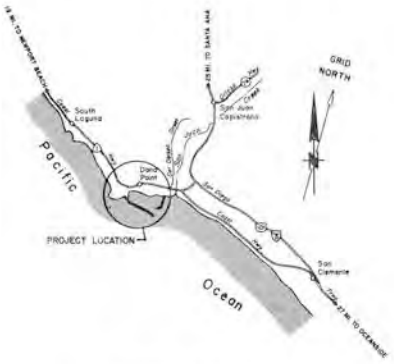

VICINITY MAP

Recommended for Approval by:
Director of Harbors and Beaches

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/673-3900

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
TITLE SHEET & VICINITY MAP

JOB NO. 1-417 APPROVED
DATE 9-24-68
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 1 OF 30
D10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-03443/BWD1-03419/BWD1-03428/BWD1-0343

County of Orange / OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times during construction. It is unlawful to make changes or alterations on same, or to deviate therefrom, except under direction of a public authority acting within the scope of its jurisdiction. The approval of these plans and specifications does not permit the violation of any section of the California Building Code or other ordinance of the jurisdiction.
Issued By: KTOM

INDEX TO DRAWINGS

SHEET NO.	TITLE
1	TITLE SHEET & VICINITY MAP
2	INDEX TO DRAWINGS, LEGEND & GENERAL NOTES
3	INDEX TO FINISHED GRADING PLANS
4	INDEX TO SECTIONS & TRANSITION DETAILS
5	SURVEY CONTROL I
6	SURVEY CONTROL II
7	SURVEY CONTROL III
8	DEWATERING REQUIREMENTS
9	FINISHED GRADING PLAN - AREA IA & AREA IB
10	FINISHED GRADING PLAN - AREA II
11	FINISHED GRADING PLAN - AREA III
12	FINISHED GRADING PLAN - AREA IV
13	FINISHED GRADING PLAN - AREA V
14	FINISHED GRADING PLAN - AREA VI
15	FINISHED GRADING PLAN - AREA VII
16	FINISHED GRADING PLAN - AREA VIII
17	DELETED
17A	FINISHED GRADING PLAN - AREA IX
18	TYPICAL GRADING SECTIONS I
19	TYPICAL GRADING SECTIONS II
20	TYPICAL GRADING SECTIONS III
21	TYPICAL GRADING SECTIONS IV
22	TYPICAL GRADING SECTIONS V
23	TYPICAL REVETMENT SECTIONS
24	REVETMENT TRANSITION DETAILS I
25	REVETMENT TRANSITION DETAILS II
26	REVETMENT TRANSITION DETAILS III
27	BOAT RAMP - PLAN & SECTIONS
28	BOAT RAMP - DETAILS
29	DEL OBISPO STREET - PROFILES I
30	DEL OBISPO STREET - PROFILES II
31	DRAINAGE PLAN
32	DRAINAGE PROFILES I
33	DRAINAGE PROFILES II
34	DRAINAGE DETAILS I
35	DRAINAGE DETAILS II
36	BRIDGE ARCHITECTURAL PLAN, ELEVATION AND MISCELLANEOUS DETAILS
37	BRIDGE HAND RAIL AND MISCELLANEOUS DETAILS
38	CONCRETE REVETTED SLOPE TYPICAL PLAN ELEVATIONS & DETAILS
39	BRIDGE STRUCTURAL PLAN AND SECTION
40	BRIDGE TYPICAL SECTIONS AND BOX GIRDER DETAILS
41	BRIDGE TYPICAL BENT AND APPROACH STRUCTURE DETAILS
42	QUAY WALL DETAILS
43	RETAINING WALLS - PLANS & ELEVATIONS
44	RETAINING WALLS - DETAILS
45	BRIDGE ELECTRICAL PLAN AND ELEVATION
46	BRIDGE ELECTRICAL MISCELLANEOUS DETAILS
	CAPRON PROPERTY GRADING DRAWINGS
47	CAPRON PROPERTY ROUGH GRADING PLAN
48	CAPRON PROPERTY - PRIORITY OF GRADING
49	CAPRON PROPERTY - TYPICAL SECTIONS
50	CAPRON PROPERTY - DRAINAGE DETAILS
51	PIER MODIFICATION STRUCTURAL & MISCELLANEOUS DETAILS

A

LEGEND

- BOUNDARY OF HARBOR DISTRICT PROPERTY
- SURVEY CONTROL LINE
- EXISTING GRADE CONTOUR (-12)
- TOP OF SLOPE
- APPROXIMATE NATURAL FORMATION SURFACE
- FLOW LINE
- (-15) DREDGING DEPTH IN FEET (BY OTHERS)
- WORKING POINT
- (-10) REQUIRED BASIN DEPTH IN FEET (MINIMUM) SEE NOTE 6 HEREON

SECTION OR DETAIL IDENTIFICATION

A / 2 ← SHEET ON WHICH SECTION OR DETAIL IS REFERENCED

DRAWING ON WHICH SECTION OR DETAIL APPEARS

GENERAL NOTES

1. STATIONS INDICATED ON ROAD PLAN AND PROFILE ARE MEASURED ALONG CENTERLINE.
2. THE CONTRACTOR SHALL DEWATER THE CONSTRUCTION AREA AS INDICATED AND SPECIFIED. IT IS IMPERATIVE THAT THE AREA SURROUNDING AND INCLUDING THE BOAT RAMP BE COMPLETED WITHIN 240 DAYS AFTER AWARD OF CONTRACT, AS INDICATED ON SHEET 8 OF THESE DRAWINGS. AT THIS TIME ALL CONSTRUCTION IN THE DESIGNATED AREA SHALL BE COMPLETE AND THE AREA SHALL BE TURNED OVER TO THE ORANGE COUNTY HARBOR DISTRICT, TOGETHER WITH THE SOUTHEASTERLY 50 FEET OF DEL OBISPO STREET FROM PACIFIC COAST HIGHWAY TO STATION 84 + 00
3. THE LOWER LIMITS OF BOTH CONCRETE AND STONE REVETTED SLOPES HAVE BEEN INDICATED HEREIN BASED ON THE INFORMATION AVAILABLE. HOWEVER, BECAUSE THE LIMITS ARE DEPENDENT ON THE DEPTH OF THE NATURAL FORMATION, THE ACTUAL LOCATION OF THE LOWER LIMITS WILL BE FIELD-DETERMINED DURING CONSTRUCTION IN ACCORDANCE WITH THE REQUIREMENTS OF SECTIONS A/23 B/23 C/23 D/23 E/23 C/26 & D/26
4. ALL COORDINATES, GRID LINES, AND BEARINGS SHOWN ON THESE DRAWINGS ARE BASED ON THE HARBOR GRID SYSTEM EXCEPT WHEN OTHERWISE NOTED. THE HARBOR GRID IS BASED UPON THE BEARING OF THE LONGEST SECTION OF THE WEST BREAKWATER, WHICH IS S. 73° 40' E. ON THE LAMBERT SYSTEM, BUT WHICH IS ARBITRARILY TAKEN AS DUE EAST ON THE HARBOR GRID. THE ORIGIN OF THE HARBOR GRID SYSTEM IS SUCH THAT THE NORTHERLY LIMIT OF THE BOAT BASINS IS EXACTLY N. 2000, WHILE THE CENTERLINE OF THE CAUSEWAY AND BRIDGE IS EXACTLY E. 8050. THE ORIGIN OF THE HARBOR GRID, IN TERMS OF LAMBERT COORDINATES, IS N. 474,520.932 AND E. 1,550,090.335.
5. ALL ELEVATIONS HEREIN ARE BASED ON MEAN LOWER LOW WATER (MLLW) DATUM. PROJECT BENCH MARK IS CALIFORNIA STATE LAND COMMISSION MONUMENT B-4061, ELEVATION 15.75, LOCATED ON THE SOUTHWESTERLY SIDE OF THE RAMP ONTO THE EXISTING DANA POINT PIER.
6. THE TERMS "REQUIRED BASIN DEPTH" AND "EXCAVATE TO - 8" (OR - 10 OR - 12), MEAN THAT THE MINIMUM ACCEPTABLE DEPTH IS THE ELEVATION SHOWN. DEEPER AREAS SHALL REMAIN AT NATURAL DEPTH. PINNACLES IN DEEPER AREAS, WHICH PROJECT ABOVE THE REQUIRED MINIMUM, SHALL BE REMOVED TO THE INDICATED DEPTH. OVER EXCAVATION OF NOT MORE THAN ONE FOOT IN WATER AREAS WILL BE PERMITTED.
7. IN AREAS WHERE CONCRETE OR OTHER CONSTRUCTION IS TO BE PLACED ON CUT SURFACES OF NATURAL FORMATION, OVER EXCAVATED AREAS SHALL BE FILLED WITH THE MATERIAL OF WHICH THE OVERLYING CONSTRUCTION IS COMPOSED.
8. UNLESS OTHERWISE INDICATED, THE NORTH ARROWS SHOWN HEREIN REFER TO HARBOR GRID NORTH

ASBUILT

REV.	DESCRIPTION	DATE
A	ADDED 17A & 51, DELETED 17	9-19-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
INDEX TO DRAWINGS
LEGEND & GENERAL NOTES

JOB NO. 1-417
DATE 9-24-68
APPROVED:
DATE OCTOBER, 1968
SCALE NONE
SHEET 2 OF 51
D10.5-1

Building&Safety - Ryan Ross 1/16/2025
Agency: Geotechnical Reports
Job Number
EAGLE-E3AEB8R01-E3A1B8R01-E3A2B8R01-E3A3
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of these plans and specifications must be done only for the project and the purposes noted in this approval. The County of Orange does not convey any rights by issuance of these plans and specifications and assumes no responsibility for errors or omissions contained therein. The approval of these plans and specifications does not permit the violation of any section of the California Building Code or County ordinances.
Director, OC Development Services
Building and Safety

N 4,300

PACIFIC COAST HIGHWAY

E 10,600

AREA IA

E 11,200

STREET

9

DOHENY BEACH STATE PARK

N

GRADING FOR THIS AREA SHOWN ON SHEETS 47 – 50 INCL.

N 3,500

AREA II

N 2,900

E 8,500

AREA IB

9

10

N 2,650

DEL OBISPO

LANTERN

RUBY

DEL PRADO

LANTERN

LANTERN

AVENUE

LANTERN

VIOLET

GOLDEN

AMBER

SANTA CLARA

N 2,500

N 2,350

BLUE

-8

BOAT RAMP

-10

AREA III

AREA IX

BEACH

EXISTING PIER

E 5,580

AREA VII

AREA V

-8

-10

-12

SHEET NUMBER

11

N 1,650

EAST BREAKWATER

WEST BASIN

N 1,500

15

EAST BASIN

13

-10

-12

-15

-10

-10

-12

E 6,200

AREA VIII

E 7,800

CAUSE WAY

AREA VI

E 9,400

AREA IV

E 11,000

HARBOR COORDINATES

N 1,000

N 800

17-A

CONC. CHANNEL MARKERS, (TYP.) E 73

ASBUILT

SEP 22 1970

16

N 650

14

12

MAIN CHANNEL

WEST BREAKWATER

PLAN A 3

1" = 200'

REV.	DESCRIPTION	DATE
A	REVISED AREA IX	9-19-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

INDEX TO FINISHED GRADING PLANS

JOB NO. 1-417
DATE 9-24-68
APPROVED:
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 3 OF 51
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
RMST-ESMSRMST-ESMSRMST-ESMSRMST-ESMS
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times during construction. It is unlawful to make changes or alterations on same, or to deviate therefrom without approval of the building official. The approval of these plans and specifications does not permit the violation of any section of the California Building Code or other ordinance of the jurisdiction.
Issued By: [illegible]
Building Official

PACIFIC COAST HIGHWAY

DOHENY BEACH STATE PARK

GRADING FOR THIS AREA SHOWN ON SHEETS 47 - 50 INCL.

DEL PRADO
LANTERN
RUBY
LANTERN
AMBER
LANTERN
VIOLET
LANTERN
GOLDEN
AVENUE
SANTA CLARA
BLUE
DEL OBISPO
STREET

BEACH
EXISTING PIER
CONCRETE REVETMENT SEE SHEET 38
CAUSEWAY
SEE SHEETS 36,37,39,40,41,45 & 46 FOR BRIDGE DETAILS
WEST BASIN
EAST BASIN
TRANSITION (A 26) (B 23) TO (C 24)
TRANSITION (A 24) (A 23) TO (B 23)
TRANSITION (A 25) (B 23) TO (C 23)
TRANSITION (B 25) (B 23) TO (C 23) (OPPOSITE HAND)
TRANSITION (A 25) (B 23) TO (C 23) (OPPOSITE HAND)
TRANSITION (C 24) (B 23) TO (D 23)
TRANSITION (D 24) (D 23) TO (E 23)
TRANSITION (B 24) (D 23) TO (E 23)
BOAT RAMP
SEE SHEETS 27 & 28 FOR DETAILS OF RAMP
EAST BREAKWATER
WEST BREAKWATER
MAIN CHANNEL

PLAN (A 4)
1" = 200'

AS BUILT

REV	DESCRIPTION	DATE
A	ADDED FILL, WEST END	9-19-69

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213 / 629-3162

JOB NO. 1-417
DATE 9-24-68
APPROVED: Rodney V. Bundick

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
INDEX TO SECTIONS & TRANSITION DETAILS

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 4 OF 61

D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-03483/BWD1-03418/BWD1-03428/BWD1-0343

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. The approval of alternate specifications does not relieve applicant of responsibility for compliance with all applicable codes, laws and regulations. The approval of alternate specifications does not prevent the Building Official from requiring corrections of errors in the plans and specifications. The Building Official is not responsible for any omissions or errors contained in the plans and specifications.
Issued By: Ryan Rose
Building & Safety

E 8,000 E 8,500 E 9,000 E 9,500 E 10,000 E 10,500 E 11,000

N 4,000 N 3,500 N 3,000 N 2,500

CURVE DATA					
	Δ	R	T	L	REMARKS
Δ_1	44°46'14"	1000'	411.87'	781.39'	℄ DEL OBISPO STREET
Δ_2	04°16'35"	1000'	37.34'	74.64'	"
Δ_3	22°14'09"	500'	98.26'	194.04'	"
Δ_4	51°13'42"	700'	335.60'	625.87'	℄ OUTBOUND RDWY
Δ_5	06°27'28"	700'	39.49'	78.90'	"

℄ PACIFIC COAST HWY.
S 87°32'34" E

100+00

98+24.17
P.T.

N 26°35'40" E
175.83'

N 4,114.84
E 11,060.91

N 4,017.62
E 10,982.19

P/L 1

N 3707.61
E 10878.65

N 27°16'12" E

N 3499.81
E 10771.53

50' 50'

233.79'

92+32.24
E.C.

P.R.C.

24.6'

℄ DEL OBISPO STA.
92+67.39 @ BOUNDARY

N 3451.35
E 10865.53

105.75'
Δ_5

92+68 ℄ DEL OBISPO STREET
= 9+11.88 E.C. OUTBOUND RDWY.

81+32.98

N 3365.94
E 10861.27

Δ_1 (℄ DEL OBISPO ST.)
Δ_4 (℄ OUTBOUND RDWY.)

N 3428.28
E 10866.80

B.C.
84+50.85

2+01.11

℄ DEL OBISPO STREET

℄ OUTBOUND ROADWAY

N 20°43'44" E

N 3,123.65
E 10,590.40

N 3,125.38
E 10,522.26

LAMBERT COORD.
N 474,292.98
E 1,561,220.56

N 2,911.35
E 10,745.13

N 2908.51
E 10815.43

LAMBERT COORD.
~~N 474,265~~ 474,270.49
~~E 1,561,298~~ 1,561,287.22

℄ EAST BREAKWATER

1450'
N 25°33' 51" E

N 2,766.40
E 9,414.78 P.I.

N 72°02'25" E

BOUNDARY OF HARBOR DISTRICT PROPERTY

℄ DEL OBISPO STREET
N 61°45'51" E

Δ_2

77+35.84
E.C.

76+61.20
B.C.

24.5'
83+90 ℄ DEL OBISPO STREET
= 0+00 ℄ OUTBOUND RDWY.

CONTROL LINE & FACE OF QUAY WALL @ +5.0

N 2,520
E 10,120

380'
DUE EAST

N 2,520
E 10,500

HARBOR 220'

BOAT RAMP

51°20'00" E
410.00'

Δ_3

64+71.84
E.C.

62+77.80
B.C.

62+37.70
℄ CAUSEWAY

DUE EAST

N 2,265.01
E 8,188.36

PLAN (A/5)
1"=100'

SEE SHEET 6

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

SURVEY CONTROL I

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

JOB NO. 1-417
DATE 9-24-68
APPROVED:

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 5 OF 50

D10.5-1

Building&Safety- Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-03408/BWD21-03410/BWD21-03428/BWD21-0343
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be kept on the jobsite. Any deviations from approved plans must be described in writing and approved by inspector. Approval of alternate specifications does not relieve applicant of responsibility for compliance with applicable codes, ordinances, and requirements. The permittee is responsible for all construction at the site and for providing safe access and working conditions for inspection.
Neal Tomastovich
Building Services Manager

SEE SHEET 5

E 8,000 E 8,500 E 9,000 E 9,500 E 10,000 E 10,500 E 11,000

N 2,500 N 2,000 N 1,500 N 1,000

B.C. E.C. Δ_3 E 8,030 40.10' DUE EAST 138.36' N 2,265.01 E 8,188.36 265.01' DUE NORTH

1226.69' 1324.95' ℄ DEL OBISPO STREET N 67°45'51"E

CONTROL LINE & FACE OF QUAY WALL @ +5.0 380' DUE EAST N 2,520 E 10,500

320' DUE NORTH E 10,120 180' DUE EAST N 2,200

400' S 16°20'00"E 406.33' S 12°20'E 1460'

N 2,112.25 E 10,530.92 85' S 73°40'00"W N 2,136.16 E 10,612.49

166.37' S 16°20'00"E 373.64 ~~373.94~~ N 87°35'36"E 347.89 TO WALL END N 1,952.60 E 10,577.71 N 1,968.30 E 10,951.32

484.67' S 12°20'E

SEE SHEET 7

~~1900'~~ 1899.76' DUE EAST N 2000 CONTROL LINE & FACE OF QUAY WALL @ +5.0

1400' 50' 50' 425' DUE NORTH 425' DUE NORTH

400' DUE NORTH 120' DUE EAST N 2,000 E 10,300 400' DUE NORTH

100' DUE EAST N 1,575 E 8,000 150' E 8,100

180' DUE EAST N 1,425 423' DUE NORTH ℄ CAUSEWAY & BRIDGE 423' DUE NORTH

180' DUE EAST N 1,600 E 10,000 E 10,180

CONTROL LINE & FACE OF QUAY WALL @ +5.0

~~1850'~~ 1849.76' DUE EAST N 1,002 1250' 50' 50' 250' DUE NORTH

1097.93' 1655.03' 3100' DUE EAST N 752

B.C. E.C. Δ_7 916.42' N 45°00'00"E 469.67'

CONTROL LINE & TOP OF REVETTED SLOPE N 752.00 E 9,850.00

N 1,402 E 10,110 N 1,400.00 E 10,498.00 388' 86.22' 200' ~~198'~~ DUE NORTH E.C. Δ_6 B.C.

N 1,202 E 9,950 160' DUE EAST 200' DUE NORTH

800' S 41°40'W ℄ EAST BREAKWATER

294.52

CURVE DATA					
	Δ	R	T	L	REMARKS
Δ_3	22°14'09"	500'	98.26'	194.04'	℄ DEL OBISPO ST.
Δ_6	135°00'00"	125'	301.78'	~~147.26~~	CONTROL LINE
Δ_7	45°00'00"	350'	144.97'	274.89'	" "

N 1,494.82 E 11,054.84

N 472,846.51 E 1,501,119.41 LAMBERT COORD.

LAMBERT COORD. N 472,422.57 E 1,500,440.97

N 897.19 E 10,523.01

PLAN A 6 1" = 100'

AS BUILT SEP 2 0 1970

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
SURVEY CONTROL II

JOB NO. 1-417 DATE 9-24-68 APPROVED: Rodney P. Kendis
DATE OCTOBER, 1968 SCALE AS SHOWN
SHEET 6 OF 50
D10.5-1

Building&Safety- Ryan Rose 1/15/2025
Approval: Geotechnical Reports
Not Required
EWO21-0240/BWO1-0241/BWO2-0242/BWO3-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. The approval of alternate specifications does not relieve applicant of responsibility for compliance with all applicable codes, laws, and regulations. The approval of alternate specifications does not assume responsibility for the accuracy or adequacy of the design, dimensions, or calculations which shall be the responsibility of the applicant or his engineer.
Neal Tomastovich
Building Official

N 2,500 · E 5,500 · E 6,000 · E 6,500 · E 7,000 · E 7,500 · E 8,000 · E 8,500 · N 2,500

N 2,000 · N 1,500 · N 1,000

N 2,025.00
E 6,080.46

321.18'
DUE EAST

N 2025.00
E 6,401.64

CONTROL LINE

199.16'
N 67°52'40" E

N 1,950.00
E 5,895.96

404.50 TO WALL END
428.1' N 23°23'52" E

PROJECT BENCH MARK CSLC
B-4061 ELEV. 15.75 MLLW.

N 1581.33
E 5720.91

N 64°36'04" W
~~224.55~~
207.36

1492.38
N. ~~1423.33~~
E. ~~5906.22~~
5908.22

CONTROL LINE
& FACE OF
QUAY WALL

DUE NORTH
~~236.00~~
241.14

2'

N 473,866.64
E 1,555,797.20

N 977.03
E 5,660.54

N. ~~1057.25~~ 1057.25
E. ~~5906.22~~ 5908.22

181.20 TO WALL END

STA. 0+00
~~160.00~~
165.00

S 23°40' E
~~1599.01~~
1599.01

EAST BREAKWATER

FOR CONTINUATION
SEE INSERT HEREON
N 885.57
E 5797.87

N 2,000 ~~1400±~~ 1400.15' DUE EAST

380' DUE NORTH

N 2025.00
E 6,401.64

N 30°00'00" W
280.72'

200' DUE NORTH

80.58
~~80~~
N1,620
DUE EAST

E 6,520

CONTROL LINE & FACE OF QUAY WALL @ +5.0

50' · 50'

425' DUE NORTH · 425' DUE NORTH

1899.76' ~~1900~~ DUE EAST

100'
DUE EAST
N1,575

E 8,050
B.C. Δ3 E.C.
1226.69'
G1 12°45'51" E
1324.95'
℄ DEL OBISPO STREET
40.10'
138.36'
N 2,265.01
E 8,188.36
2645.01' DUE NORTH

E 8,000
150'
100'
DUE EAST
N1,425

423' DUE NORTH · 423' DUE NORTH
℄ CAUSEWAY & BRIDGE

CONTROL LINE & FACE OF QUAY WALL @ +50

N1,002 ~~1250±~~ 1250.15 DUE EAST

N1,002 ~~1900±~~ 1899.76' DUE EAST

250' DUE NORTH

1655.03'

SEE SHEET 6

CURVE DATA

	Δ	R	T	L	REMARKS
Δ3	22°42'09"	500'	98.26'	194.04'	℄ DEL OBISPO ST.
Δ8	120°00'00"	125'	216.51'	~~130.90~~	CONTROL LINE
Δ9	60°00'00"	350'	202.07'	366.52'	" "

261.80'

N1,400.00
E 6,375.88

224.12'

E 6,600

N1,400

7.61'

B.C.

Δ8

E.C.

48' DUE NORTH

E 6,750

150' DUE EAST

N1,202

200' DUE NORTH

1048.25'

329.67'
S 30°00'00" E

B.C.

Δ9

E.C.

N1,002 ~~1250±~~ 1250.15 DUE EAST

N 752

1097.93' DUE EAST

3100'

N 752.00
E 6,750.00

CONTROL LINE & TOP OF REVETTED SLOPE

AS BUILT
SEP 3 0 1970

LAMBERT COORDINATES (TYPICAL)

N 472,908.76 E 1,550,600.36	N 472,022.91 E 1,559,629.23	N 471,529.23 E 1,560,606.23
N 283.68 E 6,700.67	N 283.69 E 9,850.66	N 86.38 E 10,932.83

1250' S 56°20' E

1100' S 79°40' E

℄ WEST BREAKWATER
3150'
DUE EAST

N 977.03
E 5,660.54

N 473,866.64
E 1,555,797.20

COORDINATES OF WEST BREAKWATER
NO SCALE

While the information shown is believed to be accurate the Harbors, Beaches and Parks District will not be responsible for omissions, errors or inaccuracies.

PLAN (A/7)
1" = 100'

REV.	DESCRIPTION	DATE
A	ADDED FILL WEST END	9-19-69

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213 / 629-3182

JOB NO. I-417
DATE 9-24-68
APPROVED: Rodney K. Koebig

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
SURVEY CONTROL III

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 7 OF 51

D10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services of Orange County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

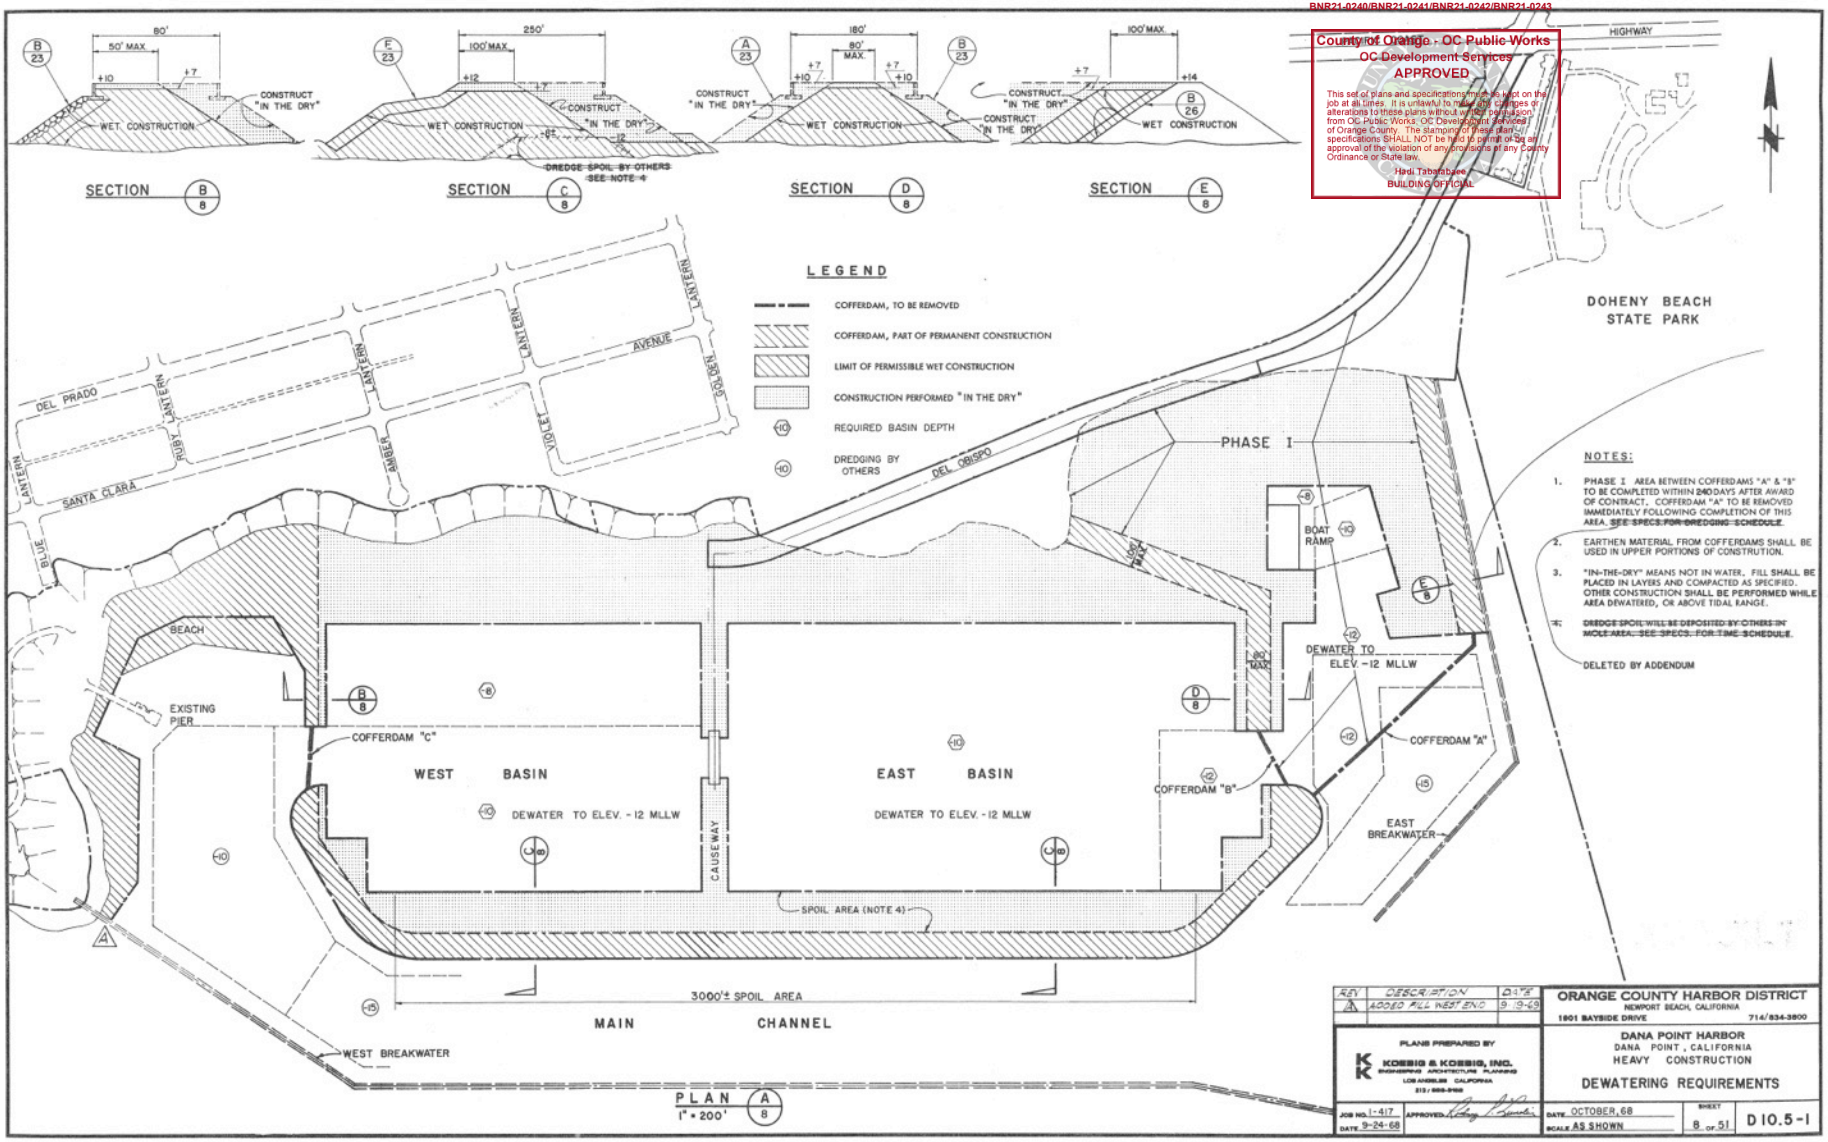

NOTES:

1. PHASE I AREA BETWEEN COFFERDAMS "A" & "B" TO BE COMPLETED WITHIN 240 DAYS AFTER AWARD OF CONTRACT. COFFERDAM "A" TO BE REMOVED IMMEDIATELY FOLLOWING COMPLETION OF THIS AREA. ~~SEE SPECS. FOR DREDGING SCHEDULE.~~
2. EARTHEN MATERIAL FROM COFFERDAMS SHALL BE USED IN UPPER PORTIONS OF CONSTRUTION.
3. "IN-THE-DRY" MEANS NOT IN WATER. FILL SHALL BE PLACED IN LAYERS AND COMPACTED AS SPECIFIED. OTHER CONSTRUCTION SHALL BE PERFORMED WHILE AREA DEWATERED, OR ABOVE TIDAL RANGE.
4. ~~DREDGE SPOIL WILL BE DEPOSITED BY OTHERS IN MOLE AREA. SEE SPECS. FOR TIME SCHEDULE.~~

DELETED BY ADDENDUM

REV	DESCRIPTION	DATE
1	ADDED ALL WEST END	9-9-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/ 688-9160

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

DEWATERING REQUIREMENTS

JOB NO. 1-417
DATE 9-24-68
APPROVED
DATE OCTOBER, 68
SCALE AS SHOWN
SHEET 8 OF 51
D 10.5-1

Building&Safety - Ryan Ross 1/16/2025
Approval: Geotechnical Reports
Permit #
BWD21-03483BWD1-03418BWD1-03428BWD1-0343

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve contractor of responsibility for compliance with requirements of the Building Code, Title 24, C.C.R. The contractor is responsible for the safety of persons and property at the job site. Approval of alternate specifications does not imply responsibility of the Building Official or County for job site conditions.
Neal Tomastovich
Building Official

N 2,900

E 8,500

E 9,400

E 10,600

E 11,200

N 4,300

N 3,500

N 2,500

N 2,650

FOR GRADING IN THIS AREA, SEE SHTS. 47-50 INCL.

80

100

120

20

40

60

80

10

20

STREET

75+00

(SEE PROFILES SHTS. 29 & 30)

BOUNDARY OF HARBOR DISTRICT PROPERTY

50' OBISPO

DEL

70+00

+24.4

+25.2

+21.2

150'

24.5

19.5

18.5

24.0

22.0

4'

30'

AREA IB

MATCH LINE SEE SHEETS 10 & 11

℄ MATCH 76+61.80 B.C. ℄ DEL OBISPO ST.

MATCH LINE - SEE SHEET 13

PLAN 1" = 50' (A/9)

PACIFIC COAST HWY.

50'

50'

100+00

EDGE OF EXIST. A.C. JOIN

EXIST. BLDG.

FOR GRADING IN THIS AREA, SEE SHTS. 47-50 INCL.

OBISPO

(SEE PROFILES SHTS. 29 & 30)

HARBOR DISTRICT PROPERTY

45+00

50'

50'

BOUNDARY OF HARBOR DISTRICT PROPERTY

DEL

BOUNDARY

10

℄ STORM DRAIN LINE "A" PLAN (6/34)

DAYLIGHT LINE

92+65 DEL OBISPO ST. ± 9+11.88 E.C. E OUTBOUND RDWY.

92+32.24 E.C.

1%

24.5

Δ5 (SEE SHT. 10)

AREA IA

MATCH LINE - SEE SHEET 10

PLAN 1" = 50' (B/9)

REV.	DESCRIPTION	DATE
A	CHANGED GRADES	10-27-69

PLANS PREPARED BY

KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

JOB NO. 1-417
DATE 9-24-68
APPROVED:

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

FINISHED GRADING PLAN-AREA IA & AREA IB

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 9 OF 58

D10.5-1

Bolding&Bolding® Ryan Rossi 7/14/2025
Approval: Geotechnical Reports
Approved
EMCO-EGMSMGO-EGHSMGO-EGHSMGO-EGH

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

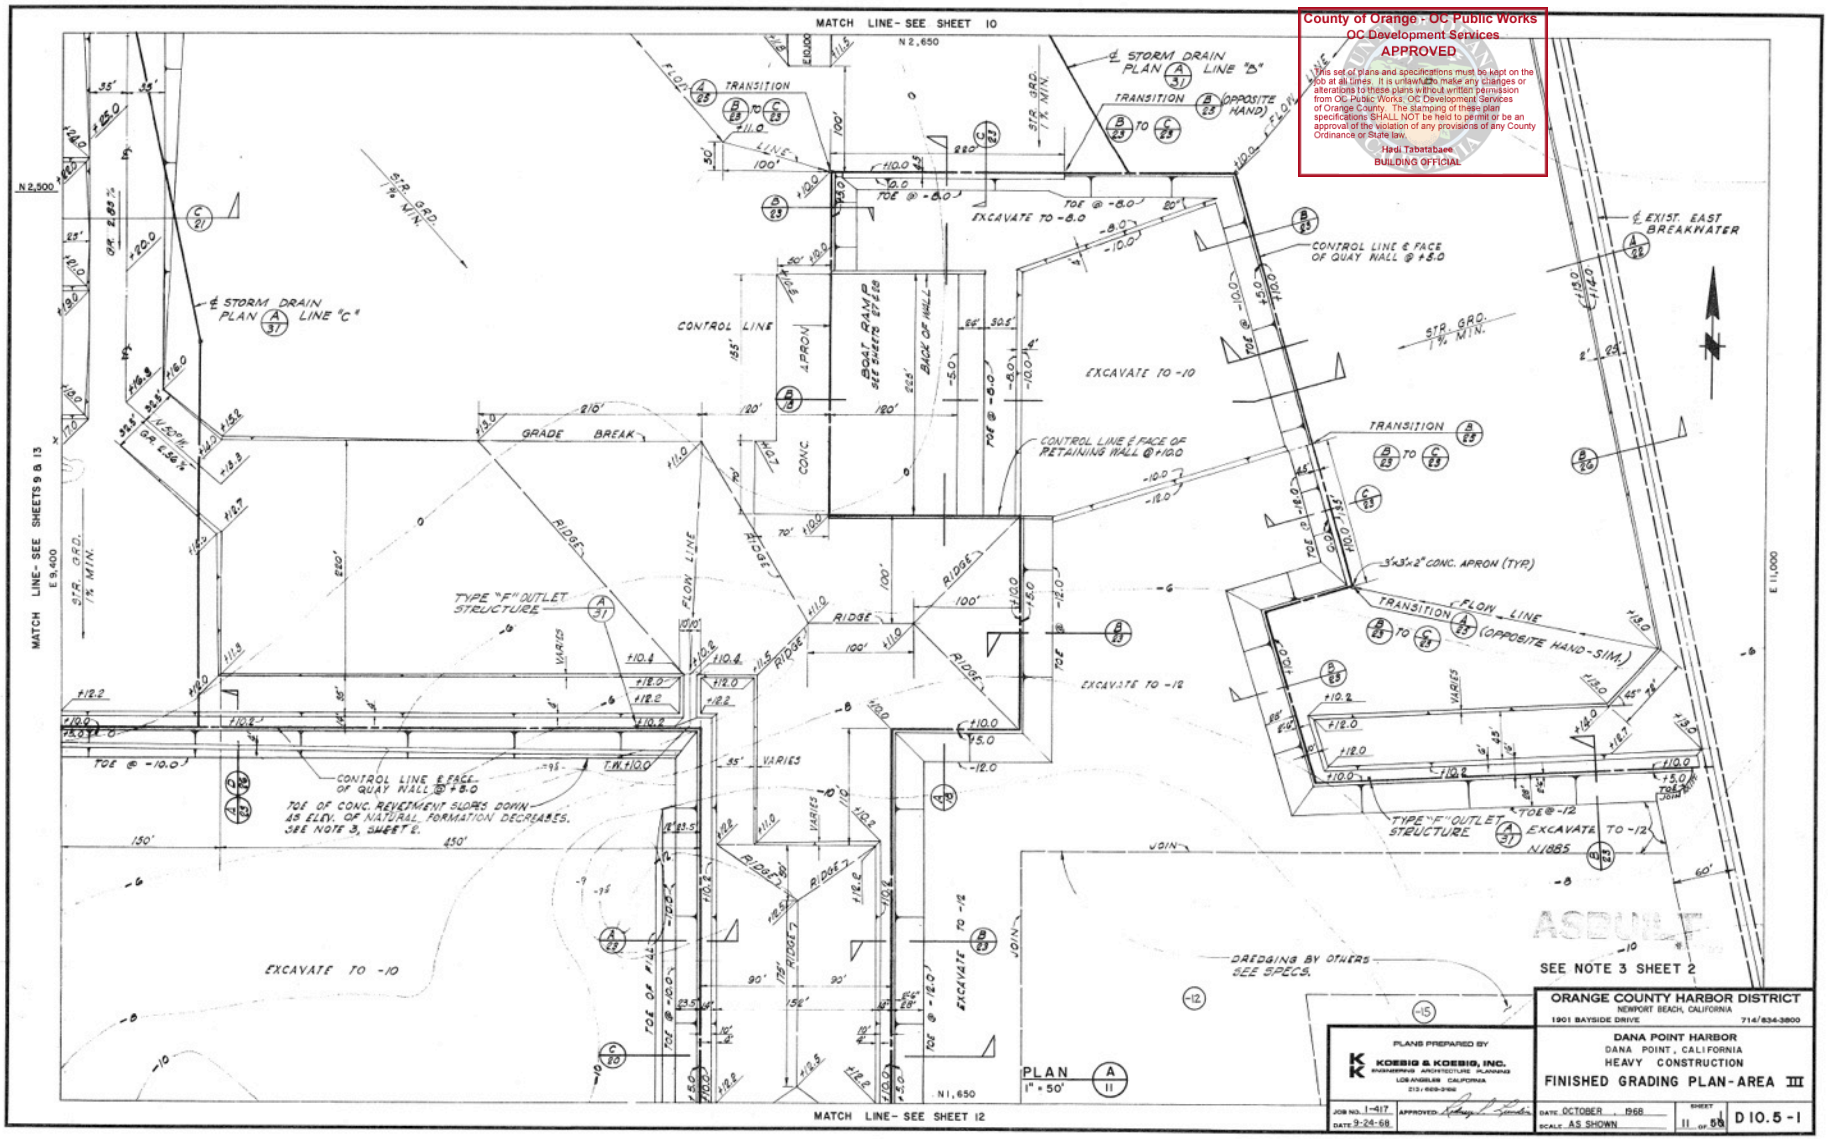

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/688-2166

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

FINISHED GRADING PLAN-AREA III

JOB NO. 1-417
DATE 9-24-68
APPROVED
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 11 OF 55
D 10.5-1

Building&Safety- Ryan Roepf 7/16/2025
Approval: Geotechnical Reports
Permit #
BWD21-01643BWD21-01618BWD21-01619BWD21-0143

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be clear on the plans. Any deviation from the approved plans must be approved in writing and on file at the jobsite. Inspection by OC Development Services is required. Approval does not constitute a building permit or authorization to violate, cancel, alter or set aside any provisions of the uniform codes or other ordinances of the county nor approve the violation of any county ordinance.
Neal Tomlinson
7/16/2025 07:17:06

MATCH LINE - SEE SHEET 11

MATCH LINE - SEE SHEETS 13 & 14

N 1,500

E 9,400

E 11,000

N 650

N1,650

EXCAVATE TO -10

EXCAVATE TO -12

ACTUAL DEPTHS / SURVEY

DREDGING BY OTHERS SEE SPECS.

2:1 SLOPE

225'

335'

180'

120'

215'

250'

172'

TOE

BENCH @ -12.0

BENCH @ -10.0

CONTROL LINE & FACE OF QUAY WALL @ +5.0

CONTROL LINE & FACE OF QUAY WALL @ +5.0

CONTROL LINE & TOP OF REVETTED SLOPE

TRANSITION A/23 TO B/23

TRANSITION B/23 TO D/23

TRANSITION B/23 TO E/23

TRANSITION D/23 TO E/23

BENCH TRANSITION

TYPE "F" OUTLET STRUCTURE A/31

TYPE "F" OUTLET STRUCTURES A/31 TYP.

DOWN DRAIN

FLOW LINE

RIDGE

GRADE BREAK

R=50

E.C.

B.C.

JOINT

QUAY WALL

T.W.

+10.0 T.W.

+10.2

+12.2

+14.0

+10.6

+11.0

+12.5

+10.4

+10.7

+12.0

+11.5

+13.0

+15.0

+7.0

+4.0

+14.0

+12.8

+12.5

+12.0

-10.0

-12.0

-12.07

+10.2

+12.07

+10.2

+12.0

-10.0

-12.0

+12.2

+12.5

+10.0

+10.2

+12.2

+12.2

+12.5

+12.2

+12.0

+12.0

+11.5

+12.0

+13.0

+12.0

+15.0

+15.0

+14.0

+12.0

+7.0

+4.0

-10.0

CURVE DATA

	Δ	R	T	L	REMARKS
Δ_6	135°00'00"	125'	301.78	~~147.26~~ 294.52	CONTROL LINE
Δ_7	45°00'00"	350'	144.97'	274.89'	" "

PLAN A/12
1" = 50'

SEE NOTE 3 SHEET 2

DEFAULT
SEP 24 1970

REV.	DESCRIPTION	DATE
1	CHANGED GRADES	10-27-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KK KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213 / 629-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
FINISHED GRADING PLAN - AREA IV

JOB NO. 1-417 APPROVED: Rodney R. Koebig
DATE 9-24-68
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 12 OF 58
D10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

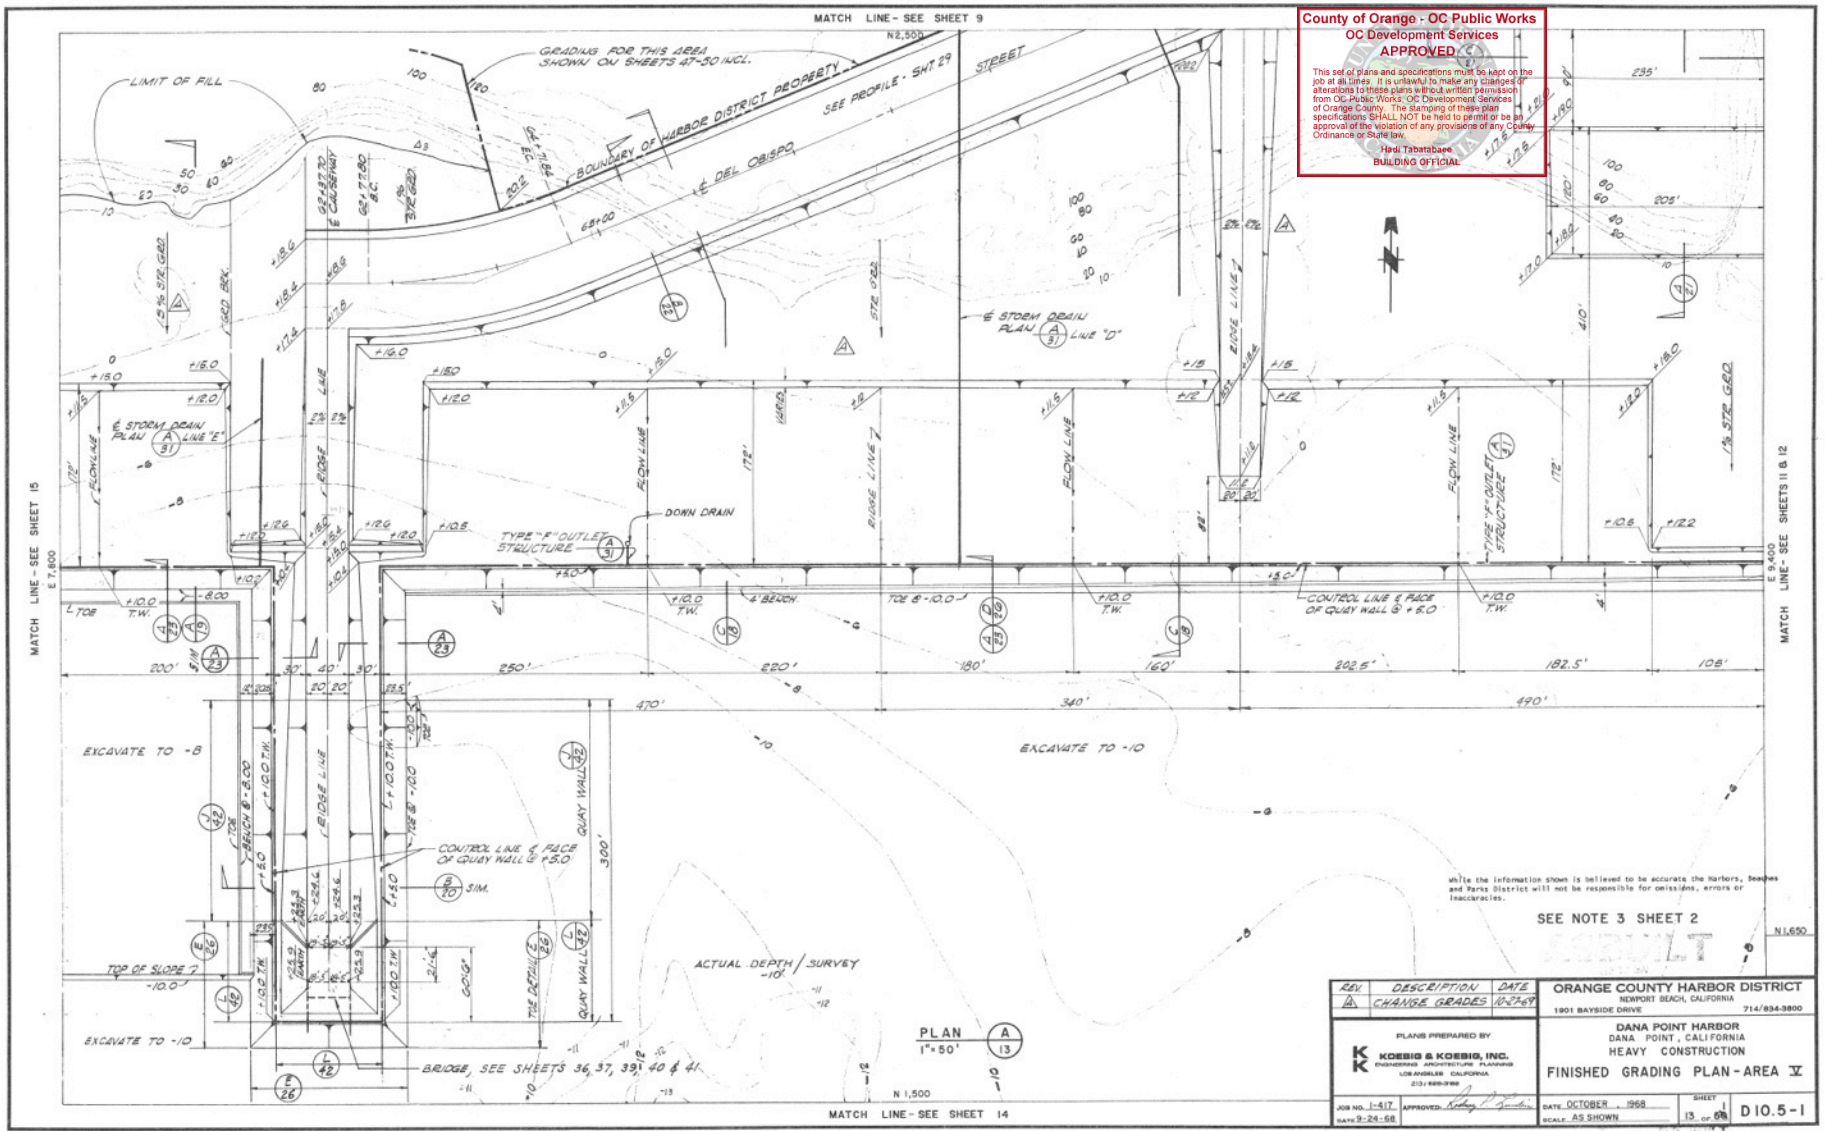

While the information shown is believed to be accurate the Harbors, Beaches and Parks District will not be responsible for omissions, errors or inaccuracies.

REV.	DESCRIPTION	DATE
A	CHANGE GRADES	10-27-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3162

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
FINISHED GRADING PLAN - AREA V

JOB NO. 1-417 APPROVED:
DATE 9-24-68
DATE OCTOBER , 1968
SCALE AS SHOWN
SHEET 13 OF 68
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

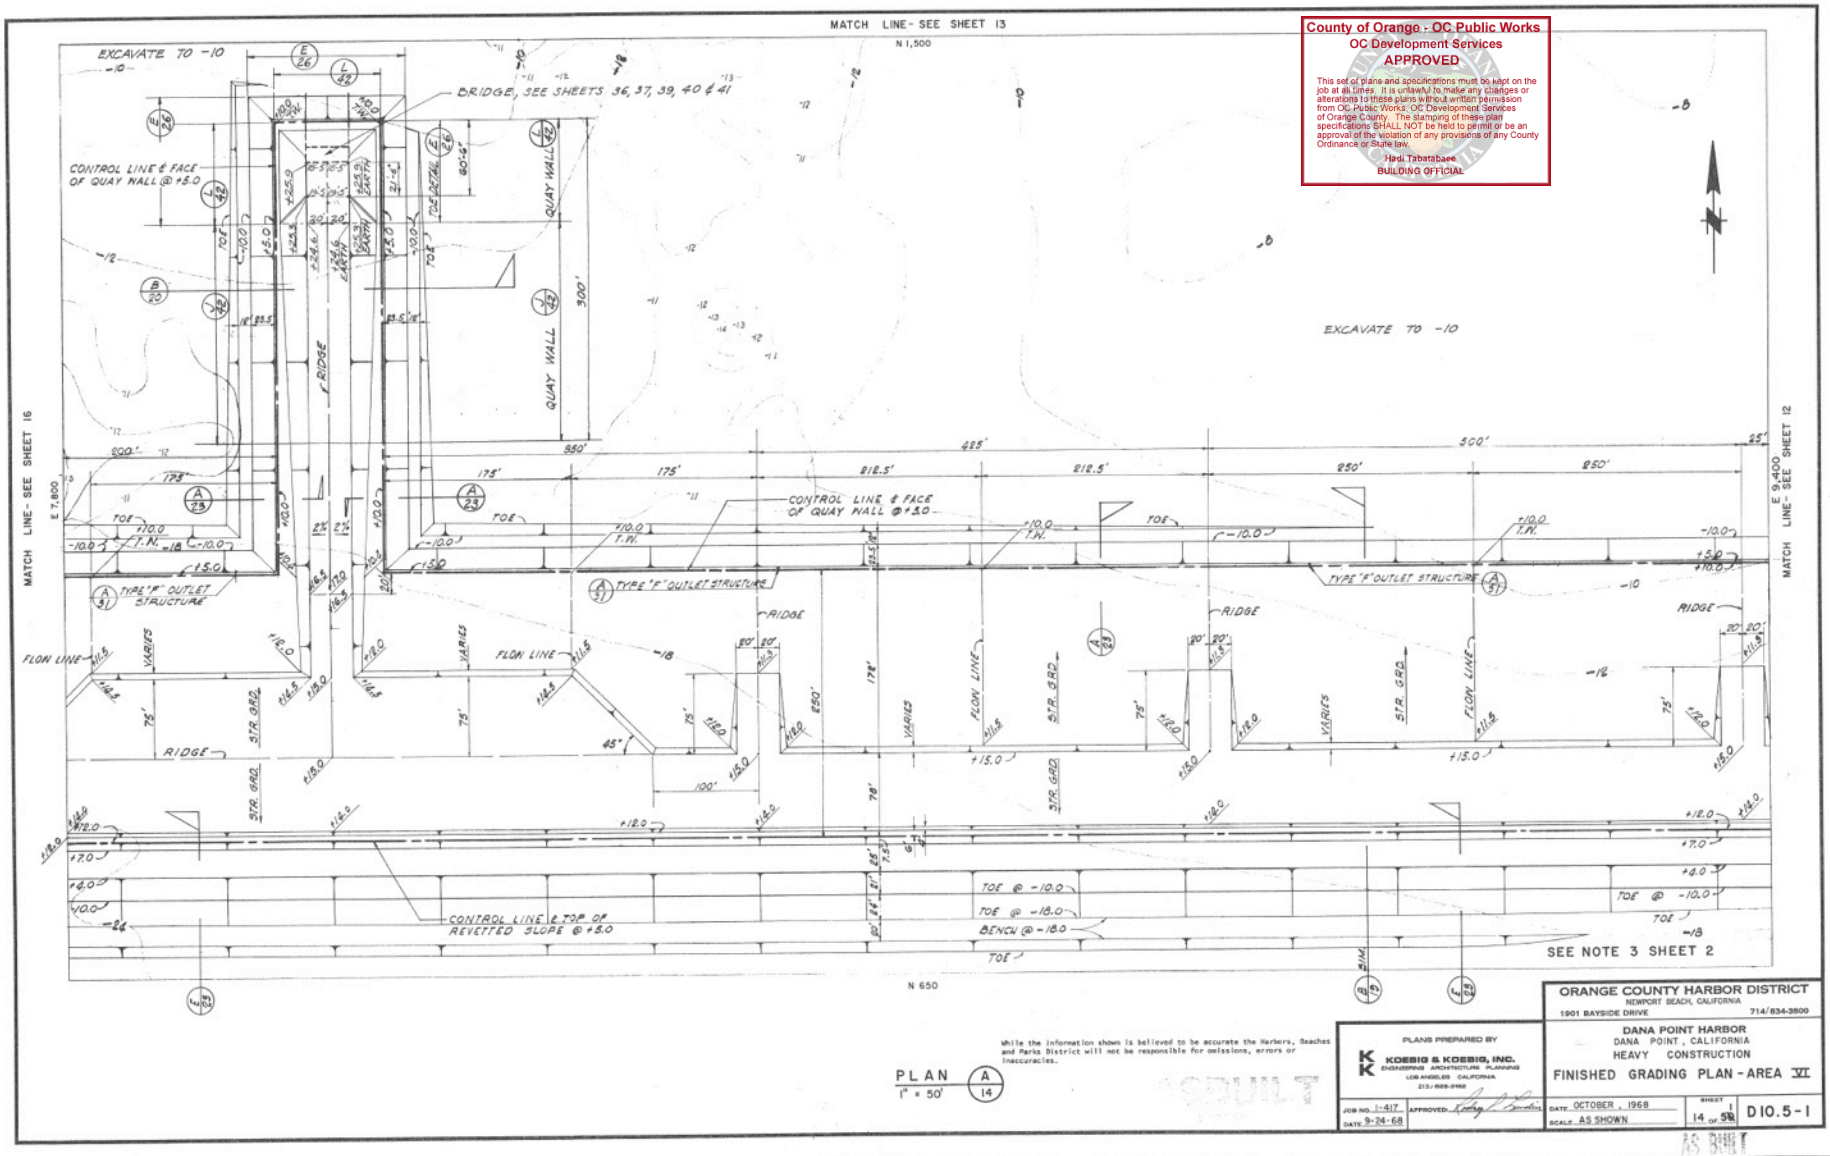

PLAN 1" = 50' (A/14)

While the information shown is believed to be accurate the Harbors, Beaches and Parks District will not be responsible for omissions, errors or inaccuracies.

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/ 629-2182

JOB NO. 1-417 APPROVED
DATE 9-24-68

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

FINISHED GRADING PLAN - AREA VI

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 14 OF 98

D10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWST2-E2ASBWST-E2A1BWST-E2A2BWST-E2A3

County of Orange - OC Public Works
OC Development/Environmental Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve contractor of responsibility for compliance with all applicable codes, ordinances & regulations. The approval of alternate specifications does not relieve contractor of responsibility for the accuracy and correctness of the design and details. County of Orange
Building Official
Ryan Rose
Date 01/16/25

N 2,500

LIMIT OF FILL

LIMIT OF FILL

STR. GRD. 1.5%

STR. GRD. 1.5%

STR. GRD. 1.5%

℄ STORM DRAIN LINE "F" PLAN (A/31)

50 40 30 20 10

+17.0 +14.0 +16.0 +13.0 +16.0 +12.0 95' 95' 120'

STR. GRD.

+11.5 FLOW LINE +12.0 +11.5 FLOW LINE +12.0 +11.5 FLOW LINE +12.0

+15.0 +12 75' +11.3 20' 20' +15.0 +12.0 172' +15.0 +12.0 +11.0 20' 20'

RIDGE LINE RIDGE LINE RIDGE LINE

-6 -6 -6 0 0

N2025 +10.0 +10.0 +11.5

TRANSITION (A/26)

TYPE "F" OUTLET STRUCTURE (A/31) TYPE "F" OUTLET STRUCTURE (A/31)

0 BEACH FILL

END REVETTED SLOPE 50' +10.0 T.W.

TOP OF SLOPE 0.0

END QUAY WALL 75'

N1820 ℄ PT.

-6 (B/21)

+12.0 20' 10' 4' +12.5 +12.2 30' 30' 170' +12.5 +12.2 30' 10' 25'

+10.0 T.W. TOE @ -8.0

CONTROL LINE ℄ FACE OF QUAY WALL @ +5.0

20.5'

26.29' EACH

2'-6" (B/23) (A/23) (D/20)

TOE

EXCAVATE TO -8.0

-8.0 -10.0

TOE @ -10.0

TRANSITION (A/24) OPPOSITE HAND (A/23) TO (B/23)

DREDGING BY OTHERS SEE SPECS.

-8 (10)

JOIN

EXCAVATE TO -10

-8 -10 -12

PLAN (A/15) 1" = 50'

N 1,500

(E/20) +10.0 T.W. -8.0 TOE 12' (A/23)

+10.0 T.W. 20.5' CONTROL LINE ℄ FACE OF QUAY WALL @ +5.0

TOE @ -8.0 +10.0 T.W. (A/19) TOE

185' 185' 182.5' 182.5' 182.5' 182.5' 100'

370' 365' 365'

EXCAVATE TO -8.0

EXCAVATE TO -10

-8.0 -10.0

MATCH LINE - SEE SHEET 17A E 6,200

MATCH LINE - SEE SHEET 13 E 7,800

MATCH LINE - SEE SHEET 16

While the information shown is believed to be accurate the Harbors, Beaches and Parks District will not be responsible for omissions, errors or inaccuracies.

SEE NOTE 3 SHEET 2

AS BUILT SEP 2 4 1970

REV	DESCRIPTION	DATE
A	CHANGED REFERENCE	9-19-69
B	CHANGED GRADES	10-27-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
FINISHED GRADING PLAN - AREA VII

JOB NO. 1-417 APPROVED: Rodney P. Koebig
DATE 9-24-68
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 15 OF 51
D10.5-1

AS BUILT
WHILE THE INFORMATION SHOWN IS BELIEVED TO BE ACCURATE THE HARBORS, BEACHES AND PARKS DISTRICT WILL NOT BE RESPONSIBLE FOR OMISSIONS, ERRORS OR INACCURACIES.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

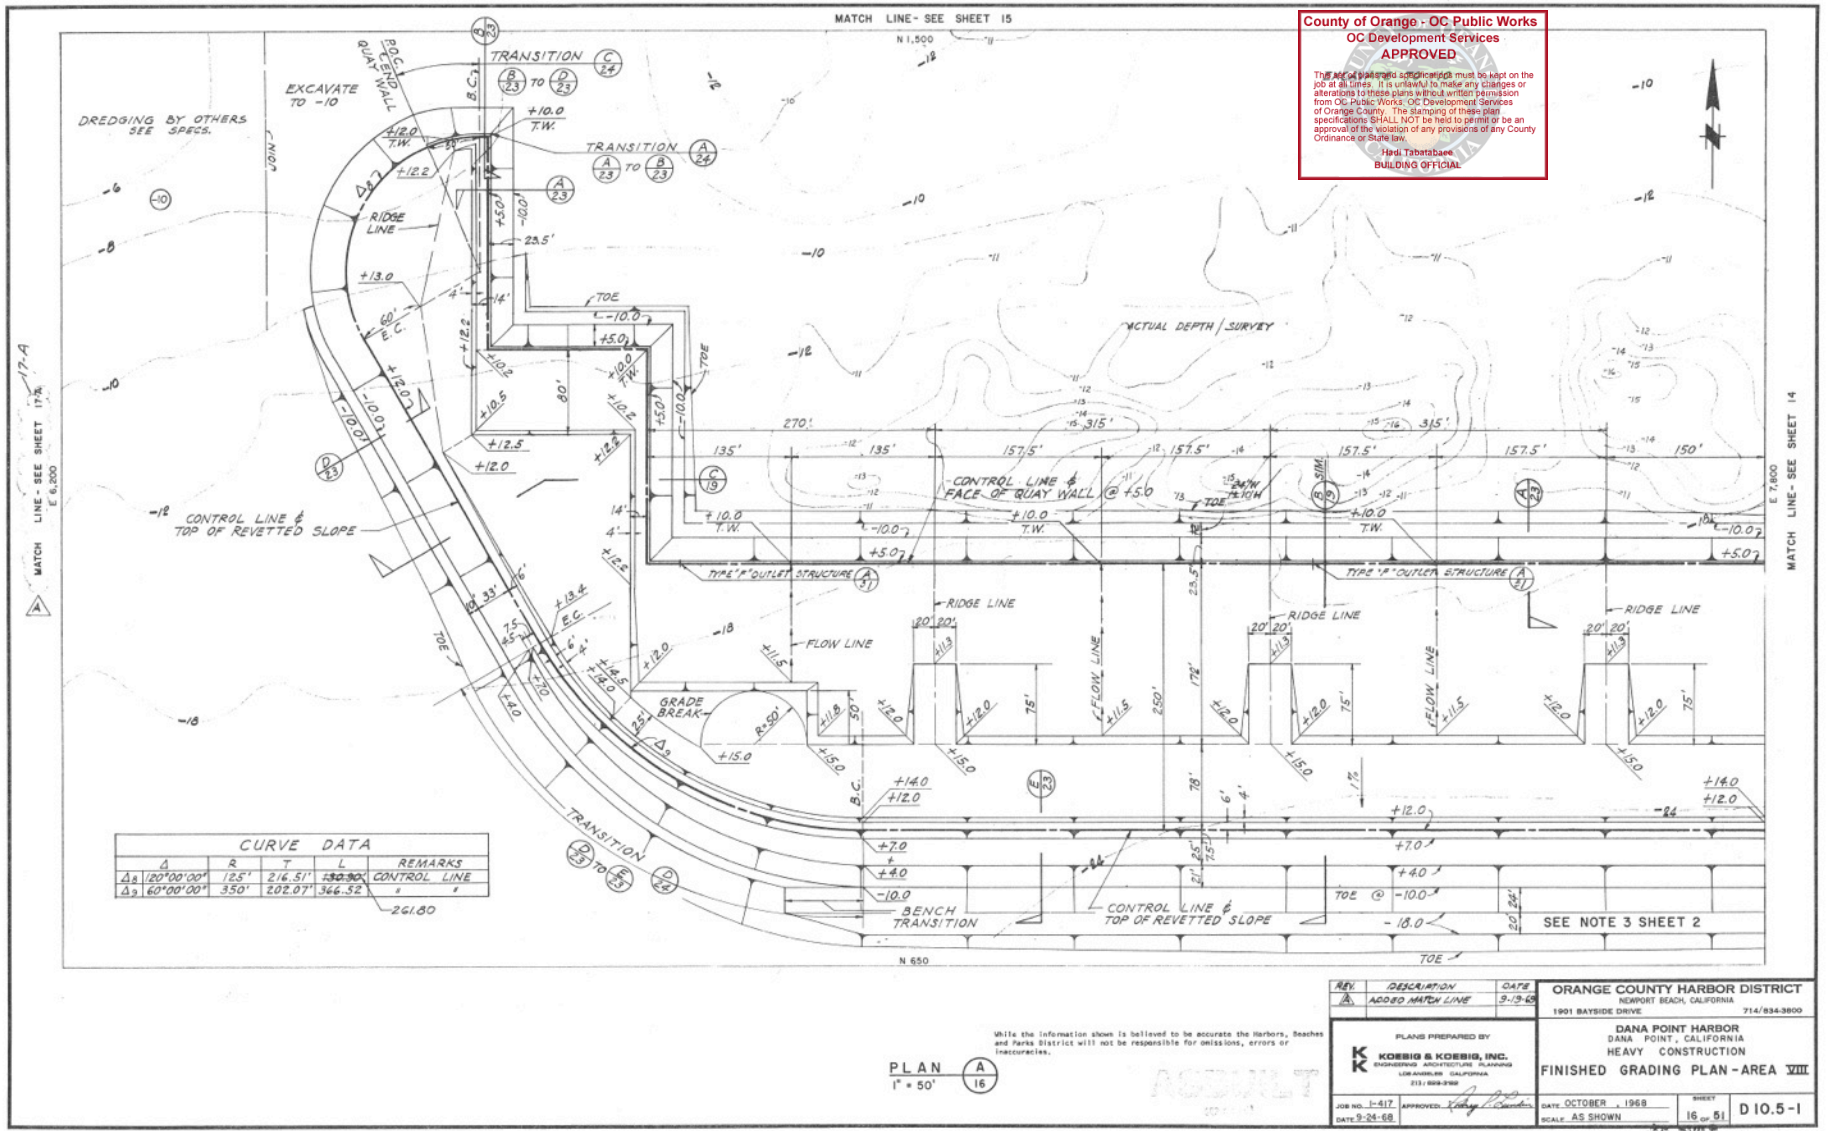

PLAN A/16
1" = 50'

While the information shown is believed to be accurate the Harbors, Beaches and Parks District will not be responsible for omissions, errors or inaccuracies.

REV.	DESCRIPTION	DATE
A	ADDED MATCH LINE	9-19-69

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/ 624-2382

JOB NO. 1-417
DATE 9-24-68
APPROVED:

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
FINISHED GRADING PLAN - AREA VIII

DATE OCTOBER , 1968
SCALE AS SHOWN
SHEET 16 OF 51
D 10.5-1

AS BUILT

Building&Safety - Rory Rose 1/16/2025
Approved: Geotechnical Reports
Permit #:
BWD21-01643BWD1-01643BWD2-01643BWD3-01643
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve contractor from providing additional measures which may be required to obtain compliance with applicable codes and regulations. The permittee is responsible for all conditions of the approved plans and specifications. Changes, modifications or alterations in the approved plans and specifications shall be approved by the Building Official.
Public Improvements
Inspection Services

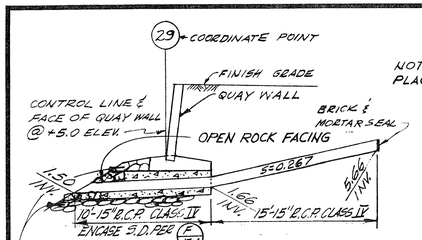

TYPICAL TYPE "G" OUTLET STRUCTURE (E 17A) 17A,31
NO SCALE
STONE REVETMENT



SECTION (F 17-A) 31,32
NO SCALE

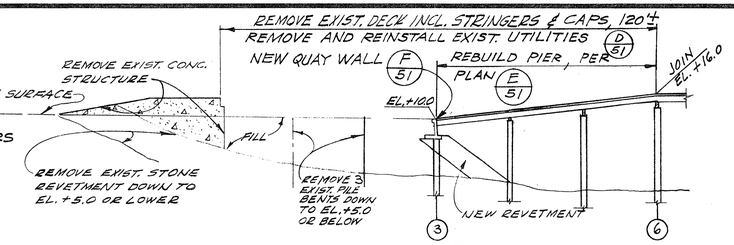

SECTION (B 17-A)
1"=20'

MATCH LINE SEE SHEET 15

MATCH LINE SEE SHEET 16

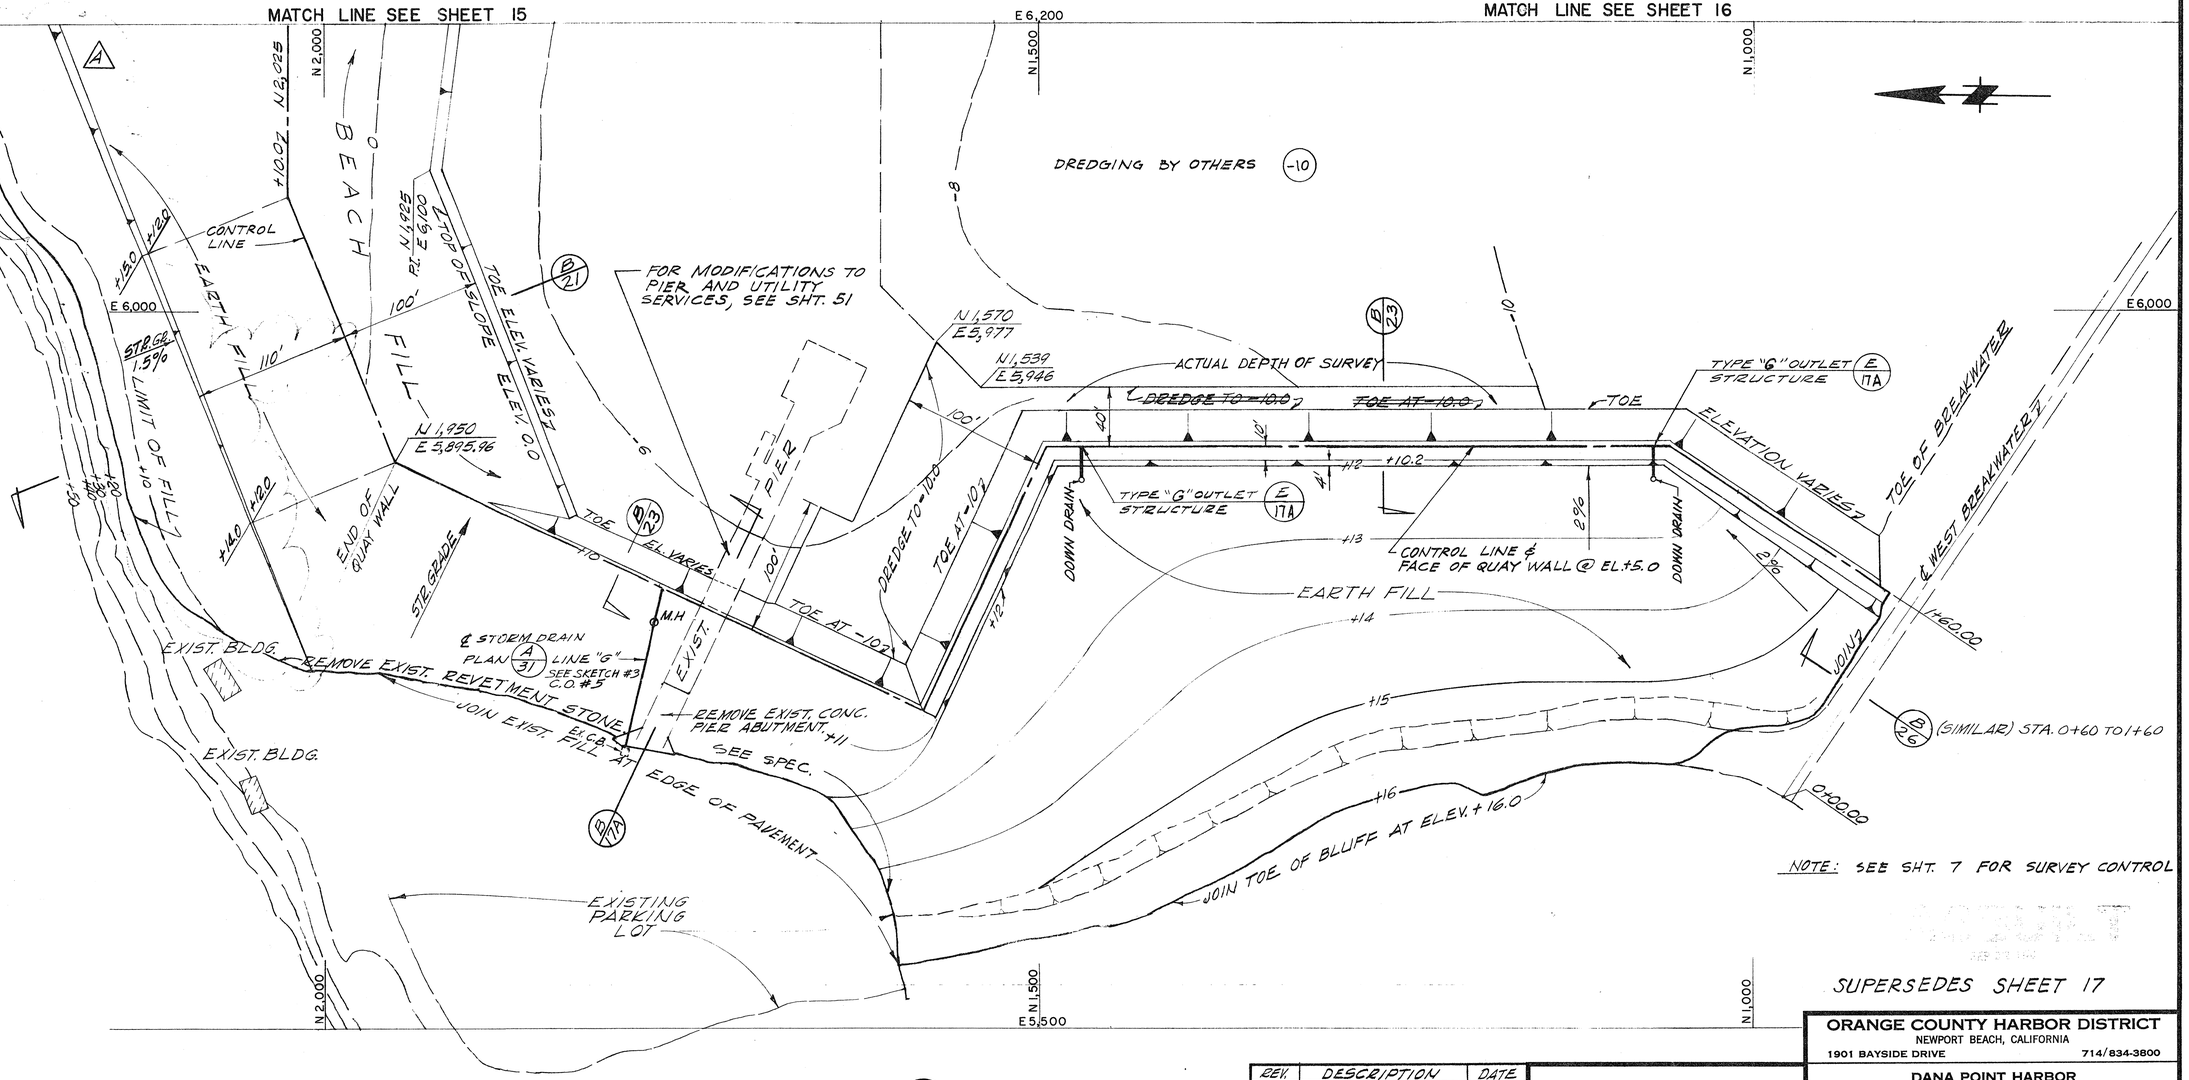

PLAN (A 17-A)
1"=50'

NOTE: SEE SHT. 7 FOR SURVEY CONTROL

SUPERSEDES SHEET 17

REV.	DESCRIPTION	DATE
A	CHANGED GRADES	10-27-69

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

JOB NO. 1-417.10
DATE 9-19-69
APPROVED

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
FINISHED GRADING PLAN - AREA IX

DATE SEPTEMBER, 1969
SCALE AS SHOWN
SHEET 17-A OF 51
D10.5-1

Building&Safety - Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #
BWD21-03483/BWD21-03419/BWD21-03420/BWD21-0343
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. The approval of alternate specifications does not relieve applicant of compliance with any applicable provisions of the California Building Code and the County of Orange Building Ordinances. The approval of alternate specifications and details does not prevent the Building Official from requiring corrective measures when necessary.
Issued By: Tom Dineen
Building Official

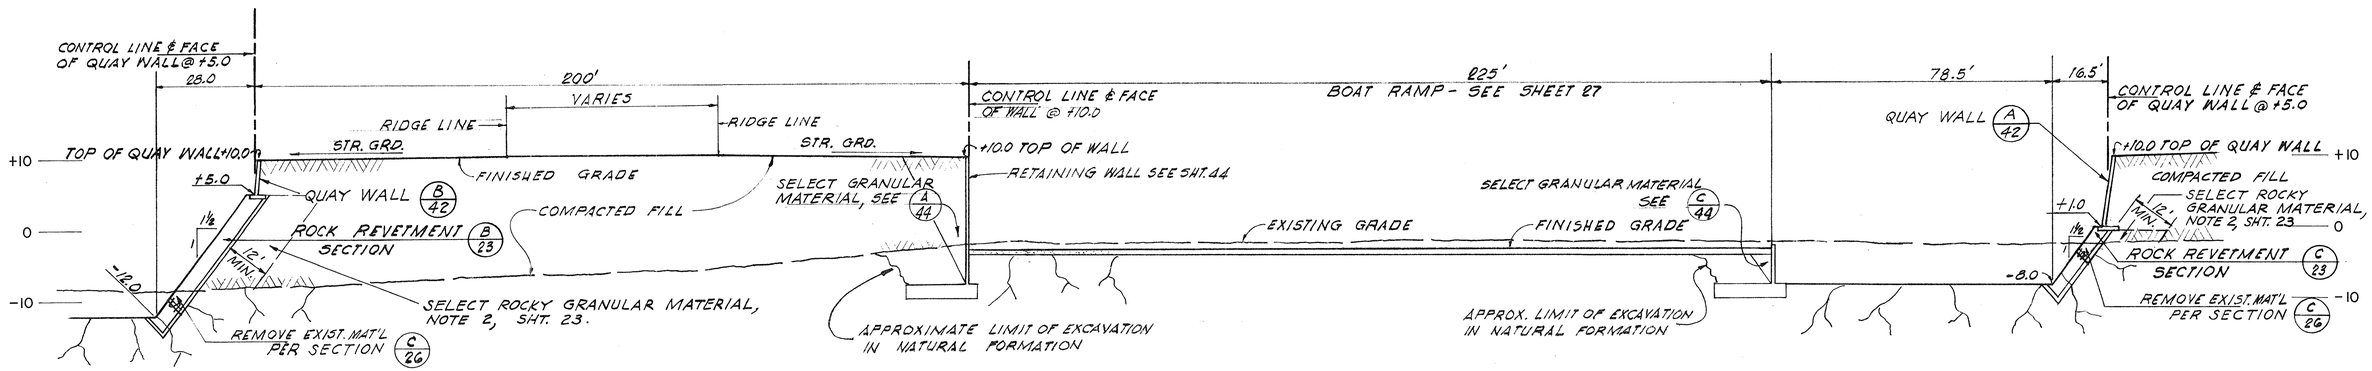

SECTION A/18 4, 11

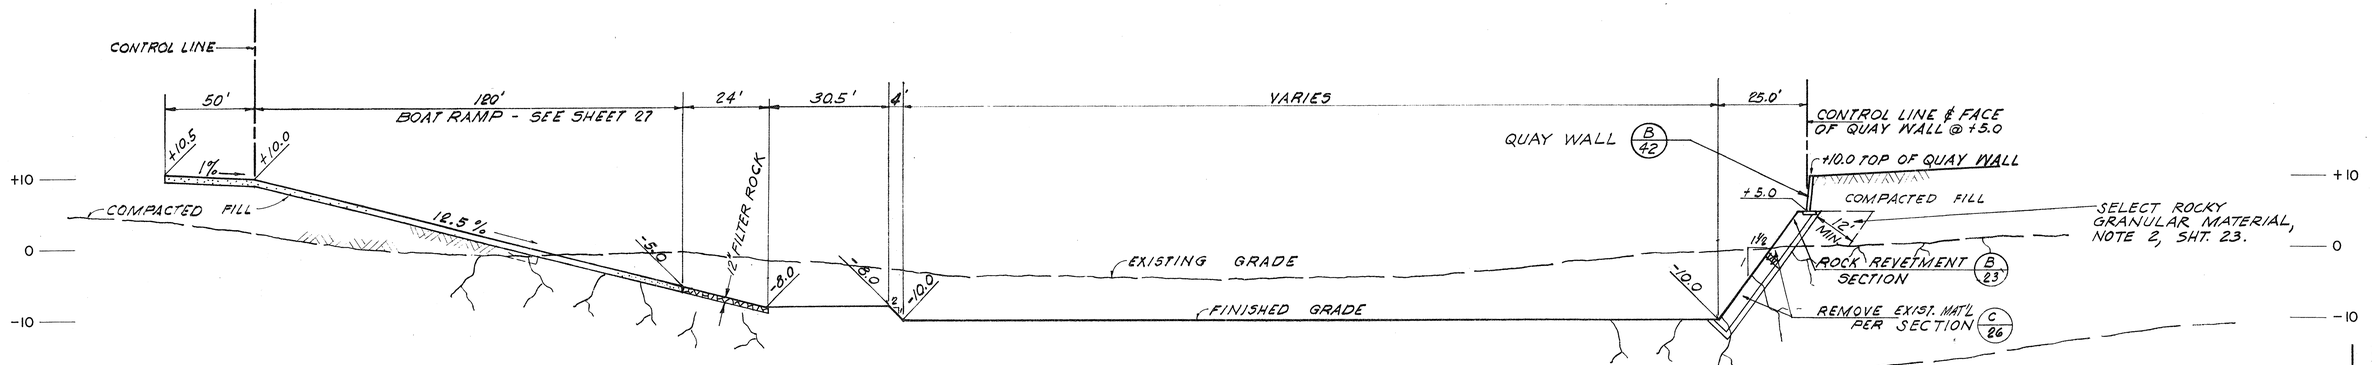

SECTION B/18 4, 11

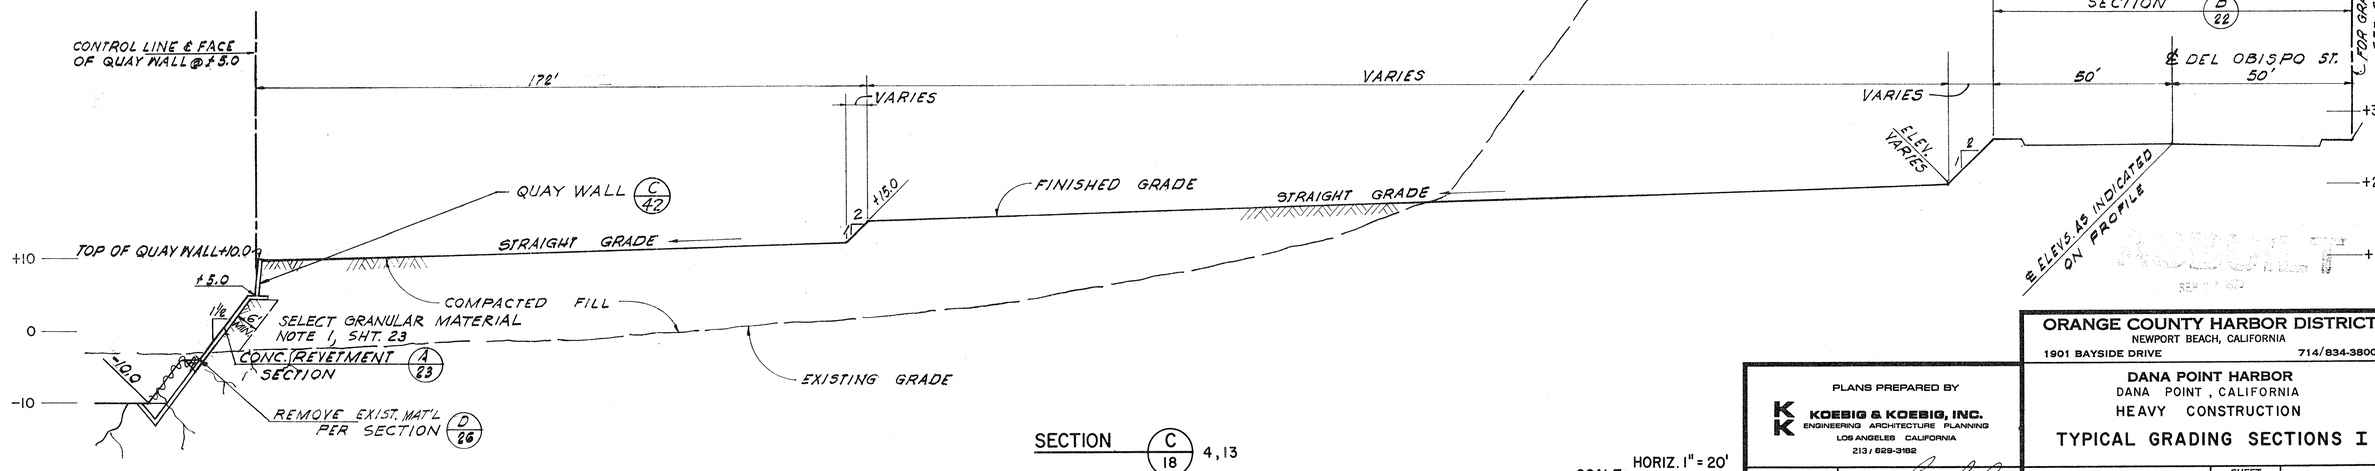

SECTION C/18 4, 13

SCALE: HORIZ. 1" = 20'
VERT. 1" = 10'

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213 / 628-3182

JOB NO. 1-417
DATE 9-24-68
APPROVED:

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

TYPICAL GRADING SECTIONS I

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 18 OF 58
D10.5-1

Building&Safety - Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #
BWD21-01643BWD1-01643BWD2-01643BWD3-01643
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be clear on the plans. Any deviation from the standard plans or the standard specifications shall be approved in advance by the Director, OC Development Services, or designee. The approval of materials or equipment does not relieve the contractor of responsibility for compliance with the plans and specifications.
Issued By: Tim Throssell
Building Services

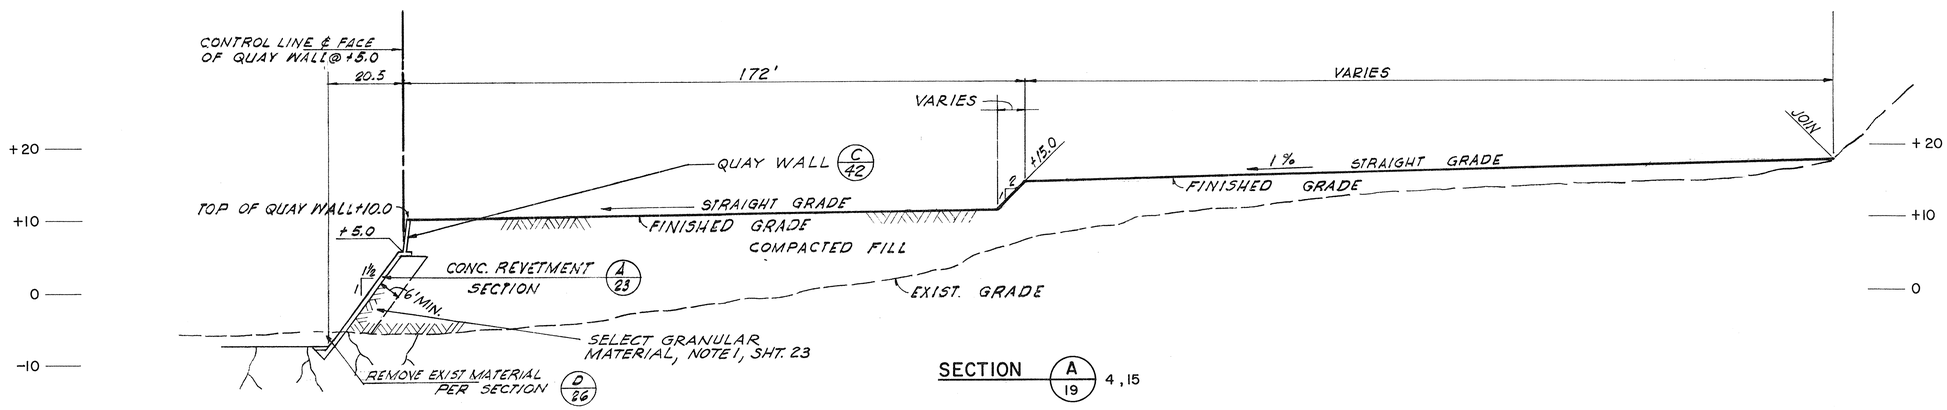

SECTION A 19 4, 15

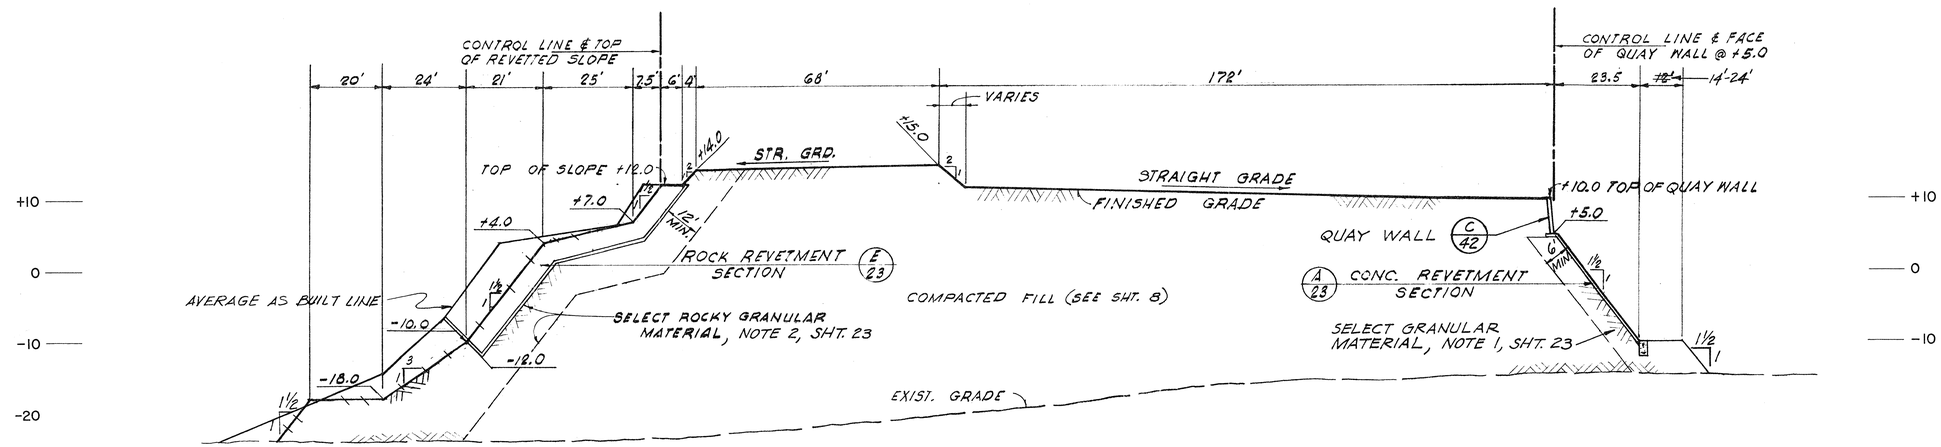

SECTION B 19 4, 12, 14 & 16

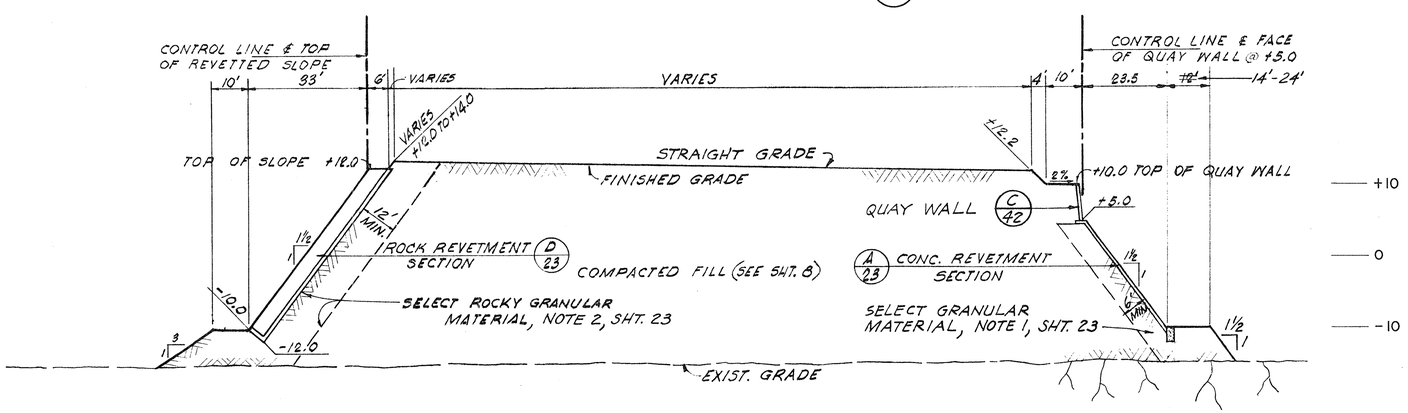

SECTION C 19 4, 16

SCALE: HORIZ. 1" = 20'
VERT. 1" = 10'

AS BUILT
SEP 3 / 1970

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/628-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

TYPICAL GRADING SECTIONS II

JOB NO. 1-417
DATE 9-24-68
APPROVED: Harry A. Koebig
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 19 OF 56
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
RMIT2-024EBMH2-024YBMH2-024UBMH2-024ZBMH2-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. The approval of alternate specifications does not relieve applicant of responsibility for compliance with applicable codes, ordinances, and regulations. The approval of alternate specifications shall not prevent the Building Official from requiring corrections of errors in the plans and specifications.
Ted Tawfelos
Building Official

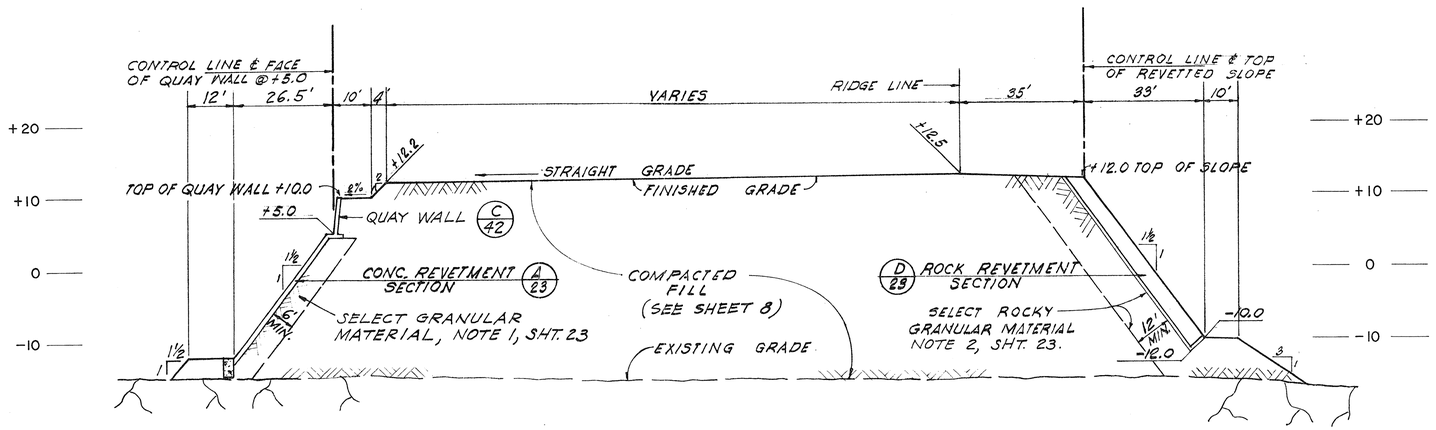

SECTION A/20 4,12

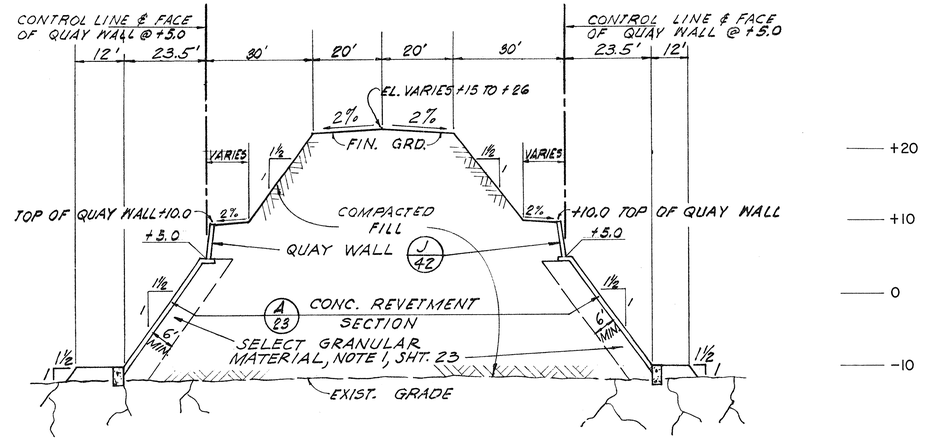

SECTION B/20 4,13,14

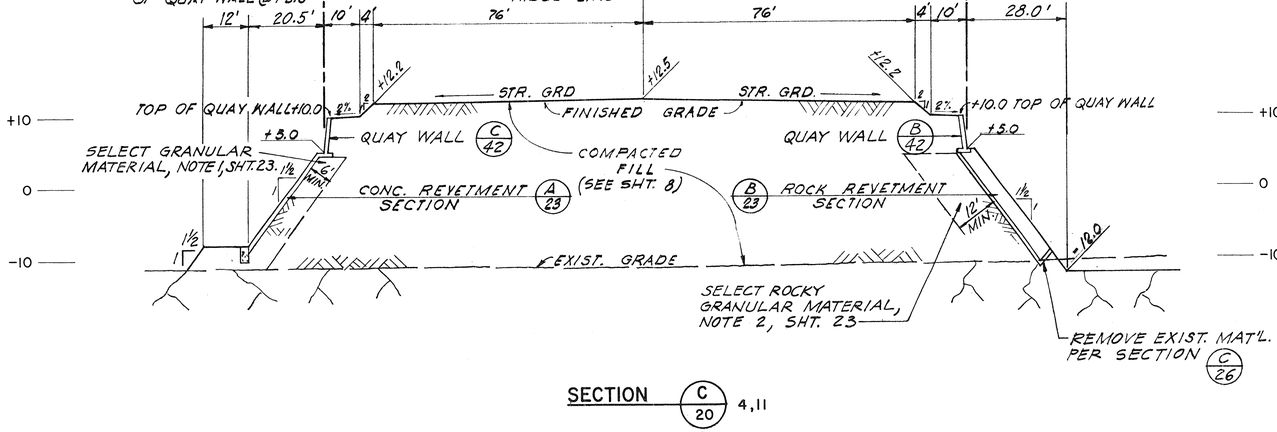

SECTION C/20 4,11

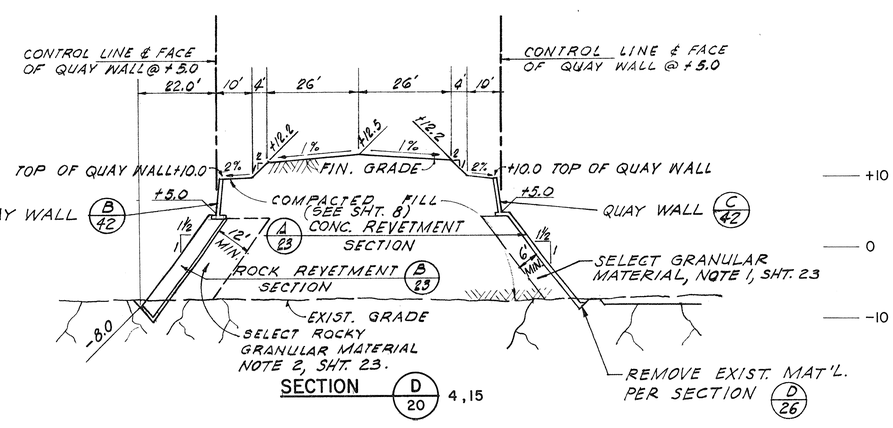

SECTION D/20 4,15

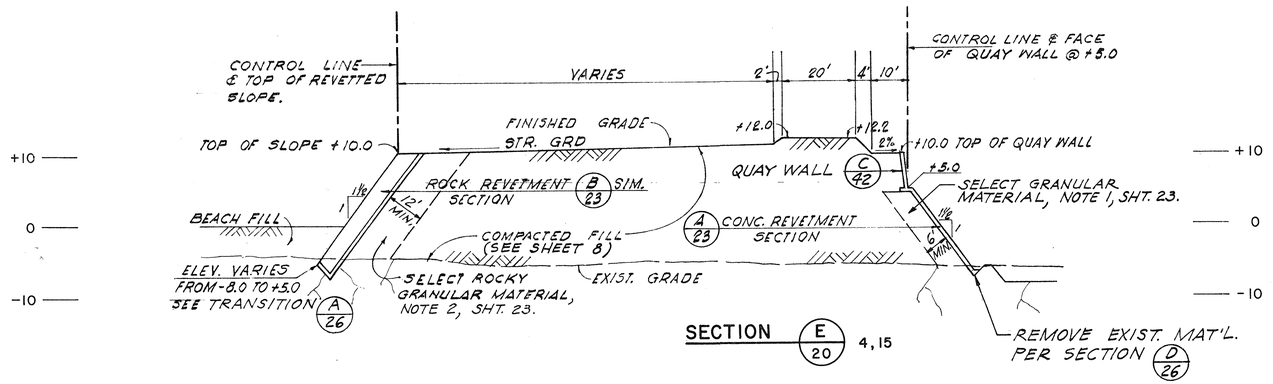

SECTION E/20 4,15

ACCEPTED
SEP 0 1 2020

SCALE: HORIZ. 1" = 20'
VERT. 1" = 10'

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213 / 629-3182

JOB NO. 1-417
DATE 9-24-68
APPROVED: Sydney L. Koebig

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

TYPICAL GRADING SECTIONS III

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 20 OF 56
D 10.5-1

Building&Safety- Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-03483;BWD21-03419;BWD21-03420;BWD21-0343

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve owner or permit applicant of responsibility for compliance with all applicable codes and ordinances. The permittee is responsible for all construction on the site and for all work within the public right-of-way or other property under the jurisdiction of the County of Orange.
Issued By: LTON

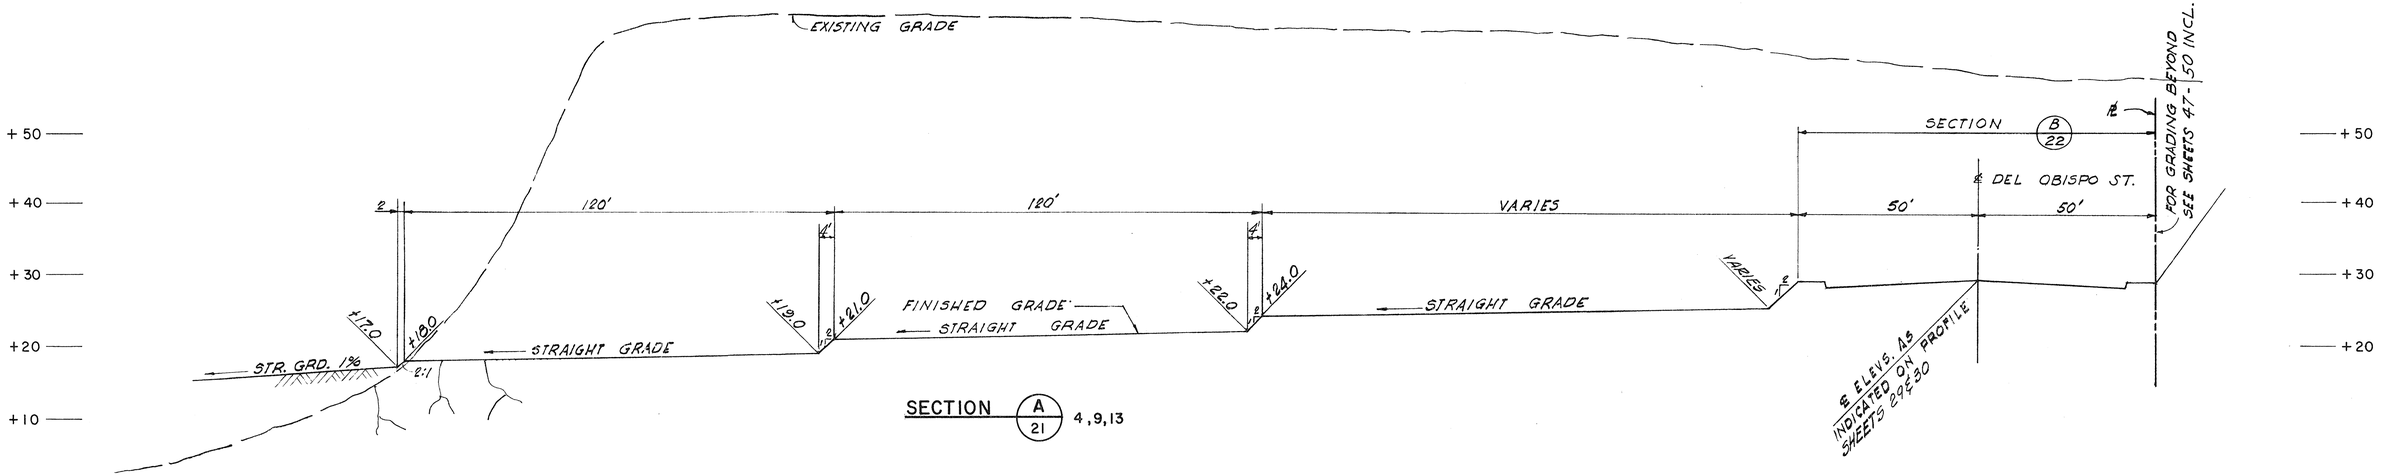

SECTION A 21 4,9,13

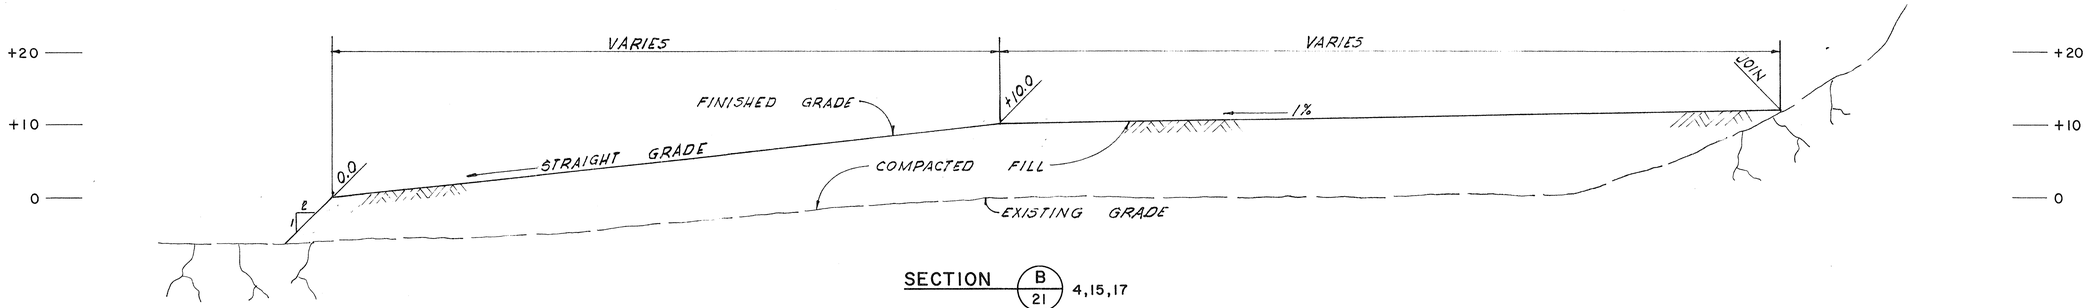

SECTION B 21 4,15,17

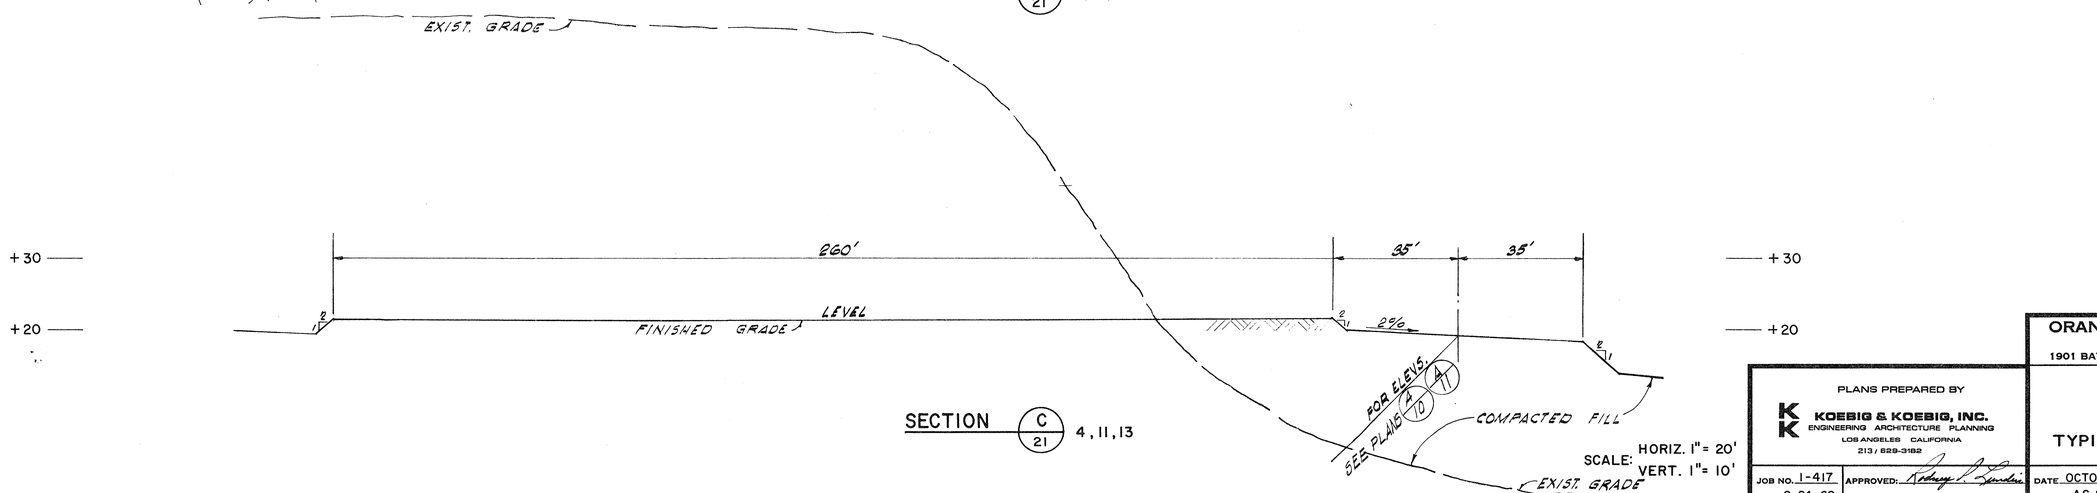

SECTION C 21 4,11,13

SCALE: HORIZ. 1"= 20'
VERT. 1"= 10'

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213 / 629-3182

JOB NO. 1-417
DATE 9-24-68
APPROVED:

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

TYPICAL GRADING SECTIONS IV

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 21 OF 50

D 10.5-1

Building&Safety- Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #
BWD21-03443BWD1-03410BWD1-03428BWD1-0343
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. The approval of alternate specifications does not relieve applicant of compliance with any applicable provisions of the California Building Code or other ordinances of the County of Orange. This permit is issued on the basis of information provided and does not authorize any violation of any federal, state or County law or regulation.
Issued By: Trina Tennyson
Reviewed By: KT/DM

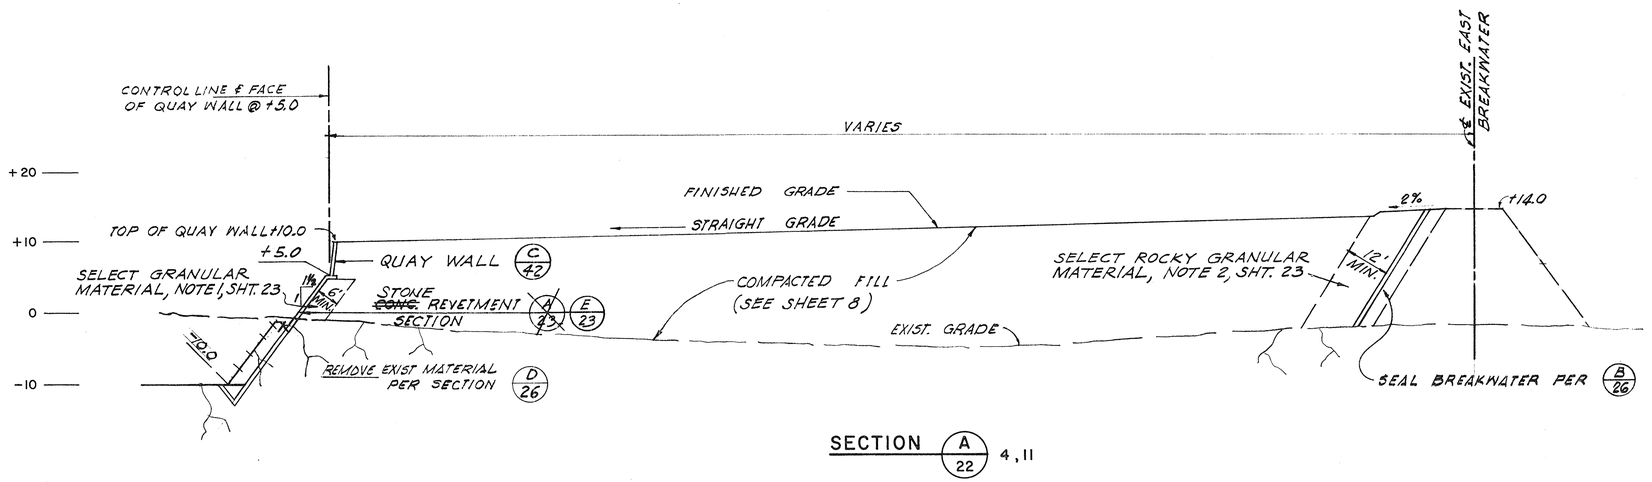

SECTION A/22 4,11

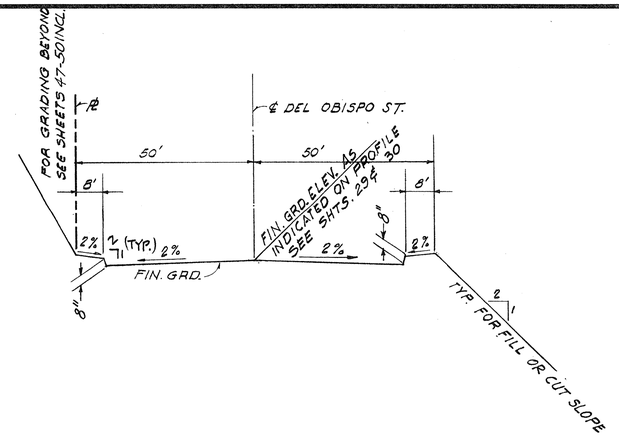

SECTION B/22 4,9,10,13

SECTION D/22 4,10

+10
0
-10

ASSIGNED
SEP 2 2 1970

SCALE: HORIZ. 1" = 20'
VERT. 1" = 10'

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213 / 629-3182

JOB NO. 1-417
DATE 9-24-68
APPROVED:

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

TYPICAL GRADING SECTIONS V

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 22 OF 59
D10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

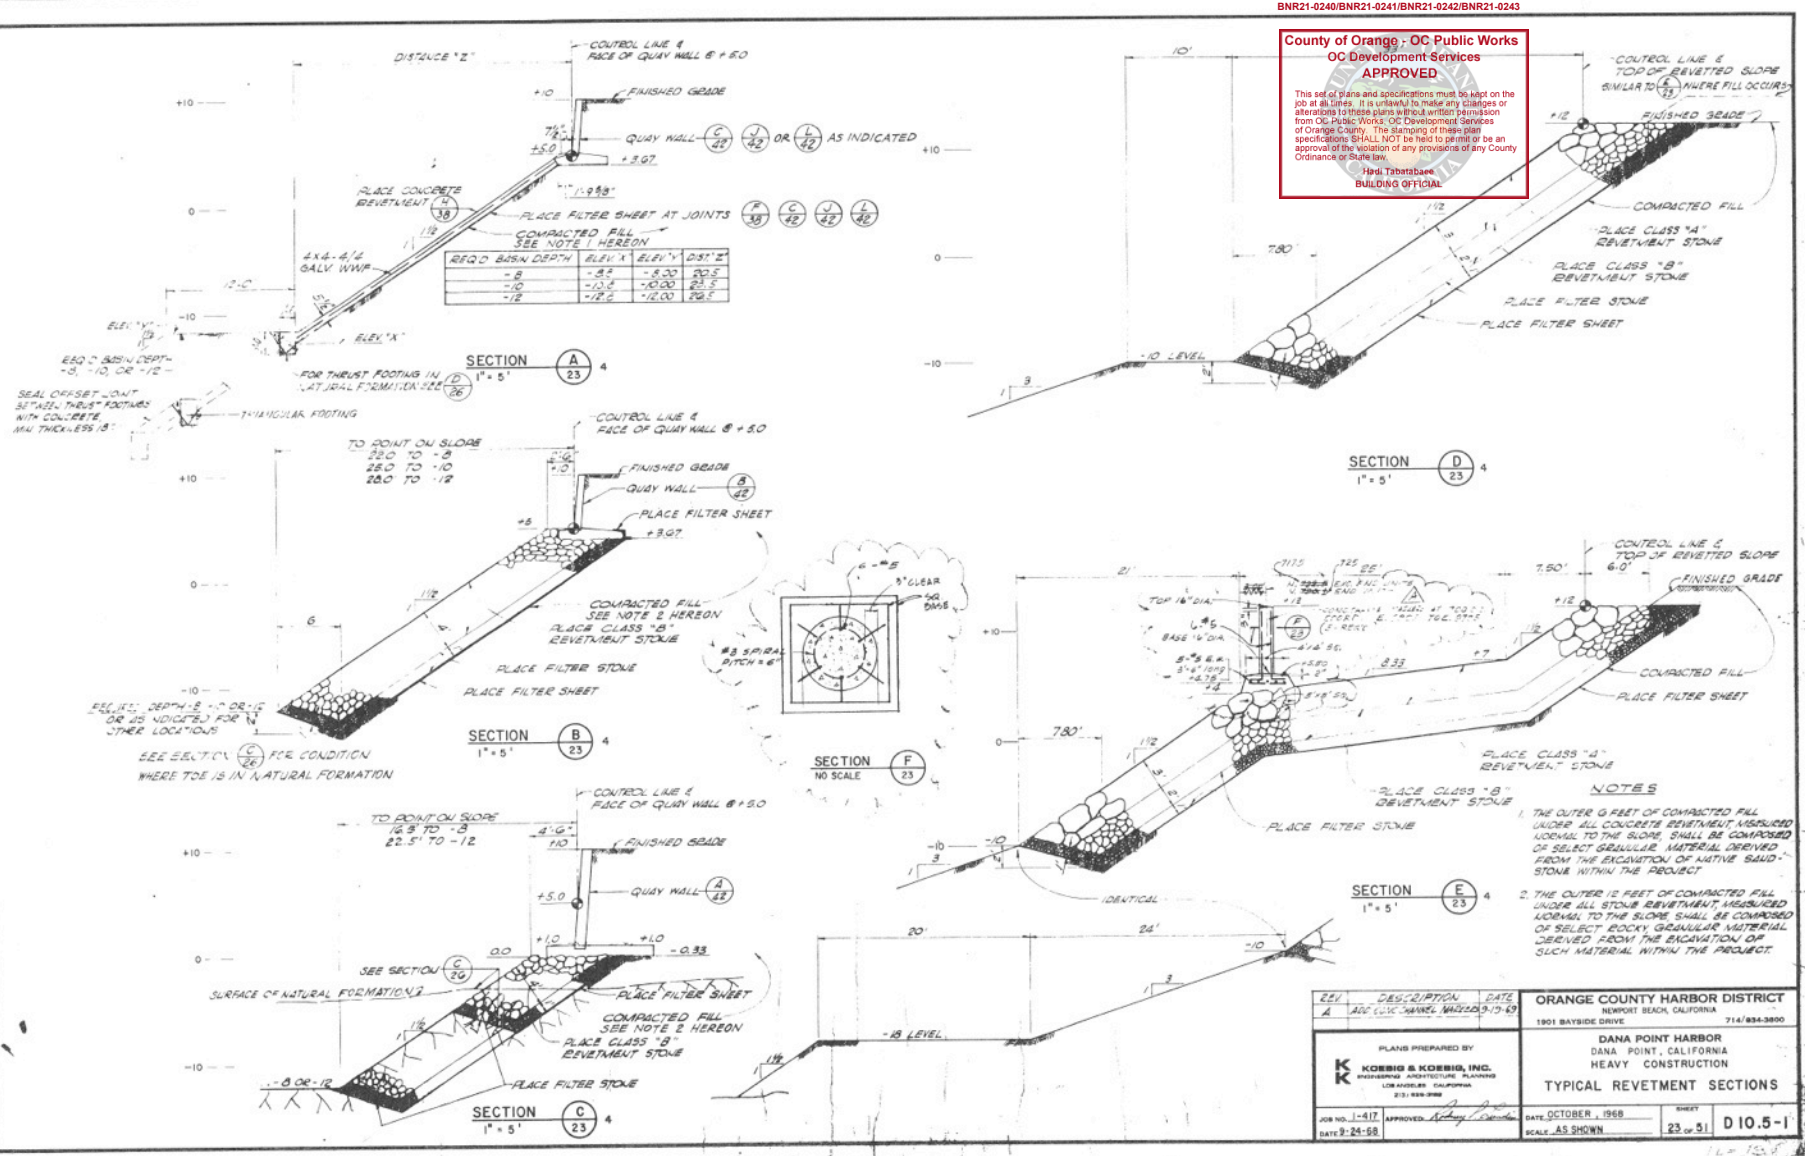

NOTES

1. THE OUTER 6 FEET OF COMPACTED FILL UNDER ALL CONCRETE REVETMENT, MEASURED NORMAL TO THE SLOPE, SHALL BE COMPOSED OF SELECT GRANULAR MATERIAL DERIVED FROM THE EXCAVATION OF NATIVE SAND-STONE WITHIN THE PROJECT.
2. THE OUTER 12 FEET OF COMPACTED FILL UNDER ALL STONE REVETMENT, MEASURED NORMAL TO THE SLOPE SHALL BE COMPOSED OF SELECT ROCKY GRANULAR MATERIAL DERIVED FROM THE EXCAVATION OF SUCH MATERIAL WITHIN THE PROJECT.

DEV.	DESCRIPTION	DATE
A	ADD CONC. CHANNEL WATERS	9-13-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
(213) 939-3981

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

TYPICAL REVETMENT SECTIONS

JOB NO. 1-417
DATE 9-24-68
APPROVED
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 23 OF 51
D10.5-1

Building/Safety Plan Prep 1/15/2020
Approval: Geotechnical Reports
Permit No.
BWD21-01443 BWD21-01444 BWD21-01445 BWD21-01446 BWD21-01447 BWD21-01448 BWD21-01449 BWD21-01450 BWD21-01451 BWD21-01452 BWD21-01453
County of Orange / OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve the applicant of responsibility for compliance with applicable codes, ordinances and regulations. Approval is void if misrepresentation of fact is discovered or if any provisions of the approved plans are violated.
Date 1/15/2020
By Chris Tabbert
Building Official

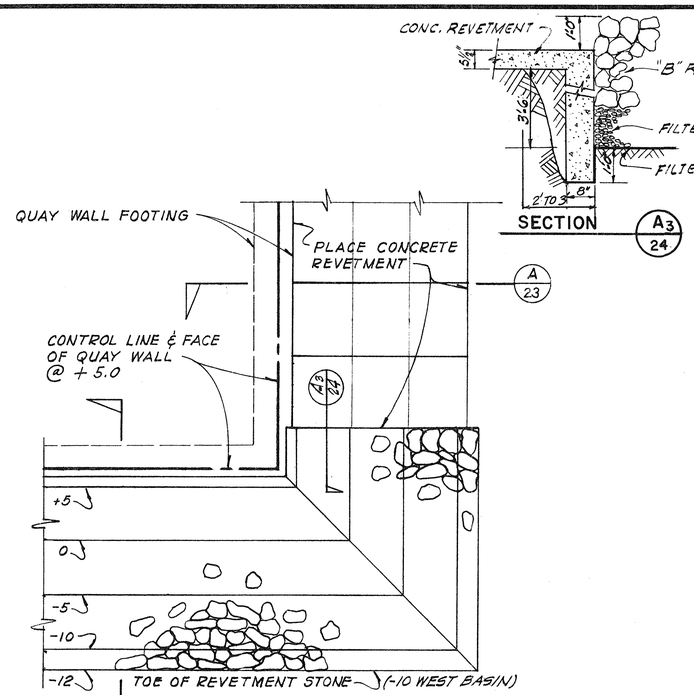

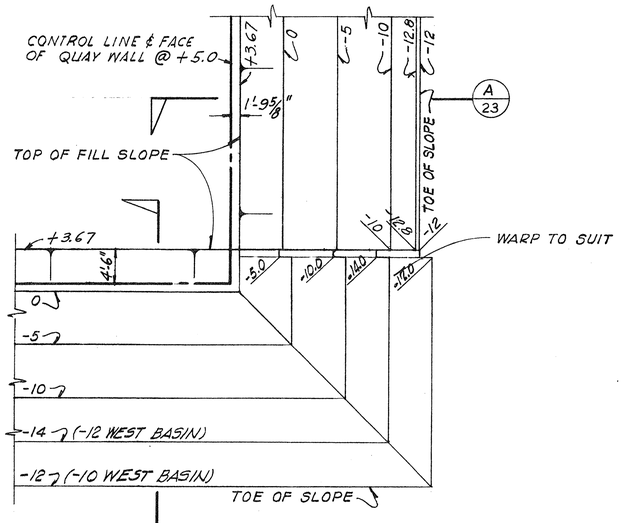

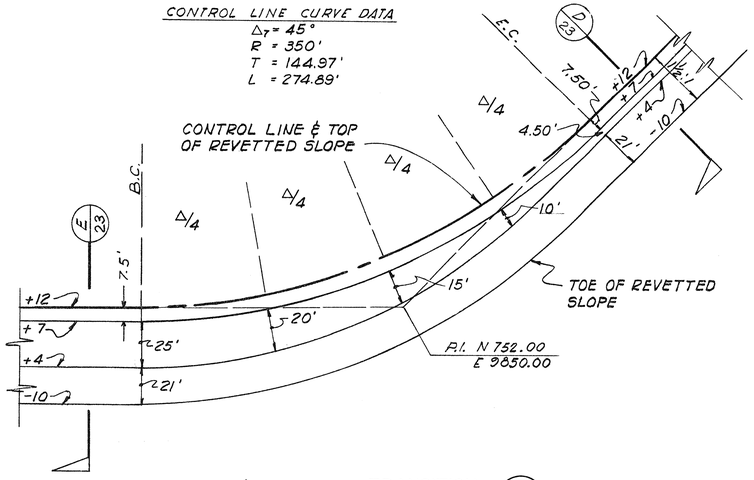

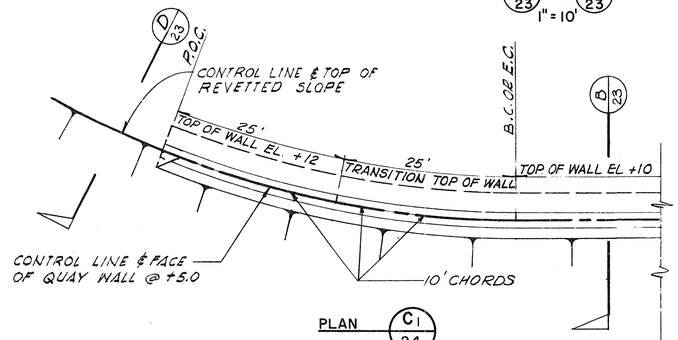



SECTION C3 24 SIMILAR B 23 & B 42

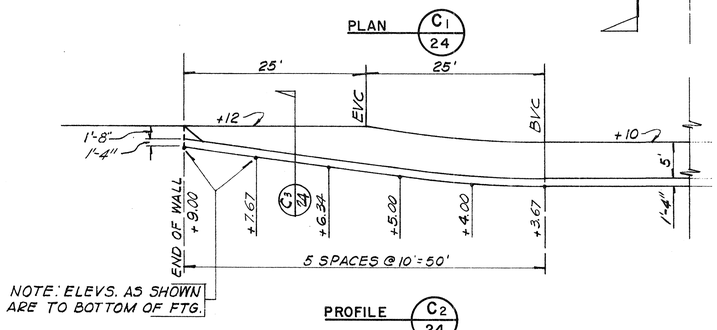

TRANSITION C 24 4,12,16
B 23 TO D 23
1" = 10

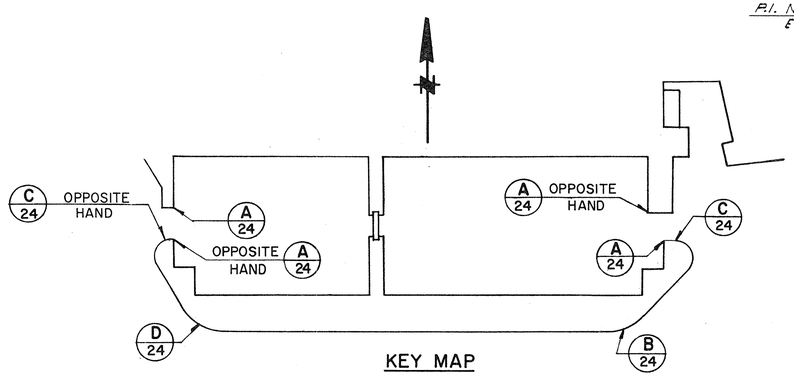

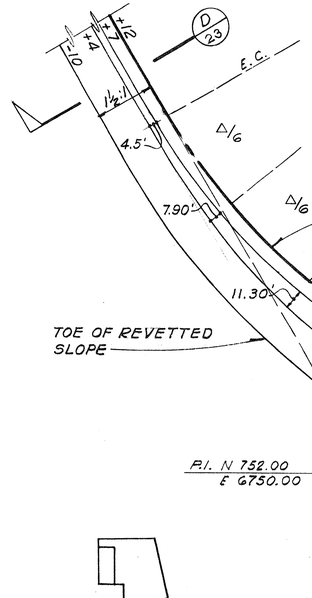

TRANSITION D 24 4,16
D 23 TO E 23
1" = 40'

ASBUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

REVETMENT TRANSITION DETAILS I

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

JOB NO. 1-417 APPROVED: Rodney P. Koebig
DATE 9-24-68
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 24 OF 58
D10.5-1

Building&Safety: Ryan Rose 1/15/2020
Approval: Geotechnical Reports
Permit #
BWD21-01443BWD21-01413BWD21-01423BWD21-0143
County of Orange / OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. The approval of alternate materials or alternate methods and/or modifications of provisions of these specifications may be granted by the Building Official as provided in Section 104.2.8, UBC. The permittee is responsible for the implementation of any alternate specifications and for the construction to conform to the approved alternate specifications.
Matt Tomasovich, PE
Building Official

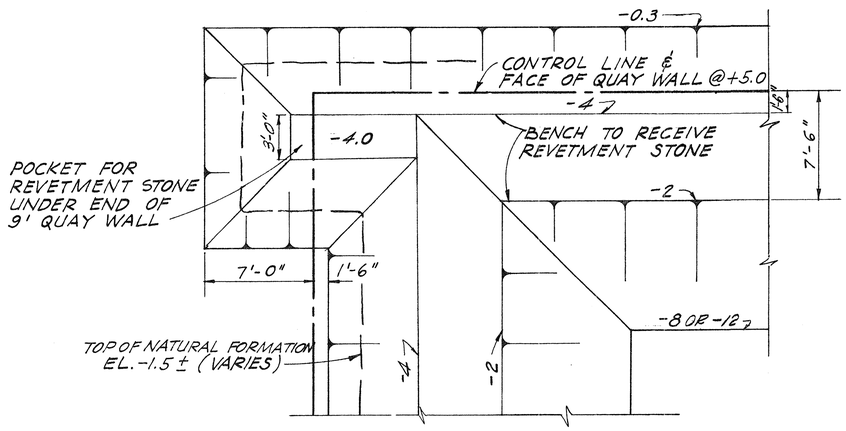

EARTHWORK PLAN A1 / 25

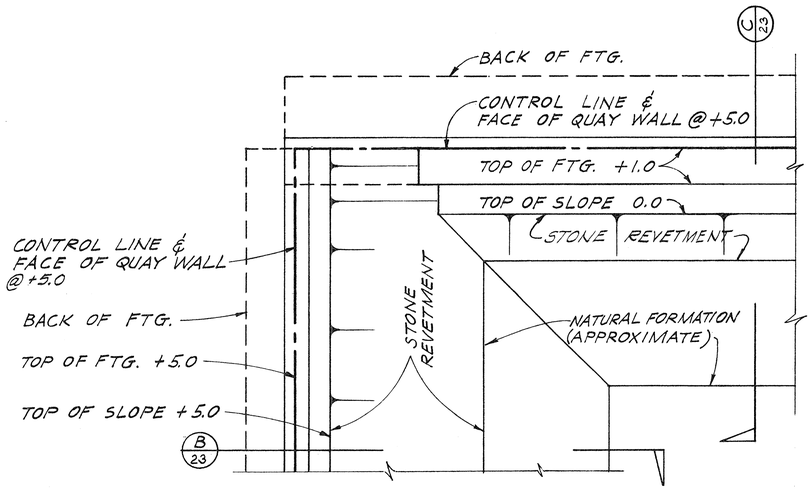

FINISH PLAN A2 / 25

TRANSITION A / 25 4, 11
B / 23 TO C / 23
1" = 5'

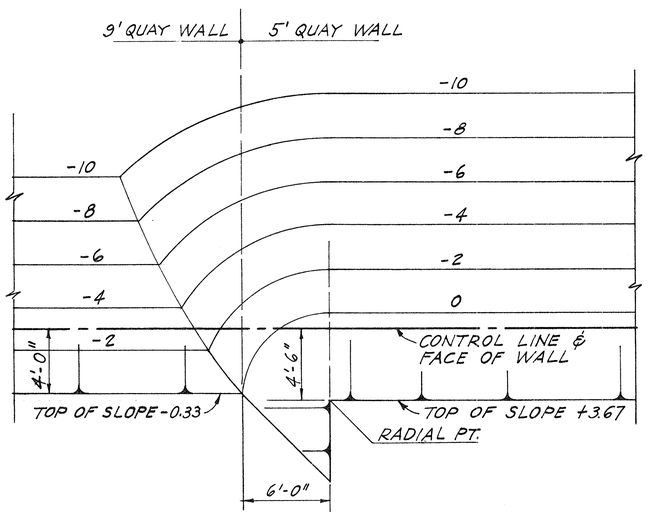

EARTHWORK PLAN B1 / 25

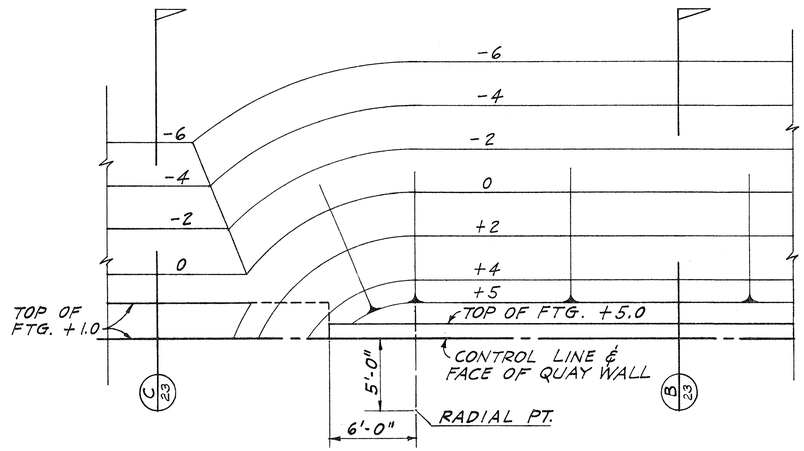

TRANSITION B / 25 4, 11
B / 23 TO C / 23
1" = 5'

FINISH PLAN B2 / 25

NOTE:
TOE ELEVATION VARIES AT THE VARIOUS LOCATIONS WHERE THESE DETAILS APPLY. CONTINUE EARTHWORK AND FINISH SLOPES DOWN TO PROPER ELEVATIONS FOR BENCH TO RECEIVE REVETMENT STONE AND FOR TOE OF SLOPE.

ASBUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

REVETMENT TRANSITION DETAILS II

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/628-3152

JOB NO. 1-417
DATE 9-24-68
APPROVED: Rodney L. Koebig
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 25 OF 50
D 10.5-1

Building&Safety- Ryan Rose 1/16/2020
Approval: Geotechnical Reports
Permit #
BWD21-01443/BWD21-01413/BWD21-01423/BWD21-0143
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of these plans and specifications must be kept on the job site at all times during construction. Any changes, modifications and/or deviations from the approved documents must be approved by the Building Official prior to doing the work listed. The approval of these plans and specifications does not permit the violation of any section of the California Building Code or other ordinance of the County of Orange.
Permit Technician
Building Services

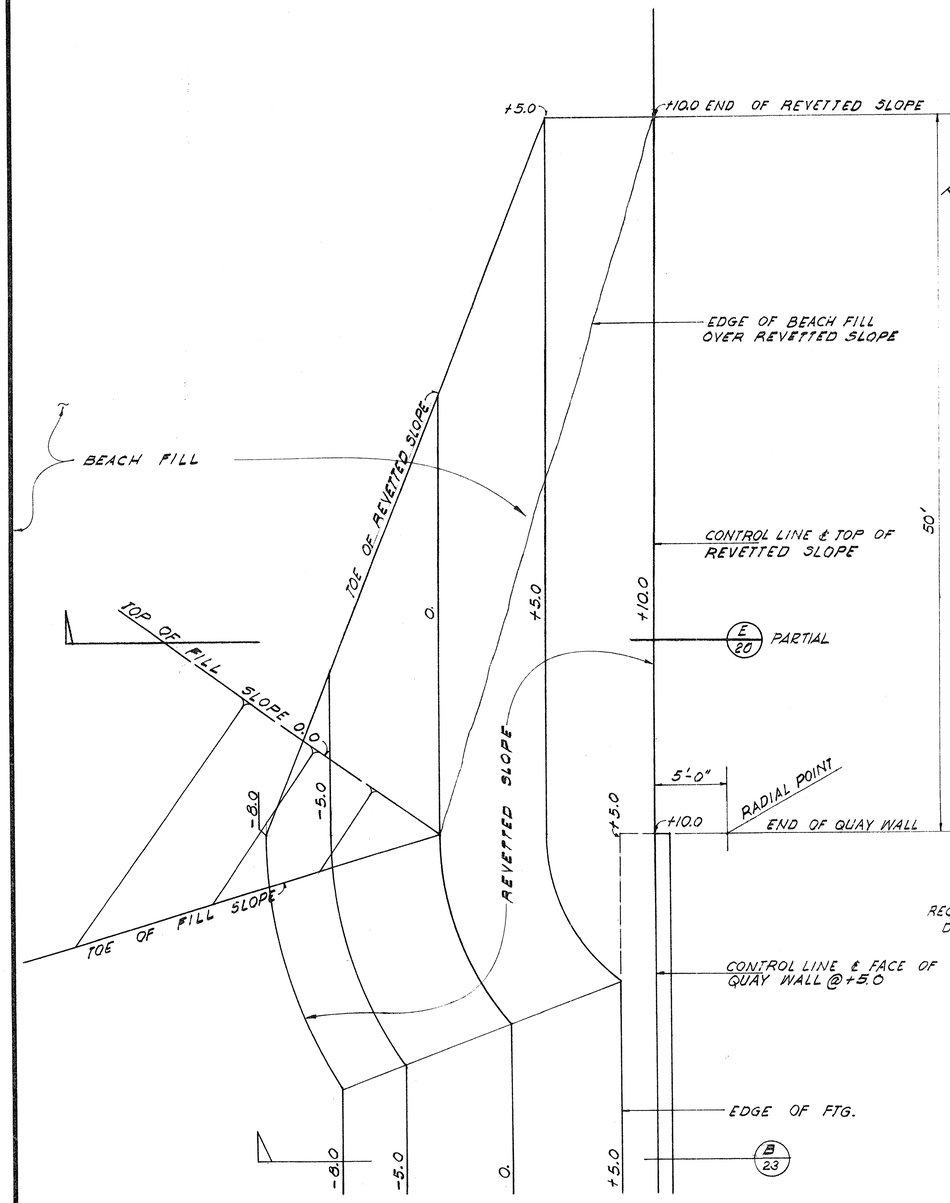

TRANSITION A 26 4,15
1" = 5'

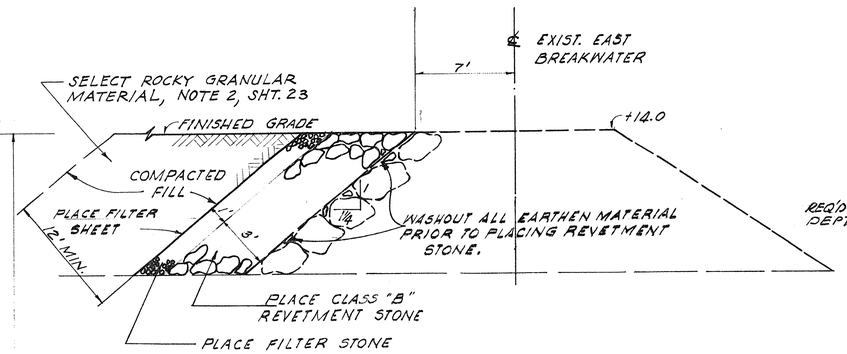

SEALING AT EAST & WEST BREAKWATERS
(TYPICAL THROUGHOUT LENGTH OF EARTH FILL)

SECTION B 26 4,8,11
1" = 5'

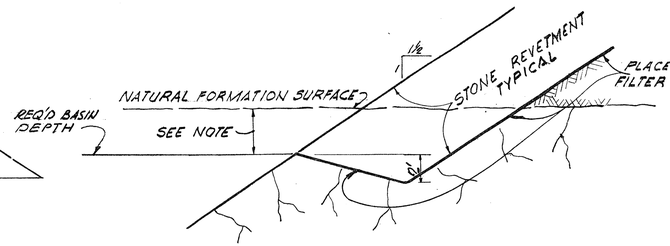

NOTE: REMOVE LOOSE, SOFT, OR WEATHERED MATERIAL AS NEEDED TO OBTAIN REASONABLY SOUND MATERIAL FOR FINISHED SURFACES.

SECTION C 26
1" = 5'

NATURAL FORMATION SURFACE

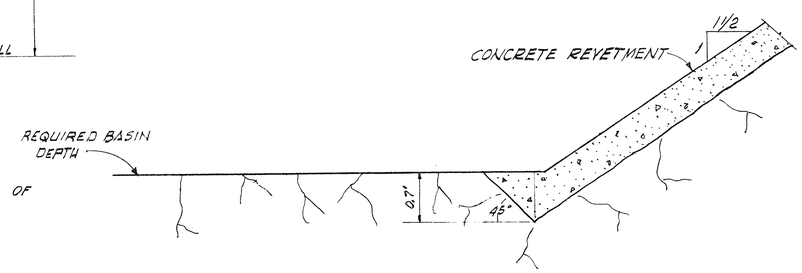

SECTION D 26 23
1" = 1'

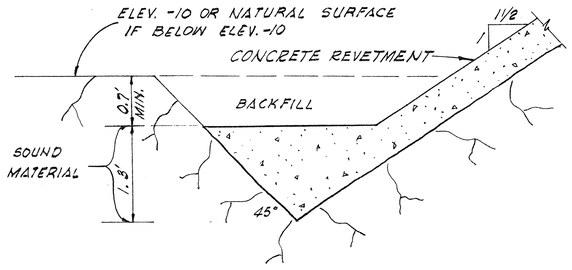

TOE DETAIL BELOW BRIDGE ABUTMENTS

SECTION E 26 13, 14
1" = 1'

ASBUILT SEP 2 8 '70

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

REVETMENT TRANSITION DETAILS III

JOB NO. 1-417 APPROVED:
DATE 9-24-68
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 26 OF 50
D 10.5-1

Building&Safety - Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
RMST2-03483RMST-03418RMST-03428RMST-0343

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be clear on the plans. Any deviation from the approved plans, or the use of alternate materials and methods without permission from the Building Official may result in the revocation of the permit. The permittee is responsible for all work performed under the permit and shall be responsible for any deviations from the approved plans.
Issued By: Date:
Neil Throedahl 1/16/2025

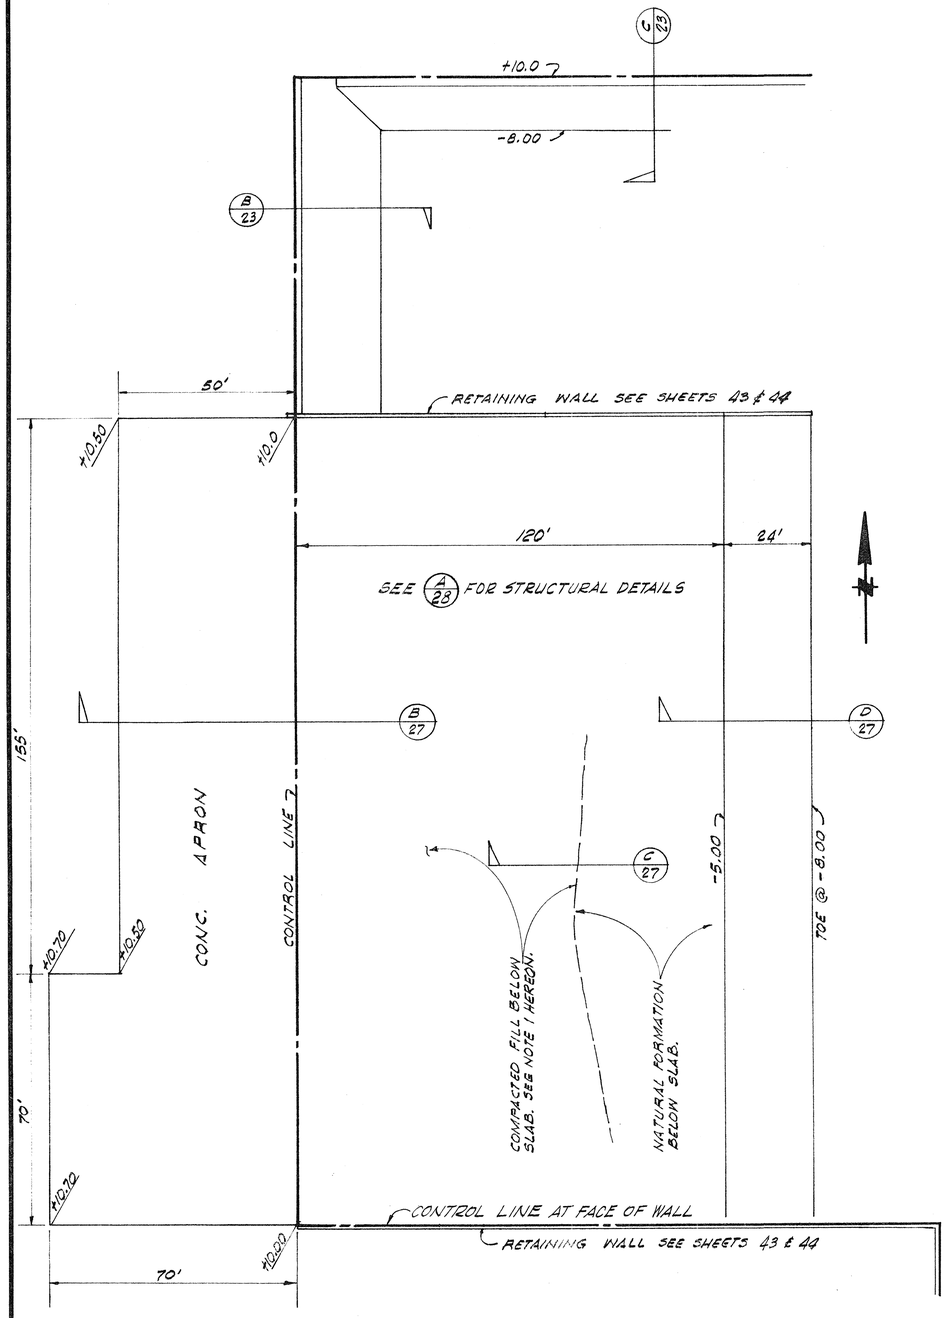

PLAN A / 27
1" = 20'

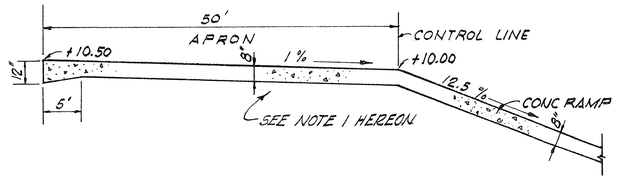

SECTION B / 27

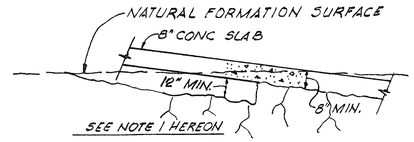

SECTION C / 27

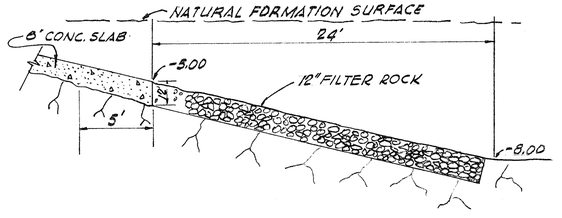

SECTION D / 27

NOTE:
1. PROVIDE A MIN. 12" THICK SUBGRADE LAYER OF GRANULAR FREE DRAINING MATERIAL BETWEEN COMPACTED FILL AND BOTTOM OF 8" CONC. PAVEMENT.

ASBUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

BOAT RAMP - PLAN & SECTIONS

JOB NO. 1-417
DATE 9-24-68
APPROVED: Rodney L. Koebig
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 27 OF 50
D10.5-1

Building&Safety- Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-03443/BWD21-03419/BWD21-03420/BWD21-0343

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. The approval of alternate specifications does not relieve the applicant of compliance with any applicable provisions of the California Building Code or other ordinances of this jurisdiction. The permittee is responsible for the protection of adjacent property and for safety on the job site. Approval of alternate specifications does not authorize violation of any law.
Inspector
Date/Time

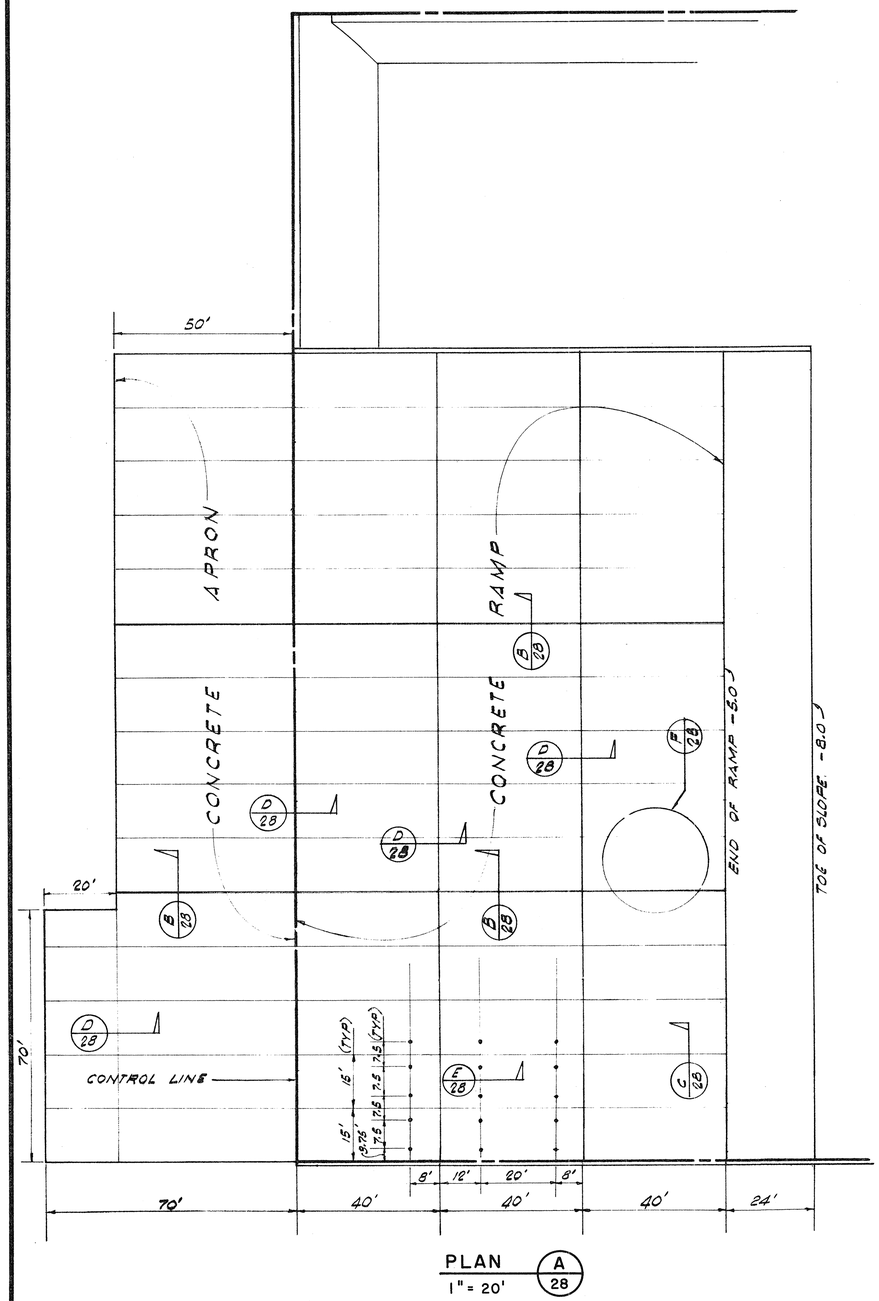

PLAN A
1" = 20'

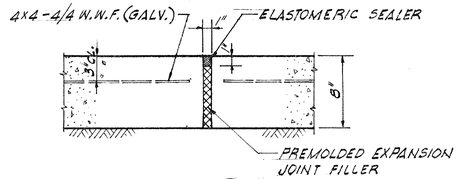

SECTION B 28

TYPICAL TRANSVERSE DUMMY CONTROL JOINT

SECTION C 28
1 1/2"= 1'-0"

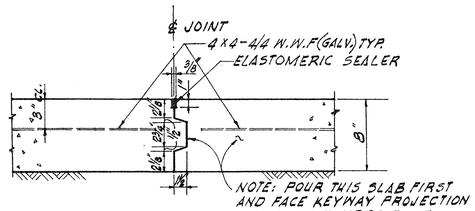

TYPICAL LONGITUDINAL CONSTRUCTION JOINT

SECTION D 28
1 1/2"= 1'-0"

2"Ø WEEP HOLE DETAIL

SECTION E 28
1 1/2"= 1'-0"

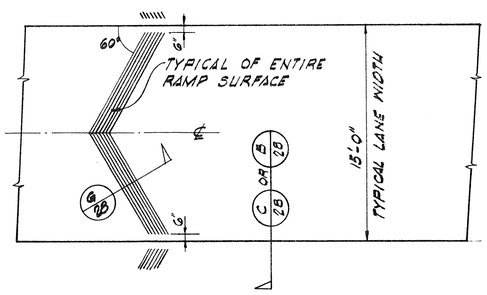

PLAN F
1"= 5'

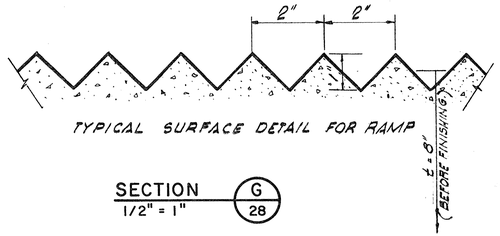

SECTION G 28
1/2" = 1"

ASBUILT SEP 23 1970

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213 / 629-3182

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

BOAT RAMP - DETAILS

JOB NO. 1-417
DATE 9-24-68
APPROVED: Kirby Koebig
DATE OCTOBER , 1968
SCALE AS SHOWN
SHEET 28 OF 50
D 10.5-1

Building&Safety - Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-03443;BWD21-03419;BWD21-03420;BWD21-0343

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve contractor from providing additional or substitute materials which may be required to comply with the intent of the plans and specifications. The contractor is responsible for all dimensions and conditions on the job and must report any discrepancies to the engineer before commencing work. The approval of these plans does not permit the violation of any ordinance or State Law.
Director, OC Development Services
Building and Safety

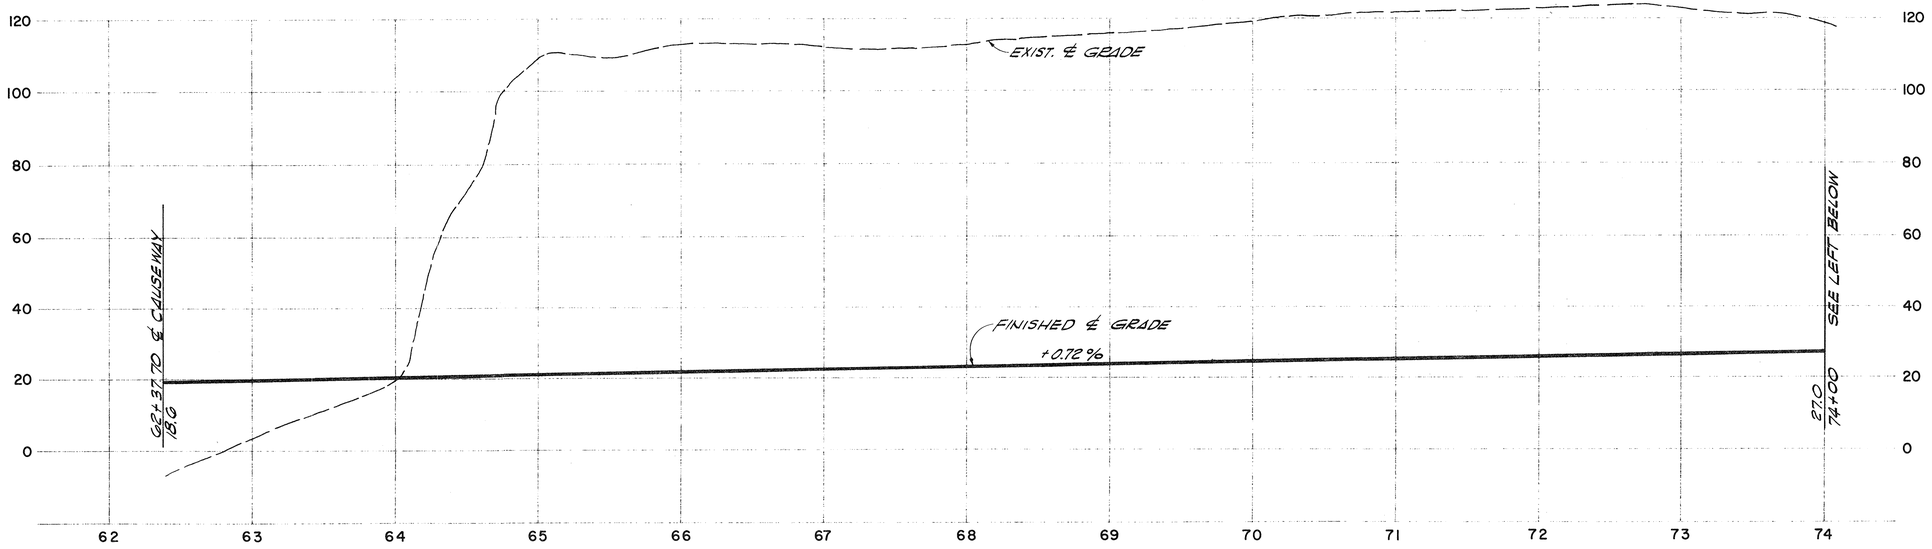

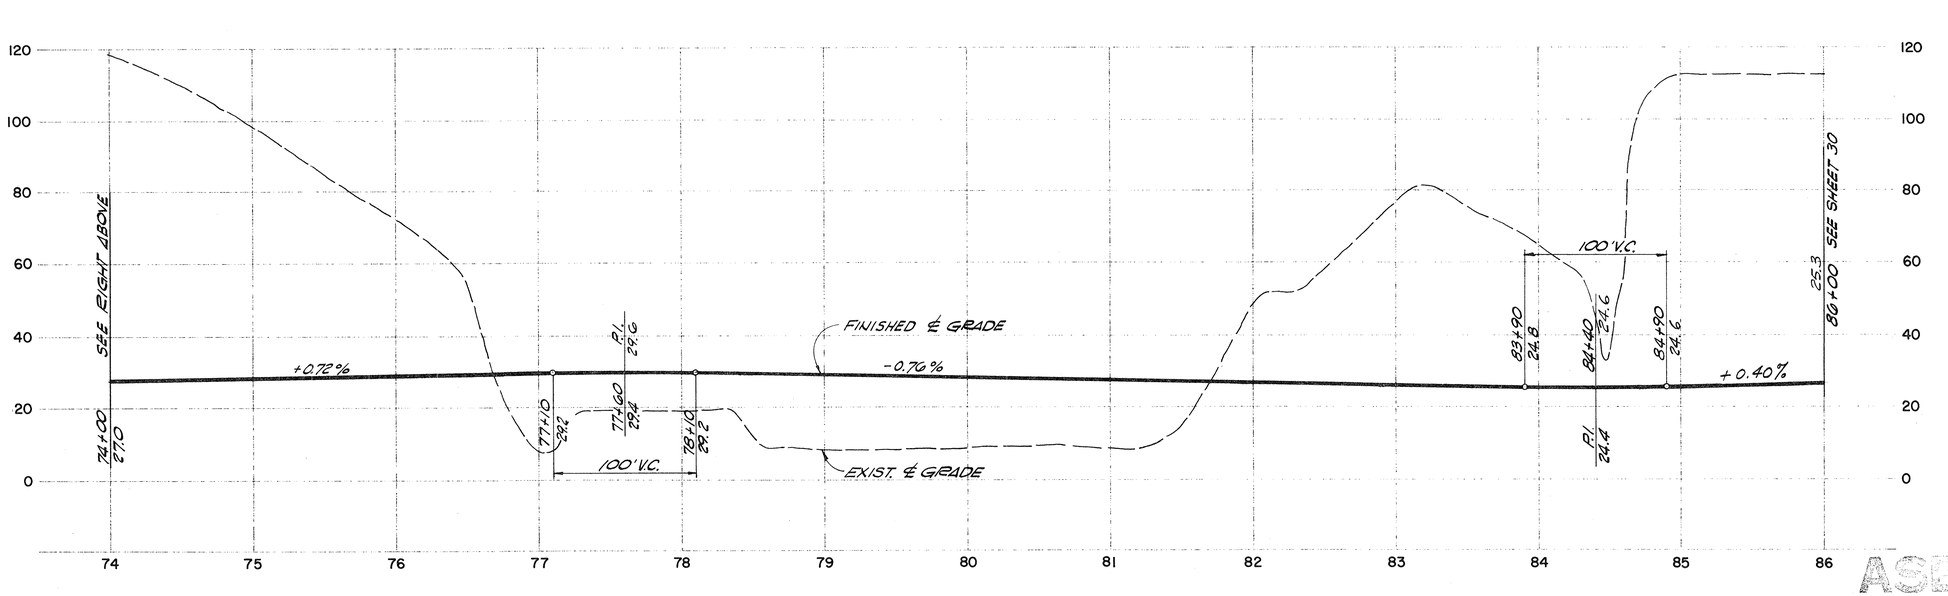

ASBUILT SEP

SCALE HORIZ. 1"= 50'
VERT. 1"= 20'

PLANS PREPARED BY	ORANGE COUNTY HARBOR DISTRICT
KOEBIG & KOEBIG, INC.	NEWPORT BEACH, CALIFORNIA
ENGINEERING ARCHITECTURE PLANNING	1901 BAYSIDE DRIVE 714/834-3800
LOS ANGELES CALIFORNIA	DANA POINT HARBOR
213/629-3182	DANA POINT, CALIFORNIA
	HEAVY CONSTRUCTION
	DEL OBISPO STREET - PROFILES I
JOB NO. 1-417 APPROVED: Rodney L. Koebig	DATE OCTOBER, 1968 SHEET 1
DATE 9-24-68	SCALE AS SHOWN 29 OF 50 D10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-03443/BWD21-03419/BWD21-03420/BWD21-0343
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve contractor of responsibility for compliance with all requirements of the applicable Code(s). The permittee is responsible for obtaining all necessary approvals from all governmental agencies. Approval of the plans does not permit the violation of any County ordinance.
Permit Technician
Reviewed by: CTM

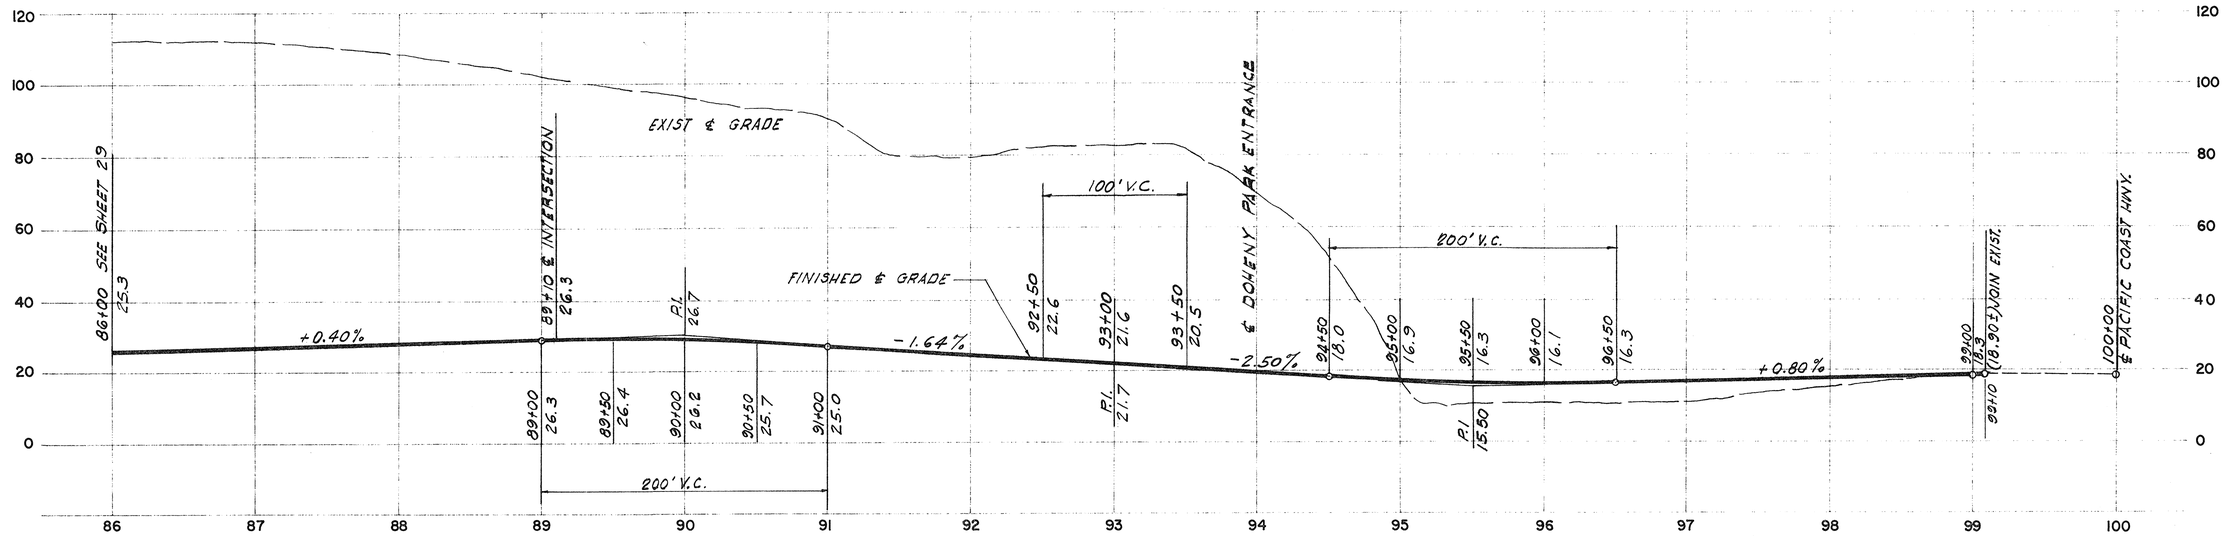

DEL OBISPO STREET

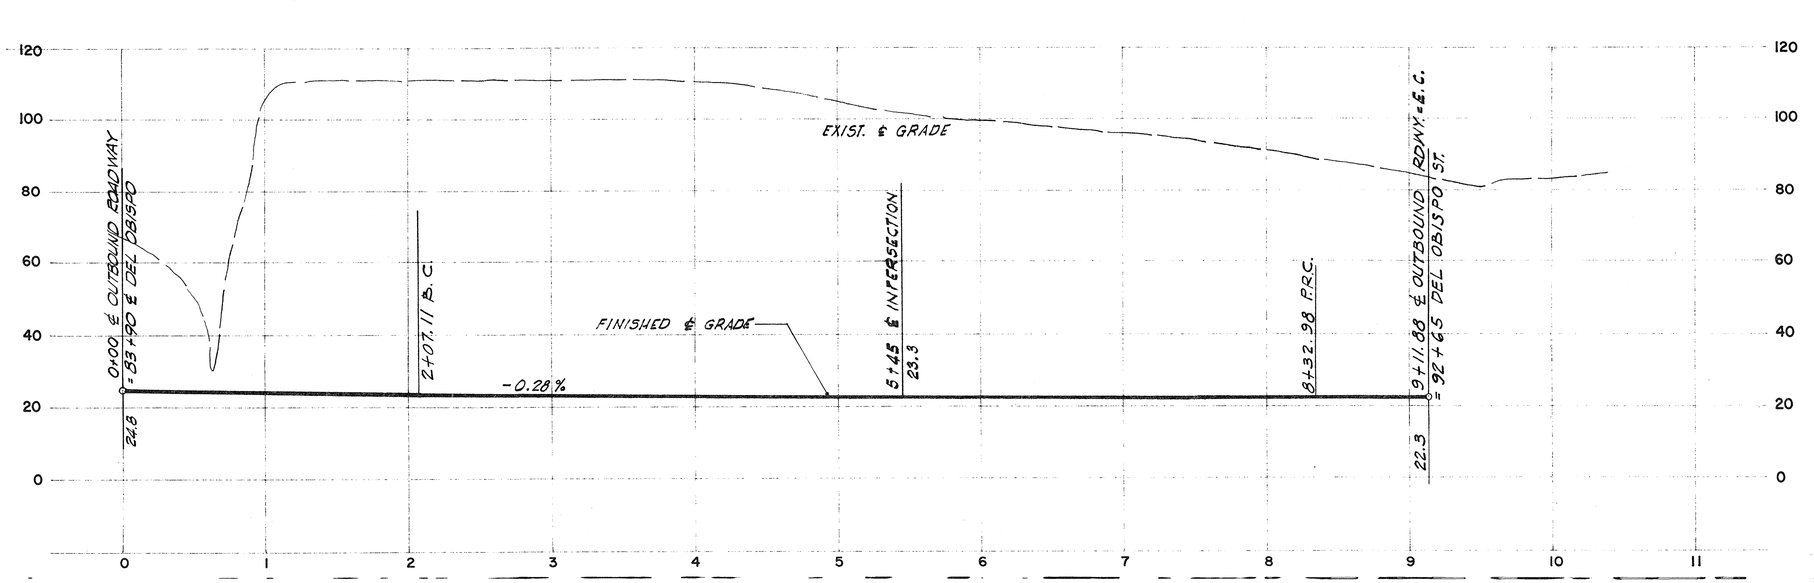

OUTBOUND ROADWAY

SCALE: HORIZ. 1"= 50'
VERT. 1"= 20'

ASBUILT

ORANGE COUNTY HARBOR DISTRICT NEWPORT BEACH, CALIFORNIA 1901 BAYSIDE DRIVE 714/834-3800	
PLANS PREPARED BY KOEBIG & KOEBIG, INC. ENGINEERING ARCHITECTURE PLANNING LOS ANGELES CALIFORNIA 213/628-3182	DANA POINT HARBOR DANA POINT, CALIFORNIA HEAVY CONSTRUCTION DEL OBISPO STREET - PROFILES II
JOB NO. 1-417 APPROVED: Rodney L. Koebig DATE 9-24-68	DATE OCTOBER, 1968 SCALE AS SHOWN SHEET 30 OF 56 D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-02439/BWD21-02419/BWD21-02420/BWD21-0243

County of Orange / OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve the engineer of responsibility for compliance with the requirements of the Building Code and other applicable laws. The approval of alternate specifications does not relieve the engineer of responsibility for the adequacy and accuracy of the engineering design.
Ted Tokunbow
Building Official

COORDINATE TABLE

POINT	NORTH	EAST	POINT	NORTH	EAST
1	2,520.00	10,400.00	15	2,000.00	9,960.00
2	3,037.35	10,107.81	16	2,000.00	9,140.00
3	2,000.00	9,535.00	17	2,000.00	8,330.00
4	~~2818.91~~ ~~2,845.08~~	~~938.33~~ ~~2,982.61~~	18	2,000.00	7,560.00
5	2,000.00	8,642.54	19	2,000.00	6,670.00
6	~~2,498.40~~	~~8,642.54~~	20	1,002.00	6,780.00
7	2,000.00	7,980.00	21	1,002.00	7380.00 ~~7,375.00~~
8	2,204.42	7,980.00	22	1,002.00	7,960.00
9	2,000.00	7,150.00 ~~7,145.00~~	23	1,002.00	8,470.00
10	2,431.46	7,150.00 ~~7,145.00~~	24	1,002.00	8,970.00
11	3,680.77	10,904.11	25	1,002.00	9,470.00
12	3,721.30	10,845.12	26	1,002.00	9,930.00
13	3,801.88	10,821.40	27	2,388.89 ~~2,266.00~~	9,535.00
14	1,954.44	10,620.00	28	1,762.00	5,806.70
			29	1,400.00	5,908.22 ~~5,906.22~~
			30	1,070.00	5,908.22 ~~5,906.22~~

(A)

E 8,000 · E 9,000 · E 10,000 · N 4,000 · N 3,000 · N 2,000 · N 1,000 · E 6,000 · E 7,000 · E 11,000

PACIFIC COAST HIGHWAY

DRAINAGE PLAN AND GRADING FOR THIS AREA SHOWN ON SHEETS 47 TO 50

B/35 INLET STRUCTURE
54" R.C.P. STORM DRAIN-LINE "A" SEE PLAN G/34
OUTLET STRUCTURE A/35
DOHENY BEACH STATE PARK

C/34 INLET STRUCTURE NO.1 (2)
A/34 INLET STRUCTURE NO.2 (4)
C/34 INLET STRUCTURE NO.1 (6)
C/34 INLET STRUCTURE NO.1 (10)
18" R.C.P. STORM DRAIN-LINE "B" SEE PROFILE B/32
D/34 STORM DRAIN OUTLET STRUCTURE (1)
60" R.C.P. STORM DRAIN-LINE "C" SEE PROFILE A/32
51" R.C.P. STORM DRAIN-LINE "F" SEE PROFILE A/33
18" R.C.P. STORM DRAIN-LINE "D" SEE PROFILE C/33
15" R.C.P. STORM DRAIN-LINE "E" SEE PROFILE B/33
D/34 STORM DRAIN OUTLET STRUCTURE (9)
D/34 STORM DRAIN OUTLET STRUCTURE (5)
BOAT RAMP
TYPE "F" OUTLET STRUCTURE E/34 (19)
TYPE "F" OUTLET STRUCTURE E/34 (17)
LINE "C" OUTLET STRUCTURE E/32 (3)
TYPE "F" OUTLET STRUCTURE E/34 (15)
TYPE "F" OUTLET STRUCTURE E/34 (14)
24" R.C.P. STORM DRAIN-LINE "G" SEE PROFILE F/32 (28)
BEACH
EXISTING PIER
TYPE "G" OUTLET STRUCTURE E/17-A (29) (30)
WEST BASIN
EAST BASIN
CAUSEWAY
TYPE "F" OUTLET STRUCTURE TYPICAL E/34 (20) (21) (22) (23) (24) (25) (26)
EAST BREAKWATER
WEST BREAKWATER
MAIN CHANNEL
DEL OBISPO
STREET
SANTA CLARA
LANTERN
RUBY
BLUE
AMBER

PLAN A/31
1" = 200'

LEGEND

- STORM DRAIN
- M.H.
- (3) COORDINATE POINT

STORM DRAIN GENERAL NOTES

1. STATIONS SHOWN ON THE STORM DRAIN PLANS ARE ALONG THE CENTERLINE OF CONDUIT OR ON A LINE NORMAL TO THE CENTERLINE OF THE CONDUIT.
2. MANHOLES SHALL BE CONSTRUCTED ACCORDING TO ORANGE COUNTY HIGHWAY DEPARTMENT STANDARD PLAN NOS. 508, 505, 507, AND 510 WHERE THE STORM DRAIN CONDUIT IS 24" OR SMALLER. FOR LARGER SIZE CONDUIT, MANHOLES SHALL BE CONSTRUCTED ACCORDING TO DETAIL.
3. WHERE REINFORCED CONCRETE PIPE HAS A DEFLECTION GREATER THAN 5° USE CONCRETE COLLAR PER DETAIL.

ASBUILT

REV.	DESCRIPTION	DATE
(A)	ADDED FILL WEST END	9-19-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

JOB NO. 1-417 APPROVED: Rodney P. Koebig
DATE 9-24-68

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

DRAINAGE PLAN

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 31 OF 51
D10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or Statute.
Hadi Tabatabaee
BUILDING OFFICIAL

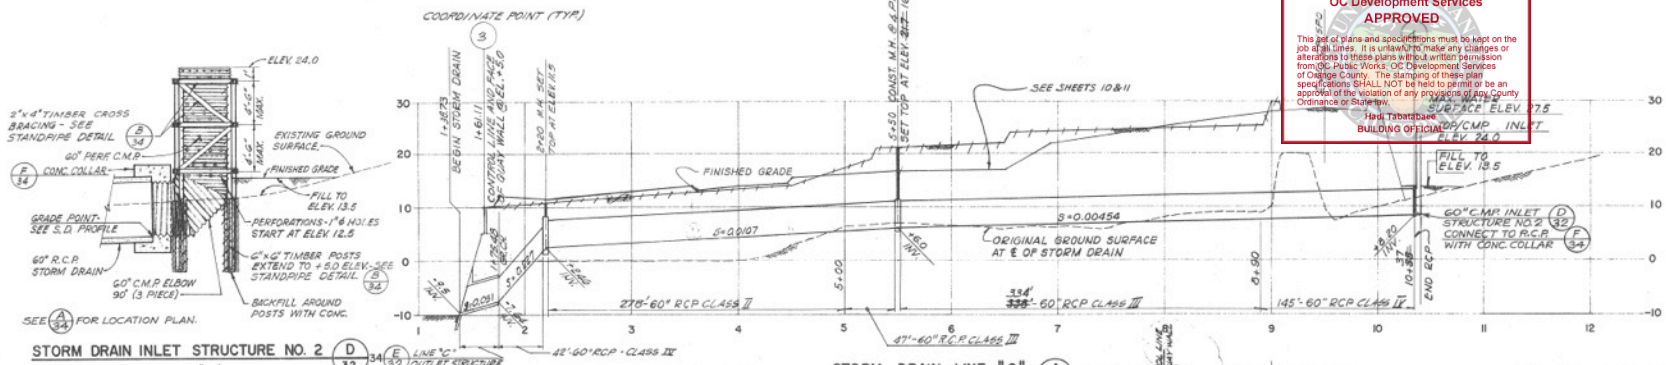

STORM DRAIN INLET STRUCTURE NO. 2 (D/32) (E/32) SCALE: 1"=5'

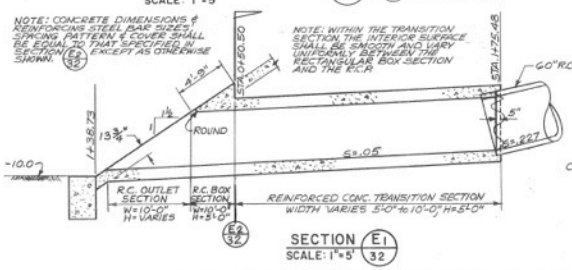

SECTION (E1/32) SCALE: 1"=5'

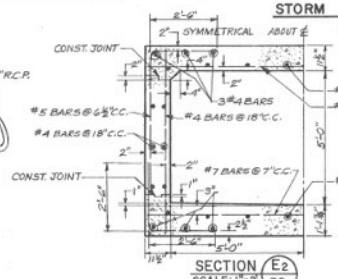

SECTION (E2/32) SCALE: 1"=2'

STORM DRAIN LINE "C" (A/32) 10,11,31,34 PROFILE

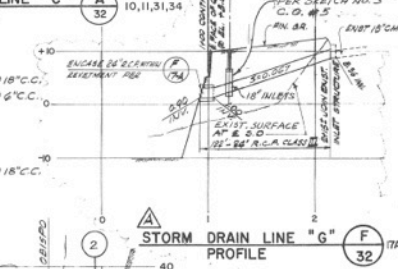

STORM DRAIN LINE "G" (F/32) (7A,31) PROFILE

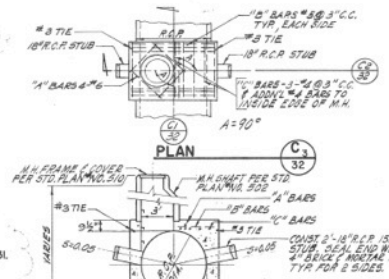

* STD. PLAN REFERS TO THE LATEST REVISED STANDARD PLANS OF THE ORANGE COUNTY HIGHWAY DEPARTMENT AS ADAPTED BY THE ORANGE COUNTY BOARD OF SUPERVISORS.

SPECIAL OUTLET STRUCTURE FOR STORM DRAIN LINE "C" (E/32) 31

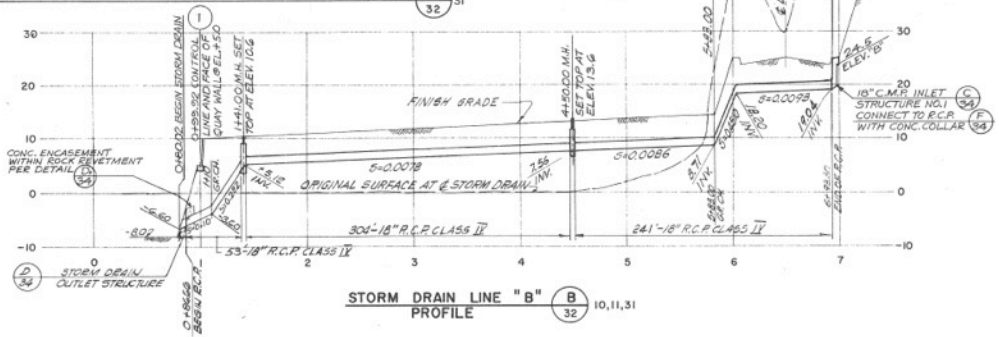

STORM DRAIN LINE "B" (B/32) 10,11,31 PROFILE

TYPICAL STORM DRAIN MANHOLE FOR DIAMETER LARGER THAN 24" (C/32) NO SCALE

REV.	DESCRIPTION	DATE
A	ADDED S.D. LINE "G"	9-19-69

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-2102

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

DRAINAGE PROFILES I

JOB NO. 1-417 DATE 9-24-68 APPROVED
DATE OCTOBER, 1968 SCALE AS SHOWN
SHEET 32 OF 51
D10.5-1

SCALE HORIZ. 1"=50' VERT. 1"=10'

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
B#21-034438/B#21-034189/B#21-034188/B#21-0343

County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be approved by the Building Official. Approval of alternate specifications does not relieve the contractor of responsibility for compliance with all applicable codes, ordinances and regulations. The approval of plans and specifications does not permit the violation of any section of these codes, ordinances or regulations.
Ina Trevizan
Building Official

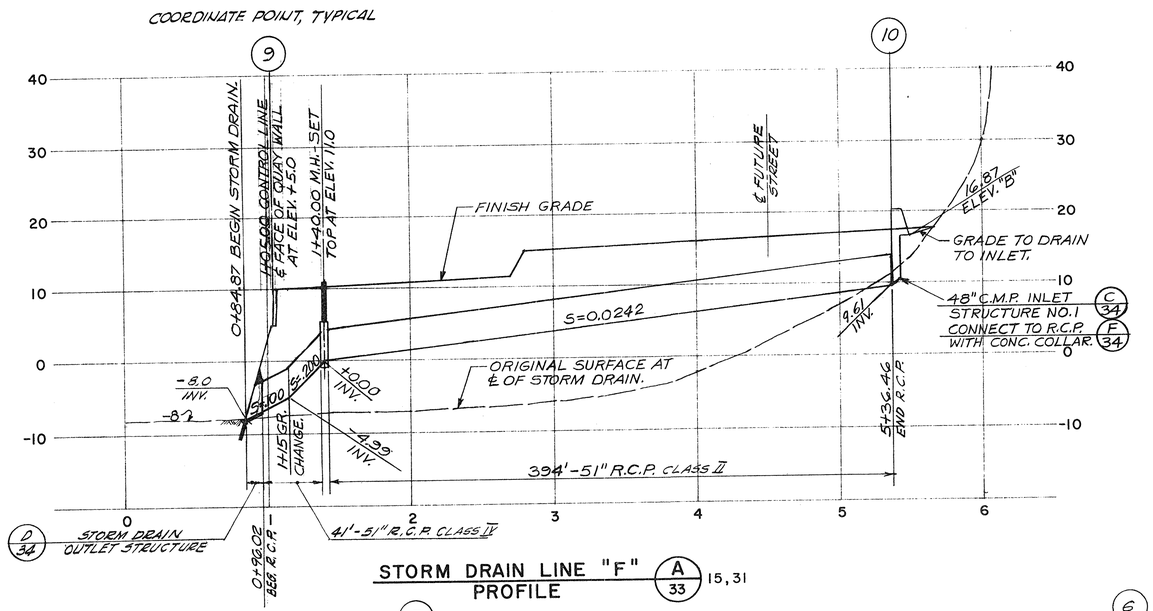

STORM DRAIN LINE "F" PROFILE (A 33) 15,31

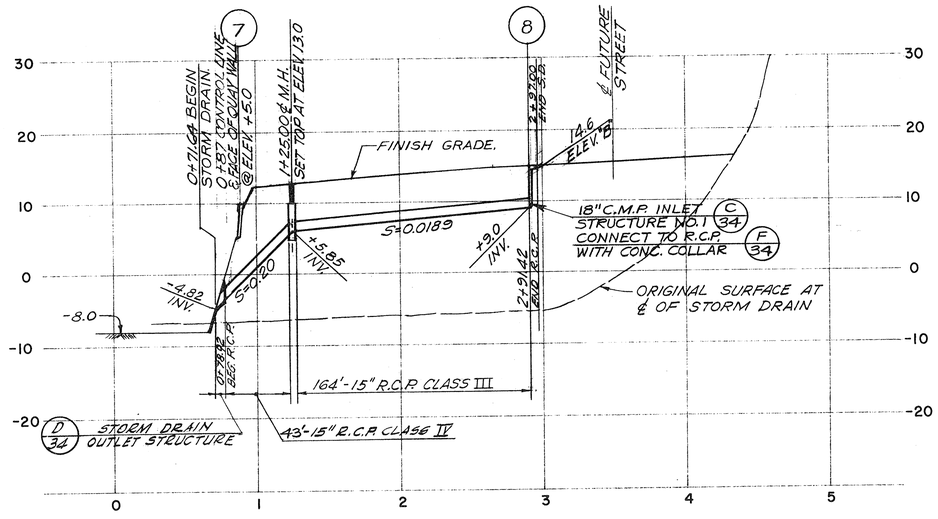

STORM DRAIN LINE "E" PROFILE (B 33) 13,31

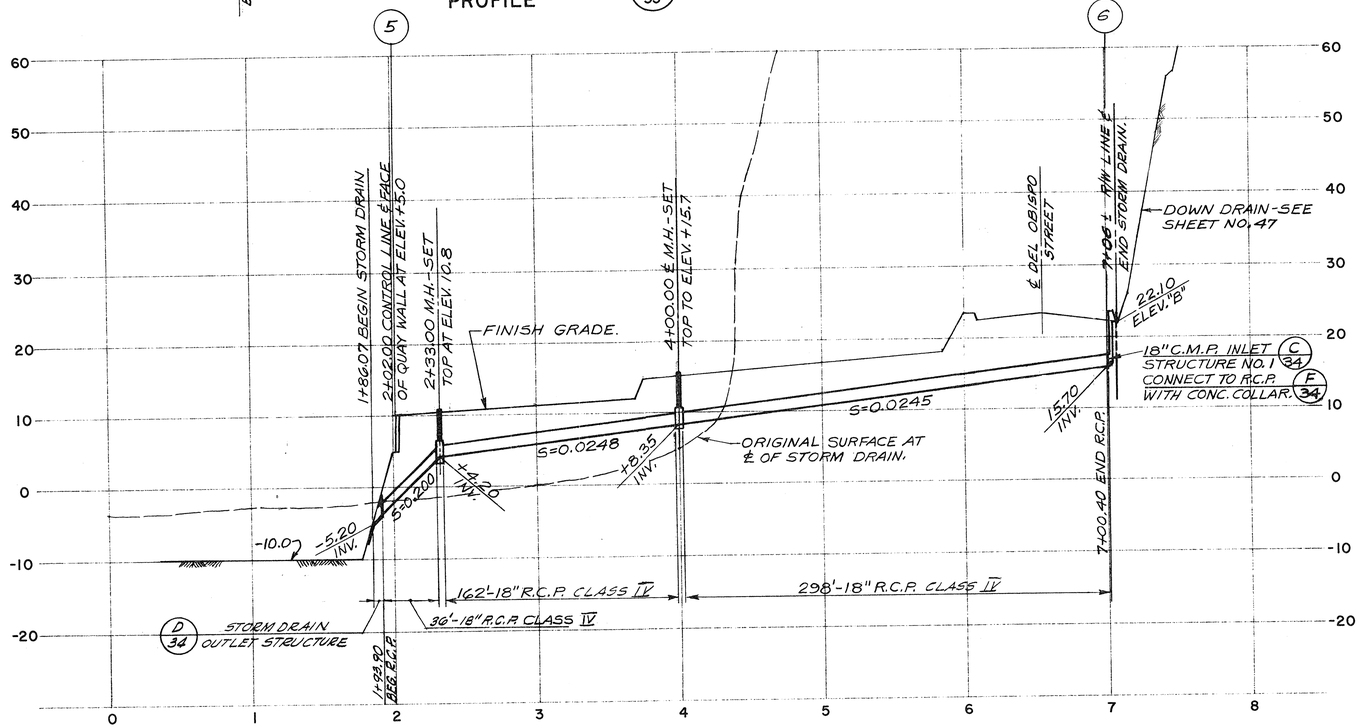

STORM DRAIN LINE "D" PROFILE (C 33) 9,13,31

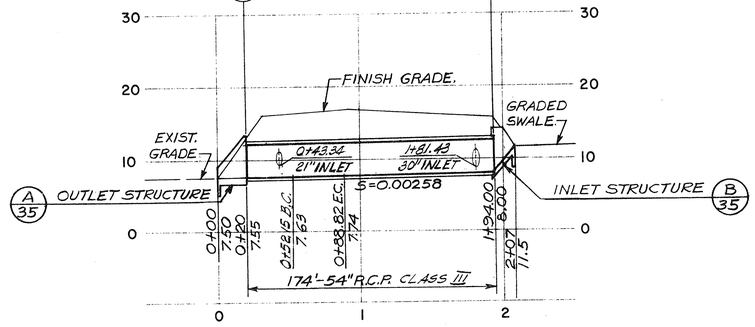

STORM DRAIN LINE "A" PROFILE (D 33) 9,31,34

FOR PLAN - SEE (G 34)

HORIZ. 1"=50'
SCALE:
VERT. 1"=10'

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

DRAINAGE PROFILES II

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

JOB NO. 1-417 DATE 9-24-68 APPROVED:
DATE OCTOBER, 1968 SCALE AS SHOWN
SHEET 33 OF 58
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations on these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hong Tabatabaee
BUILDING OFFICIAL

NOTES:
a. ALL LUMBER SHALL BE DOUGLAS FIR, "CONSTRUCTION GRADE."
b. ALL LUMBER SHALL BE BRUSH COATED WITH CREOSOTE PRESERVATIVE, AASHO, M133.
c. NAILS SHALL BE STEEL COMMON WIRE NAILS.
d. PROVIDE A MINIMUM OF 3-16d NAILS AT EACH BRACING MEMBER TO POST.

POSTS SHALL BE INSTALLED AS FOLLOWS:
1. BACKFILL PIPE TRENCH.
2. DRILL 12"ϕ POST HOLE.
3. INSTALL WOOD POST AND FILL HOLE WITH CONCRETE.

CONTOURS PER SHEET 47

STORM DRAIN INLET STRUCTURE NO. 2 (D/32 B/34)

60"R.C.P. STORM DRAIN LINE TO BE - SEE PROFILE (A/32)

DEL OBISPO — STREET

MIN. 3-16d TOE NAILS AT EACH BLOCK.
2"x4" WOOD BRACING
#3 BARS @ 6" C.C. ACROSS TOP-WELD TO C.M.P.
6"x6" BLOCKING
6"x6" SUPPORT POSTS
60"ϕ C.M.P. PERFORATED

PLAN (B1/34)

#3 BARS @ 6" O.C.
6"x6" BLOCKING
2"x4" BRACING
6"x6" SUPPORT POSTS
60" PERF. C.M.P.

NOTE:
PERFORATIONS IN C.M.P. TO BE 1"ϕ HOLES, 9" C.C. EACH WAY, OFFSET ADJACENT ROWS. HOLES TO BE DRILLED ALL AROUND PIPE FROM GROUND LINE TO 1'-0" BELOW TOP OF PIPE.

ELEVATION (B1/34) NO SCALE

STANDPIPE DETAIL (B/34) NO SCALE

STATION POINT, COORDINATES SHOWN ON PLAN ARE TO THIS POINT

STD. ARMCO END SEC. FOR C.M.P. OR EQUAL (C/34)

GALV. PROTECTION BARS

ANGLE "A" TO BE FIELD DETERMINED.

PLAN (C2/34)

COPR. METAL BAND CONNECTOR FOR SIZES 24"ϕ & SMALLER
STD. ARMCO END SEC. FOR C.M.P. OR EQUAL
GRADE TO JOIN FINISHED GRADE.
POINT 'B'
SLOPE 1/2" PER FT.
CONST. BERM TO JOIN FINISHED GRADE.
#4 BARS @ 8" O.C. WELDED TO C.M.P.
COPR. METAL 2-PC. 90° ELBOW
APPROX. GROUND LINE
SEE S.D. PROFILES
COPR. METAL BAND CONNECTOR
COPR. METAL 3-PC. 90° ELBOW
R.C. PIPE
SEE S.D. PROFILES
ELEV. SHOWN ON S.D. PROFILE.
CONC. COLLAR (F/34)

SECTION (C1/34)

INLET STRUCTURE NO. 1 (C/34 31,32,34) NO SCALE

SECTION (D1/34)

PLAN (D2/34)

STORM DRAIN LINE

SECTION (D3/34)

* WHEN OUTLET OCCURS IN STONE REVETMENT (LINE 'B' & TYPE 'F' OUTLET AT COOR. PT. 14) ENCASE R.C.P. DRAIN FOR FULL WIDTH OF STONE REVETMENT. ENCASEMENT SHALL BE EQUAL TO SECTION

CONC. OR STONE REVETMENT

SECTION (D4/34)

NOTE: OMIT APRON WHERE THRUST FOOTING OCCURS.

THRUST FOOTING (A/23)

TYPICAL STORM DRAIN OUTLET STRUCTURE (D/34 31,32,33) NO SCALE

S.D. LINE	R.C.P. SIZE	SLOPE	ELEV. INV.	Y	T
"B"	18"ϕ	0.100	-0.60	2'-10"	2'-1"
"C"	SPECIAL STRUCTURE-SEE (B/32)				
"D"	18"ϕ	0.200	-5.2	3'-7⅝"	1'-7⅝"
"E"	18"ϕ	0.200	-4.82	3'-6⅞"	1'-7⅝"
"F"	54"ϕ	0.100	-8.0	8'-0"	2'-11⅝"
TYPE "F" OUTLET STRUCT.	15"ϕ	0.300	-4.4	6'-1"	1'-8"

INLET NO.2 LOCATION PLAN (A/34 31,32) 1"=20'

17 — COORDINATE POINT (TYP.)
FINISH GRADE
14.75' CONTROL LINE OF FACE OF QUAY WALL @ +5.0 ELEV.
BRICK & MORTAR SEAL
CONC. OF STONE REVETMENT
12"C.M.P. DOWN DRAIN
MORTAR SEAL
4'x4'x3" CONC.
ON OUTLET STRUCTURE AT COORDINATE POINT (14) ENCASE 15"R.C.P. WITHIN ROCK REVETMENT PER DETAIL (F/34)
26"-18" R.C.P. CLASS III
7.99' CONST. OUTLET STRUCT. EQUAL TO S.D. OUTLET STRUCT. PER (D/34)

TYPICAL TYPE "F" OUTLET STRUCTURE (E/34 31) 1"=5'

WARP SLOPE FROM 21" TO 21" OVER CONDUIT AND EQUALENT TO OUT. ST.

TOP OF SLOPE
INLET STRUCTURE (D2/34)
ST. STA. 0+00.53 INT. ANGLE 85°
GRADE EL. TO DRAIN 5'-0.005 MIN.
TOE OF SLOPE
TOP OF SLOPE
12"-0.00 END STRUCTURE
#12 BARS
#12 BARS
#12 BARS

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

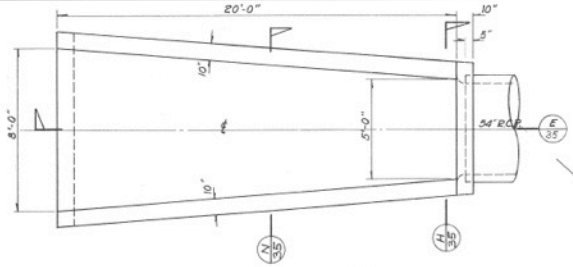

OUTLET STRUCTURE - PLAN (A 35) 31, 33, 34
3/8"=1'-0"

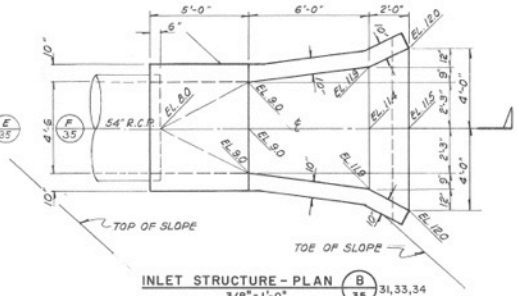

INLET STRUCTURE - PLAN (B 35) 31, 33, 34
3/8"=1'-0"

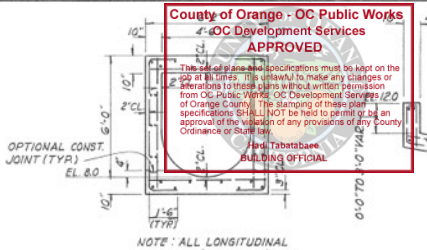

NOTE: ALL LONGITUDINAL BARS ARE #4 @ 18" O.C. (TYP.) ALL TRANSVERSE BARS ARE #4 @ 12" O.C. E.F. (TYP.)

SECTION (C 35)
3/8"=1'-0"

SECTION (D 35)
3/8"=1'-0"

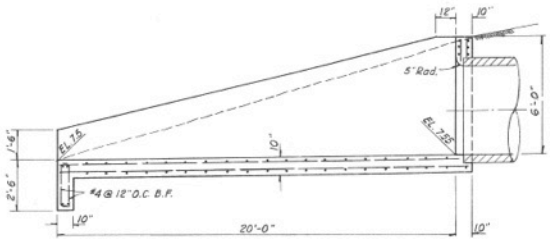

OUTLET STRUCTURE - SECTION (E 35)
3/8"=1'-0"

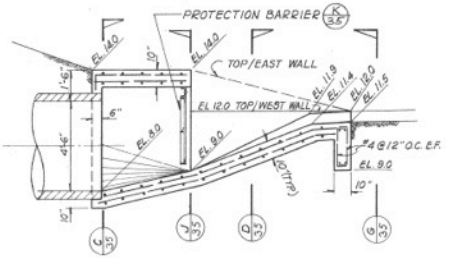

INLET STRUCTURE - SECTION (F 35)
3/8"=1'-0"

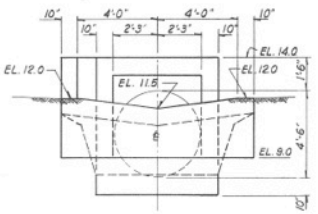

SECTION (G 35)
3/8"=1'-0"

PROTECTION BARRIER NOTES

1. ANGLES CONNECTED WITH SHEAR PINS SHALL FIT SNUGLY & TRULY FACE TO FACE.
2. SHEAR PIN HOLES TO BE DRILLED TO PROVIDE A TIGHT FIT WITH SHEAR PINS IN PLACE.
3. SHEAR PINS SHALL BE PEENED ON BOTH ENDS AFTER INSTALLATION.
4. ALL 5/8" ϕ BOLT HOLES SHALL BE DRILLED ON GAGE LINES OF ANGLES.
5. ALL BOLTS SHALL BE 5/8" ϕ EMBEDDED A MIN. OF 4" INTO CONCRETE, OR EQUIVALENT EXPANSION BOLTS FURNISHED WITH HEX NUTS & 3"ϕ MIN. THK. METAL WASHERS.
6. FRAME, BRACE, & HINGE ANGLES SHALL HAVE THE OUTSTANDING LEGS FACING IN DIRECTION OF FLOW.
7. THREAD ENDS OF HINGE PIN SO THAT NUTS & WASHERS WILL BE FLUSH WITH HINGE ANGLE. DAMAGE THREADS BEYOND NUT FACE USE BOLT STOCK FOR PINS.
8. GALVANIZE ALL FERROUS PARTS AFTER FABRICATION.
9. COVER ALL MOVABLE CONTACT SURFACES WITH A COAT OF WATERPROOF GREASE PRIOR TO INSTALLATION.
10. SHEAR PIN MATERIAL SHALL BE ALUMINUM WIRE, ALLOY 6061, TEMPER O, FED. SPEC. QQ-A-411.

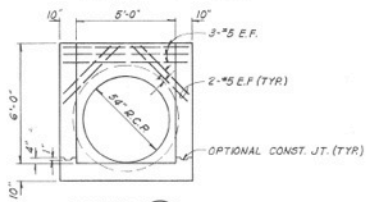

SECTION (H 35)
3/8"=1'-0"



SECTION (J 35)
3/8"=1'-0"

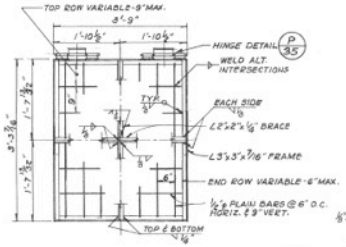

PROTECTION BARRIER DETAIL (K 35)
3/8"=1'-0"

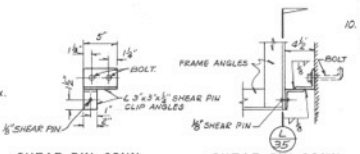

SHEAR PIN CONN. DETAIL (L 35)
1 1/2"=1'-0"

SHEAR PIN CONN. DETAIL (M 35)
1 1/2"=1'-0"

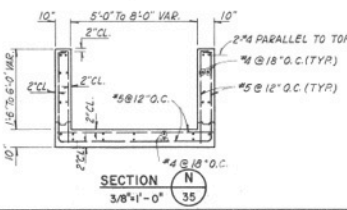

SECTION (N 35)
3/8"=1'-0"



HINGE DETAIL (P 35)
1 1/2"=1'-0"

SECTION (Q 35)
1 1/2"=1'-0"

AS BUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

DRAINAGE DETAILS II

JOB NO. 1-417
DATE 9-24-68
APPROVED
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 35 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #:
BWD21-02443/BWD21-02419/BWD21-02420/BWD21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times during construction. It is unlawful to make changes or alterations on same, or to deviate therefrom, except after obtaining written approval. The approval of these plans does not permit the violation of any section of any building, zoning, or other ordinance of the County of Orange.
Inspection Required
Inspector: Trent Tomlinson
Inspection: 24 hours

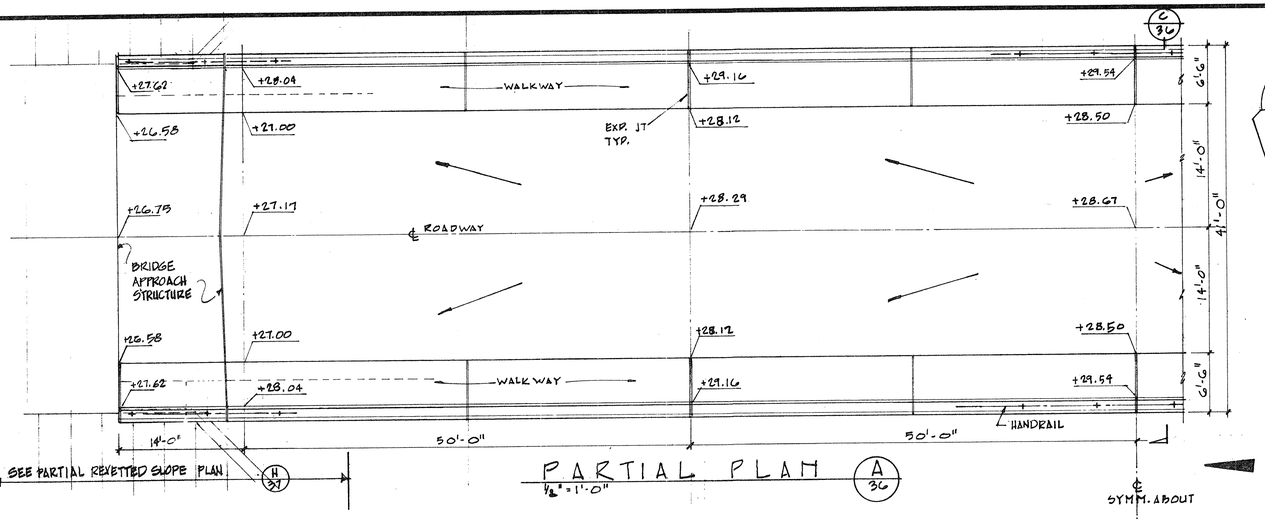

PARTIAL PLAN
1/8" = 1'-0"
A 36

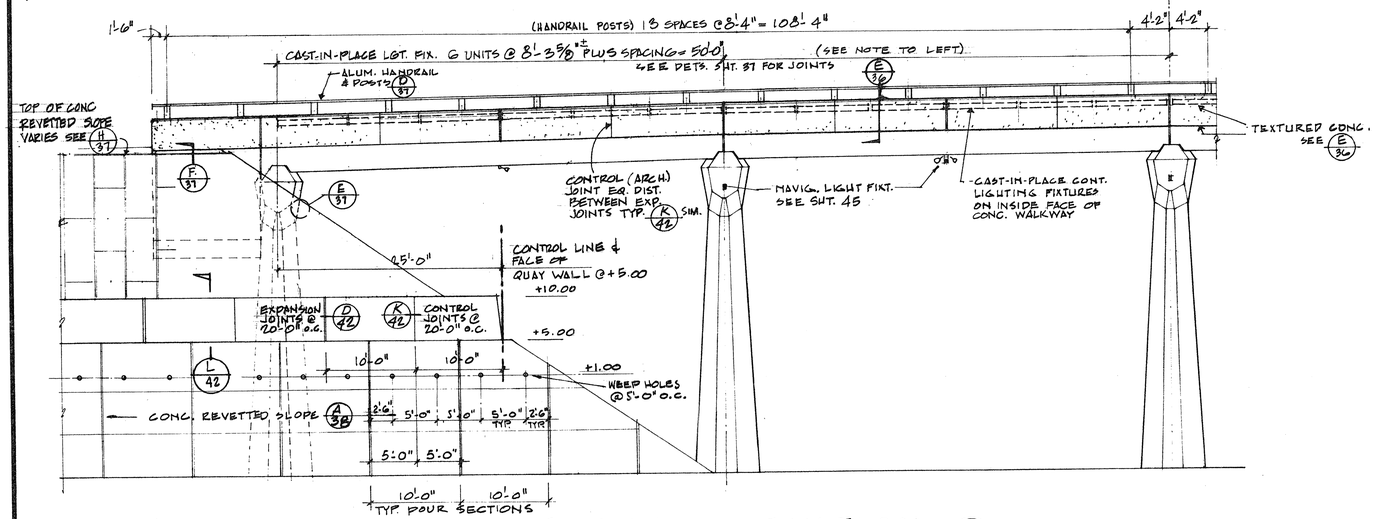

PARTIAL ELEVATION
1/8" = 1'-0"
B 36

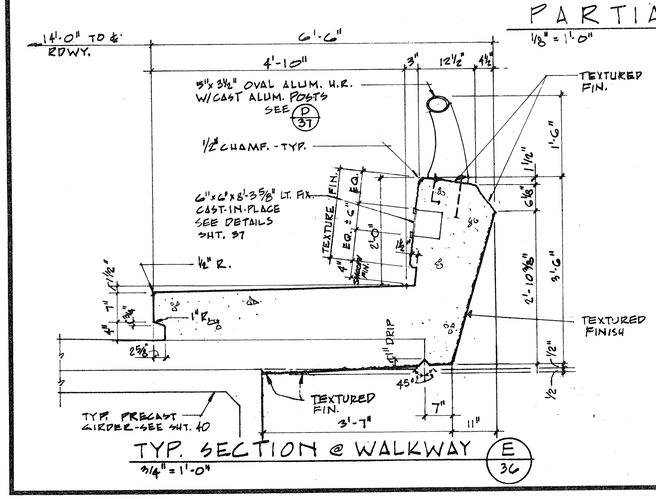

TYP. SECTION @ WALKWAY
3/4" = 1'-0"
E 36

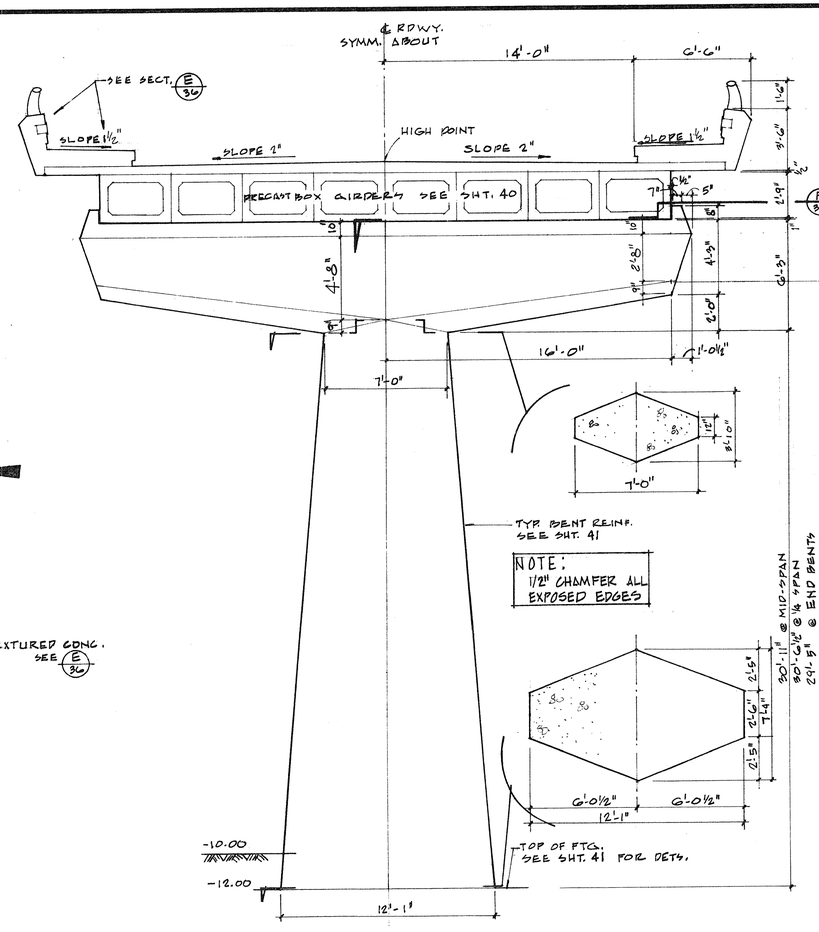

BENT ELEVATION
1/4" = 1'-0"
C 36

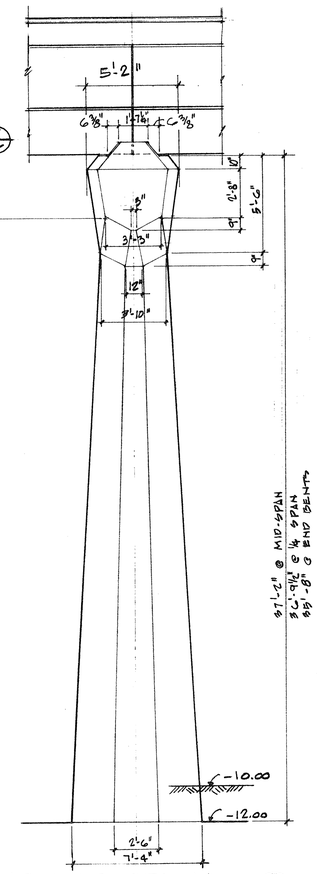

BENT ELEVATION
1/4" = 1'-0"
D 36

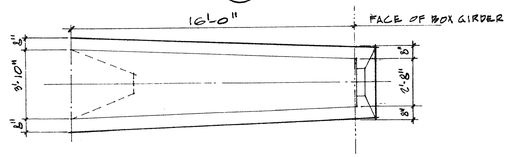

PLAN
1/4" = 1'-0"
F 36

AS BUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
BRIDGE
ARCHITECTURAL PLAN, ELEVATION AND MISCELLANEOUS DETAILS

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/628-3182

JOB NO. 1-417
DATE 9-24-68
APPROVED:
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 36 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans & specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or state law.

Hadi Tabatabaee
BUILDING OFFICIAL

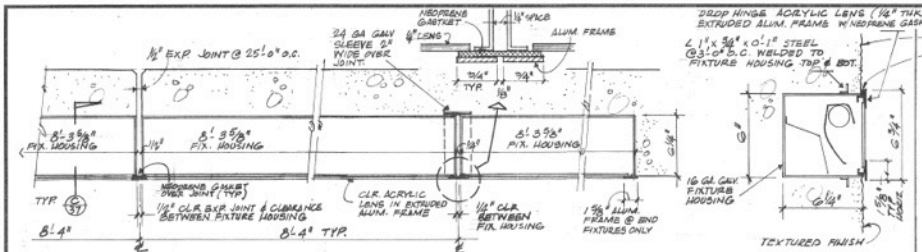

LIGHT FIXTURE @ EXP. JOINT (PLAN SECTION) 1½" = 1'-0" (A/37)

TYP. LIGHT FIXTURE SPACING (PLAN SECTION) 1½" = 1'-0" (B/37)

TYPICAL SECTION (C/37)

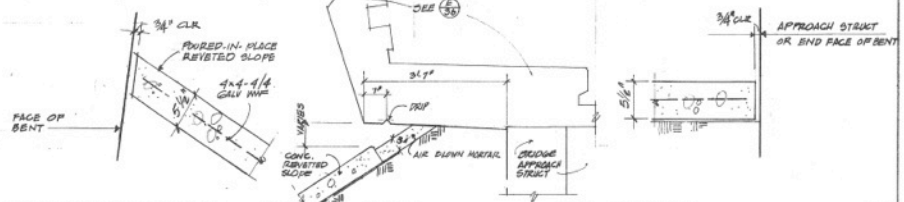

CONC. APRON @ FACE OF BENT 1½" = 1'-0" (E/37)

SECTION ¾" = 1'-0" (F/37)

SECTION 1½" = 1'-0" (G/37)

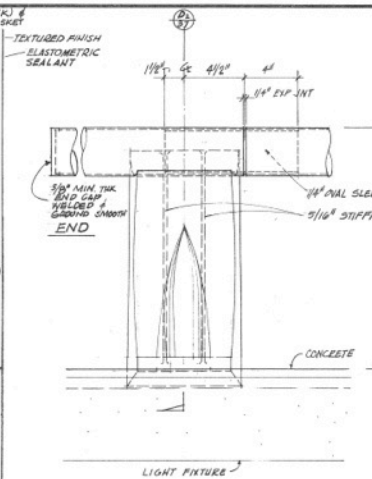

FRONT ELEVATION ¾" = 1'-0" (D1/37)



SECTION ¾" = 1'-0" (D2/37)

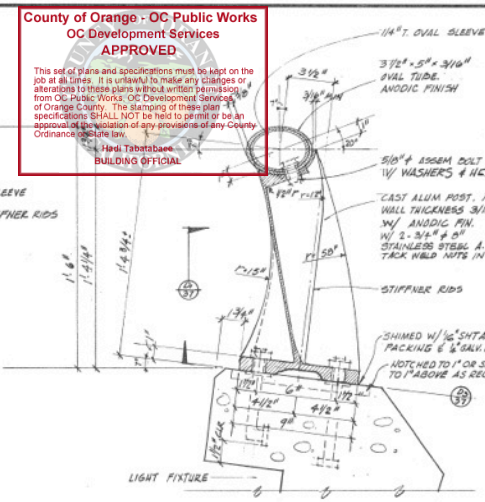

NOTE: RAILING & POST SIM. TO (MIN. THICKNESS, RADII ETC.) STATE OF CALIFORNIA, DEPT OF PUBLIC WORKS, DIVISION OF HIGHWAYS, SINGLE RAIL POST. REFER TO BRIDGE PLANNING AND DESIGN MANUAL, VOL II STANDARD PLANS, AUG 1968 PAGE 11-2 BARRIER RAILING DETAILS. DIMENSIONS SHOWN HEREIN GOVERN.

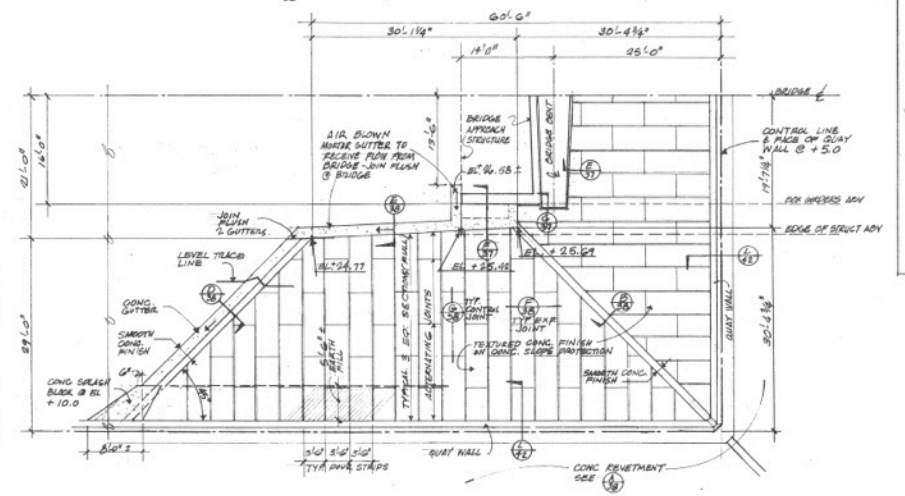

PARTIAL PLAN OF REVETTED SLOPE & BRIDGE SUPPORT 1/8" = 1'-0" (H/37)

RAILING DETAILS (D/37)

AS BUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213: 689-3160

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
BRIDGE
HAND RAIL AND MISCELLANEOUS DETAILS

JOB NO. 1-417
DATE 9-24-68
APPROVED:
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 37 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services, County of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

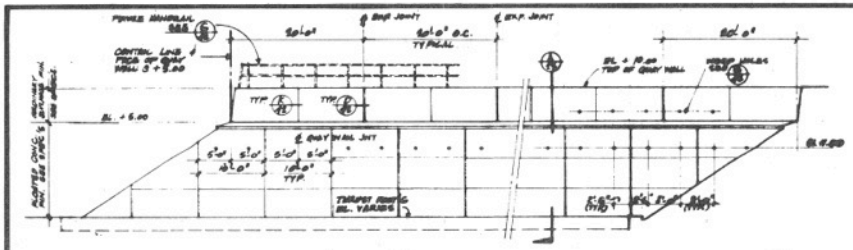

TYP. ELEVATION OF QUAY WALL & CONC. REVETTED SLOPE
3/8" = 1'-0" A/38

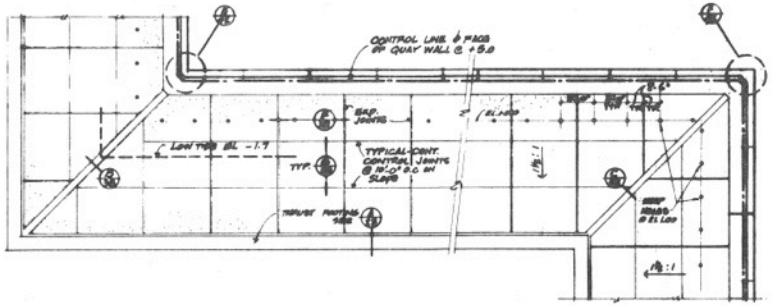

TYP. PLAN OF QUAY WALL & REVETTED SLOPE
1/8" = 1'-0" H/38

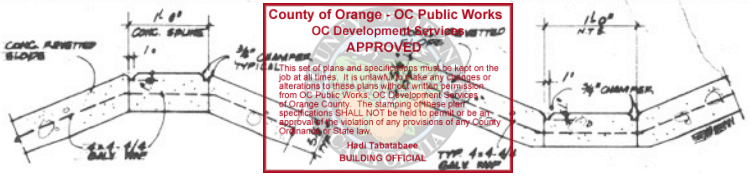

TYPICAL CONCRETE SPLINE OUTSIDE CORNER
1 1/2" = 1'-0" B/38

TYPICAL CONCRETE SPLINE INSIDE CORNER
1 1/2" = 1'-0" C/38

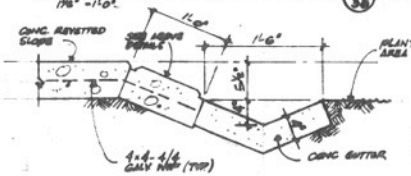

CONC. SPLINE & DRAIN @ BRIDGE
1 1/2" = 1'-0" D/38

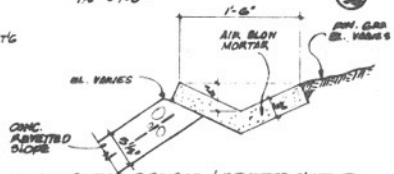

TEMP. GUTTER @ BRIDGE & REVETTED SLOPE
1 1/2" = 1'-0" E/38

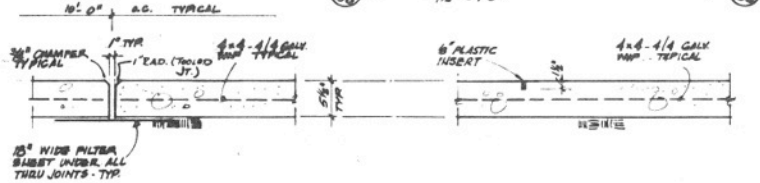

TYPICAL CONC. REVETTED SLOPE EXPANSION JOINT
1 1/2" = 1'-0" F/38

TYPICAL CONC. REVETTED SLOPE CONTROL JOINT
1 1/2" = 1'-0" G/38

ASBUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/8

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
CONSULTING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
310/ 000-0000

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

CONCRETE REVETTED SLOPE
TYPICAL PLAN ELEVATIONS & DETAILS

JOB NO. 1-417
DATE 9-24-68
APPROVED
DATE OCTOBER 1968
SCALE AS SHOWN
SHEET 38 OF 50
D 10

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permit #: BWD21-03408/BWD1-03410/BWD1-03428/BWD1-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
The use of alternate specifications must be clear on the plans. Any deviation from the standard plans and specifications requires approval by the Director of Development Services or the Director's designee. This approval, if indicated, is conditioned upon the fact that the applicant has all of the necessary approvals of the property owner(s). County Transportation Inspector
Building Services

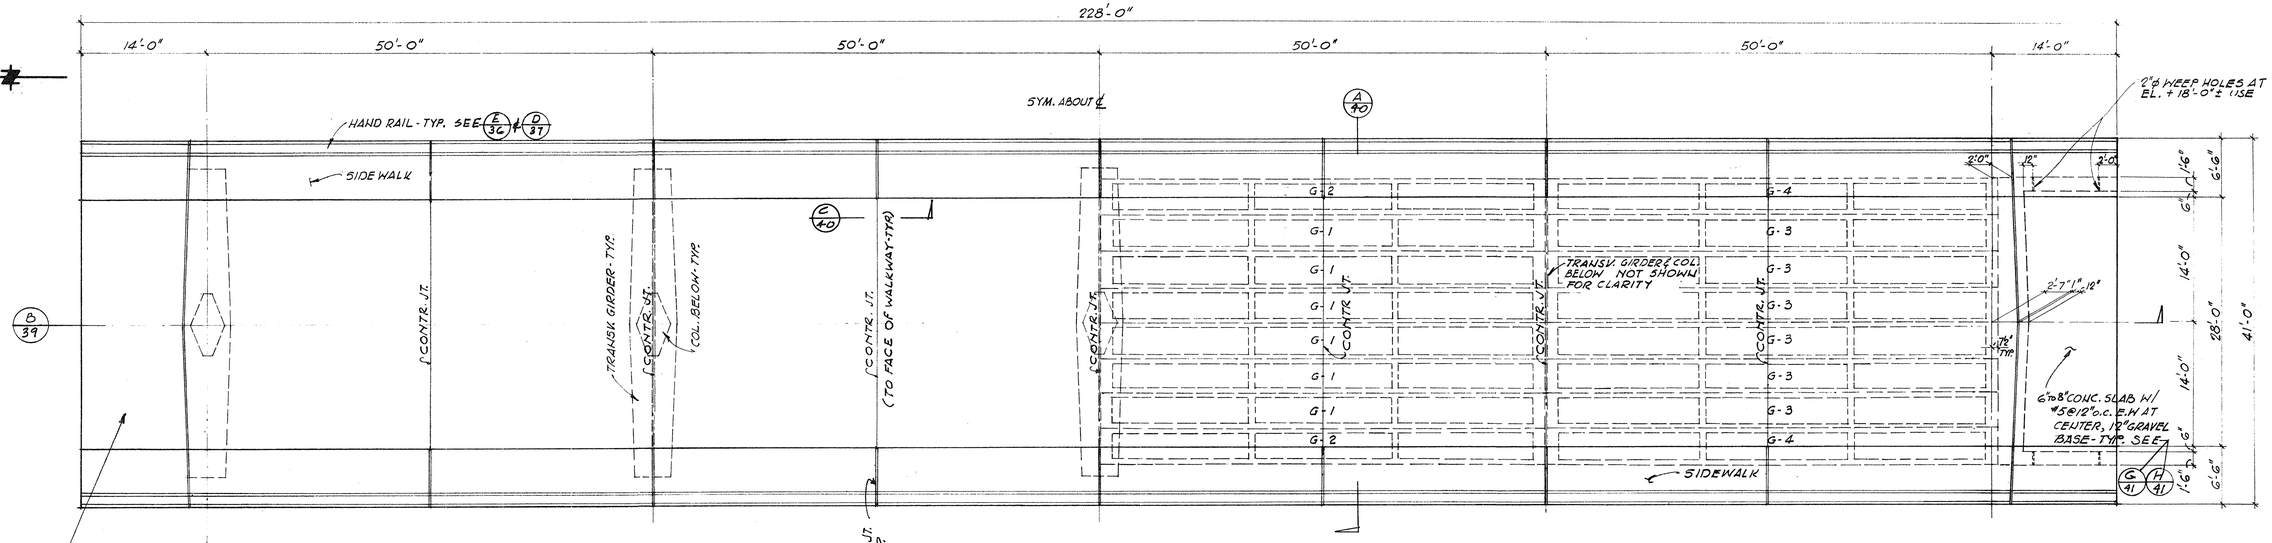

NOTE. APPROACH STRUCTURES TO BE CONSTRUCTED SIX MONTHS AFTER COMPLETION OF FILL. } Modified by Contractor request

PLAN (A/39) 1/8" = 1'-0" SEE PARTIAL PLAN (A/36)

NOTE: SEE SHT. 37 FOR PLAN OF REVETTED SLOPE & BRIDGE SUPPORT.

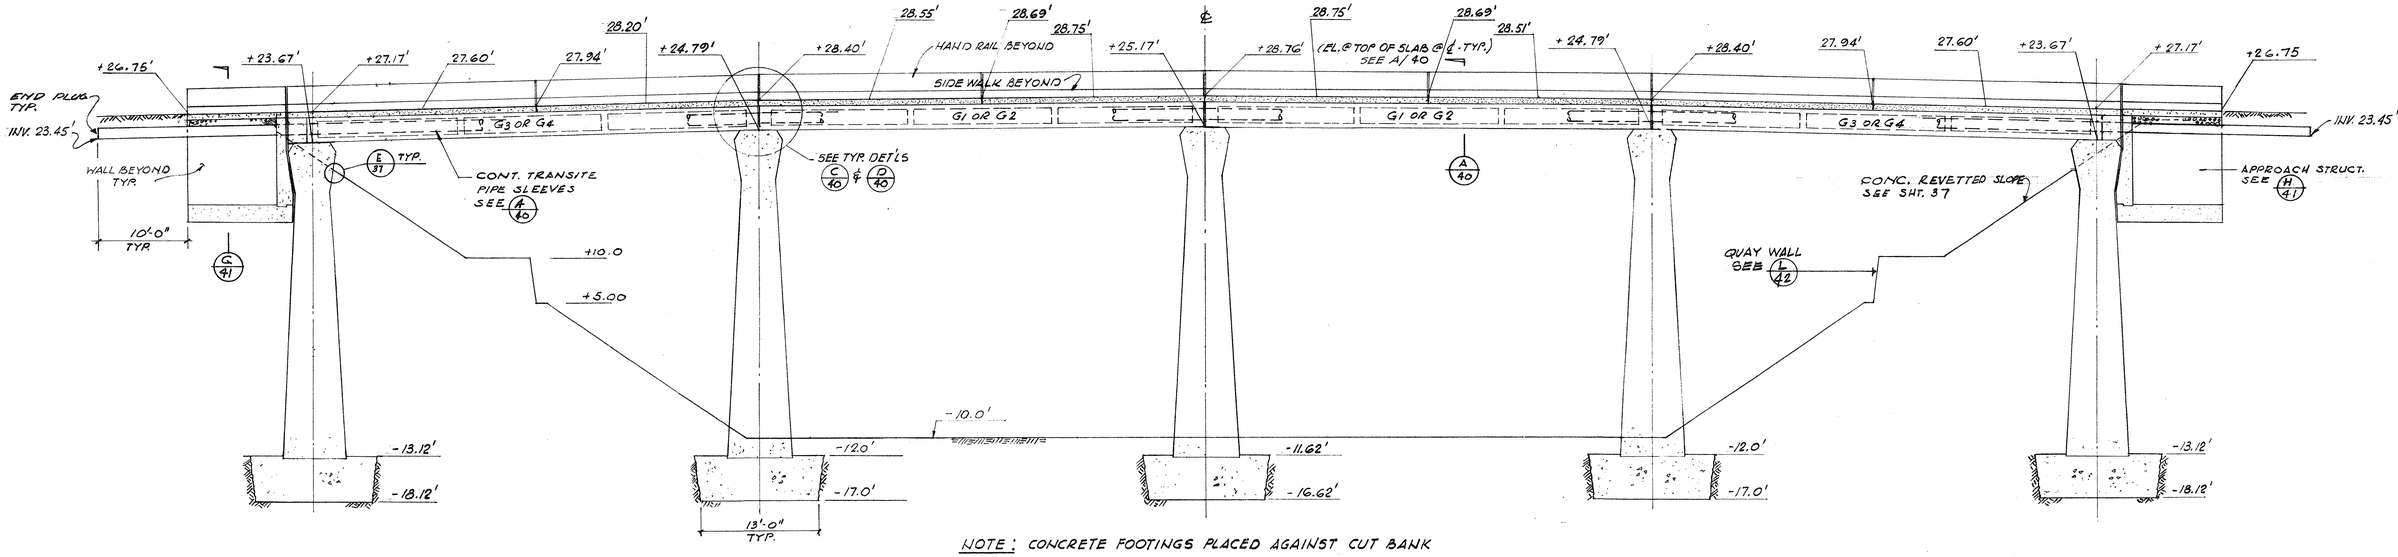

NOTE: CONCRETE FOOTINGS PLACED AGAINST CUT BANK

SECTION (B/39) 1/8" = 1'-0"

AS BUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KK KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/628-3192

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
BRIDGE
STRUCTURAL PLAN AND SECTION

JOB NO. 1-417
DATE 9-24-68
APPROVED: Rodney L. Rundle
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 39 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinances or State Laws.
Hani Tohmaz
BUILDING OFFICIAL

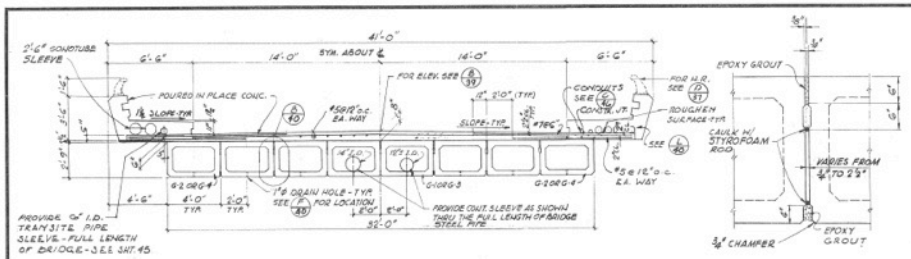

TYPICAL SECTION THRU DECK (A 40 39)
3/4" = 1'-0"



SECTION (B 40)
1" = 1'-0"

DETAIL (C 40 39)
1" = 1'-0"

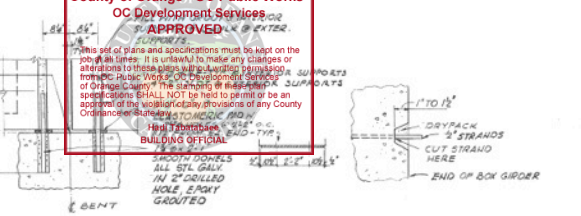

DETAIL (D 40 39)
3/4" = 1'-0"

DET. @ ENDS OF PRESTRESSING STRANDS (E 40)
NO SCALE

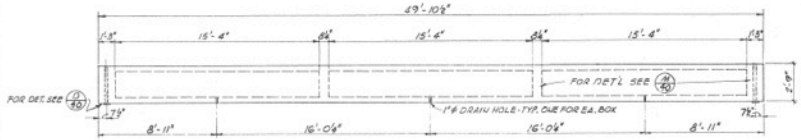

BOX GIRDERS 'G-1' & 'G-2' DETAIL (F 40)
1/4" = 1'-0"

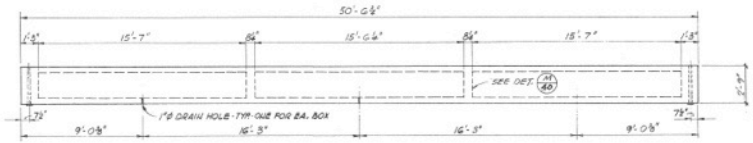

BOX GIRDERS 'G-3' & 'G-4' DETAIL (G 40)
1/4" = 1'-0"

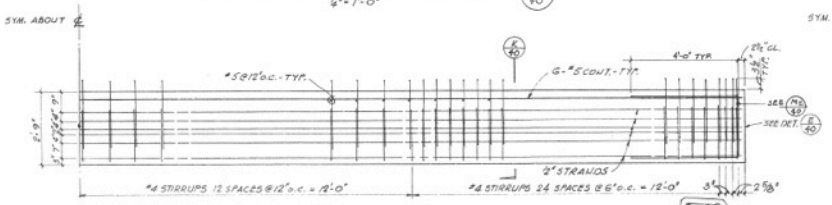

BOX GIRDERS 'G-1' & 'G-3' PRESTRESSING DETAIL (H 40)
1/4" = 1'-0"

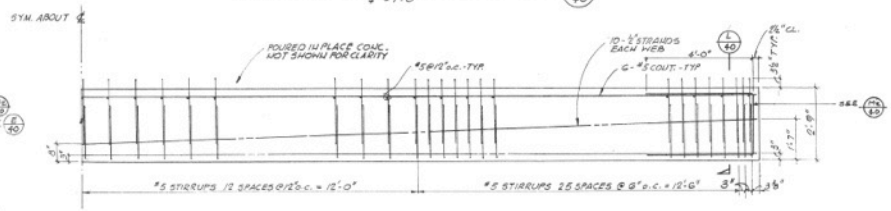

BOX GIRDERS 'G-2' & 'G-4' PRESTRESSING DETAIL (J 40)
1/4" = 1'-0"

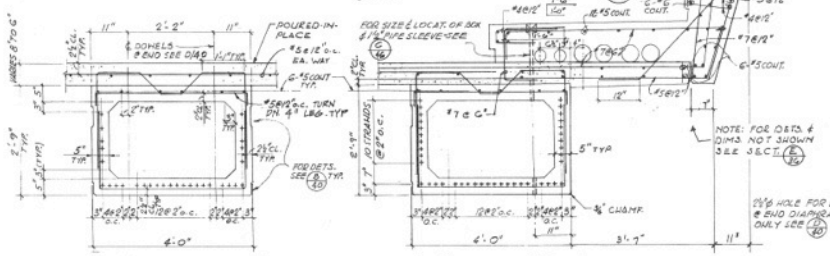

SECT. THRU G-1 & G-3 (K 40)
3/4" = 1'-0"

SECT. THRU G-2 & G-4 (L 40)
3/4" = 1'-0"

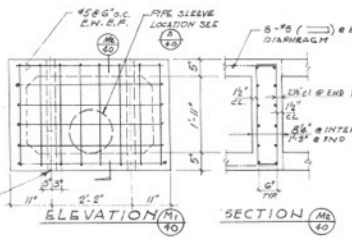

ELEVATION (M1 40) SECTION (M2 40)

TYP. DIAPHRAGM REINF. (M 40)
3/4" = 1'-0"

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/689-3182

JOB NO. 1-417
DATE 9-24-68
APPROVED

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
BRIDGE
TYPICAL SECTIONS AND BOX GIRDER DETAILS

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 40 OF 50
D 10.5 - 1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without first securing approval from OC Public Works, OC Development Services of Orange County. The construction shown on these specifications SHALL NOT be covered or put in use until approval of the violations of any provisions of any County Ordinance or State Law is obtained. APPROVED AS NOTED.
Hadi Tabatabaee
BUILDING OFFICIAL

GENERAL NOTES

1. DESIGN: MATERIAL AND CONSTRUCTION: A.A.S.H.O. 1965
2. CONCRETE SHALL BE CLASS "A" WHICH DEVELOPS f'_c = 5000 PSI, WITH NOT LESS THAN 7 1/2 SACKS OF CEMENT PER CUBIC YARD. CONCRETE FOR PRESTRESSED BOX GIRDERS: f'_{ci} = 4500 PSI, f'_c = 5000 PSI.
   a) SIDEWALKS, PAVEMENT, CURBS, DIKES, FOOTINGS AND APPROACH STRUCTURES; f'_c = 4500 PSI, WITH NOT LESS THAN 7 SACKS OF CEMENT PER CUBIC YARD. USE PLASTIMENT OR EQUAL CONCRETE DENSIFIER AS PER MANUFACTURER'S INSTRUCTIONS.
3. PRETENSIONING STEEL SHALL BE SEVEN-WIRE STRESS RELIEVED STRAND, UNCOATED, 270 KSI CONFORMING TO ASTM A-416 - PCST TENSIONING WILL NOT BE PERMITTED.
4. REINFORCING STEEL SHALL BE INTERMEDIATE GRADE DEFORMED BARS IN ACCORDANCE WITH ASTM SPECIFICATIONS A-15 AND A-305.
5. ELASTOMERIC BEARING PADS; AS PER A.A.S.H.O. SPECIFICATION, ARTICLE 1.7.51 - 50 DUROMETER HARDNESS.
6. EPOXY GROUT SHALL BE FURANE EPOCAST 530-2 OR EQUAL AND SHALL BE USED AS PER MANUFACTURER'S RECOMMENDATIONS.
7. THE TOP OF BOX GIRDERS AND FOOTINGS SHALL HAVE WOOD FLOAT ROUGH FINISH.
8. CHAMFER OR ROUND TO 3/4" RADIUS ALL EXPOSED CORNERS UNLESS OTHERWISE NOTED.
9. THE BEARING AREA VARIATION FROM PLANE SURFACE SHALL NOT EXCEED 1/16 INCH.
10. DIMENSIONS RELATING TO REINFORCING STEEL ARE TO CENTER OF BARS UNLESS OTHERWISE NOTED.
11. IN HANDLING BOX GIRDERS, THEY MUST BE MAINTAINED IN HORIZONTAL POSITION WITH LIFTING HOOKS UPRIGHT AT ALL TIMES AND MUST BE PICKED UP USING THE LIFTING HOOKS.

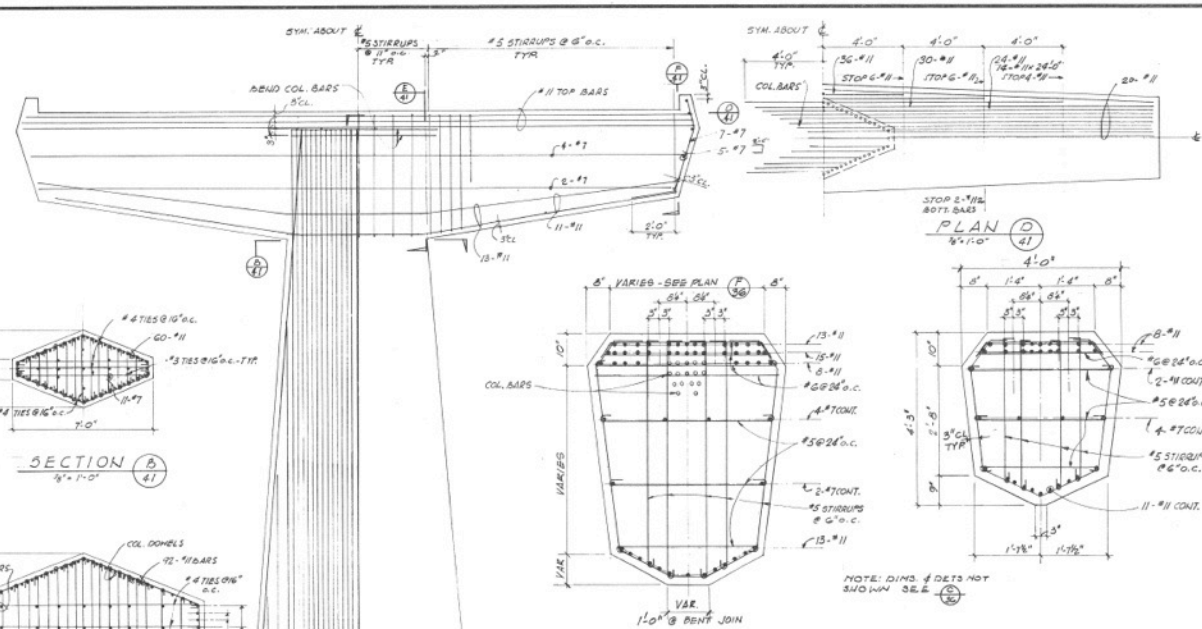

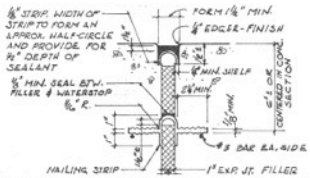

NOTE 3: 1 WATERSTOP TO HAVE AT LEAST 5 PAIRS OF RAISED RIBS WITH 0.1 SQ.IN. MIN. RIB CROSS-SECT. AREA ON EACH HALF OF WATERSTOP. HT. OF RIBS 3/32" MIN.

4. HOLES WILL BE PERMITTED IN OUTER ½" OF WEB FOR WIRES, RINGS, ETC. TIE WEB TO #8 BARS 12" o.c. MAX. TO SUPPORT WATERSTOP IN POSITION DURING CONC. PLACEMENT.

SEALED DECK JOINT DETAIL J 41
NO SCALE

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213) 629-2169

JOB NO. 1-417 APPROVED
DATE 9-24-68

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
BRIDGE
TYPICAL BENT AND APPROACH STRUCTURE DETAILS

DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 41 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or allow approval of the violation of any provisions of any County Ordinance or Section.
Hadi Tabatabaee
BUILDING OFFICIAL

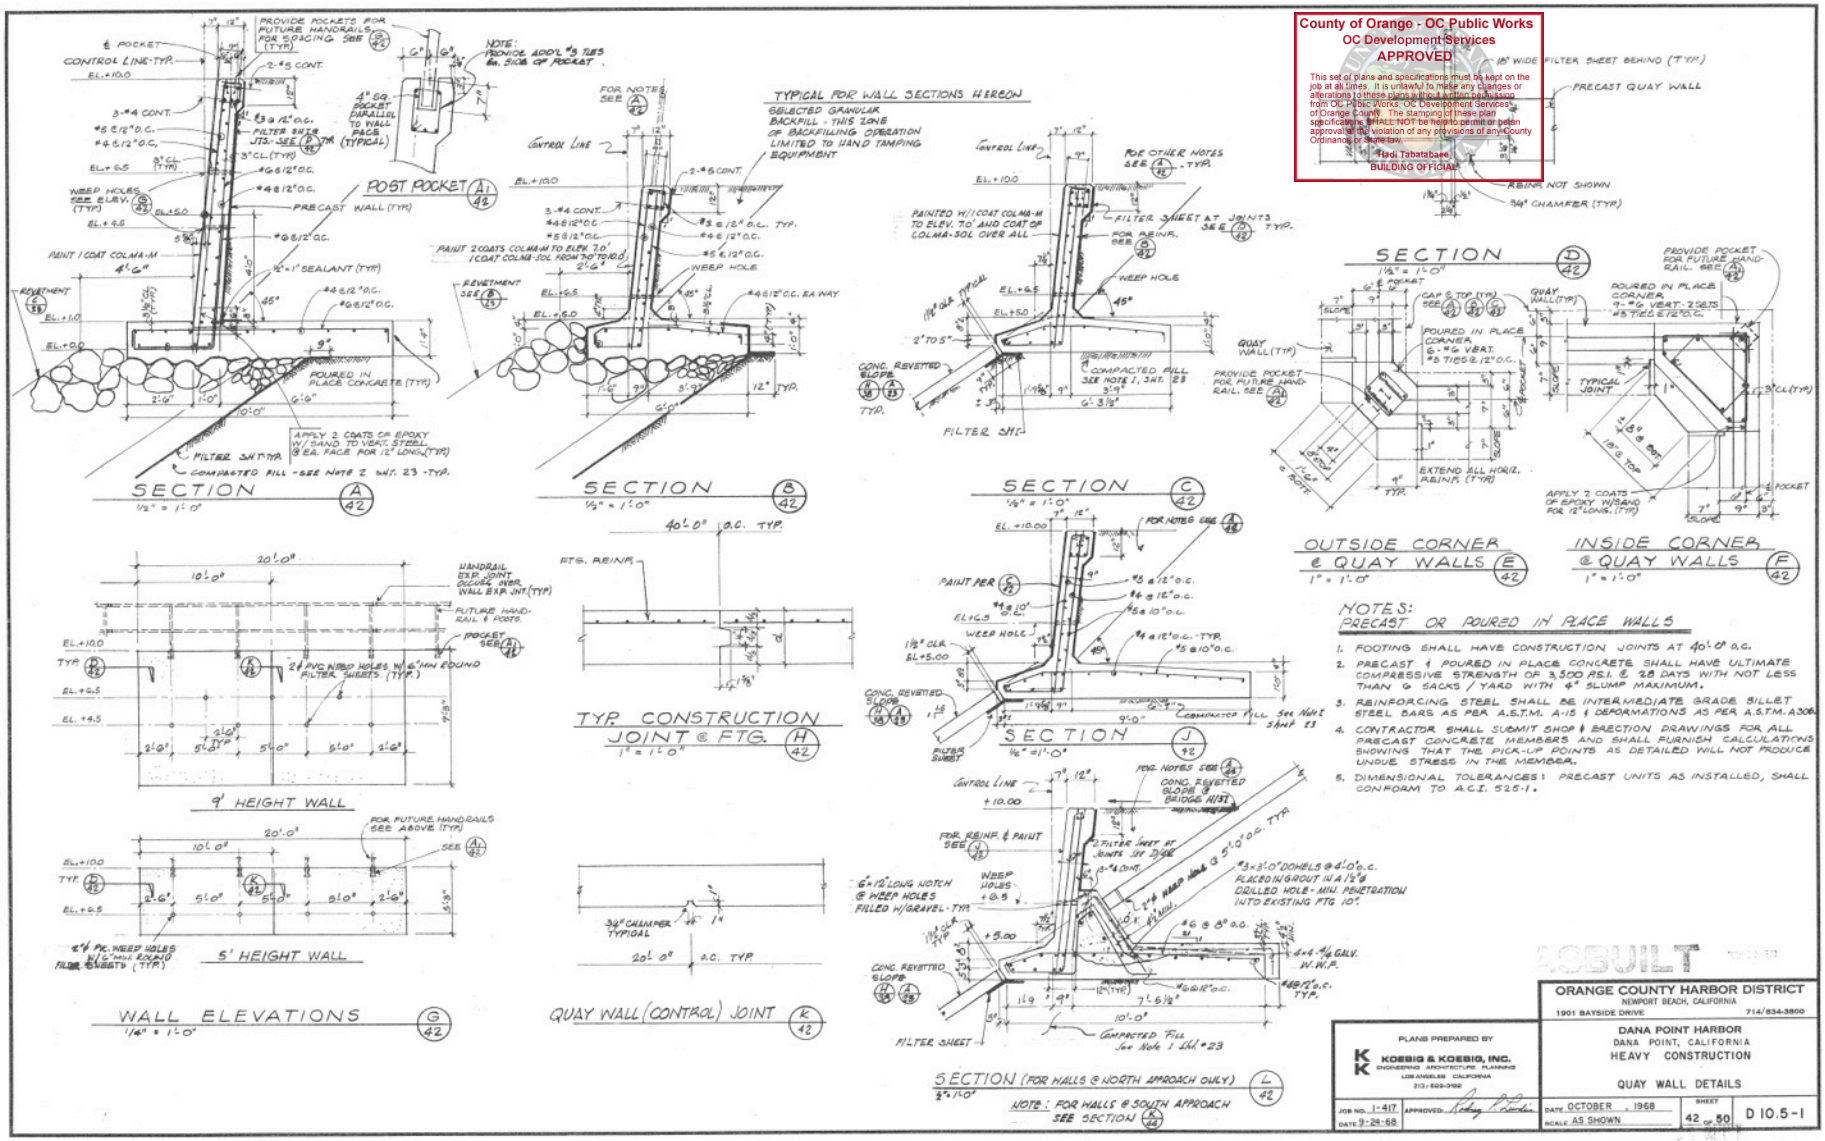

NOTES:
PRECAST OR POURED IN PLACE WALLS

1. FOOTING SHALL HAVE CONSTRUCTION JOINTS AT 40'-0" O.C.
2. PRECAST & POURED IN PLACE CONCRETE SHALL HAVE ULTIMATE COMPRESSIVE STRENGTH OF 3,500 P.S.I. @ 28 DAYS WITH NOT LESS THAN 6 SACKS / YARD WITH 4" SLUMP MAXIMUM.
3. REINFORCING STEEL SHALL BE INTERMEDIATE GRADE BILLET STEEL BARS AS PER A.S.T.M. A-15 & DEFORMATIONS AS PER A.S.T.M. A305.
4. CONTRACTOR SHALL SUBMIT SHOP & ERECTION DRAWINGS FOR ALL PRECAST CONCRETE MEMBERS AND SHALL FURNISH CALCULATIONS SHOWING THAT THE PICK-UP POINTS AS DETAILED WILL NOT PRODUCE UNDUE STRESS IN THE MEMBER.
5. DIMENSIONAL TOLERANCES: PRECAST UNITS AS INSTALLED, SHALL CONFORM TO A.C.I. 525-1.

AS BUILT

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/622-3102

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
QUAY WALL DETAILS

JOB NO. 1-417 APPROVED
DATE 9-24-68
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 42 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

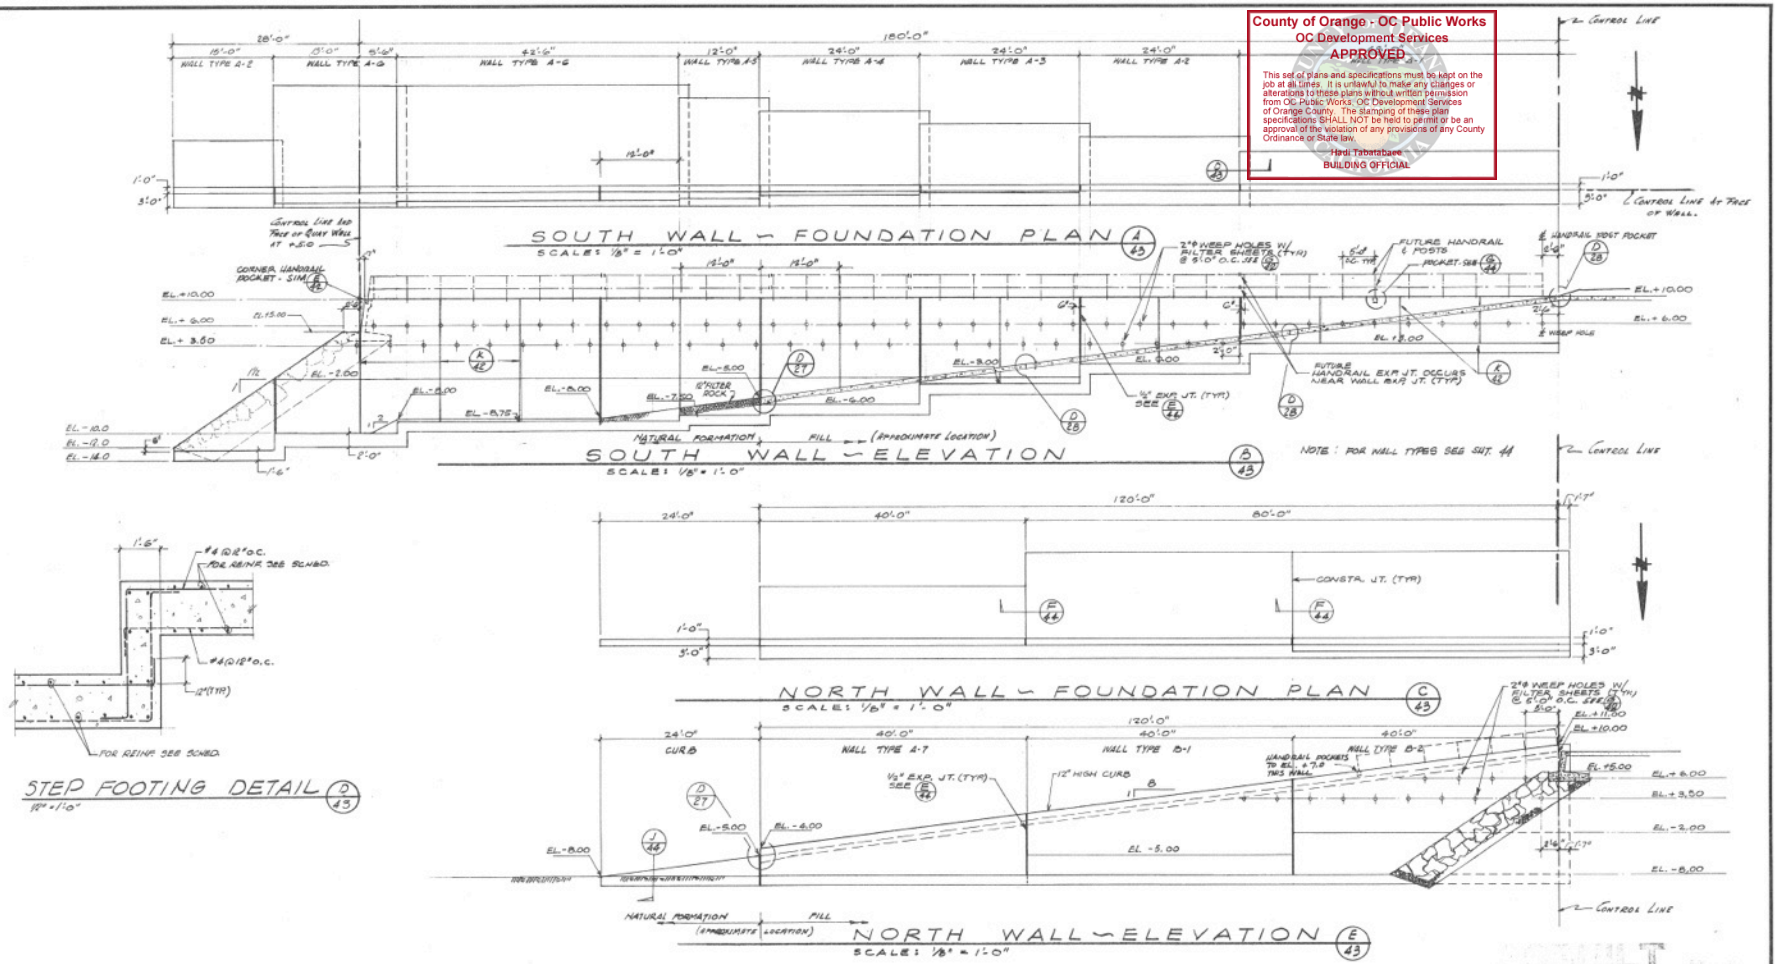

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/ 628-3160

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
RETAINING WALLS
PLANS & ELEVATIONS

JOB NO. 1-417 APPROVED
DATE 9-24-68
DATE OCTOBER , 1968
SCALE AS SHOWN
SHEET 43 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

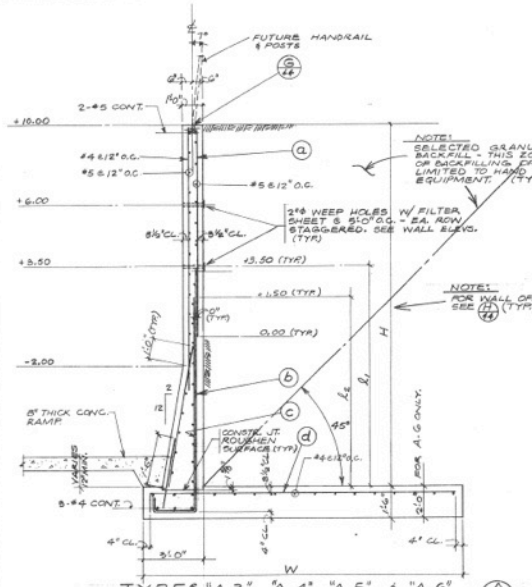

TYPES "A-3", "A-4", "A-5", & "A-6" A 44

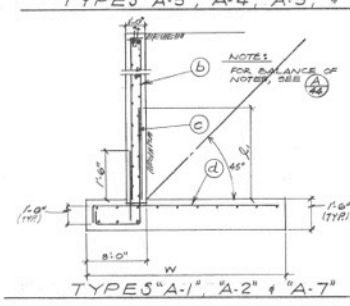

TYPES "A-1", "A-2" & "A-7" B 44

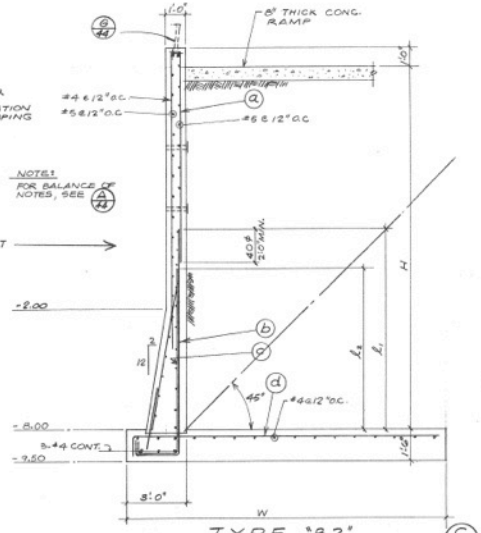

TYPE "B-2" C 44

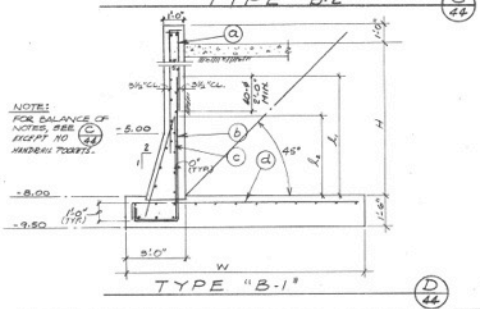

TYPE "B-1" D 44

SOUTH WALL (ELEV.① TOP OF WALL - CONSTANT)

TYPE	DIMENSIONS H	DIMENSIONS W	REINFORCING STEEL ⓐ	ⓑ	ⓒ	ⓓ	LENGTHS ℓ_1	ℓ_2	REMARKS
A-1	7'-0"	7'-6"	—	#6@12	#6@12	#5@12	8'-6"	—	——
A-2	10'-0"	10'-0"	—	#7@12	#7@6	#7@12	8'-6"	—	——
A-3	13'-0"	12'-0"	#7@12	#9@12	#7@12	#10@12	6'-6"	4'-6"	ALTERNATE ⓑ & ⓒ
A-4	16'-0"	14'-0"	#7@12	#9@12	#9@12	#9@6	9'-6"	7'-6"	" " "
A-5	18'-0"	16'-0"	#7@12	#9@12	#9@12	#10@6	11'-6"	9'-6"	" " "
A-6	20'-0"	18'-0"	#7@12	#9@12	#9@12	#10@6	13'-6"	11'-6"	" " " FTG. THICKNESS=2'-6"

NORTH WALL (ELEV.⑤ BOTT. OF FTG.-CONSTANT)

TYPE	DIMENSIONS H	DIMENSIONS W	REINFORCING STEEL ⓐ	ⓑ	ⓒ	ⓓ	LENGTHS ℓ_1	ℓ_2	REMARKS
A-7	8'-0"	11'-0"	—	#7@12	#7@12	#8@12	—	—	CONC. RAMP SAME AS TYPE "B" DETAILS.
B-1	13'-0"	16'-0"	#7@12"	#9@12"	#7@12"	#7@6"	VARIES 5.0 to 35	VARIES 3.0 to 5.5	ALTERNATE ⓓ & ⓒ BARS
B-2	18'-0"	16'-0"	#7@12"	#9@12"	#9@12"	#11@6"	VARIES 7.5 to 40	VARIES 3.5 to 8.0	ALTERNATE ⓓ & ⓒ BARS

Note: WHERE SPLICES OF DIFFERENT SIZE BARS OCCUR, LAP SHALL BE BASED ON LARGER DIAMETER.

EXP. JT. @ WALL E 44
3/4" = 1'-0"

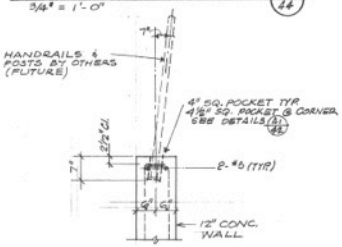

CONSTR. JT. @ FTG. F 44
3/4" = 1'-0"

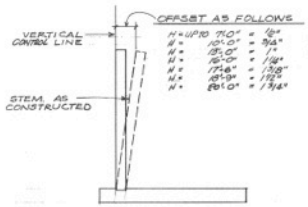

(TYP.) DETAIL G 44
3/4" = 1'-0"

TYP. WALL OFFSET H 44
NO SCALE



CURB DETAIL J 44
3/4" = 1'-0"

NOTES:
1. DRY PACK ALL THE POCKETS AND CRACKS AT THE WALL. USE MOR-ROK OR EQUAL.
2. THOROUGHLY CLEAN AND/OR SANDBLAST TOP OF FOOTING.
3. PROVIDE THE ADD'L REINFORCING AS SHOWN IN THE SKETCH.
4. PLACE ½" OF MORTAR ON TOP FACE OF FOOTING.
5. POUR CONCRETE OF 3500 PSI @ 28 DAYS.
6. FOR DETAILS NOT SHOWN SEE L 42

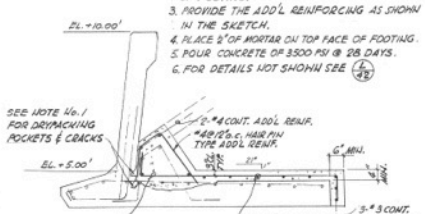

SECTION (FOR WALLS @ SOUTH APPROACH ONLY) K 44
3/4" = 1'-0"

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/ 688-9760

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION

RETAINING WALLS-DETAILS

JOB NO. 1-417 DATE 9-24-68 APPROVED
DATE OCTOBER , 1968 SCALE AS SHOWN
SHEET 44 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

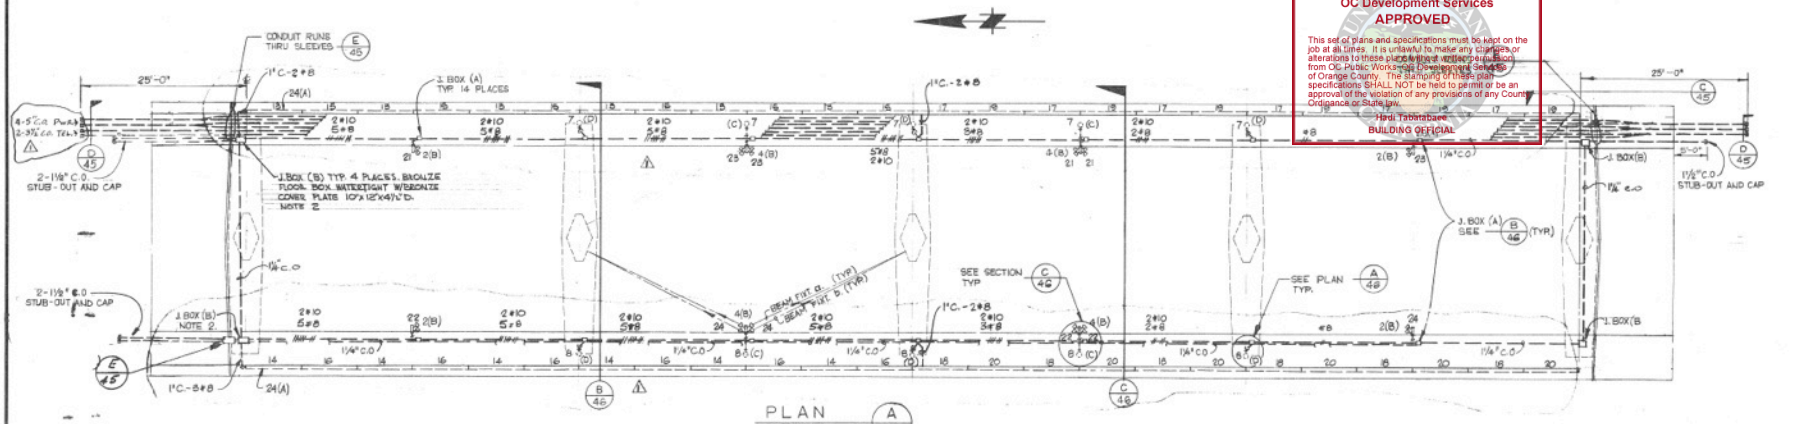

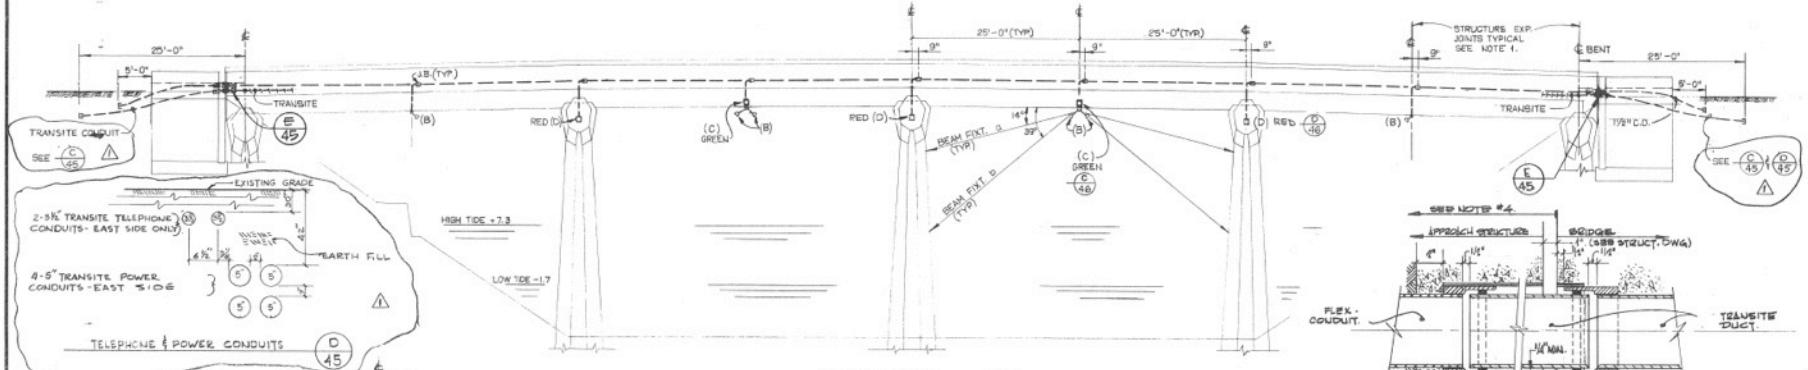

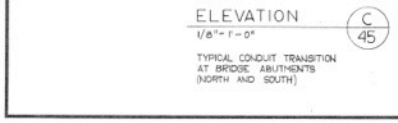



NOTES:

1. INSTALL CONDUIT EXPANSION FITTING ON EACH CONDUIT AT STRUCTURE EXPANSION JOINTS.
2. TERMINATE CONDUCTORS IN PULL BOX FOR FUTURE EXTENSION TO LTG. PANEL AND IDENTIFY ALL CONDUCTORS PER PANEL SCHEDULE (SEE SHT. 46.) LTG. PANEL SHALL BE LOCATED WITHIN 140 FT. FROM NORTH ABUTMENT OF BRIDGE.
3. INSTALL TRANSITE COND. TYPE I IN SIDEWALK AS SHOWN IN (A/46) TRANSITION TO DUCT CONFIGURATION BY USING FLEXIBLE CONDUIT (5/8" I.D.) AS INDICATED IN (C/45) TYPICAL FOR BOTH, NORTH AND SOUTH ABUTMENTS.
4. WORK IN AREA INDICATED SHALL BE ACCOMPLISHED AT THE TIME THE APPROACH STRUCTURE IS CONSTRUCTED.

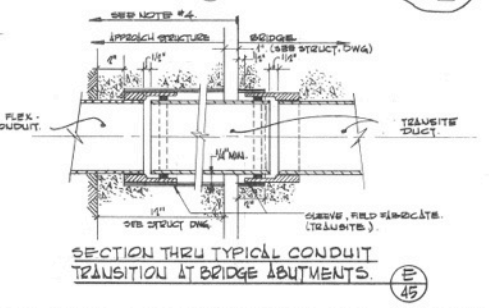

SECTION THRU TYPICAL CONDUIT TRANSITION AT BRIDGE ABUTMENTS.

NO.	DESCRIPTION	INITIATE
1	BRIDGE LTG. CKT'S	J.K. 2/8/72

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/688-2180

JOB NO. 1-417
DATE 9-24-68
APPROVED:

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3500

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
BRIDGE
ELECTRICAL PLAN AND ELEVATION

DATE OCTOBER 1968
SCALE AS SHOWN
SHEET 45 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written authorization from OC Public Works. OC Development Services. Failure to comply with Orange County The approved construction specifications SHALL NOT be used to commence work or allow work to continue without approval of the violation of any provisions of any ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

PLAN

A 46

3/8" = 1'-0"

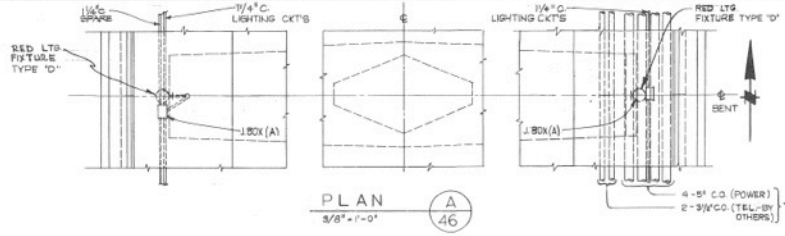

SECTION

B 46

3/8" = 1'-0"

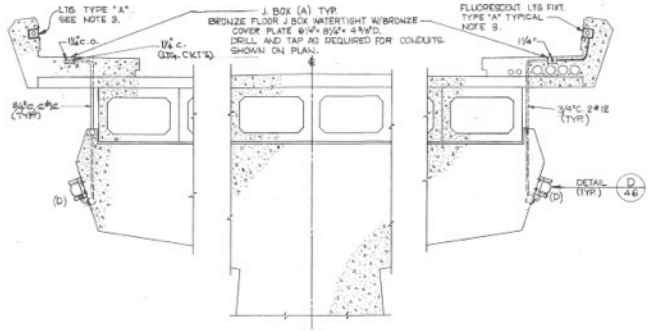

SECTION

C 46

3/8" = 1'-0"

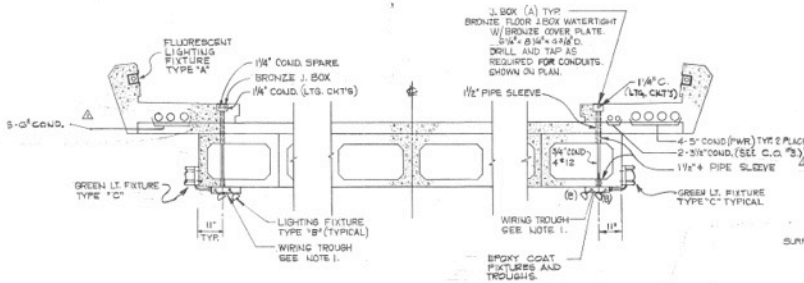

PANEL SCHEDULE "LA" (SEE NOTE 2.)

120/240 VOLTS, 1ø, 3 WIRE — 125 A. MAIN BREAKER

CONTACTOR CONTROLLED CKT'S (SPLIT BUS)

CKT. No.	DESCRIPTION	LTG. FIX.	BREAKER AMPS	BREAKER POLES	BUS A	WATTS B	WATTS C
1	BRIDGE LTG. EAST	8	20	2	750		
2	" " WEST	7	20	2	875		
3	" " EAST	6	20	2	750		
4	" " WEST	7	20	2	875		
5	" " EAST	6	20	2	750		
6	" " WEST	6	20	2	750		
7	" " EAST	6	20	2	750		
8	" " WEST	6	20	2	750		
9	" " EAST	6	20	2	750		
10	" " WEST	6	20	2	750		
11	FLOOD LTS. EAST	6	30	2	750		
12	" " WEST	6	30	2	750		
13	" " EAST	6	20	1	—	750	
14	" " WEST	6	20	1	—	750	
15	SPARE	—	20	1	500	—	
16	SPARE	—	20	1	500	—	
17	DOG & GREEN RGS. LTS. EAST	5	20	1	—	—	500
18	" " WEST	5	20	1	—	—	500
19	LTG. CONTACTOR'S RELAY	—	20	1	100	—	
20	SPARE	—	20	1	500	—	
21	SPARE	—	20	1	—	—	500
22	SPACE						

CONNECTED LOAD = 21.6 KW
AMPS = @ 240
L.C.L. = @ 1.25 = 114 AMP.

TOTAL 10,850 10,750

INSTALL (1) MECHANICALLY HELD LTG. CONTACTOR, 100 A - 2P, TO CONTROL CKT'S #7 THRU # 18. LOCATION OF PANEL AND MEANS OF CONTROLLING LTG. CONTACTOR TO BE DETERMINED LATER, SEE NOTE 2.
INSTALL (1) MECHANICALLY HELD RELAY 20 A, 4 P (N.O.) TO CONTROL CKT'S #7 & 18. RELAY SHALL BE CONTROLLED BY INDEPENDENT DEVICE; PROVIDE ALSO PUSHBUTTON TO OVERRIDE CONTROLLING DEVICE CONTACTS. (FOR CONTROL OF MECH. HELD RELAY) FOR MANUAL OPERATION AND TESTING.

FIXTURE SCHEDULE

DESCRIPTION	MOUNTING	WATTS	LAMP
FLUORESCENT RECESSED WRONGE CLEAR ACRYLIC PANEL LAY-IN TROFFER (SEE SPECIFICATIONS)	RECESSED	250	F 96T12 CW
FLOODLIGHT W/ARROW BEAM LAMP & BRONZE ANODIC FINISH	SURFACE	200	PAR 46 120 V.
CAST BRONZE WATERTIGHT WITH PRISMATIC LENS, MEDIUM SCREW SOCKET, PERKO 1005.	WALL	100	A/100
CAST BRONZE WATERTIGHT W/ GUARD RECESSED FRESNEL LENS, MEDIUM SCREW SOCKET, PERKO 1005	WALL	100	A/100

LEGEND

SYMBOL	DESCRIPTION
———	CONDUIT RUN EXPOSED.
- - -	CONDUIT RUN CONCEALED IN CONCRETE, OR BELOW GRADE.
////	TIC MARKS INDICATE QUANTITY OF WIRES, SIZE # 12 AWG, CONDUIT FILL PER CODE, UNLESS OTHERWISE NOTED.
//// #8	TIC MARKS INDICATE QUANTITY OF WIRES, SIZE AS NOTED, CONDUIT FILL PER CODE, UNLESS OTHERWISE NOTED.
▭	FLUORESCENT LIGHTING FIXTURE, MOUNTED AS INDICATED IN THE FIXTURE SCHEDULE.
○	INCANDESCENT LIGHTING FIXTURE, MOUNTED AS INDICATED IN THE FIXTURE SCHEDULE.
D-H	FLOODLIGHT FIXT, MOUNTING AS INDICATED ON PLANS.
J.B.	JUNCTION BOX.
C.O.	CONDUIT ONLY.
W.P.	WEATHERPROOF

MOUNTING DETAIL

D 46



NOTES:

1. 2'-2" x 14" L, WEATHERPROOF, CORROSIONPROOF CAST ALUM. WIRING TROUGH W/ ¾" MOUNTING HOLE AND 6 - ½" TAPPED HOLES (1 PLUG) COVER AND GASKET. EPOXY FINISH TO MATCH LTG FIXTURE.
2. "SCHEDULE" FOR PANEL "LA" SHOWN IN THIS DWG. IS FOR REFERENCE ONLY. NO PANEL INSTALLATION WILL BE INCLUDED IN THIS CONTRACT.
3. FLUORESCENT LTG. FIXTURES ON BRIDGE RAILING SHOULD BE INSTALLED IN ACCORDANCE WITH DETAILS SHOWN ON ARCHITECTURAL DWG A 37, B 37, C 37
4. TELEPHONE CONDUITS (2-3½") WILL BE ~~FURNISHED AND INSTALLED BY OTHERS~~ PER CHANGE ORDER #5.

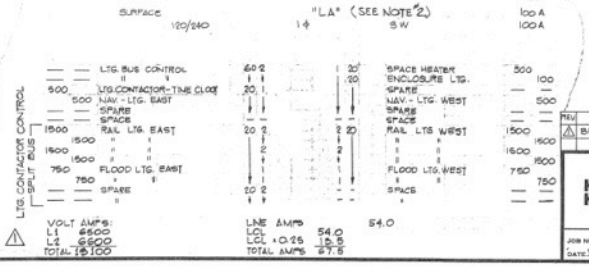

REV.	DESCRIPTION	INIT.	DATE
1	BRIDGE LTG. CKT'S.	J.K.	2/9/68

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3382

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
BRIDGE
ELECTRICAL MISCELLANEOUS DETAILS

JOB NO. 1-417
DATE 9-24-68
APPROVED
DATE OCTOBER, 1968
SCALE AS SHOWN
SHEET 46 OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services. The stamping of this plan is a positive drainage and minimum erosion in accordance with the intent specifications. SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

COORDINATES

	Northing	Easting
1	3,[illegible]	9,720.[illegible]
2	3,[illegible]	[illegible]
3	3,41[illegible]	9,006. 0
[illegible]	3,2[illegible]	9,100.00
[illegible]	3 330.00	3,386.00
[illegible]	3,330.00	8,381.03
7	3,[illegible]0.00	8,2[illegible]8.10
[illegible]	3,029.00	8,230.01
9	2,770.00	8,239.98
10	2,647.00	8,166.97
11	2,799.44	8,427.89
12	2,970.00	8,450.00
13	2,930.00	8,463.00
14	3,[illegible]0.00	8,[illegible]2.00
[illegible]	3,2[illegible]	[illegible]0.00
[illegible]	3,2[illegible]0.00	[illegible]725.00
17	3,332.00	9,[illegible]3.00
[illegible]	2,9[illegible]0.00	8,[illegible]99.01
19	2,960.00	6,296.04
20	2,770.[illegible]	6,[illegible]71.77
30	2,904.[illegible]	[illegible]0.00
31	2,947.[illegible]	[illegible]23.00
32	3,[illegible]70.00	[illegible]0.00
33	3,[illegible]3.[illegible]	[illegible]5,120.
34	3,[illegible]51.94	10,210.00
35	3,[illegible].[illegible]	10,3[illegible].00
3[illegible]	8,335.16	9,980.88
37	3,312.57	9,265.00

GENERAL NOTES

All grading shall be performed generally in accordance with these plans, the specifications, soils and geological report and the general requirements of the Orange County Grading Division.

All [illegible] shall be performed generally in accordance with the plan intent. [illegible] alterations to these plans without written permission from Grading." It is intended that each terrace or bench be completed [illegible] of Orange County. The stamping of this plan is a positive drainage and minimum erosion in accordance with the intent specifications. SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law. [illegible] and the basic requirements of the Orange County Grading Division. [illegible] of grading, the last bench or terrace cannot be completed in accordance with the plan, the site shall be left in a condition acceptable to the Orange County Grading Division and the owner.

There is no intent to place any onsite fills for the development of the property. If, for the convenience of Contractor or others, onsite fills are made they shall be placed in accordance with the specifications and requirements of the Grading Division or removed after work has been completed.

Any modification or change in the plan which is necessary because of field conditions or construction procedures shall first be approved by the owner or his representative.

This grading plan was prepared to conform to a concept development plan prepared for the property by Adrian Wilson Associates.

AS BUILT
PERMIT NO. 96322
DATE: 7-20-70

VICINITY MAP
JOB LOCATION
To Santa Ana
San Juan Capistrano
Dana Point
Capistrano Beach

SCALE 1"=100'

Property Boundary
Construct Concrete Apron See Detail Sheet No. 49 (to Edge)
Datum Plane
Contours and elevations shown on this plan northerly of the R/W line of Del Obispo St. are based on Mean Lower Low Water (U.S.C.&G.S.) Elevations shown on Del Obispo St. are approximate only. See sheets 29 and 30 For profile of Del Obispo Street.

1. Authority is hereby granted for the construction on Capron Property of the fill slopes for Del Obispo Street and the drainage structures under Del Obispo Street indicated S.D. Person.
2. Permission is hereby granted to prospective bidders on the construction indicated hereon to enter upon Capron Property prior to such bidding for the purpose of performing site investigation of the nature of the materials to be encountered in the construction.

Velocity Reducer, see detail sheet 49
Street Fill
Inlet Structure
Grade Break
STREET
54" STORM DRAIN LINE "A"
Construct Downdrain (See detail sheet 50 Type B)
Construct Downdrain (See detail sheet 50 Type A)
Construct Embankment (See detail Sht 50 Type B)
Inlet Structure
Street Fill
Property Boundary
DEL OBISPO
See detail Sheet 49
See Detail Sheet 49
See datum plane note above
Construct downdrain, Type A See detail sheet 50
DRAINAGE OUTLET 'A' SEE DETAIL SHEET 50
Terrace Drains See detail on sheet 50
Construct downdrain, Type A See detail, sheet 50
DRAINAGE OUTLET 'A' SEE DETAIL, SHEET 50
STORM DRAIN LINE "D"
STORM DRAIN LINE "C"
STORM DRAIN LINE "B"

Representative for Owner
A. L. Shipley
1903 Fulton St.
Fresno, CA 93723
(209) 22 -3161

Soils Engineer and Geologist
Moore & Taber
1223 East Truslow
Fullerton, CA 92631
(714) 525-0241

Engineer
[illegible] Engineering
412 S. Lyon Street
Santa Ana, CA [illegible]
(714) [illegible]

NOTE
All slopes to be 1½:1 unless otherwise noted. Coordinates are based on Harbor Dist system. See sheet No.48 for quantities.

Job Address:
34352 Street of the Golden Lantern
Dana Point, California.

81-0105-00-00 F-1130

NOTE: FOR 'AS BUILT' GRADING SEE SHEET 47A

APPROVALS
Conservator for the Person and Estate of George H. Capron
A.L. Shipley Jr. Date 7-20-70
Moore & Taber - Geologist & Soils Engineer
Return Moore R.C.E. 8369 Date
Boyle Engineering
A.M. Fickes R.C.E. 8844 Date

CAPRON PROPERTY
ROUGH GRADING PLAN

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works - OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

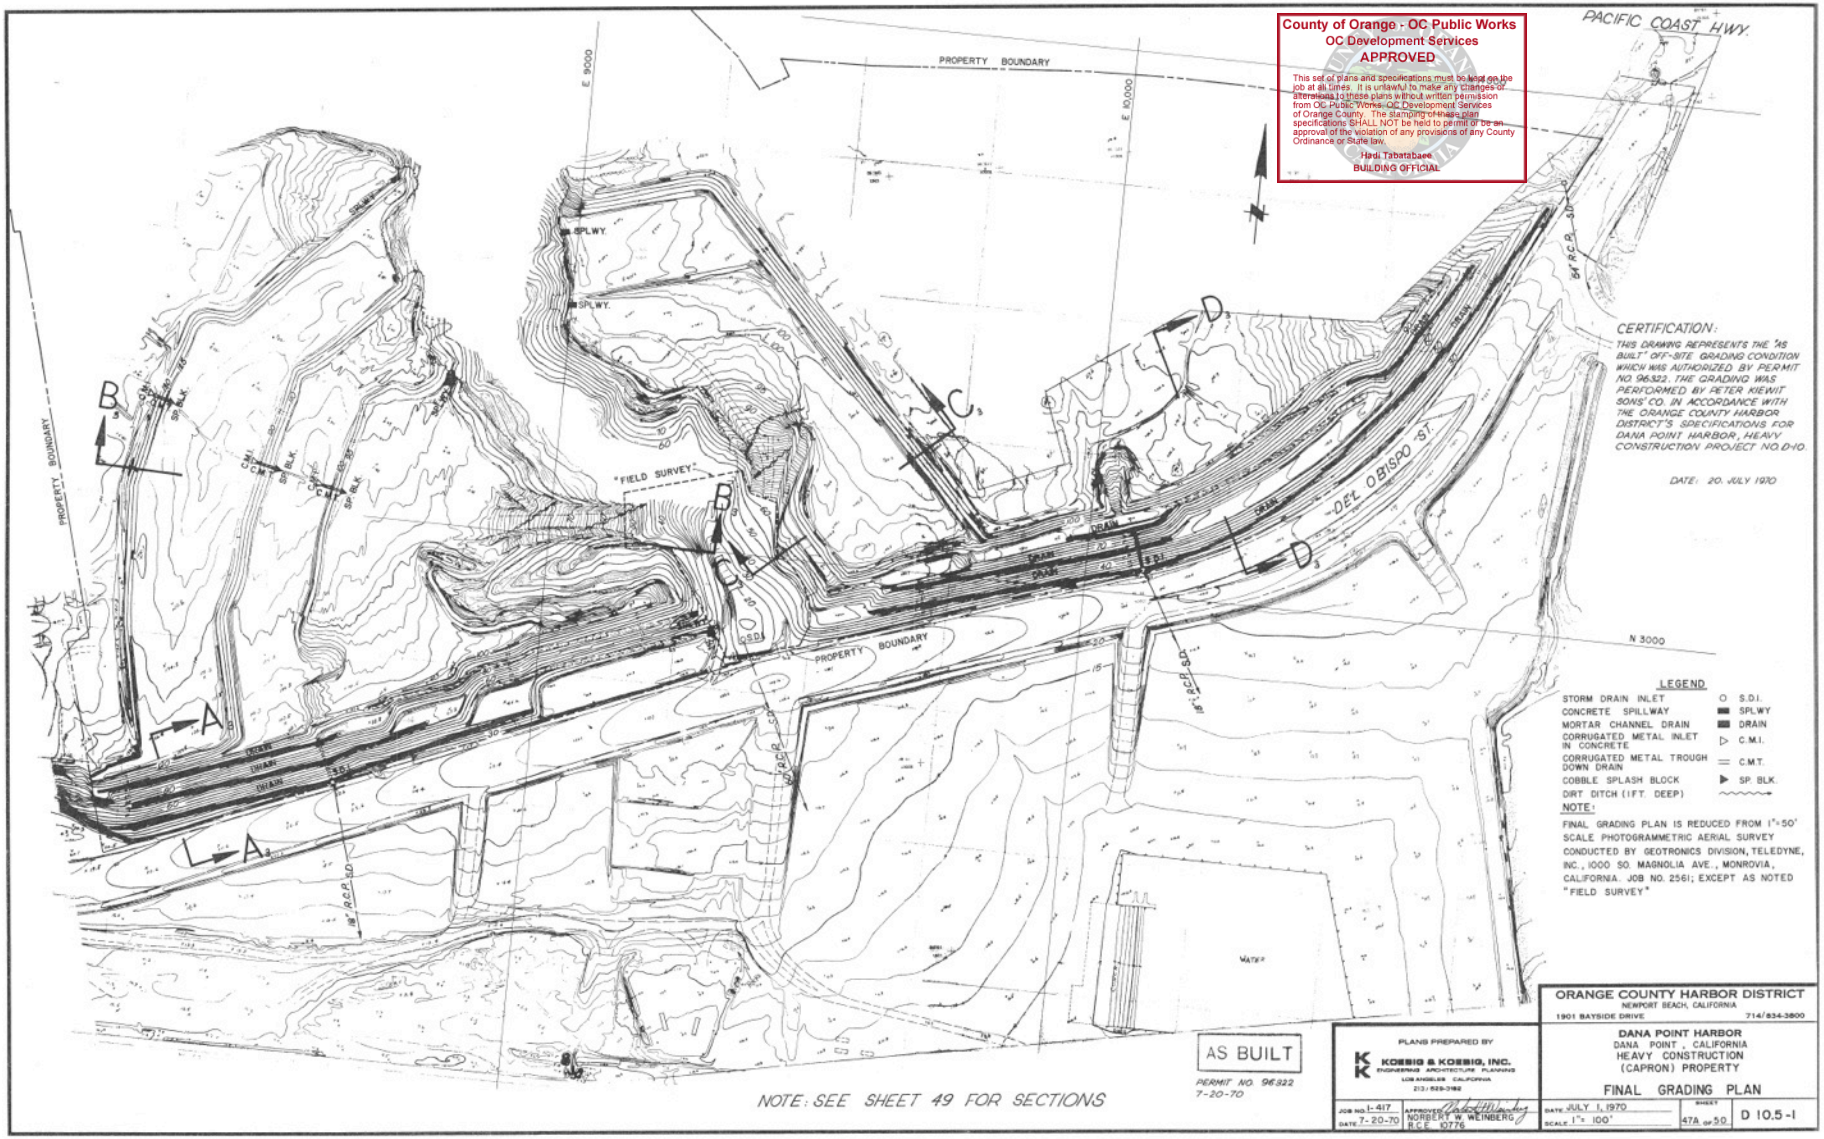

CERTIFICATION:

THIS DRAWING REPRESENTS THE "AS BUILT" OFF-SITE GRADING CONDITION WHICH WAS AUTHORIZED BY PERMIT NO. 96322. THE GRADING WAS PERFORMED BY PETER KIEWIT SONS' CO. IN ACCORDANCE WITH THE ORANGE COUNTY HARBOR DISTRICT'S SPECIFICATIONS FOR DANA POINT HARBOR, HEAVY CONSTRUCTION PROJECT NO. D-10.

DATE: 20. JULY 1970

LEGEND

STORM DRAIN INLET	O	S.D.I.
CONCRETE SPILLWAY	▬	SPLWY
MORTAR CHANNEL DRAIN	▬	DRAIN
CORRUGATED METAL INLET IN CONCRETE	▷	C.M.I.
CORRUGATED METAL TROUGH DOWN DRAIN	=	C.M.T.
COBBLE SPLASH BLOCK	▶	SP. BLK.
DIRT DITCH (1FT. DEEP)	~~~	

NOTE:

FINAL GRADING PLAN IS REDUCED FROM 1"=50' SCALE PHOTOGRAMMETRIC AERIAL SURVEY CONDUCTED BY GEOTRONICS DIVISION, TELEDYNE, INC., 1000 SO. MAGNOLIA AVE., MONROVIA, CALIFORNIA. JOB NO. 2561; EXCEPT AS NOTED "FIELD SURVEY"

AS BUILT
PERMIT NO. 96322
7-20-70

NOTE: SEE SHEET 49 FOR SECTIONS

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-3182

JOB NO. I-417
DATE 7-20-70
APPROVED
NORBERT W. WEINBERG
R.C.E. 10776

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT, CALIFORNIA
HEAVY CONSTRUCTION
(CAPRON) PROPERTY

FINAL GRADING PLAN

DATE JULY 1, 1970
SCALE 1"= 100'
SHEET 47A OF 50
D 10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

EARTH EXCAVATION QUANTITY TABULATION

AREA Nº	CUBIC YARDAGE	ACCUMULATIVE CY.
1	252,700 CY	CY
2	206,000 —	252
3	152,700 —	458
4	174,400 —	611
5	180,100 —	791,800—
6	106,100 —	95[illegible]
7	95,500 —	1072,000—
8	56,400 —	1,167,500—
9	191,100 —	1,223,900—
10	144,700 —	1,415,000—
11	77,300 —	1,559,700—
12	72,500 —	1,637,000—
13	6,300 —	1,709,500—
TOTAL	1715,800 CY	1,715,800 CY

VOID

SCALE: 1"=100'

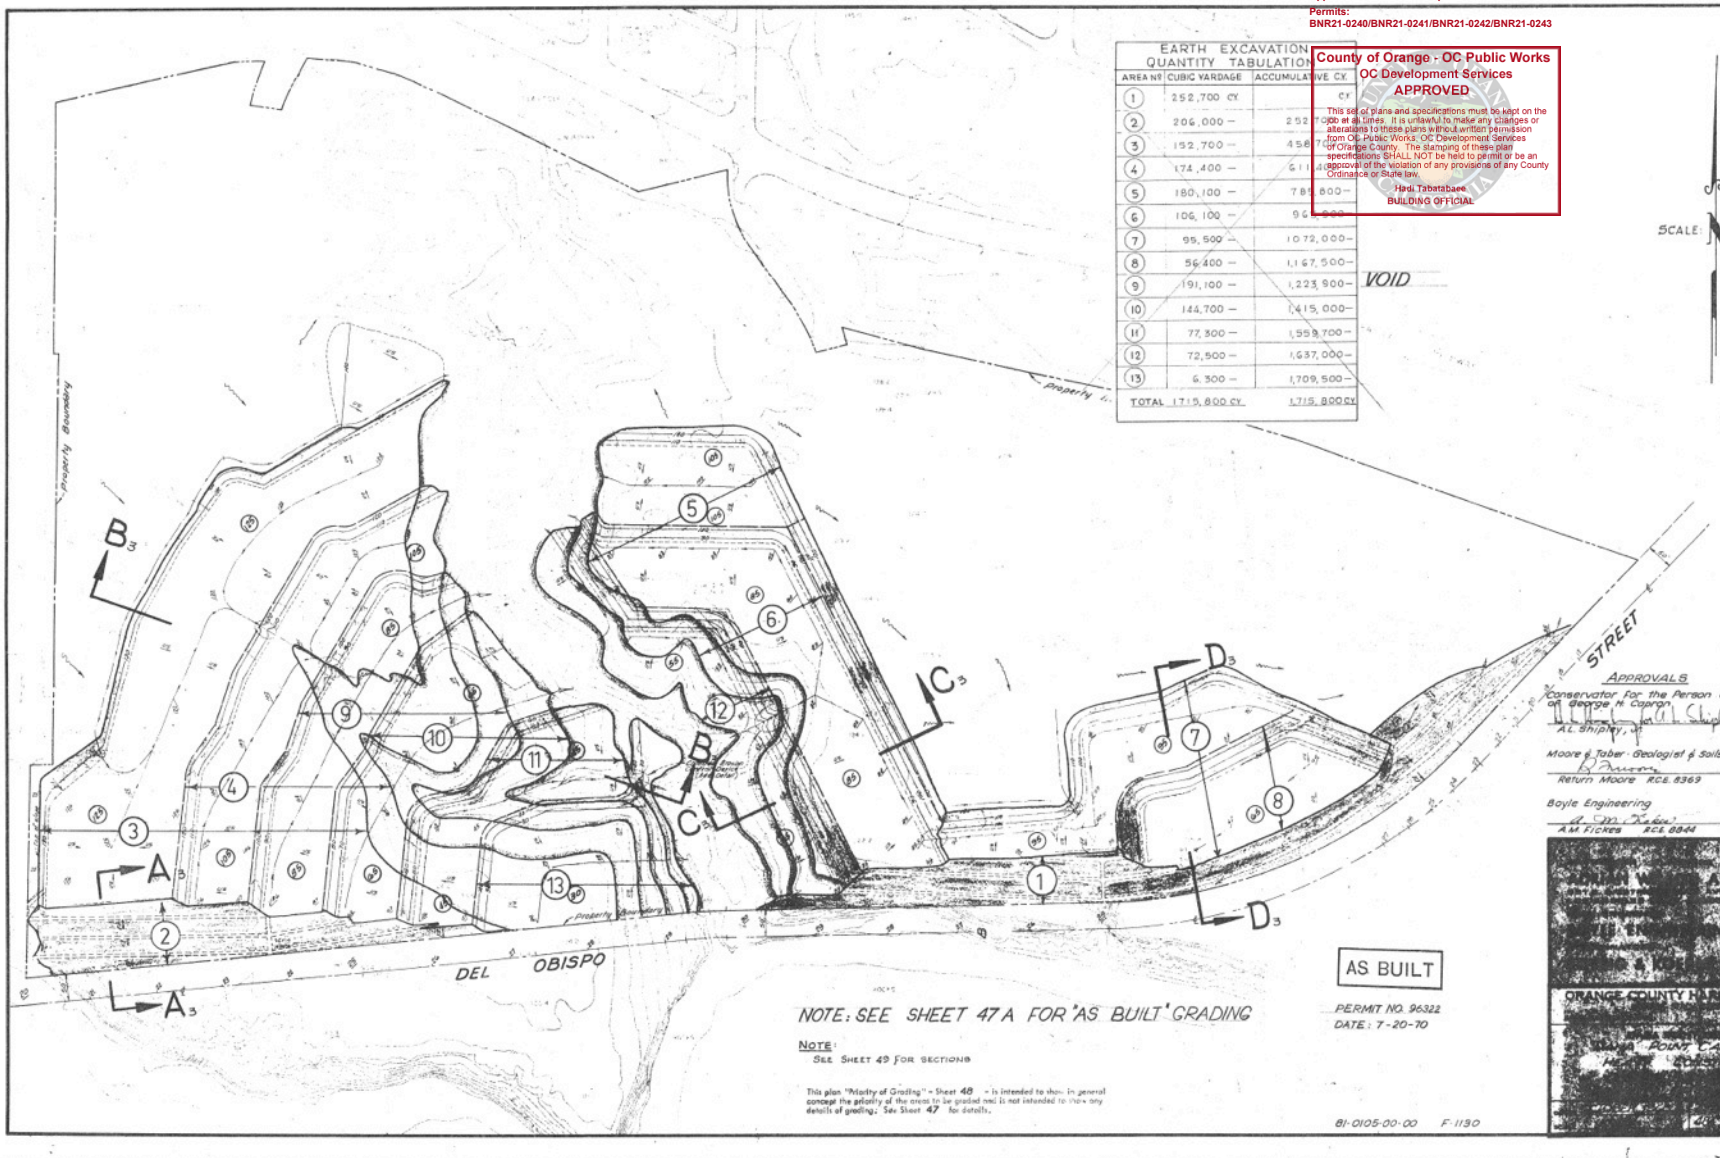

APPROVALS

Conservator for the Person and Estate of George H. Caprán
A.L. Shipley, Jr. 26-9-69
Date

Moore & Taber - Geologist & Soils Engineer
Reuben Moore R.G.E. 8369
5-12-69
Date

Boyle Engineering
A.M. Fickes R.C.E. 8844
5-12-69
Date

AS BUILT

PERMIT NO. 96322
DATE: 7-20-70

NOTE: SEE SHEET 47A FOR "AS BUILT" GRADING

NOTE:
SEE SHEET 49 FOR SECTIONS

This plan "Finality of Grading" - Sheet 48 - is intended to show in general concept the finality of the areas to be graded and is not intended to show any details of grading. See Sheet 47 for details.

81-0105-00-00 F-1130

ORANGE COUNTY [illegible]
BOARD OF [illegible]
[illegible]TION

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans specifically SHALL NOT be held to permit or be an approval of the violation of any provisions of any County
Hadi Tabatabaee
BUILDING OFFICIAL

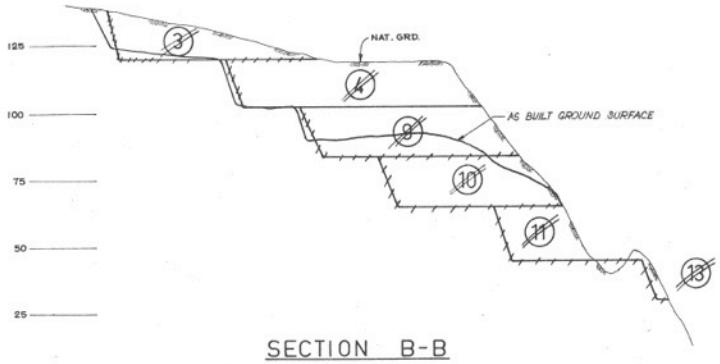

SECTION B-B
HORIZ: 1"=100'
VERT: 1"= 20'

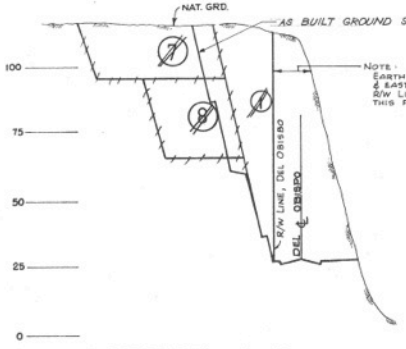

SECTION D-D
HORIZ: 1"=100'
VERT: 1"= 20'

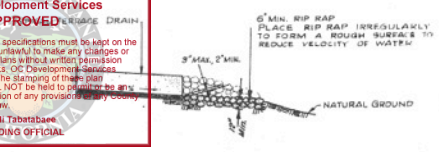

SECTION E

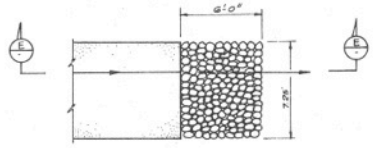

PLAN

VELOCITY REDUCER
NO SCALE

AS BUILT
PERMIT NO. 96322
DATE: 7-20-70

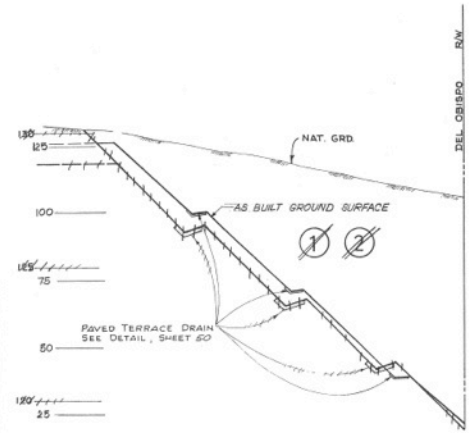

SECTION A-A
HORIZ: 1"=20'
VERT: 1"=20'

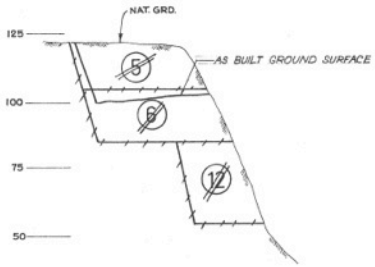

SECTION C-C
HORIZ: 1"=100'
VERT: 1"= 20'



SECTION

CONCRETE APRON
SCALE 1/4"=1'-0"

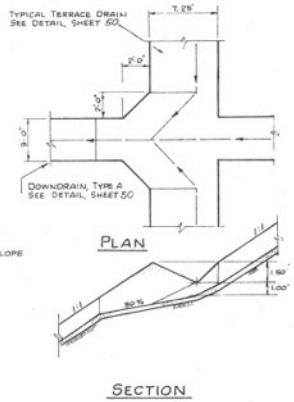

DOWNDRAIN INLET DETAIL (1/49)
NO SCALE

APPROVALS

Conservator for the Person and Estate of George N. Cagnon
A.L. Shipley, Jr. — Date 6-20-68

Moore & Taber-Geologist & Soils Engineer
Return Moore RCE 8369 — Date 5-15-68

Boyle Engineering
A.M. Fickes RCE 8841 — Date 5-16-68

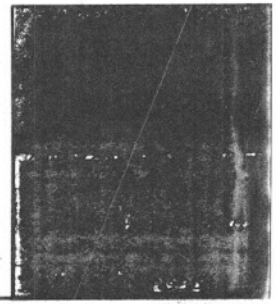

81-0105-00-00 F-1130

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0243/BNR21-0242

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The approval of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
1/21/25
Hadi Tabatabaee
BUILDING OFFICIAL



TYPICAL TERRACE DRAIN
SCALE: 1"=4'-0"



TYPICAL BERM AT TOP OF SLOPE

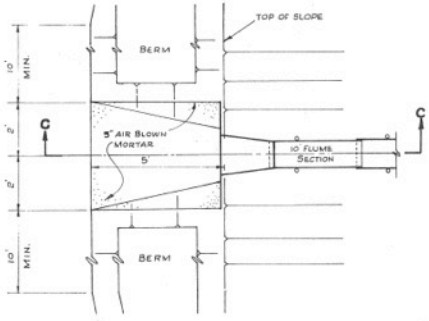

PLAN
TAPERED INLET AND FLUME DOWNDRAIN
TYPE B

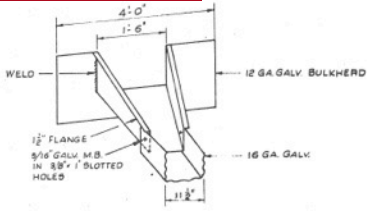

TAPERED INLET

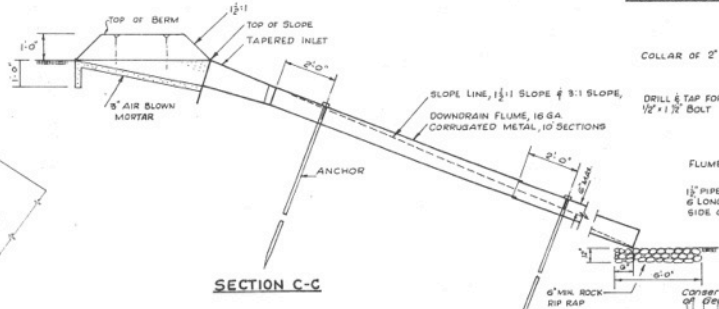

SECTION C-C



PROFILE
DOWNDRAIN & ANCHOR
SCALE: 1"=1'-0"

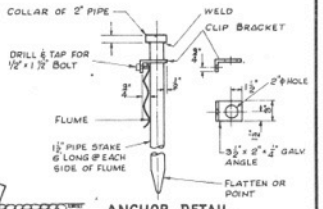

ANCHOR DETAIL

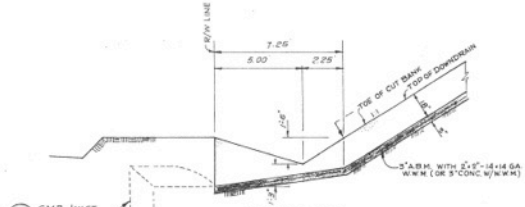

PROFILE A-A

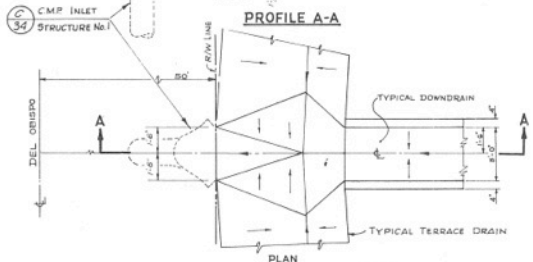

PLAN
DRAINAGE OUTLET (A)
NO SCALE

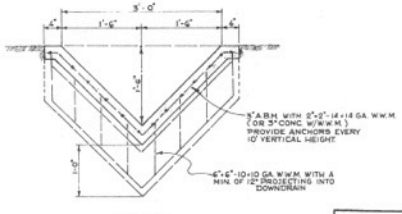

SECTION
TYPICAL DOWNDRAIN
TYPE A

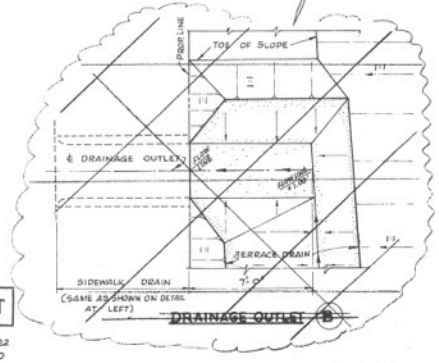

DRAINAGE OUTLET (B)

AS BUILT
PERMIT NO. 96322
DATE: 7-20-70

Conservator for the Person and Estate of George H. Capron
A.L. Shipley, Jr. 20-7-68 Date

Moore & Taber - Geologist & Soils Engineer
Return Moore R.C.E. 8369 6-15-68 Date

Boyle Engineering
[redacted] 6-14-68

81-0105-00-00 F-1130

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

NAVIGATION MARKER DETAILS

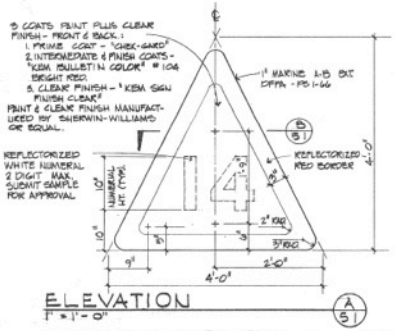

ELEVATION 1" = 1'-0" (A/S1)

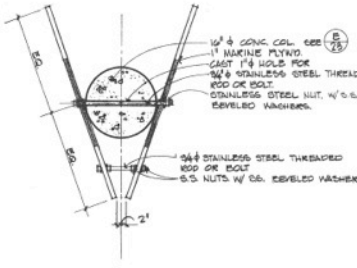

SECTION-PLAN 1" = 1'-0" (B/S1)



ELEVATION 1/2" = 1'-0" (C/S1)

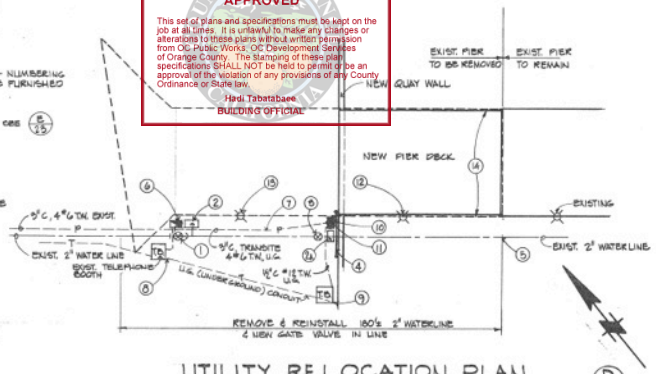

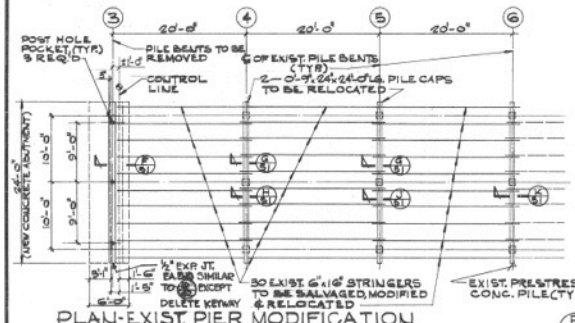

PLAN-EXIST. PIER MODIFICATION 1/8" = 1'-0" (E/S1)

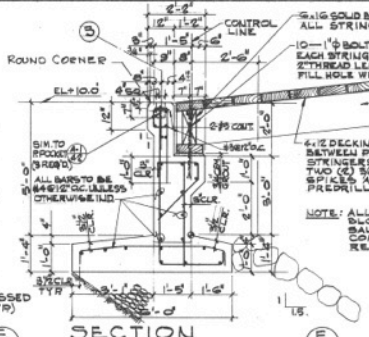

SECTION 1/2" = 1'-0" (F/S1)

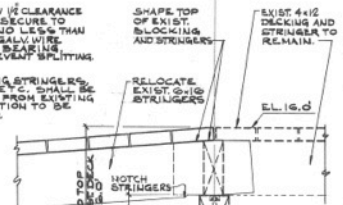

UTILITY RELOCATION PLAN
NO SCALE (D/S1)

CONSTRUCTION NOTES

1. REMOVE EXIST. 2" GATE VALVE.
2. RELOCATE EXIST. FIRE HOSE CABINET TO NEW LOCATION. (2A) MOUNT ON RAILING
3. INSTALL NEW GATE VALVE IN REINSTALLED WATER LINE.
4. INSTALL 10' EXIST. RAILING.
5. CONNECT TO EXIST. 2" WATER LINE.
6. RELOCATE PANELBOARD TO NEW LOCATION. (10)
7. EXTEND PRIMARY POWER DUCT & FEEDER TO NEW PANELBOARD LOCATION & CONNECT.
8. REMOVE TELEPHONE CONDUIT STUB-UP AND EXTEND CONDUIT TO TELEPHONE BOOTH NEW LOCATION (9) IN CONFORMANCE WITH THE TELEPHONE COMPANY REQUIREMENTS.
9. TELEPHONE BOOTH - NEW LOCATION.
10. PANELBOARD - NEW LOCATION
11. INSTALL RELOCATED PANELBOARD AND ROUTE CIRCUITS FOR LIGHTING & POWER SIMILAR TO EXISTING.
12. REMOVE LTG. STD. AND REINSTALL AFTER PIER MODIFICATION.
13. REMOVE LTG. STD. AND SALVAGE.
14. REMOVE & REINSTALL HANDRAILING WITHIN LIMITS OF NEW PIER DECK CONSTRUCTION.

GENERAL NOTES

1. WATER LINE INSTALLED WITHIN LAND AREA SHALL HAVE A MIN. COVER OF 36".
2. WATER LINE INSTALLED ON PIER SHALL BE MOUNTED SIMILAR TO EXISTING.
3. LIGHTING POWER & RECEPTACLES SHALL BE RECONNECTED SIMILAR TO EXISTING.
4. ELECTRICAL MODIFICATION WORK SHALL FOLLOW NATIONAL ELECTRICAL CODE AND LOCAL CODES.
5. ALL ELECTRICAL PERMITS SHALL BE OBTAINED BY THE CONTRACTOR.
6. SPLICES SHALL NOT BE MADE IN CONDUIT RUNS.
7. ALL FRESHLY CUT SURFACES OF DECKING, STRINGERS, ETC. SHALL BE THOROUGHLY BRUSHED WITH TWO COATS OF CREOSOTE.

AS BUILT
DEC 23 1970

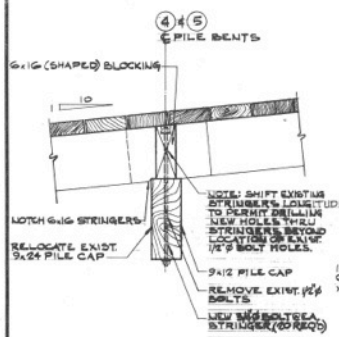

SECTION 3/4" = 1'-0" (G/S1)

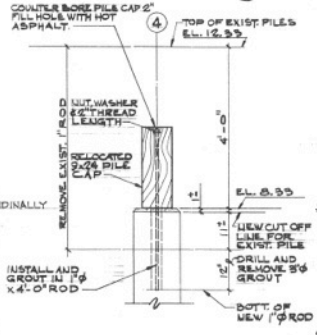

SECTION 3/4" = 1'-0" (H/S1)

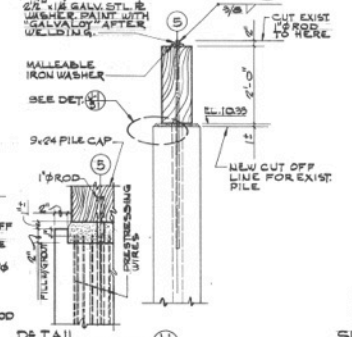

DETAIL 1" = 1'-0" (J-1/S1)

SECTION 3/4" = 1'-0" (J/S1)

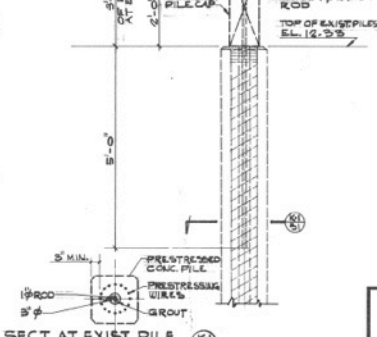

SECT. AT EXIST. PILE 3/4" = 1'-0" (K-1/S1)

SECTION 3/4" = 1'-0" (K/S1)

ORANGE COUNTY HARBOR DISTRICT
NEWPORT BEACH, CALIFORNIA
1901 BAYSIDE DRIVE 714/834-3800

DANA POINT HARBOR
DANA POINT CALIFORNIA
HEAVY CONSTRUCTION
PIER MODIFICATION
STRUCTURAL & MISCELLANEOUS DETAILS

PLANS PREPARED BY
KOEBIG & KOEBIG, INC.
ENGINEERING ARCHITECTURE PLANNING
LOS ANGELES CALIFORNIA
213/629-2700

JOB NO. 1-417.31 APPROVED
DATE 9-19-69

DATE SEPTEMBER, 1969
SCALE AS SHOWN
SHEET 51 OF 51
D10.5-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX D

Potential Obstruction Mitigation Layout

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
~~BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243~~

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Example layout for mitigation option

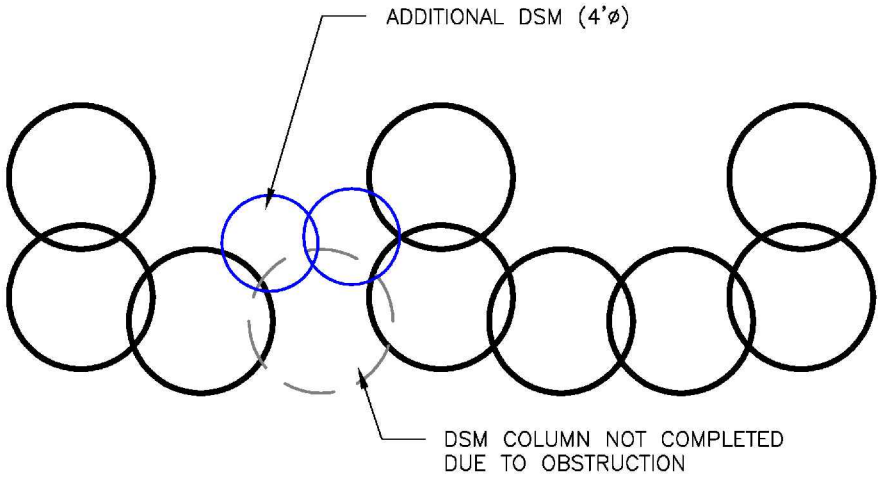

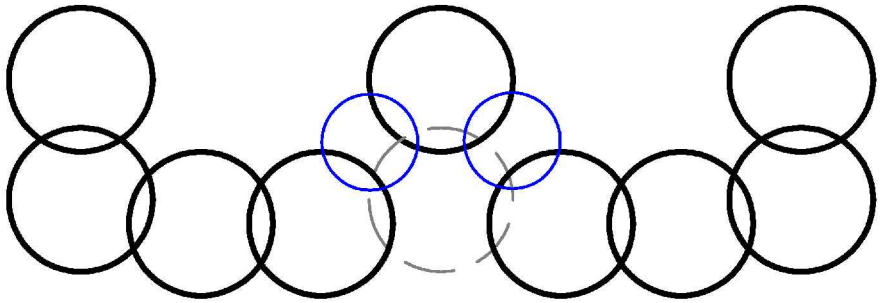

Example Layout for Mitigation Option - Sketch by AGI

GMU	Date: SEPTEMBER 20, 2021
	Project No.: 17-206-02

DRAWING: q:\2017\17-206-02\dwg\1720602_dph_commcor_example layout for mitigation option - sketch by agi.dwg PLOTTED: 9/20/2021 2:57 PM BY: Jesus Meza

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX E

Revised AGI Design Package

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

AGI
ADVANCED GEOSOLUTIONS INC
Ground Improvement and Specialty Piling Contractors

GROUND IMPROVEMENT BY DEEP SOIL MIXING

DANA POINT HARBOR COMMERCIAL COMPONENT
DANA POINT, CALIFORNIA

Submittal No. 01

DESIGN SUBMITTAL

August 23, 2021

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

1.0 INTRODUCTION

Advanced Geosolutions, Inc. (AGI) is pleased to present this design submittal package for deep soil mixing (DSM) at the planned redevelopment area located at the harbor in Dana Point, California. We understand the redevelopment involves the construction of new hotels, new commercial buildings and new marine facilities. The submittal herein addresses the design for the commercial area of this redevelopment.

The geotechnical report by GMU identifies medium dense to dense sandy artificial fill at the site down to a depth of approximately 20 feet below grade at the time of geotechnical exploration. They recommended ground improvement to mitigate excessive seismically induced lateral spreading at the project site. Ground improvement is also intended to mitigate uncertainty about the competence of the undocumented artificial fill soils and the potential associated risk with constructing structures overlying those materials. DSM was selected by the design team as the most appropriate ground improvement technique for this project based on the soil conditions, performance goals, efficiency, and site constraints.

Our design meets the performance criteria as described in the following sections. Concepts, calculations, means, and methods in this design are deemed intellectual property of AGI, and shall remain confidential. AGI's design, and any other related information, shall not be made available to another party other than the members of the design team without the express written consent of AGI. We anticipate that a set of construction drawings and specifications will be put out to bid but only the minimal set of documents required to bid the installation work should be distributed to bidders as approved by AGI.

2.0 REFERENCE DOCUMENTS AND INFORMATION

In preparing this design AGI relied on information provided by the design team, including:

- Geotechnical Investigation Report, Volumes 1, 2, and 3, Dana Point Harbor Revitalization: Buildings 1 through 12 – Commercial Component, City of Dana Point, California. Report no. 17-206-02 prepared by GMU and dated 5/27/2021.
- Site plan CAD file provided by GMU
- Foundation plan for building 1 prepared by KPFF dated 10/8/2020
- Foundation plans for buildings 6-9 prepared by KPFF dated 4/9/2021
- Foundation plans for building 10-12 prepared by KPFF dated 4/12/2021

3.0 DESIGN CRITERIA

Per the Geotech report's recommendation and discussion with the design team, the ground improvement shall be designed in consideration of the following performance criteria:

- Design earthquake Magnitude (Mw) = 6.9 and PGA = 0.67g

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- Reduce lateral spread movement to 3 inches or less behind the DSM buttress
- Ground improvement will directly support all footings with at least 5,000 psf allowable bearing pressure.
- Limit total static settlement to 1 inch or less.
- Reduce total seismic settlement to 0.5 inch or less.
- Building slab-on-grade areas require improvement or support to mitigate potential poor performance of undocumented fill materials.

4.0 CEMENT DEEP SOIL MIXING (DSM) DESIGN

The proposed DSM layout is presented in Appendix A. The DSM program includes two components: (1) DSM buttress along the waterfront, between the existing seawall and the proposed building, and (2) discrete DSM columns under the proposed buildings to support structural loads with a soil-cement load transfer platform (LTP) to distribute slab loading to the DSM columns.

The buttress is 12 feet wide and consists of overlapping 6-ft diameter DSM with a continuous front row. The columns will embed 4 feet into the Capistrano formation.

The DSM system supporting Buildings 6 through 12 consists of 4-ft diameter columns centered under all footings. In addition, the same 4-ft diameter columns are installed in a 12-ft grid pattern throughout slab-on-grade areas in building interiors. The 4-ft diameter DSM columns for building support will extend to practical refusal to rest on competent bedrock materials.

The DSM design unconfined compressive strength (UCS) is 150 psi at 28 days.

4.1 Lateral Spread

AGI performed a pseudostatic slope stability analysis in order to determine the post-improvement critical horizontal seismic coefficient (also called yield acceleration, k_y), which is a necessary input value to estimate lateral slope deformation. The analysis is presented in Appendix B1. The slope geometry and soils parameters used in the model were provided by GMU.

For section A, the composite shear strength of the DSM buttress was calculated based on the area replacement ratio (ARR), and this calculation is shown in Appendix B2. For sections C and D, the DSM block is modeled as a 5-ft wide (effective width) zone with 100% ARR on the perimeter of Building 1, while the soils inside the block is assigned unimproved strength without liquefaction.

AGI estimated lateral spread deformation using the empirical equations outlined in NCHRP Report 611 (2008), and the calculation is shown in Appendix B3. The results are summarized in Table 1 below.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Table 1. Estimated Post-improvement Slope Deformation

Section	Ky from pseudostatic analysis	Estimated Slope deformation (inch)
Section A	0.26g	1.4
Section C	0.78g	0.0
Section D	0.49g	0.1

AGI performed all applicable internal stability checks of the buttress in accordance with FHWA guidelines. Those checks included bearing capacity, overturning, crushing at the toe, racking, and internal shear failures. The analysis is included in appendix B4.

4.2 Building Support

The structural capacity and geotechnical capacity calculation are included in Appendix C1 and C2, respectively. The analysis results indicate that the allowable load on a 4-ft diameter DSM column bearing on bedrock is 200 kips.

Building loading information was not provided with the structural drawings but we understand the footings were sized for 5,000 psf. Therefore the required number of DSM column supporting each footing was determined by taking the footing area, multiply by 5.0 ksf, and divide by 200 kips.

4.3 Static Settlement

Since the DSM columns will bear directly on formation material, the main source of static settlement is the elastic compression of the soil cement. This was calculated using the software RSPile by Rocscience. The calculation is shown in Appendix C3. The elastic modulus of DSM material was selected based on FHWA's recommended correlation (300 times design compressive strength).

The result indicates static settlement of the DSM column under design load is approximately 0.5 inch.

4.4 Seismic Settlement

The DSM columns transfer building loads to bedrock, but it does not densify the surrounding soils. When the soils liquefy after an earthquake, it would induce downdrag forces on the DSM columns which causes additional compression and settlement.

AGI estimated the magnitude of liquefaction-induced downdrag and column compression using method for piles, as outlined in the AASHTO Bridge Design Manual. This calculation is shown in Appendix D, which shows that downdrag force is approximately 128 kips for a 4-ft diameter

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

column. And the corresponding seismic settlement due to DSM column compression is less than 0.1 inch.

The structural capacity and geotechnical capacity checks of Appendices C1 and C2 also ensure that the DSM column can resist this downdrag load in addition to the building design load.

5.0 DSM INSTALLATION METHOD

Cement Deep Soil Mixing is performed using a specialty, purpose-built drilling tool consisting of a series of mixing blades and/or paddles extending radially from a hollow stem. In general, as the mixing tool is advanced into the soil, the hollow stem is used as a conduit to pump grout slurry (a mixture of cement and water) and injected at the tip of the tool while blending the soils. Pre-augering or trenching operations may be used to facilitate mechanical breakdown and blending of firm or stiff soils, or to remove the upper strata before DSM operations, or to assist with spoil control. The resulting DSM product is an improved soil-cement column with low compressibility, high stiffness, and significant load carrying capacity. Typical DSM equipment and mixing tools are shown below in Figure 1.

Grout will be batched on site using an in-line jet valve or weight control system. We anticipate that cement and water will be the only components for the grout slurry. Water and/or cement component quantities are adjusted to achieve the target specific gravity prior to pumping it to the mixing drill rig. The batch plant and pump are expected to be located in an area to avoid relocating the facility during the entire DSM operation.

Figure 1. DSM mixing tool assembly (left) and track-mounted drilling rig constructing a DSM column (right)

6.0 LOAD TRANSFER PLATFORM (LTP)

As described above the design includes a LTP consisting of cement-treated soils at the ground surface. The LTP will be constructed in three 12-inch-thick lifts for a three-foot-thick section of

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

soil cement to a design strength of 200 psi at 28 days. LTP will be constructed after completion of the DSM scope placing the lifts over the top of the DSM columns throughout the structural footprints of the buildings. The LTP is designed to transfer load from the floor slab to the regularly spaced DSM columns at 12 feet on-center. See Geotechnical Report for other requirements.

We have assumed slab loading (Dead plus live) of 300 psf for this design. The performance of the LTP under load was analyzed using 2D plane strain finite element in PLAXIS, which is presented in Appendix E. The analysis demonstrates that the specified LTP will provide satisfactory performance under 300 psf floor load. The design also conservatively assumes that the artificial soils underlying the LTP may settle and accounts for the potential that a gap may form below the bottom of the LTP and the underlying soil such that no support is provided other than by the DSM columns.

7.0 DEEP SOIL MIXING QUALITY ASSURANCE / QUALITY CONTROL (QA/QC)

Quality Control / Quality Assurance will be performed in accordance with the DSM specifications as outlined on the approved drawings.

8.0 LOAD TRANSFER PLATFORM QUALITY CONTROL

LTP Quality Control will be performed in accordance with the Geotechnical Report's recommendations.

9.0 CONCLUDING REMARKS

This ground improvement preliminary design is submitted to address the geotechnical concerns of the proposed buildings. The design uses DSM ground improvement technique to meet the project requirements provided to AGI.

The layout of our ground improvement program is presented in AGI's shop drawing (Appendix A). Relevant strength parameters of the design will be verified by the UCS results.

This design was conducted in a manner consistent with the level of care and skill ordinarily exercised by members of the geotechnical engineering profession currently practicing under similar conditions and in the same locality. No warranty is made nor implied.

We appreciate the opportunity to provide our services for this project. Please contact the undersigned with any questions regarding this document.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Sincerely,

ADVANCED GEOSOLUTIONS, Inc.

REGISTERED PROFESSIONAL ENGINEER
THOMAS TRAN
C 91763
CIVIL
STATE OF CALIFORNIA

Justin Martos, P.E., G.E.
Project Manager

Thomas Tran, P.E.
Design Engineer

---- 0 ----

References

FHWA (2013) “Federal Highway Administration Design Manual: Deep Mixing for Embankment and Foundation Support”. Publication No. FHWA-HRT-13-046. U.S. Department of Transportation, Federal Highway Administration

Kitazume, M. and Terashi, M. "The Deep Mixing Method", CRC Press 2013.

Lunne, T., Robertson, P.K., and Powellm J.J.M. (1997) “Cone Penetration Testing in Geotechnical Practice”

NCHRP (2008) Report 611 “Seismic Analysis and Design of Retaining Walls, Buried Structures, Slopes, and Embankments”. Transportation Research Board

Rayamajhi,D., Nguyen, T., Ashford, S., Boulanger, R., Lu, J., Elgamal, and Shao, L. (2014). ” Numerical Study of Shear Stress Distribution for Discrete Columns in Liquefiable Soils.” J. Geotech. Geoenviron. Eng., 140, 2014.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A

Layout Drawings

Building&Safety: Ryan Rose 1/19/2020
Approved: Geotechnical Reports
Permits:
BMHV-3140B0MV2-4241B4MV2-4240BMV2-4240
County of Orange OC Public Works
OC Development Services
APPROVED
Issuance of this permit does not authorize violation of any federal, state or county laws or regulations. Permittee is responsible for all work and activities in accordance with the approved plans and specifications. Any deviation must be approved in advance. Approval of revised plans and specifications does not permit construction to begin.
Troy Danielson
Inspection Services

DANA POINT HARBOR
COMMERCIAL COMPONENT
DEEP SOIL MIXING
DANA POINT, CALIFORNIA

SHEET INDEX

GI–1	COVER SHEET
GI–2	GENERAL NOTES AND DETAILS
GI–3	DEEP SOIL MIXING PLAN
GI–4.1	DEEP SOIL MIXING LAYOUT – BUILDING 1
GI–4.2	DEEP SOIL MIXING LAYOUT – BUILDING 6
GI–4.3	DEEP SOIL MIXING LAYOUT – BUILDING 7
GI–4.4	DEEP SOIL MIXING LAYOUT – BUILDING 8
GI–4.5	DEEP SOIL MIXING LAYOUT – BUILDING 9
GI–4.6	DEEP SOIL MIXING LAYOUT – BUILDING 10
GI–4.7	DEEP SOIL MIXING LAYOUT – BUILDING 11
GI–4.8	DEEP SOIL MIXING LAYOUT – BUILDING 12
GI–5	GEOTECHNICAL SECTIONS

GROUND IMPROVEMENT DESGINER:	ADVANCED GEOSOLUTIONS, INC.
CIVIL ENGINEER:	TAIT & ASSOCIATES, INC.
STRUCTURAL ENGINEER:	KPFF
GEOTECHNICAL ENGINEER:	GMU GEOTECHNICAL, INC.

VICINITY MAP

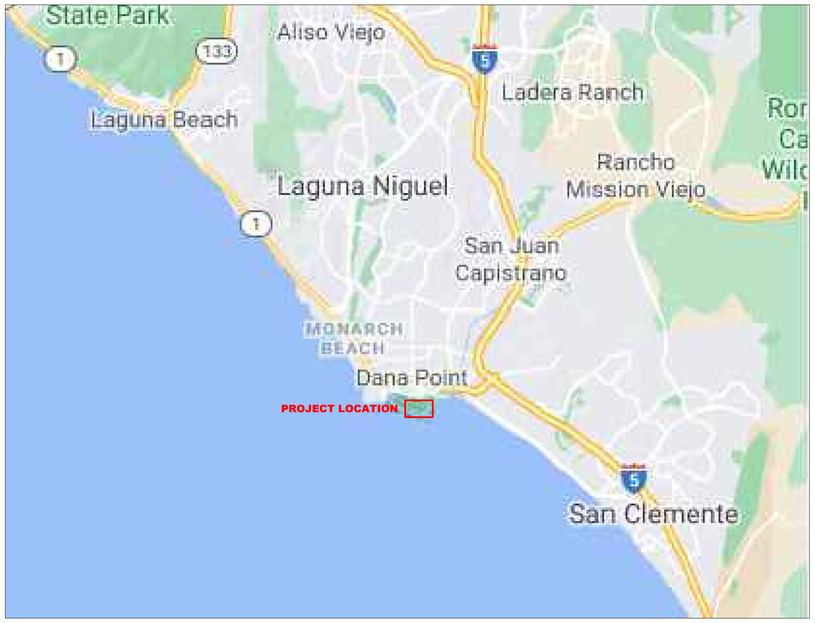

MAP DATA: GOOGLE 2020

LOCATION MAP

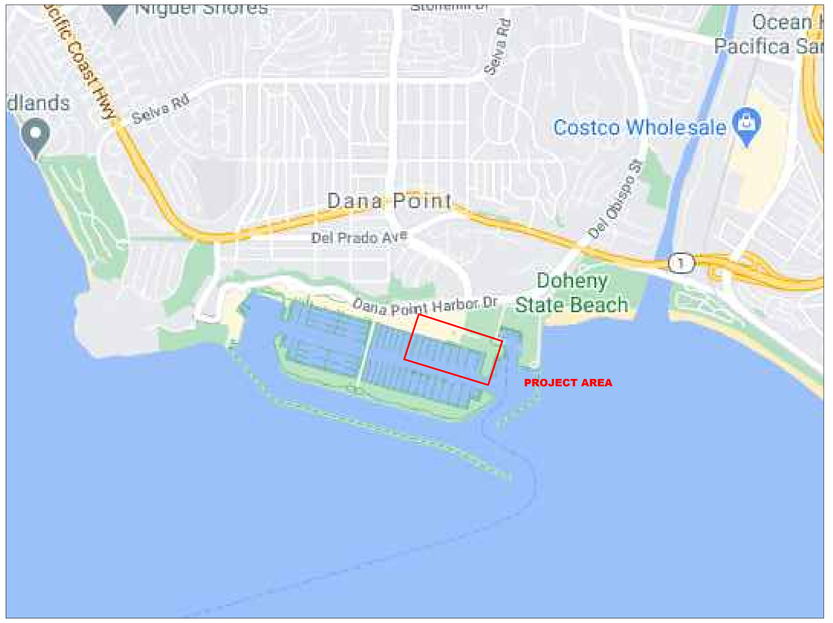

MAP DATA: GOOGLE 2020

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

COVER SHEET

PROJECT NO.	–
DATE:	08/23/2021
SCALE:	AS SHOWN

SHEET NUMBER: GI-1

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building Entity: Ryan Ross 1/18/2020
Approval: Geotechnical Reports
Permits:
BMP1-0240BMP01-0241BMP01-0242BMP01-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/18/2020
This approval is subject to the requirements and conditions set forth in the applicable regulations in effect on the date of approval. Approval does not authorize any violation of State or local laws. Any deviation from approved plans must be reviewed and approved by the County prior to construction. One set of approved plans must be available for use at the work site at all times.
By: Tim Nguyen
Permit #1194

PART 1 – GENERAL

1.1 SCOPE

A. DEEP SOILS MIXING (DSM) SHALL BE INSTALLED TO MITIGATE POTENTIAL FOR LATERAL SPREADING AND UNCERTAIN PERFORMANCE OF UNDOCUMENTED ARTIFICIAL FILL.

B. A LOAD TRANSFER PLATFORM (LTP) SHALL BE CONSTRUCTED THROUGHOUT ALL BUILDING FOOTPRINTS TO TRANSFER FLOOR SLAB LOADING TO UNDERLYING DSM COLUMNS AND PREVENT ADVERSE SETTLEMENT IN FLOOR SLAB AREAS THAT MAY RESULT FROM NEW LOADING APPLIED TO UNDERLYING UNDOCUMENTED ARTIFICIAL FILL.

C. THE DSM PLAN IS PREPARED IN ACCORDANCE WITH THE RECOMMENDATIONS OUTLINED IN THE GEOTECHNICAL REPORT PREPARED BY GMU DATED 5/27/2021.

D. THIS DESIGN IS BASED ON THE GEOTECHNICAL CHARACTERIZATION AND SOIL PARAMETERS PRESENTED IN THE REFERENCED GEOTECHNICAL REPORT, AS WELL AS LOAD REQUIREMENTS INDICATED ON THE STRUCTURAL DRAWINGS. THIS DESIGN WAS CONDUCTED IN A MANNER CONSISTENT WITH THE LEVEL OF CARE AND SKILL ORDINARILY EXERCISED BY MEMBERS OF THE GEOTECHNICAL ENGINEERING PROFESSION CURRENTLY PRACTICING UNDER SIMILAR CONDITIONS AND IN THE SAME LOCALITY. NO WARRANTY IS MADE NOR IMPLIED.

1.2 REFERENCES

A. GEOTECHNICAL INVESTIGATION REPORT, VOLUMES 1, 2, AND 3, DANA POINT HARBOR REVITALIZATION BUILDINGS 1 THROUGH 12, COMMERCIAL COMPONENT – REPORT NO. 17-206-02 PREPARED BY GMU DATED MAY 27, 2021.

B. ASTM C150 – SPECIFICATION FOR PORTLAND CEMENT

C. ASTM D1633 – STANDARD TEST METHODS FOR COMPRESSIVE STRENGTH OF MOLDED SOIL–CEMENT CYLINDERS

D. ASTM D4380 – DENSITY OF BENTONITE SLURRIES

F. FEDERAL HIGHWAY ADMINISTRATION DESIGN MANUAL: DEEP MIXING FOR EMBANKMENT, AND FOUNDATION SUPPORT, PUBLICATION NO. FHWA-HRT-13-046, OCTOBER 2013.

1.3 DEFINITIONS

A. DEEP SOIL MIXING (DSM) – A SOIL IMPROVEMENT TECHNIQUE USED TO CONSTRUCT IN SITU SOIL STRUCTURES OR TREAT SOILS IN PLACE, WITHOUT EXCAVATION OR DEWATERING. SOIL MIXING USES A LARGE, CRANE OR DRILL RIG – MOUNTED TURNTABLE TO INSERT A LARGE–DIAMETER (TYPICALLY 3– TO 8 –FOOT DIAMETER) TOOL INTO THE GROUND WHILE INJECTING AND MIXING A GROUT WITH THE SOIL. STABILIZED SOIL COLUMNS ARE CREATED THAT MAY BE JOINED TOGETHER BY OVERLAPPING TO FORM RETAINING WALLS OR FOUNDATION ELEMENTS, OR TO TREAT A LARGE BLOCK OF SOIL OR SLUDGE.

B. ASTM – ASTM INTERNATIONAL.

C. OWNER – THE OWNER AS REFERRED TO HEREIN IS DANA POINT HARBOR PARTNERS, LLC, C/O BURNHAM–WARD PROPERTIES.

D. ENGINEER – THE ENGINEER IS THE OWNER'S GEOTECHNICAL ENGINEER OF RECORD TO ACT ON ITS BEHALF IN THE EXECUTION OF THESE SPECIFICATIONS.

E. CONTRACTOR – REFERS TO THE GENERAL CONTRACTOR DIRECTLY CONTRACTED WITH THE OWNER AND SUBCONTRACTING THE DSM SCOPE TO THE DSM SUBCONTRACTOR.

F. DEEP SOIL MIXING SUBCONTRACTOR (DSM SUBCONTRACTOR) – AN INDIVIDUAL OR COMPANY WHO HAS HAD PROVEN AND SUCCESSFUL EXPERIENCE IN SOIL MIXING CONSTRUCTION.

G. GROUT – A STABLE COLLOIDAL SUSPENSION OF POWDERED CEMENT, BENTONITE, ADDITIVES AND/OR OTHER SIMILAR MATERIALS IN WATER. THE TERMS "GROUT" AND "SLURRY" ARE USED INTERCHANGEABLY IN THESE SPECIFICATIONS.

H. INJECTION RATIO – A VOLUMETRIC RATIO OF GROUT TO SOILS (E.G., 100 GALLONS/CUBIC YARD) TO BE MIXED IN A DSM COLUMN. THE GROUT INJECTION RATIO IS DETERMINED FOR EACH COLUMN BASED ON THE COLUMN DIMENSIONS, SOIL DENSITY, PATTERN OF TREATMENT, AND DESIRED APPLICATION RATE.

I. DSM COLUMN – ONE COMPLETED INSERTION, INJECTION AND MIXING OF THE SOIL WITH THE MIXING AUGER TO THE DESIGN DEPTH. THIS CREATES A COLUMN OF TREATED SOIL THE SAME DIAMETER AS THE MIXING AUGER. THE COLUMN MAY BE PRIMARY (THROUGH VIRGIN SOILS), SECONDARY (CONNECTING PRIMARY COLUMNS), TERTIARY, ETC.

J. WORKING PLATFORM – THE WORKING PLATFORM IS THE LEVELED AND STABLE SURFACE FROM WHICH THE DSM EQUIPMENT OPERATES.

K. MIXING AUGER/TOOL – THE SPECIAL TOOL THAT ATTACHES TO THE KELLY BAR AND IS INSERTED INTO THE GROUND TO MIX THE SOILS. THE TOOL MAY BE FITTED WITH PORTS FOR INJECTING GROUT, MIXING PADDLES, AUGER BLADES, ETC.

L. BLADE ROTATION NUMBER (BRN) – NUMBER OF BLADES X (RATE OF PENETRATION PLUS RATE OF WITHDRAWAL (IN REVOLUTIONS/METER). FOR EXAMPLE FOR 5 BLADES, RATE OF PENETRATION = 1 REVOLUTION/25 MM (40 REVOLUTIONS/M), AND RATE OF WITHDRAWAL = 1 REVOLUTION/20 MM (50 REVOLUTIONS/M), THE BRN = 5 X (40 + 50) = 450.

M. OBSTRUCTION – OBSTRUCTIONS ARE DEFINED AS MATERIALS CLASSIFIED AS UNDERGROUND UTILITIES, TREES (OR PARTS THEREOF), METAL, MAN–MADE OBJECTS, WOODEN/CONCRETE/STEEL OR ANY OTHER TYPE OF PILE OR DEEP FOUNDATION, OR NATURAL GROUND MATERIALS LARGER THAN A MAXIMUM COBBLE SIZE (8 INCHES MAXIMUM DIMENSION).

N. MIXING BLADE – A SINGLE MIXING BLADE SHALL CONSTITUTE A PAIR OF MIXING PADDLES ATTACHED TO THE SHAFT OF THE MIXING TOOL AT THE SAME ELEVATION. THE CUTTING PADDLES MAY ALSO BE CONSIDERED AS A MIXING BLADE.

O. DOSAGE – EXPRESSED AS THE MASS OF BINDER INTRODUCED PER VOLUME OF MIXED IN–SITU SOIL (E.G. KG/M^3).

1.4 SUBMITTALS

A. DSM WORK PLAN INCLUDING:

I. ASSIGNED NUMBER OF EACH COLUMN AS ID FOR INSTALLATION RECORD

II. NARRATIVE OF PLANNED MEANS AND METHODS TO EXECUTE THE INSTALLATION PER PLANS AND SPECIFICATIONS, INCLUDING SPECIFICATIONS OF THE GROUT BATCHING AND VERTICAL DRILL EQUIPMENT INTENDED FOR USE ON THE PROJECT.

III. NARRATIVE OF PLANNED MEANS AND METHODS TO EXECUTE THE QUALITY CONTROL REQUIREMENTS PER PLANS AND SPECIFICATIONS.

IV. PRELIMINARY SOIL MIX DESIGN INDICATING TYPE OF BINDER MATERIAL AND VOLUMETRIC PROPORTIONS FOR INITIAL TRIALS ON–SITE TO BE ADJUSTED BASED ON FIELD OBSERVATIONS AND EARLY STRENGTH RESULTS (SEE PART 3.2 TEST SECTION).

B. ACCURATE DAILY RECORDS OF THE WORK TO BE SUBMITTED BY CLOSE OF BUSINESS THE FOLLOWING DAY, INCLUDING:

I. COLUMN ID

II. DIAMETER

III. WORKING PAD ELEVATION

IV. MIXING DEPTH

V. START TIME

VI. TIME AT TIP ELEVATION

VII. FINISH TIME

VIII. MIXING DURATION

IX. GROUT MIX DETAILS (PERCENT WATER AND REAGENT BINDER)

X. GROUT INJECTION WITH DEPTH

XI. TOTAL INJECTED GROUT

XII. BLADE ROTATION NUMBER (BRN) WITH DEPTH

D. ANY PROPOSED CHANGE IN THE WORK PROCEDURES PLAN MADE NECESSARY BY CONDITIONS ENCOUNTERED DURING CONSTRUCTION FOR REVIEW AND APPROVAL BY THE ENGINEER.

E. MATERIAL CERTIFICATIONS FOR CEMENT BINDER TO BE USED IN THE PROJECT.

F. WEIGHTS: CERTIFICATES OF BATCH WEIGHTS FOR EACH TRUCK LOAD DELIVERED IF ON–SITE BATCH PLANT IS NOT USED.

G. ADMIXTURES/POZZOLANS/ADDITIVES SUBJECT TO THE APPROVAL OF THE ENGINEER, IF USED.

H. QC TEST RESULTS: SUBMIT ALL QC TEST RESULTS WITHIN 48 HOURS OF TESTING.

I. REPORT SUMMARIZING TEST SECTION RESULTS AND CALIBRATION OF DRILLING EFFORT CRITERIA FOR COLUMN DEPTH TERMINATION APPROVED BY THE ENGINEER.

J. AS–BUILT REPORT DOCUMENTING THE CONSTRUCTED LOCATIONS AND DIMENSIONS OF ALL DSM COLUMNS, COMPILATION OF ALL QUALITY CONTROL AND QUALITY ASSURANCE DATA COLLECTED FOR THE PROJECT, AND EXPLANATION OF ANY DEVIATION FROM THE PLANS AND SPECIFICATIONS PREVIOUSLY REVIEWED APPROVED TO THE SATISFACTION OF THE ENGINEER.

K. THE CONTRACTOR WILL SUBMIT A WORK PLAN DETAILING THE CONSTRUCTION AND QA/QC OF THE LTP, MEETING THE DESIGN REQUIREMENTS HEREIN AND IN THE GEOTECHNICAL REPORT.

1.5 ACCEPTANCE

A. ACCEPTANCE OF THE DSM WORK WILL BE BASED ON COMPLIANCE WITH THE STRENGTH AND GEOMETRY REQUIREMENTS OF THE PLANS AND SPECIFICATIONS AS VERIFIED BY THE ENGINEER'S QA TESTING. THE MATERIAL FORMED BY MIXING THE GROUT WITH THE IN SITU SOIL SHALL MEET A MINIMUM REQUIRED UNCONFINED COMPRESSIVE STRENGTH OF 150 POUNDS PER SQUARE INCH (PSI) AT 28 DAYS. TESTS WILL BE CONSIDERED PASSING IF THEY ARE AT LEAST 90% OF THE 150 PSI STRENGTH REQUIREMENT PROVIDED THAT NO MORE THAN 10% OF ALL TESTS FALL BELOW THE REQUIREMENT AND THE OVERALL AVERAGE STRENGTH EXCEEDS THE REQUIREMENT. IF THE UNCONFINED COMPRESSIVE STRENGTH RESULTS DO NOT MEET THAT CRITERIA, THE DSM SUBCONTRACTOR SHALL SUBMIT A MITIGATION PLAN FOR REVIEW AND APPROVAL BY THE ENGINEER.

PART 2 – PRODUCTS

2.1 MATERIALS

A. FRESH OR RECLAIMED WATER, FREE OF ANY DELETERIOUS SUBSTANCE THAT COULD ADVERSELY AFFECT THE GROUT PROPERTIES SHALL BE USED.

B. BINDER AGENT USED FOR THE PROJECT SHALL CONSIST OF PORTLAND CEMENT TYPE II/V CONFORMING TO ASTM DESIGNATION C150. THE CEMENT SHALL BE ADEQUATELY PROTECTED FROM MOISTURE AND CONTAMINATION WHILE IN TRANSIT AND STORAGE AT THE JOB SITE. RECLAIMED CEMENT OR CEMENT CONTAINING LUMPS OR DELETERIOUS MATTER SHALL NOT BE USED.

C. THE WATER AND CEMENT SHALL BE PREMIXED TO FORM A GROUT FOR INJECTION AND MIXING WITH THE IN–SITU SOIL. MATERIALS SHALL BE COMBINED IN PREDETERMINED WEIGHED PROPORTIONS WITH ITS QUALITY EVALUATED BY SPECIFIC GRAVITY MONITORED AT LEAST ONCE PER INSTALLATION BY MUD BALANCE.

D. THE DESIGN UNCONFINED COMPRESSIVE STRENGTH OF THE SOIL–CEMENT MATERIAL COMPRISING THE DSM COLUMNS IS 150 PSI AT 28 DAYS.

PART 3 – EXECUTION

3.1 EQUIPMENT

A. A PURPOSE BUILT HOLLOW STEM AND MIXING PADDLE TOOL ATTACHED TO A HIGH TORQUE ROTARY DRILL ON TRACKS SHALL BE USED TO ACCOMPLISH THE DSM. MIXING TOOLS OF 4– AND 6–FOOT–DIAMETER WILL BE IMPLEMENTED FOR THIS PROJECT. MIXING TOOLS SHALL CONSIST OF A MINIMUM OF FOUR (4) MIXING BLADES (4 PAIRS OF MIXING PADDLES).

B. CEMENT WILL BE STORED IN PURPOSE BUILT SILOS.

C. WATER SHALL BE MIXED WITH CEMENT IN A PURPOSE–BUILT WEIGH–BATCH MIXER TO PRODUCE SLURRY WITH A CONSISTENT SPECIFIC GRAVITY OR WATER:CEMENT RATIO FOR PROPER MIXING. JET VALVE MIXING OR OTHER CONTINUOUS MIXING METHODS WILL NOT BE ALLOWED.

D. GROUT SHALL BE DELIVERED TO THE MIXING RIG BY APPROPRIATELY SIZED POSITIVE DISPLACEMENT PUMPS. PROGRESSIVE CAVITY PUMPS SHALL NOT BE ALLOWED.

3.2 TEST SECTION

A. LOCATIONS: PRIOR TO INITIATING PRODUCTION WORK, DSM SUBCONTRACTOR SHALL INSTALL A MINIMUM OF TWO DSM COLUMNS WITH VARYING MIX DESIGN DOSAGE AT EACH OF THE SIX TEST SECTION LOCATIONS INDICATED ON THE PLANS.

B. EVALUATION GOALS: THE PURPOSE OF THE TEST SECTION IS TO EVALUATE THE FOLLOWING ITEMS PRIOR TO INITIATING PRODUCTION WORK. THE DSM SUBCONTRACTOR MAY PROCEED IMMEDIATELY TO PRODUCTION WHILE TEST SECTION EVALUATION RESULTS ARE PENDING BUT DOES SO AT ITS OWN RISK.

I. COLUMN DEPTH: COLUMN INSTALLATION DEPTHS FOR THE PROJECT ARE CONTROLLED BY THE DEPTH TO THE CAPISTRANO FORMATION CONTACT AS DESCRIBED IN SECTION 3.3.G. DURING TEST SECTION INSTALLATION ADJACENT TO EXISTING EXPLORATION DATA, DSM SUBCONTRACTOR SHALL MONITOR AND RECORD INDICATORS OF DRILLING EFFORT (E.G. ROTARY TORQUE APPLIED AND CROWD PRESSURE). DSM SUBCONTRACTOR SHALL PROPOSE A READILY IDENTIFIABLE METRIC SUBJECT TO THE ENGINEER'S APPROVAL FOR THE DRILL OPERATOR TO OBSERVE DURING INSTALLATION AS EVIDENCE OF ENCOUNTERING THE CAPISTRANO FORMATION.

II. MIX CONSISTENCY: DURING TEST SECTION MIXING THE DSM SUBCONTRACTOR AND ENGINEER SHALL OBSERVE

III. STRENGTH: A MINIMUM OF TWO WET–GRAB SAMPLES SHALL BE COLLECTED FROM EACH TEST SECTION COLUMN INSTALLED AT DEPTHS OF 1/3 AND 2/3 THE TOTAL INSTALLATION DEPTH. EACH SAMPLE COLLECTED SHALL BE CAST INTO CYLINDERS FOR UNCONFINED COMPRESSION STRENGTH TESTING AND EVALUATION AS DESCRIBED IN SECTION 3.4.B.

IV. LOAD TEST: DSM SUBCONTRACTOR SHALL CONDUCT A MINIMUM OF FOUR LOAD TESTS PER THE REQUIREMENTS OF THIS SPECIFICATION TO ASSESS THE 4–FOOT–DIAMETER DSM COLUMN GEOTECHNICAL CAPACITY ADJACENT TO EXPLORATORY TEST DATA. SEE PROPOSED LOAD TEST LOCATIONS ON SHEET GI–3.

3.3 CONSTRUCTION

A. INSTALL DSM COLUMNS AT THE LOCATIONS AND TO THE DEPTH INDICATED ON THE DSM PLAN.

B. HORIZONTAL ALIGNMENT: THE DSM COLUMNS SHALL BE CAREFULLY SURVEYED AND STAKED OUT PRIOR TO INSTALLATION. THE COLUMNS SHALL BE CONSTRUCTED WITHIN 4 INCHES OF THE LOCATIONS SHOWN ON THE DRAWINGS.

C. VERTICAL ALIGNMENT: VERTICAL ALIGNMENT OF THE AUGER STROKE WILL BE CONTROLLED BY THE EQUIPMENT OPERATOR. THE COLUMN VERTICALITY SHALL HAVE A TOLERANCE OF 1:50 MAXIMUM DEVIATION.

D. MIXING SHAFT SPEED: THE MIXING SHAFT SPEED (RPMS) SHALL BE ADJUSTED TO ACCOMMODATE AN ADEQUATE RATE OF MIXING SHAFT PENETRATION BASED ON THE DEGREE OF DRILLING DIFFICULTY. THE MIXING SHAFT SPEED CAN BE ADJUSTED ACCORDING TO DRILLING DIFFICULTY.

E. BOTTOM MIXING: THE BOTTOM OF THE COLUMNS SHALL BE DOUBLE MIXED BY RAISING THE MIXING SHAFTS FIVE FEET OFF THE BOTTOM AND THEN REINSERTING THEM FOR REMIXING.

F. GROUT TAKE: THE GROUT TAKE (OR INJECTION RATE) PER VERTICAL FOOT OF COLUMN WILL BE ADJUSTED TO THE REQUIREMENTS OF THE DESIGN MIX. APPROPRIATE DELIVERY PUMPS SHALL BE USED TO TRANSFER THE GROUT FROM THE MIX PLANT TO THE DSM RIG. A FLOW MONITORING DEVICE WILL BE INSTALLED IN THE GROUT LINE TO DETECT LINE BLOCKAGE AND ELECTRONICALLY RECORD INJECTION RATES AND VOLUMES VERSUS DEPTH AND TIME FOR QUALITY CONTROL MONITORING.

I. THE RATE OF APPLICATION MAY BE CONTROLLED AND MONITORED BY ADJUSTING THE PUMP OUTPUT TO THE PENETRATION RATE SO THAT A PRESET GROUT TAKE CAN BE ACHIEVED. TYPICALLY, THE APPLICATION RATE CAN BE SUCCESSFULLY CONTROLLED BY EXPERIENCED OPERATORS ONCE THE PATTERN OF OPERATION IS ESTABLISHED.

II. SOME VARIATIONS OF THE GROUT TAKE WILL OCCUR DUE TO FIELD CONDITIONS. HOWEVER, THE OVERALL APPLICATION RATE TO EACH STROKE CAN BE MONITORED, CALCULATED AND CONTROLLED. ADDITIONAL MIXING IS TO BE USED WHEN NECESSARY TO DISTRIBUTE THE GROUT THROUGH THE ENTIRE COLUMN. THE INJECTION OF GROUT TO EACH STROKE WILL BE MONITORED, CHECKED BY CALCULATION AND RECORDED.

G. COLUMN DEPTH:

I. BUTTRESS COLUMNS: COLUMNS INSTALLED FOR THE LATERAL SPREAD BUTTRESS SHALL BE INSTALLED TO A MINIMUM OF 4 FEET BEYOND THE CAPISTRANO FORMATION CONTACT AS IDENTIFIED BASED ON THE DRILLING EFFORT CALIBRATION PERFORMED DURING THE TEST SECTION WORK AND SUBJECT TO THE APPROVAL OF THE ENGINEER. PRACTICAL REFUSAL (AS DEFINED IN SECTION 3.3.H) ENCOUNTERED PRIOR TO ACHIEVING THE REQUIRED 4–FOOT EMBEDMENT INTO CAPISTRANO FORMATION MAY BE APPROVED BY THE ENGINEER ON A CASE–BY–CASE BASIS BUT THE DSM SUBCONTRACTOR SHALL BE PREPARED TO INITIATE PREDRILLING IF NEEDED TO ACHIEVE THE REQUIRED EMBEDMENT AT NO ADDITIONAL COST TO THE OWNER.

II. BUILDING SUPPORT COLUMNS: DSM COLUMNS INTENDED FOR SUPPORT OF THE RETAIL BUILDINGS SHALL BE INSTALLED TO A MINIMUM OF 1 FOOT BEYOND THE CAPISTRANO FORMATION CONTACT OR TO PRACTICAL REFUSAL. MEANS OF IDENTIFYING THE CAPISTRANO FORMATION CONTACT WILL BE BASED ON THE DRILLING EFFORT CALIBRATION PERFORMED DURING THE TEST SECTION WORK AND SUBJECT TO THE APPROVAL OF THE ENGINEER.

H. OBSTRUCTION/MIXING SHAFT PRACTICAL REFUSAL: IF OBSTRUCTIONS ARE ENCOUNTERED WHICH REDUCE THE RATE OF PENETRATION TO ONE FOOT PER MINUTE FOR TWO MINUTES UNDER FULL POWER, THE STROKE SHALL BE COMPLETED IN ACCORDANCE WITH THE SPECIFICATIONS AND REMEDIAL MEASURES WILL BE TAKEN. SUBCONTRACTOR SHALL NOTIFY CONTRACTOR TO INVESTIGATE, CONFIRM, AND REMOVE SAID OBSTRUCTIONS FROM THE SOIL MIXING AREA. ONCE CONTRACTOR REMOVES OBSTRUCTIONS AND BACKFILLS AND COMPACTS (IN LIFTS NOT TO EXCEED 3 FEET IN UNCOMPACTED THICKNESS) THE REMOVAL AREA WITH GRANULAR SAND OR SANDY GRAVEL MATERIAL, THE DSM SUBCONTRACTOR SHALL RETURN TO MIXING THE BACKFILLED AREAS AND REMAINING DSM COLUMNS PER PLANS AND SPECS. IF REMOVAL OF OBSTRUCTIONS BY CONTRACTOR DAMAGES A PREVIOUSLY INSTALLED DSM COLUMN, ASSOCIATED RE–INSTALLATION WORK SHALL BE COMPENSATED BY AS EXTRA AT THE CONTRACT UNIT PRICES. IF IT IS INFEASIBLE OR IMPRACTICAL TO CLEAR AN OBSTRUCTION FROM A DESIGN INSTALLATION LOCATION, CONTRACTOR MAY PROPOSE A MODIFICATION TO THE DESIGN PROVIDED THE ORIGINAL PERFORMANCE IS MAINTAINED SUBJECT TO THE REVIEW AND APPROVAL OF THE ENGINEER.

I. MIXING ENERGY: THE DSM SUBCONTRACTOR SHALL MIX EACH COLUMN WITH SUFFICIENT MIXING ENERGY THROUGHOUT TO PROPERLY PROCESS THE SOIL CEMENT PRODUCT. THE MIXING ENERGY SHALL BE DEMONSTRATED BY MEASURED AND RECORDED BRN REPORTED FOR EACH INSTALLATION AND THE MIXING ENERGY APPLIED SHALL MINIMALLY ACHIEVE THAT REQUIRED TO PRODUCE SATISFACTORY RESULTS DURING THE TEST SECTION.

J. NO EXCAVATION OR HEAVY GRADING BY CONTRACTOR SHALL PROCEED PRIOR TO 3 DAYS AFTER DSM COLUMN CONSTRUCTION UNLESS APPROVED BY THE DSM DESIGN ENGINEER.

K. UTILITY TRENCH: EXCAVATE THE COMPLETED DSM COLUMNS AS NECESSARY FOR UNDERGROUND UTILITIES. TRENCH BACKFILL WILL BE AS FOLLOW:

I. FOR TRENCHES CUT INTO BUTTRESS DSM AND ABOVE GWT: BACKFILL WILL NATIVE SOILS OR AS APPROVED BY THE ENGINEER.

II. FOR TRENCHES CUT INTO BUTTRESS DSM AND EXTEND BELOW GWT: BACKFILL WITH CEMENT SLURRY WITH COMPRESSIVE STRENGTH OF AT LEAST 300 PSI.

III. UTILITIES TRENCHES WILL AVOID CUTTING INTO THE DISCRETE 4' DIAMETER DSM COLUMNS SUPPORTING BUILDINGS AND SLABS.

L. MANAGEMENT OF SPOIL TO BE COORDINATED BETWEEN CONTRACTOR AND DSM SUBCONTRACTOR.

3.4 QUALITY CONTROL AND QUALITY ASSURANCE

A. PRIOR TO CONSTRUCTION, A PRELIMINARY MIX DESIGN SHALL BE GENERATED BY THE SUBCONTRACTOR. THE MIX DESIGN MAY BE OBTAINED BASED ON SITE SOILS AND LABORATORY TESTING, OR ALTERNATIVELY, BASED ON THE SUBCONTRACTORS DATABASE IN SIMILAR SOIL CONDITIONS AND STRENGTH REQUIREMENTS.

B. WET SAMPLING: THE DSM SUBCONTRACTOR SHALL OBTAIN WET BULK SAMPLES OF THE SOIL CEMENT MIX AND CAST IT IN CYLINDERS FOR SUBSEQUENT QUALITY CONTROL TESTING BY THE DSM SUBCONTRACTOR, AND QUALITY ASSURANCE TESTING AND ACCEPTANCE BY THE ENGINEER.

I. ONE SAMPLE WILL BE RETRIEVED PER WORK DAY PER RIG.

II. THE VOLUME OF SAMPLE RECOVERED DURING EACH SAMPLING SHALL BE SUFFICIENT TO CAST 6 SAMPLE CYLINDERS EACH MEASURING 3" DIAMETER BY 6" HIGH. A ½" SIEVE WILL BE USED TO SCREEN THE MATERIAL IN ORDER TO FACILITATE APPROPRIATE SCALING OF INCLUSIONS AND PROPER MODELING OF THE 3 INCH CYLINDERS.

III. OF THE 6 CYLINDERS CAST, 3 WILL BE PROVIDED TO THE ENGINEER FOR QUALITY ASSURANCE TESTING AND 3 WILL BE RETAINED BY THE DSM SUBCONTRACTOR FOR QUALITY CONTROL TESTING.

IV. TO AVOID DISTURBANCE, THE CYLINDERS ARE TO BE CURED ON SITE IN A COOLER WITH A SMALL AMOUNT OF WATER TO MAINTAIN A STABLE, COOL AND MOIST CURING ENVIRONMENT FOR 2 DAYS.

V. AFTER QUALITY ASSURANCE SAMPLES ARE RETRIEVED BY THE ENGINEER, ALL WET GRAB SAMPLES SHALL BE STORED IN A MOIST ROOM (NOT SUBMERGED) IN ACCORDANCE WITH ASTM C 192 UNTIL THE TEST DATE.

VI. THE QUALITY CONTROL SAMPLES WILL BE TESTED (BY THE DSM SUBCONTRACTOR) FOR UCS IN ACCORDANCE WITH ASTM D1633, AT 3–DAY, 7–DAY, AND 14–DAY AFTER CASTING. THE RESULTS WILL BE USED TO EXTRAPOLATE THE EXPECTED STRENGTH AT 28–DAYS.

VII. THE QUALITY ASSURANCE SAMPLES WILL BE TESTED (BY THE ENGINEER) FOR UCS IN ACCORDANCE WITH ASTM D1633, AT 7–DAY, 14–DAY, AND 28–DAY AFTER CASTING.

VII. WHEN TIME OR SCHEDULE DOES NOT PERMIT A 28–DAY CURING STRENGTH EVALUATION, THE FOLLOWING UCS AGING CORRELATION WILL BE TENTATIVELY APPLIED TO THIS JOB:

28 : 7 DAY, 1.57

VIII. THE ABOVE CORRELATION MAY BE ADJUSTED FOR SITE–SPECIFIC FINDINGS AS THE PROJECT DEVELOPS.

IX. THE DESIGN STRENGTH FOR THIS PROJECT AT 28–DAYS IS 150 PSI. SUBJECT TO THE APPROVAL OF THE ENGINEER, 7–DAY TEST RESULTS MAY BE ACCEPTED BASED ON THE CORRELATION ABOVE OR A REVISED CURING FACTOR BASED ON PROJECT–SPECIFIC STATISTICAL ANALYSIS OF AVAILABLE DATA.

C. LOAD TEST:

I. DSM SUBCONTRACTOR SHALL PERFORM A MINIMUM OF FOUR COMPRESSION LOAD TEST ON 4–FOOT–DIAMETER COLUMNS AT THE TEST SECTION LOCATION SPECIFIED FOR THE BUILDINGS ON THE DRAWINGS.

II. COMPRESSION LOAD TEST SHALL BE IN GENERAL ACCORDANCE WITH ASTM D1143. THE TEST COLUMN SHALL BE CONDUCTED TO AT LEAST 150% OF THE STATIC DESIGN LOAD.

III. LOAD TEST WILL NOT BE PERFORMED BEFORE THE COLUMN HAS ACHIEVED SUFFICIENT UNCONFINED COMPRESSIVE STRENGTH AS DEMONSTRATED BY LABORATORY TESTING ON WET GRAB SAMPLES.

D. OBSERVATION: A REPRESENTATIVE OF THE ENGINEER SHALL BE PRESENT FULL–TIME DURING ALL INSTALLATION WORK TO OBSERVE THE CONSTRUCTION OF THE DSM COLUMNS, SAMPLING, AND TESTING TO VERIFY THE DSM SUBCONTRACTOR PERFORMS THE WORK IN SUBSTANTIAL CONFORMANCE WITH THESE SPECIFICATIONS. THE ENGINEER SHALL MAINTAIN PARALLEL HAND RECORDS OF PERTINENT INSTALLATION DATA FOR COMPARISON WITH REPORTED INSTALLATION LOGS AND OBTAIN TEST SPECIMENS OF THE WET–SAMPLES COLLECTED FOR QUALITY ASSURANCE TESTING.

E. UPON COMPLETION OF SITE GRADING AND DSM/LTP INSTALLATION, WRITTEN CONFIRMATION FROM THE PROJECT GEOTECHNICAL CONSULTANT OF RECORD WILL BE PROVIDED TO CONFIRM PRELIMINARY RECOMMENDATIONS FOR PROPOSED STRUCTURE(S) ALLOWABLE BEARING VALUE REMAINS VALID. ADDITIONAL RECOMMENDATIONS SHALL BE PROVIDED AS NECESSARY.

END OF SECTION

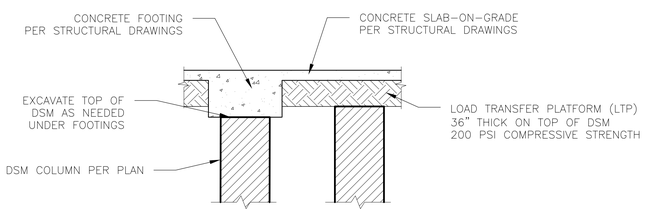

TYPICAL BUILDING SUPPORT DETAIL
SCALE: NTS

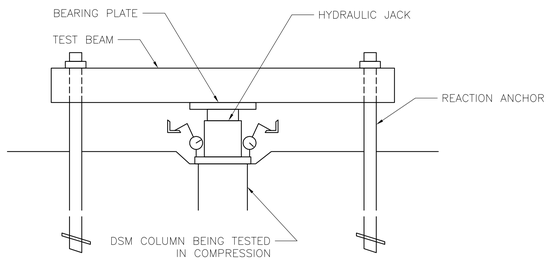

LOAD TEST SETUP
SCALE: NTS

COMPRESSION TEST LOADING SCHEDULE		
DESIGN LOAD =	200	KIPS
PERCENT OF DL	LOAD VALUE	HOLD DURATION
(%)	(KIP)	(MIN)
5%	10	4
10%	20	4
15%	30	4
20%	40	4
25%	50	4
30%	60	4
35%	70	4
40%	80	4
45%	90	4
50%	100	4
55%	110	4
60%	120	4
65%	130	4
70%	140	4
75%	150	4
80%	160	4
85%	170	4
90%	180	4
95%	190	4
100%	200	4
105%	210	4
110%	220	4
115%	230	4
120%	240	4
125%	250	4
130%	260	4
135%	270	4
140%	280	4
145%	290	4
150%	300	4
125%	250	4
100%	200	4
75%	150	4
50%	100	4
25%	50	4
5%	10	4
0%	0	-

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER
THOMAS TRAN
C 91763
CIVIL
STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

GENERAL NOTES AND DETAILS

PROJECT NO. –
DATE: 08/23/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-2

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-20190304121-02A1-BMEP-02A2BMEP2-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
Use of this plan is conditioned upon the terms of the Building Permit Agreement between the owner or his authorized agent and the County of Orange. By the issuance of this plan, the County assumes no responsibility for the completion of the work in conformance with the approved plans. Any changes or modifications must be approved by the Building Official.
Troy Tomlinson
Building Official

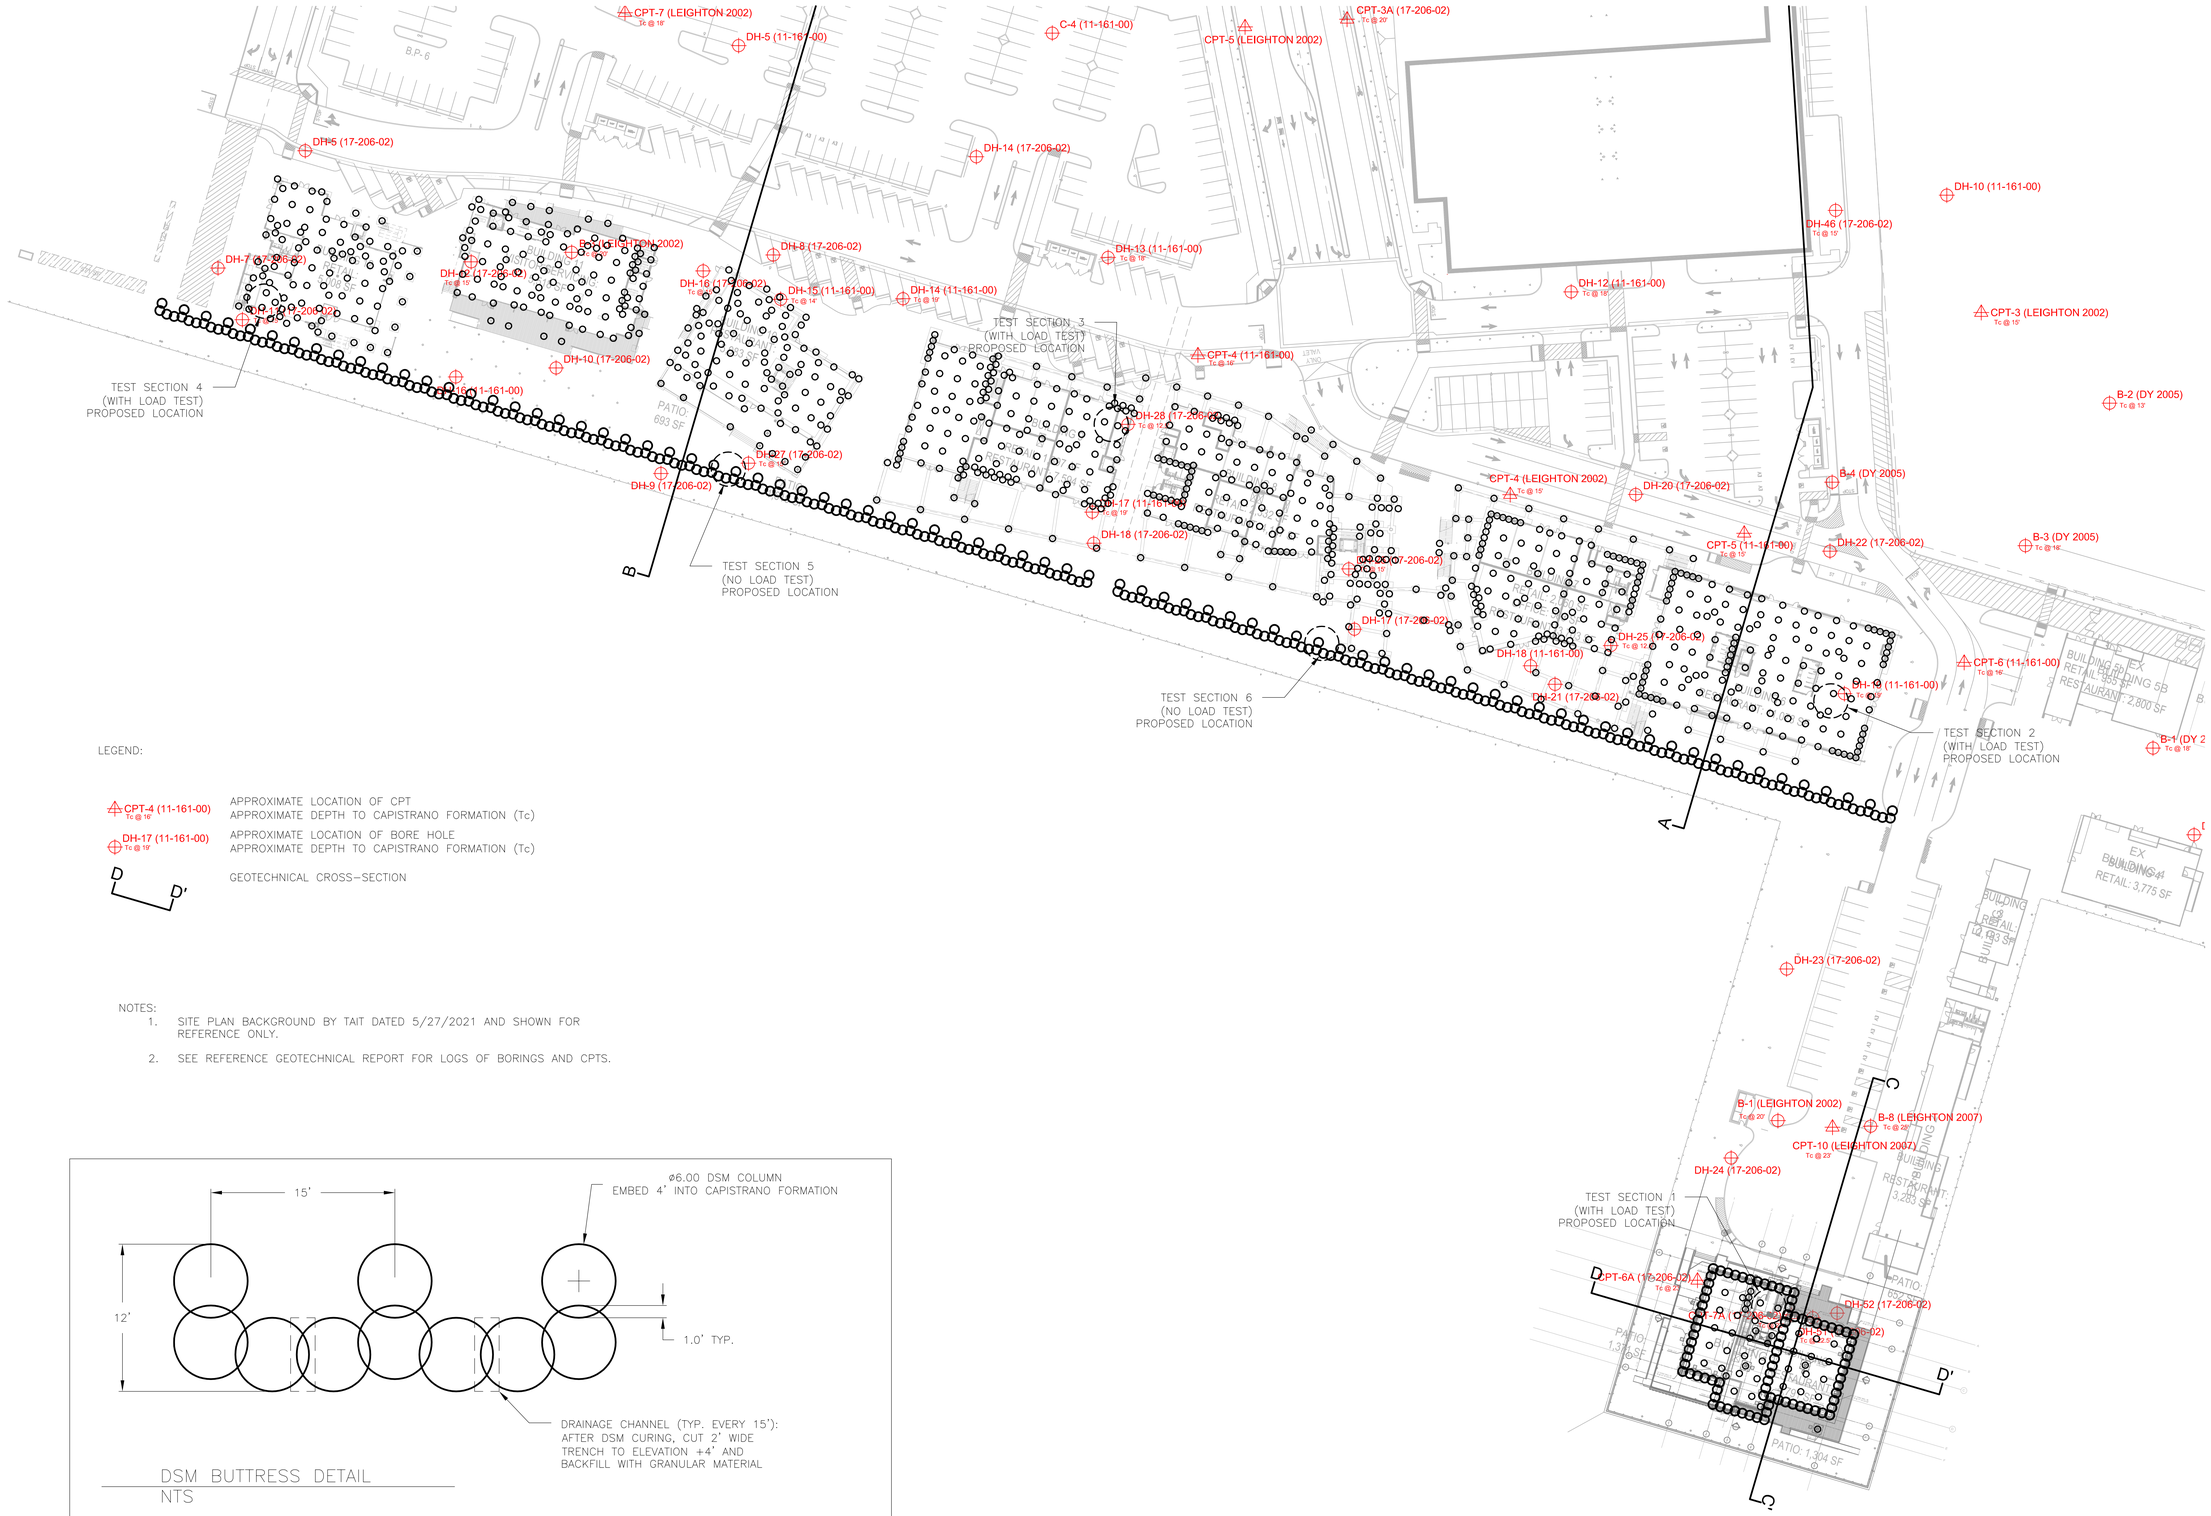

LEGEND:

CPT-4 (11-161-00) Tc @ 16' — APPROXIMATE LOCATION OF CPT
APPROXIMATE DEPTH TO CAPISTRANO FORMATION (Tc)

DH-17 (11-161-00) Tc @ 19' — APPROXIMATE LOCATION OF BORE HOLE
APPROXIMATE DEPTH TO CAPISTRANO FORMATION (Tc)

D D' — GEOTECHNICAL CROSS-SECTION

NOTES:

1. SITE PLAN BACKGROUND BY TAIT DATED 5/27/2021 AND SHOWN FOR REFERENCE ONLY.
2. SEE REFERENCE GEOTECHNICAL REPORT FOR LOGS OF BORINGS AND CPTS.

DSM BUTTRESS DETAIL
NTS

DSM PLAN
SCALE: 1" = 40'

N

0' 40' 80'
SCALE: 1"=40'

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:
GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:
DEEP SOIL MIXING PLAN

PROJECT NO. –
DATE: 08/23/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-3

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-1924B5RR21-02A1BMEP-02A2BMEP21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This plan has been reviewed for conformance with the County of Orange Codes and Ordinances applicable at the time of plan submittal. Approval of this plan does not authorize any violation of those codes and ordinances not specifically indicated on the plan. Approval of this plan shall not be construed to be a permit for, or an approval of, any violation of the County of Orange Codes and Ordinances.
Troy Danielson
1/19/2021 07:12AM

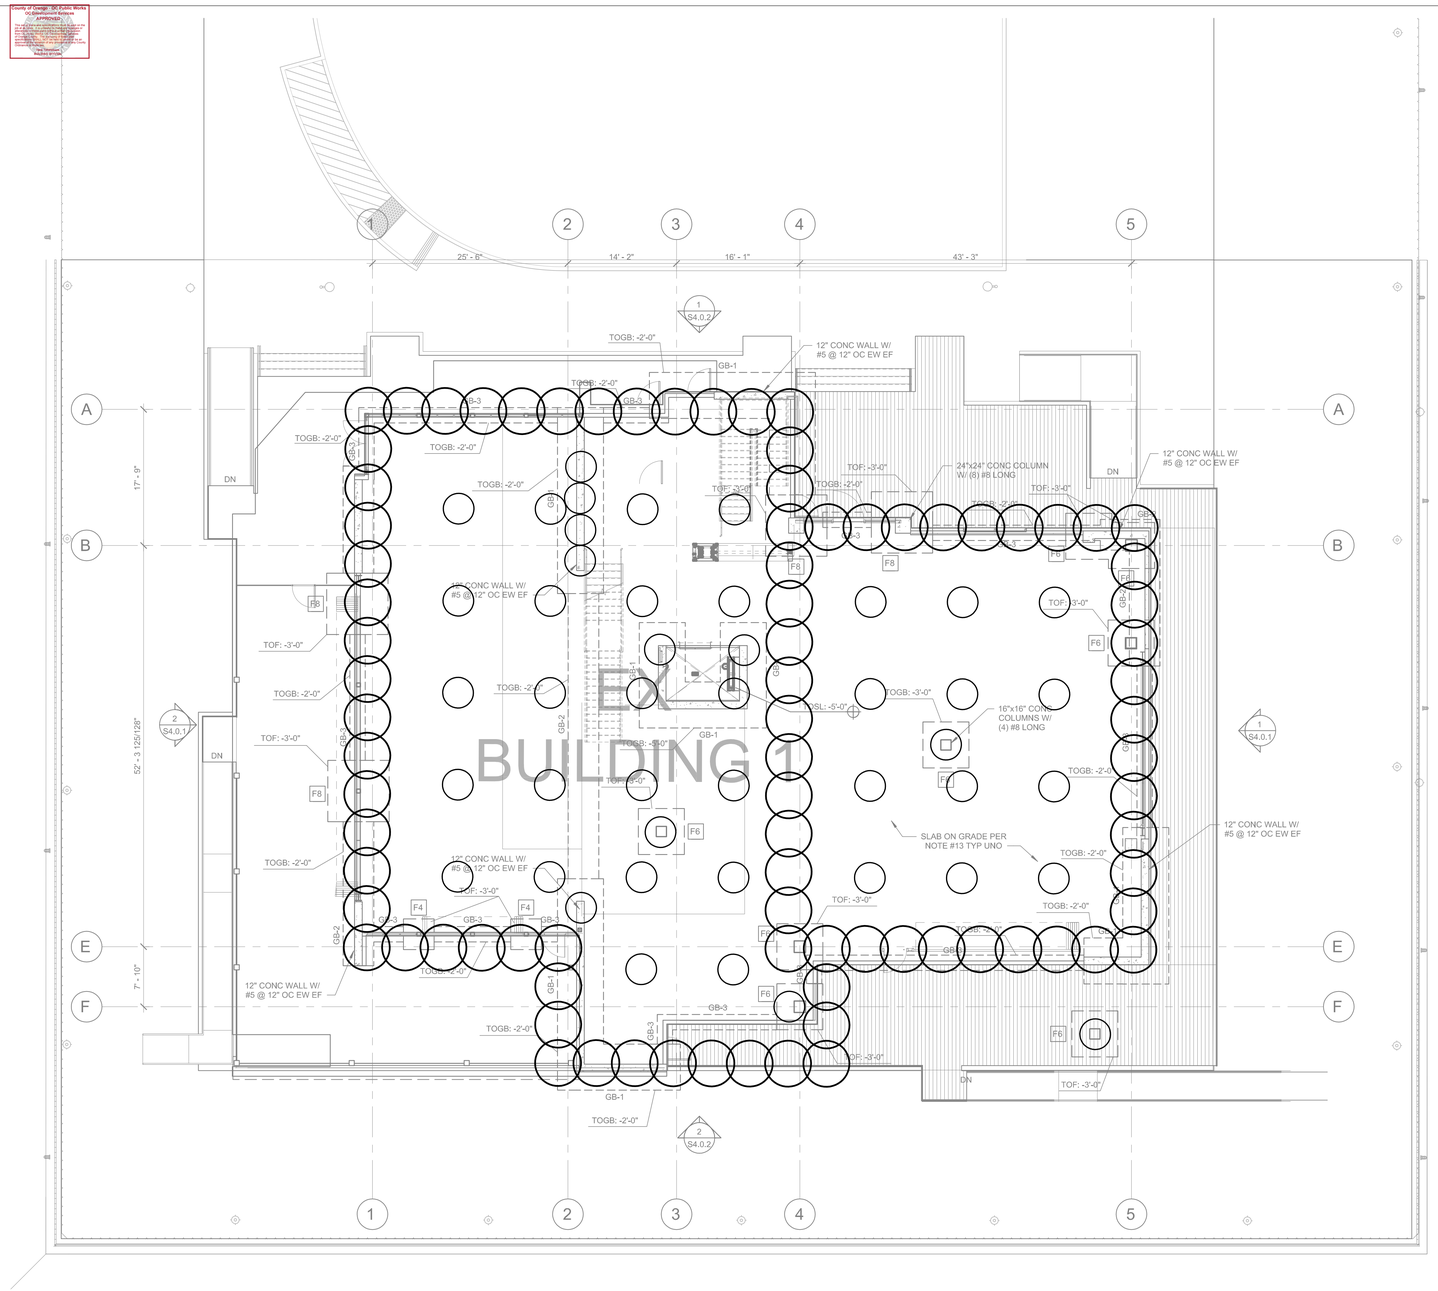

DSM COLUMN LAYOUT – BUILDING 1
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø BEARING ON CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 10/8/2020 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER
THOMAS TRAN
C 91763
CIVIL
STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 1

PROJECT NO.	SHEET NUMBER:
–	GI-4.1
DATE: 08/23/2021	
SCALE: AS SHOWN	

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP: 0140BMEP-02H1BMEP-02H2BMEP-02H3

County of Orange - OC Public Works
OC Development/Environmental Services
APPROVED
Date: 1/19/2020
This approval is valid only for the purpose and the use of the plans and/or documents submitted. Any deviation from approved plans, specifications and documents must be approved in writing by the County of Orange prior to construction. One set of approved plans must be available for use at the work site and retained by the building official. It is the permittee's responsibility to comply with all applicable codes and ordinances.
Ray Tabassian
PUBLIC WORKS

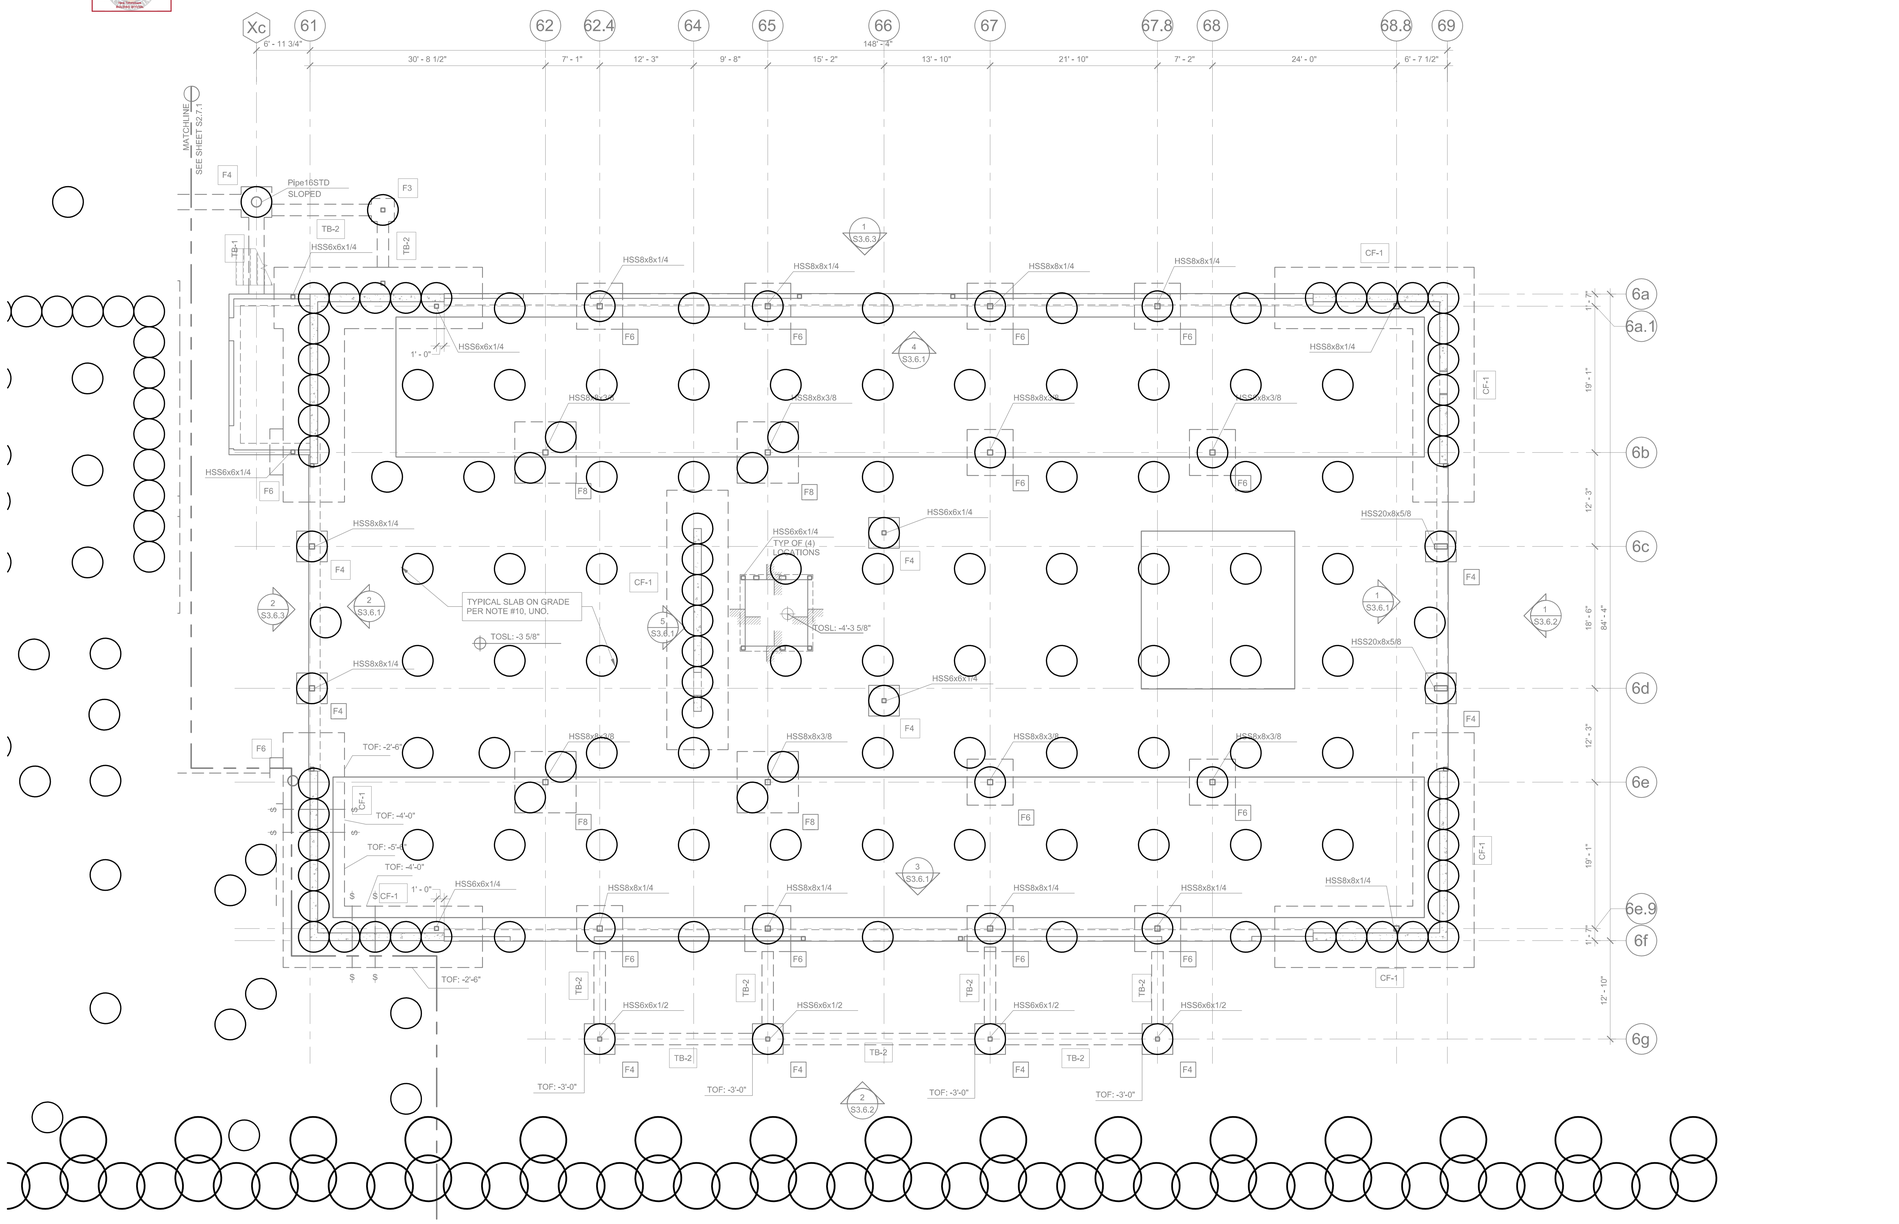

DSM COLUMN LAYOUT – BUILDING 6
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 6

PROJECT NO. –

DATE: 08/23/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.2

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-20190304121-02A1BMEP-02A2BMEP2-0243

County of Orange - OC Public Works
OC Development/Environmental Resources
APPROVED
Date: 1/19/2020
This approval is valid for the specific plans listed above and subject to any conditions imposed on the attached letter dated. It is the responsibility of the permit holder to comply with all applicable codes, laws, regulations, policies, and standards. The permit holder is not relieved of responsibility by obtaining approval given by OC Development/Environmental Resources. Other permits may be required.
Greg Timmerman
PE2012 OC Public Works

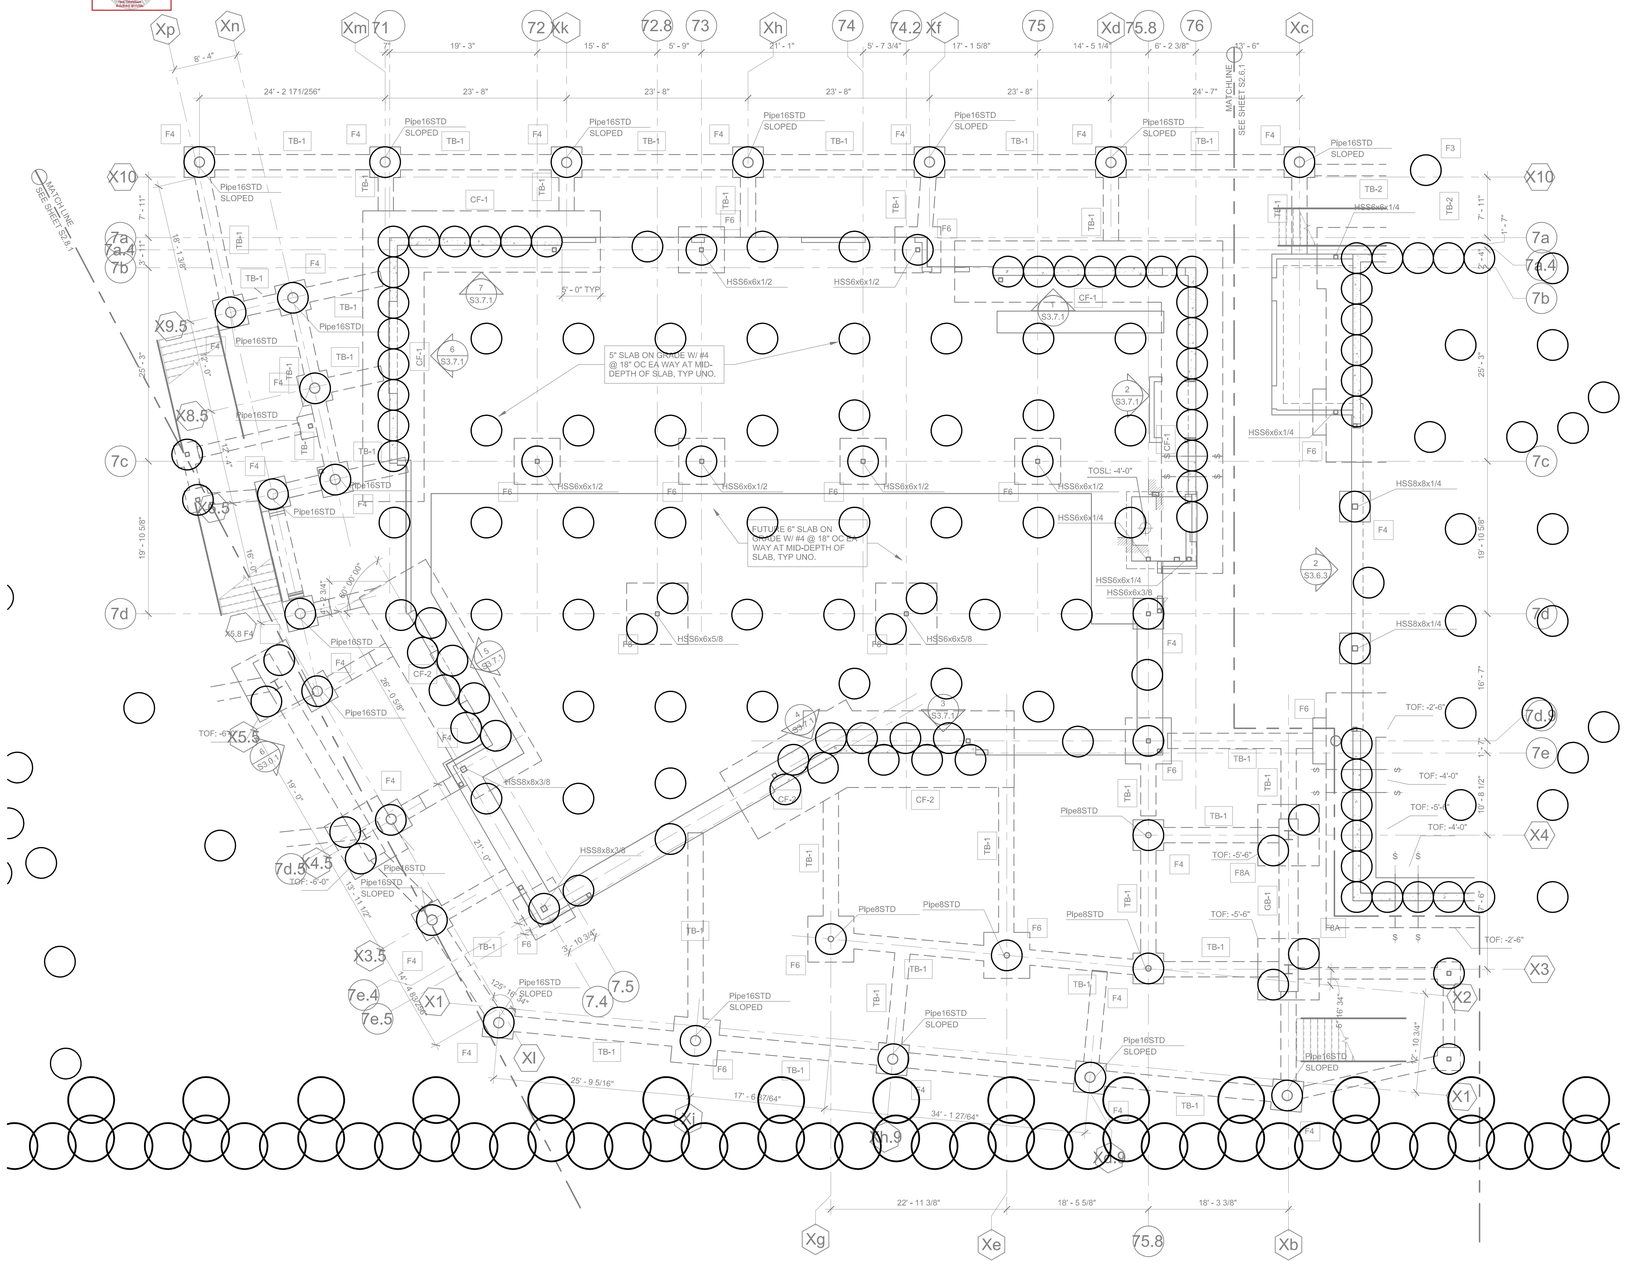

DSM COLUMN LAYOUT – BUILDING 7
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 7

PROJECT NO.	SHEET NUMBER:
–	GI-4.3
DATE: 08/23/2021	
SCALE: AS SHOWN	

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSC-0140BMSC-0241BMSC-0242BMSC-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
This approval is limited to the extent of work shown on the approved plans and does not include any work not specifically shown. All work shall conform to the applicable codes and ordinances of the jurisdiction of construction. Approval of these plans does not authorize violation of any codes or ordinances of the jurisdiction of construction.
By: Ryan Rose
Building Official

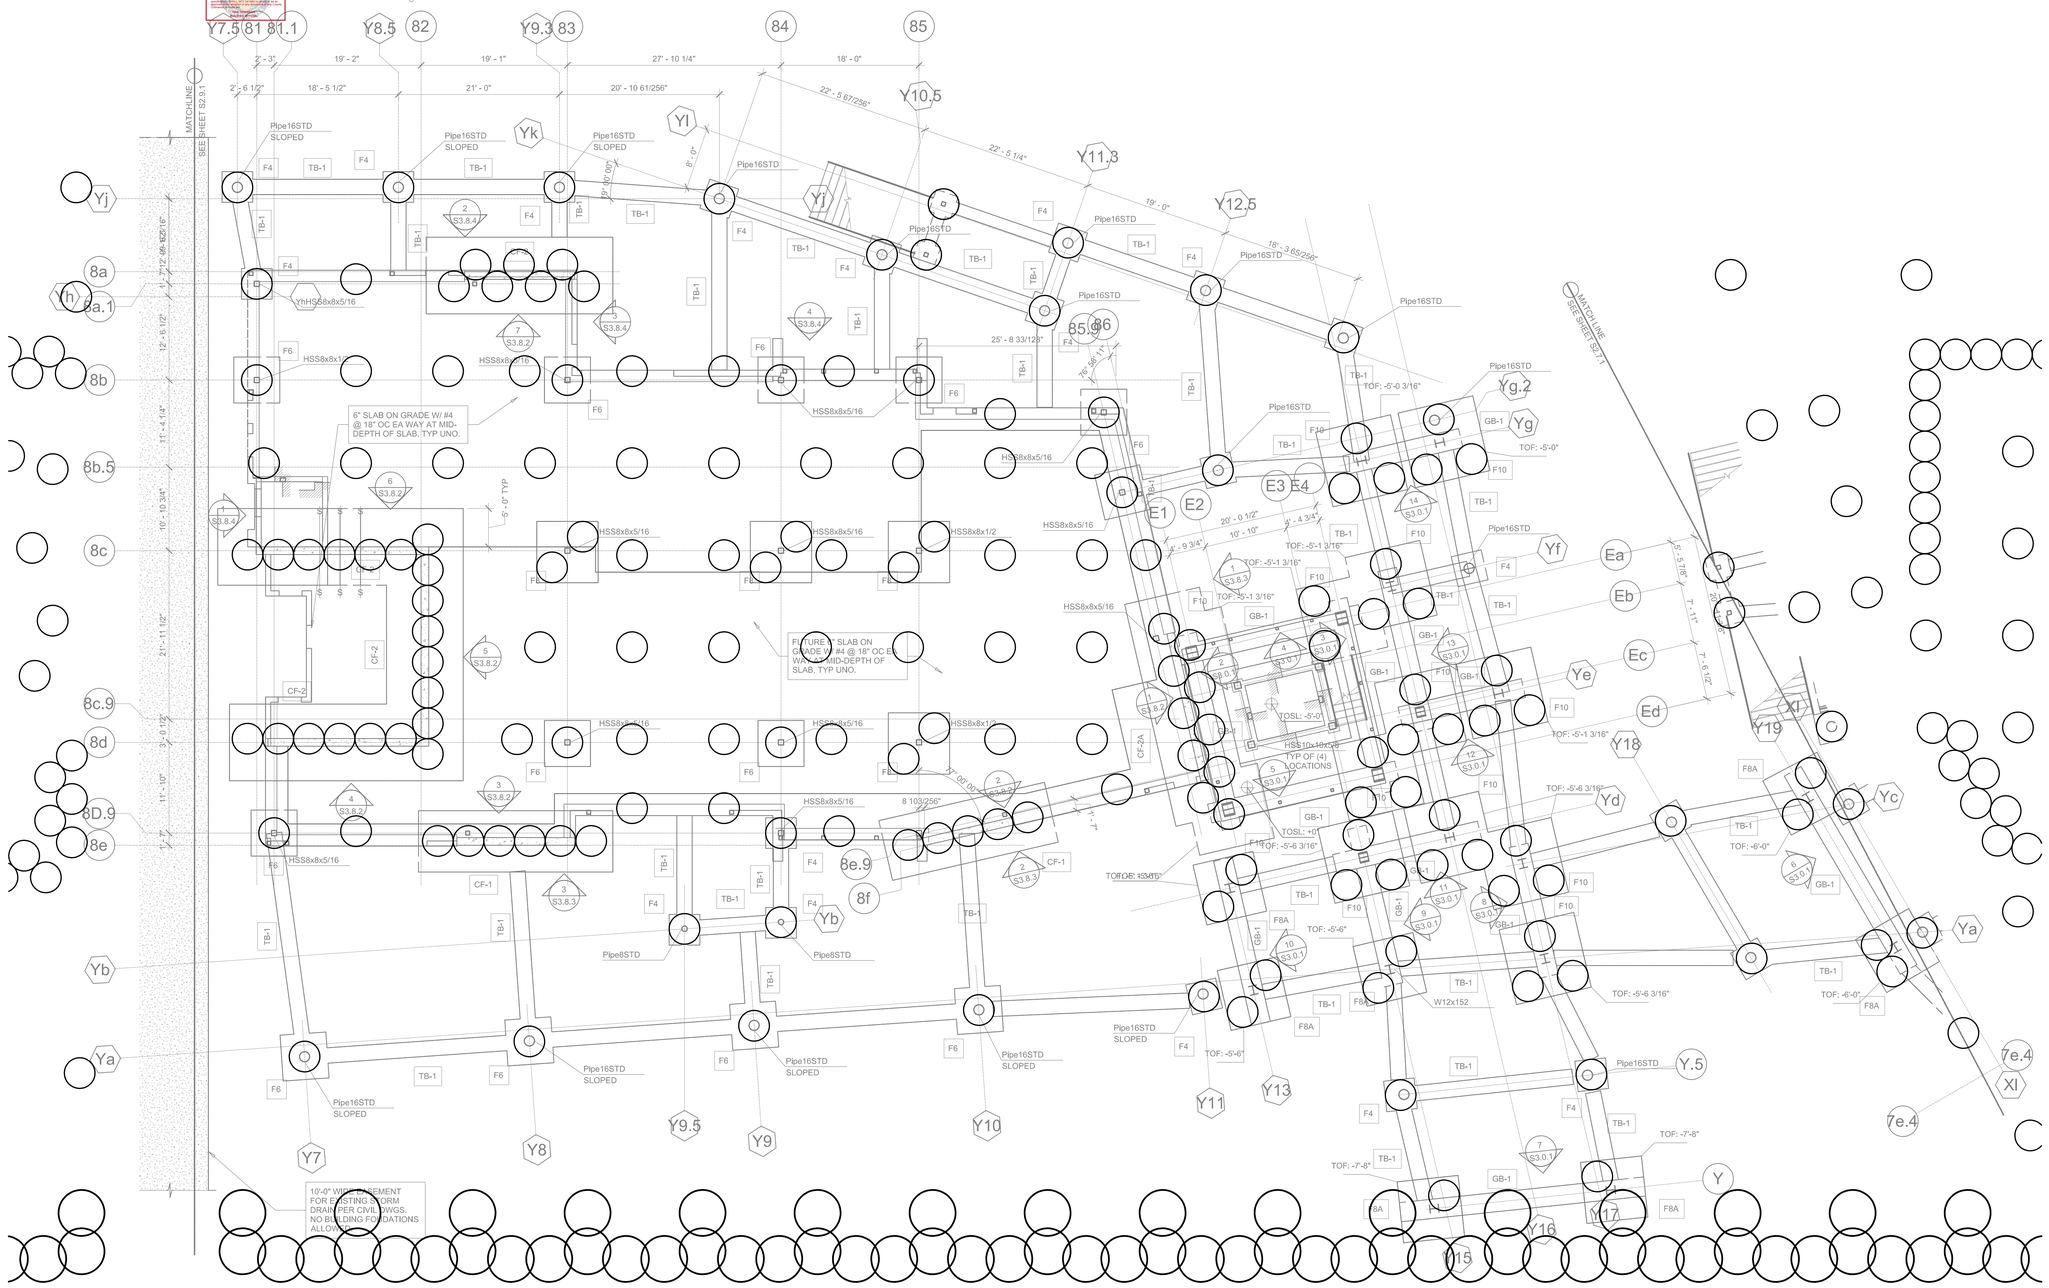

DSM COLUMN LAYOUT – BUILDING 8
SCALE: 1/8" = 1'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:

1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 8

PROJECT NO. –
DATE: 08/23/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-4.4

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/18/2020
Approval: Geotechnical Reports
Permits:
BMEP-1834BMSR21-0241BMEP-0242BMEP21-0243

County of Orange OC Public Works
OC Development Services
APPROVED
Date: 1/18/2020
This approval is valid for 2 years from the date of approval unless otherwise noted or unless the Building Official grants an extension in writing. By the Director of Development Services, the Building Official, or an authorized representative thereof. Approval of an individual item does not imply approval of the entire project.
Reg. Dimension
Related to Case

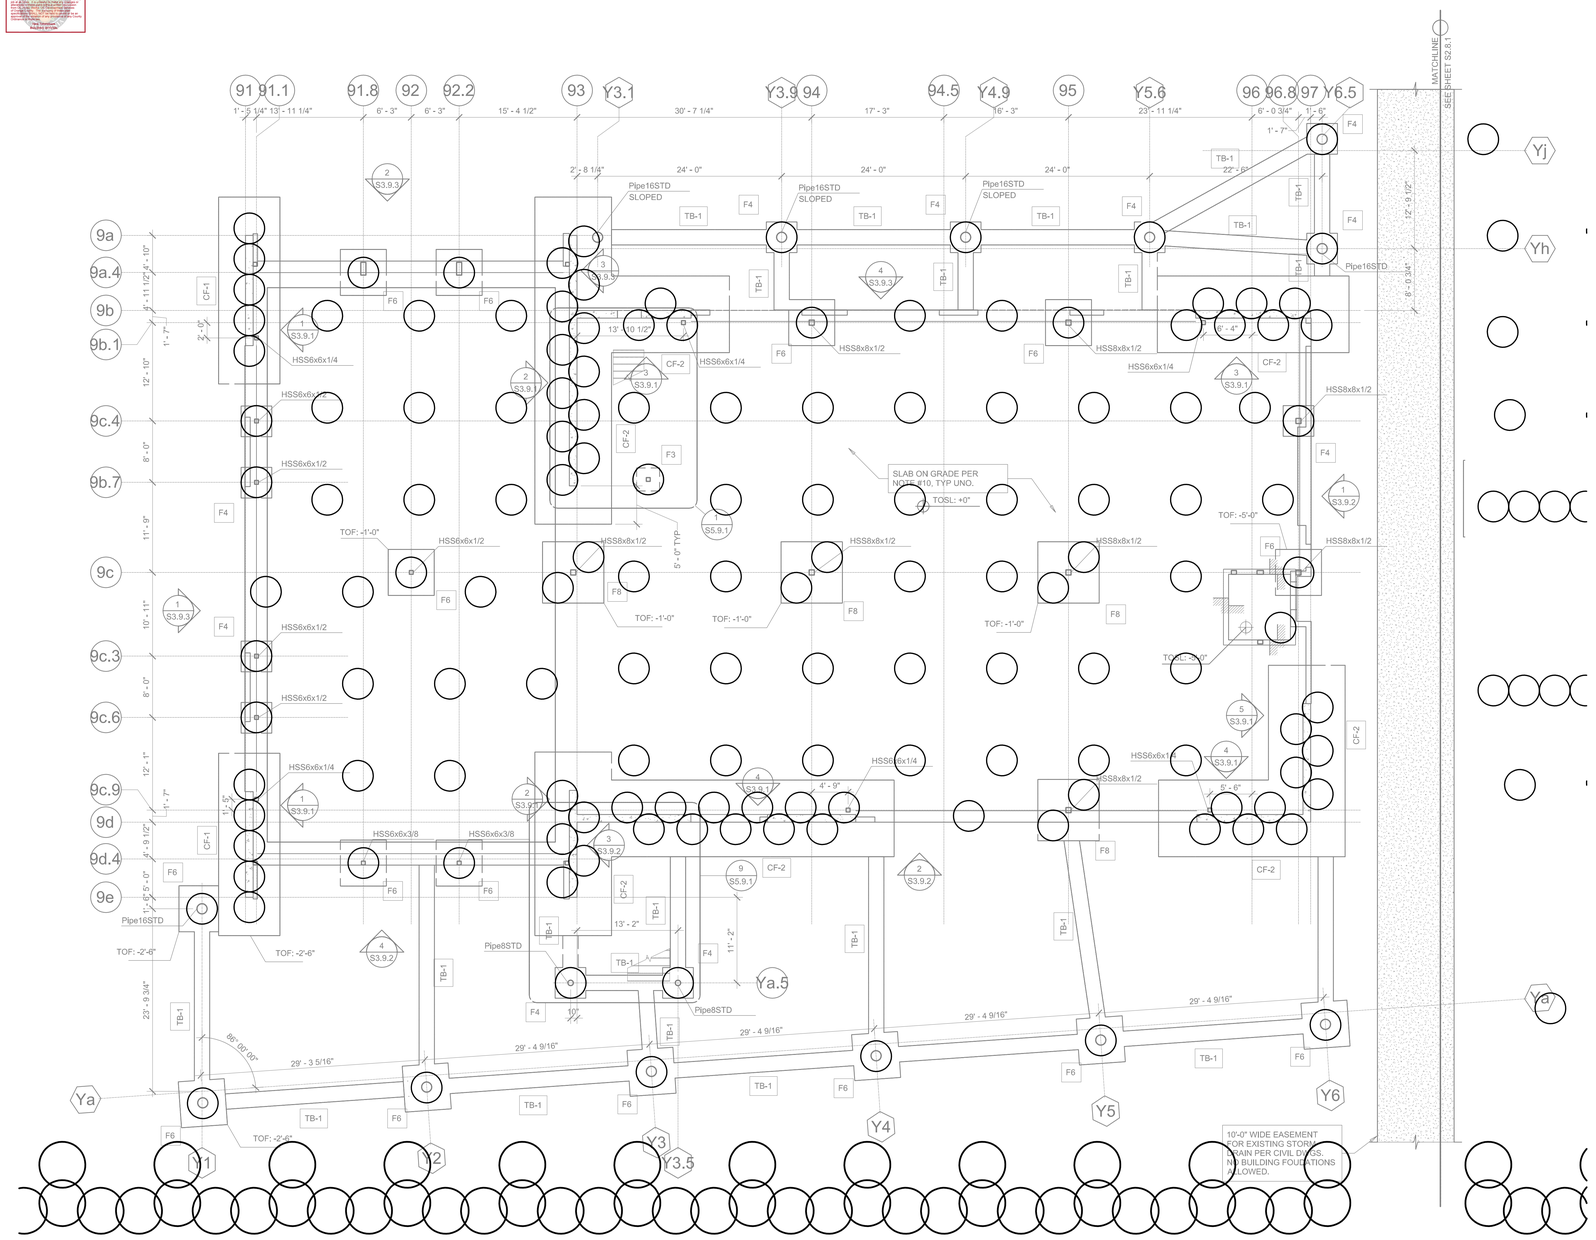

DSM COLUMN LAYOUT – BUILDING 9
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:

1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 9

PROJECT NO. –

DATE: 08/23/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.5

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-1E4B5B4B21-02A1B4B21-02A2B4B21-0243

County of Orange - OC Public Works
OC Development/Environmental
APPROVED
Date: 1/19/2020
This approval is valid for 2 years from the date of approval unless construction is started or a time extension is granted as provided by Sec. 7-9-75 of the Orange County Codified Ordinances. Any changes to the approved plans must be approved by OC Development/Environmental prior to construction of the change.
Troy Tomlinson
PERMIT SYSTEM

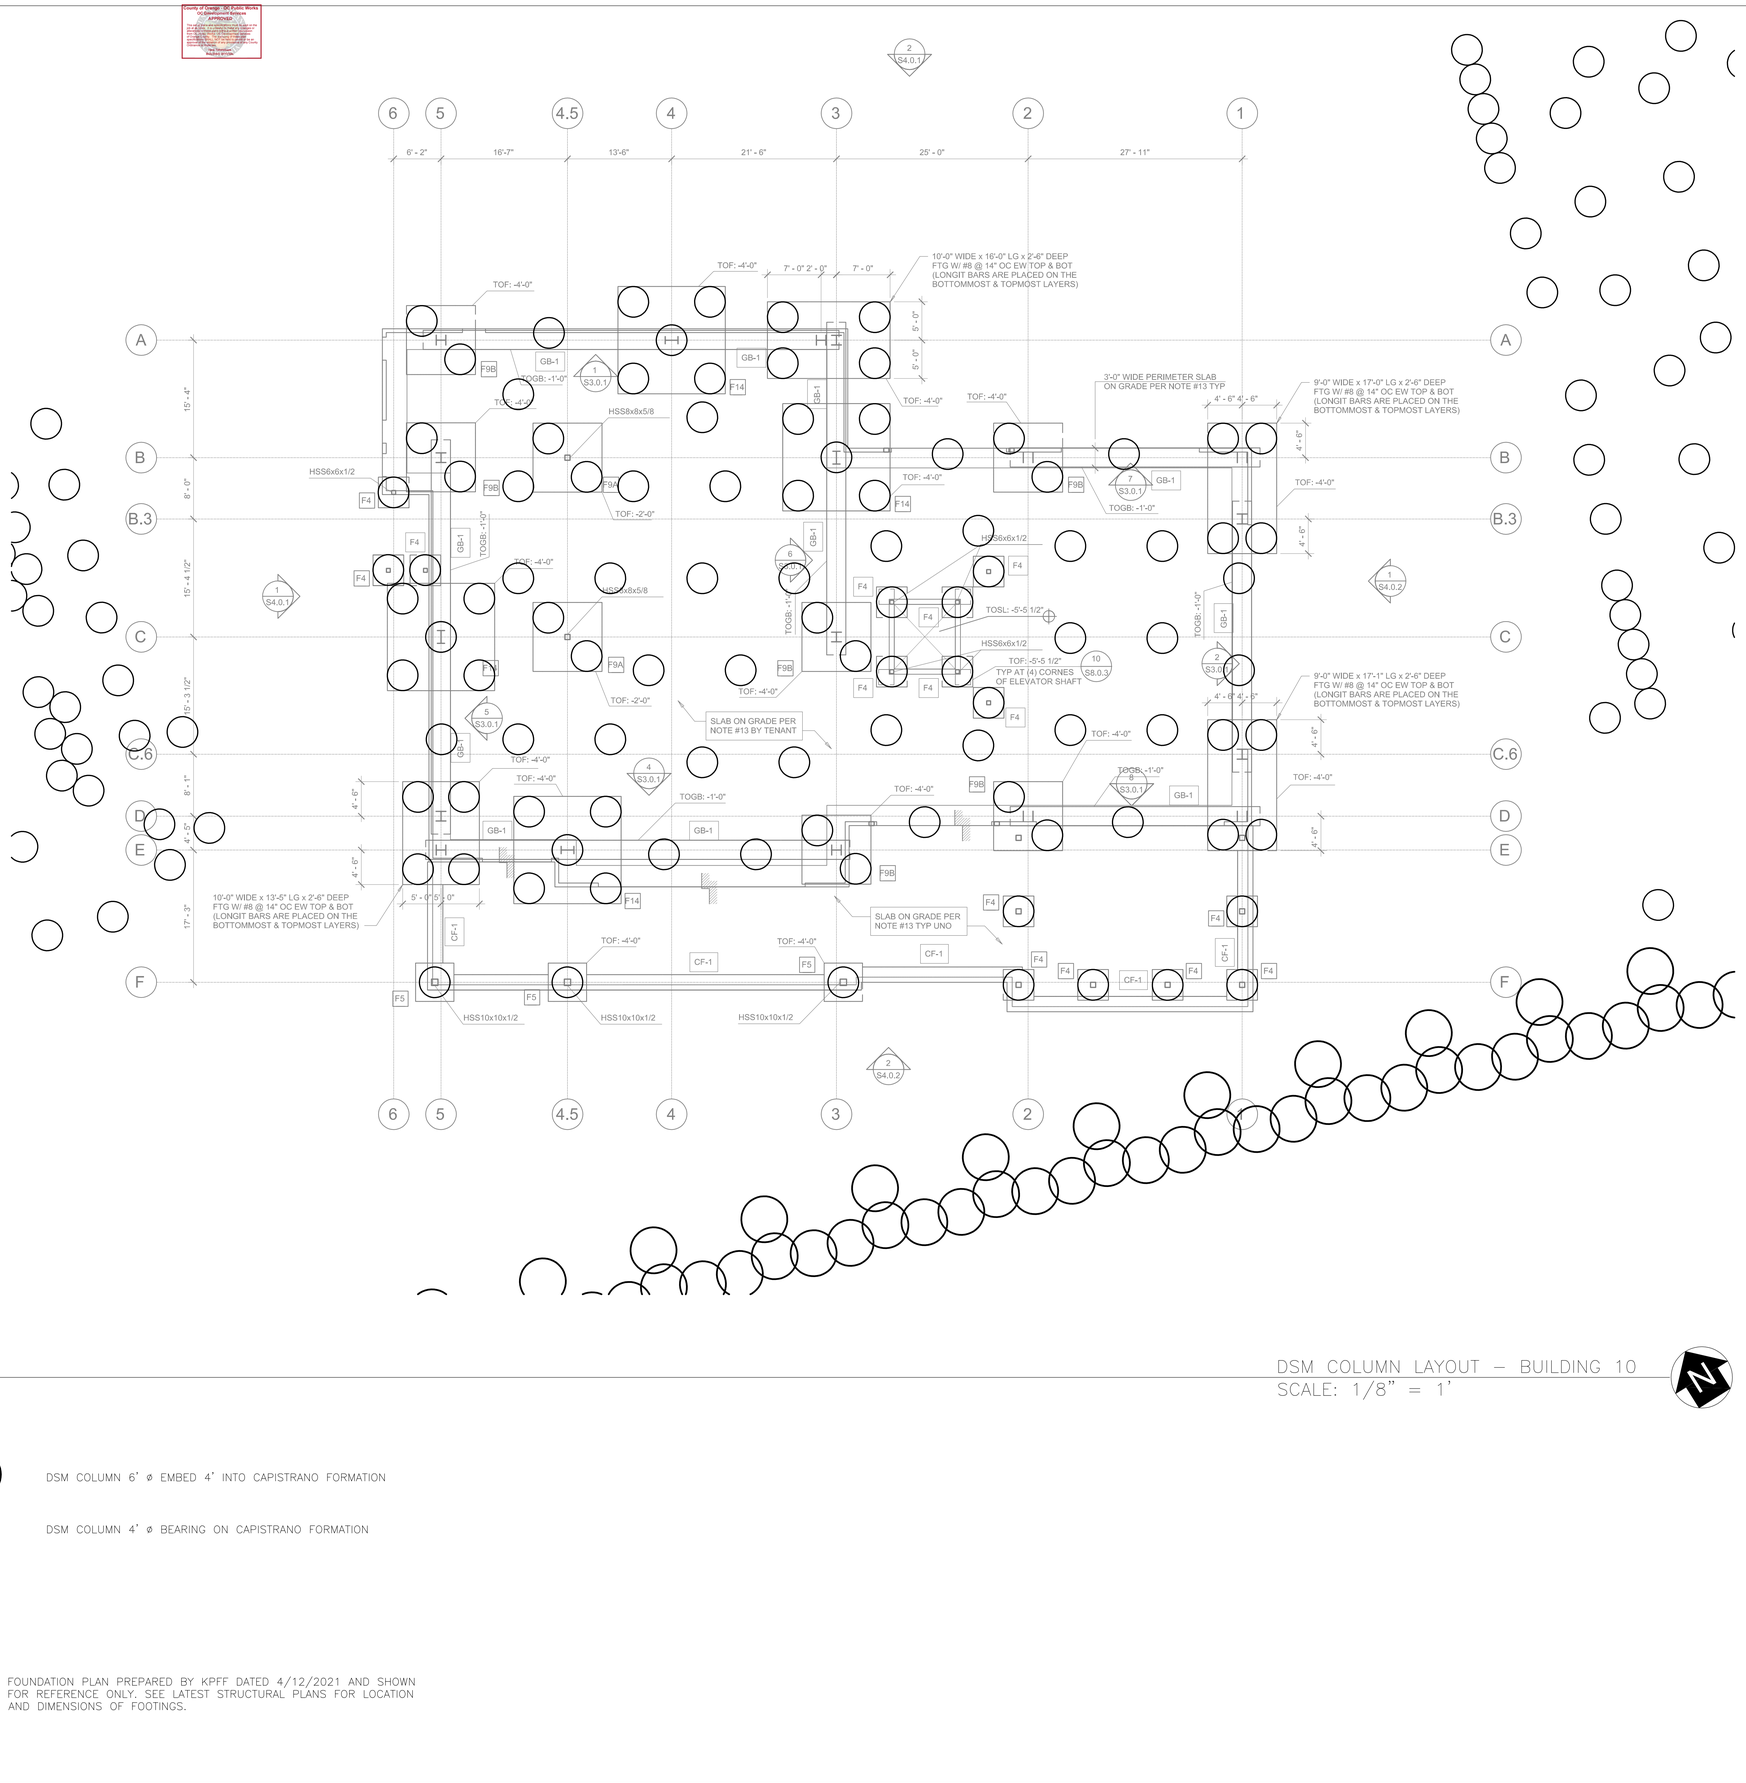

DSM COLUMN LAYOUT – BUILDING 10
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:

1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 10

PROJECT NO. –

DATE: 08/23/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.6

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/18/2020
Approval: Geotechnical Reports
Permits:
BMEP-1E4B9MR21-02H1BMR21-02H2BMR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/18/2020
This approval is valid for 12 months from the date of approval unless otherwise noted. It is the responsibility of the permittee to comply with all laws, County Codes or Ordinances and conditions of approval. Approval of construction does not authorize violation of any law.
Inspection Required
Greg Tomlinson
714.667.0784

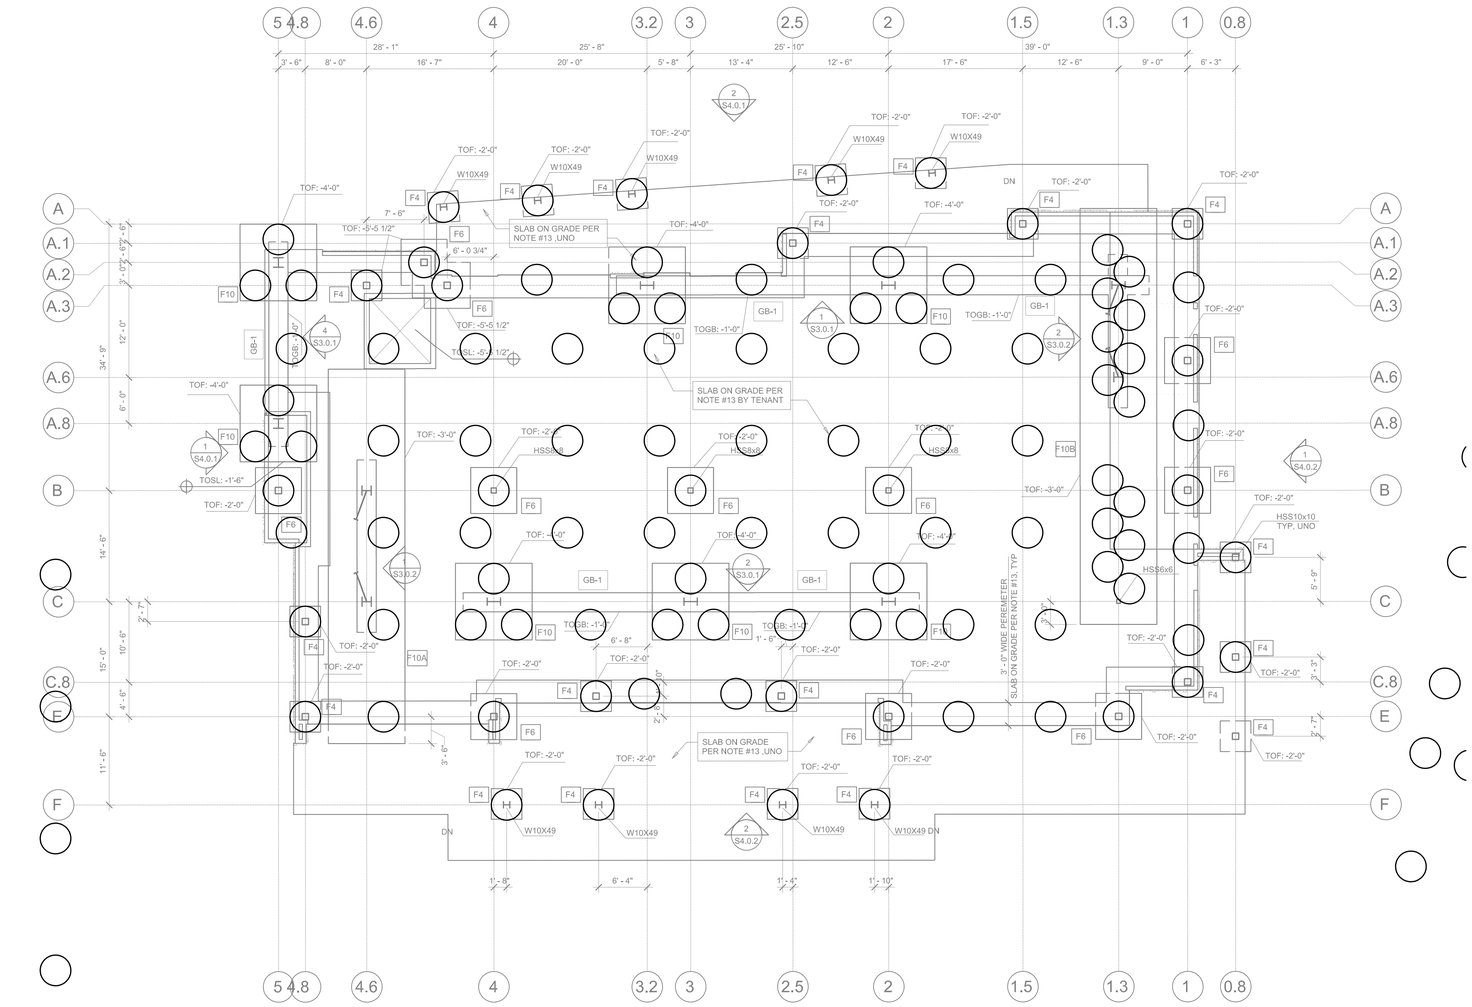

DSM COLUMN LAYOUT – BUILDING 11
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:

1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER
THOMAS TRAN
C 91763
CIVIL
STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 11

PROJECT NO.	SHEET NUMBER:
–	GI-4.7
DATE: 08/23/2021	
SCALE: AS SHOWN	

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building Activity: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMP21-0248BNR21-0241BNR21-0242BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2021
This approval is conditioned upon all conditions and requirements of the Orange County Building Codes, Ordinances, and Regulations being complied with whether specified or not. Approval of any mechanical, electrical, plumbing, structural or grading system or component is limited to that required by the Building Codes. Approval of any system or component is not approval of the overall design of the building.
By: Tomasian
Inspector

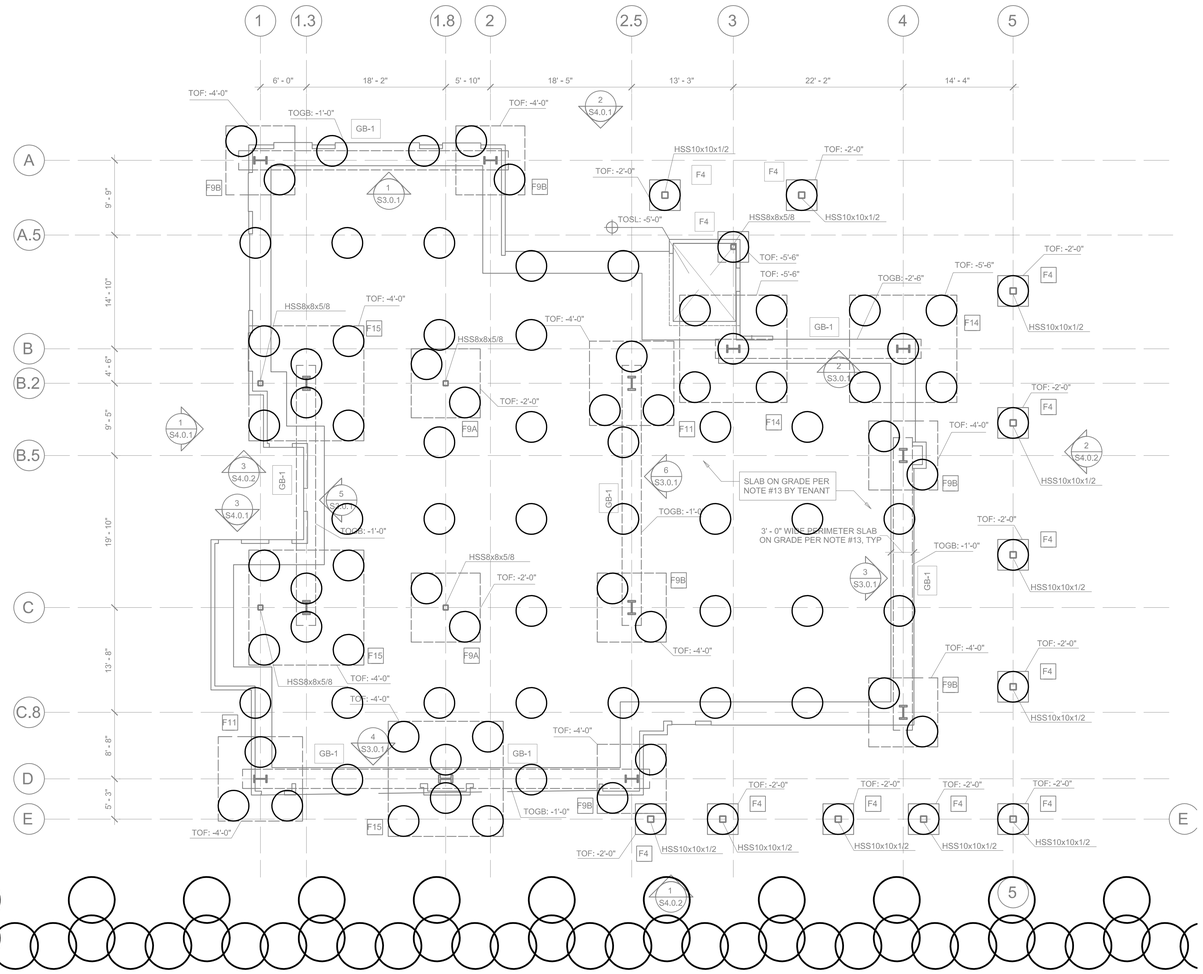

DSM COLUMN LAYOUT – BUILDING 12
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 12

PROJECT NO.	–	SHEET NUMBER:
DATE:	08/23/2021	GI-4.8
SCALE:	AS SHOWN	

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/18/2020
Approval: Geotechnical Reports
Permits:
BWDV-2248039452-02413948521-02422864521-0243

County of Orange OC Public Works
OC Development Services
APPROVED
Date: 1/18/2020
These plans and specifications have been approved for use in the County of Orange unincorporated territory in accordance with the Building Code, Grading Code, Fire Code, or Zoning Ordinance of Orange County. Approval of these plans and specifications does not permit the violation of any section of these codes or ordinances.
Troy Danielson
Inspection Services Manager

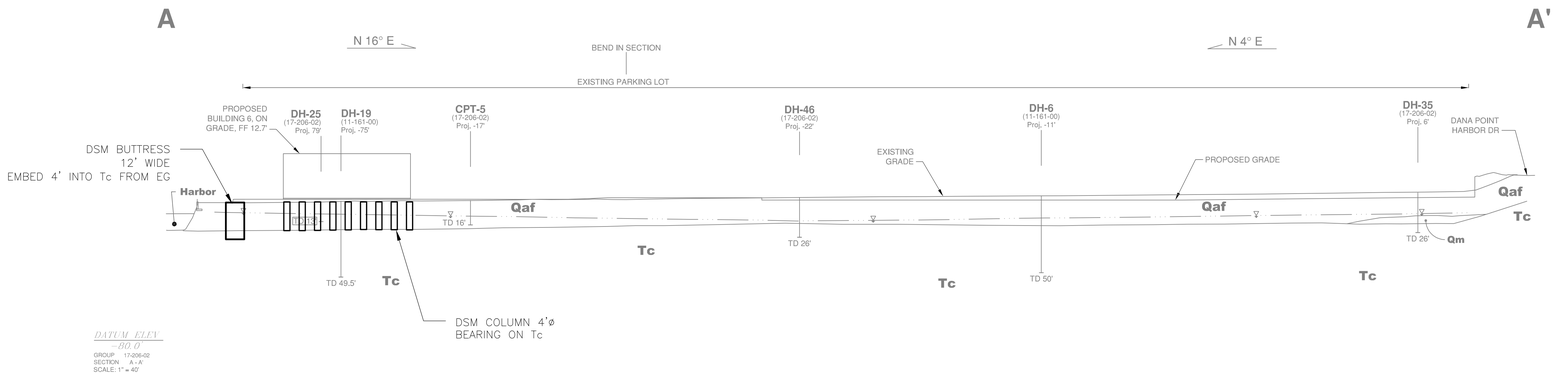

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION A - A'
SCALE: 1" = 40'

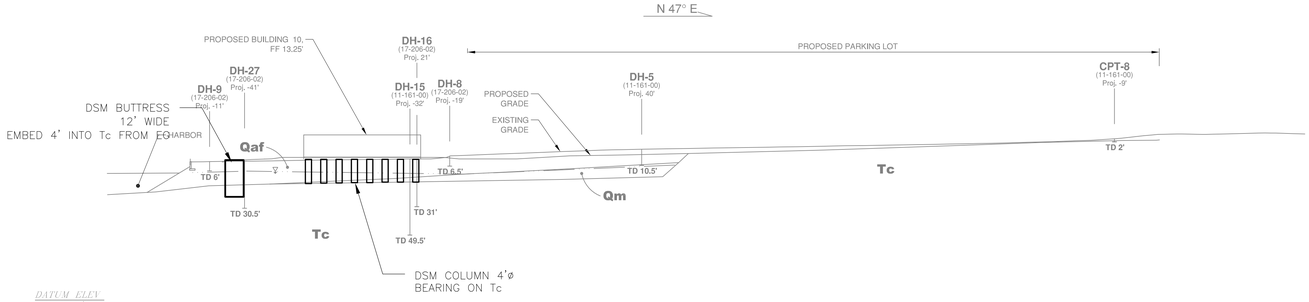

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION B - B'
SCALE: 1" = 40'

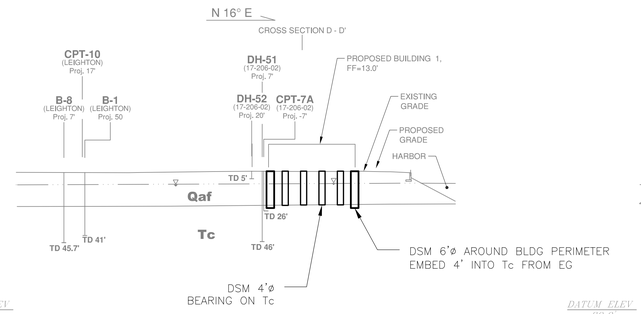

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION C - C'
SCALE: 1" = 40'

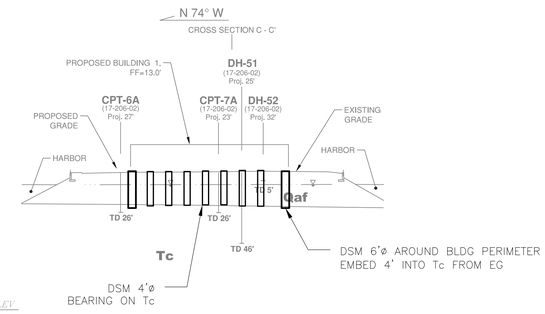

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION D - D'
SCALE: 1" = 40'

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

GEOTECHNICAL
SECTIONS

PROJECT NO. –
DATE: 08/23/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-5

S:\Projects\P714290 Dana Point Harbor Design\Drawings\Main Files\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B1

Pseudostatic Slope Stability Analysis

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

SECTION AA'

1.023

◄ 0.26

Material Name	Color	Unit Weight (lbs/ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Tensile Strength (psf)
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Automatically Calculated	0
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Automatically Calculated	0
Tc		125	Mohr-Coulomb	695	34			Water Surface	Automatically Calculated	
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Automatically Calculated	
Liquefied 1		125	Vertical Stress Ratio			0.17	0	Water Surface	Automatically Calculated	0
Liquefied 2		125	Vertical Stress Ratio			0.1	0	Water Surface	Automatically Calculated	0
Liquefied 3		125	Vertical Stress Ratio			0.5	0	Water Surface	Automatically Calculated	0
DSM		125	Mohr-Coulomb	7200	0			Water Surface	Automatically Calculated	

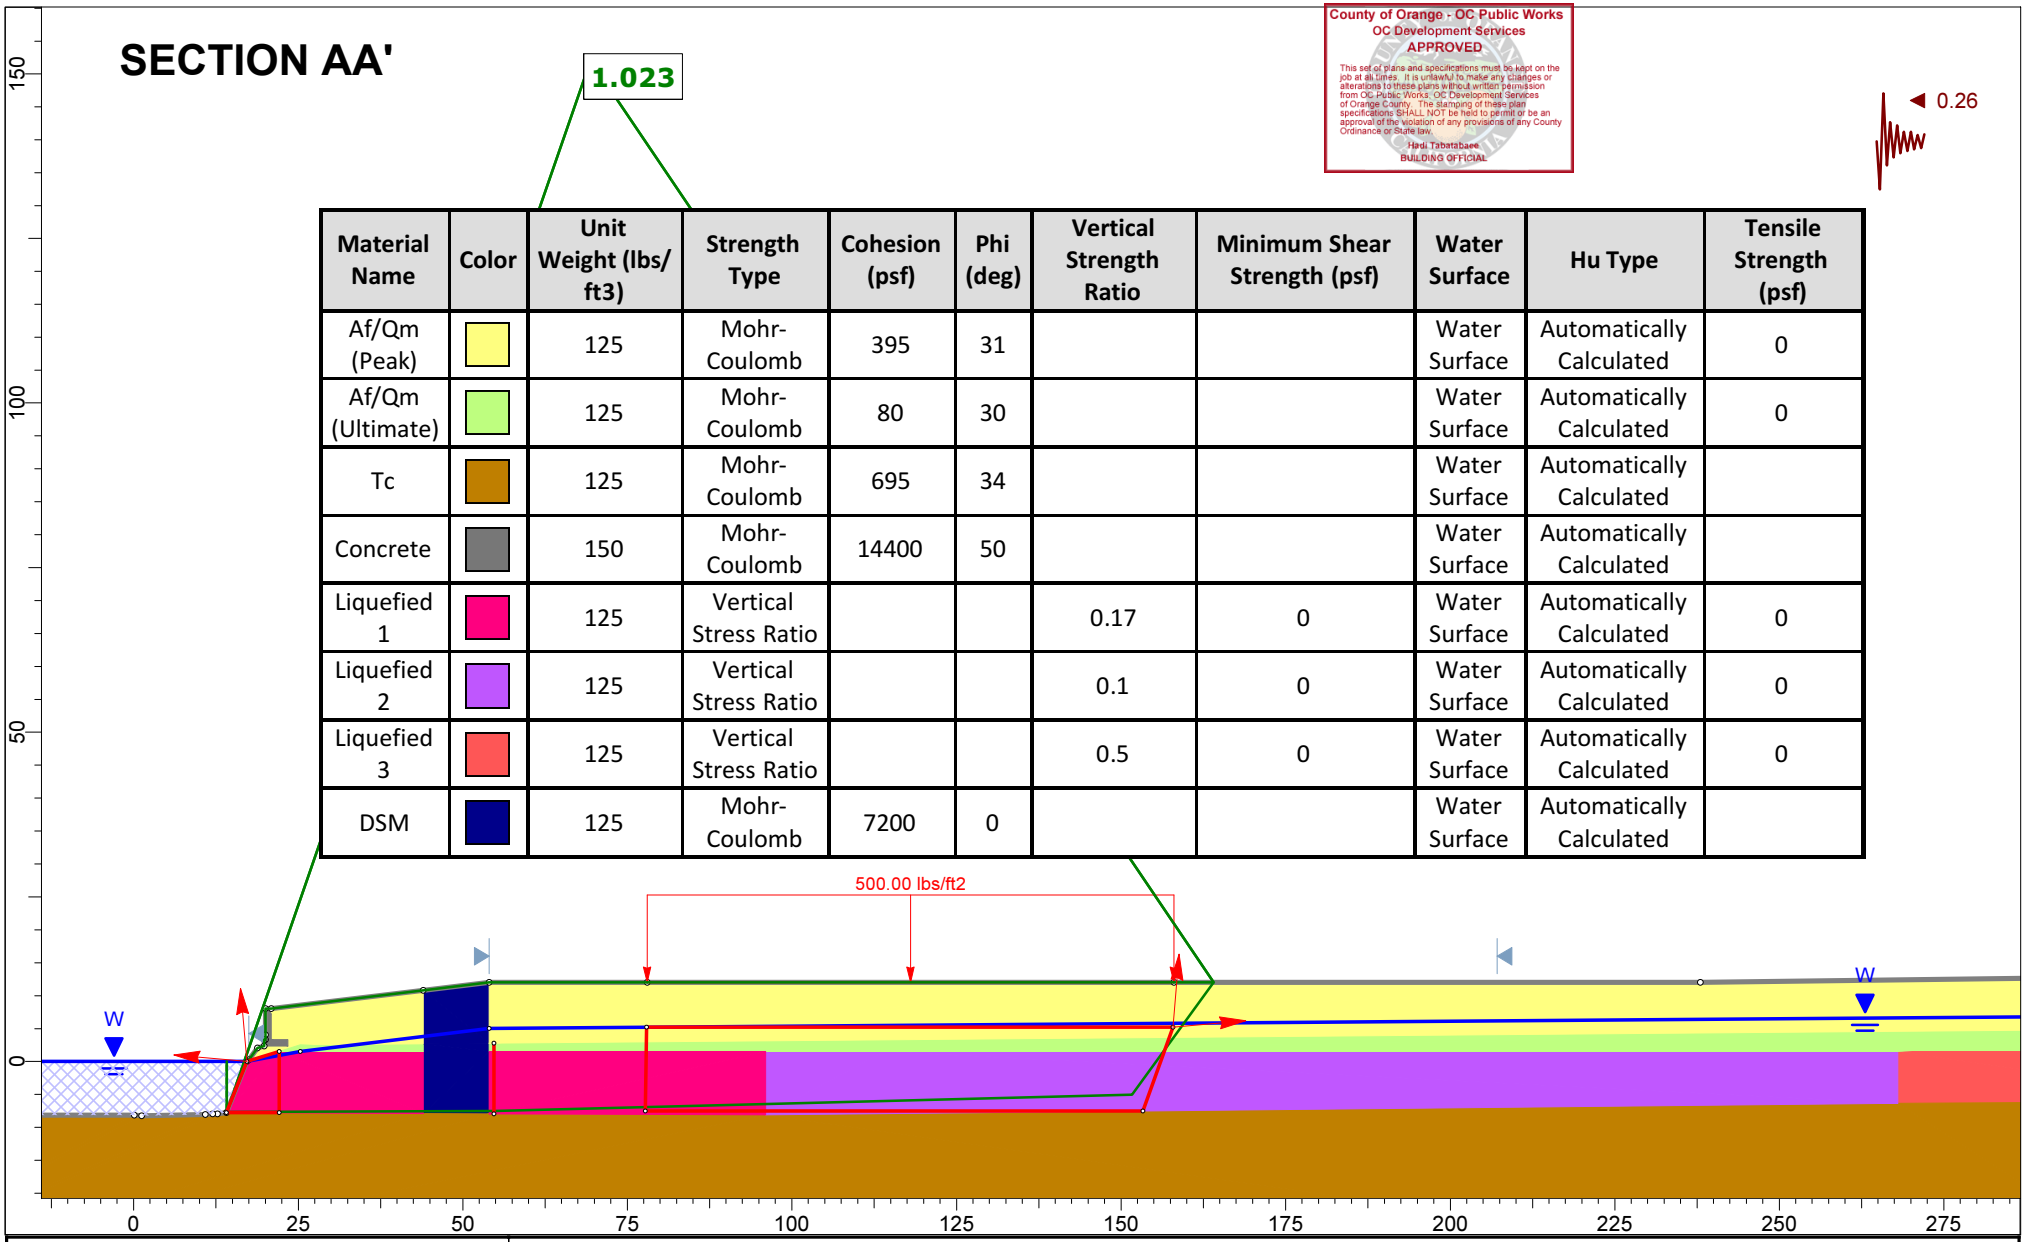

SLIDEINTERPRET 9.012

Project	Dana Point Harbor		
Group	DSM_10ft	Scenario	kh=0.26 Block Search
Drawn By	TT	Company	AGI
Date		File Name	Section_Arev.slmd

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

SECTION CC'

Material Name	Color	Unit Weight (lbs/ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Hu	Ru
Liquefied 1		125	Vertical Stress Ratio			0.25	0	Water Surface	Custom	1	
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Custom	1	
Tc		125	Mohr-Coulomb	695	34			None			0
Liquefied 2		125	Vertical Stress Ratio			0.1	0	Water Surface	Custom	1	
Liquefied 3		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1	
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Custom	1	
DSM		125	Mohr-Coulomb	20000	0			Water Surface	Custom	1	
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Custom	1	

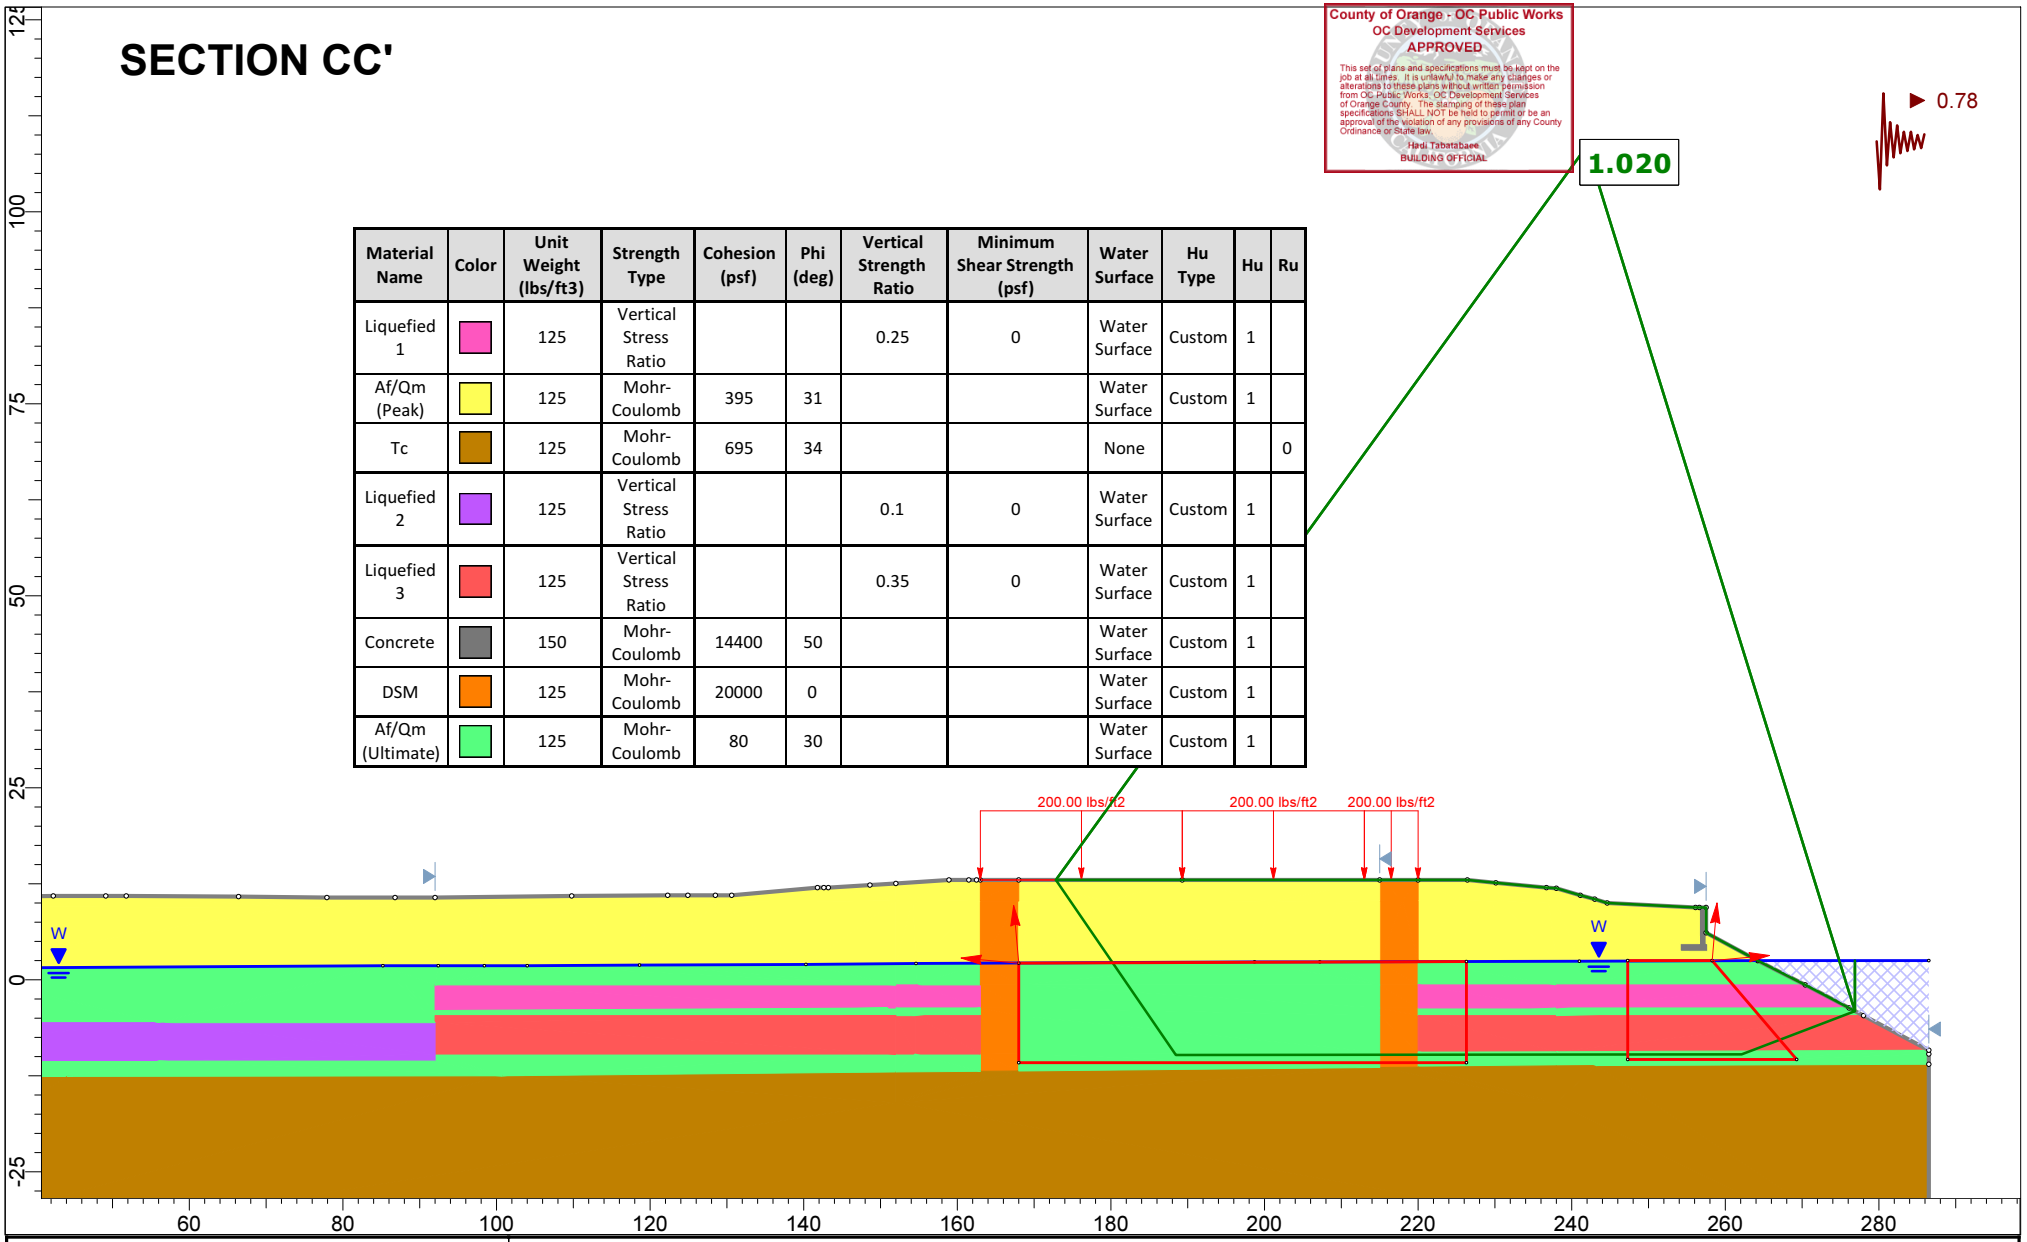

AGI	*Project*	Dana Point Harbor	
	Group	Group 1	*Scenario* kh=0.78 Block Search
	Drawn By	TT	*Company* AGI
	Date		*File Name* Section_C.slmd

SLIDEINTERPRET 9.012

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
1067
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations without the prior written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

SECTION DD'

Material Name	Color	Unit Weight (lbs/ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Hu
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Custom	1
Tc		125	Mohr-Coulomb	695	34			Water Surface	Custom	1
Liquefied 4		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1
Liquefied 2		125	Vertical Stress Ratio			0.55	0	Water Surface	Custom	1
Liquefied 3		125	Vertical Stress Ratio			0.3	0	Water Surface	Custom	1
Liquefied 5		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Custom	1
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Custom	1
DSM		125	Mohr-Coulomb	20000	0			Water Surface	Custom	1

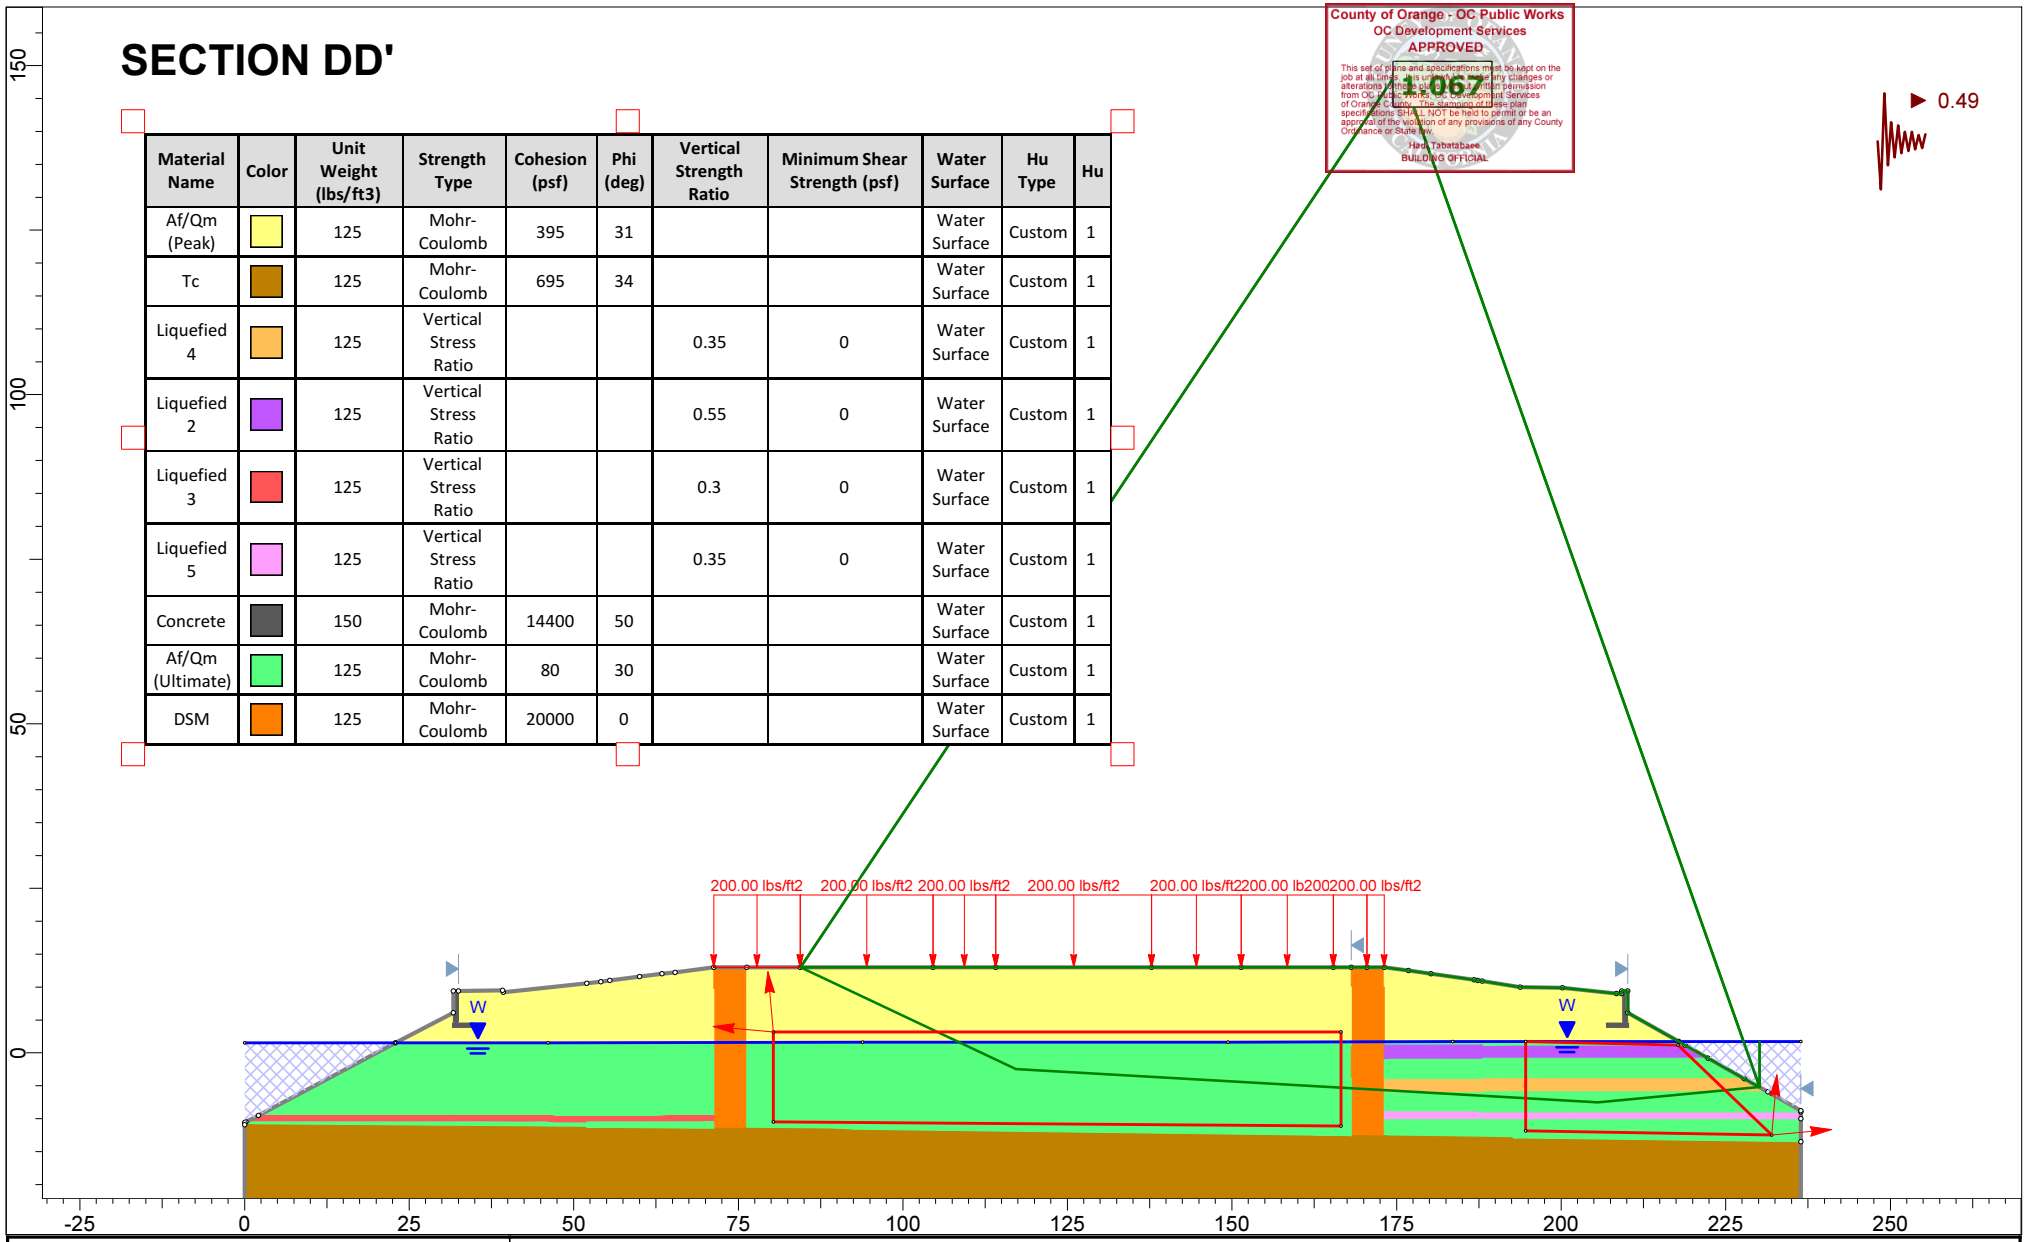

Project	Dana Point Harbor		
Group	Group 1	Scenario	kh=0.5 Block Search
Drawn By	TT	Company	AGI
Date	4/15/2021	File Name	Section_D.slmd

SLIDEINTERPRET 9.012

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B2

Composite Shear Strength of DSM Buttress

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Determine composite shear strength of DSM buttress for use in pseudostatic slope stability anlysis
Lateral stread buttress

Geometry:

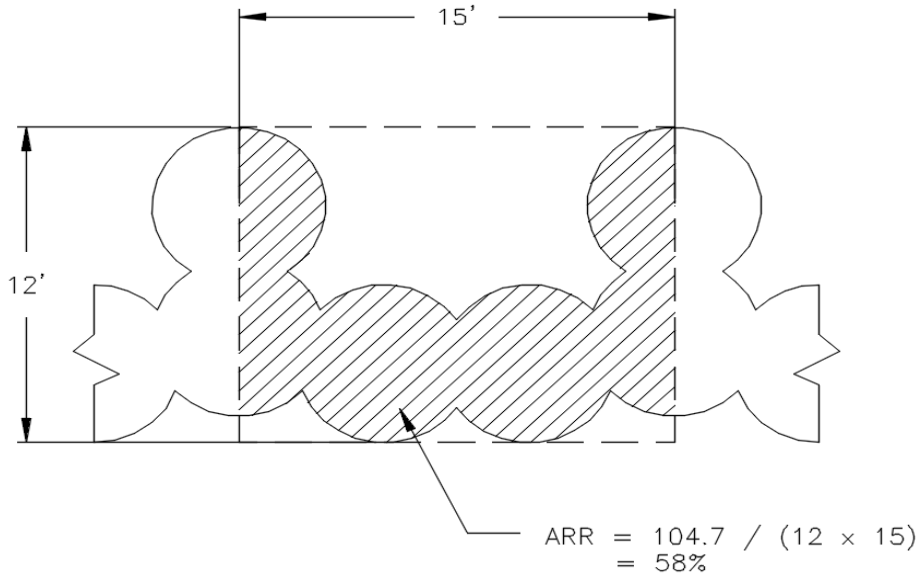

Input values:

ARR =	**58%**		Area replacement ratio
q_DSM28 =	**150**	psi	Design compressive strength of DSM at 28 days
fc =	**2**		Curing factor (long term)

Calculations:

q_DSM =	300	psi	Long term compressive strength of DSM for seismic condition
s_DSM =	150	psi	Shear strength of DSM = 1/2 compressive strength
=	21600	psf	
s_comp =	12528	psf	Composite shear strenght = s_DSM x ARR (Neglect shear strength of native soils)

Select conservative value of **7200 psf** to ensure strain compatibility

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B3

Post-Improvement Slope Lateral Deformation

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.26**	g
Correlated displacement in soils - West US region	d	**1.4**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.49**	g
Correlated displacement in soils - West US region	d	**0.1**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.78**	g
Correlated displacement in soils - West US region	d	**0.0**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B4

Internal Stability Analysis

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM Internal Stability Design Calculations - Per FHWA (2013)

Input Parameters		
DSM Panel height (H_dm)=	24	ft
DSM Panel Width (B)=	12	ft
Panel Effective Width (b)=	5.2	ft
Chord Length (c)=	3.3	ft
s_shear=	15	ft
Replacement Ratio (a_s,shear) =	0.347	
Panel Bottom Ele. =	-12	ft
G.W. Ele. =	5	ft
Soil below DSM panel tip:		
Cohesion (C_m) =	695	psf
Friction angle (Phi_m)=	34	deg
Effective Unit Weight=	62.6	pcf
Soil above DSM panel tip:		
Effective Unit Weight=	62.6	pcf
DSM Strength (28 days) =	150	psi
DSM Strength (1 year) =	300	psi
DSM Panel Unit Weight=	125	pcf
Lateral Seismic Coefficient (k_h) =	0.19	g
P_ae =	23,959	lbs/ft
h_a=	8.0	ft
P_p (Rankin or Coulomb Methods)=	31,411	lbs/ft
h_p=	2.5	ft
Va=	7,188	lbs/ft
Vp=	9,423	lbs/ft

Force Calculations		
Panel Weight (W)=	36000	lbs/ft
Buoyancy Force (U)=	12,730	lbs/ft
Inertial Load on Panel (Fa)=	6840	lbs/ft
T=	22528	lbs/ft
N=	33,764	lbs/ft
N'=	21,035	lbs/ft
x_N=	3.17	ft
x_N'=	1.46	ft

Combined Overturning and bearing capacity failure		
q_toe=	24,438	psf
N'c=	42.2	
N'q=	29.4	
N'_gamma (Vesic 1975)=	41.1	
q_all =	80,218	psf
Is Demand < Allowable?	DESIGN OK	

Crushing of DSM Panel at the outside toe		
q_toe=	24,438	psf
fv=	0.95	
Fc=	1.3	
S_dm	21600	psf
Vertical Eff. Pressure at the toe ele	1689	psf
q_all =	32,414	psf
Is Demand < Allowable?	DESIGN OK	

Racking Failure Mode		
T_v=	905	psf
fv=	0.95	
Fv=	1.3	
Tv_all=	3,494	psf
Is Demand < Allowable?	DESIGN OK	

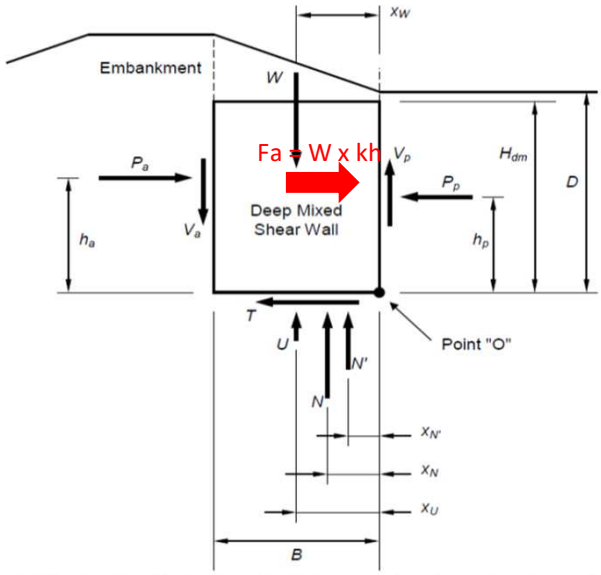

Figure 51. Illustration. Definition sketch for combined overturning and bearing calculations.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Check internal shear

Shear force	46000	lbs/ft	(Given)
Panel spacing	15	ft	
DSM section area per panel	104.7	sf	(Per 15' of length, and including continuous front row)
DSM compressive strength	150	psi	
Available shear strength	75	psi	
Shear stress	46	psi	
Factor of savefy	1.64		OK

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C1

DSM Column Structural Capacity

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Structural Capacity of 4ft dia. DSM column - Static Condition

Column Diameter=	**4.0**	
F.S.=	**1.5**	
UCS, 28-day strength (psi)=	**150**	
Curing Factor (fc) =	**1.00**	28-day strength
Confining Pressure effects =	**1**	
UCS, 90-day strength (psi)=	**150**	
Allowable pressure (psf)	14400	
Allowable load (kips)	181.0	
Max. Demand - ASD Level (kips)	**180**	
Is Capacity >= Demand?	**Yes**	

Structural Capacity of 4ft dia. DSM column - Post Liquefaction

Column Diameter=	**4.0**	
F.S.=	**1.3**	
UCS, 28-day strength (psi)=	**150**	
Curing Factor (fc) =	**2.00**	365-day strength
Confining Pressure effects =	**1**	
UCS, 365-day strength (psi)=	**300**	
Allowable pressure (psf)	33231	
Allowable load (kips)	417.6	
Max. Demand - ASD Level (kips)	**308**	including 128k downdrag
Is Capacity >= Demand?	**Yes**	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C2

DSM Column Geotechnical Capacity

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the Authorities: OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM GEOTECHNICAL CAPACITY

PROJECT INFORMATION

Version 1.0

Project Name: Dana Point
Borehole Number: (11-161-00) DH-17
Project Number: N/A
Drawing ref:
Calculation By: **Thomas Tran** Reviewed By: **Justin Martos**

Date 01/08/21

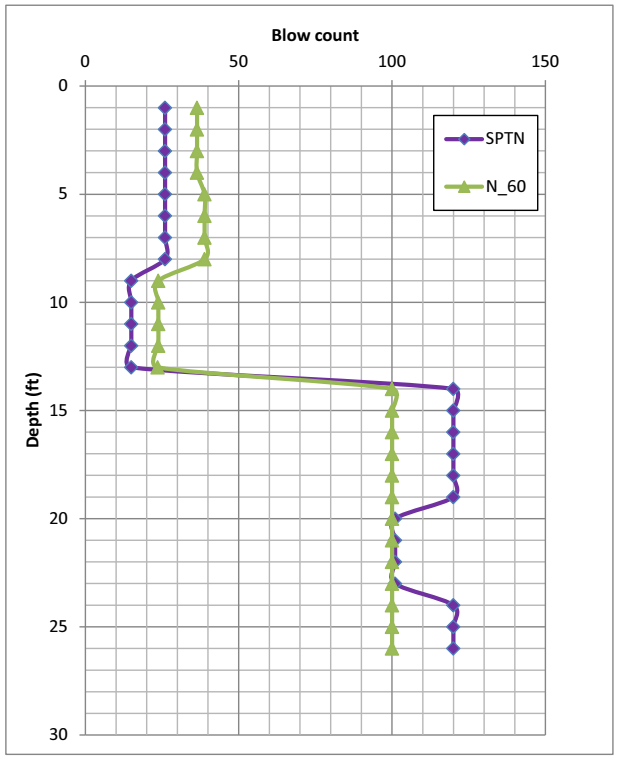

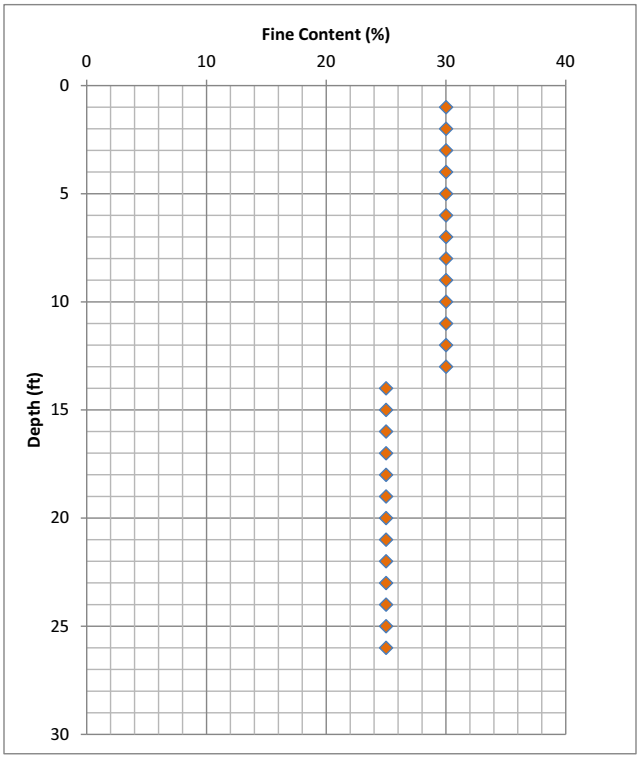

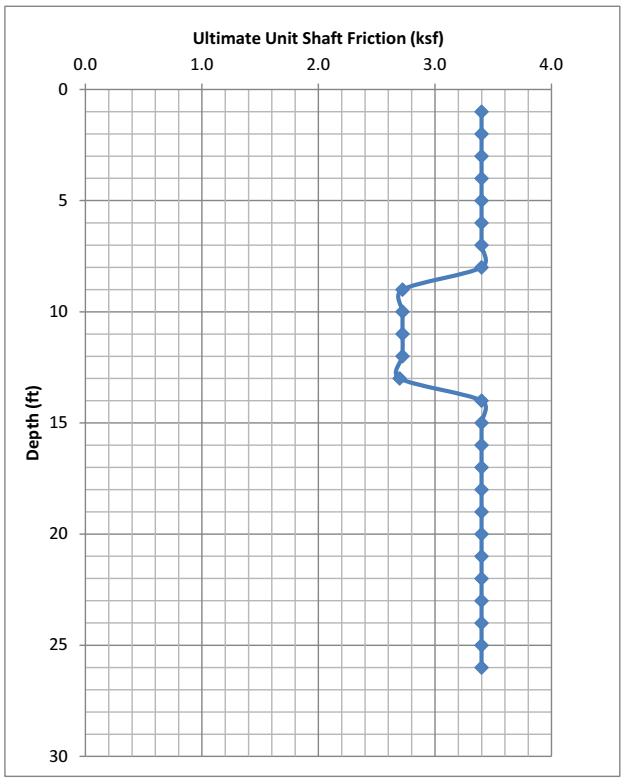

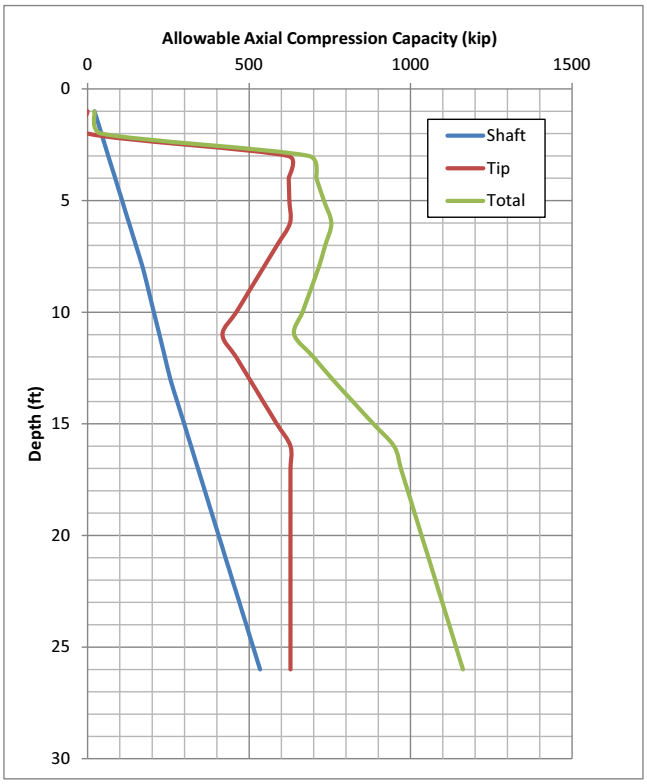

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM GEOTECHNICAL CAPACITY

PROJECT INFORMATION

Version 1.0

Project Name: Dana Point
Borehole Number: (11-161-00) DH-19
Project Number: N/A
Drawing ref:
Calculation By: **Thomas Tran** Reviewed By: **Justin Martos**

Date 01/08/21

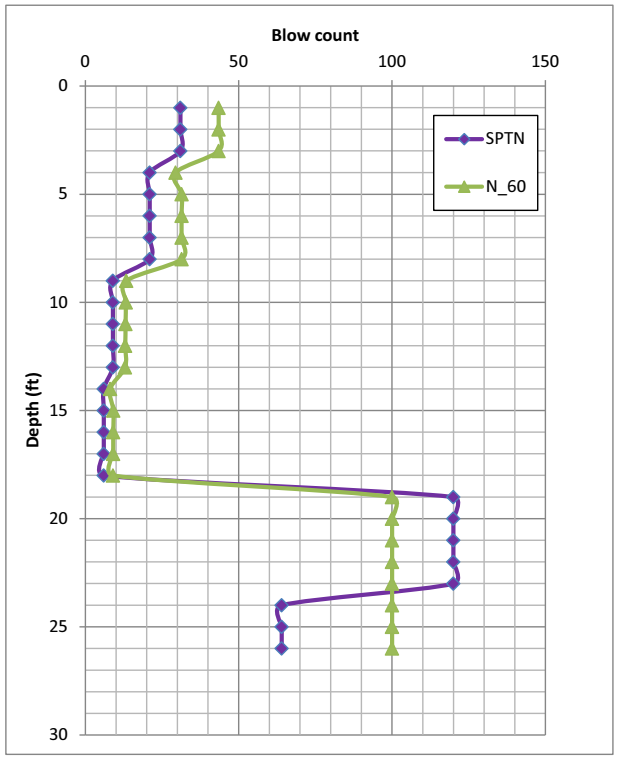

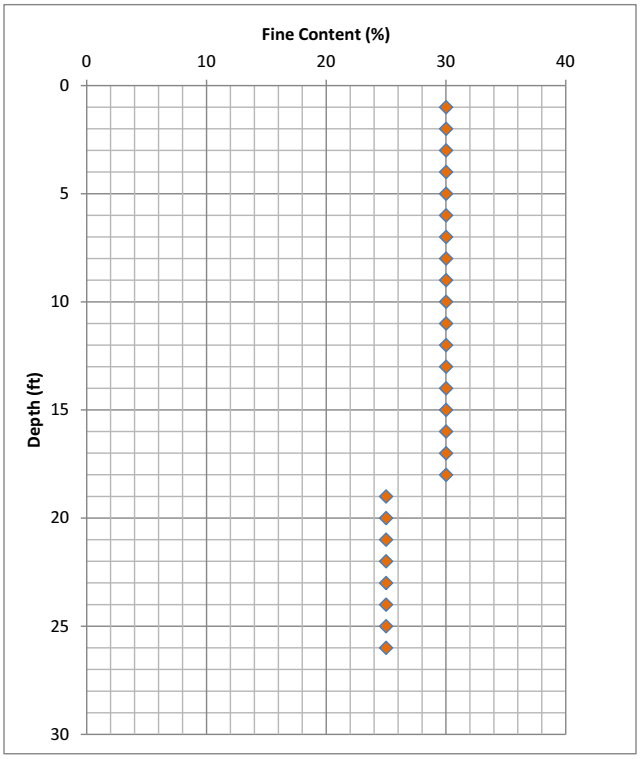

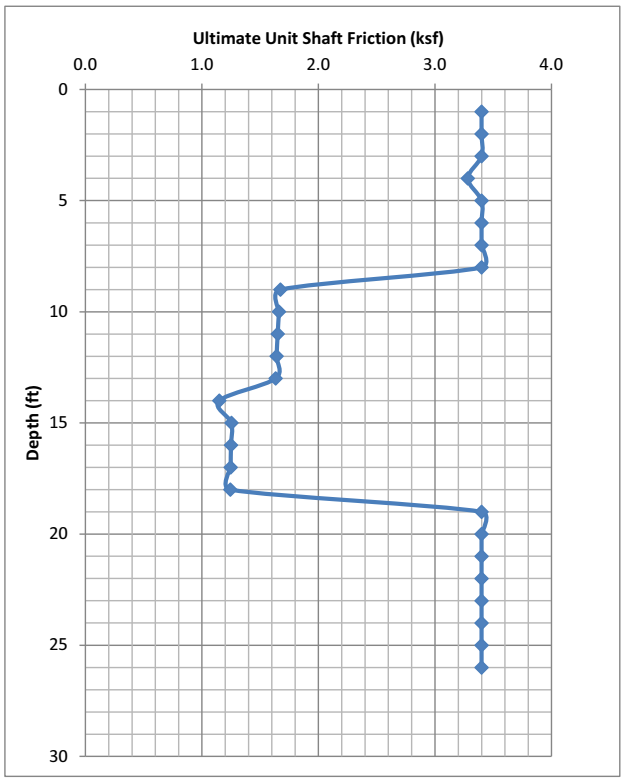

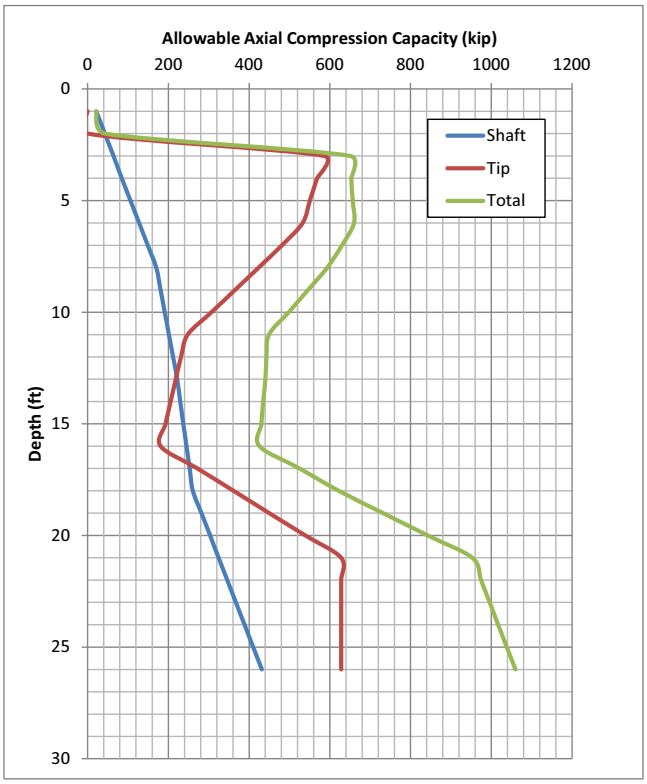

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM GEOTECHNICAL CAPACITY

PROJECT INFORMATION

Version 1.0

Project Name: Dana Point
Borehole Number: (17-206-02) DH-25
Project Number: N/A
Drawing ref:
Calculation By: **Thomas Tran** Reviewed By: **Justin Martos**

Date 01/08/21

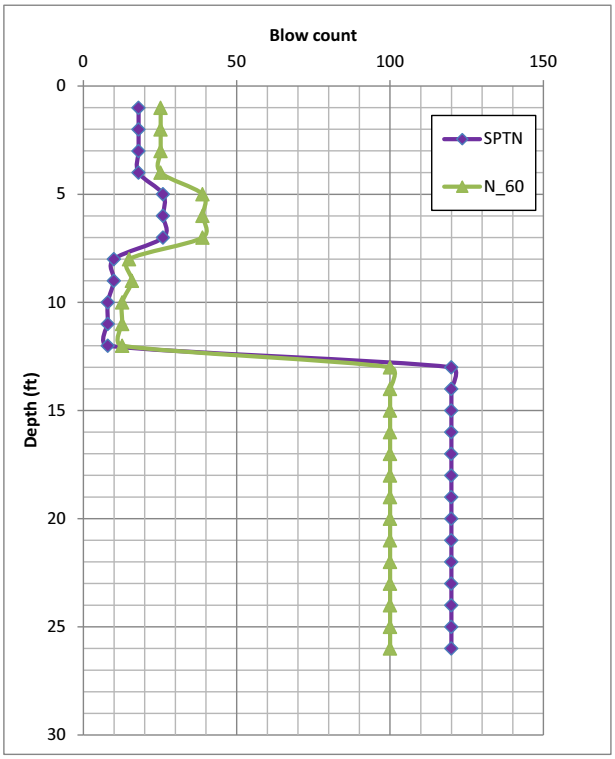

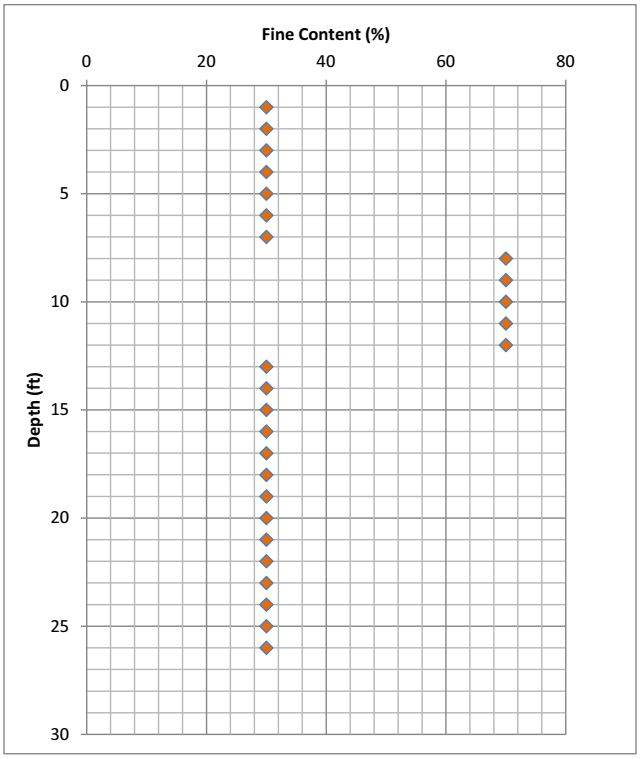

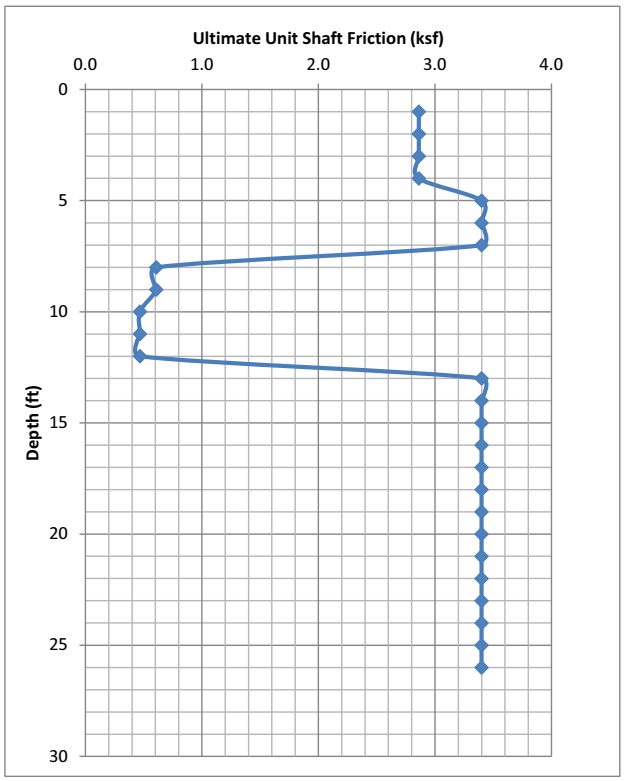

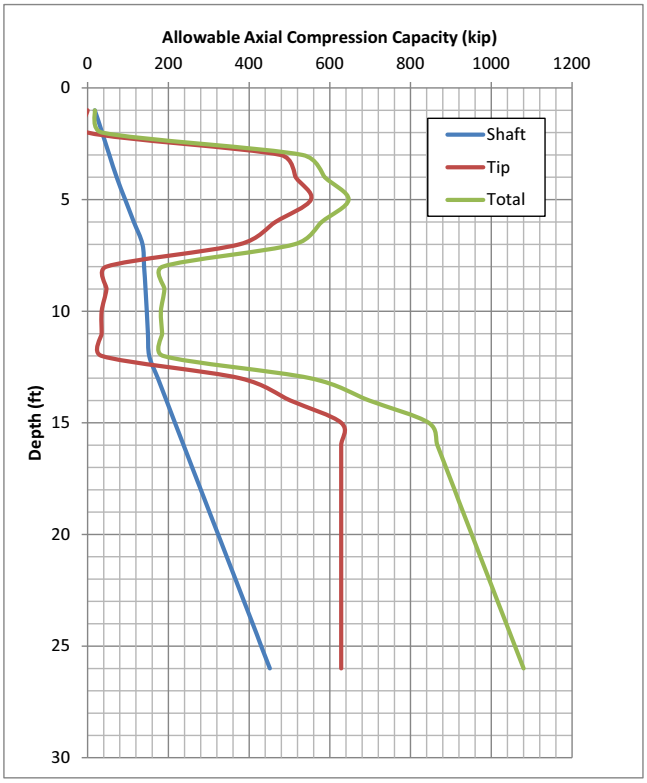

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM GEOTECHNICAL CAPACITY

PROJECT INFORMATION

Version 1.0

Project Name: Dana Point
Borehole Number: (17-206-02) DH-26
Project Number: N/A
Drawing ref:
Calculation By: **Thomas Tran** Reviewed By: **Justin Martos**

Date 01/08/21

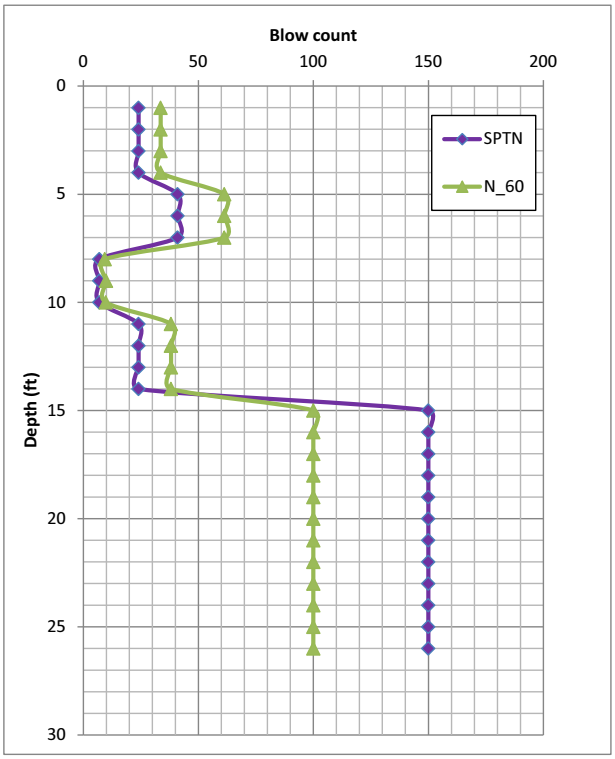

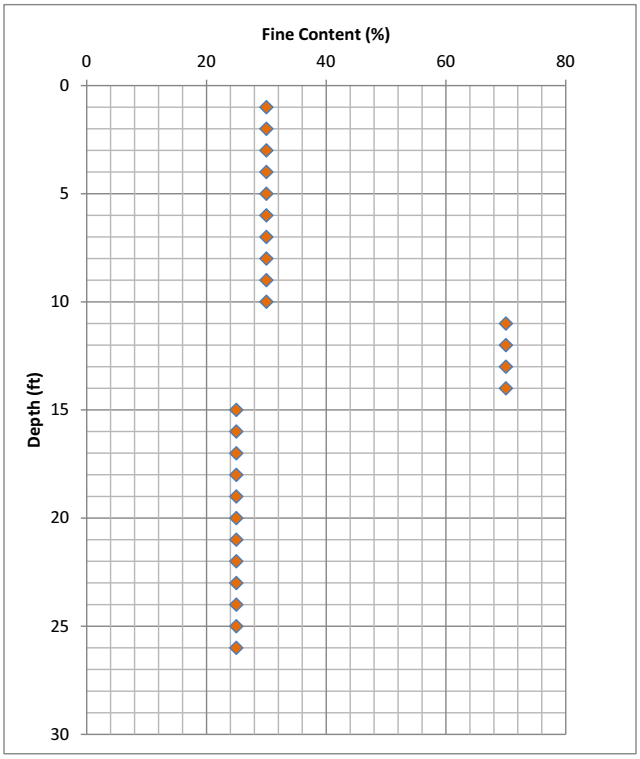

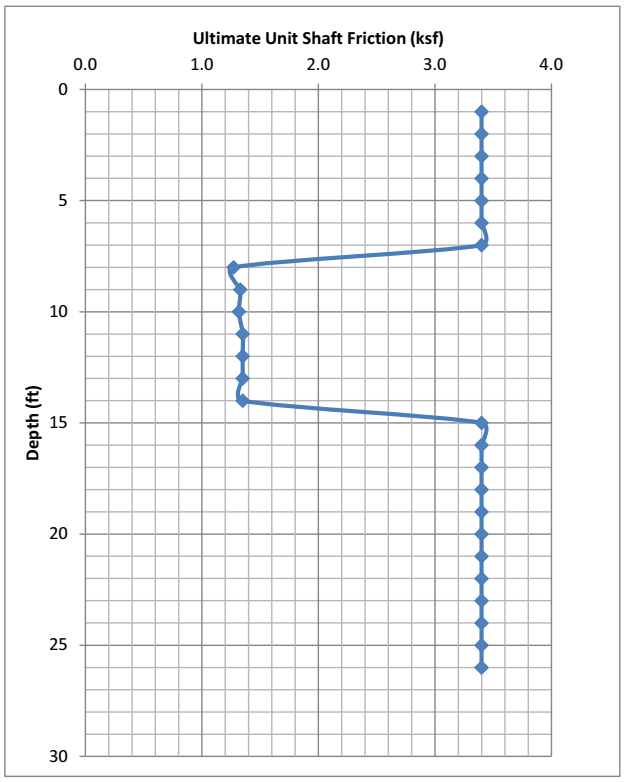

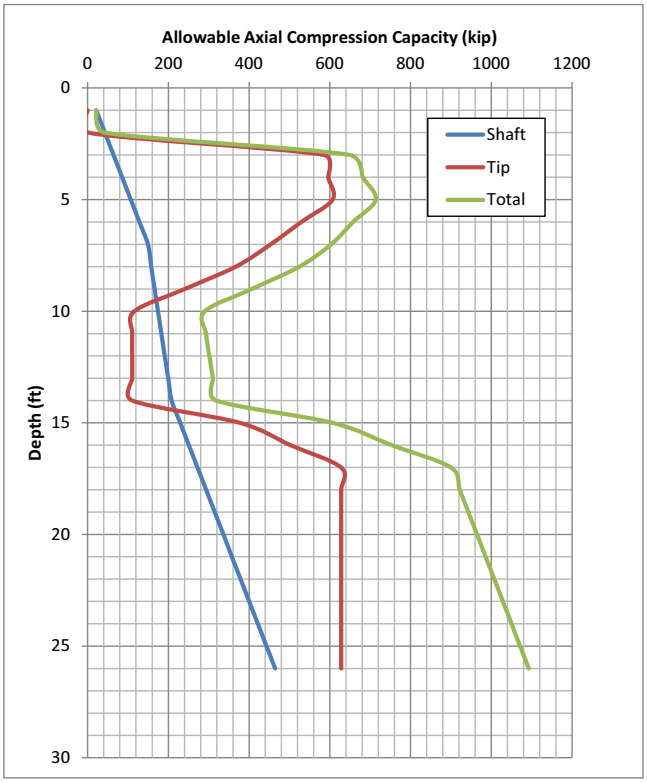

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C3

DSM Column Settlement

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Tzpile Analysis Information

Project Summary

File Name DPH DSM 4ft.rspile
File Version 0.000

Project Title Dana Point Harbor
Analysis DSM 4ft
Date Created 10/25/2018, 8:32:35 AM

Results

Axial Force vs Settlement

Pile Head Axial Force (lbs)	Pile Head Settlement (in)	Pile Toe Axial Force (lbs)	Pile Toe Settlement (in)
200000.00	0.48	81394.78	0.02

Axial Displacement, Axial Force

Axial Displacement, Axial Force

Soil Layer #	Pile Depth (ft)	Axial Displacement (in)	Axial Force (lbs)
1	-0.00	0.477455	200000.0000
1	0.20	0.47156	199985.3497
1	0.40	0.465667	199941.3987
1	0.60	0.459775	199868.1472
1	0.80	0.453886	199765.5950
1	1.00	0.448	199633.7422
1	1.20	0.442119	199472.5887
1	1.40	0.436242	199282.1347
1	1.60	0.430372	199062.3800
1	1.80	0.424509	198813.3247
1	2.00	0.418653	198534.9687
1	2.20	0.412806	198227.3122
1	2.40	0.406969	197890.3550
1	2.60	0.401142	197524.0973
1	2.80	0.395326	197128.5389
1	3.00	0.389522	196703.6799
1	3.20	0.383732	196249.5203
1	3.40	0.377955	195766.0602
1	3.60	0.372192	195253.2994
1	3.80	0.366446	194711.2381
1	4.00	0.360715	194139.8762
1	4.20	0.355002	193539.2138
1	4.40	0.349307	192909.2508
1	4.60	0.343631	192249.9873
1	4.80	0.337975	191561.4233
1	5.00	0.33234	190843.5588
1	5.20	0.326726	190096.3938
1	5.40	0.321135	189319.9283

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

1	5.60	0.315567	188514.1624
1	5.80	0.310023	187679.0960
1	6.00	0.304504	186814.7292
1	6.20	0.299011	185921.0621
1	6.40	0.293545	184998.0946
1	6.60	0.288107	184045.8267
1	6.80	0.282697	183064.2586
1	7.00	0.277316	182053.3901
1	7.20	0.271966	181013.2215
1	7.40	0.266647	179943.7526
1	7.60	0.26136	178844.9835
1	7.80	0.256105	177716.9143
1	8.00	0.250884	176559.5450
1	8.20	0.245698	175372.8756
1	8.40	0.240547	174156.9062
1	8.60	0.235432	172911.6369
1	8.80	0.230355	171637.0676
1	9.00	0.225316	170333.1984
1	9.20	0.220315	169000.0293
1	9.40	0.215354	167637.5605
1	9.60	0.210434	166245.7920
1	9.80	0.205555	164824.7237
1	10.00	0.200718	163374.3559
1	10.20	0.195925	161894.6885
1	10.40	0.191176	160385.7216
1	10.60	0.186471	158847.4553
1	10.80	0.181813	157279.8895
1	11.00	0.177201	155683.0245
1	11.20	0.172636	154056.8603
1	11.40	0.16812	152401.3968
1	11.60	0.163653	150716.6343
1	11.80	0.159236	149002.5728
1	12.00	0.15487	147259.2123
1	12.20	0.150556	145486.5530
1	12.40	0.146295	143684.5949
1	12.60	0.142087	141853.3380
1	12.80	0.137934	139992.7826
1	13.00	0.133835	138102.9286
1	13.20	0.129793	136183.7761
1	13.40	0.125808	134235.3253
1	13.60	0.121881	132257.5762
1	13.80	0.118013	130250.5289
1	14.00	0.114204	128214.1836
1	14.20	0.110455	126148.5402
1	14.40	0.106768	124053.5989
1	14.60	0.103143	121929.3598
1	14.80	0.0995814	119775.8230
1	15.00	0.0960827	117640.7133
1	15.20	0.0926462	115553.6424
1	15.40	0.0892705	113515.2631
1	15.60	0.0859542	111526.2072
1	15.80	0.0826957	109587.0866
1	16.00	0.0794937	107698.4964
1	16.20	0.0763466	105861.0163

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

1	16.40	0.0732528	104075.2131
1	16.60	0.0702109	102341.6430
1	16.80	0.0672194	100660.8534
1	17.00	0.0642766	99033.3853
1	17.20	0.0613809	97459.7756
1	17.40	0.0585309	95940.5593
1	17.60	0.0557248	94476.2717
1	17.80	0.052961	93067.4507
1	18.00	0.050238	91714.6390
1	18.20	0.047554	90418.3870
1	18.40	0.0449073	89179.2542
1	18.60	0.0422963	87997.8125
1	18.80	0.0397193	86874.6482
1	19.00	0.0371745	85810.3646
1	19.20	0.0346602	84805.5842
1	19.40	0.0321747	83860.9519
1	19.60	0.029716	82977.1370
1	19.80	0.0272826	82154.8359

General Properties

Pile Loading

Load Case #	Axial Load (lbs)
1	200000.00

Axial Soil Loading

Soil Displacement (in)	Sliding Depth (ft)
0.0000000	0.00

Pile Properties

Property	Value
Name	DSM 4ft
Pile Type:	Cylindrical
Material Type:	Elastic
Young's Modulus (psf)	6480000.00
Diameter (ft)	4.00

Soil Layer Properties

Layers

Layer Name	Layer Type	Thickness (ft)
Soil Layer 1	API Sand	20.00
Soil Layer 2	API Sand	30.00

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Soil Layer 1

Property	Value
Soil Type	Sand
Thickness (ft)	20.00
Unit Weight (lbs/ft3)	125.00
Friction Angle (deg)	30.00
Coefficient of Lateral Earth Pressure	1.00
Bearing Capacity Factor	12.00
Maximum Unit Skin Friction (psf)	1400.00
Maximum End Bearing Resistance (psf)	60000.00

Soil Layer 2

Property	Value
Soil Type	Sand
Thickness (ft)	30.00
Unit Weight (lbs/ft3)	125.00
Friction Angle (deg)	34.00
Coefficient of Lateral Earth Pressure	1.00
Bearing Capacity Factor	40.00
Maximum Unit Skin Friction (psf)	2000.00
Maximum End Bearing Resistance (psf)	200000.00

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX D

Liquefaction-induced Downdrag Force Calculation

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
As in effect on the date of approval by the Director. No additions, deletions or alterations to these plans without written permission from OC Public Works - OC Development Services of Orange County. The stamping of these plans and specifications SHALL NOT be held to relieve or limit approval of the violation of any provisions of any County Ordinance or Building Code.
Hindi Tabassum
BUILDING OFFICIAL

Created by Amin Rahmani, Ph.D., P.E. - February 19, 2018
Copyright © 2018 Amin Rahmani. All rights reserved.

Downdrag Calculations per AASHTO LRFD Bridge Design (2012) - Drilled Shafts

Notes:

1. Please enter the required inputs shown in blue.
2. This spreadsheet should be used for drilled shafts, only.
3. The formulations are based on povisions of AASHTO LRFD Bridge Design, 2012 - Section 10.8.
4. Per section 10.8.3.5.2, Beta method is used for cohesionless material , where N60 is average SPT blow count corrected only for hammer efficiency.
5. Put zero values for Su and N60 if not applicable.
6. Units are all Imperial. The macro must be modified for metric units.
7. Do not add any row or column to this spreadsheet.
8. The spreadsheet is formulated up to row No. 6000.

Input Parameters

Pile Diameter =	4	ft	
Wall thickness	24.0	inch	Use D/2 for concrete piles
Elastic Young's Modulus =	12960.0	ksf	
Depth where FF settlement is 0.4" =	19.0	ft	
Column Depth =	20.0	ft	
Ground Water Table Depth =	10.0	ft	

Click below to run analysis

Calculate Downdrag Force & the Resulting Pile Elastic Compression

Outputs

Negative Friction (Downdrag) =	128.7	kips
Pile Elastic Compression=	0.02	inch
Ultimate Positive Friction =	12.6	kips
Ultimate End Bearing =	706.5	kips

Input Parameters							Calculation Results							
Depth (ft)	Liquefiable?	(Su_liq)/sigma'	Cohesive Material- Su (psf)	Cohesionless Material - N60 (blows/ft)	Is the soil gravelly sand or gravel?	Unit Weight (pcf)	Sigma_v' (psf)	alpha	Beta	Mobilized Friction (psf)	Average Mob. Friction (psf)	Negative Friction, i.e., downdrag (kips)	Positive Friction (kips)	Cumulative Comp. due to downdrag load (inch)
0.00	No		0.0	20.0	No	125.0	0.00	0.00	0.00	0.00	0.00	0.00		0.00
1.00	No		0.0	20	No	125.0	125.00	0.00	1.40	175.57	87.78	1.10		0.00
2.00	No		0.0	20	No	125.0	250.00	0.00	1.33	333.66	254.62	4.30		0.00
3.00	No		0.0	20	No	125.0	375.00	0.00	1.29	482.45	408.06	9.43		0.00
4.00	No		0.0	20	No	125.0	500.00	0.00	1.25	623.72	553.09	16.38		0.00
5.00	No		0.0	20	No	125.0	625.00	0.00	1.21	758.51	691.12	25.07		0.00
6.00	No		0.0	20	No	125.0	750.00	0.00	1.18	887.55	823.03	35.41		0.00
7.00	No		0.0	20	No	125.0	875.00	0.00	1.16	1011.34	949.44	47.34		0.00
8.00	No		0.0	20	No	125.0	1000.00	0.00	1.13	1130.29	1070.81	60.80		0.00
9.00	No		0.0	20	No	125.0	1125.00	0.00	1.11	1244.71	1187.50	75.72		0.01
10.00	No		0.0	20	No	125.0	1250.00	0.00	1.08	1354.88	1299.79	92.05		0.01
11.00	Yes	0.17	0.0	0.0	No	125.0	1312.60	-	-	223.14	789.01	101.97		0.01
12.00	Yes	0.17	0.0	0.0	No	125.0	1375.20	-	-	233.78	228.46	104.84		0.01
13.00	Yes	0.17	0.0	0.0	No	125.0	1437.80	-	-	244.43	239.11	107.84		0.01
14.00	Yes	0.17	0.0	0.0	No	125.0	1500.40	-	-	255.07	249.75	110.98		0.01
15.00	Yes	0.17	0.0	0.0	No	125.0	1563.00	-	-	265.71	260.39	114.25		0.01
16.00	Yes	0.17	0.0	0.0	No	125.0	1625.60	-	-	276.35	271.03	117.66		0.01
17.00	Yes	0.17	0.0	0.0	No	125.0	1688.20	-	-	286.99	281.67	121.20		0.01
18.00	Yes	0.17	0.0	0.0	No	125.0	1750.80	-	-	297.64	292.32	124.87		0.01
19.00	Yes	0.17	0.0	0.0	No	125.0	1813.40	-	-	308.28	302.96	128.68		0.01
20.00	No		0.0	120.0	No	125.0	1876.00	0.00	0.90	1695.63	1001.96		12.59	
21.00	No		0.0	120.0	No	125.0	1938.60	0.00	0.89	1722.95	1709.29			
22.00	No		0.0	120.0	No	125.0	2001.20	0.00	0.87	1749.11	1736.03			
23.00	No		0.0	120.0	No	125.0	2063.80	0.00	0.86	1774.12	1761.62			
24.00	No		0.0	120.0	No	125.0	2126.40	0.00	0.85	1798.01	1786.06			
25.00	No		0.0	120.0	No	125.0	2189.00	0.00	0.83	1820.78	1809.39			
26.00	No		0.0	120.0	No	125.0	2251.60	0.00	0.82	1842.45	1831.61			
27.00	No		0.0	120.0	No	125.0	2314.20	0.00	0.81	1863.04	1852.74			

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX E

PLAXIS Analysis of LTP Section

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Static and seismic performance of the proposed LTP system under slab load of 300 psf was evaluated using the finite element computer program PLAXIS, 2D. The geometry of the FE modal was composed of two-dimensional (2D) plane-strain model of:

a. 4ft diameter DSM columns at 12ftx12ft spacing and 20ft deep;
b. Three (3) layers of 12" thick cement-treated fill with UCS=200psi;
c. Soil layers from the ground information collected from CPTs and borings.

The effective width of the DSM columns were taken as 1.05 ft in order to account for the three-dimensional effects in the 2D plain-strain model. Equivalent secant elastic parameters and shear strength of the native soils were obtained from the site investigation data. Table A below presents the input soil parameters.

Table A. Input Soil Properties for PLAXIS analysis.

Depth (ft)	Soil Type	Static Condition		Liquefied Condition	
		Secant Young's Modulus (ksf)	Shear Strength	Secant Young's Modulus (ksf)	Shear Strength
0 to 9	Af/Qm	400	Phi = 31, c = 395 psf	-	-
9 to 20	Af/Qm (below GWT)	400	Phi = 30, c = 80 psf	100	Phi = 5.7 deg
Below 20	Tc	3000	Phi = 34, c = 695 psf	-	-
-	LTP (UCS, 28day=200 psi)	7200	14400 psf	14400 (365 day UCS)	28800 psf (365 day UCS)
-	CDSM (UCS, 28day=150 psi)	6480	10800 psf	12960 (365 day UCS)	21600 psf (365 day UCS)

The main goal of the analysis was to ensure that the deformations are in a tolerable ranges and LTP system did not show any signs of failure in tension and compression under the slab load during static and seismic loadings. Geometry of the model, deformations and stresses are presented in the following pages.

LTP Model - Static Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

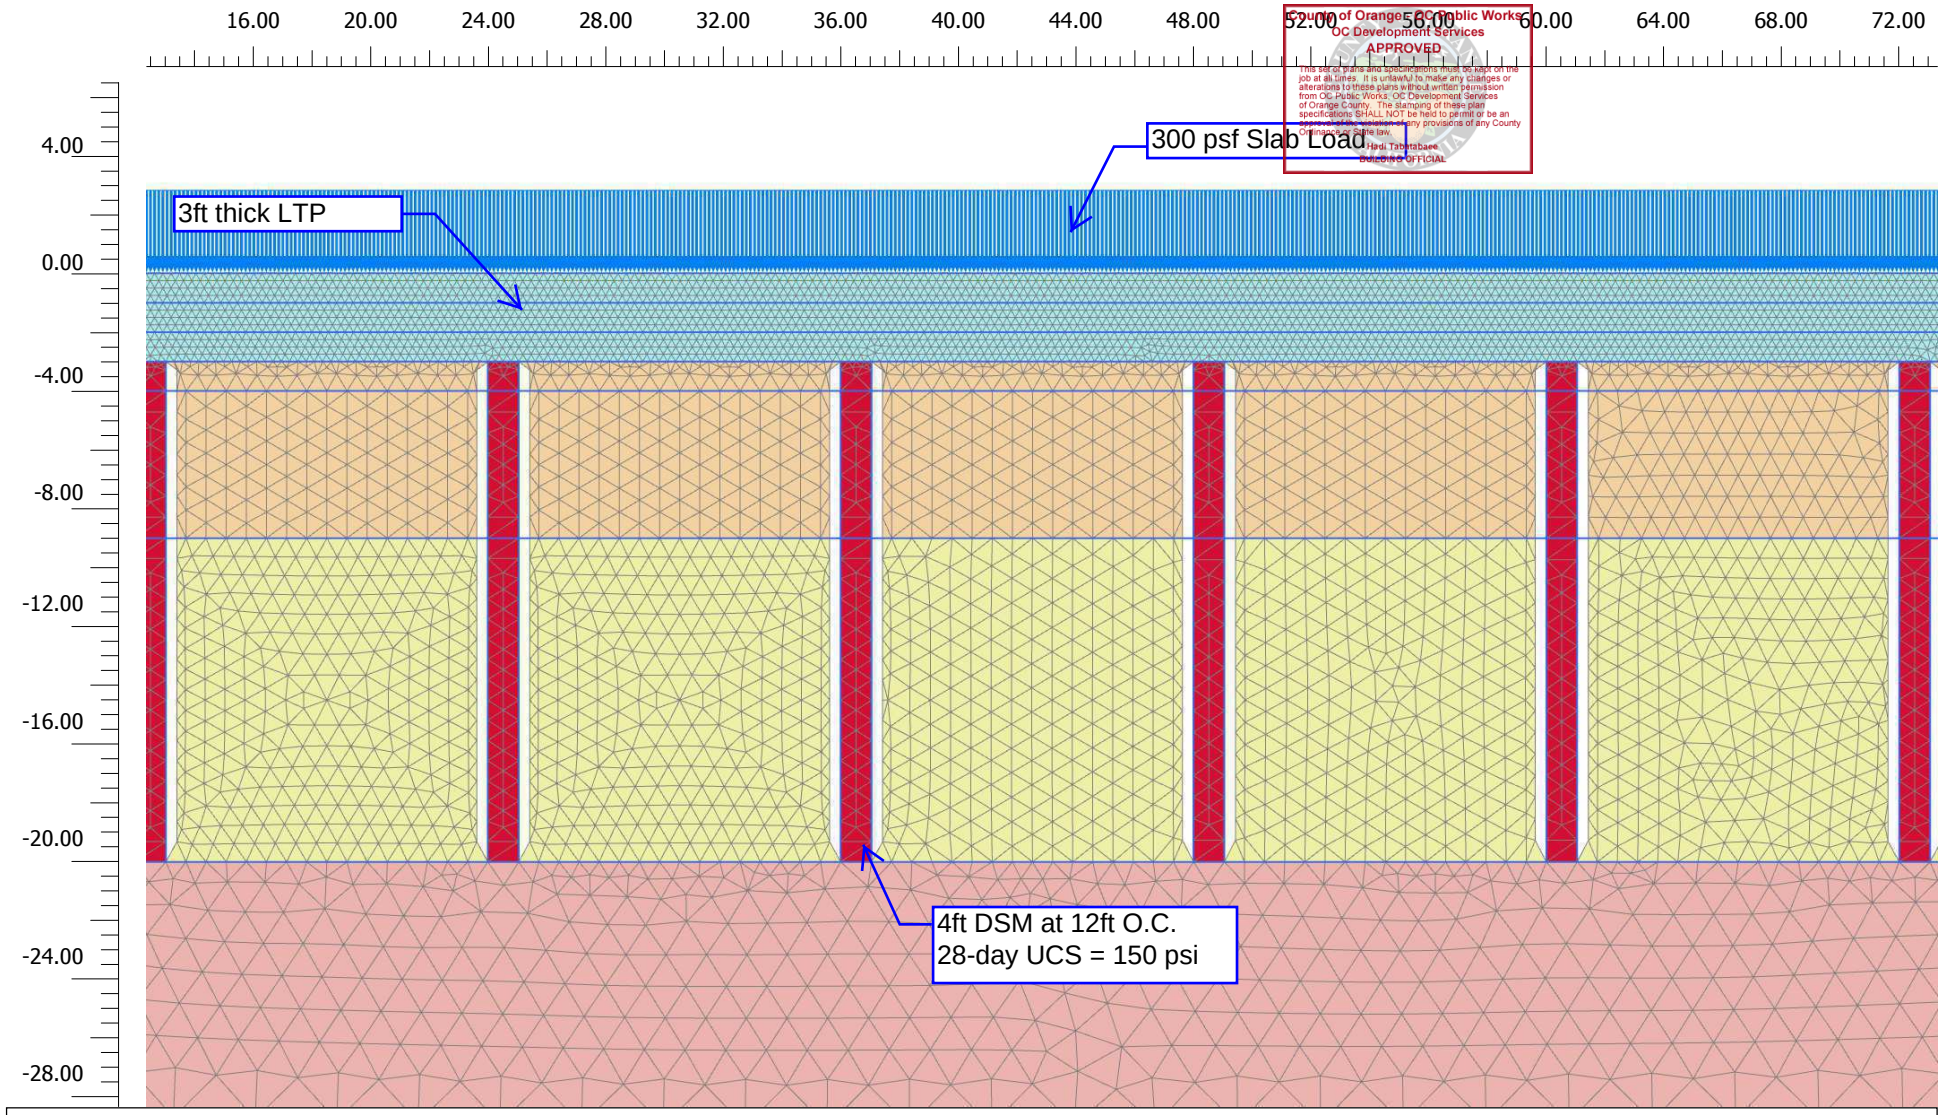

Connectivity plot

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Static	*Step* 124	*Company* Advanced Geosolutions Inc (AGI)

Deformation Contours - Static Loading Condition

Building&Safety; Ryan Rose 1/16/2025
Approved Foundation Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange, OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

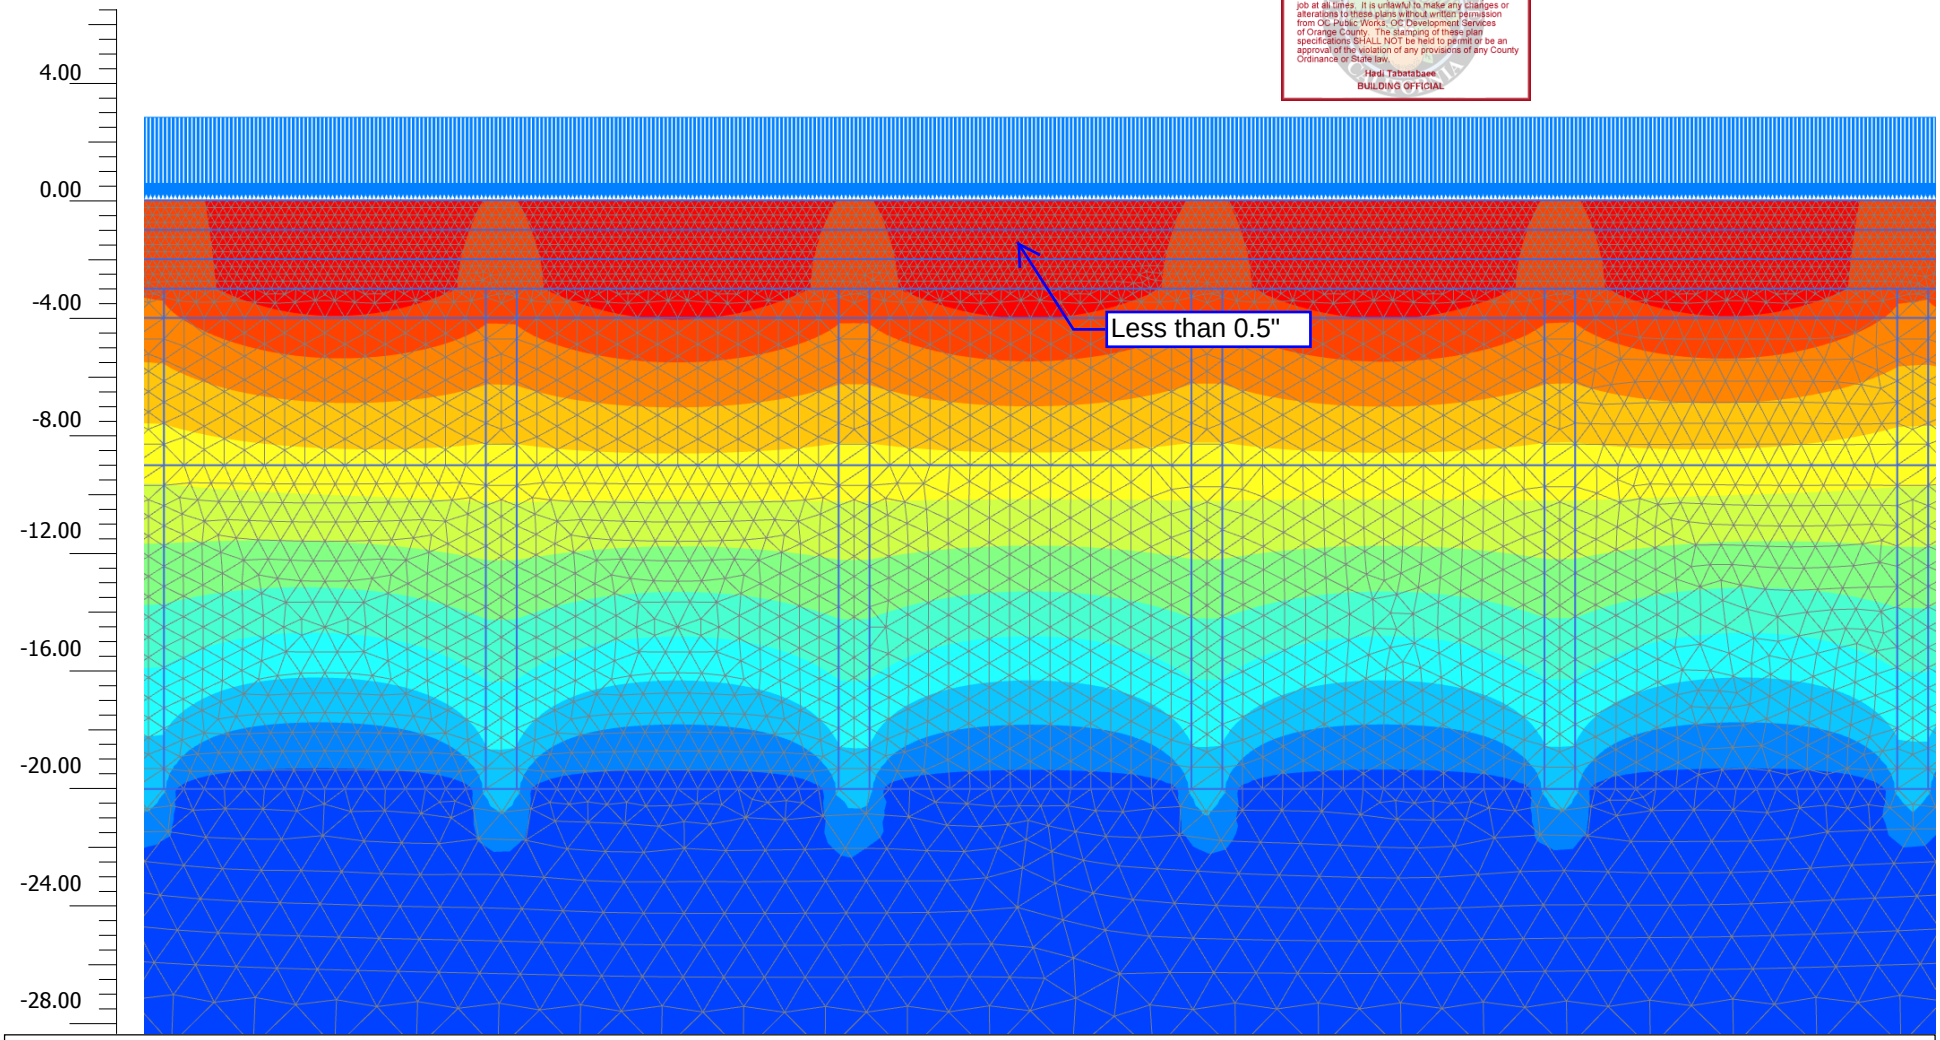

Total displacements u_y (scaled up 200 times)

Maximum value = 0.000 ft (Element 13635 at Node 14266)

Minimum value = -0.01189 ft (Element 220 at Node 2397)

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Static	*Step* 124	*Company* Advanced Geosolutions Inc (AGI)

Vertical Stress Contours - Static Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approval: Construction Plans
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

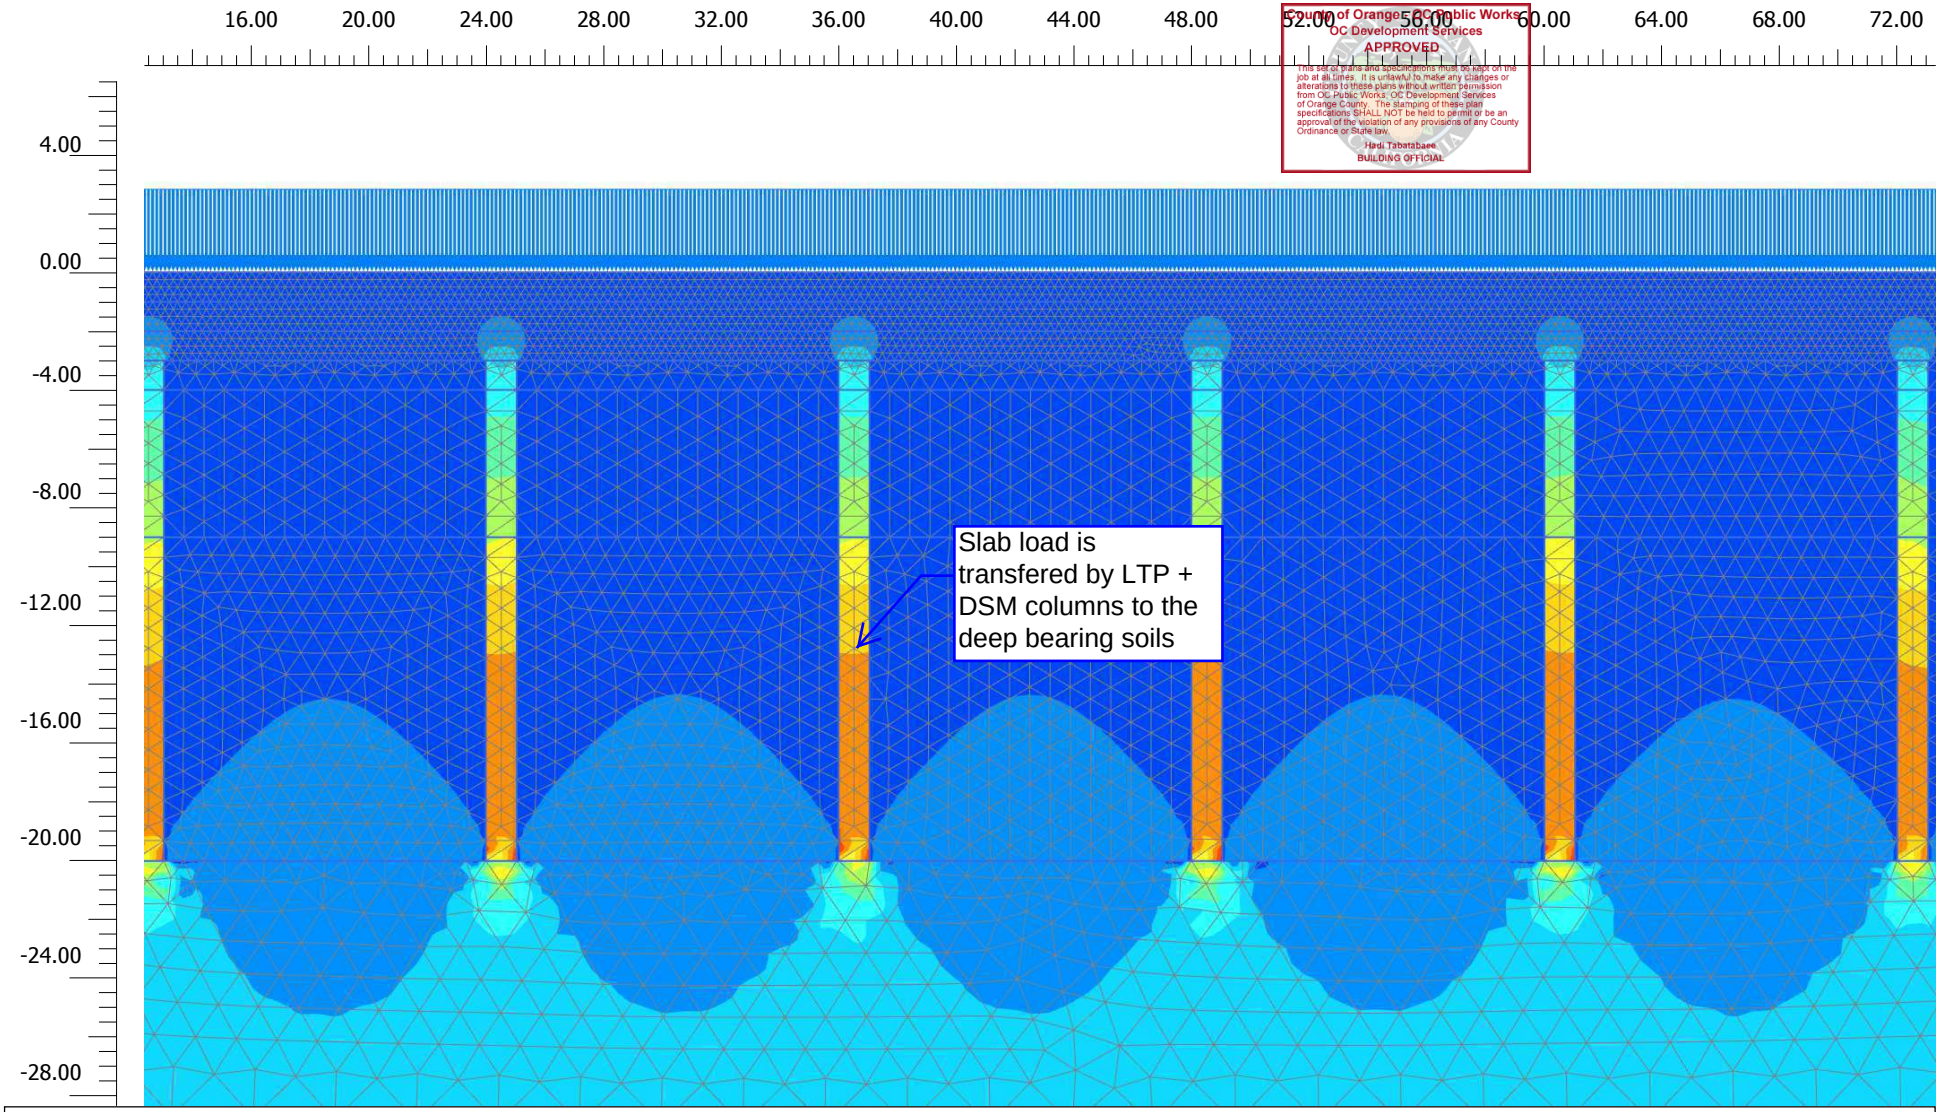

Cartesian effective stress σ'_{yy} (scaled up $0.200*10^{-3}$ times)

Maximum value = 287.2 lbf/ft² (Element 14799 at Node 18824)

Minimum value = $-10.47*10^{3}$ lbf/ft² (Element 12027 at Node 19297)

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Static	*Step* 124	*Company* Advanced Geosolutions Inc (AGI)

Potential Failures within LTP - Static Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Geotechnical/Mechanical Report
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

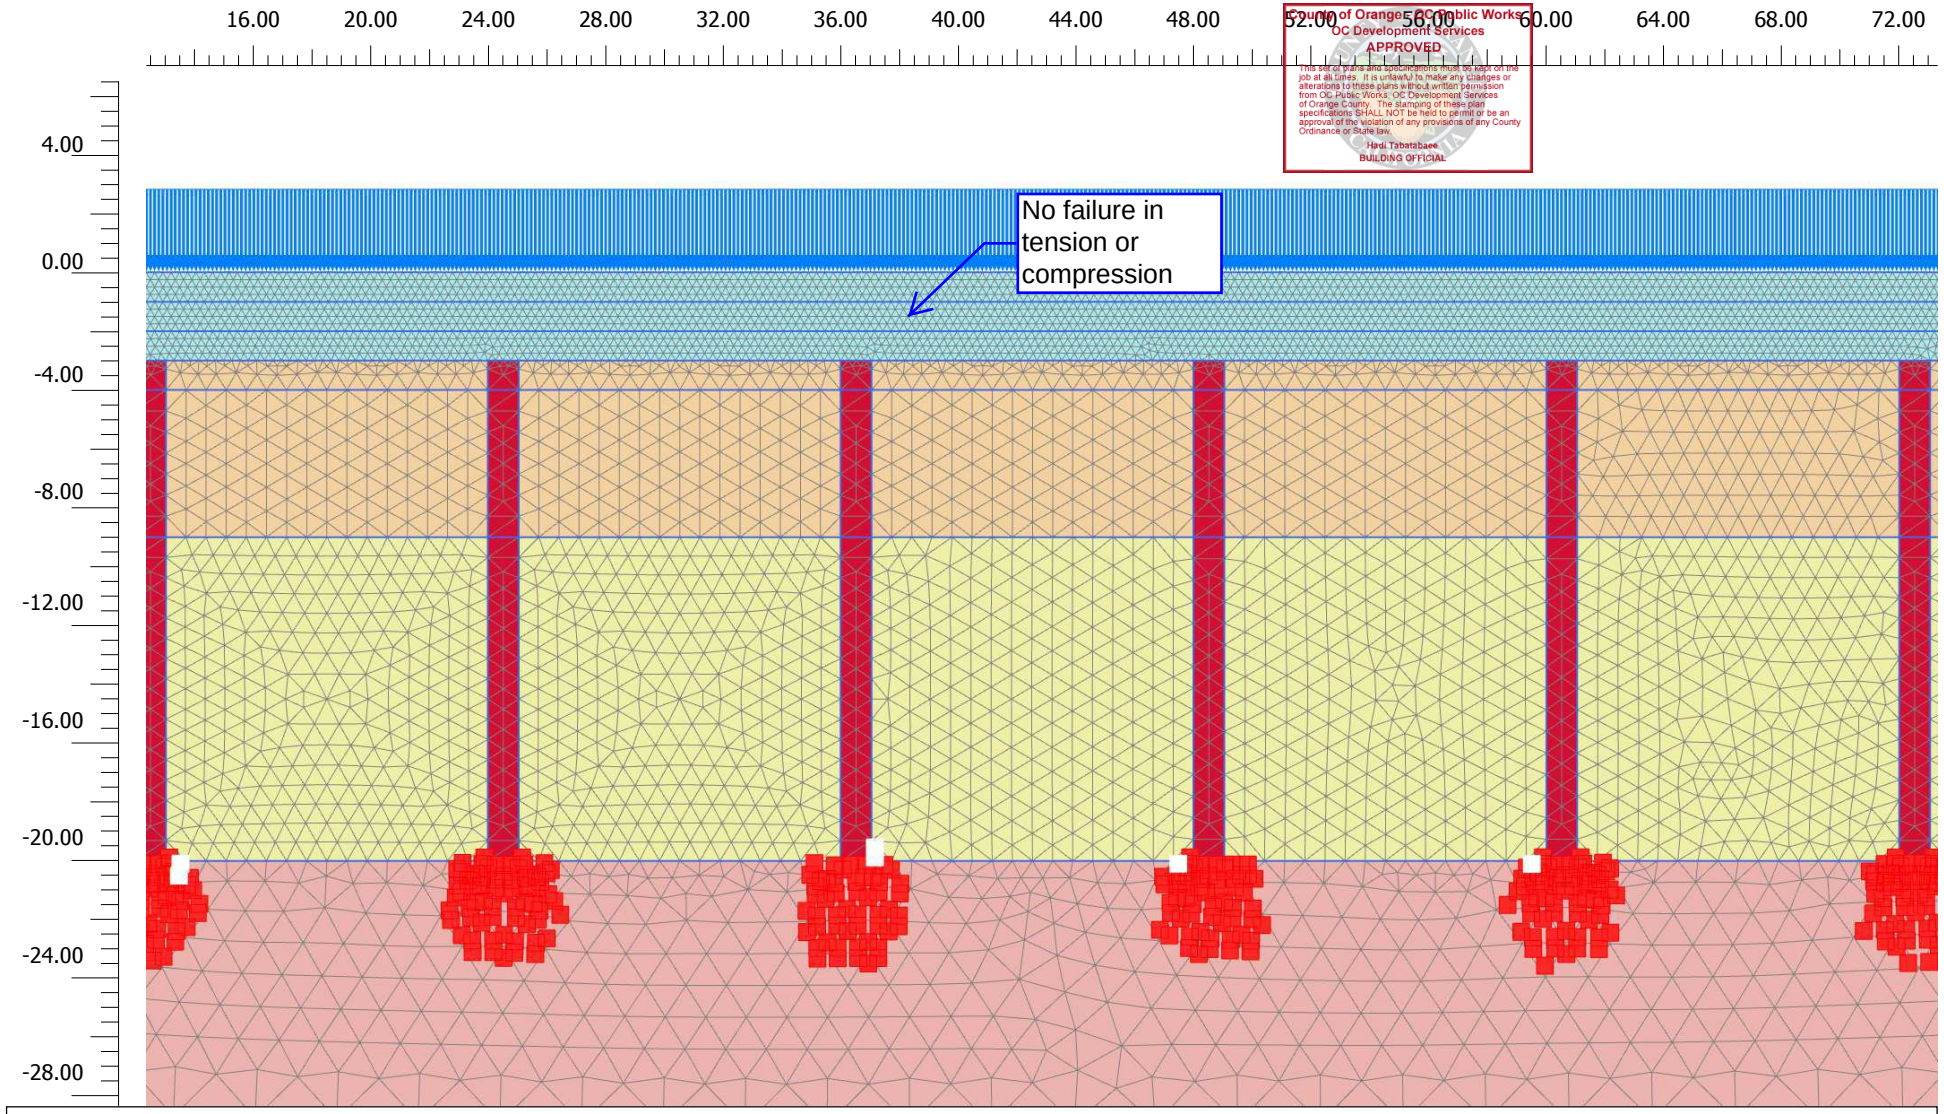

Plastic points (scaled up 0.00 times)

■Failure point ☐Tension cut-off point

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Static	*Step* 124	*Company* Advanced Geosolutions Inc (AGI)

LTP Model - Seismic Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Saadi Tabatabaee
BUILDING OFFICIAL

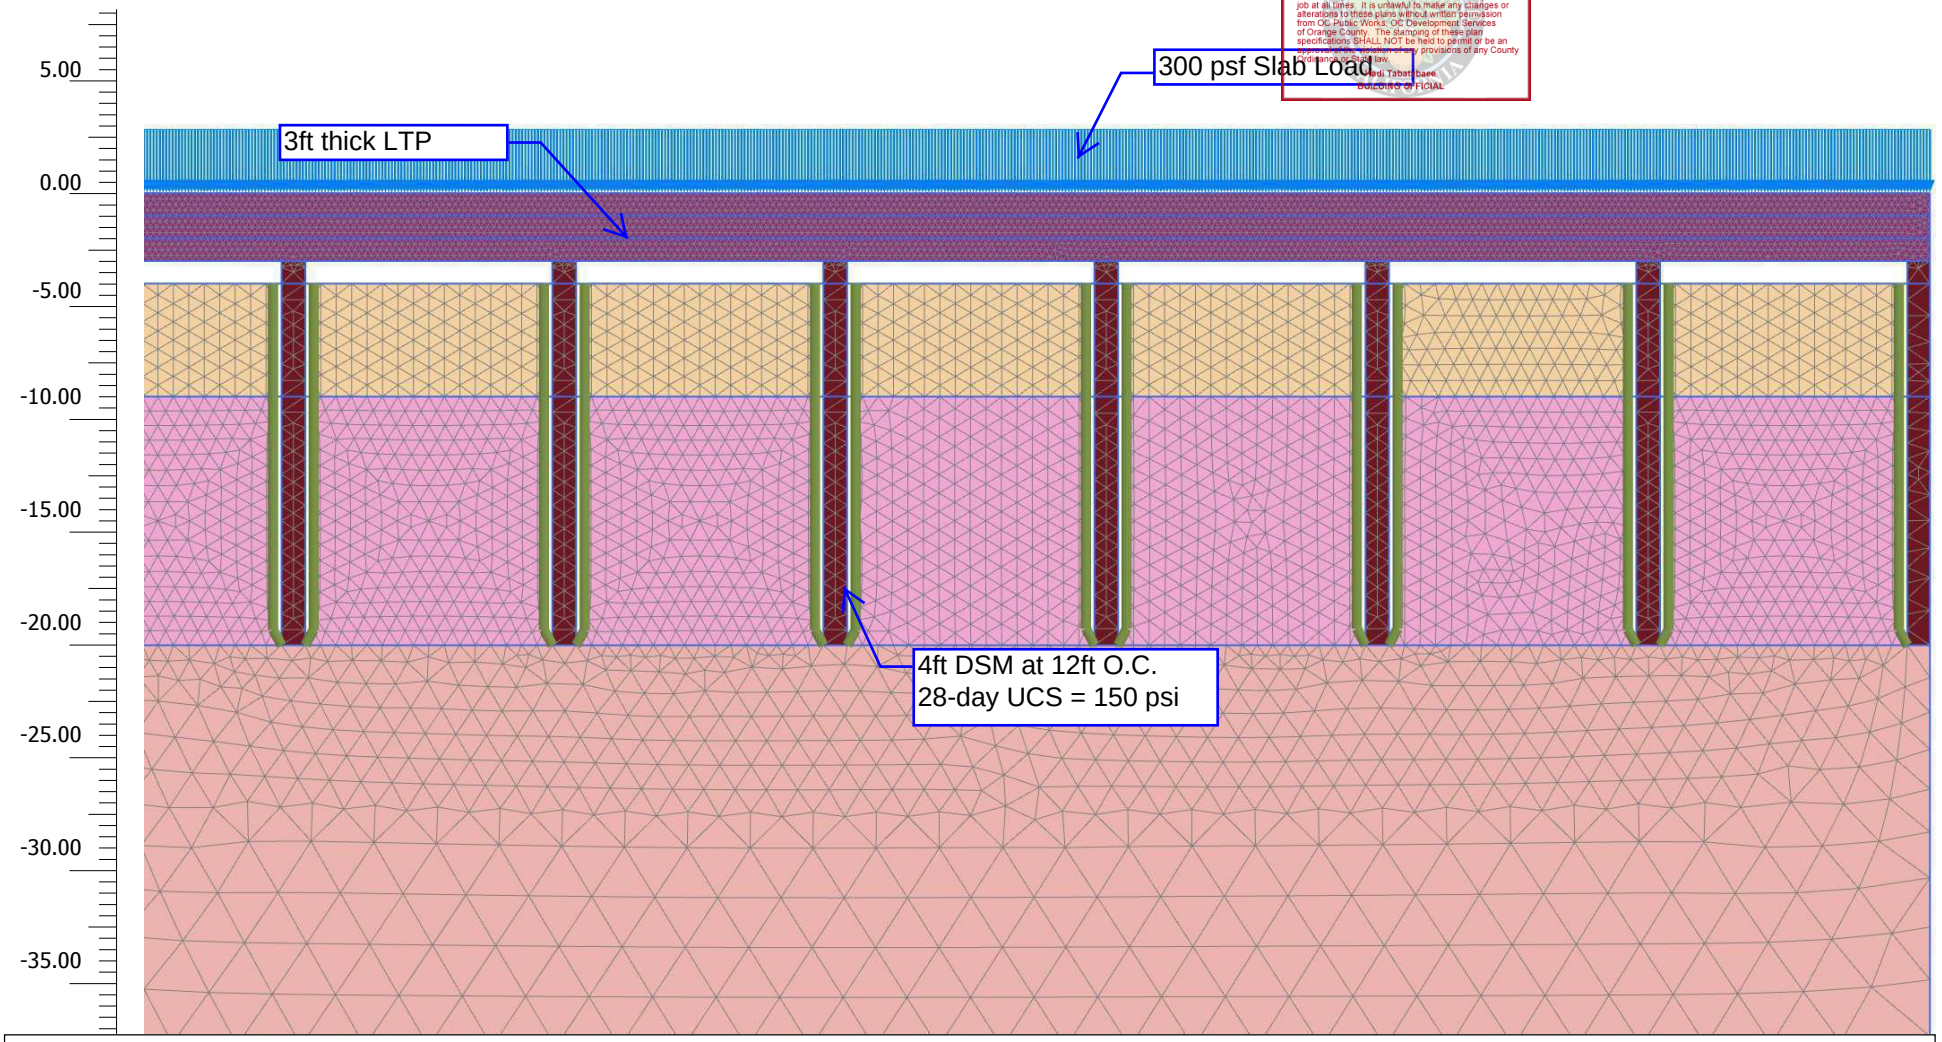

Connectivity plot

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Seismic	*Step* 192	*Company* Advanced Geosolutions Inc (AGI)

Deformation Contours - Seismic Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approval: Contact Information
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

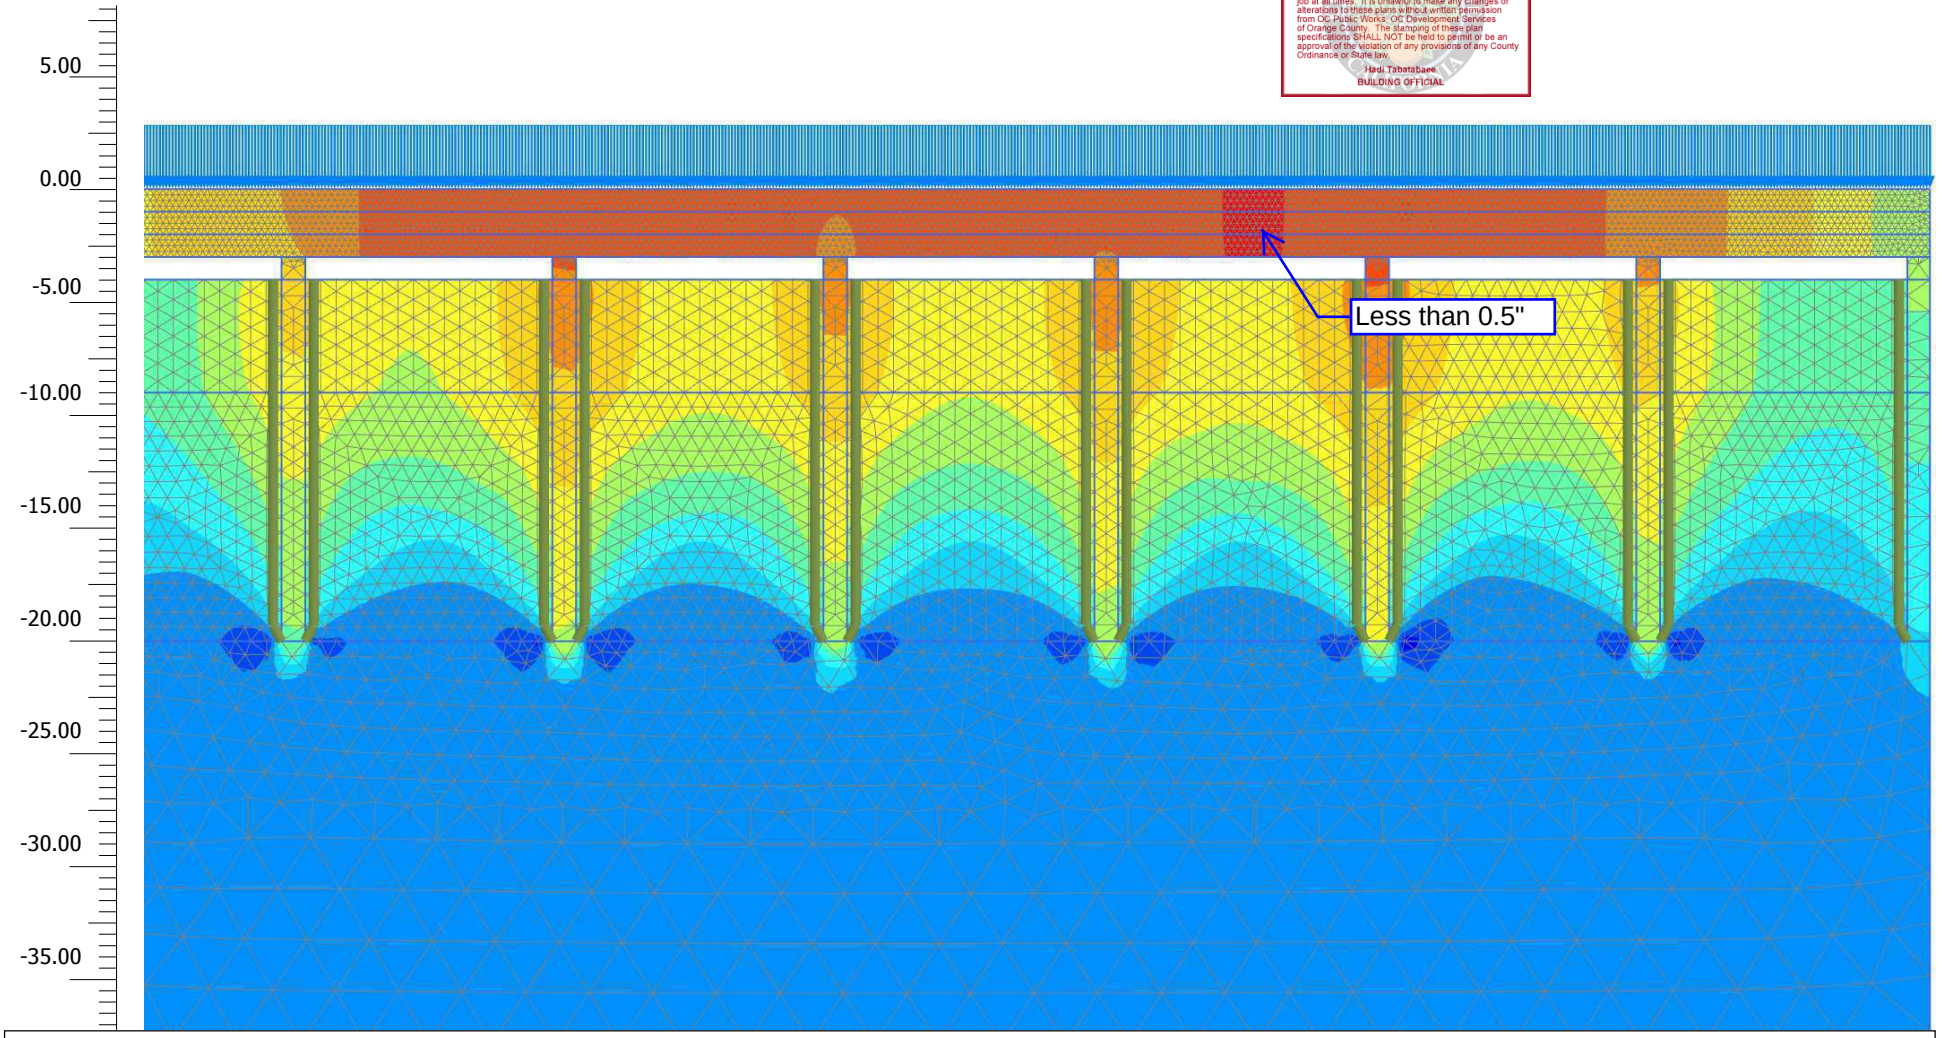

Total displacements u_y (scaled up 100 times)

Maximum value = $3.638*10^{-3}$ ft (Element 12726 at Node 22739)

Minimum value = -0.01813 ft (Element 385 at Node 18873)

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Seismic	*Step* 192	*Company* Advanced Geosolutions Inc (AGI)

Vertical Stress Contours - Seismic Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Geotechnical Geotechnical Report
Permits
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

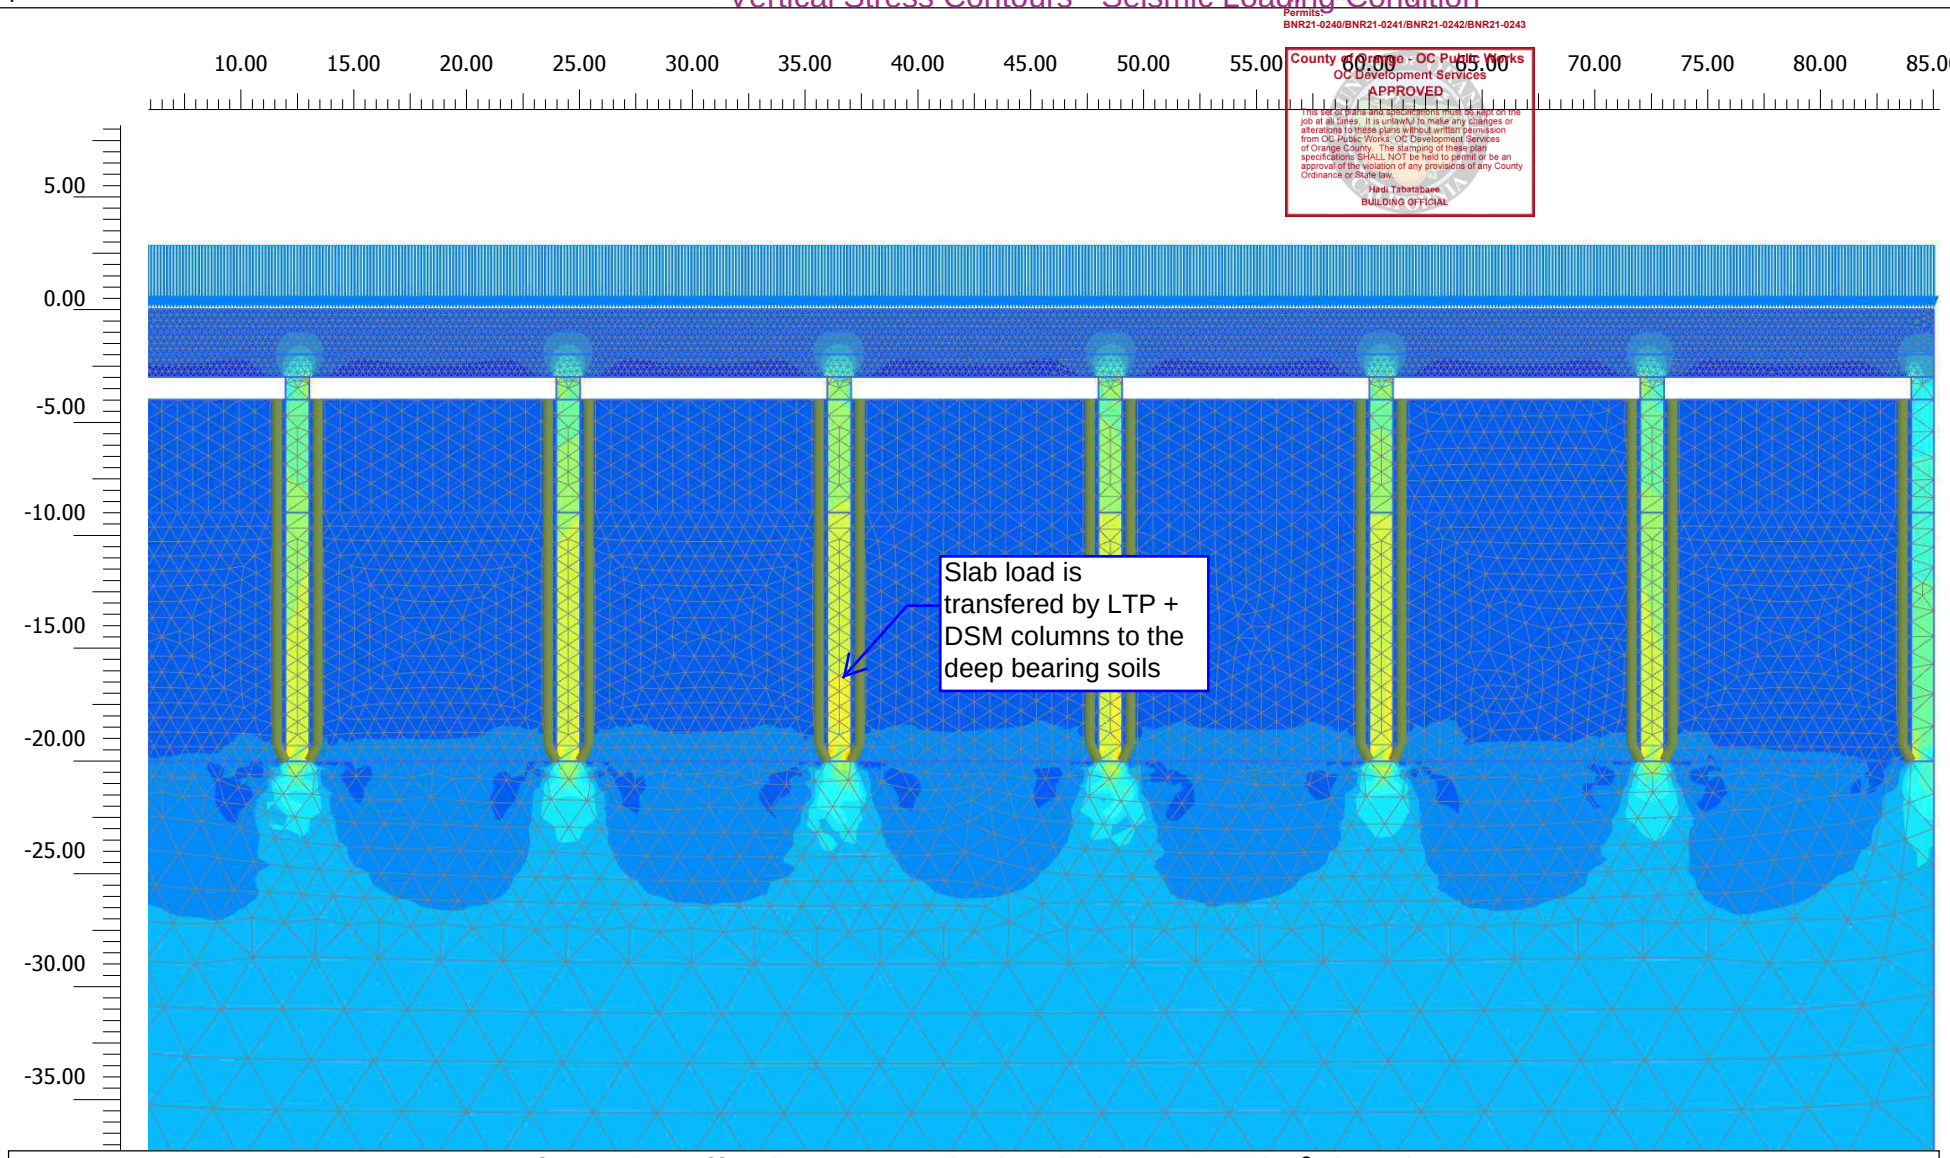

Cartesian effective stress σ'_{yy} (scaled up $0.200*10^{-3}$ times)

Maximum value = 1246 lbf/ft² (Element 6346 at Node 29371)

Minimum value = $-15.50*10^{3}$ lbf/ft² (Element 8067 at Node 27896)

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Seismic	*Step* 192	*Company* Advanced Geosolutions Inc (AGI)

Potential Failures within LTP - Seismic Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approved Deviations & Reports:
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

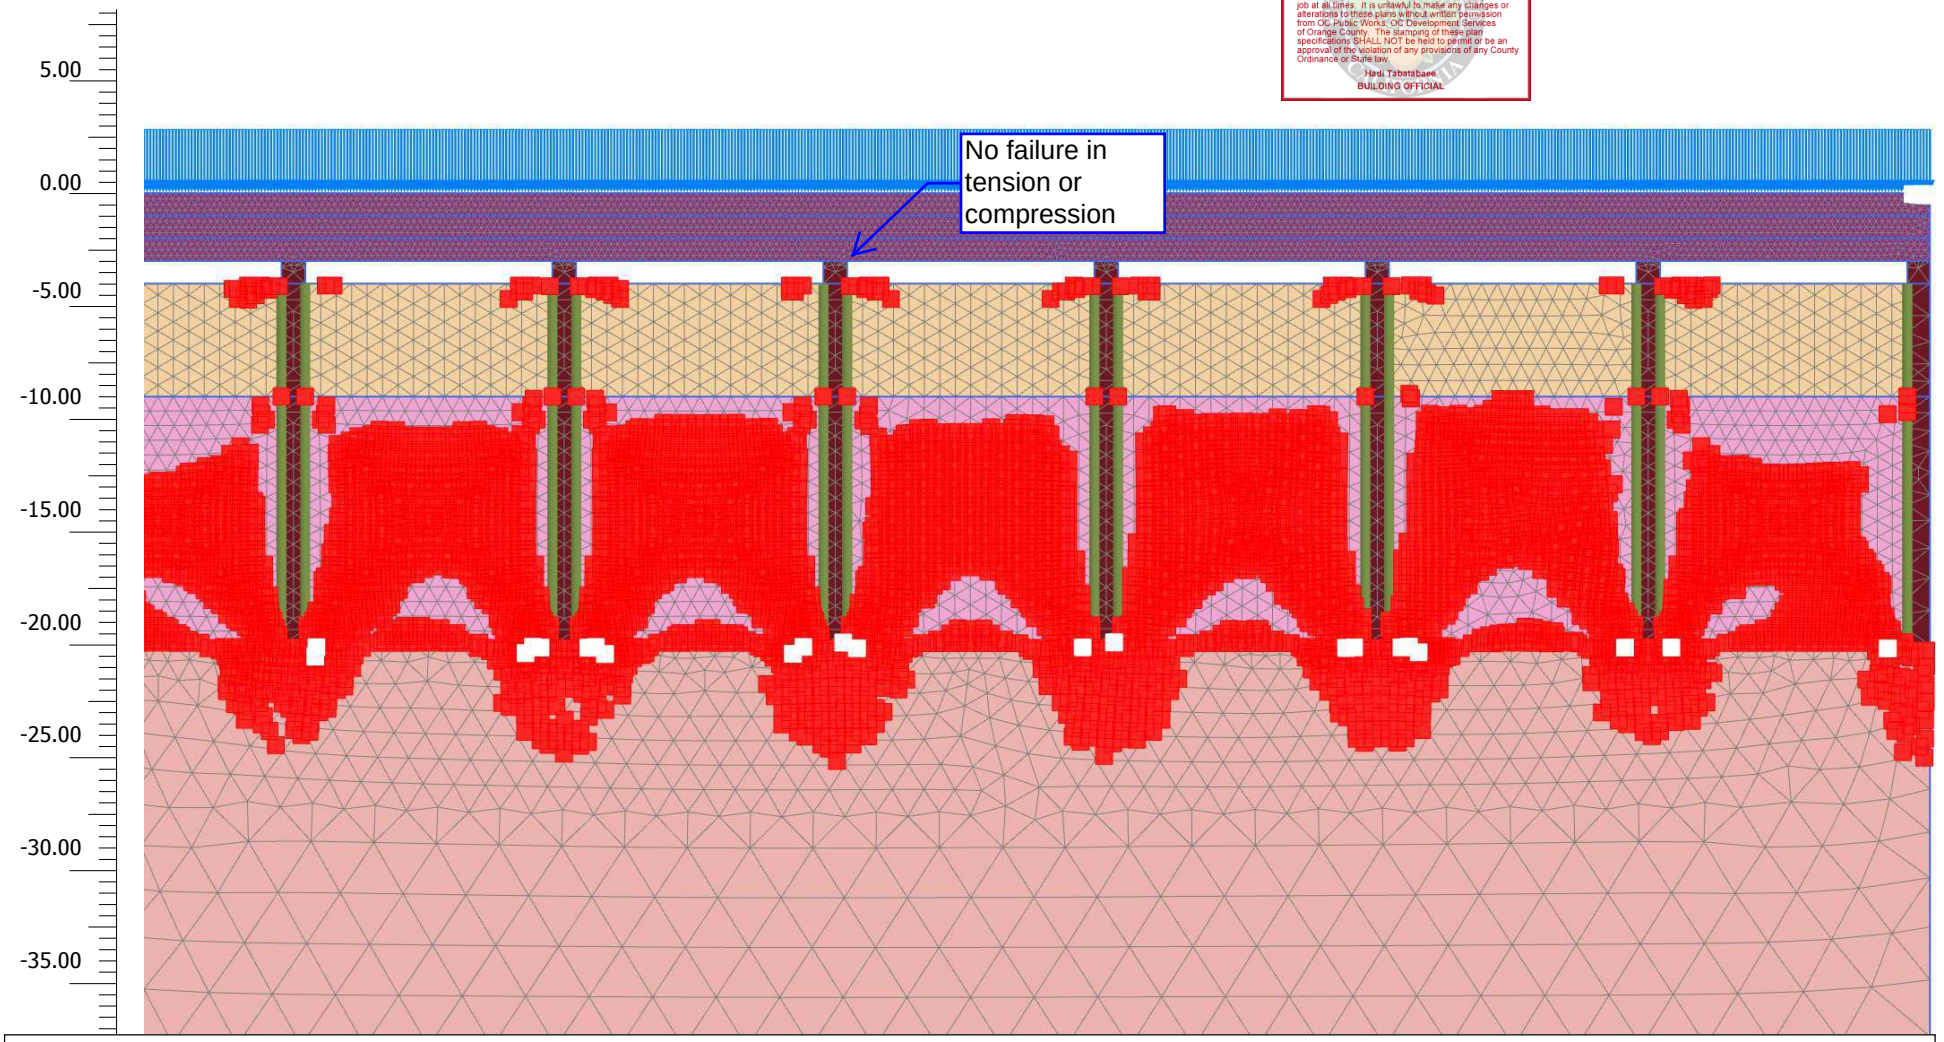

Plastic points (scaled up 0.00 times)

■Failure point ☐Tension cut-off point

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Seismic	*Step* 192	*Company* Advanced Geosolutions Inc (AGI)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX F

Revised GMU Plates 2 and 3

Authenticity Sign-Here 1787928
Approval: Geotechnical Reports
Review
#ffffc3b6d6b6f1-82e1-8b52-91e2-8b6f1-82e1-8b52-91e2-82e1-8b52-91e2-8b6f1-82e1-8b52-91e2-8b6f1-82e1-8b52-91e2-8b6f1

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSR1-0248/BMSR2-0241/BMSR1-0242/BMSR2-0243

County of Orange - OC Public Works
OC Development Services
Building & Safety Division
Use of this plan and/or permit is subject to all of the terms and conditions of the applicable permit and all applicable laws, regulations and ordinances of the County of Orange. Approval of this plan and/or permit by the County of Orange does not authorize the violation of any County ordinance or regulation. Approval of this plan and/or permit by the County of Orange shall not be construed to be a permit for, or an approval of, any violation of any provision of any County ordinance or regulation.
Reg. Dimension
Reg. Exp. 12/31/20

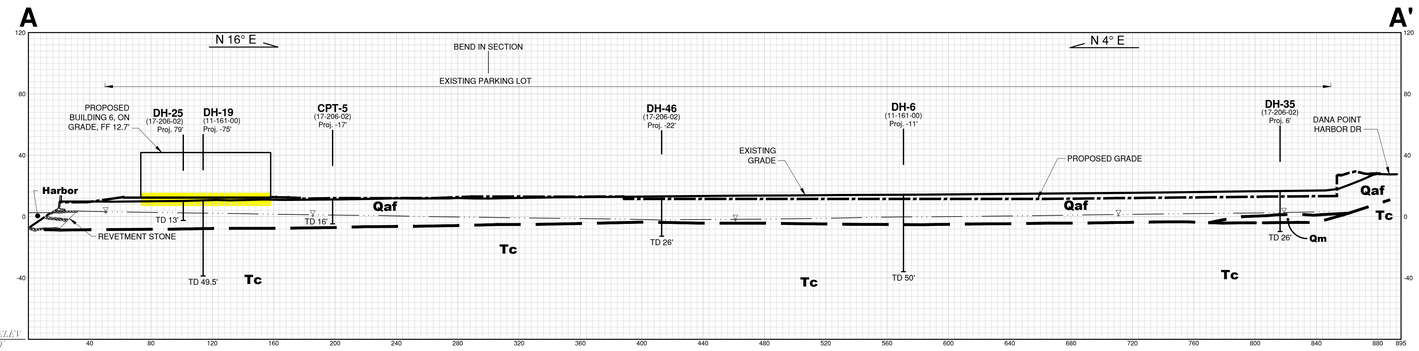

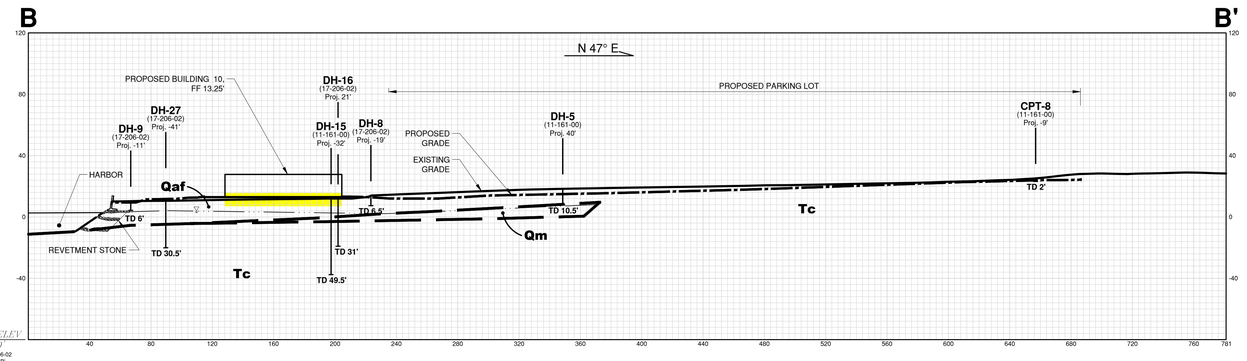

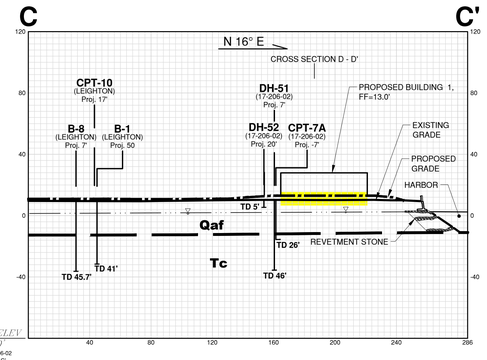

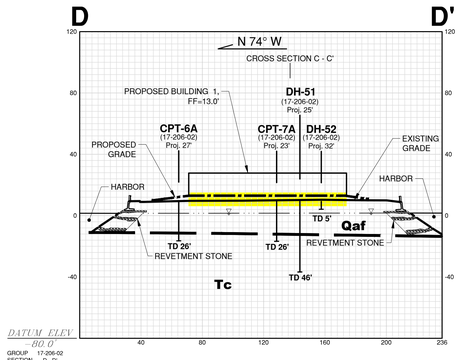

PROPOSED LTP LIMITS (EXTENDED TO EDGE OF BUILDING FOUNDATIONS ENVELOPE)

0 40' 80'

Geotechnical Sections
Commercial Buildings
Commercial Component Dana Point Harbor Partners, LLC.

GMU | Date: August 27, 2021 | Project No.: 17-206-02 | Plate 3

DRAWING: q:\2017\17-206-02\dwg\1720602_dph_commcor_plate 3_geo sections.dwg PLOTTED: 8/27/2021 5:06 PM BY: Jesus Meza

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX G

Additional AGI Stability/Lateral Spread Analyses

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee

SECTION AA'

1.006

Material Name	Color	Unit Weight (lbs/ ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Tensile Strength (psf)
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Automatically Calculated	0
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Automatically Calculated	0
Tc		125	Mohr-Coulomb	695	34			Water Surface	Automatically Calculated	
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Automatically Calculated	
Liquefied 1		125	Vertical Stress Ratio			0.17	0	Water Surface	Automatically Calculated	0
Liquefied 2		125	Vertical Stress Ratio			0.1	0	Water Surface	Automatically Calculated	0
Liquefied 3		125	Vertical Stress Ratio			0.5	0	Water Surface	Automatically Calculated	0
DSM		125	Mohr-Coulomb	7200	0			Water Surface	Automatically Calculated	

0.27

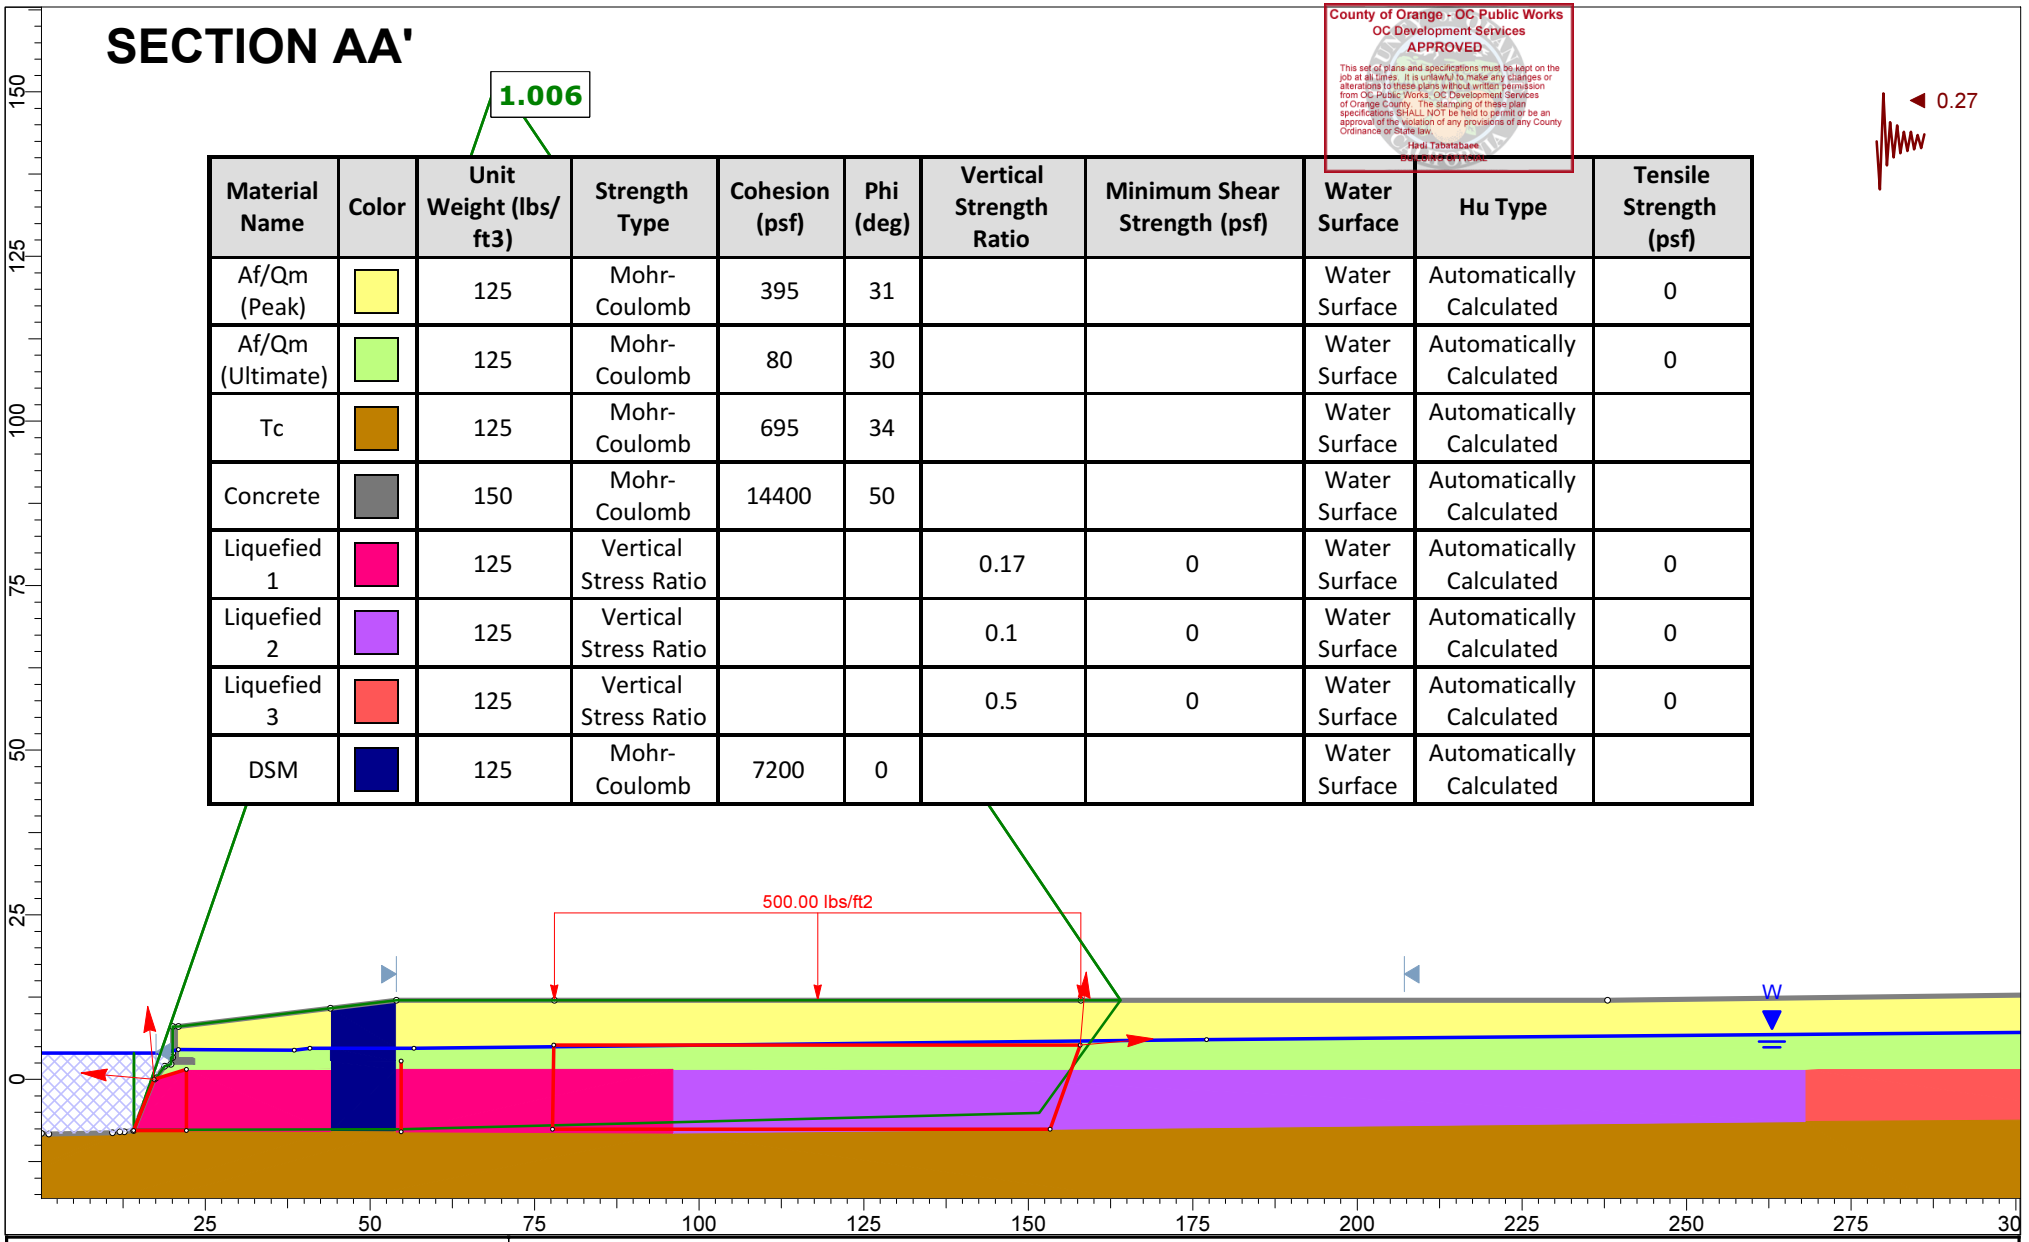

Project	Dana Point Harbor		
Group	DSM_10ft	Scenario	kh=0.26 Block Search
Drawn By	TT	Company	AGI
Date		File Name	Section_Arev.slmd

SLIDEINTERPRET 9.012

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED 1.013
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

SECTION CC'

Material Name	Color	Unit Weight (lbs/ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Hu
Liquefied 1		125	Vertical Stress Ratio			0.25	0	Water Surface	Custom	1
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Custom	1
Tc		125	Mohr-Coulomb	695	34			Water Surface	Custom	1
Liquefied 2		125	Vertical Stress Ratio			0.1	0	Water Surface	Custom	1
Liquefied 3		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Custom	1
DSM		125	Mohr-Coulomb	20000	0			Water Surface	Custom	1
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Custom	1

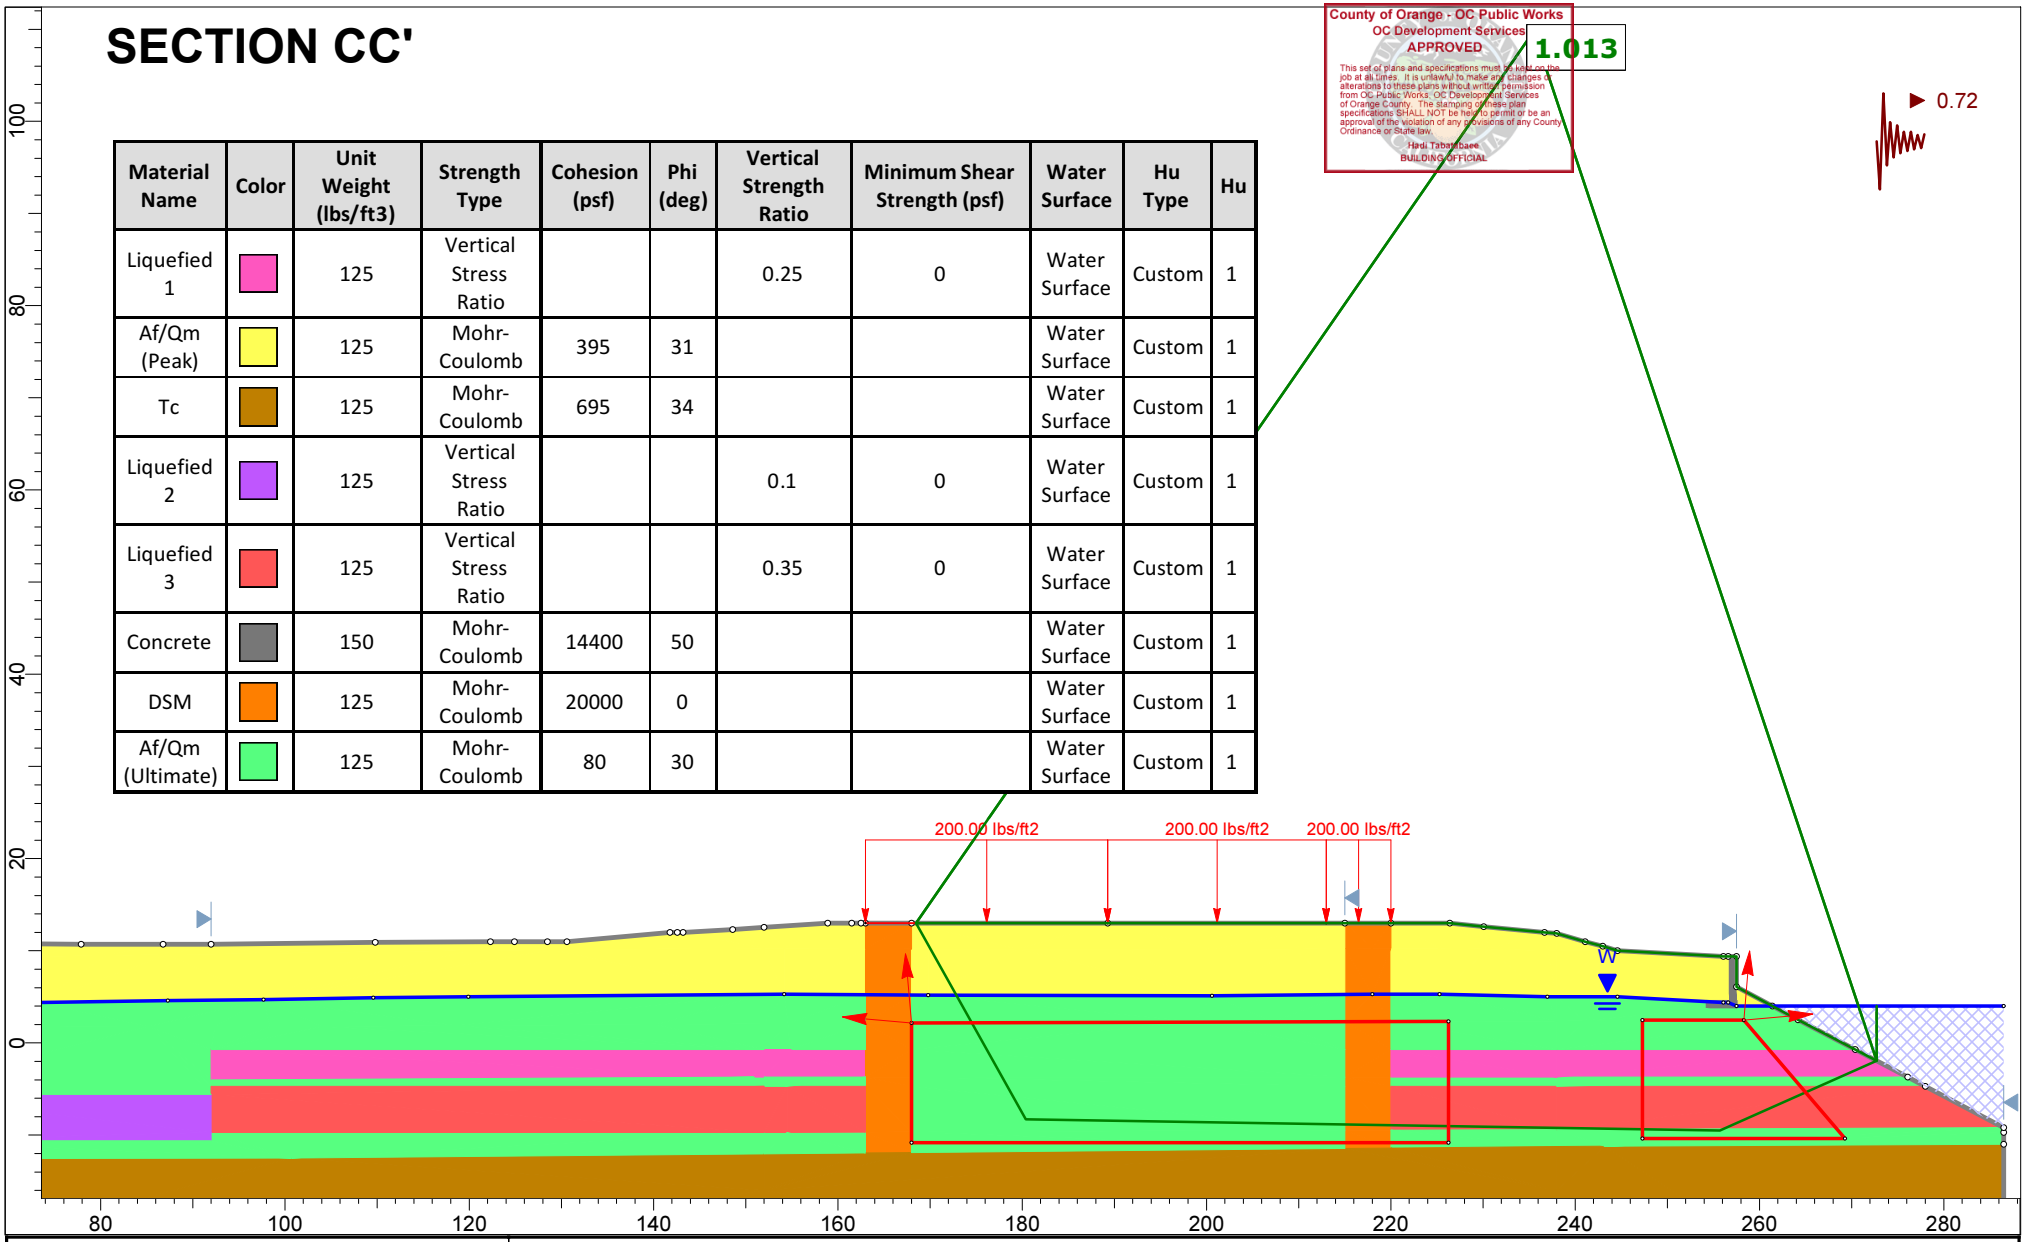

AGI™

SLIDEINTERPRET 9.012

Project	Dana Point Harbor		
Group	Group 1	*Scenario*	kh=0.78 Block Search
Drawn By	TT	*Company*	AGI
Date		*File Name*	Section_C.slmd

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
1074
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

SECTION DD'

▶ 0.49

Material Name	Color	Unit Weight (lbs/ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Hu
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Custom	1
Tc		125	Mohr-Coulomb	695	34			Water Surface	Custom	1
Liquefied 4		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1
Liquefied 2		125	Vertical Stress Ratio			0.55	0	Water Surface	Custom	1
Liquefied 3		125	Vertical Stress Ratio			0.3	0	Water Surface	Custom	1
Liquefied 5		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Custom	1
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Custom	1
DSM		125	Mohr-Coulomb	20000	0			Water Surface	Custom	1

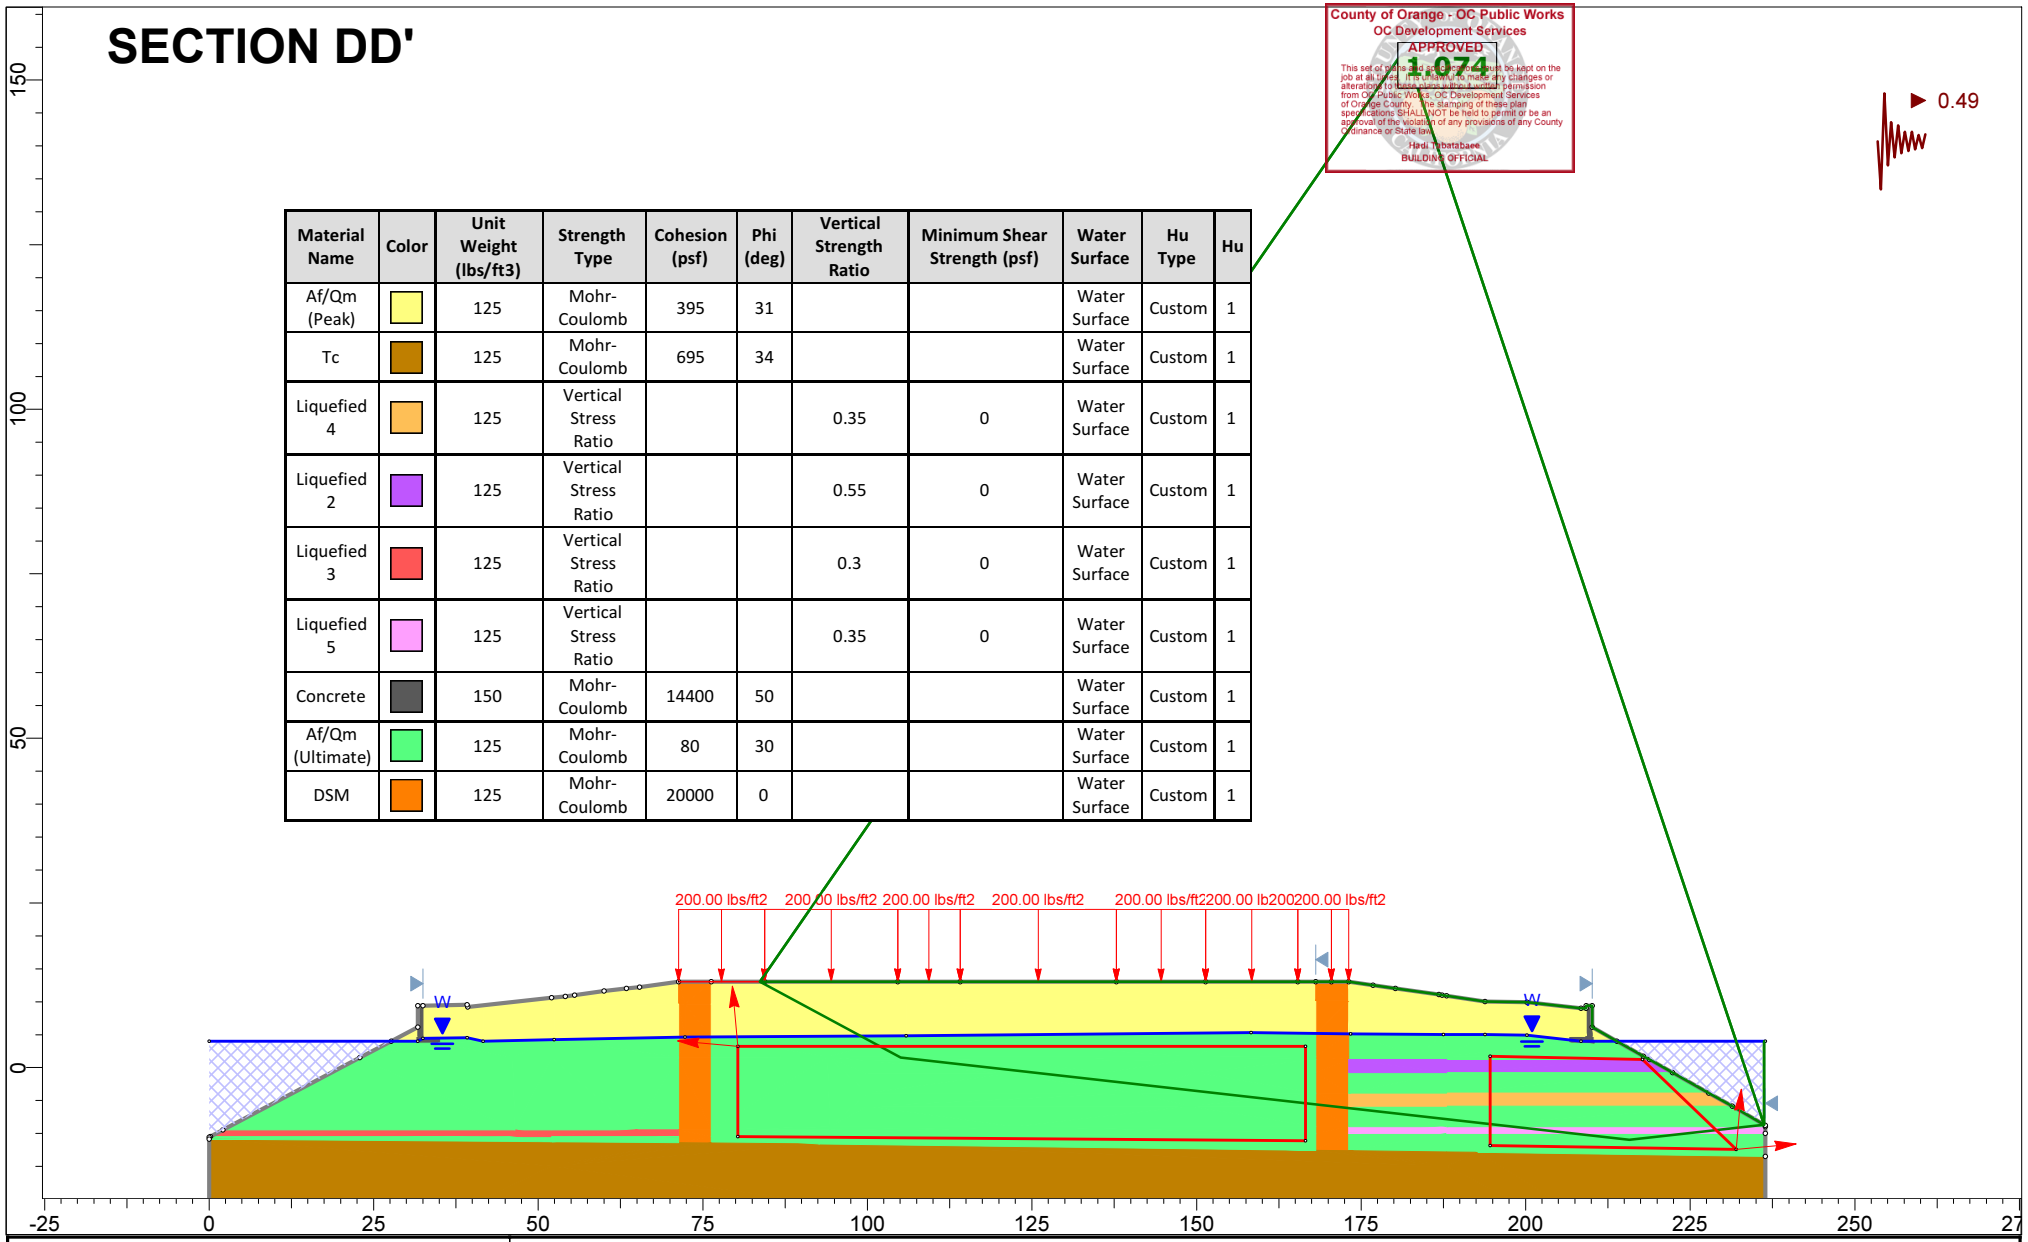

SLIDEINTERPRET 9.012

Project	Dana Point Harbor		
Group	Group 1	*Scenario*	kh=0.5 Block Search
Drawn By	TT	*Company*	AGI
Date	4/15/2021	*File Name*	Section_D.slmd

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation - Section A

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.27**	g
Correlated displacement in soils - West US region	d	**1.3**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation - Section C

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.72**	g
Correlated displacement in soils - West US region	d	**0.0**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation - Section A

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.49**	g
Correlated displacement in soils - West US region	d	**0.1**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

May 27, 2021

Mr. Bryon Ward, President
DANA POINT HARBOR PARTNERS, LLC
c/o BURNHAM-WARD PROPERTIES
1100 Newport Center Drive, Suite 200
Newport Beach, CA 92660

GMU Project 17-206-02

Subject: Geotechnical Review of AGI Deep Soil Mixing (DSM) Submittal, Dana Point Harbor Revitalization – Commercial Component, City of Dana Point, County of Orange, California

References:
(1) Deep Soil Mixing Design Submittal, Dana Point Harbor Commercial Core, City of Dana Point, County of Orange, California, prepared by Advanced GeoSolutions, Inc. (AGI), dated May 27, 2021 (AGI Reference: L19-1748).

(2) Our "Geotechnical Investigation Report, Volumes 1, 2, and 3, Dana Point Harbor Revitalization: Buildings 1 through 12 – Commercial Component, City of Dana Point, California," dated May 27, 2021 (GMU Project 17-206-02).

Dear Mr. Ward:

The purpose of this correspondence is to confirm in writing that GMU Geotechnical, Inc. (GMU) has performed a geotechnical review of the reference (1) Deep Soil Mixing (DSM) design submittal by Advanced GeoSolutions, Inc. (AGI) for the subject project. The AGI submittal is to support the foundation design of the proposed buttress and eight (8) new retail/office/surf museum/restaurant buildings (Buildings 1, and 6-12) for the commercial core. The subject site is bounded by Dana Point Harbor Drive, the planned realignment of Golden Lantern, and the new proposed parking structure and existing parking lot on the north, the existing boat launch ramp and Embarcadero Marina area on the east, the existing Casitas Place and the existing Marina Inn for the future Hotel component site on the west, and the existing sea wall and harbor on the south.

As is standard of practice, Quality Control (QC) for the Deep Soil Mix (DSM) installations will performed by both the DSM contractor and the Geotechnical Engineer of Record (GMU). The QC requirements to be completed by the contractor are contained on Sheet GI-2 contained in the attached reference (1) AGI plans under "General Notes and Details". Note VII under 3.4 Quality Control and Quality Assurance also refers to supplemental testing by the "engineer". This supplemental DSM QC testing will be performed full-time by one of GMU's Senior Engineering Technicians reporting directly to the Geotechnical Engineer-of-Record (GE) and includes:

- Observation, documentation, and verification of geotechnical conditions.
- Determination/verification that bedrock has been reached in the buttress and under each building to design penetration depth prescribed at each DSM location.
- Depth and diameter of each DSM.
- Verification and sampling of DSM installation per design.
- Observation and documentation of load testing.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

It should be further noted that all the above QC test results will be submitted to the GE of record at GMU for his review and acceptance from a geotechnical engineering perspective.

Based on our review, the attached reference (1) AGI Deep Soil Mixing design submittal has been prepared in general accordance with the parameters and recommendations presented in our reference (2) report. All the recommendations included herein, and in our reference (2) report, remain applicable to the site improvements; thus, the subject design submittal is acceptable from a geotechnical perspective.

Should you have any questions, please do not hesitate to contact us.

Respectfully submitted,

David R. Atkinson
Project Manager

Gregory Silver, M.Sc., PE, GE 2336
President / CEO
Principal Geotechnical Engineer

(Three (3) print copies and electronic copy)

Attachment:
AGI Deep Soil Mixing Design Submittal

cc: SMS Architects
Attn: Mr. Brandon Dedmon (electronic copy)

Tindall Consulting
Attn: Mr. John Tindall (electronic copy)

Westling and Associates
Attn: Mr. Josh Westling (electronic copy)

TAIT Engineering
Attn: Ms. Daniela Malott (electronic copy)

Advanced Geosolutions, Inc.
Attn: Mr. Justin Martos (electronic copy)

dra/17-206-02L Geotechnical Review of AGI Deep Soil Mixing Submittal for DPHP, LLC Commercial Component (5-27-21)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations on these plans without written permission from OC Public Works, OC Development Services, Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Advanced Geosolutions, Inc.
13 Orchard Road, Suite 105
Lake Forest, California 92630
P (310) 796-9000 F (310) 796-9001

May 27, 2021 AGI Ref: L19-1748

GMU Geotechnical, Inc.
Attn: Mr. David R. Atkinson
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688

Re: Deep Soil Mixing Design Submittal
Dana Point Harbor Commercial Core
City of Dana Point, County of Orange, California

Dear Mr. Atkinson:

In accordance with our Subconsulting Agreement, AGI is pleased to submit this design report and drawings for the deep soil mixing ground improvement at the Dana Point Harbor, Commercial Core project.

We are glad to be of service. Please contact us if you have any question regarding the attached document.

Sincerely,

ADVANCED GEOSOLUTIONS, Inc.

Justin Martos, P.E., G.E.
Project Manager

THOMAS TRAN

Thomas Tran, P.E.
Design Engineer

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

AGI
ADVANCED GEOSOLUTIONS INC
Ground Improvement and Specialty Piling Contractors

GROUND IMPROVEMENT BY DEEP SOIL MIXING

DANA POINT HARBOR COMMERCIAL COMPONENT
DANA POINT, CALIFORNIA

Submittal No. 01

DESIGN SUBMITTAL

May 27, 2021

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

1.0 INTRODUCTION

Advanced Geosolutions, Inc. (AGI) is pleased to present this design submittal package for deep soil mixing (DSM) at the planned redevelopment area located at the harbor in Dana Point, California. We understand the redevelopment involves the construction of new hotels, new commercial buildings and new marine facilities. The submittal herein addresses the design for the commercial area of this redevelopment.

The geotechnical report by GMU identifies medium dense to dense sandy artificial fill at the site down to a depth of approximately 20 feet below grade at the time of geotechnical exploration. They recommended ground improvement to mitigate excessive seismically induced lateral spreading at the project site. Ground improvement is also intended to mitigate uncertainty about the competence of the undocumented artificial fill soils and the potential associated risk with constructing structures overlying those materials. DSM was selected by the design team as the most appropriate ground improvement technique for this project based on the soil conditions, performance goals, efficiency, and site constraints.

Our design meets the performance criteria as described in the following sections. Concepts, calculations, means, and methods in this design are deemed intellectual property of AGI, and shall remain confidential. AGI's design, and any other related information, shall not be made available to another party other than the members of the design team without the express written consent of AGI. We anticipate that a set of construction drawings and specifications will be put out to bid but only the minimal set of documents required to bid the installation work should be distributed to bidders as approved by AGI.

2.0 REFERENCE DOCUMENTS AND INFORMATION

In preparing this design AGI relied on information provided by the design team, including:

- Geotechnical Investigation Report, Volumes 1, 2, and 3, Dana Point Harbor Revitalization: Buildings 1 through 12 – Commercial Component, City of Dana Point, California. Report no. 17-206-02 prepared by GMU and dated 5/27/2021.
- Site plan CAD file provided by GMU
- Foundation plan for building 1 prepared by KPFF dated 10/8/2020
- Foundation plans for buildings 6-9 prepared by KPFF dated 4/9/2021
- Foundation plans for building 10-12 prepared by KPFF dated 4/12/2021

3.0 DESIGN CRITERIA

Per the Geotech report's recommendation and discussion with the design team, the ground improvement shall be designed in consideration of the following performance criteria:

- Design earthquake Magnitude (Mw) = 6.9 and PGA = 0.67g

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- Reduce lateral spread movement to 3 inches or less behind the DSM buttress
- Ground improvement will directly support all footings with at least 5,000 psf allowable bearing pressure.
- Limit total static settlement to 1 inch or less.
- Reduce total seismic settlement to 0.5 inch or less.
- Building slab-on-grade areas require improvement or support to mitigate potential poor performance of undocumented fill materials.

4.0 CEMENT DEEP SOIL MIXING (DSM) DESIGN

The proposed DSM layout is presented in Appendix A. The DSM program includes two components: (1) DSM buttress along the waterfront, between the existing seawall and the proposed building, and (2) discrete DSM columns under the proposed buildings to support structural loads with a soil-cement load transfer platform (LTP) to distribute slab loading to the DSM columns.

The buttress is 12 feet wide and consists of overlapping 6-ft diameter DSM with a continuous front row. The columns will embed 4 feet into the Capistrano formation.

The DSM system supporting Buildings 6 through 12 consists of 4-ft diameter columns centered under all footings. In addition, the same 4-ft diameter columns are installed in a 12-ft grid pattern throughout slab-on-grade areas in building interiors. The 4-ft diameter DSM columns for building support will extend to practical refusal to rest on competent bedrock materials.

The DSM design unconfined compressive strength (UCS) is 150 psi at 28 days.

4.1 Lateral Spread

AGI performed a pseudostatic slope stability analysis in order to determine the post-improvement critical horizontal seismic coefficient (also called yield acceleration, k_y), which is a necessary input value to estimate lateral slope deformation. The analysis is presented in Appendix B1. The slope geometry and soils parameters used in the model were provided by GMU.

For section A, the composite shear strength of the DSM buttress was calculated based on the area replacement ratio (ARR), and this calculation is shown in Appendix B2. For sections C and D, the DSM block is modeled as a 5-ft wide (effective width) zone with 100% ARR on the perimeter of Building 1, while the soils inside the block is assigned unimproved strength without liquefaction.

AGI estimated lateral spread deformation using the empirical equations outlined in NCHRP Report 611 (2008), and the calculation is shown in Appendix B3. The results are summarized in Table 1 below.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Table 1. Estimated Post-improvement Slope Deformation

Section	Ky from pseudostatic analysis	Estimated Slope deformation (inch)
Section A	0.26g	1.4
Section C	0.78g	0.0
Section D	0.49g	0.1

AGI performed all applicable internal stability checks of the buttress in accordance with FHWA guidelines. Those checks included bearing capacity, overturning, crushing at the toe, racking, and internal shear failures. The analysis is included in appendix B4.

4.2 Building Support

The structural capacity and geotechnical capacity calculation are included in Appendix C1 and C2, respectively. The analysis results indicate that the allowable load on a 4-ft diameter DSM column bearing on bedrock is 200 kips.

Building loading information was not provided with the structural drawings but we understand the footings were sized for 5,000 psf. Therefore the required number of DSM column supporting each footing was determined by taking the footing area, multiply by 5.0 ksf, and divide by 200 kips.

4.3 Static Settlement

Since the DSM columns will bear directly on formation material, the main source of static settlement is the elastic compression of the soil cement. This was calculated using the software RSPile by Rocscience. The calculation is shown in Appendix C3. The elastic modulus of DSM material was selected based on FHWA's recommended correlation (300 times design compressive strength).

The result indicates static settlement of the DSM column under design load is approximately 0.5 inch.

4.4 Seismic Settlement

The DSM columns transfer building loads to bedrock, but it does not densify the surrounding soils. When the soils liquefy after an earthquake, it would induce downdrag forces on the DSM columns which causes additional compression and settlement.

AGI estimated the magnitude of liquefaction-induced downdrag and column compression using method for piles, as outlined in the AASHTO Bridge Design Manual. This calculation is shown in Appendix D, which shows that downdrag force is approximately 128 kips for a 4-ft diameter

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

column. And the corresponding seismic settlement due to DSM column compression is less than 0.1 inch.

The structural capacity and geotechnical capacity checks of Appendices C1 and C2 also ensure that the DSM column can resist this downdrag load in addition to the building design load.

5.0 DSM INSTALLATION METHOD

Cement Deep Soil Mixing is performed using a specialty, purpose-built drilling tool consisting of a series of mixing blades and/or paddles extending radially from a hollow stem. In general, as the mixing tool is advanced into the soil, the hollow stem is used as a conduit to pump grout slurry (a mixture of cement and water) and injected at the tip of the tool while blending the soils. Pre-augering or trenching operations may be used to facilitate mechanical breakdown and blending of firm or stiff soils, or to remove the upper strata before DSM operations, or to assist with spoil control. The resulting DSM product is an improved soil-cement column with low compressibility, high stiffness, and significant load carrying capacity. Typical DSM equipment and mixing tools are shown below in Figure 1.

Grout will be batched on site using an in-line jet valve or weight control system. We anticipate that cement and water will be the only components for the grout slurry. Water and/or cement component quantities are adjusted to achieve the target specific gravity prior to pumping it to the mixing drill rig. The batch plant and pump are expected to be located in an area to avoid relocating the facility during the entire DSM operation.

Figure 1. DSM mixing tool assembly (left) and track-mounted drilling rig constructing a DSM column (right)

6.0 LOAD TRANSFER PLATFORM (LTP)

As described above the design includes a LTP consisting of cement-treated soils at the ground surface. The LTP will be constructed in three 12-inch-thick lifts for a three-foot-thick section of

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

soil cement to a design strength of 200 psi at 28 days. LTP will be constructed after completion of the DSM scope placing the lifts over the top of the DSM columns throughout the structural footprints of the buildings. The LTP is designed to transfer load from the floor slab to the regularly spaced DSM columns at 12 feet on-center. See Geotechnical Report for other requirements.

We have assumed slab loading (Dead plus live) of 300 psf for this design. The performance of the LTP under load was analyzed using 2D plane strain finite element in PLAXIS, which is presented in Appendix E. The analysis demonstrates that the specified LTP will provide satisfactory performance under 300 psf floor load. The design also conservatively assumes that the artificial soils underlying the LTP may settle and accounts for the potential that a gap may form below the bottom of the LTP and the underlying soil such that no support is provided other than by the DSM columns.

7.0 DEEP SOIL MIXING QUALITY ASSURANCE / QUALITY CONTROL (QA/QC)

Quality Control / Quality Assurance will be performed in accordance with the DSM specifications as outlined on the approved drawings.

8.0 LOAD TRANSFER PLATFORM QUALITY CONTROL

LTP Quality Control will be performed in accordance with the Geotechnical Report's recommendations.

9.0 CONCLUDING REMARKS

This ground improvement preliminary design is submitted to address the geotechnical concerns of the proposed buildings. The design uses DSM ground improvement technique to meet the project requirements provided to AGI.

The layout of our ground improvement program is presented in AGI's shop drawing (Appendix A). Relevant strength parameters of the design will be verified by the UCS results.

This design was conducted in a manner consistent with the level of care and skill ordinarily exercised by members of the geotechnical engineering profession currently practicing under similar conditions and in the same locality. No warranty is made nor implied.

We appreciate the opportunity to provide our services for this project. Please contact the undersigned with any questions regarding this document.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Sincerely,

ADVANCED GEOSOLUTIONS, Inc.

Justin Martos, P.E., G.E.
Project Manager

Thomas Tran, P.E.
Design Engineer

REGISTERED PROFESSIONAL ENGINEER
THOMAS TRAN
C 91763
CIVIL
STATE OF CALIFORNIA

---- 0 ----

References

FHWA (2013) “Federal Highway Administration Design Manual: Deep Mixing for Embankment and Foundation Support”. Publication No. FHWA-HRT-13-046. U.S. Department of Transportation, Federal Highway Administration

Kitazume, M. and Terashi, M. "The Deep Mixing Method", CRC Press 2013.

Lunne, T., Robertson, P.K., and Powellm J.J.M. (1997) “Cone Penetration Testing in Geotechnical Practice”

NCHRP (2008) Report 611 “Seismic Analysis and Design of Retaining Walls, Buried Structures, Slopes, and Embankments”. Transportation Research Board

Rayamajhi,D., Nguyen, T., Ashford, S., Boulanger, R., Lu, J., Elgamal, and Shao, L. (2014). ” Numerical Study of Shear Stress Distribution for Discrete Columns in Liquefiable Soils.” J. Geotech. Geoenviron. Eng., 140, 2014.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A

Layout Drawings

Building&Safety: Ryan Rose 1/19/2020
Approved: Geotechnical Reports
Permits:
BWDV-2019050521-02413MWD1-02429MWD1-0243

County of Orange OC Public Works
OC Development Services
APPROVED
This approval is limited to the extent of the work described on the approved plans. Approval of this document does not authorize any violation of State or local laws. By issuing this approval, the County of Orange assumes no responsibility for any omissions or errors that may exist. Approval of this document does not relieve the applicant of responsibility to comply with all applicable laws, ordinances, regulations, and codes.
Troy Danielson
Inspection Services

DANA POINT HARBOR
COMMERCIAL COMPONENT
DEEP SOIL MIXING
DANA POINT, CALIFORNIA

SHEET INDEX

GI-1	COVER SHEET
GI-2	GENERAL NOTES AND DETAILS
GI-3	DEEP SOIL MIXING PLAN
GI-4.1	DEEP SOIL MIXING LAYOUT – BUILDING 1
GI-4.2	DEEP SOIL MIXING LAYOUT – BUILDING 6
GI-4.3	DEEP SOIL MIXING LAYOUT – BUILDING 7
GI-4.4	DEEP SOIL MIXING LAYOUT – BUILDING 8
GI-4.5	DEEP SOIL MIXING LAYOUT – BUILDING 9
GI-4.6	DEEP SOIL MIXING LAYOUT – BUILDING 10
GI-4.7	DEEP SOIL MIXING LAYOUT – BUILDING 11
GI-4.8	DEEP SOIL MIXING LAYOUT – BUILDING 12
GI-5	GEOTECHNICAL SECTIONS

GROUND IMPROVEMENT DESGINER:	ADVANCED GEOSOLUTIONS, INC.
CIVIL ENGINEER:	TAIT & ASSOCIATES, INC.
STRUCTURAL ENGINEER:	KPFF
GEOTECHNICAL ENGINEER:	GMU GEOTECHNICAL, INC.

VICINITY MAP

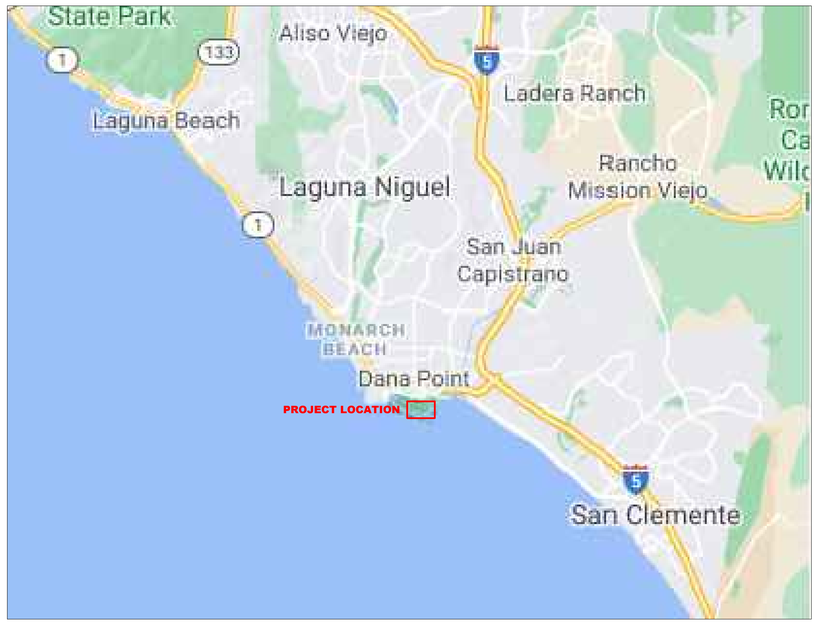

MAP DATA: GOOGLE 2020

LOCATION MAP

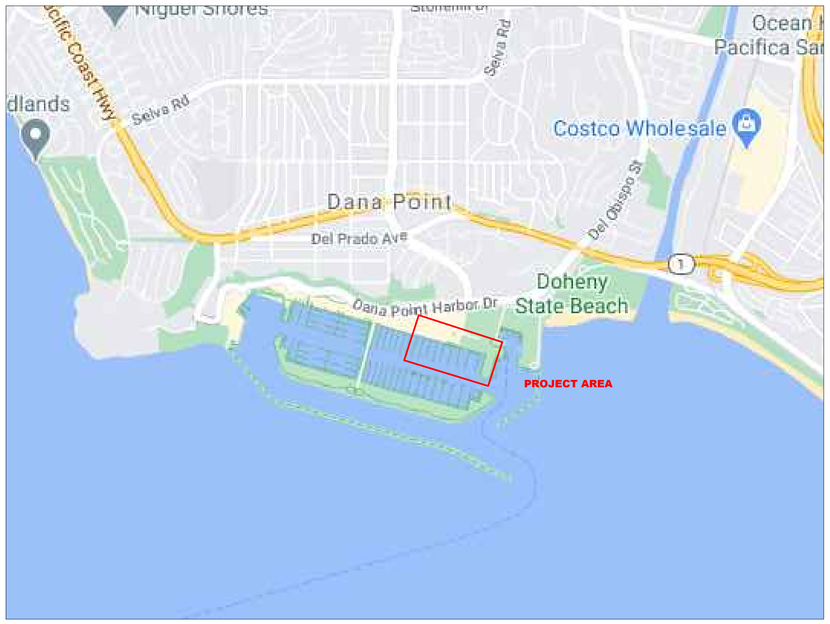

MAP DATA: GOOGLE 2020

AGI
ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TAIT C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

COVER SHEET

PROJECT NO.	–
DATE:	05/27/2021
SCALE:	AS SHOWN

SHEET NUMBER:

GI-1

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building Entity: Ryan Ross 1/18/2020
Approval: Geotechnical Reports
Permits:
SHA01-0248SHA01-0241SHA01-0242SHA01-0243

County of Orange - OC Public Works
OC Construction Services
APPROVED
Date: 1/18/2020
This approval is limited to the items listed on the approval letter and does not include any other work. By this approval the County of Orange does not authorize the violation of any law, ordinance, regulation or restriction which prohibits the use or occupancy of property for the purpose proposed. This approval does not prevent the County of Orange from requiring the correction of errors in the plans or from preventing operations being carried on thereunder when in violation of law or ordinance or in violation of the provisions of any permit granted.
Troy Donahue
Inspection Supervisor

PART 1 – GENERAL

1.1 SCOPE

A. DEEP SOILS MIXING (DSM) SHALL BE INSTALLED TO MITIGATE POTENTIAL FOR LATERAL SPREADING AND UNCERTAIN PERFORMANCE OF UNDOCUMENTED ARTIFICIAL FILL.

B. A LOAD TRANSFER PLATFORM (LTP) SHALL BE CONSTRUCTED THROUGHOUT ALL BUILDING FOOTPRINTS TO TRANSFER FLOOR SLAB LOADING TO UNDERLYING DSM COLUMNS AND PREVENT ADVERSE SETTLEMENT IN FLOOR SLAB AREAS THAT MAY RESULT FROM NEW LOADING APPLIED TO UNDERLYING UNDOCUMENTED ARTIFICIAL FILL.

C. THE DSM PLAN IS PREPARED IN ACCORDANCE WITH THE RECOMMENDATIONS OUTLINED IN THE GEOTECHNICAL REPORT PREPARED BY GMU DATED 5/27/2021.

D. THIS DESIGN IS BASED ON THE GEOTECHNICAL CHARACTERIZATION AND SOIL PARAMETERS PRESENTED IN THE REFERENCED GEOTECHNICAL REPORT, AS WELL AS LOAD REQUIREMENTS INDICATED ON THE STRUCTURAL DRAWINGS. THIS DESIGN WAS CONDUCTED IN A MANNER CONSISTENT WITH THE LEVEL OF CARE AND SKILL ORDINARILY EXERCISED BY MEMBERS OF THE GEOTECHNICAL ENGINEERING PROFESSION CURRENTLY PRACTICING UNDER SIMILAR CONDITIONS AND IN THE SAME LOCALITY. NO WARRANTY IS MADE NOR IMPLIED.

1.2 REFERENCES

A. GEOTECHNICAL INVESTIGATION REPORT, VOLUMES 1, 2, AND 3, DANA POINT HARBOR REVITALIZATION BUILDINGS 1 THROUGH 12, COMMERCIAL COMPONENT – REPORT NO. 17-206-02 PREPARED BY GMU DATED MAY 27, 2021.

B. ASTM C150 – SPECIFICATION FOR PORTLAND CEMENT

C. ASTM D1633 – STANDARD TEST METHODS FOR COMPRESSIVE STRENGTH OF MOLDED SOIL–CEMENT CYLINDERS

D. ASTM D4380 – DENSITY OF BENTONITE SLURRIES

F. FEDERAL HIGHWAY ADMINISTRATION DESIGN MANUAL: DEEP MIXING FOR EMBANKMENT, AND FOUNDATION SUPPORT, PUBLICATION NO. FHWA-HRT-13-046, OCTOBER 2013.

1.3 DEFINITIONS

A. DEEP SOIL MIXING (DSM) – A SOIL IMPROVEMENT TECHNIQUE USED TO CONSTRUCT IN SITU SOIL STRUCTURES OR TREAT SOILS IN PLACE, WITHOUT EXCAVATION OR DEWATERING. SOIL MIXING USES A LARGE, CRANE OR DRILL RIG – MOUNTED TURNTABLE TO INSERT A LARGE–DIAMETER (TYPICALLY 3– TO 8 –FOOT DIAMETER) TOOL INTO THE GROUND WHILE INJECTING AND MIXING A GROUT WITH THE SOIL. STABILIZED SOIL COLUMNS ARE CREATED THAT MAY BE JOINED TOGETHER BY OVERLAPPING TO FORM RETAINING WALLS OR FOUNDATION ELEMENTS, OR TO TREAT A LARGE BLOCK OF SOIL OR SLUDGE.

B. ASTM – ASTM INTERNATIONAL.

C. OWNER – THE OWNER AS REFERRED TO HEREIN IS DANA POINT HARBOR PARTNERS, LLC, C/O BURNHAM–WARD PROPERTIES.

D. ENGINEER – THE ENGINEER IS THE OWNER'S GEOTECHNICAL ENGINEER OF RECORD TO ACT ON ITS BEHALF IN THE EXECUTION OF THESE SPECIFICATIONS.

E. CONTRACTOR – REFERS TO THE GENERAL CONTRACTOR DIRECTLY CONTRACTED WITH THE OWNER AND SUBCONTRACTING THE DSM SCOPE TO THE DSM SUBCONTRACTOR.

F. DEEP SOIL MIXING SUBCONTRACTOR (DSM SUBCONTRACTOR) – AN INDIVIDUAL OR COMPANY WHO HAS HAD PROVEN AND SUCCESSFUL EXPERIENCE IN SOIL MIXING CONSTRUCTION.

G. GROUT – A STABLE COLLOIDAL SUSPENSION OF POWDERED CEMENT, BENTONITE, ADDITIVES AND/OR OTHER SIMILAR MATERIALS IN WATER. THE TERMS "GROUT" AND "SLURRY" ARE USED INTERCHANGEABLY IN THESE SPECIFICATIONS.

H. INJECTION RATIO – A VOLUMETRIC RATIO OF GROUT TO SOILS (E.G., 100 GALLONS/CUBIC YARD) TO BE MIXED IN A DSM COLUMN. THE GROUT INJECTION RATIO IS DETERMINED FOR EACH COLUMN BASED ON THE COLUMN DIMENSIONS, SOIL DENSITY, PATTERN OF TREATMENT, AND DESIRED APPLICATION RATE.

I. DSM COLUMN – ONE COMPLETED INSERTION, INJECTION AND MIXING OF THE SOIL WITH THE MIXING AUGER TO THE DESIGN DEPTH. THIS CREATES A COLUMN OF TREATED SOIL THE SAME DIAMETER AS THE MIXING AUGER. THE COLUMN MAY BE PRIMARY (THROUGH VIRGIN SOILS), SECONDARY (CONNECTING PRIMARY COLUMNS), TERTIARY, ETC.

J. WORKING PLATFORM – THE WORKING PLATFORM IS THE LEVELED AND STABLE SURFACE FROM WHICH THE DSM EQUIPMENT OPERATES.

K. MIXING AUGER/TOOL – THE SPECIAL TOOL THAT ATTACHES TO THE KELLY BAR AND IS INSERTED INTO THE GROUND TO MIX THE SOILS. THE TOOL MAY BE FITTED WITH PORTS FOR INJECTING GROUT, MIXING PADDLES, AUGER BLADES, ETC.

L. BLADE ROTATION NUMBER (BRN) – NUMBER OF BLADES X (RATE OF PENETRATION PLUS RATE OF WITHDRAWAL (IN REVOLUTIONS/METER). FOR EXAMPLE FOR 5 BLADES, RATE OF PENETRATION = 1 REVOLUTION/25 MM (40 REVOLUTIONS/M), AND RATE OF WITHDRAWAL = 1 REVOLUTION/20 MM (50 REVOLUTIONS/M), THE BRN = 5 X (40 + 50) = 450.

M. OBSTRUCTION – OBSTRUCTIONS ARE DEFINED AS MATERIALS CLASSIFIED AS UNDERGROUND UTILITIES, TREES (OR PARTS THEREOF), METAL, MAN–MADE OBJECTS, WOODEN/CONCRETE/STEEL OR ANY OTHER TYPE OF PILE OR DEEP FOUNDATION, OR NATURAL GROUND MATERIALS LARGER THAN A MAXIMUM COBBLE SIZE (8 INCHES MAXIMUM DIMENSION).

N. MIXING BLADE – A SINGLE MIXING BLADE SHALL CONSTITUTE A PAIR OF MIXING PADDLES ATTACHED TO THE SHAFT OF THE MIXING TOOL AT THE SAME ELEVATION. THE CUTTING PADDLES MAY ALSO BE CONSIDERED AS A MIXING BLADE.

O. DOSAGE – EXPRESSED AS THE MASS OF BINDER INTRODUCED PER VOLUME OF MIXED IN–SITU SOIL (E.G. KG/M^3).

1.4 SUBMITTALS

A. DSM WORK PLAN INCLUDING:

I. ASSIGNED NUMBER OF EACH COLUMN AS ID FOR INSTALLATION RECORD

II. NARRATIVE OF PLANNED MEANS AND METHODS TO EXECUTE THE INSTALLATION PER PLANS AND SPECIFICATIONS, INCLUDING SPECIFICATIONS OF THE GROUT BATCHING AND VERTICAL DRILL EQUIPMENT INTENDED FOR USE ON THE PROJECT.

III. NARRATIVE OF PLANNED MEANS AND METHODS TO EXECUTE THE QUALITY CONTROL REQUIREMENTS PER PLANS AND SPECIFICATIONS.

IV. PRELIMINARY SOIL MIX DESIGN INDICATING TYPE OF BINDER MATERIAL AND VOLUMETRIC PROPORTIONS FOR INITIAL TRIALS ON–SITE TO BE ADJUSTED BASED ON FIELD OBSERVATIONS AND EARLY STRENGTH RESULTS (SEE PART 3.2 TEST SECTION).

B. ACCURATE DAILY RECORDS OF THE WORK TO BE SUBMITTED BY CLOSE OF BUSINESS THE FOLLOWING DAY, INCLUDING:

I. COLUMN ID

II. DIAMETER

III. WORKING PAD ELEVATION

IV. MIXING DEPTH

V. START TIME

VI. TIME AT TIP ELEVATION

VII. FINISH TIME

VIII. MIXING DURATION

IX. GROUT MIX DETAILS (PERCENT WATER AND REAGENT BINDER)

X. GROUT INJECTION WITH DEPTH

XI. TOTAL INJECTED GROUT

XII. BLADE ROTATION NUMBER (BRN) WITH DEPTH

D. ANY PROPOSED CHANGE IN THE WORK PROCEDURES PLAN MADE NECESSARY BY CONDITIONS ENCOUNTERED DURING CONSTRUCTION FOR REVIEW AND APPROVAL BY THE ENGINEER.

E. MATERIAL CERTIFICATIONS FOR CEMENT BINDER TO BE USED IN THE PROJECT.

F. WEIGHTS: CERTIFICATES OF BATCH WEIGHTS FOR EACH TRUCK LOAD DELIVERED IF ON–SITE BATCH PLANT IS NOT USED.

G. ADMIXTURES/POZZOLANS/ADDITIVES SUBJECT TO THE APPROVAL OF THE ENGINEER, IF USED.

H. QC TEST RESULTS: SUBMIT ALL QC TEST RESULTS WITHIN 48 HOURS OF TESTING.

I. REPORT SUMMARIZING TEST SECTION RESULTS AND CALIBRATION OF DRILLING EFFORT CRITERIA FOR COLUMN DEPTH TERMINATION APPROVED BY THE ENGINEER.

J. AS–BUILT REPORT DOCUMENTING THE CONSTRUCTED LOCATIONS AND DIMENSIONS OF ALL DSM COLUMNS, COMPILATION OF ALL QUALITY CONTROL AND QUALITY ASSURANCE DATA COLLECTED FOR THE PROJECT, AND EXPLANATION OF ANY DEVIATION FROM THE PLANS AND SPECIFICATIONS PREVIOUSLY REVIEWED APPROVED TO THE SATISFACTION OF THE ENGINEER.

K. THE CONTRACTOR WILL SUBMIT A WORK PLAN DETAILING THE CONSTRUCTION AND QA/QC OF THE LTP, MEETING THE DESIGN REQUIREMENTS HEREIN AND IN THE GEOTECHNICAL REPORT.

1.5 ACCEPTANCE

A. ACCEPTANCE OF THE DSM WORK WILL BE BASED ON COMPLIANCE WITH THE STRENGTH AND GEOMETRY REQUIREMENTS OF THE PLANS AND SPECIFICATIONS AS VERIFIED BY THE ENGINEER'S QA TESTING. THE MATERIAL FORMED BY MIXING THE GROUT WITH THE IN SITU SOIL SHALL MEET A MINIMUM REQUIRED UNCONFINED COMPRESSIVE STRENGTH OF 150 POUNDS PER SQUARE INCH (PSI) AT 28 DAYS. TESTS WILL BE CONSIDERED PASSING IF THEY ARE AT LEAST 90% OF THE 150 PSI STRENGTH REQUIREMENT PROVIDED THAT NO MORE THAN 10% OF ALL TESTS FALL BELOW THE REQUIREMENT AND THE OVERALL AVERAGE STRENGTH EXCEEDS THE REQUIREMENT. IF THE UNCONFINED COMPRESSIVE STRENGTH RESULTS DO NOT MEET THAT CRITERIA, THE DSM SUBCONTRACTOR SHALL SUBMIT A MITIGATION PLAN FOR REVIEW AND APPROVAL BY THE ENGINEER.

PART 2 – PRODUCTS

2.1 MATERIALS

A. FRESH OR RECLAIMED WATER, FREE OF ANY DELETERIOUS SUBSTANCE THAT COULD ADVERSELY AFFECT THE GROUT PROPERTIES SHALL BE USED.

B. BINDER AGENT USED FOR THE PROJECT SHALL CONSIST OF PORTLAND CEMENT TYPE II/V CONFORMING TO ASTM DESIGNATION C150. THE CEMENT SHALL BE ADEQUATELY PROTECTED FROM MOISTURE AND CONTAMINATION WHILE IN TRANSIT AND STORAGE AT THE JOB SITE. RECLAIMED CEMENT OR CEMENT CONTAINING LUMPS OR DELETERIOUS MATTER SHALL NOT BE USED.

C. THE WATER AND CEMENT SHALL BE PREMIXED TO FORM A GROUT FOR INJECTION AND MIXING WITH THE IN–SITU SOIL. MATERIALS SHALL BE COMBINED IN PREDETERMINED WEIGHED PROPORTIONS WITH ITS QUALITY EVALUATED BY SPECIFIC GRAVITY MONITORED AT LEAST ONCE PER INSTALLATION BY MUD BALANCE.

D. THE DESIGN UNCONFINED COMPRESSIVE STRENGTH OF THE SOIL–CEMENT MATERIAL COMPRISING THE DSM COLUMNS IS 150 PSI AT 28 DAYS.

PART 3 – EXECUTION

3.1 EQUIPMENT

A. A PURPOSE BUILT HOLLOW STEM AND MIXING PADDLE TOOL ATTACHED TO A HIGH TORQUE ROTARY DRILL ON TRACKS SHALL BE USED TO ACCOMPLISH THE DSM. MIXING TOOLS OF 4– AND 6–FOOT–DIAMETER WILL BE IMPLEMENTED FOR THIS PROJECT. MIXING TOOLS SHALL CONSIST OF A MINIMUM OF FOUR (4) MIXING BLADES (4 PAIRS OF MIXING PADDLES).

B. CEMENT WILL BE STORED IN PURPOSE BUILT SILOS.

C. WATER SHALL BE MIXED WITH CEMENT IN A PURPOSE–BUILT WEIGH–BATCH MIXER TO PRODUCE SLURRY WITH A CONSISTENT SPECIFIC GRAVITY OR WATER:CEMENT RATIO FOR PROPER MIXING. JET VALVE MIXING OR OTHER CONTINUOUS MIXING METHODS WILL NOT BE ALLOWED.

D. GROUT SHALL BE DELIVERED TO THE MIXING RIG BY APPROPRIATELY SIZED POSITIVE DISPLACEMENT PUMPS. PROGRESSIVE CAVITY PUMPS SHALL NOT BE ALLOWED.

3.2 TEST SECTION

A. LOCATIONS: PRIOR TO INITIATING PRODUCTION WORK, DSM SUBCONTRACTOR SHALL INSTALL A MINIMUM OF TWO DSM COLUMNS WITH VARYING MIX DESIGN DOSAGE AT EACH OF THE SIX TEST SECTION LOCATIONS INDICATED ON THE PLANS.

B. EVALUATION GOALS: THE PURPOSE OF THE TEST SECTION IS TO EVALUATE THE FOLLOWING ITEMS PRIOR TO INITIATING PRODUCTION WORK. THE DSM SUBCONTRACTOR MAY PROCEED IMMEDIATELY TO PRODUCTION WHILE TEST SECTION EVALUATION RESULTS ARE PENDING BUT DOES SO AT ITS OWN RISK.

I. COLUMN DEPTH: COLUMN INSTALLATION DEPTHS FOR THE PROJECT ARE CONTROLLED BY THE DEPTH TO THE CAPISTRANO FORMATION CONTACT AS DESCRIBED IN SECTION 3.3.G. DURING TEST SECTION INSTALLATION ADJACENT TO EXISTING EXPLORATION DATA, DSM SUBCONTRACTOR SHALL MONITOR AND RECORD INDICATORS OF DRILLING EFFORT (E.G. ROTARY TORQUE APPLIED AND CROWD PRESSURE). DSM SUBCONTRACTOR SHALL PROPOSE A READILY IDENTIFIABLE METRIC SUBJECT TO THE ENGINEER'S APPROVAL FOR THE DRILL OPERATOR TO OBSERVE DURING INSTALLATION AS EVIDENCE OF ENCOUNTERING THE CAPISTRANO FORMATION.

II. MIX CONSISTENCY: DURING TEST SECTION MIXING THE DSM SUBCONTRACTOR AND ENGINEER SHALL OBSERVE

III. STRENGTH: A MINIMUM OF TWO WET–GRAB SAMPLES SHALL BE COLLECTED FROM EACH TEST SECTION COLUMN INSTALLED AT DEPTHS OF 1/3 AND 2/3 THE TOTAL INSTALLATION DEPTH. EACH SAMPLE COLLECTED SHALL BE CAST INTO CYLINDERS FOR UNCONFINED COMPRESSION STRENGTH TESTING AND EVALUATION AS DESCRIBED IN SECTION 3.4.B.

IV. LOAD TEST: DSM SUBCONTRACTOR SHALL CONDUCT A MINIMUM OF FOUR LOAD TESTS PER THE REQUIREMENTS OF THIS SPECIFICATION TO ASSESS THE 4–FOOT–DIAMETER DSM COLUMN GEOTECHNICAL CAPACITY ADJACENT TO EXPLORATORY TEST DATA. SEE PROPOSED LOAD TEST LOCATIONS ON SHEET GI–3.

3.3 CONSTRUCTION

A. INSTALL DSM COLUMNS AT THE LOCATIONS AND TO THE DEPTH INDICATED ON THE DSM PLAN.

B. HORIZONTAL ALIGNMENT: THE DSM COLUMNS SHALL BE CAREFULLY SURVEYED AND STAKED OUT PRIOR TO INSTALLATION. THE COLUMNS SHALL BE CONSTRUCTED WITHIN 4 INCHES OF THE LOCATIONS SHOWN ON THE DRAWINGS.

C. VERTICAL ALIGNMENT: VERTICAL ALIGNMENT OF THE AUGER STROKE WILL BE CONTROLLED BY THE EQUIPMENT OPERATOR. THE COLUMN VERTICALITY SHALL HAVE A TOLERANCE OF 1:50 MAXIMUM DEVIATION.

D. MIXING SHAFT SPEED: THE MIXING SHAFT SPEED (RPMS) SHALL BE ADJUSTED TO ACCOMMODATE AN ADEQUATE RATE OF MIXING SHAFT PENETRATION BASED ON THE DEGREE OF DRILLING DIFFICULTY. THE MIXING SHAFT SPEED CAN BE ADJUSTED ACCORDING TO DRILLING DIFFICULTY.

E. BOTTOM MIXING: THE BOTTOM OF THE COLUMNS SHALL BE DOUBLE MIXED BY RAISING THE MIXING SHAFTS FIVE FEET OFF THE BOTTOM AND THEN REINSERTING THEM FOR REMIXING.

F. GROUT TAKE: THE GROUT TAKE (OR INJECTION RATE) PER VERTICAL FOOT OF COLUMN WILL BE ADJUSTED TO THE REQUIREMENTS OF THE DESIGN MIX. APPROPRIATE DELIVERY PUMPS SHALL BE USED TO TRANSFER THE GROUT FROM THE MIX PLANT TO THE DSM RIG. A FLOW MONITORING DEVICE WILL BE INSTALLED IN THE GROUT LINE TO DETECT LINE BLOCKAGE AND ELECTRONICALLY RECORD INJECTION RATES AND VOLUMES VERSUS DEPTH AND TIME FOR QUALITY CONTROL MONITORING.

I. THE RATE OF APPLICATION MAY BE CONTROLLED AND MONITORED BY ADJUSTING THE PUMP OUTPUT TO THE PENETRATION RATE SO THAT A PRESET GROUT TAKE CAN BE ACHIEVED. TYPICALLY, THE APPLICATION RATE CAN BE SUCCESSFULLY CONTROLLED BY EXPERIENCED OPERATORS ONCE THE PATTERN OF OPERATION IS ESTABLISHED.

II. SOME VARIATIONS OF THE GROUT TAKE WILL OCCUR DUE TO FIELD CONDITIONS. HOWEVER, THE OVERALL APPLICATION RATE TO EACH STROKE CAN BE MONITORED, CALCULATED AND CONTROLLED. ADDITIONAL MIXING IS TO BE USED WHEN NECESSARY TO DISTRIBUTE THE GROUT THROUGH THE ENTIRE COLUMN. THE INJECTION OF GROUT TO EACH STROKE WILL BE MONITORED, CHECKED BY CALCULATION AND RECORDED.

G. COLUMN DEPTH:

I. BUTTRESS COLUMNS: COLUMNS INSTALLED FOR THE LATERAL SPREAD BUTTRESS SHALL BE INSTALLED TO A MINIMUM OF 4 FEET BEYOND THE CAPISTRANO FORMATION CONTACT AS IDENTIFIED BASED ON THE DRILLING EFFORT CALIBRATION PERFORMED DURING THE TEST SECTION WORK AND SUBJECT TO THE APPROVAL OF THE ENGINEER. PRACTICAL REFUSAL (AS DEFINED IN SECTION 3.3.H) ENCOUNTERED PRIOR TO ACHIEVING THE REQUIRED 4–FOOT EMBEDMENT INTO CAPISTRANO FORMATION MAY BE APPROVED BY THE ENGINEER ON A CASE–BY–CASE BASIS BUT THE DSM SUBCONTRACTOR SHALL BE PREPARED TO INITIATE PREDRILLING IF NEEDED TO ACHIEVE THE REQUIRED EMBEDMENT AT NO ADDITIONAL COST TO THE OWNER.

II. BUILDING SUPPORT COLUMNS: DSM COLUMNS INTENDED FOR SUPPORT OF THE RETAIL BUILDINGS SHALL BE INSTALLED TO A MINIMUM OF 1 FOOT BEYOND THE CAPISTRANO FORMATION CONTACT OR TO PRACTICAL REFUSAL. MEANS OF IDENTIFYING THE CAPISTRANO FORMATION CONTACT WILL BE BASED ON THE DRILLING EFFORT CALIBRATION PERFORMED DURING THE TEST SECTION WORK AND SUBJECT TO THE APPROVAL OF THE ENGINEER.

H. OBSTRUCTION/MIXING SHAFT PRACTICAL REFUSAL: IF OBSTRUCTIONS ARE ENCOUNTERED WHICH REDUCE THE RATE OF PENETRATION TO ONE FOOT PER MINUTE FOR TWO MINUTES UNDER FULL POWER, THE STROKE SHALL BE COMPLETED IN ACCORDANCE WITH THE SPECIFICATIONS AND REMEDIAL MEASURES WILL BE TAKEN. SUBCONTRACTOR SHALL NOTIFY CONTRACTOR TO INVESTIGATE, CONFIRM, AND REMOVE SAID OBSTRUCTIONS FROM THE SOIL MIXING AREA. ONCE CONTRACTOR REMOVES OBSTRUCTIONS AND BACKFILLS AND COMPACTS (IN LIFTS NOT TO EXCEED 3 FEET IN UNCOMPACTED THICKNESS) THE REMOVAL AREA WITH GRANULAR SAND OR SANDY GRAVEL MATERIAL, THE DSM SUBCONTRACTOR SHALL RETURN TO MIXING THE BACKFILLED AREAS AND REMAINING DSM COLUMNS PER PLANS AND SPECS. IF REMOVAL OF OBSTRUCTIONS BY CONTRACTOR DAMAGES A PREVIOUSLY INSTALLED DSM COLUMN, ASSOCIATED RE–INSTALLATION WORK SHALL BE COMPENSATED BY AS EXTRA AT THE CONTRACT UNIT PRICES. IF IT IS INFEASIBLE OR IMPRACTICAL TO CLEAR AN OBSTRUCTION FROM A DESIGN INSTALLATION LOCATION, CONTRACTOR MAY PROPOSE A MODIFICATION TO THE DESIGN PROVIDED THE ORIGINAL PERFORMANCE IS MAINTAINED SUBJECT TO THE REVIEW AND APPROVAL OF THE ENGINEER.

I. MIXING ENERGY: THE DSM SUBCONTRACTOR SHALL MIX EACH COLUMN WITH SUFFICIENT MIXING ENERGY THROUGHOUT TO PROPERLY PROCESS THE SOIL CEMENT PRODUCT. THE MIXING ENERGY SHALL BE DEMONSTRATED BY MEASURED AND RECORDED BRN REPORTED FOR EACH INSTALLATION AND THE MIXING ENERGY APPLIED SHALL MINIMALLY ACHIEVE THAT REQUIRED TO PRODUCE SATISFACTORY RESULTS DURING THE TEST SECTION.

J. NO EXCAVATION OR HEAVY GRADING BY CONTRACTOR SHALL PROCEED PRIOR TO 3 DAYS AFTER DSM COLUMN CONSTRUCTION UNLESS APPROVED BY THE DSM DESIGN ENGINEER.

K. UTILITY TRENCH: EXCAVATE THE COMPLETED DSM COLUMNS AS NECESSARY FOR UNDERGROUND UTILITIES. TRENCH BACKFILL WILL BE AS FOLLOW:

I. FOR TRENCHES CUT INTO BUTTRESS DSM AND ABOVE GWT: BACKFILL WILL NATIVE SOILS OR AS APPROVED BY THE ENGINEER.

II. FOR TRENCHES CUT INTO BUTTRESS DSM AND EXTEND BELOW GWT: BACKFILL WITH CEMENT SLURRY WITH COMPRESSIVE STRENGTH OF AT LEAST 300 PSI.

III. UTILITIES TRENCHES WILL AVOID CUTTING INTO THE DISCRETE 4' DIAMETER DSM COLUMNS SUPPORTING BUILDINGS AND SLABS.

L. MANAGEMENT OF SPOIL TO BE COORDINATED BETWEEN CONTRACTOR AND DSM SUBCONTRACTOR.

3.4 QUALITY CONTROL AND QUALITY ASSURANCE

A. PRIOR TO CONSTRUCTION, A PRELIMINARY MIX DESIGN SHALL BE GENERATED BY THE SUBCONTRACTOR. THE MIX DESIGN MAY BE OBTAINED BASED ON SITE SOILS AND LABORATORY TESTING, OR ALTERNATIVELY, BASED ON THE SUBCONTRACTORS DATABASE IN SIMILAR SOIL CONDITIONS AND STRENGTH REQUIREMENTS.

B. WET SAMPLING: THE DSM SUBCONTRACTOR SHALL OBTAIN WET BULK SAMPLES OF THE SOIL CEMENT MIX AND CAST IT IN CYLINDERS FOR SUBSEQUENT QUALITY CONTROL TESTING BY THE DSM SUBCONTRACTOR, AND QUALITY ASSURANCE TESTING AND ACCEPTANCE BY THE ENGINEER.

I. ONE SAMPLE WILL BE RETRIEVED PER WORK DAY PER RIG.

II. THE VOLUME OF SAMPLE RECOVERED DURING EACH SAMPLING SHALL BE SUFFICIENT TO CAST 6 SAMPLE CYLINDERS EACH MEASURING 3" DIAMETER BY 6" HIGH. A ½" SIEVE WILL BE USED TO SCREEN THE MATERIAL IN ORDER TO FACILITATE APPROPRIATE SCALING OF INCLUSIONS AND PROPER MODELING OF THE 3 INCH CYLINDERS.

III. OF THE 6 CYLINDERS CAST, 3 WILL BE PROVIDED TO THE ENGINEER FOR QUALITY ASSURANCE TESTING AND 3 WILL BE RETAINED BY THE DSM SUBCONTRACTOR FOR QUALITY CONTROL TESTING.

IV. TO AVOID DISTURBANCE, THE CYLINDERS ARE TO BE CURED ON SITE IN A COOLER WITH A SMALL AMOUNT OF WATER TO MAINTAIN A STABLE, COOL AND MOIST CURING ENVIRONMENT FOR 2 DAYS.

V. AFTER QUALITY ASSURANCE SAMPLES ARE RETRIEVED BY THE ENGINEER, ALL WET GRAB SAMPLES SHALL BE STORED IN A MOIST ROOM (NOT SUBMERGED) IN ACCORDANCE WITH ASTM C 192 UNTIL THE TEST DATE.

VI. THE QUALITY CONTROL SAMPLES WILL BE TESTED (BY THE DSM SUBCONTRACTOR) FOR UCS IN ACCORDANCE WITH ASTM D1633, AT 3–DAY, 7–DAY, AND 14–DAY AFTER CASTING. THE RESULTS WILL BE USED TO EXTRAPOLATE THE EXPECTED STRENGTH AT 28–DAYS.

VII. THE QUALITY ASSURANCE SAMPLES WILL BE TESTED (BY THE ENGINEER) FOR UCS IN ACCORDANCE WITH ASTM D1633, AT 7–DAY, 14–DAY, AND 28–DAY AFTER CASTING.

VII. WHEN TIME OR SCHEDULE DOES NOT PERMIT A 28–DAY CURING STRENGTH EVALUATION, THE FOLLOWING UCS AGING CORRELATION WILL BE TENTATIVELY APPLIED TO THIS JOB:

28 : 7 DAY, 1.57

VIII. THE ABOVE CORRELATION MAY BE ADJUSTED FOR SITE–SPECIFIC FINDINGS AS THE PROJECT DEVELOPS.

IX. THE DESIGN STRENGTH FOR THIS PROJECT AT 28–DAYS IS 150 PSI. SUBJECT TO THE APPROVAL OF THE ENGINEER, 7–DAY TEST RESULTS MAY BE ACCEPTED BASED ON THE CORRELATION ABOVE OR A REVISED CURING FACTOR BASED ON PROJECT–SPECIFIC STATISTICAL ANALYSIS OF AVAILABLE DATA.

C. LOAD TEST:

I. DSM SUBCONTRACTOR SHALL PERFORM A MINIMUM OF FOUR COMPRESSION LOAD TEST ON 4–FOOT–DIAMETER COLUMNS AT THE TEST SECTION LOCATION SPECIFIED FOR THE BUILDINGS ON THE DRAWINGS.

II. COMPRESSION LOAD TEST SHALL BE IN GENERAL ACCORDANCE WITH ASTM D1143. THE TEST COLUMN SHALL BE CONDUCTED TO AT LEAST 150% OF THE STATIC DESIGN LOAD.

III. LOAD TEST WILL NOT BE PERFORMED BEFORE THE COLUMN HAS ACHIEVED SUFFICIENT UNCONFINED COMPRESSIVE STRENGTH AS DEMONSTRATED BY LABORATORY TESTING ON WET GRAB SAMPLES.

D. OBSERVATION: A REPRESENTATIVE OF THE ENGINEER SHALL BE PRESENT FULL–TIME DURING ALL INSTALLATION WORK TO OBSERVE THE CONSTRUCTION OF THE DSM COLUMNS, SAMPLING, AND TESTING TO VERIFY THE DSM SUBCONTRACTOR PERFORMS THE WORK IN SUBSTANTIAL CONFORMANCE WITH THESE SPECIFICATIONS. THE ENGINEER SHALL MAINTAIN PARALLEL HAND RECORDS OF PERTINENT INSTALLATION DATA FOR COMPARISON WITH REPORTED INSTALLATION LOGS AND OBTAIN TEST SPECIMENS OF THE WET–SAMPLES COLLECTED FOR QUALITY ASSURANCE TESTING.

END OF SECTION

COMPRESSION TEST LOADING SCHEDULE		
DESIGN LOAD =	200	KIPS
PERCENT OF DL	LOAD VALUE	HOLD DURATION
(%)	(KIP)	(MIN)
5%	10	4
10%	20	4
15%	30	4
20%	40	4
25%	50	4
30%	60	4
35%	70	4
40%	80	4
45%	90	4
50%	100	4
55%	110	4
60%	120	4
65%	130	4
70%	140	4
75%	150	4
80%	160	4
85%	170	4
90%	180	4
95%	190	4
100%	200	4
105%	210	4
110%	220	4
115%	230	4
120%	240	4
125%	250	4
130%	260	4
135%	270	4
140%	280	4
145%	290	4
150%	300	4
125%	250	4
100%	200	4
75%	150	4
50%	100	4
25%	50	4
5%	10	4
0%	0	-

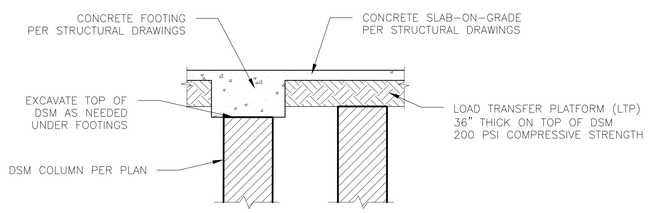

TYPICAL BUILDING SUPPORT DETAIL
SCALE: NTS

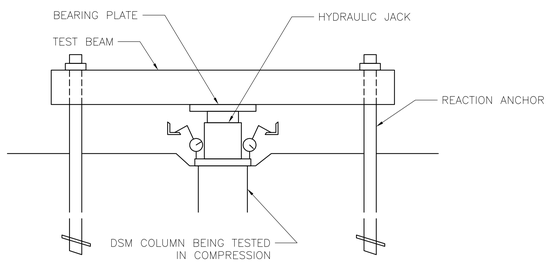

LOAD TEST SETUP
SCALE: NTS

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER
THOMAS TRAN
C 91763
CIVIL
STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

GENERAL NOTES AND DETAILS

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-2

S:\Leads\Dana Point Harbor (19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSH-B24BDMR21-02H1BMR21-02H2BMR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
Use of this plan is conditioned upon the acceptance of the County of Orange and its officers, agents and employees of any and all liability arising from the use of this plan. By using this plan or any part thereof, the user agrees to indemnify and hold harmless the County of Orange and its officers, agents and employees from any and all claims, actions, suits, or other proceedings arising out of the use of this plan or any part thereof.
Troy Tomlinson
Inspection Services

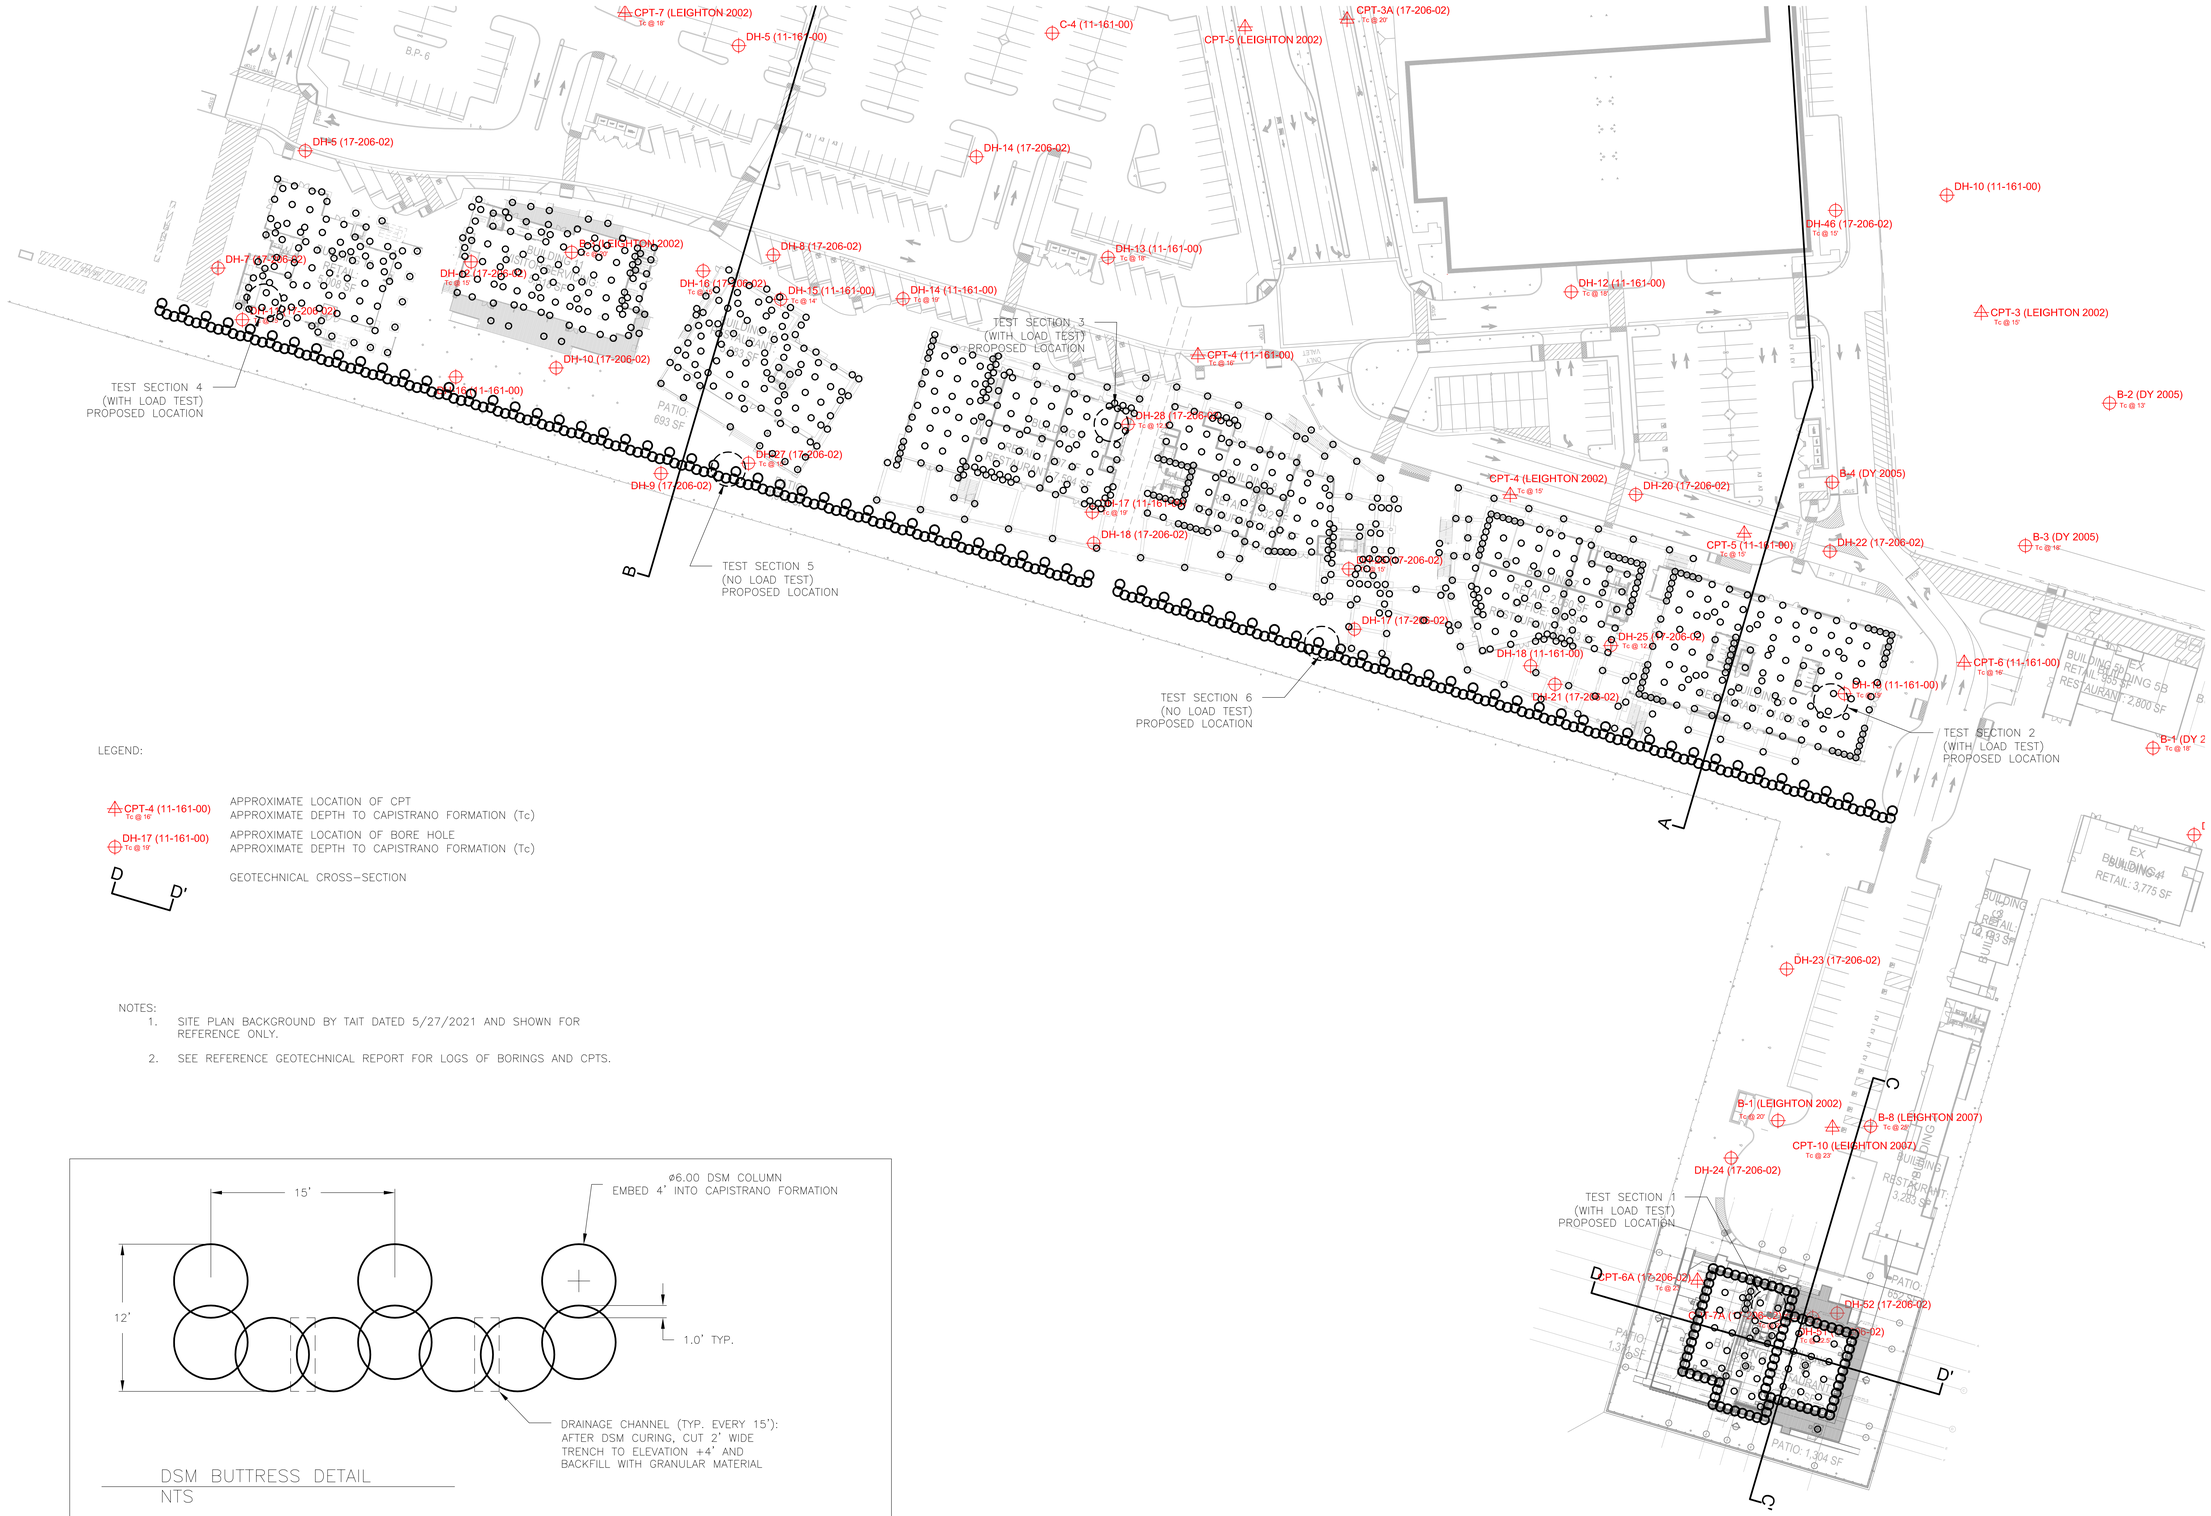

LEGEND:

CPT-4 (11-161-00) Tc @ 16' — APPROXIMATE LOCATION OF CPT
APPROXIMATE DEPTH TO CAPISTRANO FORMATION (Tc)

DH-17 (11-161-00) Tc @ 19' — APPROXIMATE LOCATION OF BORE HOLE
APPROXIMATE DEPTH TO CAPISTRANO FORMATION (Tc)

D D' — GEOTECHNICAL CROSS-SECTION

NOTES:
1. SITE PLAN BACKGROUND BY TAIT DATED 5/27/2021 AND SHOWN FOR REFERENCE ONLY.
2. SEE REFERENCE GEOTECHNICAL REPORT FOR LOGS OF BORINGS AND CPTS.

DSM BUTTRESS DETAIL
NTS

DSM PLAN
SCALE: 1" = 40'

N

0' 40' 80'
SCALE: 1"=40'

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:
GROUND IMPROVEMENT FOR
DANA POINT HARBOR COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:
DEEP SOIL MIXING PLAN

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-3

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSC-024839-R21-024139-BMSC-024839-R21-0240

County of Orange OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
This approval is conditioned upon all applicable laws and regulations being complied with during development whether or not they are set forth in this approval. By using this document the applicant accepts responsibility for all requirements of the approved plans and permit and is responsible for notifying his employees and subcontractors of them.
Jay Crittenden
714.667.8726

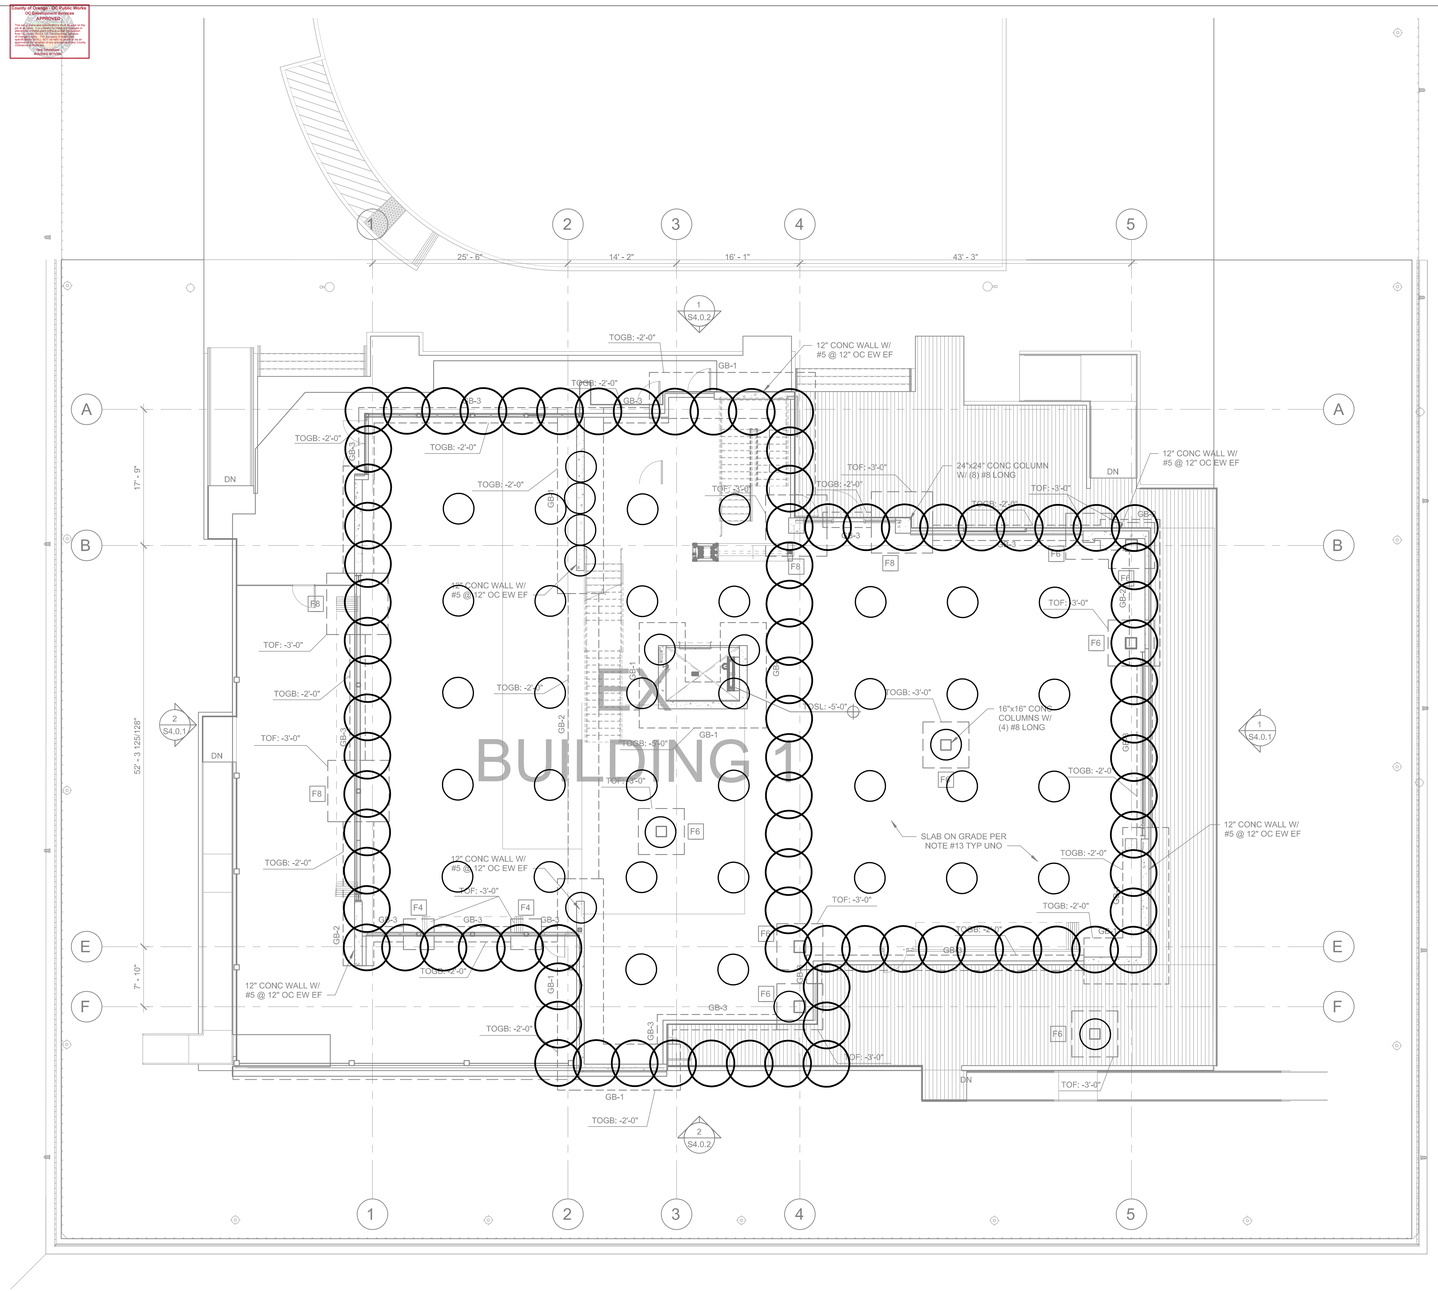

DSM COLUMN LAYOUT – BUILDING 1
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø BEARING ON CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 10/8/2020 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 1

PROJECT NO.	SHEET NUMBER:
–	GI-4.1
DATE: 05/27/2021	
SCALE: AS SHOWN	

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP: 0140BMEP-02H1BMEP-02H2BMEP-02H3

County of Orange - OC Public Works
OC Development/Environmental Services
APPROVED
This plan has been reviewed for conformance with the County of Orange Local Drainage Manual and the Model Water Quality Management Plan (WQMP). Approval does not relieve the owner, engineer, or agent of responsibility for errors, omissions, or variations from the requirements of the Local Drainage Manual or the approved WQMP. Approval does not authorize work within the County right-of-way.
By: Date:
PERMIT #:

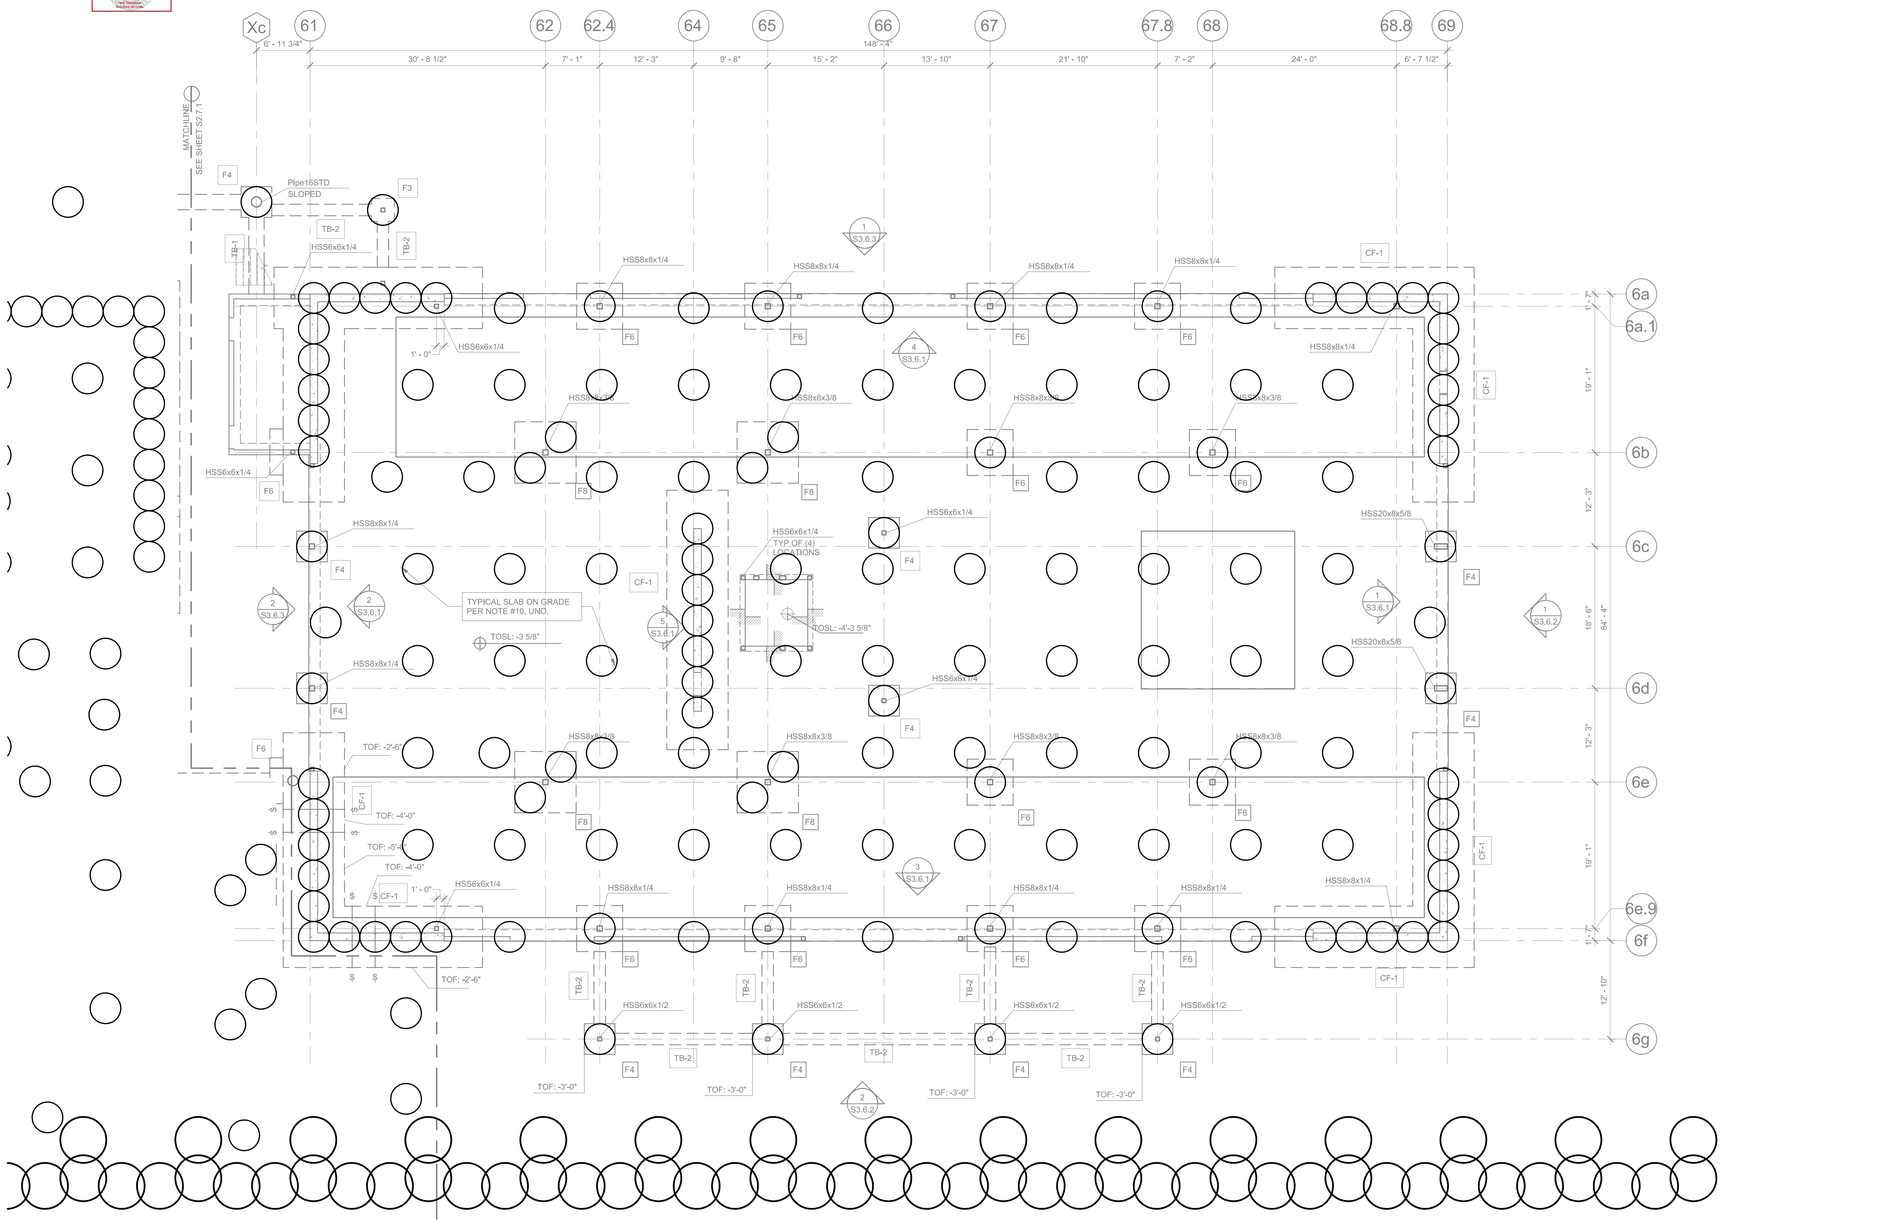

DSM COLUMN LAYOUT – BUILDING 6
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 STATE OF CALIFORNIA CIVIL

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 6

PROJECT NO. –

DATE: 05/27/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.2

S:\Leeds\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-1924BSWR21-02A1BMEP-1924BSWR21-02A2

County of Orange - OC Public Works
OC Development/Environmental Resources
APPROVED
Date: 1/19/2020
This approval is conditioned upon all applicable laws and regulations being complied with during the development of the project. Approval does not constitute building permit or authorization for construction. Other agency approval may be required.
Permit Authority: Land Development
By: Tim Dimmitt
Expires: 1/19/2021

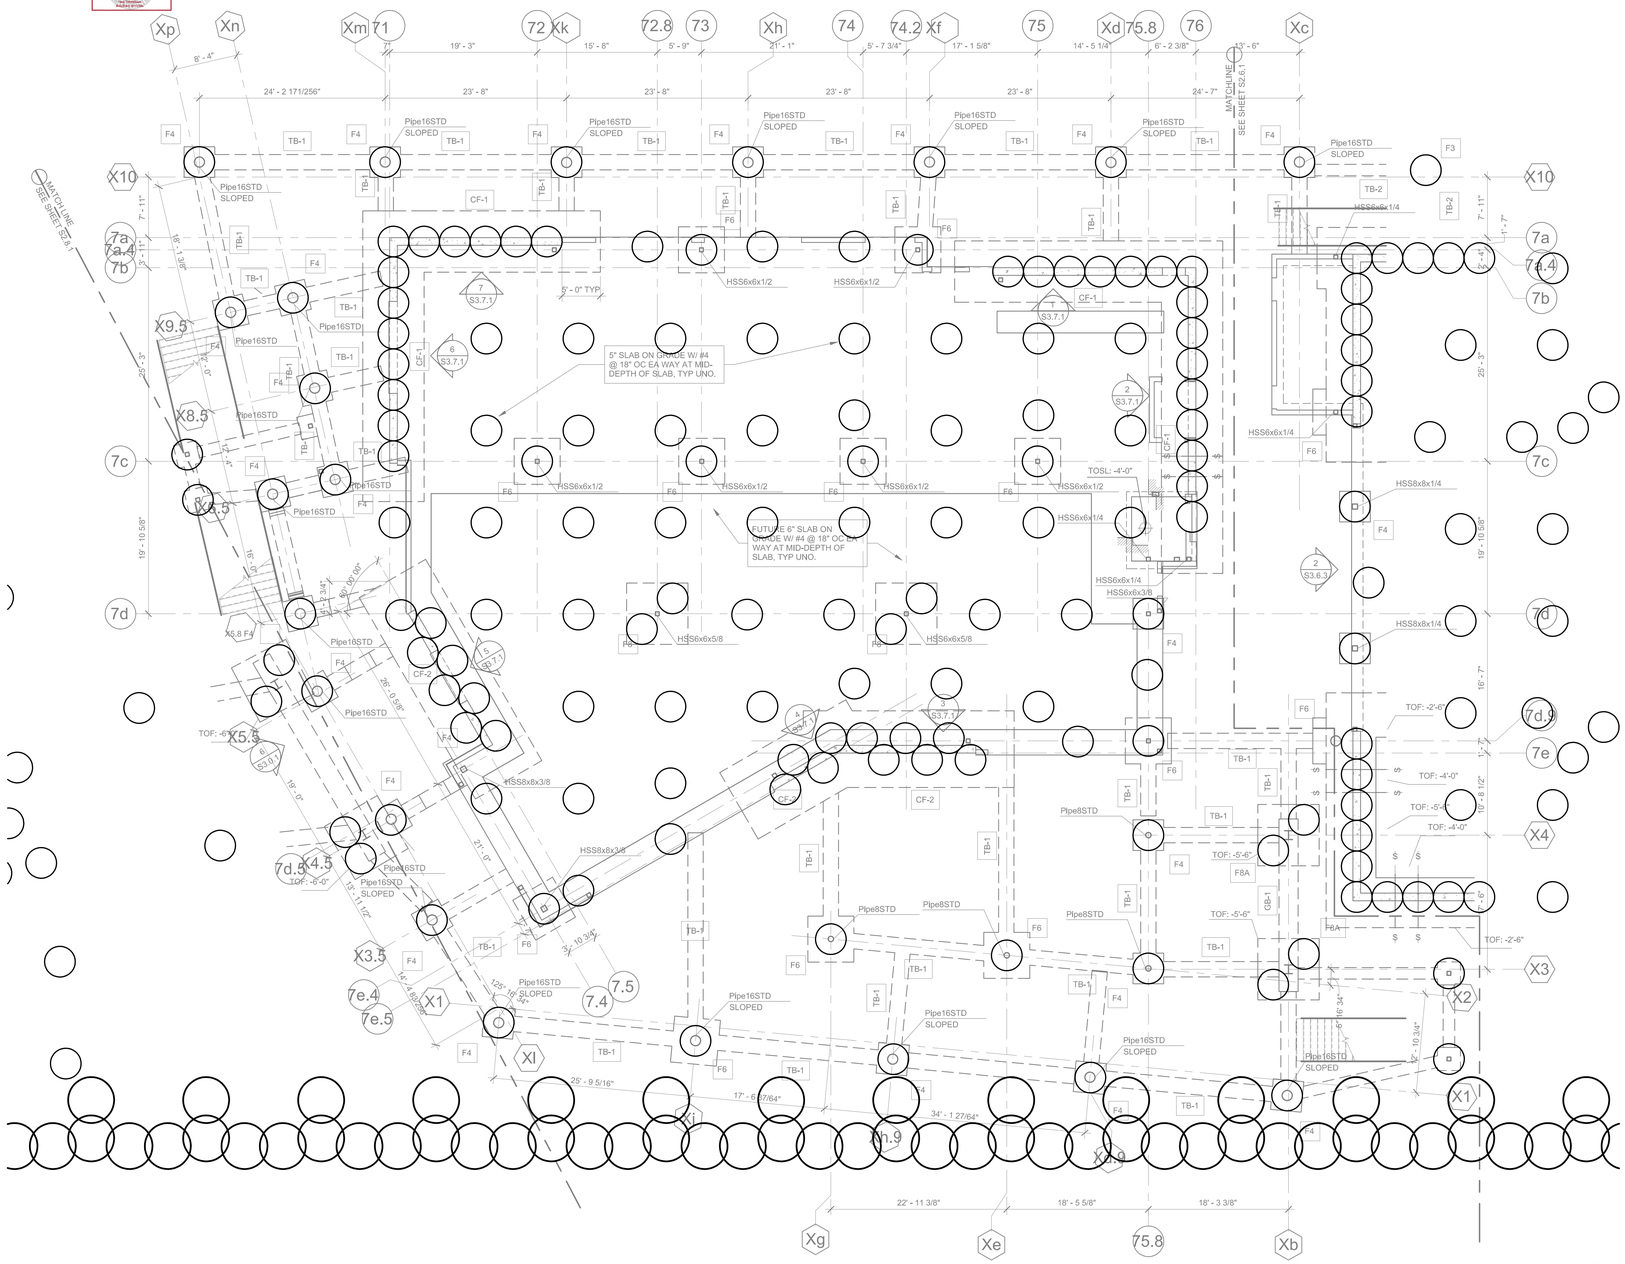

DSM COLUMN LAYOUT – BUILDING 7
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 7

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN

SHEET NUMBER: GI-4.3

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSC-0240BSMS1-02412BMS1-02422BMS1-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
This approval is conditioned upon all applicable laws and regulations being complied with during all phases of construction. Issuance of this approval does not relieve the permittee of the responsibility of complying with all applicable laws and regulations. This approval shall not be valid unless the signature block is completed.
By: Tim Constantine
Building Official

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

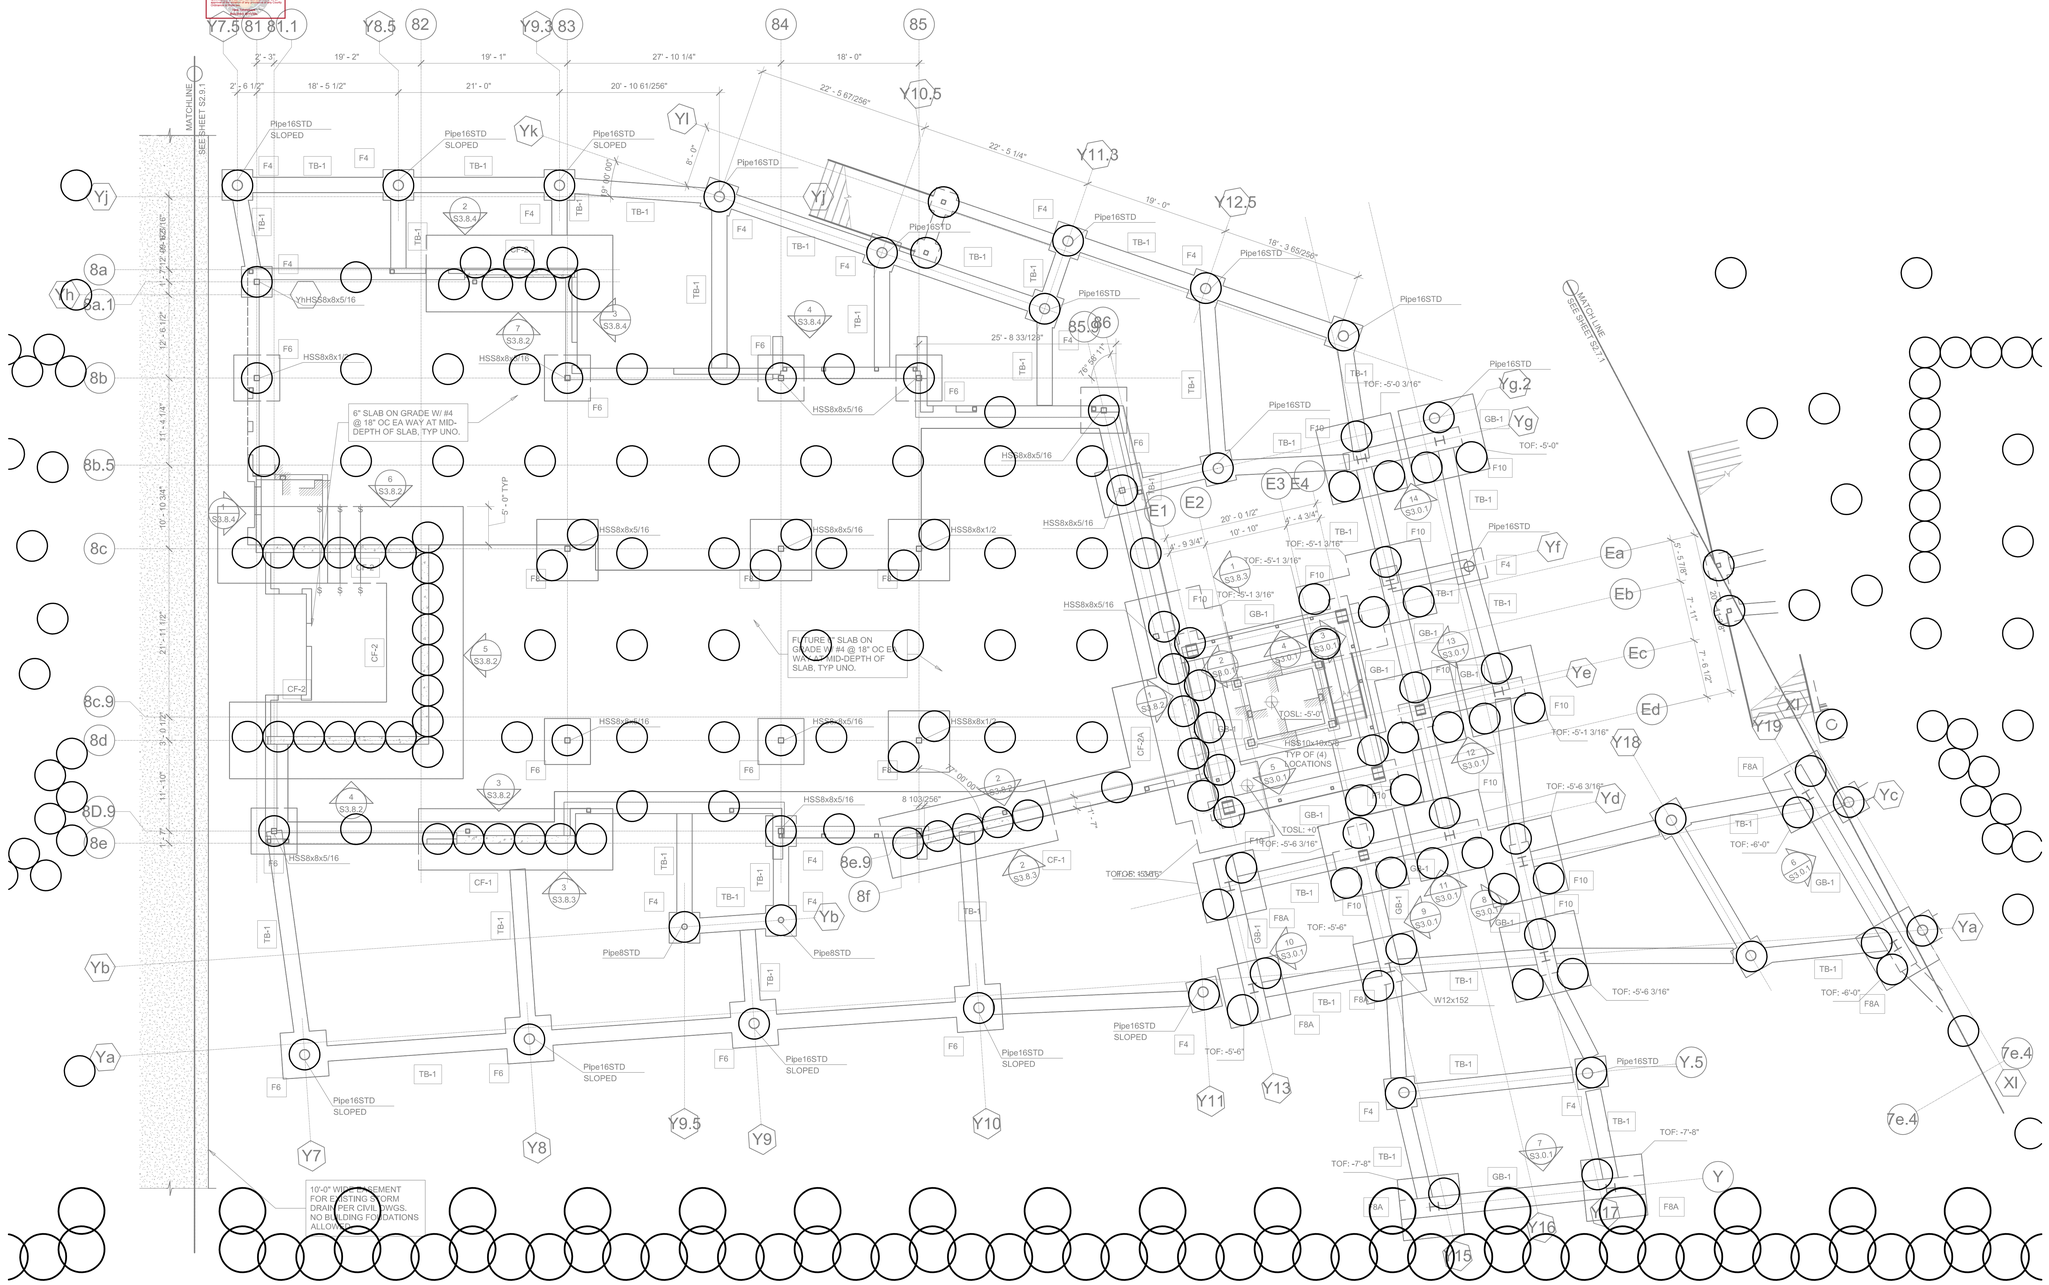

DSM COLUMN LAYOUT – BUILDING 8
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 8

PROJECT NO. –

DATE: 05/27/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.4

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-1924BSWR21-02412BMEP21-02423BMEP21-02431

County of Orange OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
This approval is valid only for the purpose and the use of which is requested. Approval of any work does not authorize violation of any law, regulation, ordinance or code of the County of Orange or any other agency. Approval of any work based on information provided by the applicant or his agent shall not prevent subsequent rejection of any work based on subsequently discovered information.
Reg. Geologist
PERMIT SYSTEM

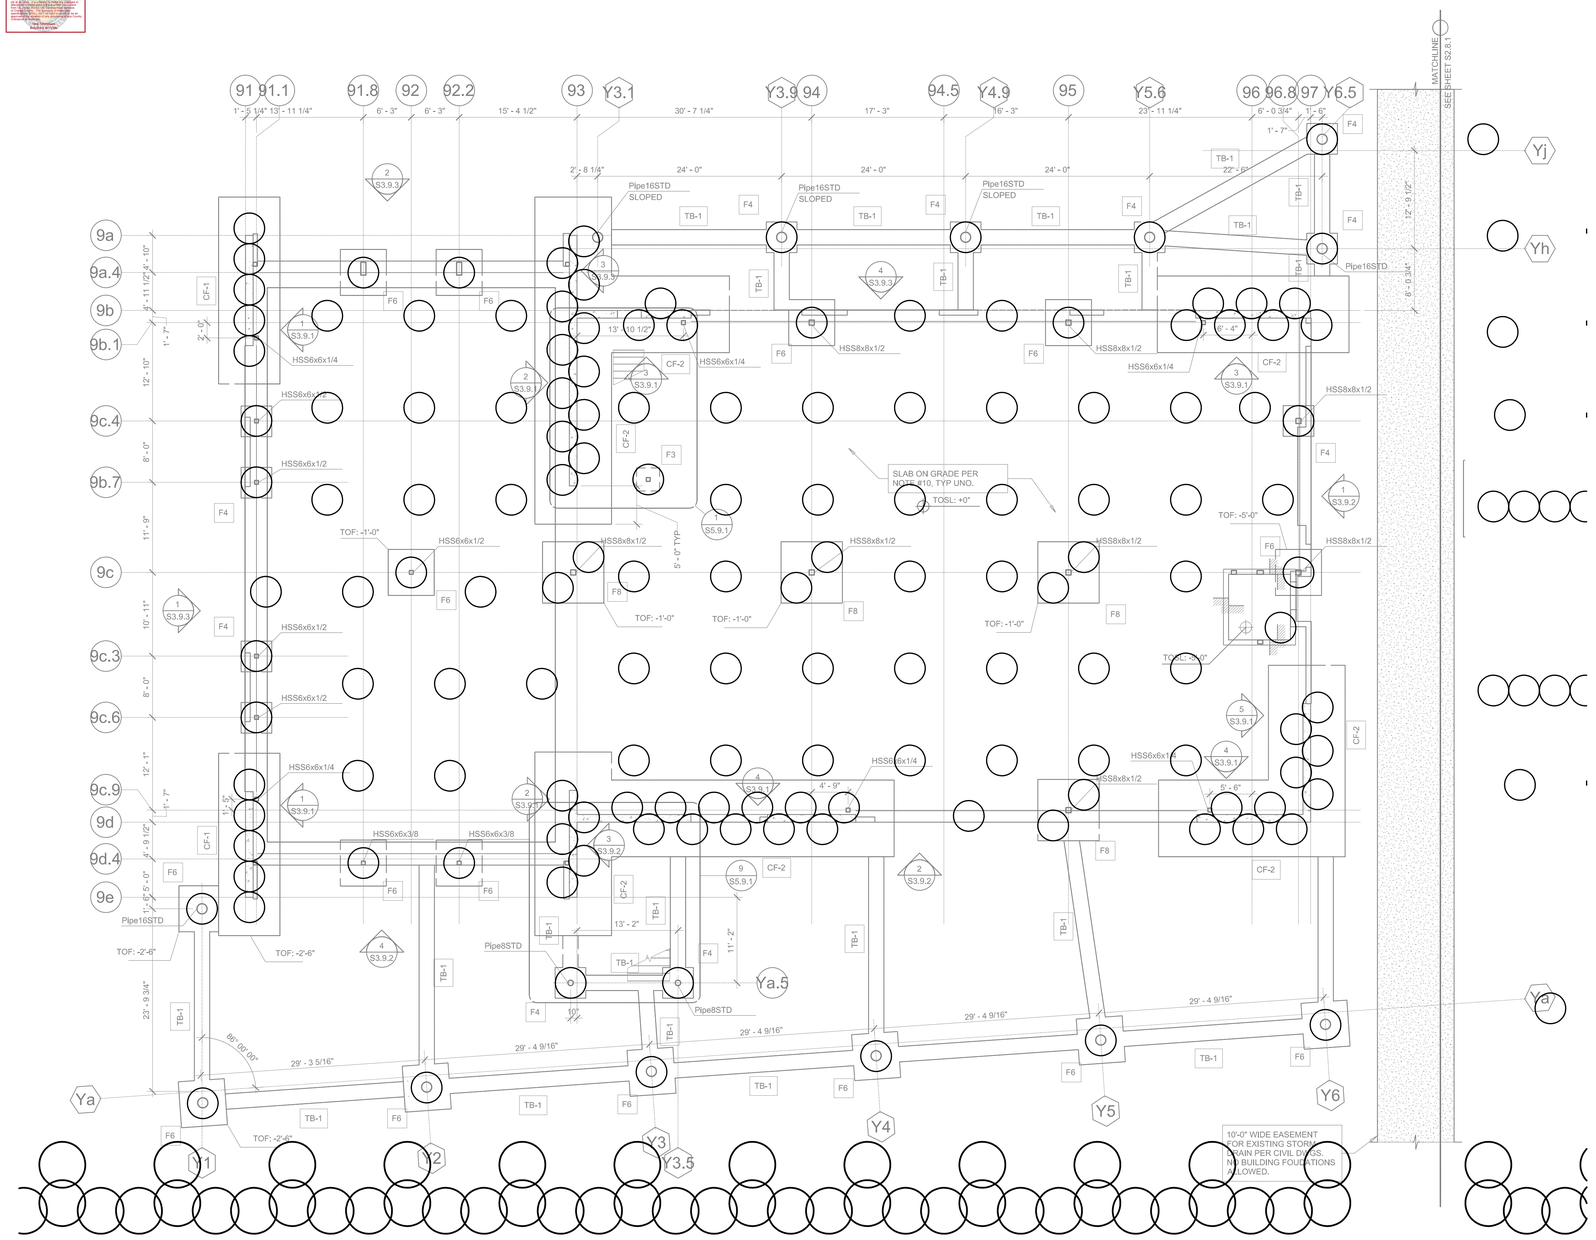

DSM COLUMN LAYOUT – BUILDING 9
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:
GROUND IMPROVEMENT FOR
DANA POINT HARBOR COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:
DEEP SOIL MIXING LAYOUT – BUILDING 9

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-4.5

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-1E4B5B4B21-02A1B4B21-02A2B4B21-0243

County of Orange - OC Public Works
OC Development/Environmental
APPROVED
Your submittal has been reviewed and found to be in general conformance with applicable County codes and ordinances. Approval of this document does not authorize any violation of State or Federal laws. Approval does not constitute permission for any encroachment onto County right-of-way or easements. Approval is subject to any corrections required during construction.
Greg Donovan
PUBLIC WORKS

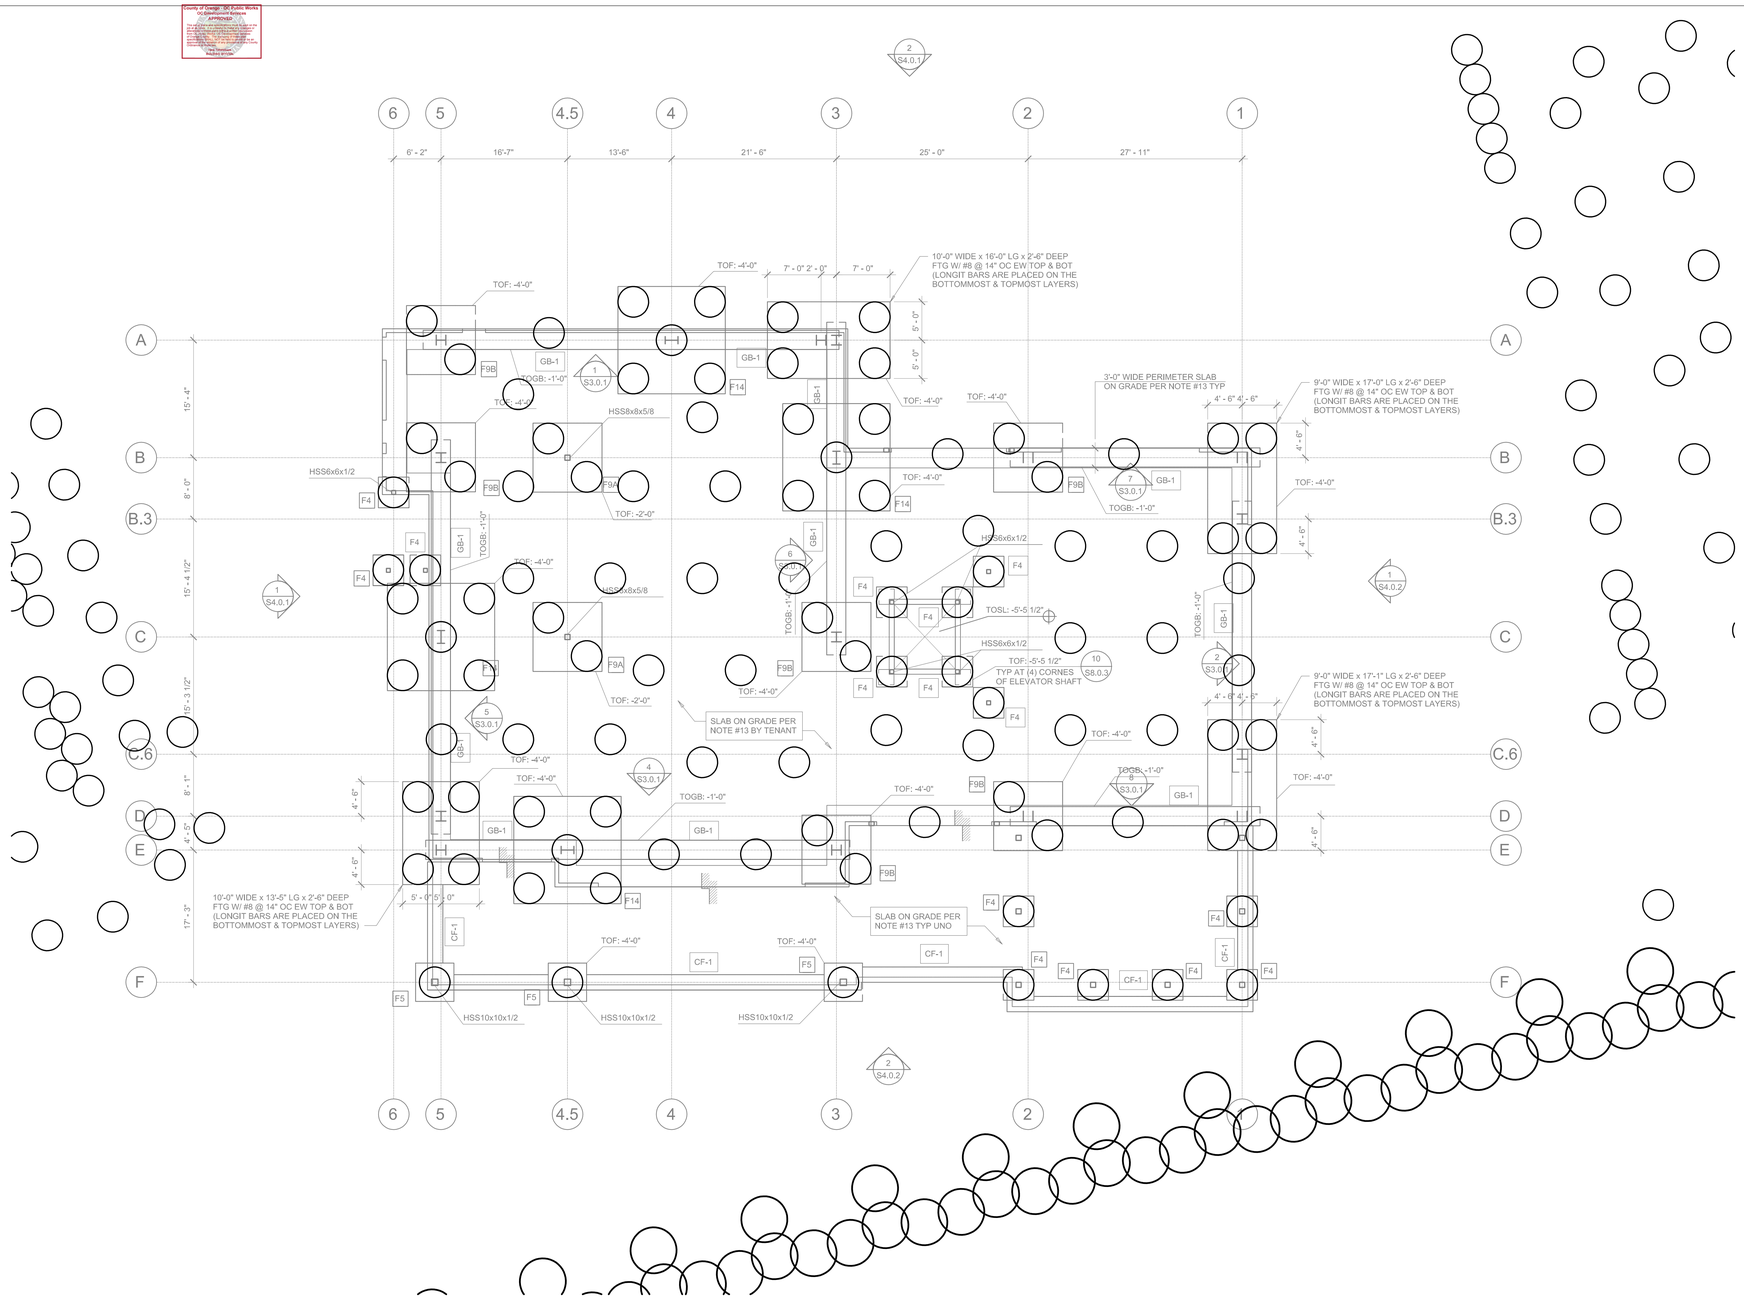

DSM COLUMN LAYOUT – BUILDING 10
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:

1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 10

PROJECT NO. –

DATE: 05/27/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.6

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP1-0248BMEP2-0241BMEP3-0242BMEP4-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
Your plans are approved for construction as noted on the set of plans. It is your responsibility to obtain all necessary permits and clearances from all departments and agencies having jurisdiction over your project. Approval does not authorize violation of any code or regulation. Approval of revised plans must be obtained for changes made during construction.
Greg Immesoete
PERMIT INTERN

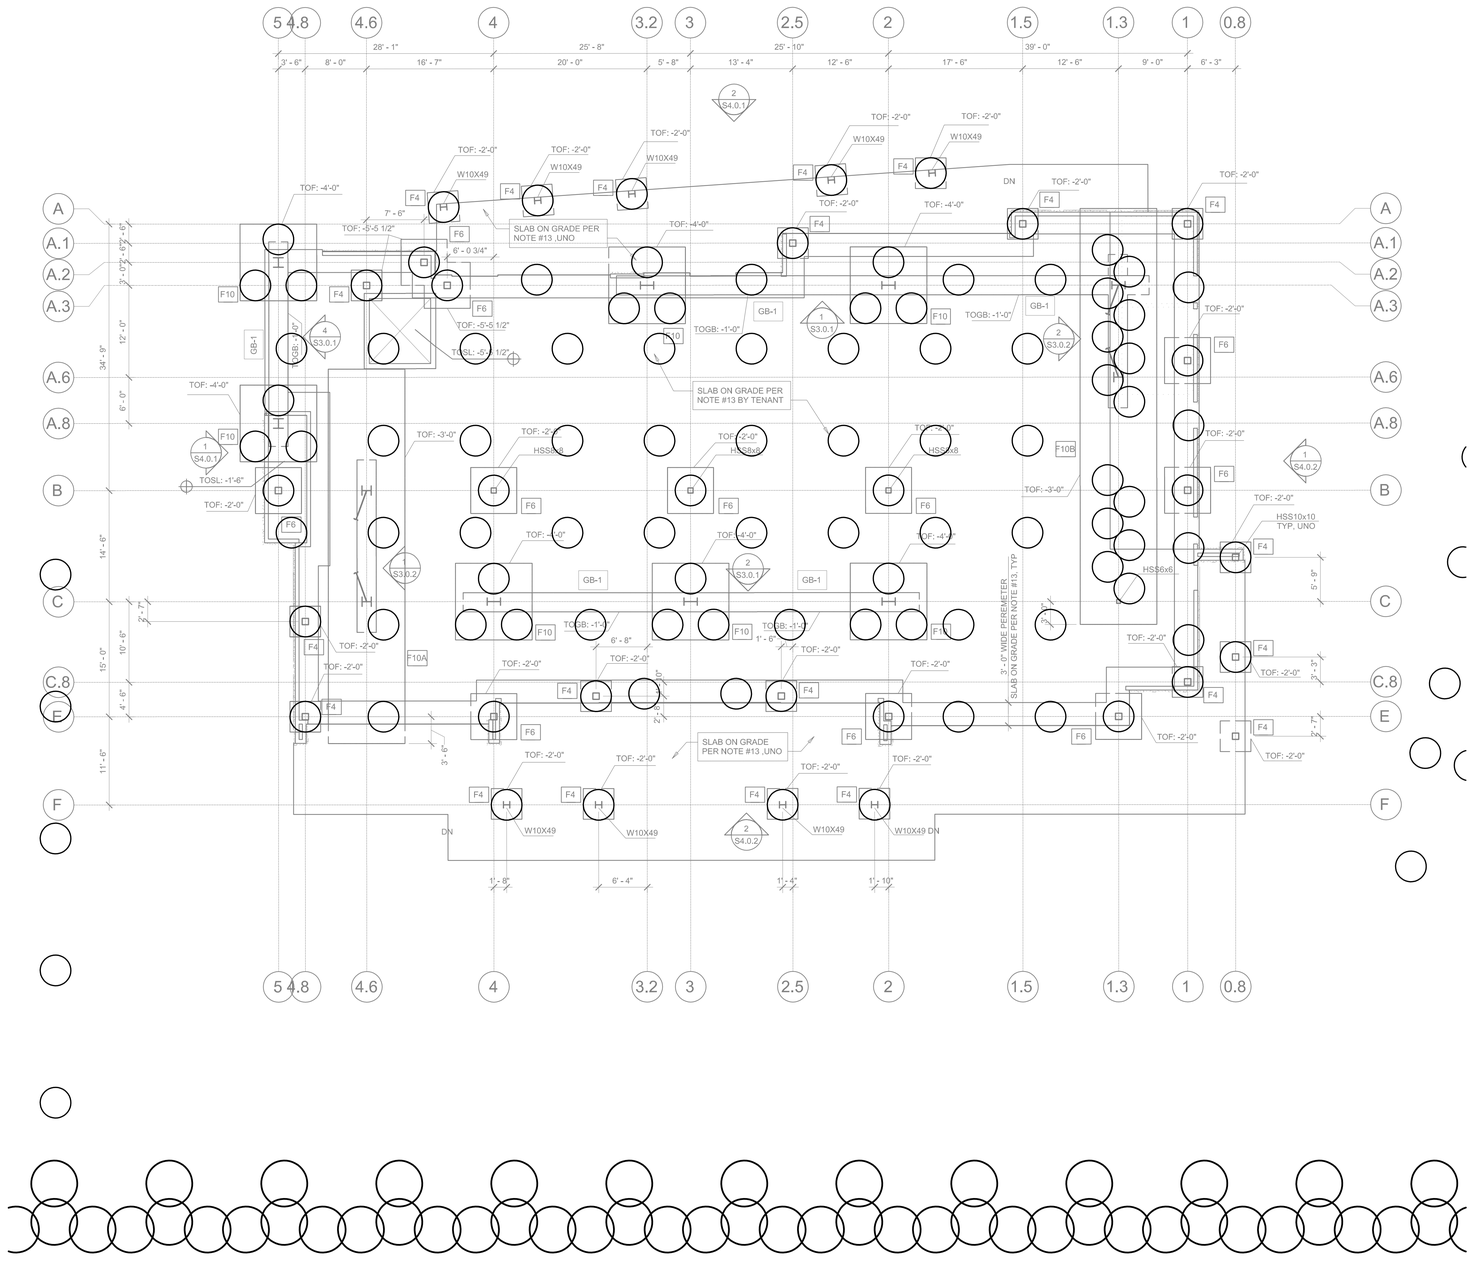

DSM COLUMN LAYOUT – BUILDING 11
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:

1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 11

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN

SHEET NUMBER: GI-4.7

S:\Leeds\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approved: Geotechnical Reports
Permits:
BMSV-S1409/BMSV-S31/BMSV-S34/BMSV-S343

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
Your plans are approved for construction subject to all applicable conditions imposed by ordinance or law. By this approval the County of Orange does not assume responsibility for any omissions or errors that may exist. Approval of any construction work is conditioned upon full compliance with all County of Orange regulations.
Jay Crittenden
PUBLIC WORKS

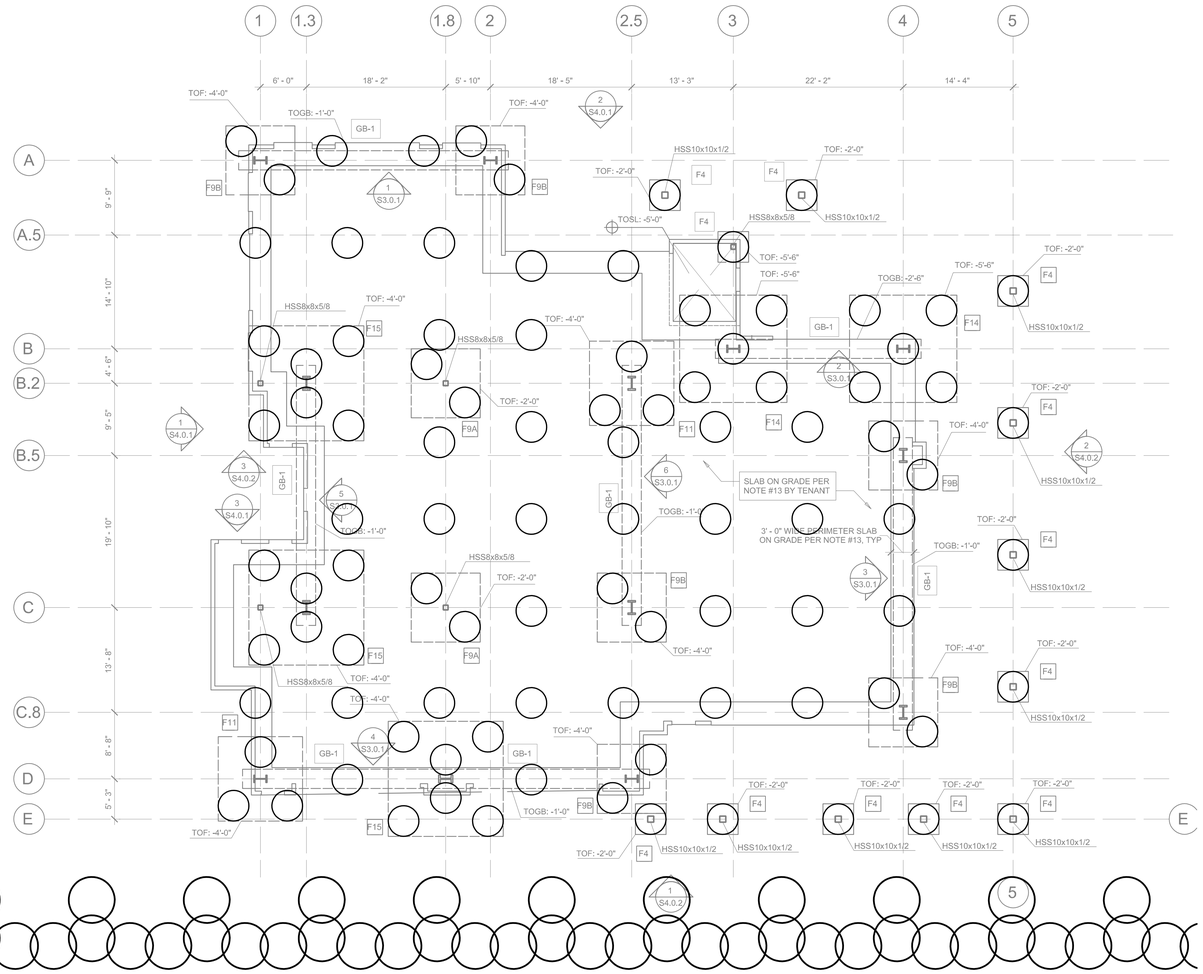

DSM COLUMN LAYOUT – BUILDING 12
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 12

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN

SHEET NUMBER:
GI-4.8

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BWDI-GAMBWRG1-02413MRD1-02422MRV1-0243

County of Orange OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
These plans and specifications have been approved for use in the County of Orange unincorporated territory in accordance with the Building Code, Grading Code, Fire Code, or Subdivision Ordinance. Approval of these plans and specifications does not permit any violation of any section of the Building Code, Grading Code, Fire Code, or Subdivision Ordinance.
Troy Danielson
Inspection Services

A

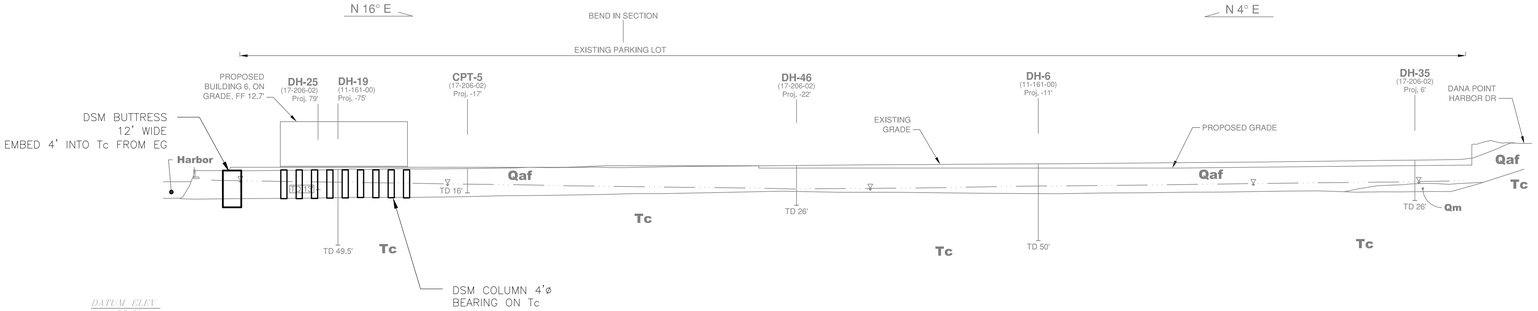

A'

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION A - A'
SCALE: 1" = 40'

B

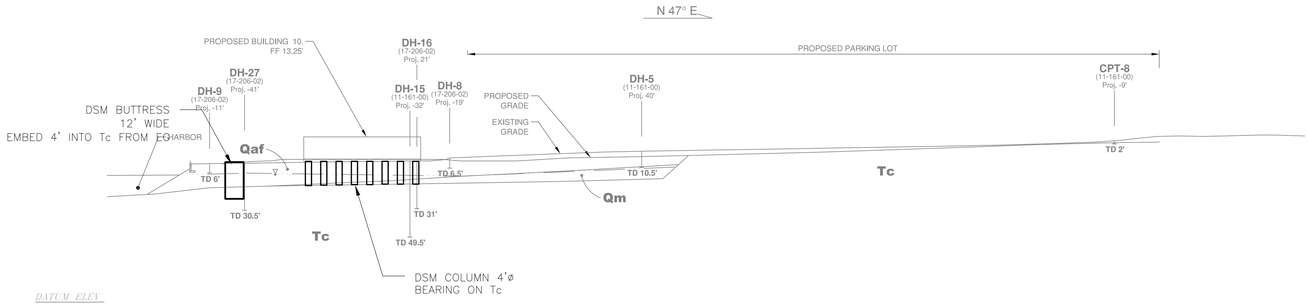

B'

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION B - B'
SCALE: 1" = 40'

C

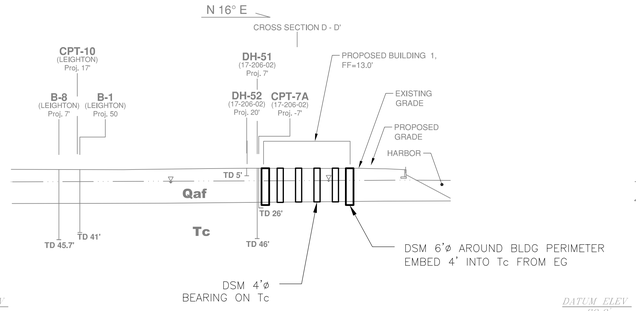

C'

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION C - C'
SCALE: 1" = 40'

D

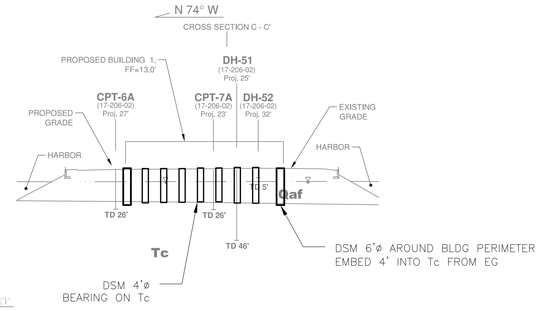

D'

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION D - D'
SCALE: 1" = 40'

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 STATE OF CALIFORNIA CIVIL

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

GEOTECHNICAL
SECTIONS

PROJECT NO.	SHEET NUMBER:
–	GI-5
DATE: 05/27/2021	
SCALE: AS SHOWN	

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B1

Pseudostatic Slope Stability Analysis

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

1.023

0.26

Material Name	Color	Unit Weight (lbs/ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Tensile Strength (psf)
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Automatically Calculated	0
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Automatically Calculated	0
Tc		125	Mohr-Coulomb	695	34			Water Surface	Automatically Calculated	
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Automatically Calculated	
Liquefied 1		125	Vertical Stress Ratio			0.17	0	Water Surface	Automatically Calculated	0
Liquefied 2		125	Vertical Stress Ratio			0.1	0	Water Surface	Automatically Calculated	0
Liquefied 3		125	Vertical Stress Ratio			0.5	0	Water Surface	Automatically Calculated	0
DSM		125	Mohr-Coulomb	7200	0			Water Surface	Automatically Calculated	

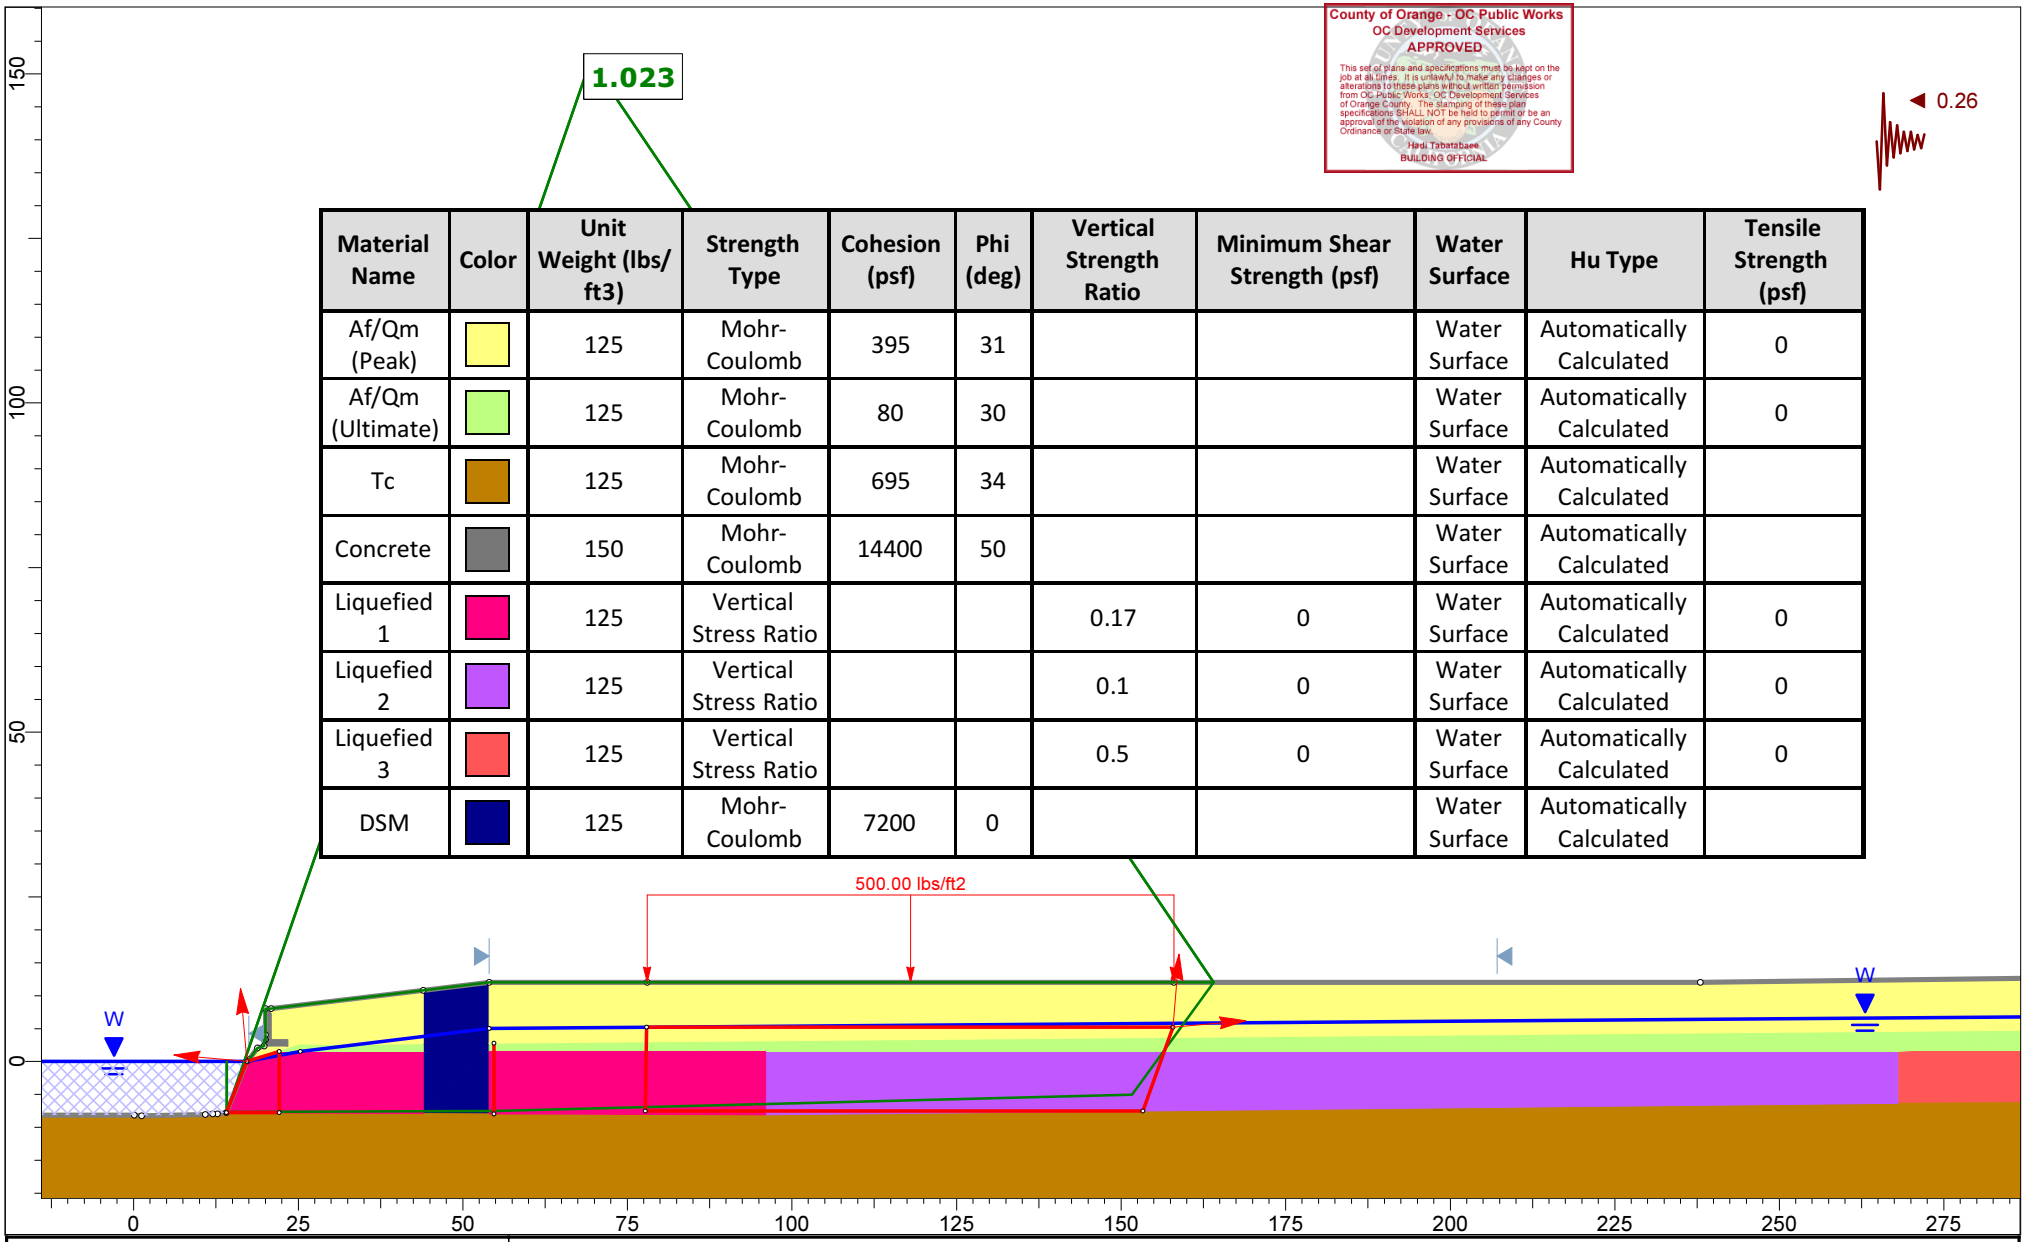

SLIDEINTERPRET 9.012

Project	Dana Point Harbor		
Group	DSM_10ft	Scenario	kh=0.26 Block Search
Drawn By	TT	Company	AGI
Date		File Name	Section_Arev.slmd

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

Material Name	Color	Unit Weight (lbs/ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Hu	Ru
Liquefied 1		125	Vertical Stress Ratio			0.25	0	Water Surface	Custom	1	
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Custom	1	
Tc		125	Mohr-Coulomb	695	34			None			0
Liquefied 2		125	Vertical Stress Ratio			0.1	0	Water Surface	Custom	1	
Liquefied 3		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1	
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Custom	1	
DSM		125	Mohr-Coulomb	20000	0			Water Surface	Custom	1	
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Custom	1	

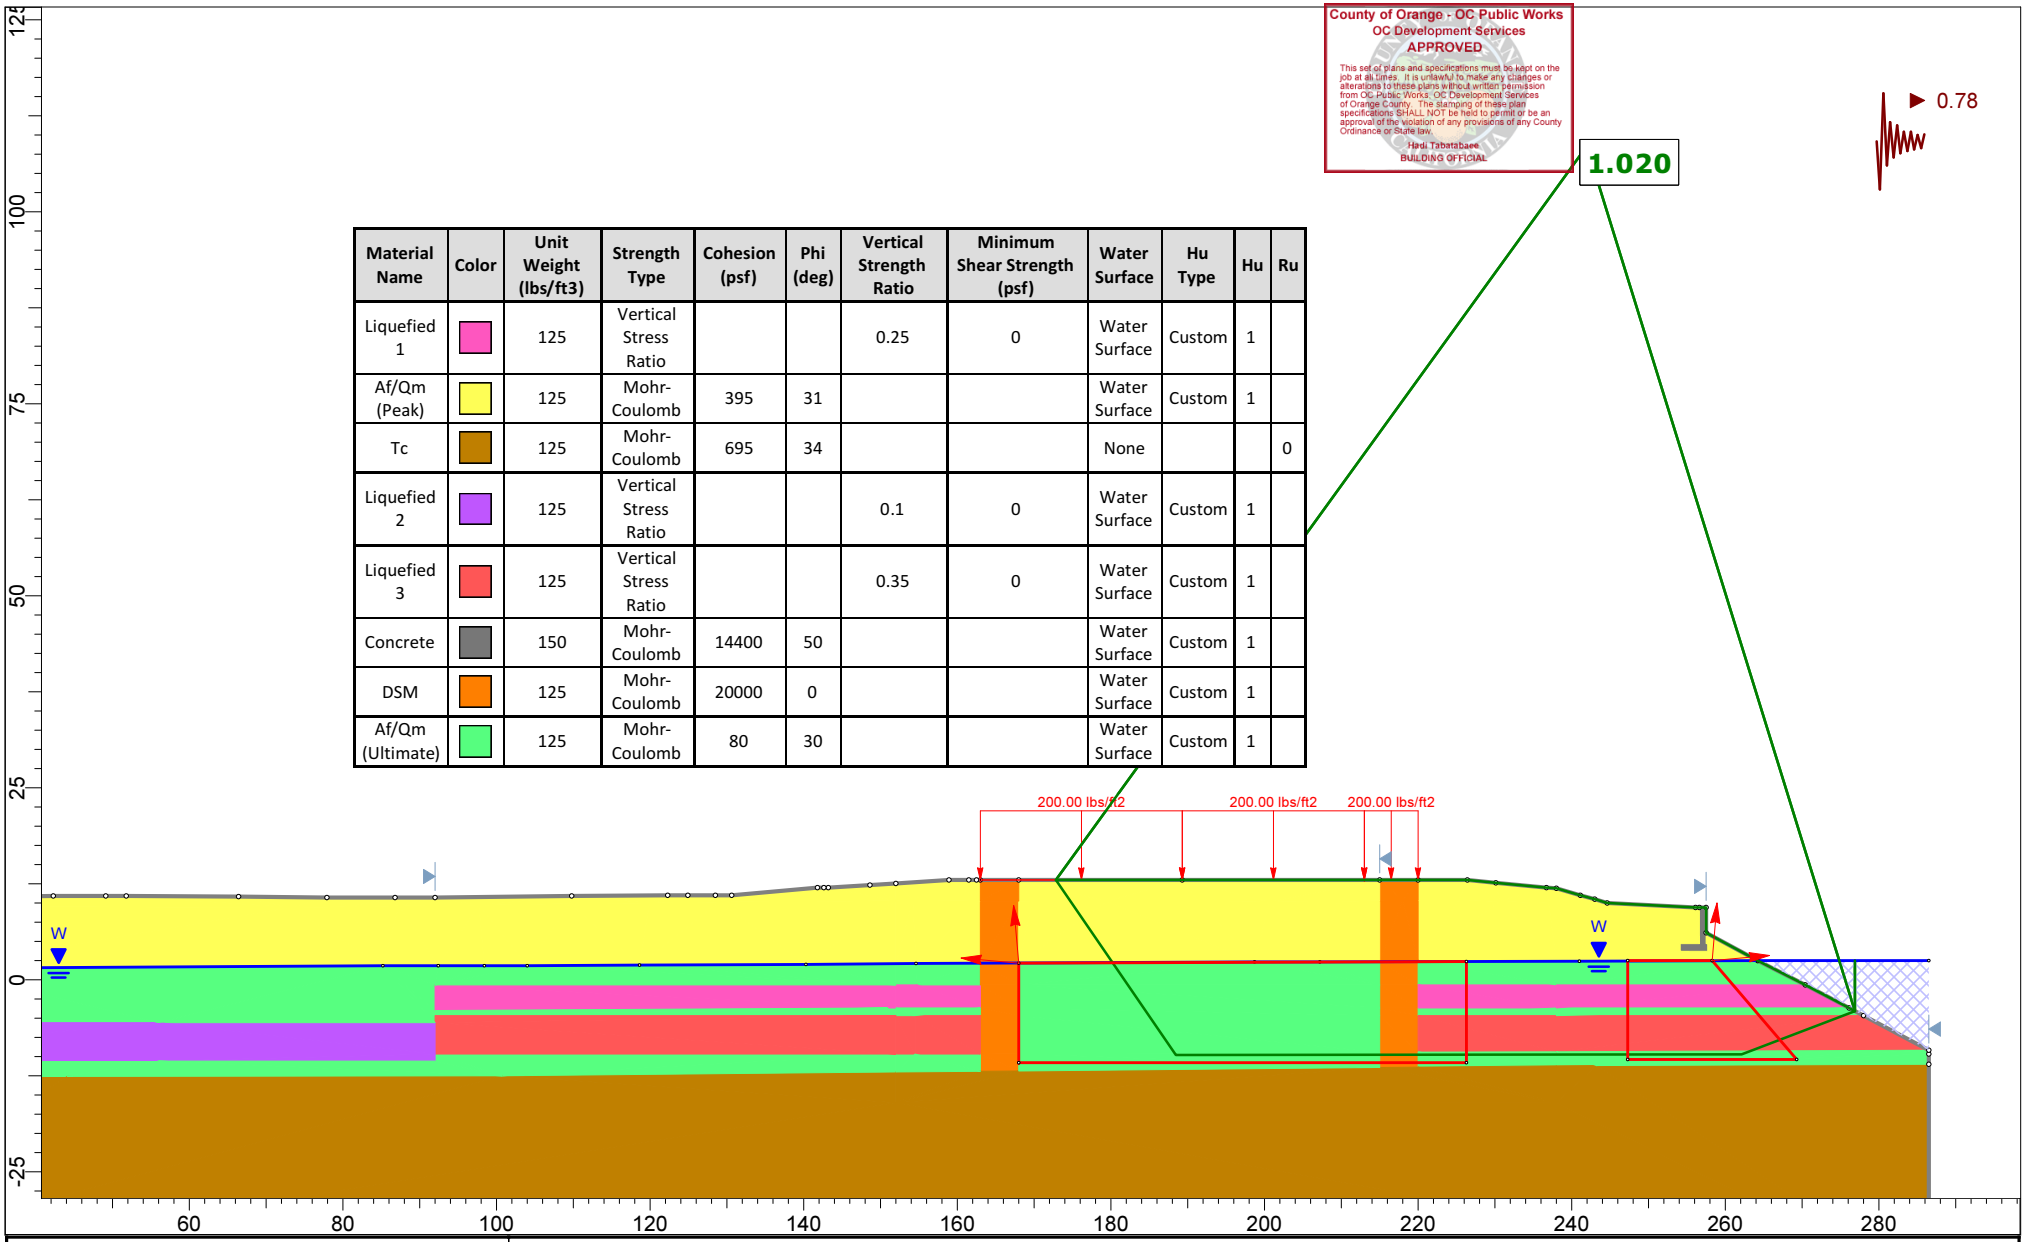

AGI	Project	Dana Point Harbor	
	Group	Group 1	Scenario kh=0.78 Block Search
	Drawn By	TT	Company AGI
	Date		File Name Section_C.slmd

SLIDEINTERPRET 9.012

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
1067
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations without the written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Material Name	Color	Unit Weight (lbs/ft3)	Strength Type	Cohesion (psf)	Phi (deg)	Vertical Strength Ratio	Minimum Shear Strength (psf)	Water Surface	Hu Type	Hu
Af/Qm (Peak)		125	Mohr-Coulomb	395	31			Water Surface	Custom	1
Tc		125	Mohr-Coulomb	695	34			Water Surface	Custom	1
Liquefied 4		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1
Liquefied 2		125	Vertical Stress Ratio			0.55	0	Water Surface	Custom	1
Liquefied 3		125	Vertical Stress Ratio			0.3	0	Water Surface	Custom	1
Liquefied 5		125	Vertical Stress Ratio			0.35	0	Water Surface	Custom	1
Concrete		150	Mohr-Coulomb	14400	50			Water Surface	Custom	1
Af/Qm (Ultimate)		125	Mohr-Coulomb	80	30			Water Surface	Custom	1
DSM		125	Mohr-Coulomb	20000	0			Water Surface	Custom	1

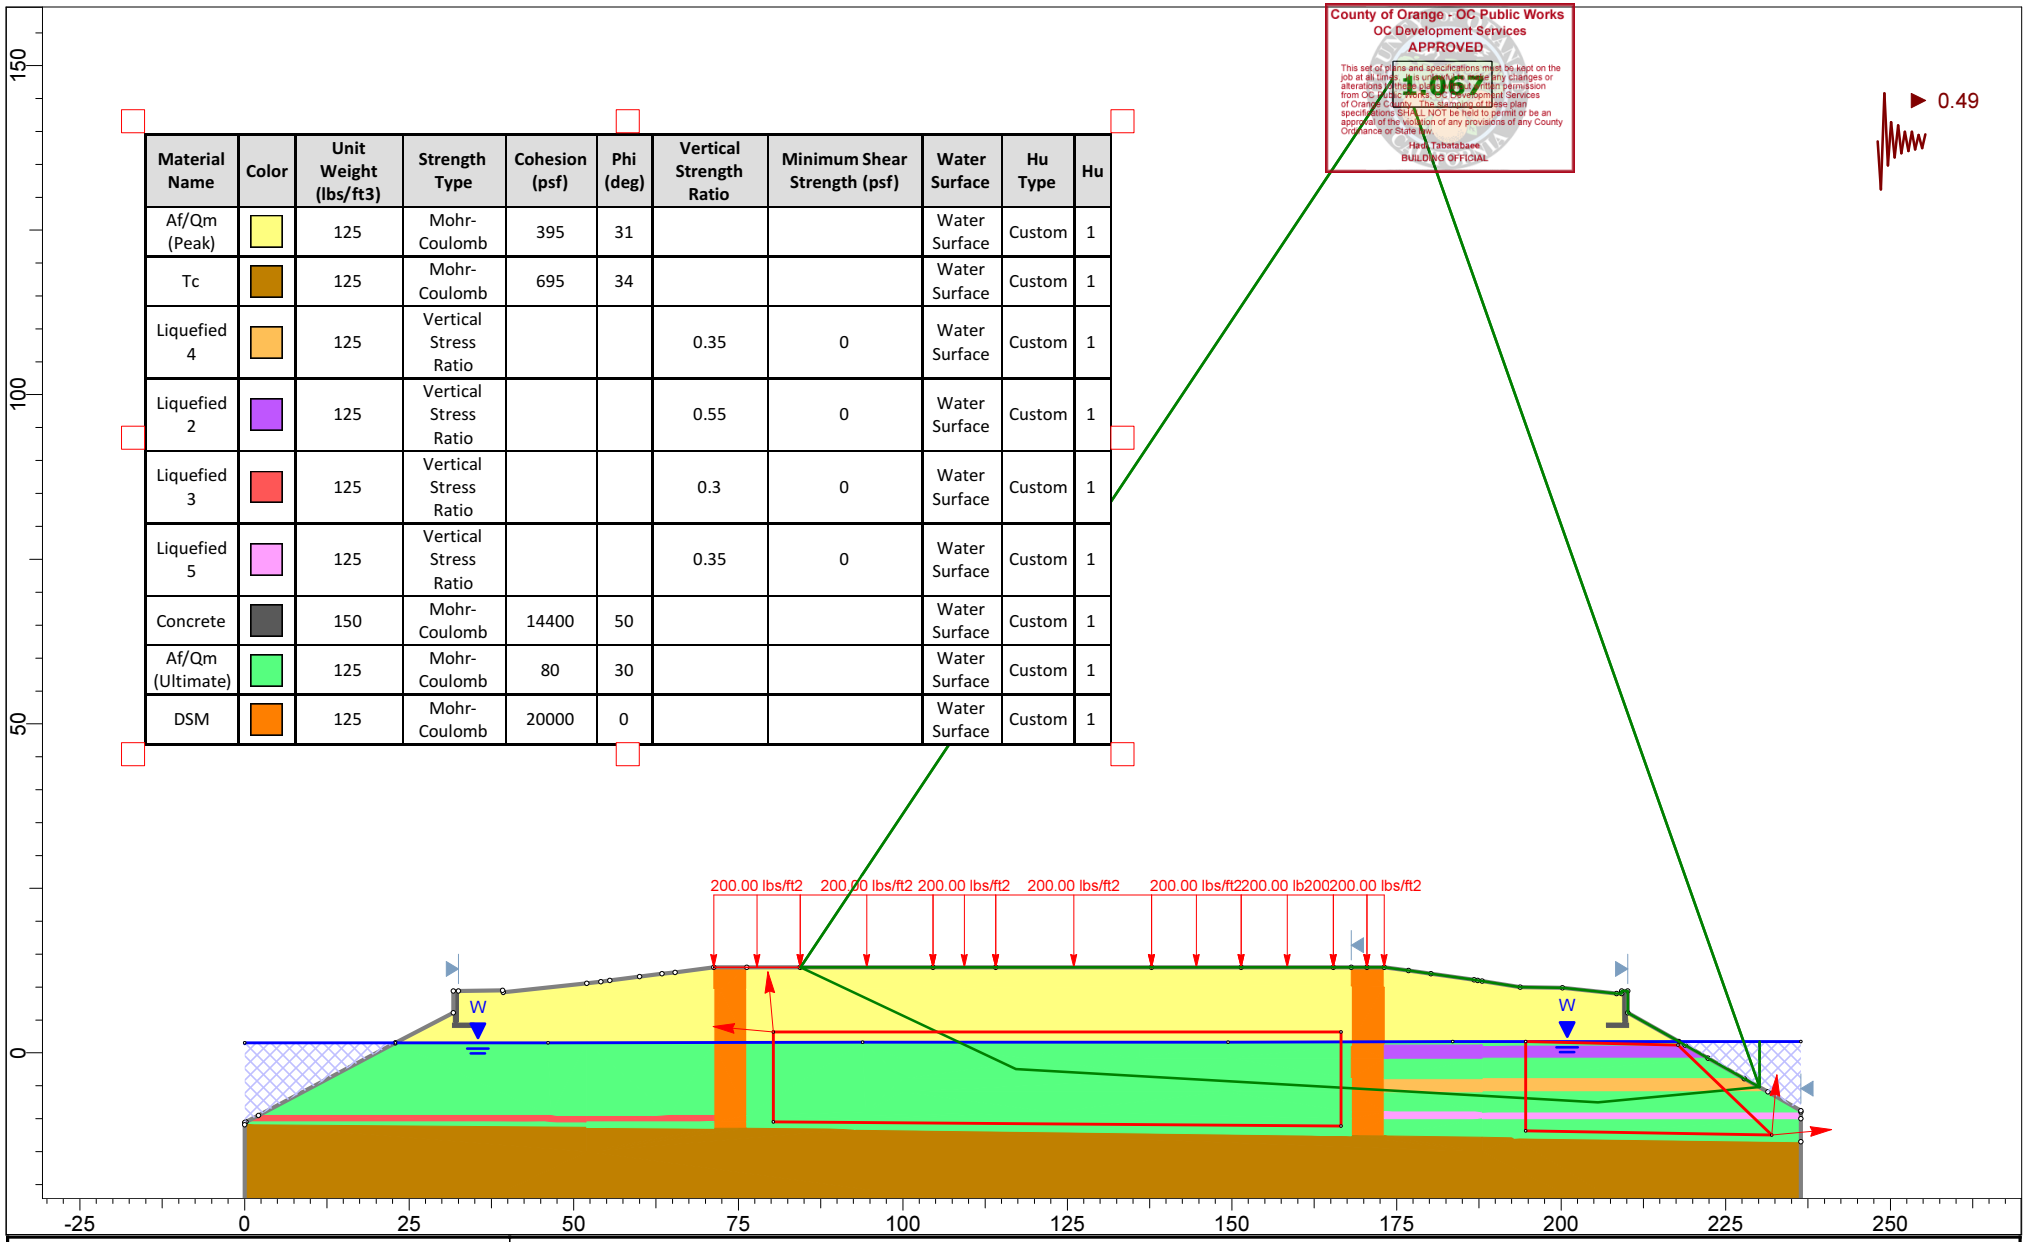

SLIDEINTERPRET 9.012

Project	Dana Point Harbor		
Group	Group 1	*Scenario*	kh=0.5 Block Search
Drawn By	TT	*Company*	AGI
Date	4/15/2021	*File Name*	Section_D.slmd

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B2

Composite Shear Strength of DSM Buttress

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Determine composite shear strength of DSM buttress for use in pseudostatic slope stability anlysis
Lateral stread buttress

Geometry:

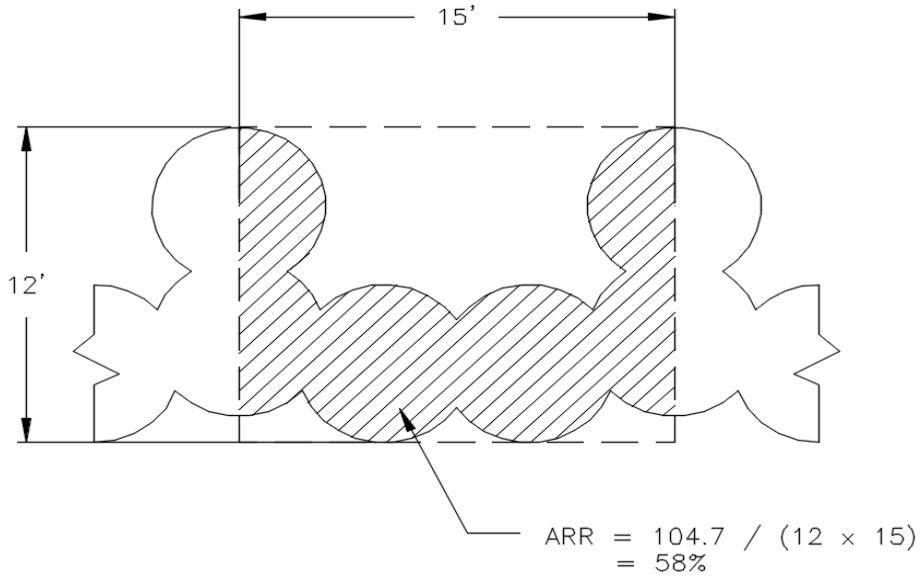

Input values:

ARR =	**58%**		Area replacement ratio
q_DSM28 =	**150**	psi	Design compressive strength of DSM at 28 days
fc =	**2**		Curing factor (long term)

Calculations:

q_DSM =	300	psi	Long term compressive strength of DSM for seismic condition
s_DSM =	150	psi	Shear strength of DSM = 1/2 compressive strength
=	21600	psf	
s_comp =	12528	psf	Composite shear strenght = s_DSM x ARR (Neglect shear strength of native soils)

Select conservative value of **7200 psf** to ensure strain compatibility

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B3

Post-Improvement Slope Lateral Deformation

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.26**	g
Correlated displacement in soils - West US region	d	**1.4**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.49**	g
Correlated displacement in soils - West US region	d	**0.1**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Seismic Displacement Calculation

Reference: NCHRP 611

Inputs

PGA modified for site class	k_max	**0.67**	g
Earthquake magnitude	M	**6.9**	
Spectral acceleration at 1 sec	S1	**0.45**	g

Calculated

$$\ln(\mathrm{PGV}) = 3.97 + 0.94\ln(S_1) + 0.013\left(\ln(S_1) + 2.93\right)^2 + 0.063M \qquad (5\text{-}9)$$

Peak ground velocity	PGV	41.0	cm/s
		16.1	in/s

WUS-Soil:

$$\log(d) = -1.56 - 0.72\log\left(k_y/k_{\max}\right) + 3.21\log\left(1 - k_y/k_{\max}\right) - 0.87\log(k_{\max}) + 1.62\log(\mathrm{PGV}) \qquad (5\text{-}5)$$

Yield acceration from pseudo static analysis	k_y	**0.78**	g
Correlated displacement in soils - West US region	d	**0.0**	inches

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B4

Internal Stability Analysis

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM Internal Stability Design Calculations - Per FHWA (2013)

Input Parameters		
DSM Panel height (H_dm)=	24	ft
DSM Panel Width (B)=	12	ft
Panel Effective Width (b)=	5.2	ft
Chord Length (c)=	3.3	ft
s_shear=	15	ft
Replacement Ratio (a_s,shear) =	0.347	
Panel Bottom Ele. =	-12	ft
G.W. Ele. =	5	ft
Soil below DSM panel tip:		
Cohesion (C_m) =	695	psf
Friction angle (Phi_m)=	34	deg
Effective Unit Weight=	62.6	pcf
Soil above DSM panel tip:		
Effective Unit Weight=	62.6	pcf
DSM Strength (28 days) =	150	psi
DSM Strength (1 year) =	300	psi
DSM Panel Unit Weight=	125	pcf
Lateral Seismic Coefficient (k_h) =	0.19	g
P_ae =	23,959	lbs/ft
h_a=	8.0	ft
P_p (Rankin or Coulomb Methods)=	31,411	lbs/ft
h_p=	2.5	ft
Va=	7,188	lbs/ft
Vp=	9,423	lbs/ft

Force Calculations		
Panel Weight (W)=	36000	lbs/ft
Buoyancy Force (U)=	12,730	lbs/ft
Inertial Load on Panel (Fa)=	6840	lbs/ft
T=	22528	lbs/ft
N=	33,764	lbs/ft
N'=	21,035	lbs/ft
x_N=	3.17	ft
x_N'=	1.46	ft

Combined Overturning and bearing capacity failure		
q_toe=	24,438	psf
N'c=	42.2	
N'q=	29.4	
N'_gamma (Vesic 1975)=	41.1	
q_all =	80,218	psf
Is Demand < Allowable?	DESIGN OK	

Crushing of DSM Panel at the outside toe		
q_toe=	24,438	psf
fv=	0.95	
Fc=	1.3	
S_dm	21600	psf
Vertical Eff. Pressure at the toe ele	1689	psf
q_all =	32,414	psf
Is Demand < Allowable?	DESIGN OK	

Racking Failure Mode		
T_v=	905	psf
fv=	0.95	
Fv=	1.3	
Tv_all=	3,494	psf
Is Demand < Allowable?	DESIGN OK	

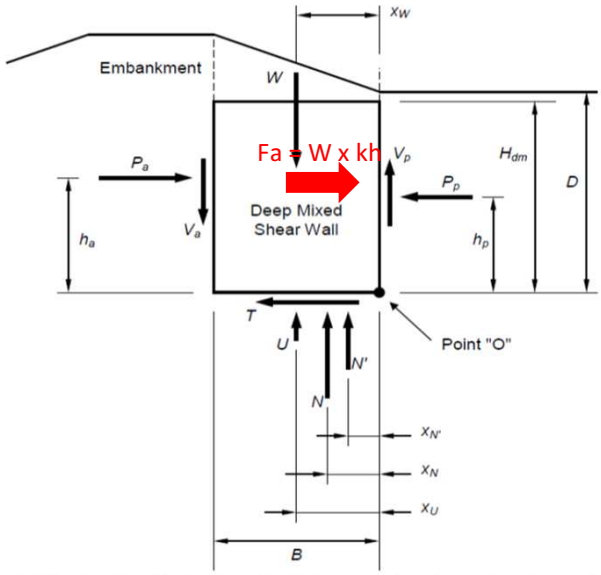

Figure 51. Illustration. Definition sketch for combined overturning and bearing calculations.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Check internal shear

Shear force	46000	lbs/ft	(Given)
Panel spacing	15	ft	
DSM section area per panel	104.7	sf	(Per 15' of length, and including continuous front row)
DSM compressive strength	150	psi	
Available shear strength	75	psi	
Shear stress	46	psi	
Factor of savefy	1.64		OK

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C1

DSM Column Structural Capacity

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Structural Capacity of 4ft dia. DSM column - Static Condition

Column Diameter=	**4.0**	
F.S.=	**1.5**	
UCS, 28-day strength (psi)=	**150**	
Curing Factor (fc) =	**1.00**	28-day strength
Confining Pressure effects =	**1**	
UCS, 90-day strength (psi)=	**150**	
Allowable pressure (psf)	14400	
Allowable load (kips)	181.0	
Max. Demand - ASD Level (kips)	**180**	
Is Capacity >= Demand?	**Yes**	

Structural Capacity of 4ft dia. DSM column - Post Liquefaction

Column Diameter=	**4.0**	
F.S.=	**1.3**	
UCS, 28-day strength (psi)=	**150**	
Curing Factor (fc) =	**2.00**	365-day strength
Confining Pressure effects =	**1**	
UCS, 365-day strength (psi)=	**300**	
Allowable pressure (psf)	33231	
Allowable load (kips)	417.6	
Max. Demand - ASD Level (kips)	**308**	including 128k downdrag
Is Capacity >= Demand?	**Yes**	

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C2

DSM Column Geotechnical Capacity

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the Authorities: OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM GEOTECHNICAL CAPACITY

PROJECT INFORMATION

Version 1.0

Project Name: Dana Point
Borehole Number: (11-161-00) DH-17
Project Number: N/A
Drawing ref:
Calculation By: **Thomas Tran** Reviewed By: **Justin Martos**

Date 01/08/21

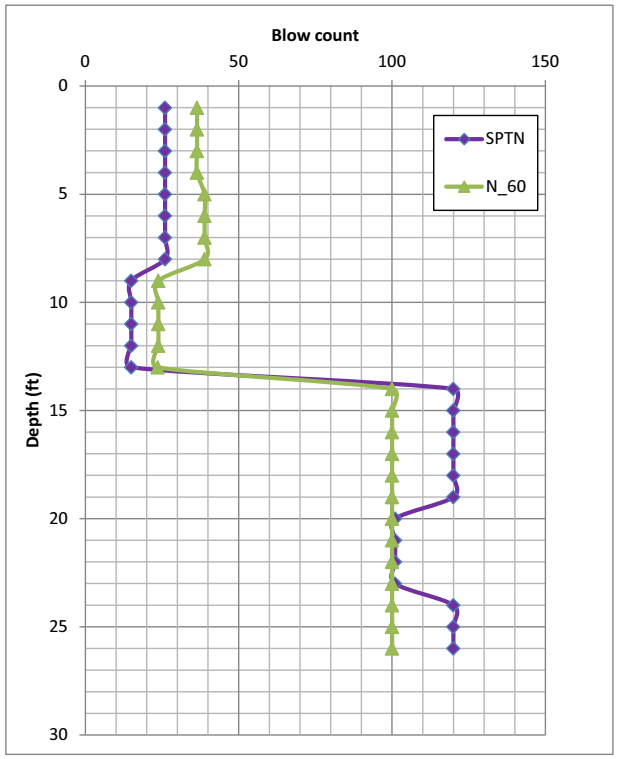

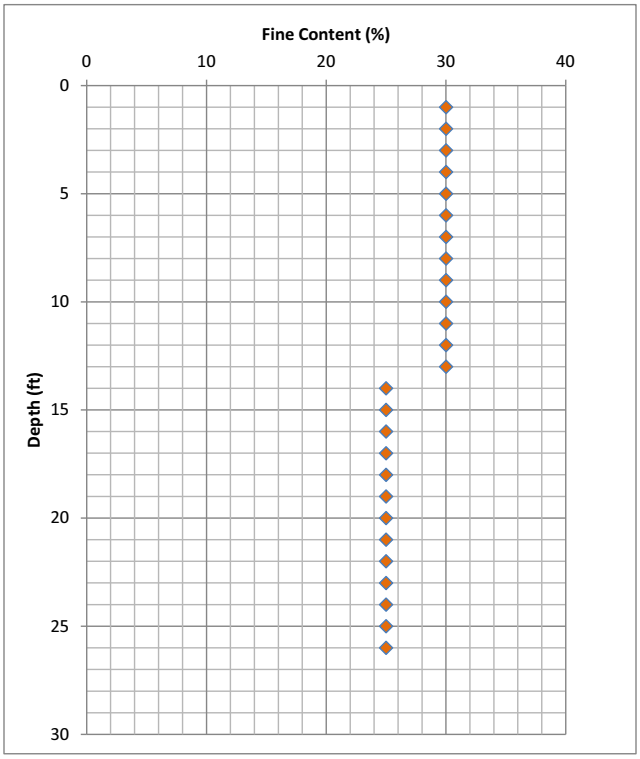

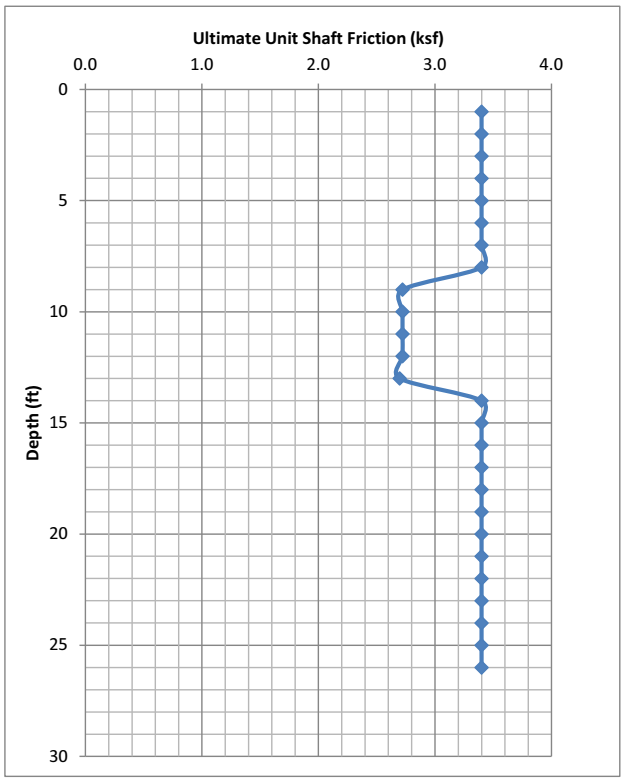

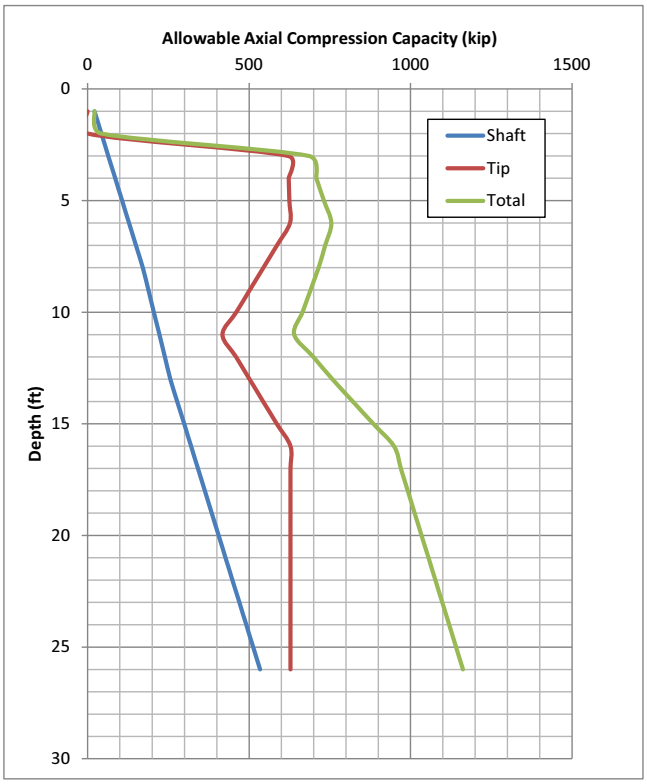

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from the OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM GEOTECHNICAL CAPACITY

PROJECT INFORMATION

Version 1.0

Project Name: Dana Point
Borehole Number: (11-161-00) DH-19
Project Number: N/A
Drawing ref:
Calculation By: **Thomas Tran** Reviewed By: **Justin Martos**

Date 01/08/21

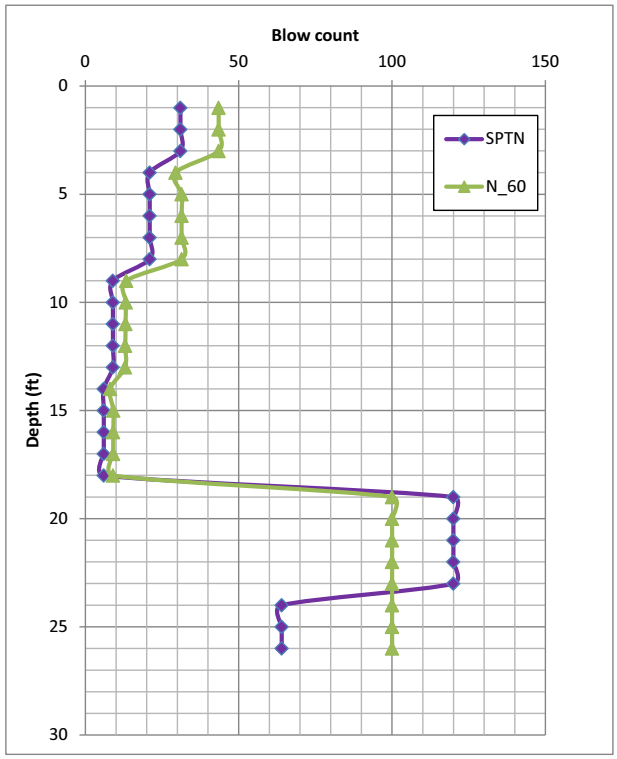

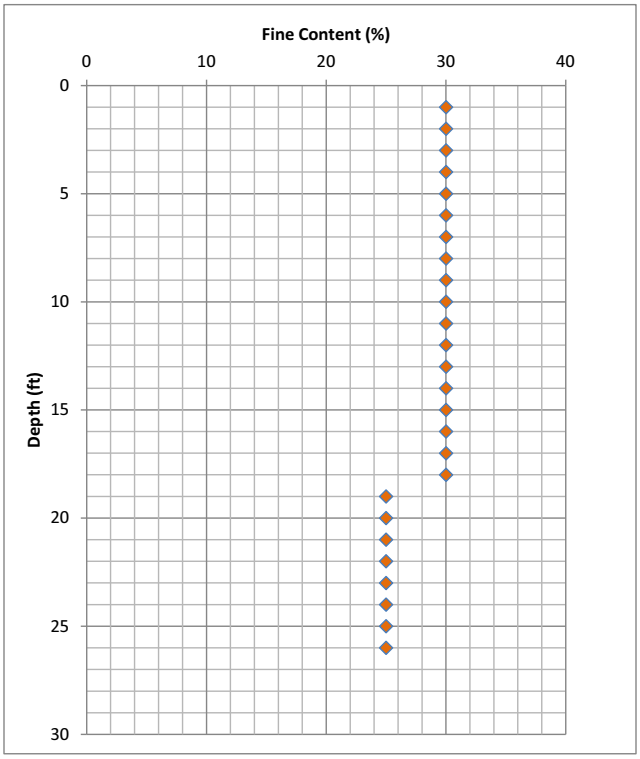

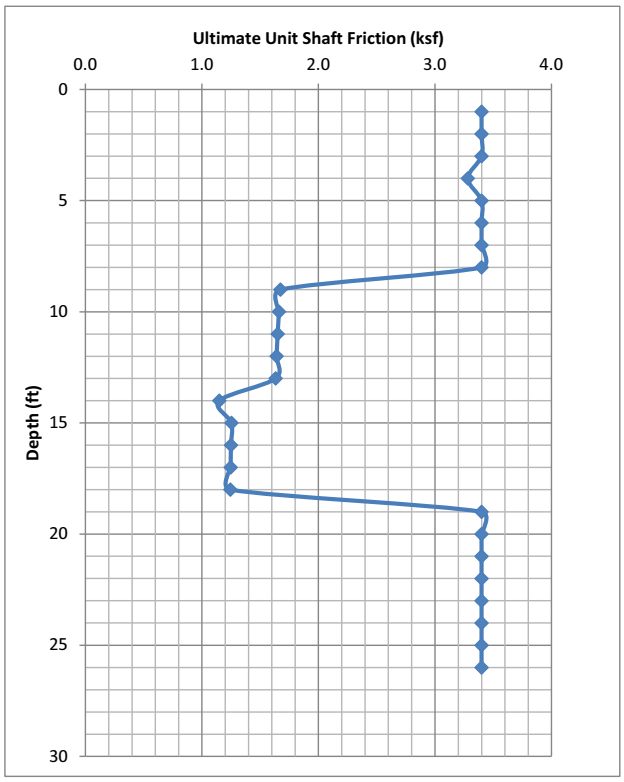

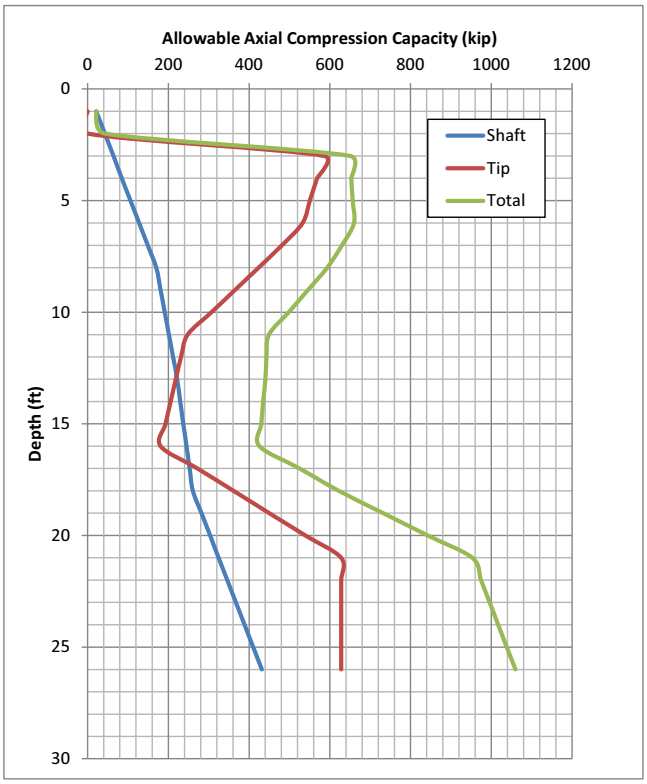

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM GEOTECHNICAL CAPACITY

PROJECT INFORMATION

Version 1.0

Project Name: Dana Point
Borehole Number: (17-206-02) DH-25
Project Number: N/A
Drawing ref:
Calculation By: **Thomas Tran** Reviewed By: **Justin Martos**

Date 01/08/21

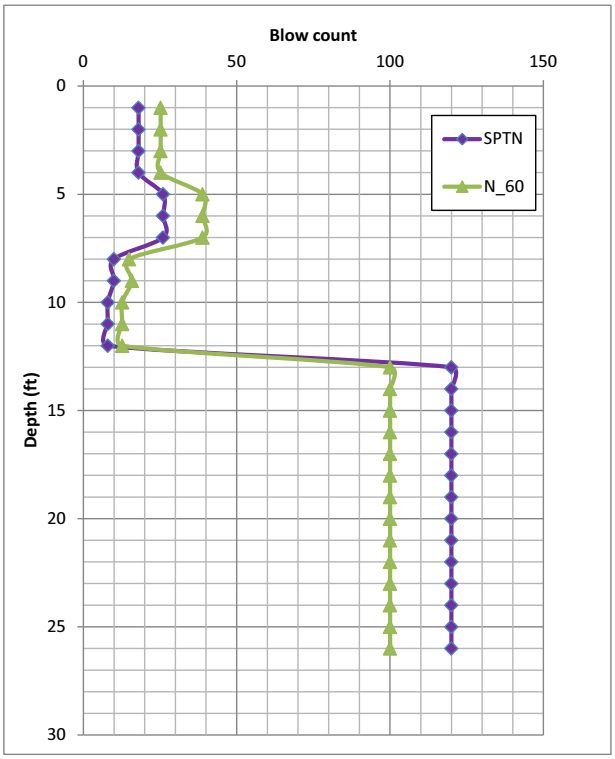

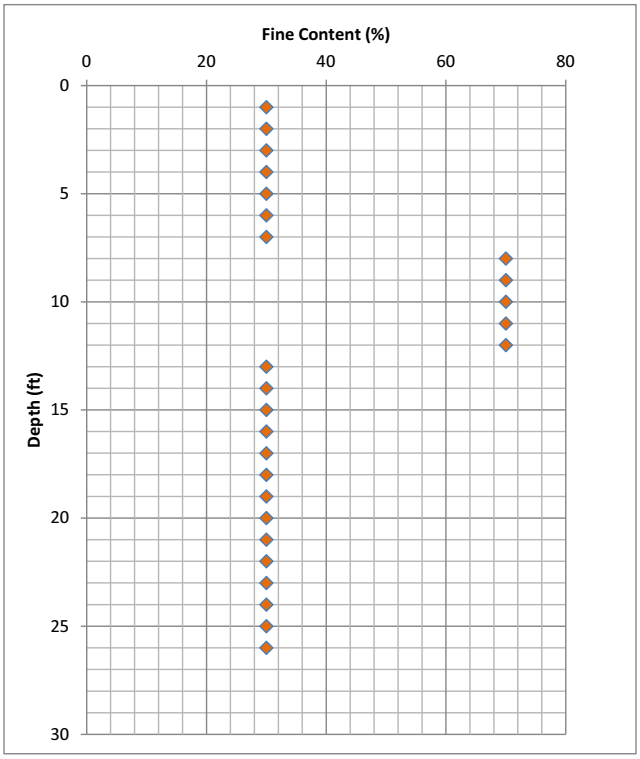

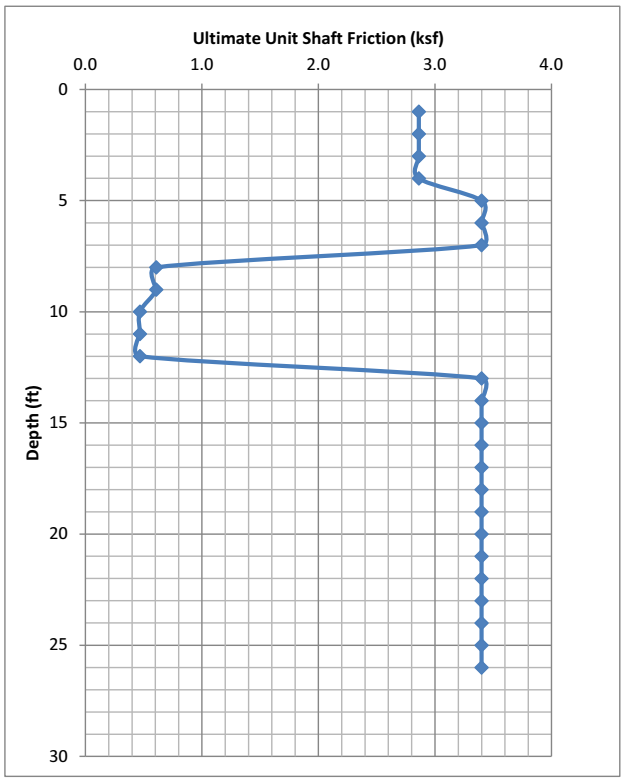

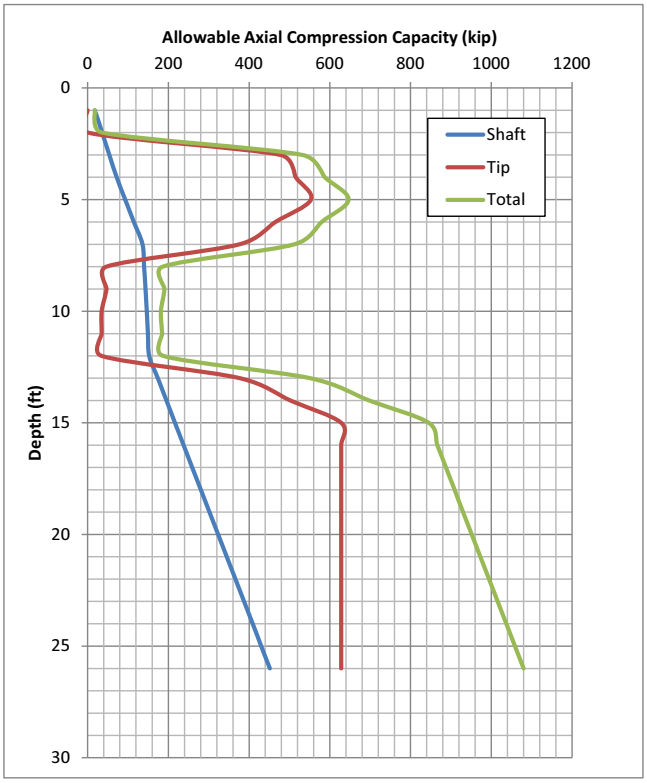

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DSM GEOTECHNICAL CAPACITY

PROJECT INFORMATION

Version 1.0

Project Name: Dana Point
Borehole Number: (17-206-02) DH-26
Project Number: N/A
Drawing ref:
Calculation By: **Thomas Tran** Reviewed By: **Justin Martos**

Date 01/08/21

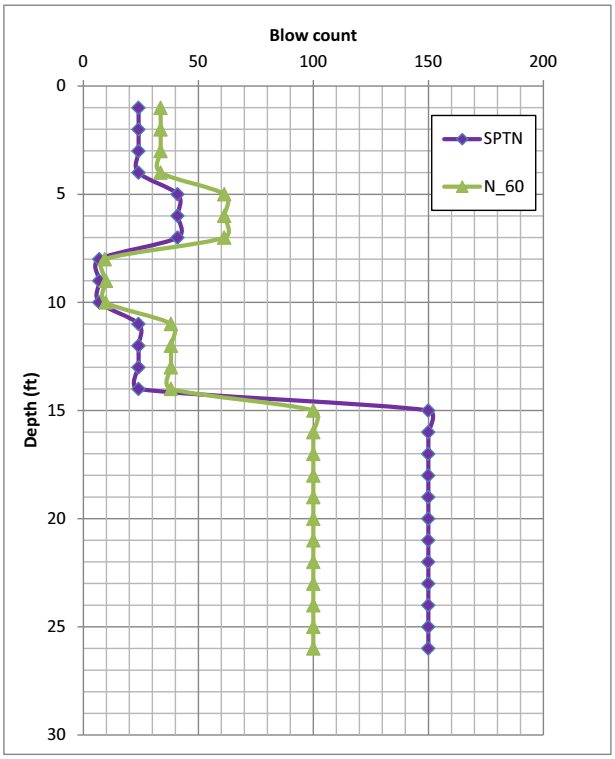

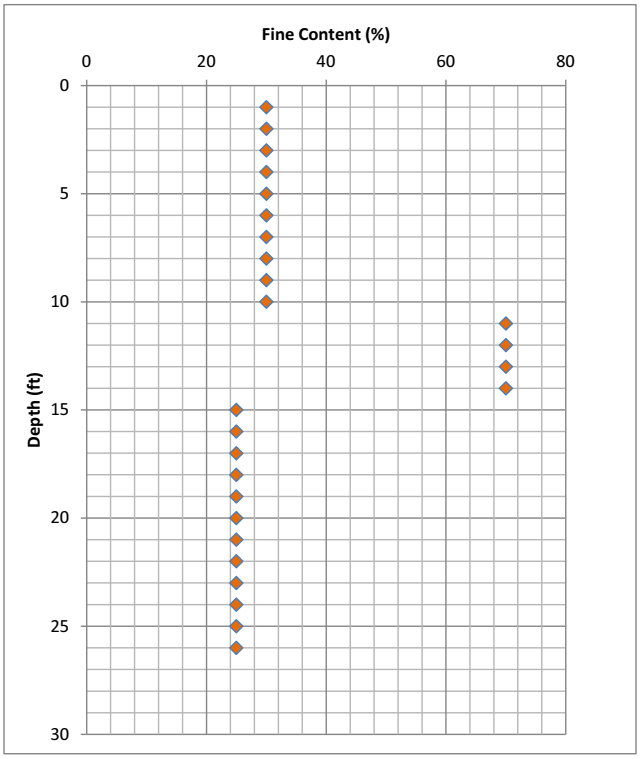

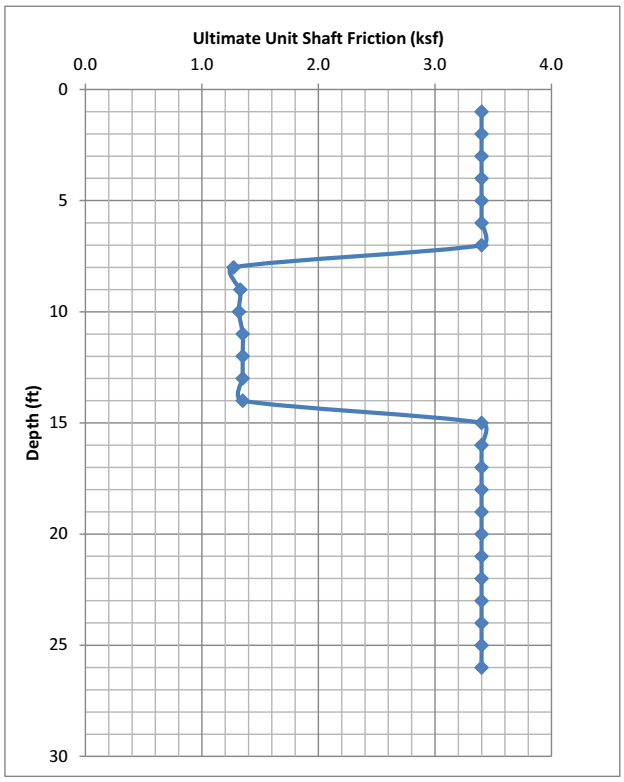

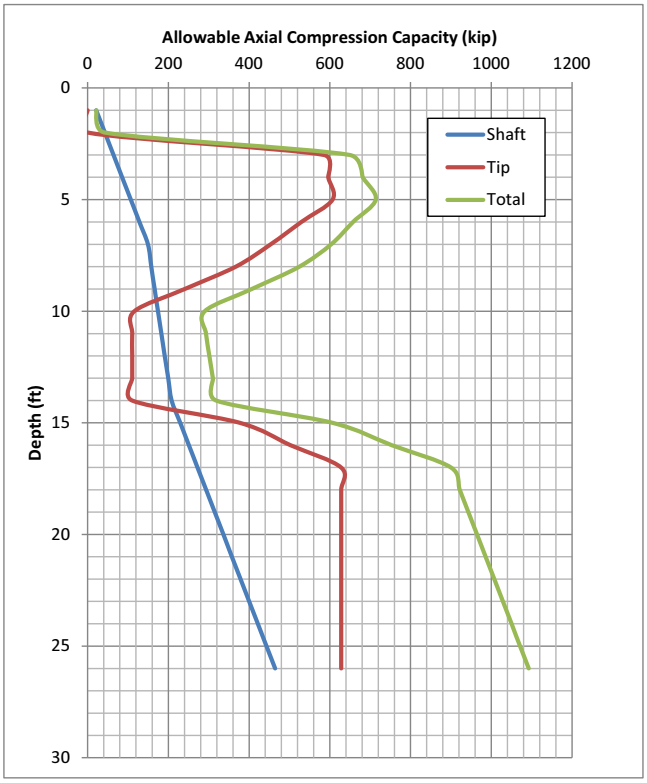

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C3

DSM Column Settlement

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Tzpile Analysis Information

Project Summary

File Name DPH DSM 4ft.rspile
File Version 0.000

Project Title Dana Point Harbor
Analysis DSM 4ft
Date Created 10/25/2018, 8:32:35 AM

Results

Axial Force vs Settlement

Pile Head Axial Force (lbs)	Pile Head Settlement (in)	Pile Toe Axial Force (lbs)	Pile Toe Settlement (in)
200000.00	0.48	81394.78	0.02

Axial Displacement, Axial Force

Axial Displacement, Axial Force

Soil Layer #	Pile Depth (ft)	Axial Displacement (in)	Axial Force (lbs)
1	-0.00	0.477455	200000.0000
1	0.20	0.47156	199985.3497
1	0.40	0.465667	199941.3987
1	0.60	0.459775	199868.1472
1	0.80	0.453886	199765.5950
1	1.00	0.448	199633.7422
1	1.20	0.442119	199472.5887
1	1.40	0.436242	199282.1347
1	1.60	0.430372	199062.3800
1	1.80	0.424509	198813.3247
1	2.00	0.418653	198534.9687
1	2.20	0.412806	198227.3122
1	2.40	0.406969	197890.3550
1	2.60	0.401142	197524.0973
1	2.80	0.395326	197128.5389
1	3.00	0.389522	196703.6799
1	3.20	0.383732	196249.5203
1	3.40	0.377955	195766.0602
1	3.60	0.372192	195253.2994
1	3.80	0.366446	194711.2381
1	4.00	0.360715	194139.8762
1	4.20	0.355002	193539.2138
1	4.40	0.349307	192909.2508
1	4.60	0.343631	192249.9873
1	4.80	0.337975	191561.4233
1	5.00	0.33234	190843.5588
1	5.20	0.326726	190096.3938
1	5.40	0.321135	189319.9283

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

1	5.60	0.315567	188514.1624
1	5.80	0.310023	187679.0960
1	6.00	0.304504	186814.7292
1	6.20	0.299011	185921.0621
1	6.40	0.293545	184998.0946
1	6.60	0.288107	184045.8267
1	6.80	0.282697	183064.2586
1	7.00	0.277316	182053.3901
1	7.20	0.271966	181013.2215
1	7.40	0.266647	179943.7526
1	7.60	0.26136	178844.9835
1	7.80	0.256105	177716.9143
1	8.00	0.250884	176559.5450
1	8.20	0.245698	175372.8756
1	8.40	0.240547	174156.9062
1	8.60	0.235432	172911.6369
1	8.80	0.230355	171637.0676
1	9.00	0.225316	170333.1984
1	9.20	0.220315	169000.0293
1	9.40	0.215354	167637.5605
1	9.60	0.210434	166245.7920
1	9.80	0.205555	164824.7237
1	10.00	0.200718	163374.3559
1	10.20	0.195925	161894.6885
1	10.40	0.191176	160385.7216
1	10.60	0.186471	158847.4553
1	10.80	0.181813	157279.8895
1	11.00	0.177201	155683.0245
1	11.20	0.172636	154056.8603
1	11.40	0.16812	152401.3968
1	11.60	0.163653	150716.6343
1	11.80	0.159236	149002.5728
1	12.00	0.15487	147259.2123
1	12.20	0.150556	145486.5530
1	12.40	0.146295	143684.5949
1	12.60	0.142087	141853.3380
1	12.80	0.137934	139992.7826
1	13.00	0.133835	138102.9286
1	13.20	0.129793	136183.7761
1	13.40	0.125808	134235.3253
1	13.60	0.121881	132257.5762
1	13.80	0.118013	130250.5289
1	14.00	0.114204	128214.1836
1	14.20	0.110455	126148.5402
1	14.40	0.106768	124053.5989
1	14.60	0.103143	121929.3598
1	14.80	0.0995814	119775.8230
1	15.00	0.0960827	117640.7133
1	15.20	0.0926462	115553.6424
1	15.40	0.0892705	113515.2631
1	15.60	0.0859542	111526.2072
1	15.80	0.0826957	109587.0866
1	16.00	0.0794937	107698.4964
1	16.20	0.0763466	105861.0163

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

1	16.40	0.0732528	104075.2131
1	16.60	0.0702109	102341.6430
1	16.80	0.0672194	100660.8534
1	17.00	0.0642766	99033.3853
1	17.20	0.0613809	97459.7756
1	17.40	0.0585309	95940.5593
1	17.60	0.0557248	94476.2717
1	17.80	0.052961	93067.4507
1	18.00	0.050238	91714.6390
1	18.20	0.047554	90418.3870
1	18.40	0.0449073	89179.2542
1	18.60	0.0422963	87997.8125
1	18.80	0.0397193	86874.6482
1	19.00	0.0371745	85810.3646
1	19.20	0.0346602	84805.5842
1	19.40	0.0321747	83860.9519
1	19.60	0.029716	82977.1370
1	19.80	0.0272826	82154.8359

General Properties

Pile Loading

Load Case #	Axial Load (lbs)
1	200000.00

Axial Soil Loading

Soil Displacement (in)	Sliding Depth (ft)
0.0000000	0.00

Pile Properties

Property	Value
Name	DSM 4ft
Pile Type:	Cylindrical
Material Type:	Elastic
Young's Modulus (psf)	6480000.00
Diameter (ft)	4.00

Soil Layer Properties

Layers

Layer Name	Layer Type	Thickness (ft)
Soil Layer 1	API Sand	20.00
Soil Layer 2	API Sand	30.00

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Soil Layer 1

Property	Value
Soil Type	Sand
Thickness (ft)	20.00
Unit Weight (lbs/ft3)	125.00
Friction Angle (deg)	30.00
Coefficient of Lateral Earth Pressure	1.00
Bearing Capacity Factor	12.00
Maximum Unit Skin Friction (psf)	1400.00
Maximum End Bearing Resistance (psf)	60000.00

Soil Layer 2

Property	Value
Soil Type	Sand
Thickness (ft)	30.00
Unit Weight (lbs/ft3)	125.00
Friction Angle (deg)	34.00
Coefficient of Lateral Earth Pressure	1.00
Bearing Capacity Factor	40.00
Maximum Unit Skin Friction (psf)	2000.00
Maximum End Bearing Resistance (psf)	200000.00

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX D

Liquefaction-induced Downdrag Force Calculation

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
As in effect on the date of approval by the Director. No additions, deletions or alterations to these plans without written permission from OC Public Works - OC Development Services of Orange County. The stamping of these plans and specifications SHALL NOT be held to relieve or limit approval of the violation of any provisions of any County Ordinance or Building Code.
Hindi Tabassum
BUILDING OFFICIAL

Created by Amin Rahmani, Ph.D., P.E. - February 19, 2018
Copyright © 2018 Amin Rahmani. All rights reserved.

Downdrag Calculations per AASHTO LRFD Bridge Design (2012) - Drilled Shafts

Notes:

1. Please enter the required inputs shown in blue.
2. This spreadsheet should be used for drilled shafts, only.
3. The formulations are based on povisions of AASHTO LRFD Bridge Design, 2012 - Section 10.8.
4. Per section 10.8.3.5.2, Beta method is used for cohesionless material , where N60 is average SPT blow count corrected only for hammer efficiency.
5. Put zero values for Su and N60 if not applicable.
6. Units are all Imperial. The macro must be modified for metric units.
7. Do not add any row or column to this spreadsheet.
8. The spreadsheet is formulated up to row No. 6000.

Input Parameters

Pile Diameter =	4	ft	
Wall thickness	24.0	inch	Use D/2 for concrete piles
Elastic Young's Modulus =	12960.0	ksf	
Depth where FF settlement is 0.4" =	19.0	ft	
Column Depth =	20.0	ft	
Ground Water Table Depth =	10.0	ft	

Click below to run analysis

Calculate Downdrag Force & the Resulting Pile Elastic Compression

Outputs

Negative Friction (Downdrag) =	128.7	kips
Pile Elastic Compression=	0.02	inch
Ultimate Positive Friction =	12.6	kips
Ultimate End Bearing =	706.5	kips

Input Parameters							Calculation Results							
Depth (ft)	Liquefiable?	(Su_liq)/sigma'	Cohesive Material- Su (psf)	Cohesionless Material - N60 (blows/ft)	Is the soil gravelly sand or gravel?	Unit Weight (pcf)	Sigma_v' (psf)	alpha	Beta	Mobilized Friction (psf)	Average Mob. Friction (psf)	Negative Friction, i.e., downdrag (kips)	Positive Friction (kips)	Cumulative Comp. due to downdrag load (inch)
0.00	No		0.0	20.0	No	125.0	0.00	0.00	0.00	0.00	0.00	0.00		0.00
1.00	No		0.0	20	No	125.0	125.00	0.00	1.40	175.57	87.78	1.10		0.00
2.00	No		0.0	20	No	125.0	250.00	0.00	1.33	333.66	254.62	4.30		0.00
3.00	No		0.0	20	No	125.0	375.00	0.00	1.29	482.45	408.06	9.43		0.00
4.00	No		0.0	20	No	125.0	500.00	0.00	1.25	623.72	553.09	16.38		0.00
5.00	No		0.0	20	No	125.0	625.00	0.00	1.21	758.51	691.12	25.07		0.00
6.00	No		0.0	20	No	125.0	750.00	0.00	1.18	887.55	823.03	35.41		0.00
7.00	No		0.0	20	No	125.0	875.00	0.00	1.16	1011.34	949.44	47.34		0.00
8.00	No		0.0	20	No	125.0	1000.00	0.00	1.13	1130.29	1070.81	60.80		0.00
9.00	No		0.0	20	No	125.0	1125.00	0.00	1.11	1244.71	1187.50	75.72		0.01
10.00	No		0.0	20	No	125.0	1250.00	0.00	1.08	1354.88	1299.79	92.05		0.01
11.00	Yes	0.17	0.0	0.0	No	125.0	1312.60	-	-	223.14	789.01	101.97		0.01
12.00	Yes	0.17	0.0	0.0	No	125.0	1375.20	-	-	233.78	228.46	104.84		0.01
13.00	Yes	0.17	0.0	0.0	No	125.0	1437.80	-	-	244.43	239.11	107.84		0.01
14.00	Yes	0.17	0.0	0.0	No	125.0	1500.40	-	-	255.07	249.75	110.98		0.01
15.00	Yes	0.17	0.0	0.0	No	125.0	1563.00	-	-	265.71	260.39	114.25		0.01
16.00	Yes	0.17	0.0	0.0	No	125.0	1625.60	-	-	276.35	271.03	117.66		0.01
17.00	Yes	0.17	0.0	0.0	No	125.0	1688.20	-	-	286.99	281.67	121.20		0.01
18.00	Yes	0.17	0.0	0.0	No	125.0	1750.80	-	-	297.64	292.32	124.87		0.01
19.00	Yes	0.17	0.0	0.0	No	125.0	1813.40	-	-	308.28	302.96	128.68		0.01
20.00	No		0.0	120.0	No	125.0	1876.00	0.00	0.90	1695.63	1001.96		12.59	
21.00	No		0.0	120.0	No	125.0	1938.60	0.00	0.89	1722.95	1709.29			
22.00	No		0.0	120.0	No	125.0	2001.20	0.00	0.87	1749.11	1736.03			
23.00	No		0.0	120.0	No	125.0	2063.80	0.00	0.86	1774.12	1761.62			
24.00	No		0.0	120.0	No	125.0	2126.40	0.00	0.85	1798.01	1786.06			
25.00	No		0.0	120.0	No	125.0	2189.00	0.00	0.83	1820.78	1809.39			
26.00	No		0.0	120.0	No	125.0	2251.60	0.00	0.82	1842.45	1831.61			
27.00	No		0.0	120.0	No	125.0	2314.20	0.00	0.81	1863.04	1852.74			

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX E

PLAXIS Analysis of LTP Section

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Static and seismic performance of the proposed LTP system under slab load of 300 psf was evaluated using the finite element computer program PLAXIS, 2D. The geometry of the FE modal was composed of two-dimensional (2D) plane-strain model of:

a. 4ft diameter DSM columns at 12ftx12ft spacing and 20ft deep;
b. Three (3) layers of 12" thick cement-treated fill with UCS=200psi;
c. Soil layers from the ground information collected from CPTs and borings.

The effective width of the DSM columns were taken as 1.05 ft in order to account for the three-dimensional effects in the 2D plain-strain model. Equivalent secant elastic parameters and shear strength of the native soils were obtained from the site investigation data. Table A below presents the input soil parameters.

Table A. Input Soil Properties for PLAXIS analysis.

Depth (ft)	Soil Type	Static Condition		Liquefied Condition	
		Secant Young's Modulus (ksf)	Shear Strength	Secant Young's Modulus (ksf)	Shear Strength
0 to 9	Af/Qm	400	Phi = 31, c = 395 psf	-	-
9 to 20	Af/Qm (below GWT)	400	Phi = 30, c = 80 psf	100	Phi = 5.7 deg
Below 20	Tc	3000	Phi = 34, c = 695 psf	-	-
-	LTP (UCS, 28day=200 psi)	7200	14400 psf	14400 (365 day UCS)	28800 psf (365 day UCS)
-	CDSM (UCS, 28day=150 psi)	6480	10800 psf	12960 (365 day UCS)	21600 psf (365 day UCS)

The main goal of the analysis was to ensure that the deformations are in a tolerable ranges and LTP system did not show any signs of failure in tension and compression under the slab load during static and seismic loadings. Geometry of the model, deformations and stresses are presented in the following pages.

LTP Model - Static Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

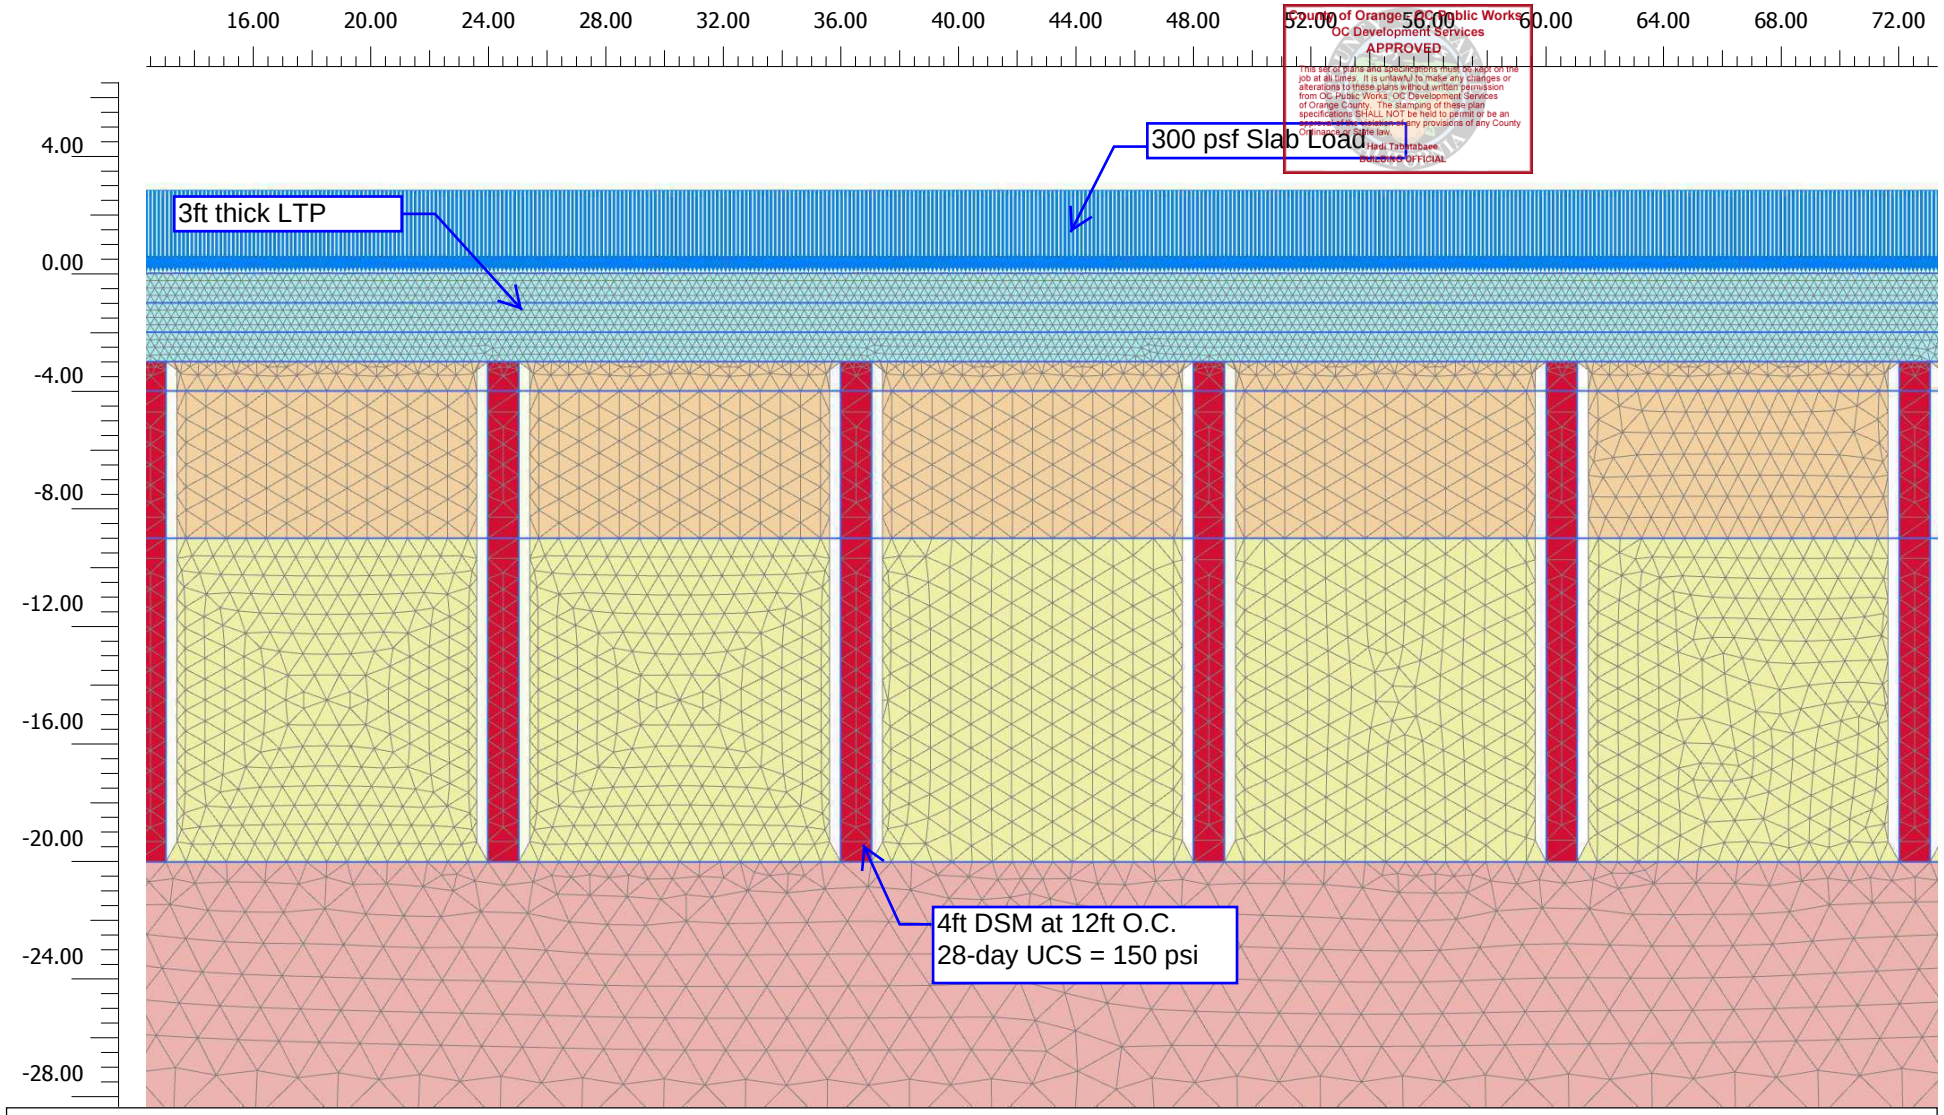

Connectivity plot

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Static	*Step* 124	*Company* Advanced Geosolutions Inc (AGI)

Deformation Contours - Static Loading Condition

Building&Safety; Ryan Rose 1/16/2025
Approved Foundation Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange, OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

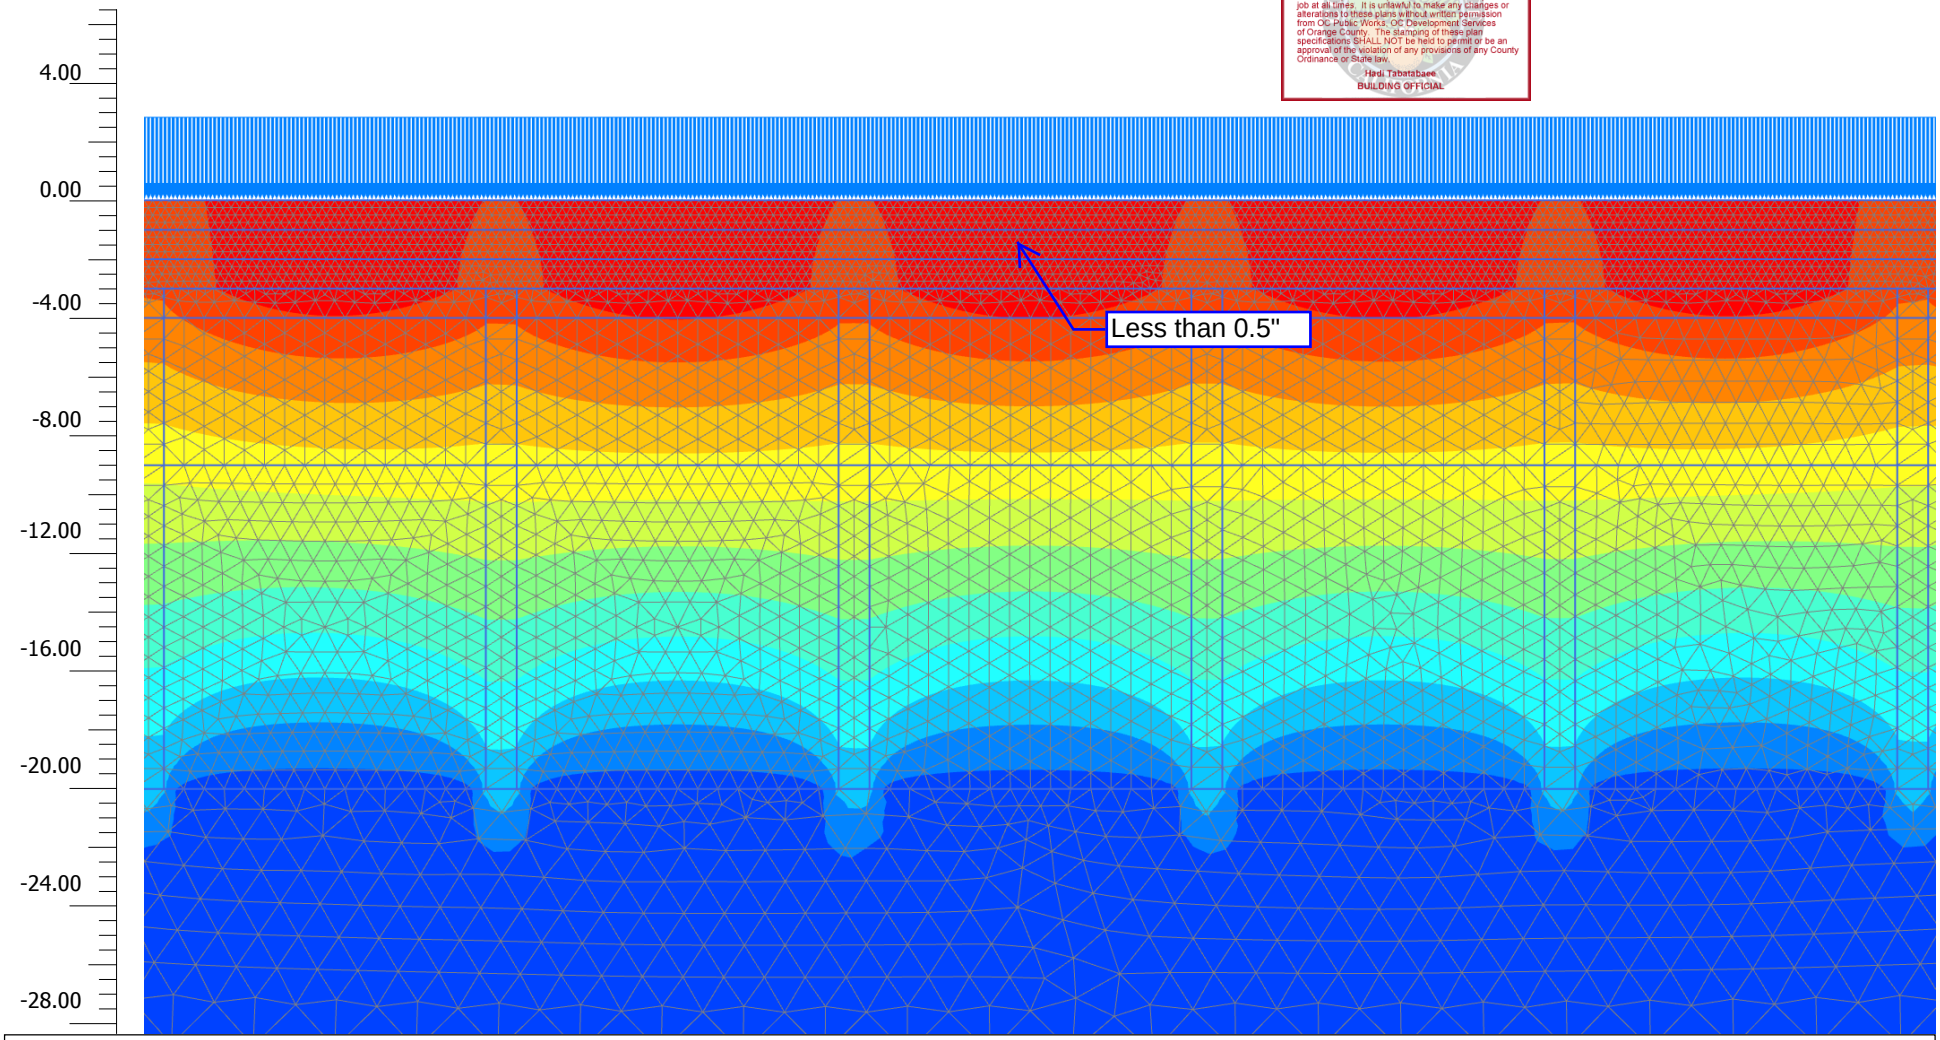

Total displacements u_y (scaled up 200 times)

Maximum value = 0.000 ft (Element 13635 at Node 14266)

Minimum value = -0.01189 ft (Element 220 at Node 2397)

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Static	*Step* 124	*Company* Advanced Geosolutions Inc (AGI)

Vertical Stress Contours - Static Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approval: Construction Plans
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

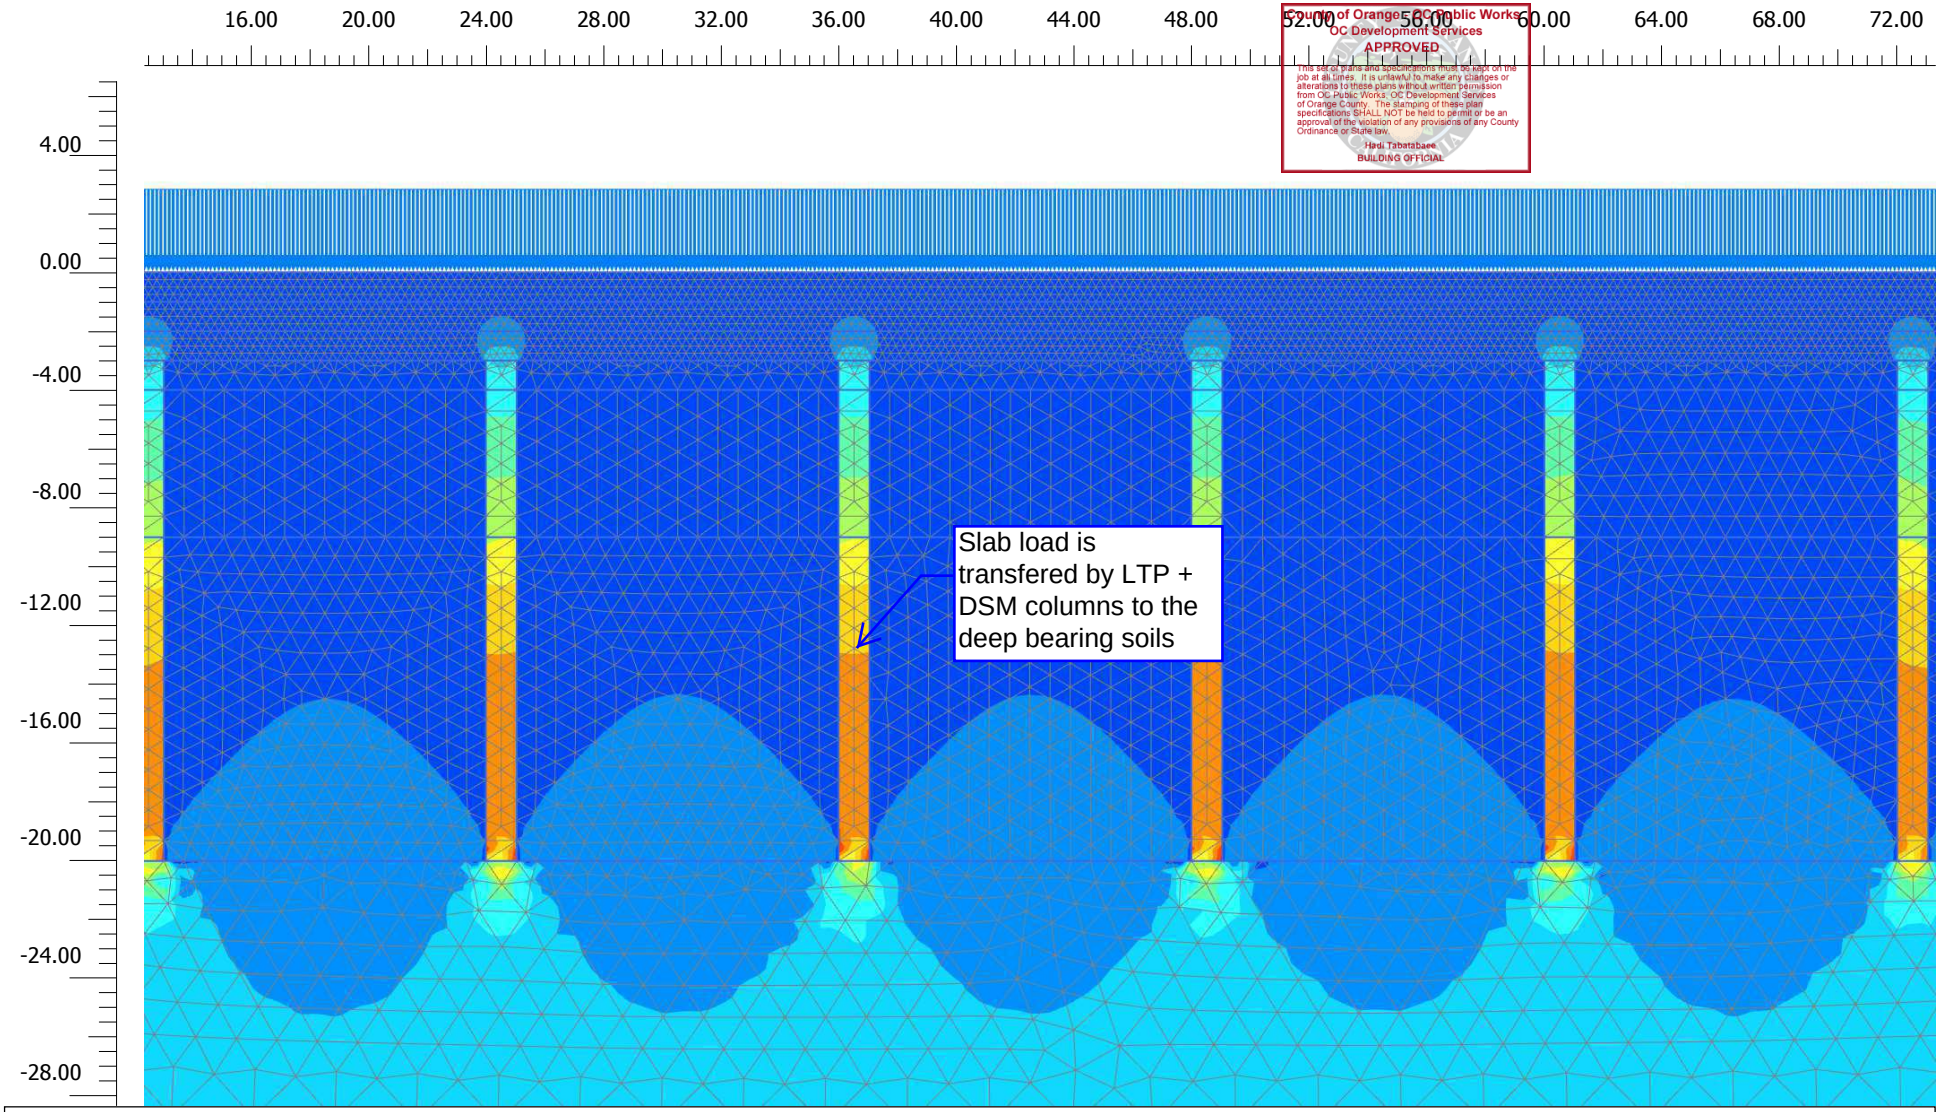

Cartesian effective stress σ'_{yy} (scaled up $0.200*10^{-3}$ times)

Maximum value = 287.2 lbf/ft² (Element 14799 at Node 18824)

Minimum value = $-10.47*10^{3}$ lbf/ft² (Element 12027 at Node 19297)

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Static	*Step* 124	*Company* Advanced Geosolutions Inc (AGI)

Potential Failures within LTP - Static Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Geotechnical/Mechanical Report
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

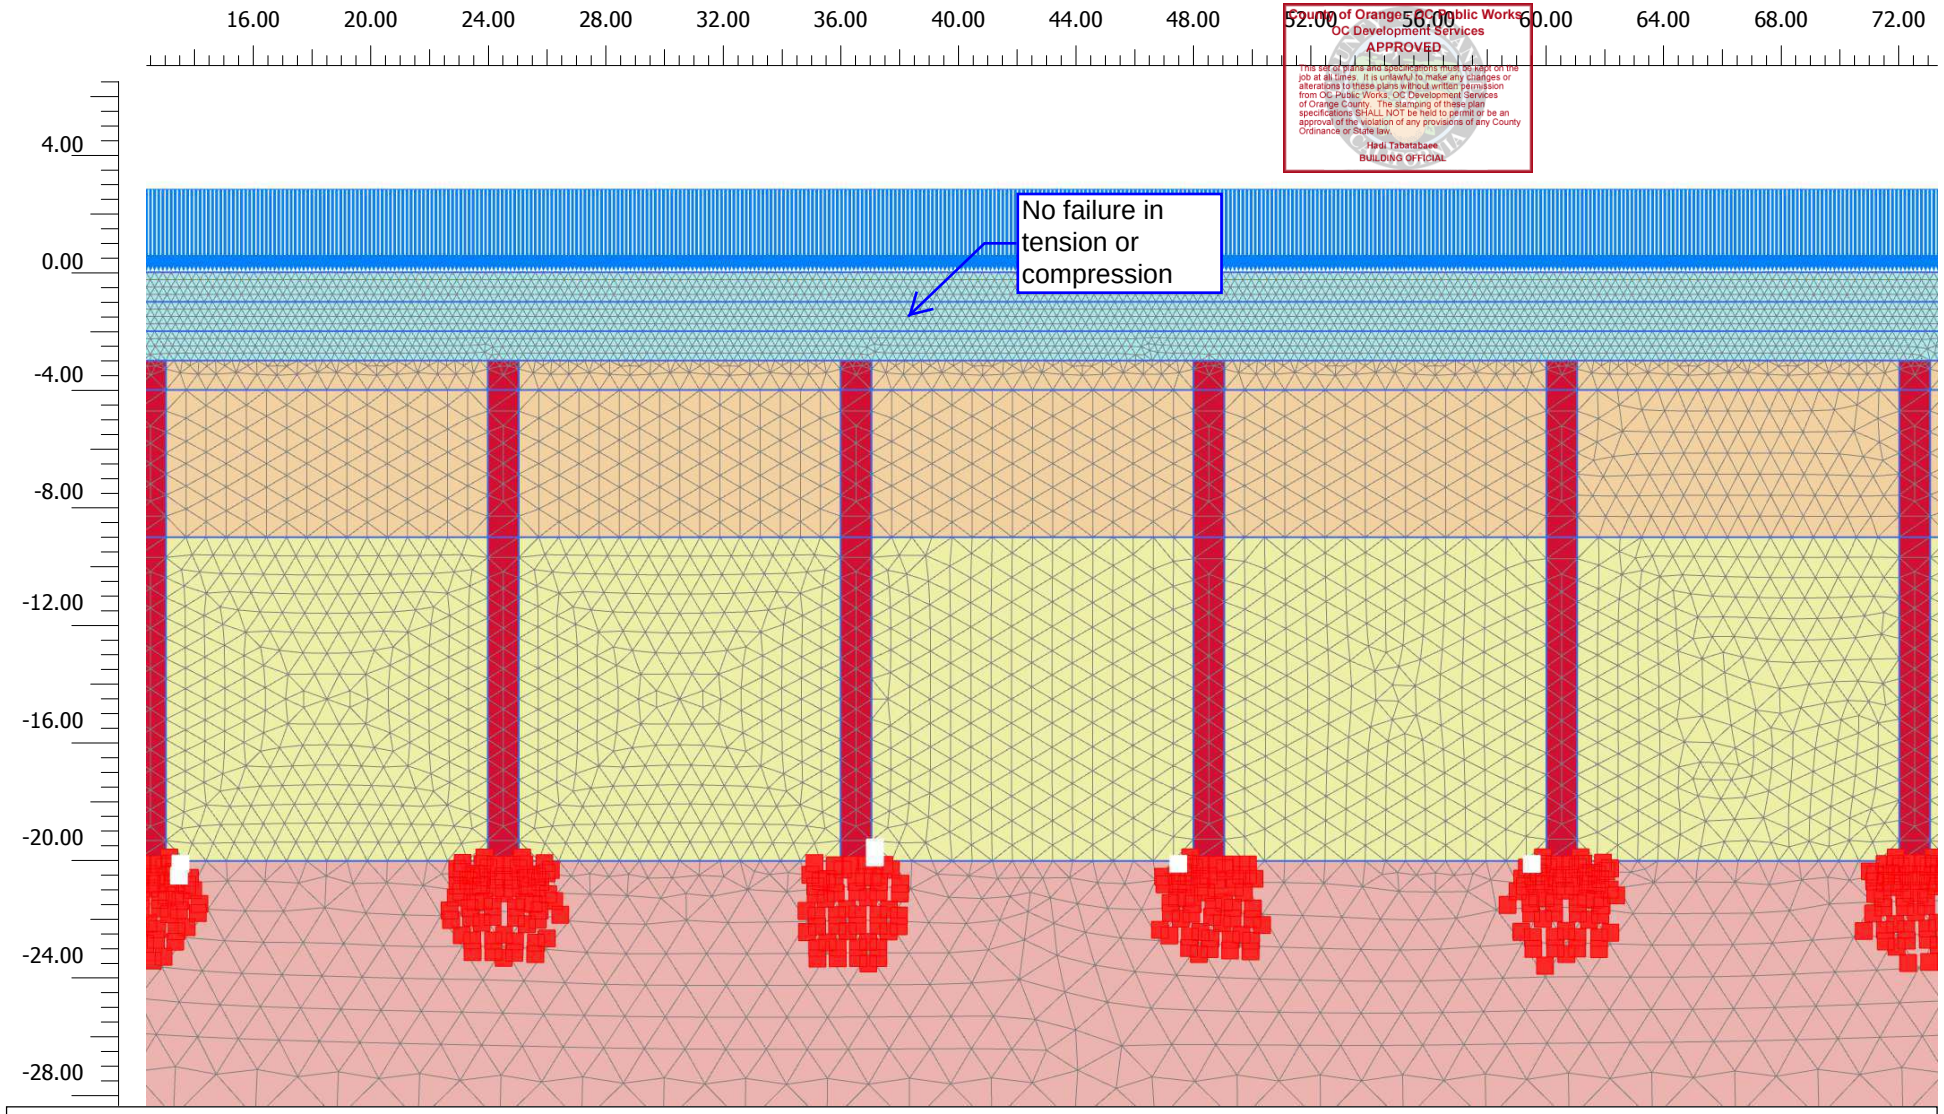

Plastic points (scaled up 0.00 times)

■Failure point ☐Tension cut-off point

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Static	*Step* 124	*Company* Advanced Geosolutions Inc (AGI)

LTP Model - Seismic Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Saadi Tabatabaee
BUILDING OFFICIAL

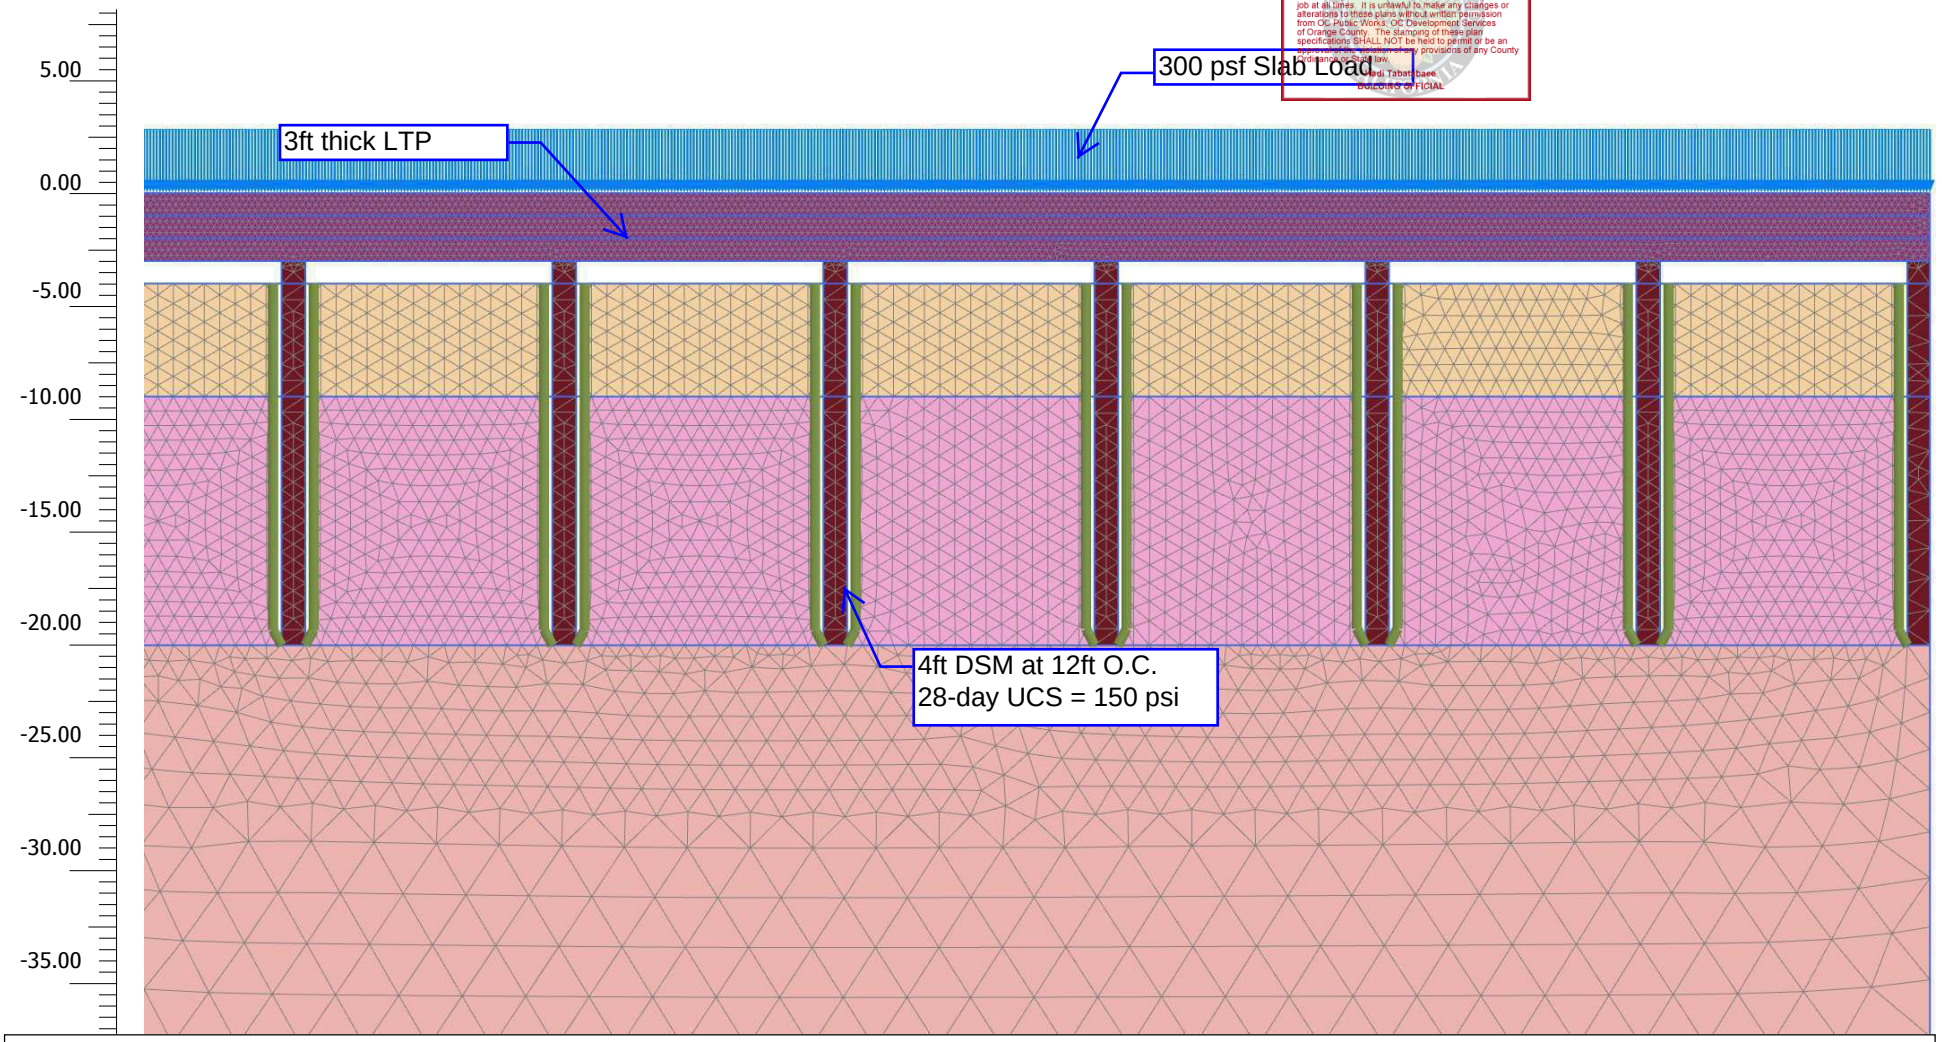

Connectivity plot

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Seismic	*Step* 192	*Company* Advanced Geosolutions Inc (AGI)

Deformation Contours - Seismic Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approval: Contact Information
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

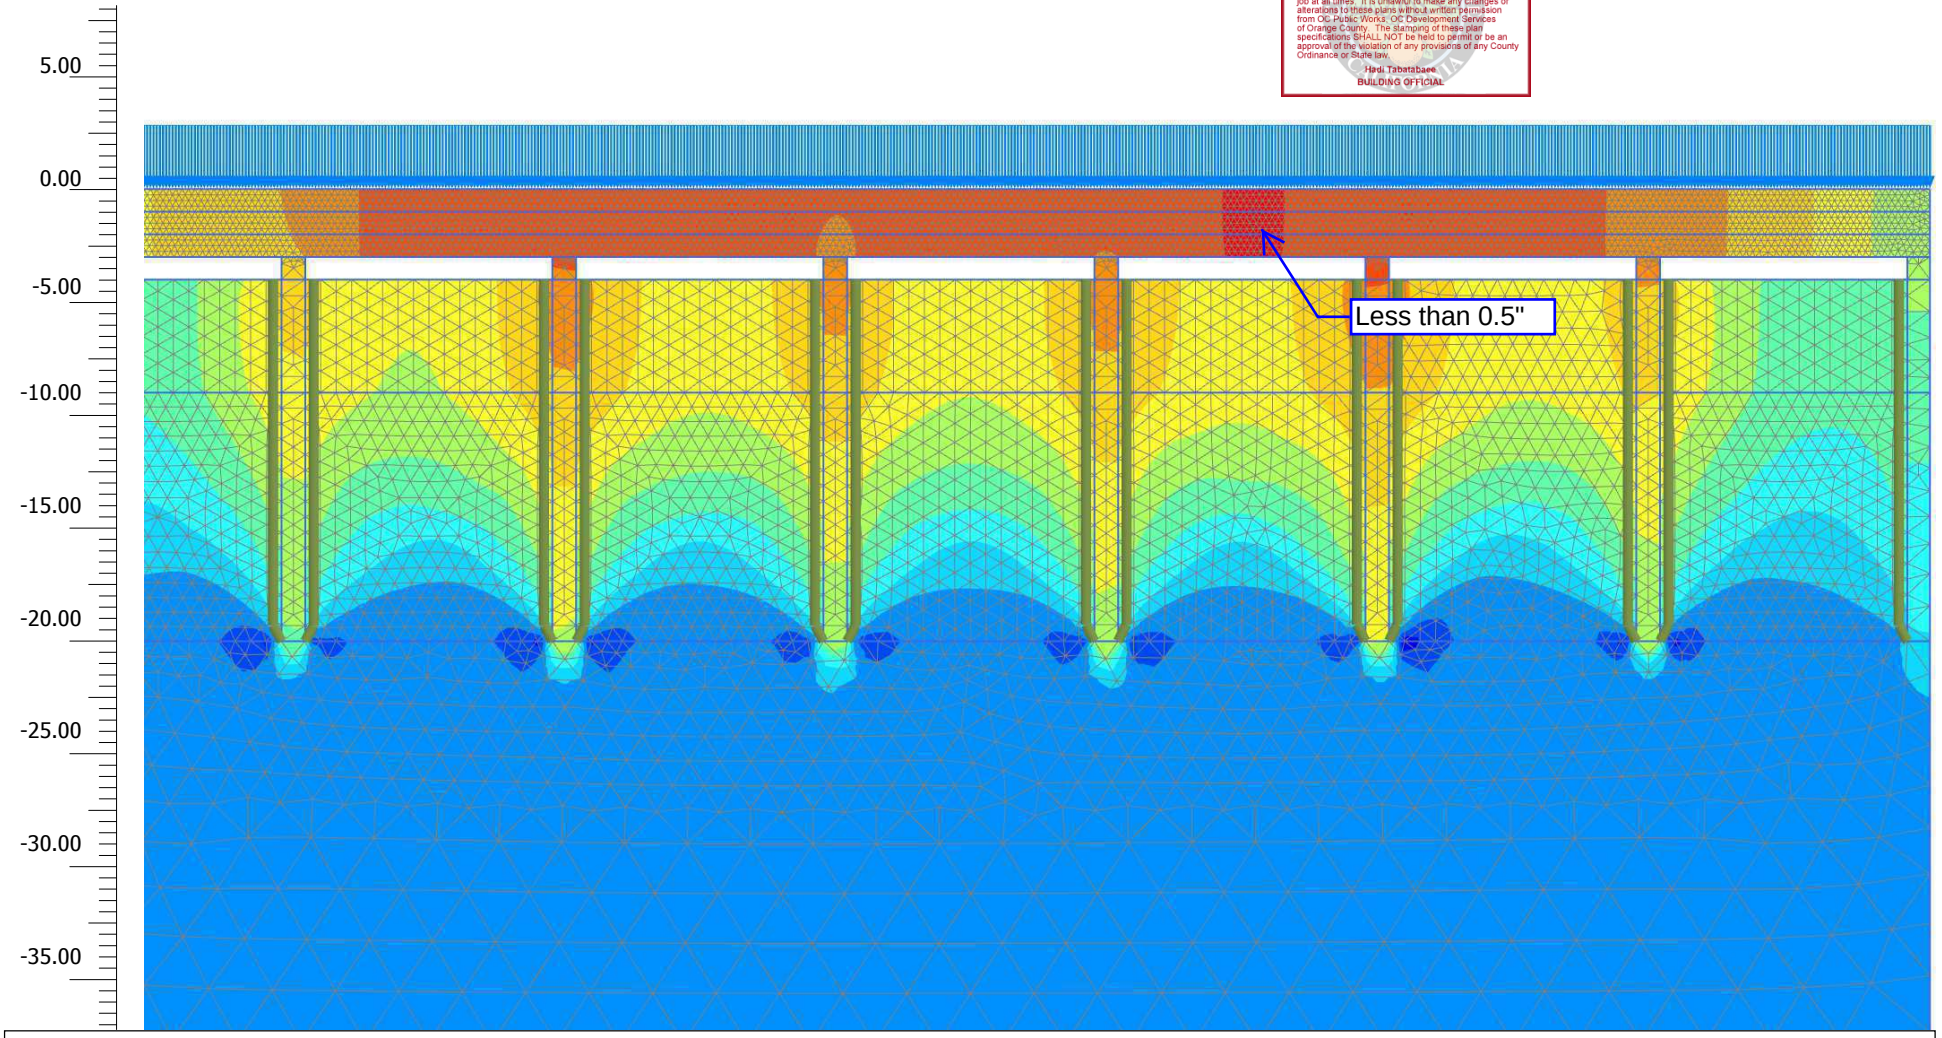

Total displacements u_y (scaled up 100 times)

Maximum value = $3.638*10^{-3}$ ft (Element 12726 at Node 22739)

Minimum value = -0.01813 ft (Element 385 at Node 18873)

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Seismic	*Step* 192	*Company* Advanced Geosolutions Inc (AGI)

Vertical Stress Contours - Seismic Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Geotechnical Geotechnical Report
Permits
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

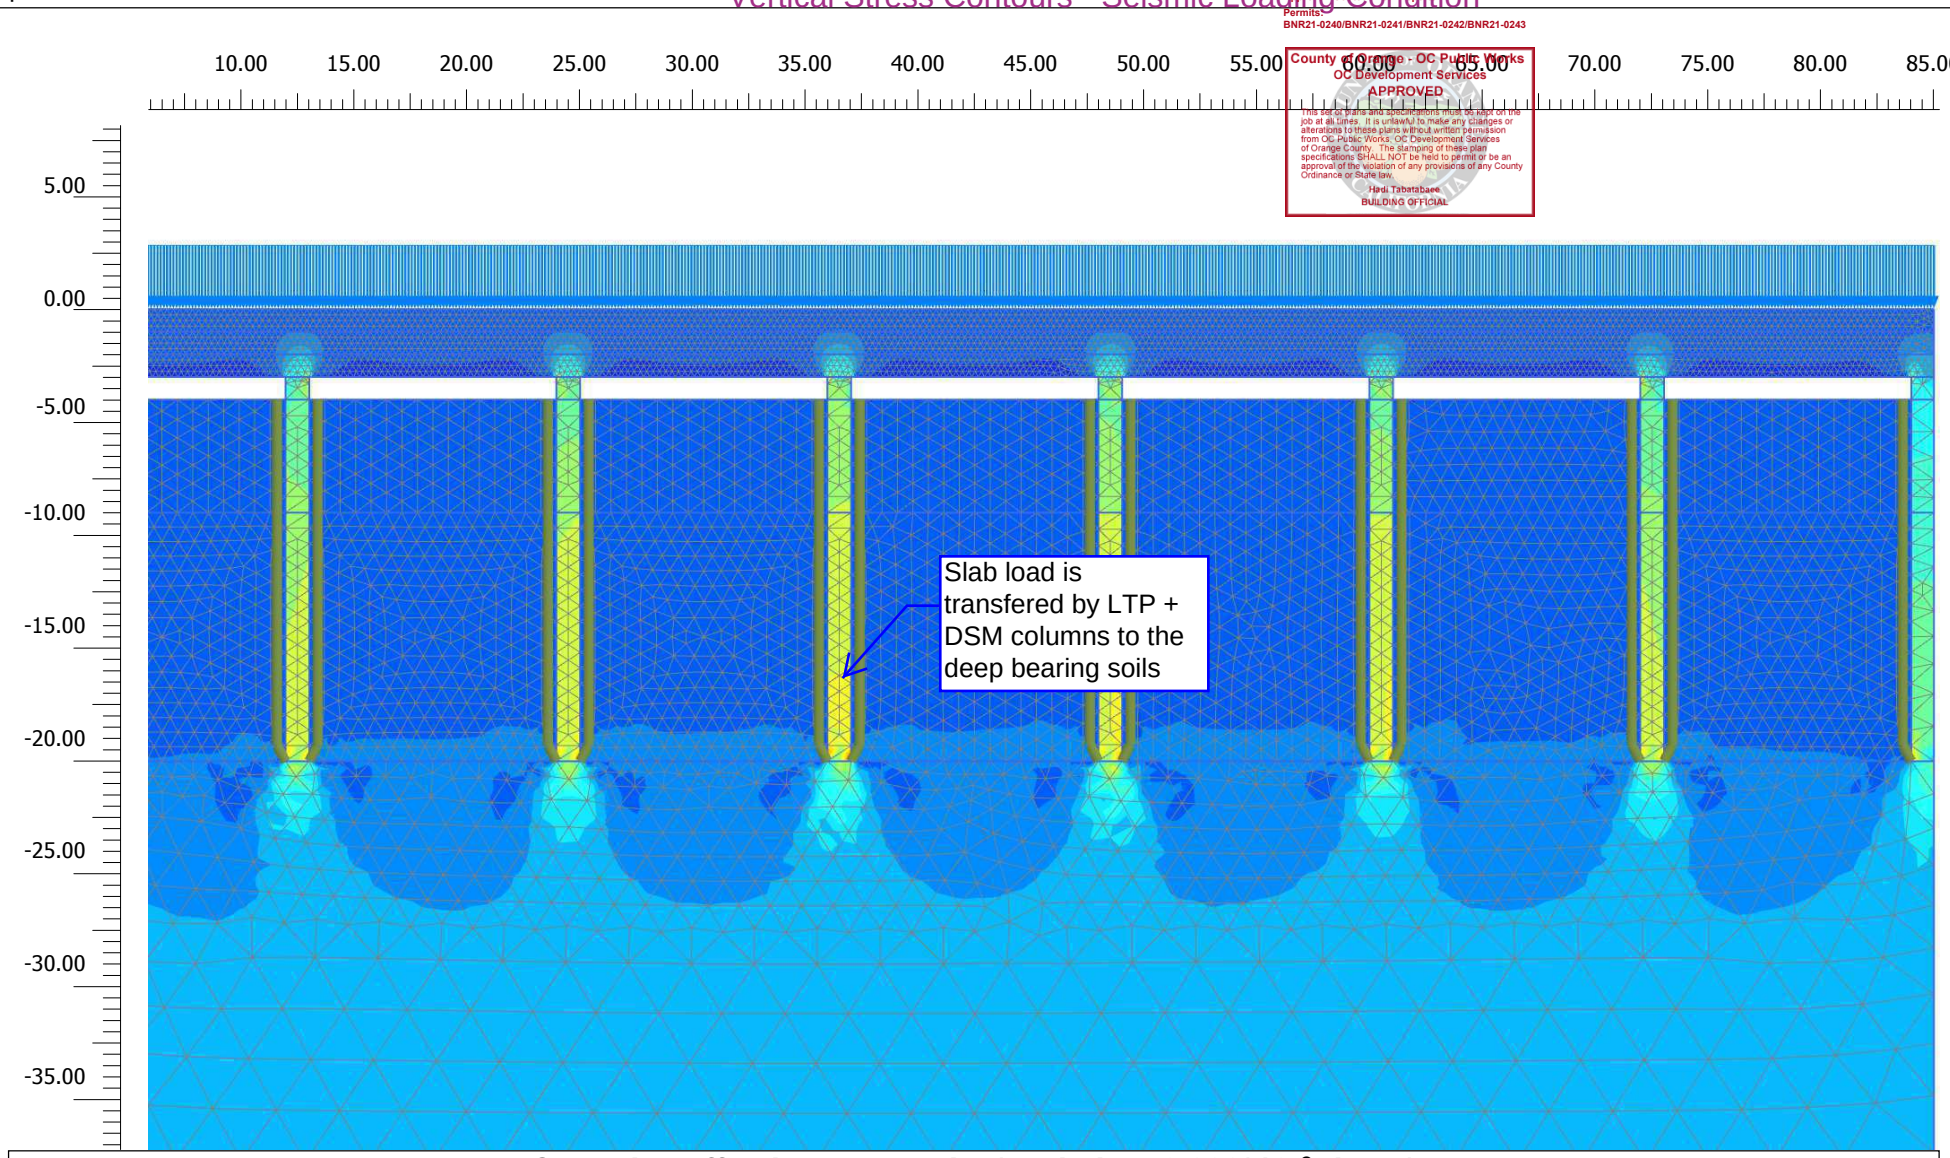

Cartesian effective stress σ'_{yy} (scaled up $0.200*10^{-3}$ times)

Maximum value = 1246 lbf/ft² (Element 6346 at Node 29371)

Minimum value = $-15.50*10^{3}$ lbf/ft² (Element 8067 at Node 27896)

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Seismic	*Step* 192	*Company* Advanced Geosolutions Inc (AGI)

Potential Failures within LTP - Seismic Loading Condition

Building&Safety: Ryan Rose 1/16/2025
Approved Deviations & Reports:
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

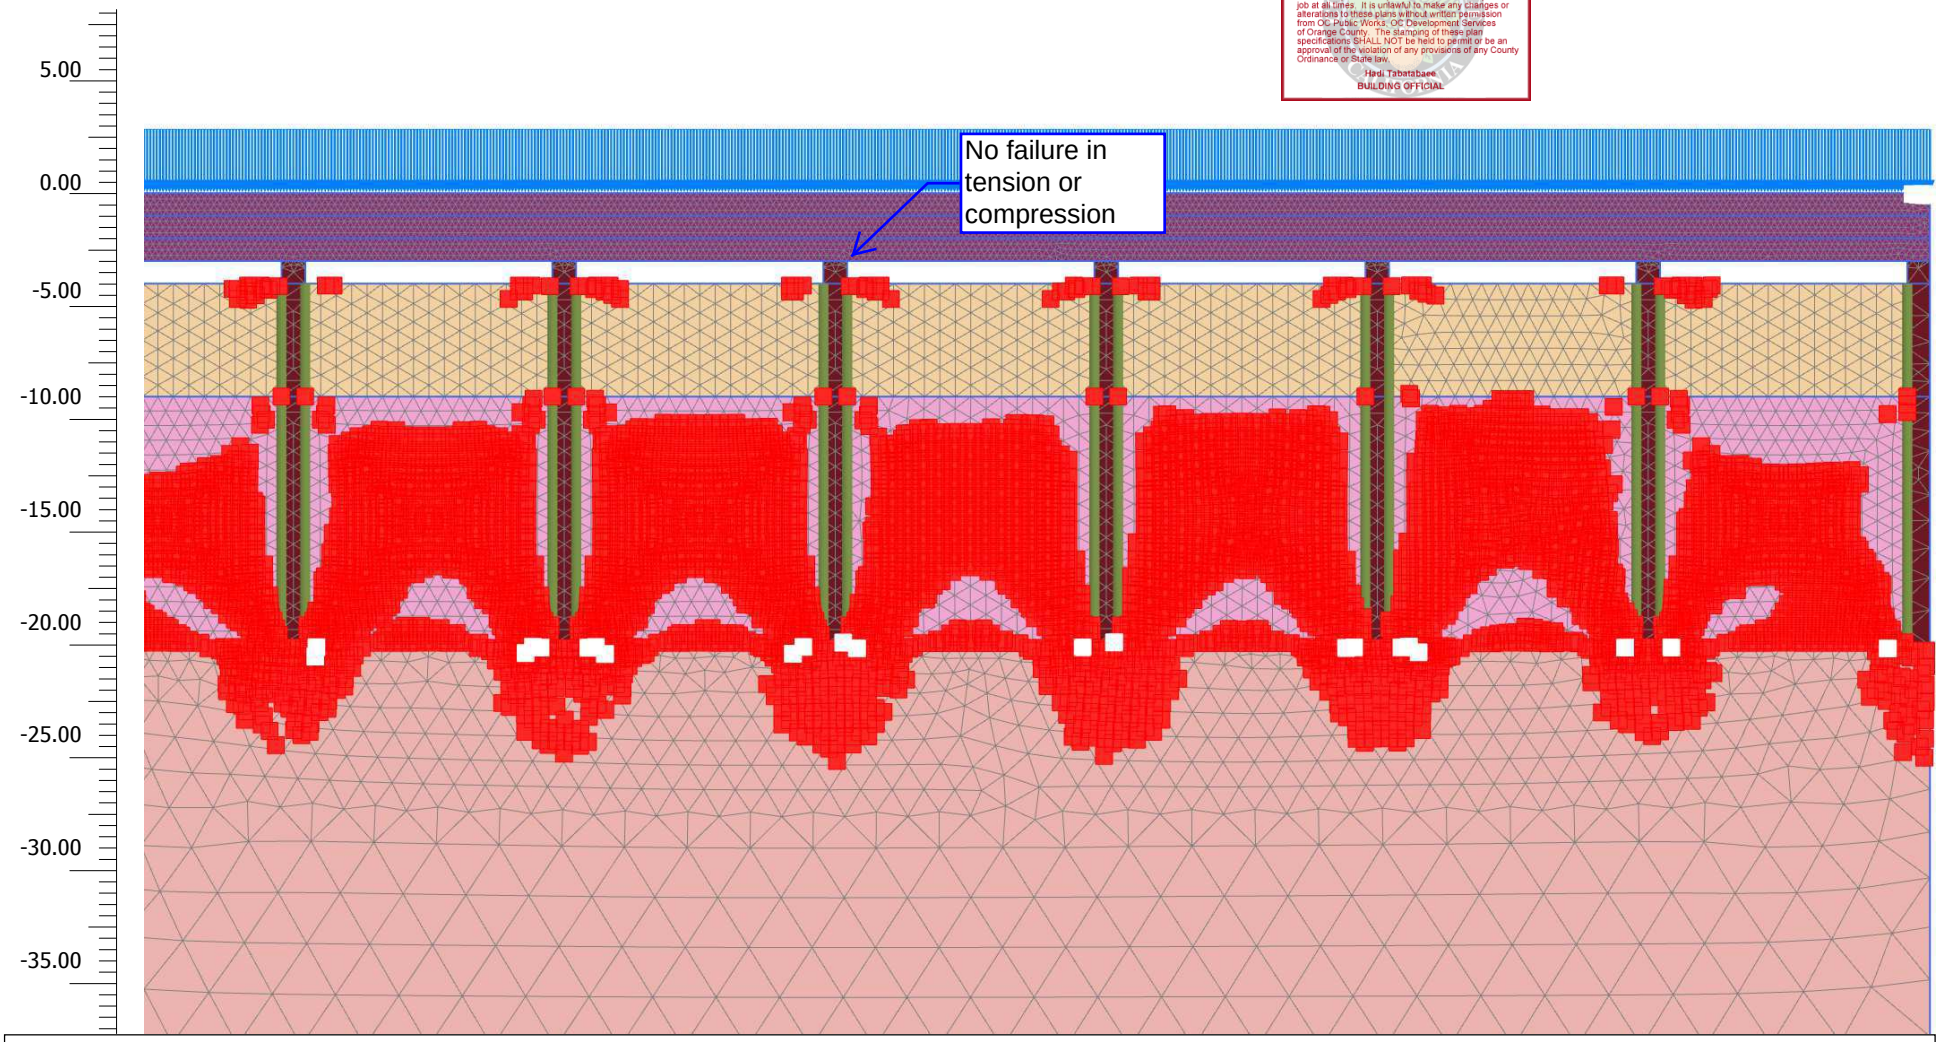

AGI	*Project description* DPH LTP Design		*Date* 4/11/2021
	Project filename LTP_Design_Seismic	*Step* 192	*Company* Advanced Geosolutions Inc (AGI)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations on same, or to deviate therefrom without permission from OC Development Services. Approval of these plans and specifications does NOT permit the violation of any section of Orange County Codes, ordinances or other laws or specifications. APPROVAL SHALL NOT be construed to be or be an approval of any provision or any County Ordinance or State Law.

Geotechnical Investigation Report, Volumes 1, 2, and 3, Dana Point Harbor Revitalization: Buildings 1 through 12, Commercial Component, City of Dana Point, California

Prepared For
DANA POINT HARBOR PARTNERS, LLC
c/o BURNHAM-WARD PROPERTIES

GMU

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Geotechnical Investigation Report, Volumes 1, 2, and 3, Dana Point Harbor Revitalization: Buildings 1 through 12, Commercial Component, City of Dana Point, California

Prepared For
DANA POINT HARBOR PARTNERS, LLC
c/o BURNHAM-WARD PROPERTIES

May 27, 2021

GMU Project No. 17-206-02

23241 Arroyo Vista
Rancho Santa Margarita | CA 92688
949.888.6513 | FX: 949.888.1380 | www.gmugeo.com

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TRANSMITTAL

DANA POINT HARBOR PARTNERS, LLC
c/o BURNHAM-WARD PROPERTIES
1100 Newport Center Drive, Suite 200
Newport Beach, CA 92660

DATE: May 27, 2021

PROJECT: 17-206-02

ATTENTION: Mr. Bryon Ward, President

SUBJECT: Geotechnical Investigation Report, Volumes 1, 2, and 3,
Dana Point Harbor Revitalization:
Buildings 1 through 12, Commercial Component,
City of Dana Point, California

DISTRIBUTION:

Addressee: (3 print copies + electronic copy)

SMS Architects
Attn: Mr. Brandon Dedmon (electronic copy)

Tindall Consulting
Attn: Mr. John Tindall (electronic copy)

Westling & Associates
Attn: Mr. Josh Westling (electronic copy)

TAIT Engineering
Attn: Ms. Daniela Malott (electronic copy)

Snyder Langston
Attn: Ms. Pam Santos (electronic copy)

Advanced GeoSolutions, Inc.
Attn: Mr. Justin Martos (electronic copy)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TABLE OF CONTENTS

Description Page

VOLUME 1 of 3

PURPOSE 1
PROPOSED IMPROVEMENTS 1
SITE LOCATION AND DESCRIPTION 1
BACKGROUND HISTORY AND PREVIOUS REPORTS 2
AERIAL PHOTOGRAPHY REVIEW 3
SUBSURFACE EXPLORATION 3
GEOLOGIC FINDINGS 4
GENERAL GEOLOGY AND SUBSURFACE CONDITIONS 4
Regional Geology 4
Site-Specific Conditions 4
Artificial Fill (Qaf) 5
Marine Deposits (Qm) 5
Capistrano Formation (Tc) 5
GROUNDWATER 5
GEOLOGIC HAZARDS 7
FAULTING AND SEISMICITY 7
LIQUEFACTION 7
LANDSLIDES 7
TSUNAMI, SEICHE, AND FLOODING 8
Tsunamis 8
Seiches 9
Flooding 9
GEOTECHNICAL ENGINEERING FINDINGS AND ANALYSES 9
LIQUEFACTION ANALYSES 9
Seismic Input 9
Liquefaction Evaluation and Seismic Settlement 10
LATERAL SPREAD ANALYSES 10
Lateral Spreading and Cyclic Mobility 10
SOIL EXPANSION 11
SOIL CORROSION 11
STATIC SETTLEMENT / COMPRESSIBLITY 12
PRELIMINARY INFILTRATION TESTING 12
EXCAVATION CHARACTERISTICS 13
CONCLUSIONS 14
RECOMMENDATIONS 15
REQUIRED GEOTECHNICAL MITIGATION SUMMARY 15
SITE PREPARATION 16

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

LATERAL SPREADING MITIGATION 16
BUILDINGS SUPPORTED BY DSM 17
GRADING 17
General 17
Corrective Grading 17
Additional Grading Recommendations 21
Dewatering 21
Volume Change 21
GRADING AND APPROVAL PROCEDURES 22
TEMPORARY EXCAVATIONS 22
STRUCTURE SEISMIC DESIGN 23
COMMERCIAL BUILDINGS 1 and 6-12 DESIGN RECOMMENDATIONS 24
Geotechnical Slab and Foundation Recommendations 24
COMMERCIAL BUILDINGS 2-5A and 5B DESIGN RECOMMENDATIONS 26
NON-BUILDING MISCELLANEOUS STRUCTURES
DESIGN RECOMMENDATIONS 27
SITE RETAINING WALLS DESIGN AND CONSTRUCTION 28
POLE FOUNDATION DESIGN RECOMMENDATIONS 29
STRUCTURAL CONCRETE 29
FERROUS METAL CORROSION 30
MOISTURE VAPOR TRANSMISSION 30
Moisture Vapor Retarder 30
Water Vapor Transmission Discussion 31
Floor Coverings 31
SURFACE DRAINAGE 31
INFILTRATION DESIGN CONSIDERATION 32
BIORETENTION AREAS 32
UTILITY DESIGN AND BACKFILL CONSIDERATIONS 32
Utility Design 32
Utility Trench Backfill 33
PAVEMENT DESIGN RECOMMENDATIONS 34
General 34
Asphalt Pavement Design 35
Portland Cement Concrete Pavement Design 35
TURF BLOCK PAVEMENT 36
RECYCLED AC MATERIAL 36
DISINTEGRATED GRANITE WALKWAYS 37
FLATWORK DESIGN RECOMMENDATIONS 37
ROOT BARRIERS 37
PLAN REVIEW AND FUTURE SERVICES 38
PLAN REVIEW 38

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

FUTURE SERVICES 38
Construction Plan Review 38
Geotechnical Testing During Grading and Construction 38
LIMITATIONS 39
CLOSURE 40
SITE-SPECIFIC REFERENCES 41
AERIAL PHOTOGRAPHS 42
TECHNICAL REFERENCES 43

Plate 1 -- Location Map
Plate 2 -- Composite Geotechnical Map
Plate 3 -- Geotechnical Sections
Plate 4 -- Tsunami Inundation Map
Plate 5 -- Design Groundwater Level Plan
Plate 6 -- Retaining Wall Construction Detail
Plate 7 -- DSM and LTP Installation Detail

VOLUME 2 of 3

APPENDICES A through F

APPENDIX A: GMU Geotechnical Exploration Procedures and Logs
APPENDIX A-1: Previous Drill Hole Logs by GMU
APPENDIX A-2: Previous Boring Logs by Others
APPENDIX A-3: Cone Penetration Testing (CPT) Logs by GMU
APPENDIX A-4: Cone Penetration Testing (CPT) Logs by Others
APPENDIX B: Recent Geotechnical Laboratory Procedures and Test Results by GMU
APPENDIX B-1: Previous Laboratory Test Results by GMU
APPENDIX B-2: Previous Laboratory Test Results by Others
APPENDIX C: Infiltration Test Results
APPENDIX C-1: Previous Infiltration Testing Results
APPENDIX D: CPT Liquefaction Analysis
APPENDIX E: Lateral Spread Analysis
APPENDIX F: Flatwork/Hardscape Table

VOLUME 3 of 3

APPENDIX G: Advanced GeoSolutions (AGI) Mitigation Plans

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

PURPOSE

This report presents the results of our geotechnical investigation for the "Commercial Component" of the Dana Point Harbor Revitalization Project. The purpose of our investigation was to develop geotechnical recommendations pertaining to site grading and the design and construction of the proposed buildings and other site improvements (i.e., roadways, parking lots, trash enclosures, site walls, exterior concrete flatwork, miscellaneous site structures, etc.) Our investigation included performing laboratory testing, data analysis, and geotechnical engineering evaluation, and developing recommendations for geotechnical hazard mitigation and proposed building and improvement areas.

PROPOSED IMPROVEMENTS

The Commercial Component of the Dana Point Harbor Revitalization Project encompasses the retail and restaurant buildings. It is our understanding that the proposed development on the land side of the existing sea wall will consist of constructing eight (8) new retail/office/surf museum/restaurant buildings (Buildings 1, and 6-12), and renovating five (5) existing retail/restaurant buildings (Buildings 2-4, 5A, and 5B), along with a new parking area, landscape site structures, landscaping, small retaining walls, flatwork, and other appurtenant structures. We understand that the renovation of Buildings 2-4, 5A and 5B will generally consist of remodeling the existing buildings with new doors and windows and, on some of the buildings, removing interior walls to reconfigure their layout.

Plate 2 of this report shows the location of the structures. We understand from our review of the project precise grading plans prepared by TAIT Engineering that the grades for the new buildings will be raised by approximately 1 to 3 feet. The ocean side revitalization, consisting of boat slips, boater facilities, dry boat storage, day-boat parking, and launch ramp areas, as well as a proposed hotel area west of the Commercial Component, will be performed by others under a separate permit.

SITE LOCATION AND DESCRIPTION

The subject site is bounded by Dana Point Harbor Drive, the planned realignment of Golden Lantern, and the proposed parking structure and existing parking lot on the north, the existing boat launch ramp and Embarcadero Marina area on the east (which will be the future Dry Stack Storage Component site), the existing Casita Place and the existing Marina Inn on the west (which will be part of the future Hotel Component site), and the existing sea wall and harbor on the south (see Plate 1 – Location Map). The existing sea wall on the south or "ocean side" of the site is a "Quay" wall which consists of slightly battered, cantilevered, reinforced-concrete gravity wall constructed

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

directly above 1.5:1 (horizontal to vertical) slopes. The slopes below the sea wall are comprised of riprap, with a concrete lining covering the ocean side riprap slope.

The majority of the site is relatively flat and drains by sheet flow towards the south to existing storm drain catch basins. However, there is an up to 16-foot-high, 2:1 (horizontal to vertical) slope along the north side of the site below Dana Point Harbor Drive, and an up to 14-foot-high, 2:1 (horizontal to vertical) slope along the west side of the site below Golden Lantern. The elevations of the flat portion of the site range from approximately 13.5 feet above mean sea level (msl) in the northern portion, to approximately 11 feet above msl in the southern portion. The site contains several existing buildings, with most of the site covered by either asphalt pavement or concrete flatwork, with some planters and landscape areas planted with flowers, groundcover, shrubs, and occasional trees.

BACKGROUND HISTORY AND PREVIOUS REPORTS

In order to research the site's history and geologic conditions, we reviewed published geologic maps and reports, previous geotechnical reports by other geotechnical consultants for the subject site and entire harbor area, and a previous report for the existing sea walls.

Based on our research, Dana Point Harbor is located within a cove (Dana Cove) that is bordered on the north by cliffs or bluffs that are approximately 100 to 200 feet high, and on the west by a hard, resistant promontory of land known as The Headlands. Prior to the construction of the harbor, the cove was bordered by a rocky shoreline along the base of the cliffs. However, due to the protection provided by The Headlands, a sandy shore was able to form toward San Juan Creek.

Dana Point Harbor was constructed in the late 1960s and early 1970s by the County of Orange and the United States Army Corps of Engineers. It is our understanding that the harbor was constructed by excavating the native soils after the cove was dewatered through the construction of a coffer dam. The construction of the coffer dam included the installation of sheet piling and the placement of fill in a wet condition. The harbor was then dewatered and the water basins were excavated to maximum depths of approximately 10 to 12 feet below sea level with the exception of local areas within the northern portion of the harbor where hard bedrock materials were encountered. Artificial fill was then placed in a relatively dry condition up to existing grades, and the sea walls, boat ramps, docks, and buildings were then constructed. In addition, a riprap breakwater was constructed along the south side of the harbor to protect it from wave action.

In order to provide access to the harbor, the shoreline cliffs were cut back to construct Dana Point Harbor Drive and Street of the Golden Lantern. These slopes were cut to gradients ranging from 1:1 (horizontal to vertical) to 2:1, depending on their geologic structure and material type.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

An evaluation of the existing sea walls was performed by Bluewater Design Group in December of 2003. Their evaluation indicated that most of the existing sea walls are "Quay" walls which consist of slightly battered, cantilevered, reinforced-concrete gravity walls constructed directly above 1.5:1 (horizontal to vertical) slopes composed of riprap. The harbor side of the slope is covered by concrete panels. The extent of the riprap on the non-harbor side is unknown; however, it is anticipated that it consists of a 1.5:1 (horizontal to vertical) slope composed of riprap with no concrete lining. As a result, the Quay wall footings are supported on either rock riprap or shallow fills placed on top of the riprap. The walls are not embedded into the ground and thus rely on their own weight, the weight of the soil over the heel, and the friction between the bottom of the footings and the underlying soil or riprap to prevent overturning and resist sliding forces. Most of the Quay walls are 5 feet in height; however, some local sections are 9 feet in height. The report by Bluewater Design Group also indicated that the north and south sides of the public boat launch ramp are supported by conventional cantilever retaining walls that range from 2 to 15 feet in height with footings founded into fill materials.

AERIAL PHOTOGRAPHY REVIEW

An aerial photo review of 20 sets of stereo-paired air photos spanning from 1952 through 1999 was performed for the subject site in order to assess historical land use and site development. (aerial photos were provided by Continental Aerial Photo). Photos taken prior to development of the harbor area show an undeveloped cliff bordered by a rocky shoreline and a relatively natural cove. In 1967, two jetties were constructed on the east and west sides of the cove. By 1970, the alteration of the cove into a man-made harbor was nearing completion and the roadways had been graded. The photos indicate that Dana Point Harbor Drive and the northerly areas of the harbor (generally parking lot and boat storage) are likely underlain by bedrock from the cut operation of the shoreline cliff. By 1975, the harbor appears to be essentially in its current condition with the existing buildings and paved areas. Photos reviewed after 1975 show no significant changes to the area.

SUBSURFACE EXPLORATION

GMU conducted a recent subsurface exploration program to evaluate the soil conditions within the project and surrounding areas. The recent subsurface explorations performed by GMU consisted of the following:

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- Twenty eight (28) hollow-stem-auger exploratory drill holes by GMU to a maximum depth of 50 feet below the existing ground surface in order to determine site-specific subsurface geologic and groundwater conditions and to obtain bulk and drive samples for geotechnical testing.
- Seven (7) CPT soundings by GMU to a maximum depth of 26 feet below the existing ground surface.

The drill holes were logged by our Staff Geologist and samples were collected and transported to our facility for observation and testing. The drill holes and CPT locations are shown on Plate 2 – Composite Geotechnical Map. Drill hole logs are contained in Appendix A and CPT reports are presented in Appendix A-3.

Additionally, we have utilized previous geotechnical exploration data that was performed by GMU and by others. The previous drill hole logs by GMU are presented within Appendix A-1.; previous drill hole logs by others are presented within Appendix A-2; and previous CPT data performed by others are presented within Appendix A-4.

GEOLOGIC FINDINGS

GENERAL GEOLOGY AND SUBSURFACE CONDITIONS

Regional Geology

Published geologic maps indicate that prior to development, the site consisted of a natural cove that was protected by a hard, resistant promontory of land to the west known as The Headlands. The cove was bordered by a rocky shoreline along the base of steep sea cliffs. The sea cliffs are comprised of marine sedimentary rocks of the Capistrano Formation that are capped by marine and non-marine terrace deposits. The base of the sea cliffs was mantled by talus deposits and local deposits of artificial fill while the bottom of the cove was covered by marine deposits. The harbor was constructed by dewatering the cove, partially excavating the native soils along the base of the cliffs and within the cove, and then replacing the excavated materials as compacted fill and creating cut slopes to create roadways to the harbor.

Site-Specific Conditions

The subject site, including the proposed commercial buildings and other site improvements, are within the cove area of the harbor and is underlain by artificial fills, marine deposits, and bedrock of the Capistrano Formation. These materials are described in more detail in subsequent sections of this report.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Artificial Fill (Qaf)

The artificial fill materials within the site originated from both the marine deposits and bedrock within the cove, and the talus deposits and bedrock materials along the base of the sea cliffs. As a result of the fill materials being comprised of a variety of different geologic units, the fill materials are highly variable and consist of frequently alternating layers of clayey sands, silty sands, sands, sandy clays, and sandy silts with gravel, isolated cobbles, and some scattered rock fragments greater than 6 inches in diameter. In general, the granular sand materials were found to be medium dense to dense while the fine-grained clay and silt materials were found to be predominantly firm to very firm. In addition, our laboratory testing indicates that the fill materials have varying degrees of compressibility and hydro-collapse.

Marine Deposits (Qm)

The marine deposit materials within the site are comprised of materials typically deposited in beach and submarine environments and, where encountered, generally consist of wet, medium dense, silty sands to sands. Marine deposits were encountered underlying the artificial fill within six of our current drill holes (DH-26, DH-29, DH-34, DH-35, DH-46, and DH-51).

Capistrano Formation (Tc)

Capistrano Formation bedrock was encountered below the fill and/or marine deposits in all our deeper drill holes and in all our CPT soundings. The bedrock was observed to consist predominantly of hard to very hard, fine- to coarse-grained, massive sandstones with occasional beds of moderately hard to hard, gray to very dark gray claystones and siltstones.

GROUNDWATER

Groundwater is present at shallow depths below the subject site. Review of the Seismic Hazard Zone Report for the Dana Point Quadrangle indicates that the historic high groundwater level is 5 feet below the existing grade at the project site. In our recent and previous subsurface explorations, groundwater was encountered at depths ranging from 5 to 16 feet below the existing grade. Groundwater levels were measured utilizing a measuring tape or groundwater sounder within the boring during drilling; however, for this investigation, drill holes were not left open for extended periods of time to allow the groundwater to reach equilibrium within the drill holes. In order to determine more accurate groundwater levels, laboratory testing was performed on samples collected during drilling in order to obtain the in-situ saturation levels of the onsite soils. The groundwater levels indicated on the drill hole logs are based on field observations combined with results from our laboratory testing. The groundwater levels shown on the cross sections represent a rough conservative average of the groundwater levels shown on the boring logs and represent a best-fit geologic model.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

To aid in the designing of the underground utilities and provide estimated groundwater levels that may be encountered by contractors, the groundwater levels shown on the cross sections were adjusted to account for average high tide conditions. These "estimated high tide" groundwater levels are shown on Plate 5. It should be noted that these groundwater levels should be used with caution as they do not account for King Tides, Maximum High Tides, and effects due to climate change.

The following table summarizes groundwater levels at the site:

Groundwater Levels Summary

Groundwater Condition	Basis	Use	Reference/ Value
Average groundwater levels	Groundwater levels encountered during exploration and adjusted for saturation and geologic model	General	Boring logs, Plates 2 & 3
Groundwater levels adjusted for daily high tides	Average groundwater levels adjusted for daily high tides	Underground utility design and likely high tide levels that may be encountered by contractors	Plate 5
Groundwater levels to be used for liquefaction and lateral spreading analyses	Boring logs, Plates 2 & 3, CGS Historic High GW Level	Geotechnical engineering design (i.e., liquefaction, lateral spreading, etc.)	5' bgs

Any construction extending below the depths shown on Plate 5 may encounter saturated conditions. Consequently, appropriate construction precautions should be utilized (i.e., deeper excavations for utility lines, etc.).

It should be further noted that the estimated groundwater levels represent our best interpretation of the information available at the time of this report. Consequently, actual groundwater levels at the time of construction may differ from the estimates presented in this report. It is up to the contractor to determine the groundwater levels at the time of construction. **The contractor is strongly encouraged to directly determine groundwater levels immediately prior to construction. The installation of a piezometer, which can be measured through tidal cycles, should be considered by the contractor.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GEOLOGIC HAZARDS

FAULTING AND SEISMICITY

The site is not located within a published Alquist-Priolo Earthquake Fault Zone, and no known active faults are shown on current geologic maps as crossing the site. The nearest known active fault is the offshore segment of the Newport-Inglewood fault, which is located approximately 2.5 miles southwest of the site and is capable of generating a maximum earthquake magnitude (M_w) of 7.5. The site is also located 9.5 miles from the San Joaquin Hills Blind Thrust, which is capable of generating a maximum earthquake magnitude (M_w) of 7.1.

The site has been subject to local earthquakes including the 1933 Long Beach Earthquake with a 6.4 magnitude, and the 1997 Northridge Earthquake with a 6.7 magnitude. An earthquake search indicated that approximately 37 earthquakes with magnitudes greater than 5 occurred within a 100-kilometer (~ 62 miles) radius from the site within the past 200 years. Given the proximity of the site to these and numerous other active and potentially active faults, the site will likely be subject to earthquake ground motions in the future.

LIQUEFACTION

The site is located within a zone of required investigation for liquefaction as shown on the Seismic Hazard Zone Map for the Dana Point Quadrangle (CGS, 2001). Consequently, and also based on the conditions encountered in the subsurface explorations for this project, the site may be subject to seismic settlement and lateral spreading related to liquefaction. Liquefaction, seismic settlement, and lateral spreading were quantitively analyzed as part of this investigation, with the results discussed under the "Geotechnical Engineering Findings and Analyses" section of this report (Page 9).

LANDSLIDES

Based on our review of available geologic maps, literature, topographic maps, aerial photographs, and our subsurface evaluation, no landslides or related features underlie the site; however, an earthquake-induced landslide is mapped near the proposed development within the existing bluffs where surficial instability and cracking may occur. However, based on the distance between the bluffs and the project site, there is no potential for landslides to impact the proposed development.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TSUNAMI, SEICHE, AND FLOODING

Tsunamis

Tsunamis or seismic sea waves that have affected coastal Southern California are generally produced by submarine fault rupture. Historical records indicate that the coast from San Pedro to Newport Bay, has been affected by six significant tsunamis since 1868 (Vasily Tito, National Oceanographic and Atmospheric Administration, Personal Communication, June 1998). The largest waves were on the order of 6 to 8 feet. The most extensive recent damage occurred in harbor areas such as Los Angeles (Alaska - 1964, Chile - 1960).

Legg et al. (2004) investigated the tsunami hazard associated with the Catalina fault offshore of Southern California. They simulated tsunamis based on co-seismic deformation of the sea floor and estimated that coastal run-up values are 5 to 13 feet, although run-up could exceed 23 feet depending upon amplification due to bathymetry and coastal configuration. Large earthquakes on the Catalina fault are relatively infrequent, with recurrence intervals of several hundred to thousands of years (Legg et al., 2004).

Tsunami Inundation Maps

In 2009, the California Emergency Management Agency, California Geological Survey, and University of Southern California partnered in an effort to create tsunami inundation maps for California. The tsunami inundation maps were generated through a modeling process that utilizes the Method of Splitting Tsunamis (MOST). This computational program models tsunami evolution and inundation based on bathymetry and topography. The modeling also utilizes a variety of tsunami source events, including "realistic local and distant earthquakes and hypothetical extreme undersea, near-shore landslides" (California Emergency Management Agency et al., 2009). Using the source, bathymetry, and topography, the tsunami modeling yields a maximum inundation line. It is important to note that the published map does not represent inundation from a single event, but rather is the result of combining inundation lines from multiple source events. Therefore, the entire inundation region will likely not be inundated during a single tsunami event (California Emergency Management Agency et al., 2009).

The Tsunami Inundation Map states that the "tsunami inundation map was prepared to assist cities and counties in identifying their tsunami hazard. It is intended for local jurisdictional, coastal evacuation planning uses only." Furthermore, the map conveys that it is not intended for regulatory purposes. With respect to probability, the map states that it contains "no information about the probability of any tsunami affecting any area within a specific period of time."

A Tsunami Inundation Map for Emergency Planning was published for the Dana Point Quadrangle (California Emergency Management Agency et al., 2009). It is critical to note three points: (1) the map is only intended for emergency planning and evacuation planning; (2) the map does not

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

convey any information with respect to probability or timing of tsunami events; and (3) the inundation line is a conservative combination of multiple source events.

Tsunami Hazard Assessment

As shown on the attached Plate 4 – Tsunami Inundation Map, the proposed site is located within a tsunami inundation area. Therefore, it should be anticipated that the site will be directly affected by a tsunami. Although the probability and severity of tsunami inundation in the lowland areas cannot be estimated based on current available information, tsunami evaluation performed by others suggests that tsunami waves could potentially impact and scour the new building foundations during a tsunami event. This potential tsunami scour and foundation loss of strength were considered in the foundation recommendations developed for the site.

Seiches

The potential for the site to be adversely impacted by earthquake-induced seiches is considered to be high due to the presence of significant enclosed bodies of water located in the vicinity of the site.

Flooding

According to the County of Orange FEMA Flood Insurance Rate Map, the site is located within "Zone X", an area of 0.2% annual chance flood, 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile, and protected by levees from 1% annual chance flood. The potential for the site to be adversely impacted by significant flooding is considered low.

GEOTECHNICAL ENGINEERING FINDINGS AND ANALYSES

LIQUEFACTION ANALYSES

Seismic Input

Based on 2019 CBC requirements, the peak ground acceleration (PGA_M) for the Maximum Considered Earthquake (MCE) event was used for the liquefaction evaluation. The PGA_M of 0.66g and a mean magnitude of 6.8 were considered for this study.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction Evaluation and Seismic Settlement

The site is located within a zone of required investigation for liquefaction as shown on the Seismic Hazard Zone Map for the Dana Point Quadrangle (CGS, 2001).

Liquefaction analyses were performed based on the 2019 CBC and ASCE 7-16 criteria. A historic high groundwater depth of 5 feet was used in the analysis.

Given that CPT results provide a more reliable, accurate and continuous database from which to calculate liquefaction magnitude (i.e., relative to SPT-based analyses), our liquefaction analyses is based on CPT soundings. A liquefaction evaluation was performed on each CPT by means of CLiq, v.2.3.1.15 software and the Robertson (2009) methodology and are presented in Appendix D. Liquefaction analyses based on Standard Penetration Test (SPT) blowcounts were also performed as a cross-check. The SPT-based analysis provided a settlement estimate that was consistent with the results of the CPT analysis.

Based on our seismic settlement analysis and review of overall soil conditions, the earthquake-induced (EQ-induced) settlement is estimated to be 0.75 inch for the MCE event. A differential EQ-induced settlement of 0.5 inch over a span of 40 feet should be prudently considered in the design of the structures.

LATERAL SPREAD ANALYSES

Lateral Spreading and Cyclic Mobility

The proposed development is located within the vicinity of the existing sea wall and harbor where free face geometry and localized areas of shallow liquefiable soils exist. As a result, lateral spread analyses were performed to determine the potential of flow failure to occur during the MCE event. The lateral displacement was analyzed utilizing Cross Sections A-A', C-C', and D-D' for the MCE seismic loading.

Our evaluation included evaluating the stability of each section, post-earthquake, using the residual shear strength of the potentially liquefiable soils, estimating the yield acceleration for the section, and assessing the seismic deformations under liquefied condition which may be considered as an upper bound for the seismic deformations. Slope/W 2020 software was used for the slope stability analysis. Bray and Travasarou (2000) and Rathja and Antonakos (2011) procedures were used for evaluating the seismic displacements.

Our analyses revealed that the post-earthquake slope stability safety factors are less than 1.0 with the liquefied residual shear strengths, indicating a very high potential for earthquake-induced flow failure. Additionally, based on our post-earthquake deformation analyses, the lateral spread deformation was calculated to be greater than 90 inches on average, thus indicating that ground

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

mitigation is required to reduce lateral deformations to levels compatible with the proposed foundation design.

Based on our analyses and findings, numerous lateral spread remediation schemes were evaluated. The most viable remediation scheme consisted of the placement of a Deep Soil Mixing (DSM) buttress between proposed Buildings 6-12 and the existing sea wall, as well as placing the building foundations on DSM piles. In the case of Building 1, the DSM buttress was integrated into the piles below the building due to lack of space for a buttress. More details of the design are contained in subsequent sections of this report.

We note that the DSM columns are designed to provide lateral support for improvements that are located inside the DSM buttress mitigation zone in the event that lateral spreading occurs. Consequently, non-structural improvements such as hardscape and utilities, including the portion of the sea wall seaward of the DSM buttress, are prone to lateral spreading and potential damage.

SOIL EXPANSION

The expansion potential of the surficial soils mantling the site (i.e., the artificial fills that will impact the proposed improvements) are highly variable, ranging from very low to medium. Consequently, the design of the exterior hardscape features should consider a medium expansion potential.

SOIL CORROSION

Corrosion

Based on the test results for pH, soluble chlorides, sulfate, and minimum resistivity of the site soils obtained during our subsurface investigation, the on-site soils should be considered to have:

- A moderate sulfate content or "S1" sulfate exposure to concrete per ACI 318, Table 19.3.1.1. This should be utilized for all concrete above the groundwater table shown on Plate 5.
- A low minimum resistivity indicating conditions that are severely corrosive to ferrous metals.
- A moderate to high chloride content (corrosive to severely corrosive to ferrous metals).

The results of the laboratory chemical tests performed within the site are included in Appendix B.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Concrete Structures Exposed to Seawater

Due to the close proximity of the proposed improvements to the existing harbor and the potential for groundwater fluctuation, we anticipate that some concrete may be in contact with seawater and thus may be exposed to seawater chlorides. Therefore, concrete exposure of W1 and C2 in accordance with ACI 19.3.1.1 should be expected and considered in the concrete design for any concrete structures that may be deep enough to encounter groundwater as determined from Plate 5 (i.e., concrete storm drain pipe, etc.)

STATIC SETTLEMENT / COMPRESSIBLITY

Buildings

Static settlement will be induced by the introduction of new building loads. The underlying artificial fill and marine deposit soils encountered are moderately to slightly compressible under static loading. However, the geotechnical engineering characteristics of the underlying surficial soils are highly variable. Given this variability, and in order to: 1) minimize lateral spreading, 2) minimize foundation scour during a tsunami event, and 3) provide a uniform support of new building foundations, it was determined that DSM columns along with soil cement Load Transfer Platform (LTP) would provide an adequate support for the new buildings.

Given that the foundations will bear onto DSM columns, building foundation settlements will be minimal. Additionally, since the interior concrete slabs will bear on soil cement LTP which is designed to span between the DSM columns below the foundations, settlements are also expected to be minimal. However, local vertical seismic settlements that exceed the estimated values could occur during a maximum considered earthquake, inducing minor building slab distress.

Detailed settlement estimations for the building foundations were performed by Advanced GeoSolutions, Inc. (AGI) and are contained in their design submittal (submitted under separate cover). GMU has reviewed AGI's settlement analysis and confirmed that it is in general conformance with the recommendations provided in this report. The magnitude of the total and differential settlements are provided within the "Geotechnical Slab and Foundation Recommendations" section of this report (Page 24).

PRELIMINARY INFILTRATION TESTING

Seventeen (17) preliminary infiltration tests were performed in general conformance with the County of Orange Technical Guidance Document (TGD). The drill holes, shown on the attached Plate 2 – Composite Geotechnical Map, were excavated to depths of approximately 3.25 to 7.0 feet below the existing grade using a hollow-stem-auger drill rig. The calculated unfactored raw observed infiltration rates are presented in the following table.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Infiltration Rates Results Summary

Drill Hole	Depth Below Finish Grade (feet)	Unfactored Raw Observed Infiltration Rates (inches/hour) *
GMU 17-206-02		
DH-5	5.0	0.04
DH-7	5.0	0.05
DH-8	5.0	0.03
DH-9	5.0	0.03
DH-10	5.0	0.07
DH-13	5.0	0.29
DH-14	5.0	0.10
DH-17	5.0	1.19
DH-18	5.0	0.28
DH-19	4.0	0.01
DH-20	5.0	0.07
DH-21	5.0	0.10
DH-22	5.0	0.24
DH-23	5.0	0.11
DH-24	5.0	0.05
GMU 11-161-00		
DH-10	3.25	0.35
DH-22	7.0	0.04

**Rates do not incorporate a factor of safety.*

The results of the infiltration testing indicate that the unfactored raw observed infiltration rates range from 0.01 to 1.19 inches per hour, with an average unfactored infiltration rate of 0.18 inch per hour. ***Thus, we conclude that infiltration rates for the entire site do not meet the minimum requirement of 0.3 inch/hour when a minimum factor of safety of 2 is applied per the County of Orange TGD manual.*** The preliminary infiltration test hole locations are shown on the attached Composite Geotechnical Map, Plate 2. The results of the infiltration testing are contained in Appendix C of this report.

EXCAVATION CHARACTERISTICS

The artificial fill soils and bedrock materials underlying the site can be easily excavated with conventional grading equipment such as dozers, loaders, excavators, and backhoes. We expect that excavation of new utility trenches can be accomplished utilizing conventional trenching machines and backhoes. Furthermore, groundwater may be encountered (see Plate 5).

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CONCLUSIONS

Based on the geologic and geotechnical findings, it is our opinion that the proposed development is feasible and practical from a geotechnical standpoint if accomplished in accordance with the County of Orange grading and building requirements and the recommendations presented herein. It is also the opinion of GMU Geotechnical that the proposed grading and construction will not adversely affect the geologic stability of adjoining properties provided grading and construction are performed in accordance with the recommendations provided in this report. A summary of conclusions is as follows:

1. The project area is not underlain by any known active faults. Seismic structure design should be in accordance with the 2019 CBC based on ASCE 7-16.

2. As described in detail in the "Groundwater" section of this report (Page 5), groundwater may be as high as 5 feet bgs and is anticipated to impact construction of the DSM columns and excavations for deep utility lines; however, it is not anticipated to impact corrective grading. Plate 5 – Design Groundwater Level Plan, was developed to provide a guide to determining the depth to groundwater for construction.

3. The potential for lateral spreading is considered very high within the limits of the proposed development. Therefore, mitigation for lateral spreading utilizing DSM columns will be required.

4. The site will be subject to low magnitude seismic settlement, therefore settlements should be incorporated into the structure design.

5. The proposed Buildings 1, and 6 through 12 foundations may be subject to significant differential static settlements due to compression resulting from the fill variability. Therefore, ground improvement consisting of DSM columns for direct support of shallow foundations is recommended.

6. The proposed Buildings 2 through 5 renovation may be supported on a conventional slab-on-grade foundation system that is compatible with the existing foundations and slabs.

7. The near-surface site soils are anticipated to have a low to medium expansion potential (EIs 19 to 84) based on our recent laboratory test results and local experience.

8. Given the fill variability and potential disturbance from the demolition of existing structures, corrective grading will be required in all areas of the site – i.e., below building areas and landscape areas.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

9. Corrosion testing indicates that the on-site soils have a moderate sulfate exposure level and are corrosive to buried ferrous metals and reinforcing steel. In addition, concrete structures below the groundwater table may be exposed to seawater, thus requiring special recommendations. Consequently, restriction on the type of cement, water to cement ratio, and compressive strength is required per ACI 318. Additionally, any metal exposed to the soil will need protection.

10. Based on the above Conclusion Items 3 through 9, the following remediation measures will be required: 1) corrective grading beneath the entire site, 2) a DSM column buttress along the sea wall in conjunction with DSM columns below Buildings 6-12 to minimize lateral spreading to 3 inches or less (Note: for Building 1, the DSM buttress was integrated into the DSMs below the building), 3) DSM columns below Buildings 1 and 6 through 12 foundations, 4) a 3-foot layer of cement-treated LTP within Buildings 1 and 6 through 12 pads to span the artificial fill between DSM columns for slab support, and 5) use of a conventional foundation system for the renovation of Buildings 2 through 5.

11. Based on our infiltration testing, infiltration of water into the subsurface soils is deemed not feasible in accordance with the County of Orange TGD manual.

RECOMMENDATIONS

REQUIRED GEOTECHNICAL MITIGATION SUMMARY

The following summarizes the required geotechnical mitigation for the site improvements:

- Lateral Spread Mitigation
  - A buttress of DSM columns will be required between the sea wall and Buildings 6 through 12. The DSM buttress will be set back 20 feet from the sea wall to minimize the potential for encountering existing riprap. Given that a conventional foundation and slab-on-grade foundation system was selected, the DSMs will be designed to reduce lateral spread deformations to 3 inches or less.
  - For Building 1, the DSM buttress was integrated into the design of the DSM columns below the building.

- Buildings 1, and 6 through 12
  - Foundations are to be supported on DSM columns due to:1) fill variability and related differential movements (both expansion and settlement), 2) seismic settlement, 3) lateral spread, and 4) tsunami scour.
  - Slab-on-grade to be supported on a Load Transfer Platform consisting of a 3-foot section of cement-treated soil designed to span between the DSM columns.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- Buildings 2 through 5A and 5B
  - Conventional shallow foundation system.
  - Removed and recompacted or slurry fill below the foundations.

- Flatwork, Pavements, Site Improvements
  - Supported by removed and recompacted engineered fill.

The following summarizes the construction sequence of the required geotechnical mitigation:

- Construction of DSM columns for the buttress and Buildings 1, and 6 through 12.
- Corrective grading of the entire site.
- Raise grades to final grade elevation (i.e., 1-3 feet above existing grades) and construction of the LTP beneath Buildings 1, and 6 through 12.
- Construction of buildings and improvements.

SITE PREPARATION

Following demolition, all significant organic material such as weeds, brush, tree branches, or roots, or construction debris such as old irrigation lines, asphalt concrete, and other decomposable material should be removed prior to the start of the construction of the DSM columns. No rock or broken concrete greater than 6 inches in diameter should be utilized in the fills.

LATERAL SPREADING MITIGATION

As discussed previously, the DSM columns are designed to reduce the lateral spread deformation to 3 inches or less in order to eliminate the need for tying of the building foundation elements in all directions in accordance with ASCE 7-16. Design of the DSM columns is provided by AGI and was reviewed by GMU and found to be in general conformance with the recommendations provided in this report. In general, the DSM buttress columns that are planned in front of Buildings 6-12 and behind the sea wall will be 6 feet in diameter, will extend a minimum of 4 feet into competent bedrock, and will be overlapped to create a continuous 12-foot-wide buttress. The buttress is planned to be set back a minimum of 20 feet from the back of the existing sea wall in order to minimize encountering the existing riprap that is supporting the sea wall; however, it should be noted that the extent of the existing riprap is currently unknown, and isolated areas of riprap may be encountered within the 20-foot zone. As previously discussed, the DSM buttress columns below Building 1 will be integrated into the DSM columns below the building (see next section). Additionally, in order to relieve hydrostatic pressure, slot-cut trenches are planned at approximately 15-foot on-center as shown on AGI's ground improvement plans.

A copy of AGI's ground improvement plans and specifications are attached as Appendix G of this report.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

BUILDINGS SUPPORTED BY DSM

In addition to the DSM columns that are planned within the buttress zone behind the existing sea wall, DSM columns are also planned to support the proposed Buildings 1, and 6 through 12. The DSM columns for Buildings 6 through 12 are planned to be 4 feet in diameter and will be embedded 12 inches into bedrock or refusal, whichever occurs first. For Building 1, the DSMs below the building will consist of: 1) an outer row of 6-foot-diameter DSMs at the perimeter of the building, and 2) interior 4-foot-diameter DSM columns. All DSM columns for Building 1 will be embedded 12 inches into bedrock.

The building DSM columns design provided by AGS is presented as Appendix G of this report.

GRADING

General

The following recommendations pertain to any required grading associated with the proposed improvements and corrective grading needed to support the proposed improvements. All site preparation and grading should be performed in accordance with the County of Orange grading code requirements and the recommendations presented in this report.

Corrective Grading

In all areas of the site, corrective grading should consist of removal and recompaction of 2 feet below the existing ground surface. More detailed recommendations are contained below to ensure that all required corrective grading is performed for each type of improvement. However, it is envisioned that the blanket 2-foot removal will create the necessary corrective grading for all structures. Detailed recommendations for the soil cement LTP are also provided below.

<u>Buildings 1, and 6 through 12 Pads (Existing Grade Treatment)</u>

Corrective grading for the Building 1, and 6 through 12 pads, including the construction of the Load Transfer Platform (LTP) should be performed in accordance with the following recommendations:

- The subgrade within the proposed building pads should be excavated to a depth of 2 feet below the existing grade prior to raising of the grade. The excavation should extend laterally a minimum of 2 feet outside the edge of the buildings envelope.
- The bottom of the over-excavation should then be scarified to a depth of at least 8 inches, moisture conditioned to least 2% above optimum moisture content, and recompacted to at least 92% relative compaction.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- Following the approval of the over-excavation bottom by a representative of GMU, the onsite material mixed with the design cement content may be used as fill material to achieve the planned LTP elevation (i.e., minimum of 3 feet).
- The LTP construction should be performed in accordance with the general recommendations provided in the next section.
- Building pads that require additional fill to achieve the design grade (fill over the LTP), the onsite soil may be used as fill, provided that it is moisture conditioned to 2% above optimum moisture content and compacted to achieve 92% relative compaction.
- Fill paced above the LTP and supporting the new slabs should be tested by GMU to confirm that the expansion index (EI) of the material is less than 50.

Buildings 1, 6-12 Pads (Load Transfer Platform)

After the completion of the corrective grading, a 3-foot section of cement-treated LTP should be constructed in accordance with the following recommendations:

- The LTP, consisting of a soil-cement mixture, shall be placed over the properly recompacted subgrade.
- The minimum thickness of the LTP shall be 3 feet and extend to the edge of the building foundations envelope.
- The 3-foot-thick section of soil-cement shall be constructed in 3 lifts, with each lift having a compacted thickness of no more than 12 inches.
- A mix design shall be performed by the contractor to determine the required amount of cement for the section to achieve a 28-day unconfined compressive strength of 200 psi.
    - Based on the soil types encountered during our subsurface investigation, we anticipate that 6 percent cement can be used for bidding purposes.
    - Final mix design and cement content shall be provided by the contractor prior to performing the work and should be reviewed by GMU.
- The cement shall be dry mixed using a pulverizer. Homogenous mixing of the cement is crucial and requires proper equipment to achieve.
- Following dry mixing, perform a second mixing process with the introduction of water to hydrate the cement, if additional moisture is needed. The moisture content of the mixture must be approximately 1% to 3% above optimum moisture content. From the time the initial addition of water occurs, the material should be fully mixed (dry and wet) and compacted within 2.5 hours or less.
- Compaction of each lift of soil-cement should be performed using a large sheepsfoot compactor. Each lift of cement-treated soil shall be compacted to at least 92% of the maximum dry density as determined by ASTM D 1557.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- The surface of the treated material should wetted at least three times daily (possibly more depending on weather) to maintain a moist surface condition and promote proper curing.
- For at least 24 hours after completion of compaction, heavy traffic on the surface should be minimized to the maximum extent possible, and heavy construction equipment traffic should be completely avoided to prevent breakdown of the treated material prior to the curing process being complete. After 24 hours, the surface should be proof-rolled and checked for yielding under heavy rubber-tire vehicle loads (such as a fully-loaded water truck). If the surface indicates signs of yielding or instability, an additional 24 hours of curing time should be implemented, again minimizing heavy traffic loading.

Please refer to the attached Plate 7 for details of the typical DSM and LTP installation.

Buildings 2 – 5A & 5B Foundation / Slab-On-Grade

Based on our understanding that minor improvements such as construction of new interior and exterior walls with new footings and slab-on-grade may take place within the existing Buildings 2 through 5, we recommend that any new footings and slab-on-grade be supported on engineered fill in accordance with the following recommendations:

- The new footings/slab-on-grade should be excavated to a depth of 2 feet below the bottom of footing or bottom of slab.
- The bottom of the over-excavation should then be scarified to a depth of at least 6 inches, moisture conditioned to least 2% above optimum moisture content, and recompacted to at least 92% relative compaction.
- Following the approval of the over-excavation bottom by a representative of GMU, the onsite material may be used as fill material to achieve the planned foundation bottom elevation.
- The fill material should be placed in 6- to 8-inch-thick lifts, moisture conditioned to 2% above optimum moisture content, and compacted to achieve 92% relative compaction.

As an alternative to the removal and recompaction of the onsite soils, particularly for new footing areas, the excavated 2 feet of soil may be replaced with a 2 sack sand-cement slurry.

Grading of All Areas Outside Building Footprints (Landscape and Hardscape Areas):

- Corrective grading in all areas outside Buildings 6 through 12 will consist of the removal and recompaction of 2 feet bgs.
- Local areas of deeper removal and recompaction may be required based on the requirements for: 1) miscellaneous site appurtenant structures/site retaining walls, 2) vehicular pavement, and 3) flatwork/hardscape/pedestrian pavers (see next sections).

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- **Fills to bring the landscape areas up to grade shall not consist of spoils from the DSMs or LTP as this could create long-term perched water problems.**

Miscellaneous Site Appurtenant Structures / Site Retaining Walls

Grading recommendations for miscellaneous site appurtenant structures and site retaining walls should consist of the following:

- The foundations for appurtenant structures should be over-excavated to a depth of at least 24 inches below the bottom of the foundations.
- The bottom of the over-excavation should then be scarified to a depth of at least 6 inches, moisture conditioned to least 2% above optimum moisture content, and recompacted to at least 92% relative compaction.
- Following the approval of the over-excavation bottom by a representative of GMU, the onsite material may be used as fill material to achieve the planned foundation bottom elevation.
- The fill material should be placed in 6- to 8-inch-thick lifts, moisture conditioned to 2% above optimum moisture content, and compacted to achieve 92% relative compaction.

Vehicular Pavement

Grading recommendations for the new vehicular pavement areas should consist of the following:

- The vehicular pavement section should be over-excavated to a depth of at least 12 inches below the bottom of the pavement section (i.e., 12 inches below the bottom of the aggregate base).
- The bottom of the over-excavation should then be scarified to a depth of at least 6 inches, moisture conditioned to least 2% above optimum moisture content, and recompacted to at least 92% relative compaction.
- Following the approval of the over-excavation bottom by a representative of GMU, the onsite material may be used as fill material to achieve the planned subgrade elevation. Spoil generated by the construction of the DSMs or LTP may also be used to bring the subgrade up to the bottom of the structural pavement section.
- The fill material should be placed in 6- to- 8-inch-thick lifts, moisture conditioned to at least 2% above optimum moisture content, and compacted to achieve 92% relative compaction.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Flatwork/Hardscape/Pedestrian Pavers

Grading recommendations for the new concrete flatwork/hardscape/pedestrian pavers areas should consist of the following:

- The flatwork/hardscape/pedestrian pavers section should be over-excavated to a depth of at least 12 inches below the bottom of the pavers sections (i.e., 12 inches below the bottom of the aggregate base).
- The bottom of the over-excavation should then be scarified to a depth of at least 6 inches, moisture conditioned to least 2% above optimum moisture content, and recompacted to at least 92% relative compaction.
- Following the approval of the over-excavation bottom by a representative of GMU, the onsite material may be used as fill material to achieve the planned subgrade elevation.
- The fill material should be placed in 6- to- 8-inch-thick lifts, moisture conditioned to at least 2% above optimum moisture content, and compacted to achieve 92% relative compaction.
- The flatwork sections should be placed on either a 4-inch-thick layer of crushed miscellaneous base (CMB), crushed aggregate base (CAB), or imported granular material with an EI of 50 or less. To bring the flatwork grade up to within 4 inches of the bottom of the flatwork, spoils from the DSMs or LTP construction may be used, provided that the material is moisture conditioned to 2% above optimum moisture content and compacted to achieve 92% relative compaction.

Additional Grading Recommendations

If existing loose fill materials are found to be disturbed to depths greater than the proposed remedial grading, the depth of excavation, scarification, and re-compaction should be increased accordingly in local areas as recommended by GMU. GMU will need to provide site-specific recommendations based on their observations in the field.

Dewatering

Groundwater is not anticipated to be encountered during corrective grading. However, groundwater should be anticipated during installation of deeper utilities and should be pumped from utility trenches prior to placement of slurry. Final evaluation as to the need for and type of dewatering should be made by the contractor immediately prior to grading. It is recommended that groundwater monitoring be performed prior to the start of construction.

Volume Change

In order to aid in planning for the anticipated grading, we estimate that the change in volume of on-site disturbed surficial fills that are excavated and placed as new compacted fill at an average

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

relative compaction of 92% will result in volume losses ranging from approximately 5% to 10%. For rough planning purposes only, an average volume loss of 7.5% may be assumed.

GRADING AND APPROVAL PROCEDURES

Based on discussions with the County of Orange, facilitated by the Geotechnical Reviewer Mr. Ryan Rose, the grading will be processed under a single precise grading permit. However, individual building pad releases will be granted on a per-pad basis upon completion of the following items for each building pad:

- Demolition
- Installation of Deep Soil Mixing (DSM) columns within the building pad
- All corrective grading – i.e., minimum 2' bgs
- Construction of the cement-treated Load Transfer Platform (LTP) within the building pad.

To release each pad, a grading pad release letter will be prepared by GMU and submitted to the County of Orange. Subject to approval by the County of Orange, each pad can be incrementally released for trenching related to foundation construction. A building permit will need to be obtained prior to foundation construction. In addition, it should be noted that the final grading permit will not be signed off until all the precise grading is complete outside the building pads for all of the buildings (i.e., utility trench backfill, surface drainage, etc.)

TEMPORARY EXCAVATIONS

Temporary excavations for demolition, earthwork, footings, and utility trenches are expected. We anticipate that unsurcharged excavations with vertical side slopes less than or equal to 4 feet high will generally be stable; however, all temporary excavations should be observed by the contractor (primary responsibility) as well as a representative of GMU to verify the soil types and identify special conditions. Our preliminary recommendations for temporary excavations are as follows:

- OSHA Soil Types for Excavation Requirements:
  - Artificial Fill: Type C
  - Bedrock: Type B
- Additional Recommendations:
  - The tops of the excavations should be barricaded so that vehicles and storage loads do not encroach within 10 feet of the excavations. A greater setback may be necessary for heavy vehicles, such as concrete trucks and cranes. GMU should be advised of such heavy vehicle loadings so that specific setback requirements can be established.
  - If the temporary construction excavations are to be maintained during the rainy season, berms are recommended to be graded along the tops of the excavations in

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

order to prevent runoff water from entering the excavation and eroding the slope faces.

- There is a potential for caving and collapse of sidewalls for excavations performed below groundwater. Proper lateral support and/or shoring should be implemented by the contractor based on the conditions exposed and as evaluated by GMU.

Our temporary excavation recommendations are provided only as **minimum** guidelines. All work associated with temporary excavations should meet the minimal safety requirements as set forth by CAL-OSHA. **Temporary slope construction, maintenance, and safety are the responsibility of the contractor.**

Although not anticipated, shoring may be required where the sides of the excavation cannot be sloped to the requirements provided in this report or as required by OSHA for the given soil types. Shoring design (if required) should be based on our geotechnical maps, cross sections, boring logs, and laboratory testing provided in this report. Shoring design performed by others should be reviewed by this office.

STRUCTURE SEISMIC DESIGN

Site-specific seismic design parameters were determined using the USGS computer program ASCE 7 Hazard Tool. The site coordinates used in the analysis were 33.46085° North Latitude and 117.69342° West Longitude. Based on our field exploration and the site soil profile, the site is designated as Site Class C. Seismic design coefficients based on ASCE 7-16 and the 2019 CBC are listed in table below.

2019 CBC and ASCE 7-16 Seismic Design Parameters

Seismic Item	Design Values[a]	ASCE 7-16 or 2019 CBC Reference
Site Class based on soil profile (ASCE 7-16 Table 20.3-1)	C	ASCE 7-16 Table 20.3-1
Short Period Spectral Acceleration S_s	1.266	CBC Figures 1613.2.1 (1-8)
1-sec. Period Spectral Acceleration S_1	0.455	CBC Figures 1613.2.1 (1-8)
Site Coefficient F_a (2019 CBC Table 1613.2.3(1))	1.2	CBC Table 1613.2.3 (1)
Site Coefficient F_v (2019 CBC Table 1613.2.3(2))	1.5	CBC Table 1613.2.3 (2)
Short Period MCE* Spectral Acceleration S_{MS} $S_{MS} = F_a S_s$	1.519	CBC Equation 16-36
1-sec. Period MCE Spectral Acceleration S_{M1} $S_{M1} = F_v S_1$	0.682	CBC Equation 16-37
Short Period Design Spectral Acceleration S_{DS} $S_{DS} = 2/3 S_{Ms}$	1.012	CBC Equation 16-38
1-sec. Period Design Spectral Acceleration S_{D1} $S_{D1} = 2/3 S_{M1}$	0.455	CBC Equation 16-39
MCE[b] Peak Ground Acceleration (PGA)	0.555	ASCE 7-16 Figures 22-9 to 22-13
Site Coefficient F_{PGA} (ASCE 7-16 Table 11.8-1)	1.2	ASCE 7-16 Table 11.8-1
Modified MCE[b] Peak Ground Acceleration (PGA_M)	0.666	ASCE 7-16 Equation 11.8-1
Seismic Design Category	D	ASCE 7-16 Tables 11.6.1 and 11.6.2

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

It should be recognized that much of Southern California is subject to some level of damaging ground shaking as a result of movement along the major active (and potentially active) fault zones that characterize this region. Design utilizing the 2019 CBC is not meant to completely protect against damage or loss of function. Therefore, the preceding parameters should be considered as minimum design criteria.

COMMERCIAL BUILDINGS 1 AND 6-12 DESIGN RECOMMENDATIONS

Geotechnical Slab and Foundation Recommendations

General

Buildings 1 and 6 through 12 should founded on conventional foundations supported on DSM columns and a slab-on-grade supported on a blanket of cement-treated Load Transfer Platform (LTP). Please refer to the detail presented on the attached Plate 7 for DSM and LTP installation.

Slab Design

- Slab Support
    - Minimum 3-foot-thick section of cement-treated LTP or onsite soil underlain by 3-foot section of LTP. See previous “Corrective Grading” section (Page 17).
        - Subgrade compaction
            - 92% relative compaction
            - 1-3% over optimum moisture content for soil-cement mixture. 2% over optimum for onsite soil.
- Slab Type
    - Conventional
        - The minimum slab thickness and reinforcement provided below considers that the onsite soil consist of medium expansive soil and that the LTP will provide uniform support for the proposed slab.
    - Minimum Thickness
        - 5 inches
        - Final thickness to be determined by the structural engineer
    - Minimum Reinforcement
        - #4 bars at 16 inches o.c.
        - Final reinforcement to be specified by the structural engineer
- Moisture Retarder/Barrier
    - 15-mil Stegowrap or equivalent installed in strict compliance with the manufacture’s recommendations.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Foundation Design

- Footing Type
  - Conventional spread and continuous footings
- Footing Support – DSM
  - DSM columns extended into bedrock
  - Minimum 12 inches into bedrock or refusal, whichever occurs first, as verified under the observation or supervision of a Certified Engineering Geologist
  - Note: Groundwater should be anticipated during the deep soil mixing process. See Plate 5.
- Minimum Footing Size
  - Minimum dimensions
    - Width: 24 inches
    - Depth: 24 inches below lowest adjacent grade
- Allowable Bearing Value
  - 5,000 psf
  - As determined by AGI in their design document submitted under separate cover.
  - This value may be increased by 1/3 for short-term loadings such as seismic and wind.
- Preliminary Settlement Estimate
  - DSM
    - Static Total: 1 inch
    - Static Differential: 0.5 inch over a span of 40 feet
    - See AGI design submittal
  - Seismic Settlement
    - Total: 0.75 inch
    - Differential: 0.5 inch over a span of 40 feet
- Passive Resistance and Preliminary Friction Coefficient
  - Passive resistance: 300 psf/ft (engineered fill)
    - Disregard upper 6 inches
    - Maximum allowable of 3,000 psf
  - Friction coefficient: 0.35
  - 1/3 increase for temporary loads such as wind or seismic
- Concrete (Foundation and Slab)*
  - Type: II/V
  - Maximum water/cement ratio: 0.50
  - Minimum compressive strength of 4,000 psi

*See "**Structural Concrete**" section of this report (Page 29).

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

COMMERCIAL BUILDINGS 2-5A and 5B DESIGN RECOMMENDATIONS

We understand that some of the buildings identified as Buildings 2 through 5 will be remodeled by removing and re-configuring some of the interior and exterior walls. As part of this remodel, new footings and re-construction of existing slab-on-grades are expected. Recommendations for new footings and slab-on-grade are presented below.

Slab Design

- Slab Support
  - Minimum 2-foot removal and recompaction
    - Subgrade compaction
      - 92% relative compaction
      - 2% over optimum moisture content
- Slab Type
  - Conventional
    - The minimum slab thickness and reinforcement provided below considers that the onsite soil consist of medium expansive soil and that the LTP will provide uniform support for the proposed slab.
  - Minimum Thickness
    - 5 inches
    - Final thickness to be determined by the structural engineer
  - Minimum Reinforcement
    - #4 bars at 18 inches o.c.
    - Final reinforcement to be specified by the structural engineer
- Moisture Retarder/Barrier
  - 15-mil Stegowrap or equivalent installed in strict compliance with the manufacturer's recommendations.

Foundation Design

- Footing Type
  - Conventional spread and continuous footings
- Footing Support – 2 feet of engineered fill
  - May consist of 2 feet of compacted onsite soil or
  - 2 feet of 2 sack sand cement slurry
- Minimum Footing Size
  - Minimum dimensions
    - Width: 18 inches
    - Depth: 24 inches below lowest adjacent grade

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- Allowable Bearing Value
  - 2,500 psf
  - This value may be increased by 1/3 for short-term loadings such as seismic and wind
- Settlement Estimate
  - Static Total: 1 inch
  - Static Differential: 0.5 inch over a span of 40 feet
- Passive Resistance and Preliminary Friction Coefficient:
  - Passive resistance: 300 psf/ft (engineered fill)
    - Disregard upper 6 inches
    - Maximum allowable of 3,000 psf
  - Friction coefficient: 0.35
  - 1/3 increase for temporary loads such as wind or seismic
- Concrete (Foundation and Slab)*
    - Type: II/V
    - Maximum water/cement ratio: 0.50
    - Minimum compressive strength of 4,000 psi

*See "**Structural Concrete**" section of this report (Page 29).

NON-BUILDING MISCELLANEOUS STRUCTURES DESIGN RECOMMENDATIONS

The following recommendations pertain to non-building foundations supported on 2 feet of engineered fill in accordance with "Corrective Grading" section (Page 17). The design parameters presented below may be used for foundation structural design.

- Bearing Material
  - 2 feet of engineered fill
- Minimum Footing Size
  - Width: 18 inches
  - Depth: 24 inches embedment below lowest adjacent soil grade (depth)
- Allowable Bearing Capacity: 2,000 psf for the minimum footing size given above.
  - Above value may be increased by 1/3 for short-term loading such as wind or seismic
- Lateral Foundation Resistance
  - Allowable passive resistance: 300 psf/ft (disregard upper 6 inches, max 3,000 psf)
  - Allowable friction coefficient: 0.35
  - Above values may be combined without reduction and may be increased by 1/3 for temporary loads such as wind or seismic

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

SITE RETAINING WALLS DESIGN AND CONSTRUCTION

- Foundation Design
  - Minimum Foundation Width: 24 inches
  - Minimum Foundation Depth: Depth below lowest adjacent grade to bottom of footing: 24 inches
  - Bearing Materials: Minimum of 2 feet of engineered fill
  - Allowable Bearing Capacity: 2,000 psf for footing on level ground; may be increased 750 psf for each additional foot of width or depth to a maximum of 4,000 psf. (1/3 increase for wind or seismic)
  - Unit Weight of Backfill: 125 pcf
  - Lateral Foundation Resistance:
    - Allowable Passive Earth Pressure: 300 psf/ft of depth (static)
    - Coefficient of Friction: 0.35
    - Disregard upper 6 inches
    - May be increased 1/3 for seismic conditions
    - May be combined without resistance
  - Wall Design Parameters
    - Active Earth Pressure: 40 pcf – Assumptions: 1) level backfill; 2) select backfill; 3) back-drainage; and 4) wall movement > 0.01 H allowed.
    - Seismic Earth Pressure Walls > 6 feet: 17 pcf – triangular distribution
    - Weight of Backfill: 125 pcf
    - Control/Construction Joints: As a minimum, maximum spacing of 15 feet and at angle points (non-basement walls)
    - Waterproofing: The back side of all retaining walls should be waterproofed down to the top of the foundation prior to placing subdrains or backfill. The design and selection of the waterproofing system is outside the scope of our report and is outside our purview.
  - Concrete*: Type II/V cement (geotechnical perspective only)
    0.50 w/c ratio
    4,000 psi concrete

*See "**Structural Concrete**" section of this report (Page 29).

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- Wall Backfill and Drainage: See Plate 6 – Retaining Wall Construction Detail
- Select Backfill
  - Low expansion
  - Subject to geotechnical approval

POLE FOUNDATION DESIGN RECOMMENDATIONS

Pole foundations will be required for the light bollards for the new parking areas. As a minimum, the pole foundations should be at least 18 inches in diameter and at least 4 feet deep; however, the actual dimensions should be determined by the project structural engineer based on the following design parameters.

- Bearing Materials: Engineered fill approved by a representative from GMU.
- Bearing Values: Allowable bearing pressure of 3,000 pounds per square foot (psf). At least 18 inches in diameter and embedded a minimum of 4 feet below the lowest adjacent grade.
- Lateral Load: Passive resistance of 300 pounds per foot of pile diameter per foot of depth into competent bearing material.

  Passive resistance should be disregarded within the upper foot due to possible disturbance during drilling. The passive resistance may be assumed to be acting over an area equivalent to two pile diameters.

STRUCTURAL CONCRETE

Laboratory tests indicate that the onsite soils in the general area of the site possess moderate levels of sulfate content or "S1" exposure per ACI 318-14, Table 19.3.1.1. Therefore, any structural features which will be in direct contact with the site soils at depth will have restrictions on the type of Portland cement, water to cement ratio, and the concrete compressive strength per ACI 318, Table 19.3.2.1 as follows:

- Type II/V cement with a maximum water to cement ratio of 0.50, and a minimum compressive strength of 4,000 psi (from a geotechnical perspective only).
- **NOTE: Any reinforced concrete elements that extend below the water table should be designed for C2 (Severe) exposure to moisture and chlorides, which consists of a maximum water to cement ratio of 0.40 and minimum compressive strength of 5,000 psi in accordance with ACI 318, Table 19.3.2.1.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

The aforementioned recommendations regarding concrete are made from a soils perspective only. Final concrete mix design is beyond our purview. All applicable codes, ordinances, regulations, and guidelines should be followed regarding designing a durable concrete with respect to the potential for sulfate exposure from the on-site soils and/or changes in the environment. Due to the potential for seawater exposure, the use of a corrosion engineer should be considered.

FERROUS METAL CORROSION

The results of the laboratory chemical tests performed on a sample of soil collected within the site indicate that the on-site soils are moderately corrosive to ferrous metals. In addition, some utilities may be planned below the groundwater table which may have elevated chlorides due to seawater. Consequently, metal structures which will be in direct contact with the soil (i.e., underground metal conduits, pipelines, metal signposts, etc.), in close proximity to the soil (wrought iron fencing, etc.), and/or below the groundwater table may be subject to corrosion.

The use of special coatings or cathodic protection around buried metal structures has been shown to be beneficial in reducing corrosion potential. Additional provisions will be required to address the high chloride contents of the soil or groundwater per the 2019 CBC to protect the concrete reinforcement. The laboratory testing program performed for this project does not address the potential for corrosion to copper piping. In this regard, a corrosion engineer should be consulted to perform more detailed testing and develop appropriate mitigation measures (if necessary).

The above discussion is provided for general guidance regarding the corrosiveness of the on-site soils to typical metal structures used for construction. Detailed corrosion testing and recommendations for protecting buried ferrous metal and/or copper elements are beyond our purview. If detailed testing is required, a corrosion engineer should be consulted to perform the testing and develop appropriate mitigation measures.

MOISTURE VAPOR TRANSMISSION

Moisture Vapor Retarder

A vapor retarder or barrier such as Stego 15 Mil Class A or equivalent should be utilized beneath the building slabs. The retarder/barrier should be installed as follows:

- Below moisture-sensitive floor areas.
- Installed per the manufacture's specifications as well as with all applicable recognized installation procedures such as ASTM E1643-98.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

- Joints between the sheets and the openings for utility piping should be lapped and taped. If the barrier is not continuously placed across footings/ribs, the barrier should, as a minimum, be lapped into the sides of the footings/rib trenches down to the bottom of the trench.
- Punctures in the vapor barrier should be repaired prior to concrete placement.

A capillary break is not required. Also, sand and/or the amount of sand above the moisture vapor retarder should be specified by the owner. The selection of sand above the retarder is not a geotechnical engineering issue and is hence outside our purview.

Water Vapor Transmission Discussion

The placement of a moisture vapor retarder below all slab areas is recommended where moisture sensitive flooring will be placed. It should be noted that the moisture retarder is intended only to reduce moisture vapor transmissions from the soil beneath the concrete and is consistent with the current standard of the industry in building construction in Southern California. It is not intended to provide a "waterproof" or "vapor proof" barrier or reduce vapor transmission from sources above the retarder (i.e., concrete). Sources above the retarder include any sand placed on top of the retarder (i.e., to be determined by the project structural designer) and from the concrete itself (i.e., vapor emitted during the curing process). The evaluation of water vapor from any source and its effect on any aspect of the proposed building space above the slab (i.e., floor covering applicability, mold growth, etc.) is outside our purview and the scope of this report.

Floor Coverings

Prior to the placement of flooring, the floor slabs should be properly cured and tested to verify that the water vapor transmission rate (WVTR) is compatible with the flooring requirements.

SURFACE DRAINAGE

Surface drainage should be carefully controlled during and after grading to prevent ponding and uncontrolled runoff adjacent to building structures and/or other properties. Care will be required during grading to maintain slopes, swales, and other erosion control measures needed to direct runoff toward permanent surface drainage facilities. Positive drainage of at least 2% away from the perimeters of the structures and site pavements should be incorporated into the design. In addition, it is recommended that nuisance water be directed away from the perimeters of the structures using area drains in adjacent landscape and flatwork areas and roof drains tied into the site storm drain system.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

INFILTRATION DESIGN CONSIDERATION

Based on our infiltration testing discussed in a previous section of this report, the installation of an infiltration facility such as an infiltration basin or trench within the subject site is not feasible from a geotechnical standpoint. On this basis, we recommend that one or more of the following Best Management Practices (BMPs) be considered:

- Rain gardens and dispersion trenches
- Bioretention areas and planters
- Permeable pavement
- Similar BMP's infiltrating over an extensive surface area and providing robust pretreatment or embedded treatment process.

Final selection of the type and location of BMP should be provided by the project civil engineer.

BIORETENTION AREAS

If bioretention features are installed, we recommend that an impermeable liner be installed at the bottom and sides of all bioretention areas to prevent vertical and lateral water migration into the adjacent structures and pavements. The design of bioretention basins above the liner is beyond our purview.

UTILITY DESIGN AND BACKFILL CONSIDERATIONS

Utility Design

Buoyancy

Utilities may be subject to buoyancy uplift forces. As a minimum, groundwater levels contained on Plate 5 should be assumed subject to the "notes" contained therein.

Additional Considerations

Site liquefaction may affect the utilities, pavements, and other site improvements. These improvements will be affected by total, regional differential, and local differential seismic settlements. In this regard, wherever possible, utilities should not be located under building slabs.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

The following additional recommendations should also be considered.

- We recommend flexible PVC connections for the utilities connecting to the buildings, and earthquake shut-off valves for pressured utilities at their entrance to the site in accordance with SCWD standards.
- Significant repair and/or replacement will likely be required for all appurtenant structures and utilities in areas not mitigated for liquefaction, in the event of the design level earthquake.
- Any proposed cast iron piping should consider the corrosivity of the onsite soil in accordance with "Ferrous Metal Corrosion" section of this report (Page 30).

Utility Trench Backfill

General

New utility pipeline trenches should be backfilled with select bedding materials beneath and around the pipes and compacted soil above the pipe bedding where utilities are located above groundwater, and slurry backfill where utilities are placed below groundwater. Recommendations for the types of the materials to be used and the proper placement of these materials are provided in the following sections.

Pipe Bedding (Above Groundwater)

The pipe bedding materials should extend from at least 6 inches below the pipes to at least 12 inches above the crown of the pipes. Pipe bedding should consist of either clean sand with a sand equivalent (SE) of at least 30, or crushed rock. If crushed rock is used, it should consist of ¾-inch crushed rock that conforms to Table 200-1.2.1 (A) of the 2021 "Greenbook." Pipe bedding should also meet the minimum requirements of the County of Orange. If the requirements of the County are more stringent, they should take precedence over the geotechnical recommendations. Sufficient laboratory testing should be performed to verify the bedding meets the minimum requirements of the Greenbook and City of Dana Point and County of Orange grading codes.

Based on our subsurface exploration and knowledge of the onsite materials, the soils that will be excavated from the pipeline trenches will not meet the recommendations for pipe bedding materials; therefore, imported materials will be required for pipe bedding.

Granular pipe bedding material having a sand equivalent of 30 or greater should be properly placed in thicknesses not exceeding 3 feet, and then sufficiently flooded or jetted in place.

Crushed rock, if used, should be capped with filter fabric (Mirafi 140N, or equivalent) to prevent the migration of fines into the rock.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Utility Trench Backfill (Above Groundwater)

All existing soil material within the limits of the pipeline alignment is considered suitable for use as trench backfill above the pipe bedding zone or above the slurry if care is taken to remove all significant organic and other decomposable debris, and moisture condition the soil materials as necessary.

Imported soils are not anticipated for backfill since the on-site soils are suitable. However, if imported soils are used, the soils should consist of clean, granular materials with physical and chemical characteristics similar to those described herein for on-site soils. Any imported soils to be used as backfill should be evaluated and approved by GMU prior to placement.

Soils to be used as trench backfill should be moistened, dried, or blended as necessary to achieve a minimum of 2% over optimum moisture content for compaction, placed in loose lifts no greater than 8 inches thick, and mechanically compacted/densified to at least 90% relative compaction as determined by ASTM Test Method D 1557. Jetting is not permitted in this trench zone.

No rock or broken concrete greater than 6 inches in maximum diameter should be utilized in the trench backfills.

Utility Trench Backfill (Below Groundwater)

Utilities that are planned below the groundwater elevation should be backfilled with 2 sack sand-cement slurry to at least 6 inches above the encountered groundwater. The backfill zone above the groundwater may consist of onsite soil or 2 sack sand-cement slurry. If onsite soil is used, it should be placed after the slurry has been allowed to cure for a minimum of 8 hours. The onsite soil should be placed in accordance with the above "Utility Trench Backfill (Above Groundwater)" section.

DSM / LTP Trench Backfill

Utility trench backfills that are planned within the proposed DSM columns and/or building LTP should consist of 2 sack sand-cement slurry regardless if the trenches are above or below groundwater.

PAVEMENT DESIGN RECOMMENDATIONS

General

It is expected that the driveways within the site will be constructed with both asphalt pavement and Portland cement concrete. Therefore, recommendations for both types of pavement areas are provided in the following sections. In order to accommodate fire truck and trash truck loadings, a traffic index (T.I.) of 5.5 has been assumed for the drive areas.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Asphalt Pavement Design

Based on an anticipated R-value of 10, to be obtained after precise grading of asphalt pavement subgrade in the commercial area, the following pavement thicknesses should be anticipated:

Location	R-Value	Traffic Index	Asphalt Concrete (in.)	Aggregate Base (in.)
Car Parking Stalls	10	4.0	4.0	4.0
Drive Aisles	10	5.5	4.0	9.5
Drive Aisles/ Fire Lane	10	7.0	6.0	11.5

Based on our analyses and the provided T.I. of 7.0 for a fire lane, as determined by the project civil engineer, we note that the structural section provided above is adequate to support an occasional OCFA 94,000-pound fire apparatus.

Asphalt pavement structural sections should consist of:

- Crushed miscellaneous base (CMB) or crushed aggregate base (CAB) materials meeting the minimum County of Orange requirements.
- Asphalt concrete (AC) materials of a type meeting the minimum County of Orange requirements.
- The subgrade soils may consist of either onsite soils or recompacted spoils from the DSM and LTP construction, and should be moisture conditioned to a minimum 2% above the optimum moisture content to a depth of at least 6 inches and compacted to at least 92% relative compaction (per ASTM 1557).
- The CMB or CAB and AC should be compacted to at least 95% relative compaction (per ASTM 1557).

Portland Cement Concrete Pavement Design

Driveways, vehicular drives, and appurtenant concrete paving such as trash receptacle bays, will require Portland cement concrete (PCC) pavement. Assuming a T.I. of 6 to 7, a design section of 8 inches of PCC over 6 inches AB should be adequate. PCC vehicular pavement should be designed in accordance with the County of Orange standards.

- The subgrade soils may consist of either onsite soils or recompacted spoils from the DSM and LTP construction, and should be moisture conditioned to a minimum 2% above the optimum moisture content to a depth of at least 6 inches and compacted to at least 92% relative compaction (per ASTM 1557).
- The CMB or CAB should be compacted to at least 95% relative compaction (per ASTM 1557).

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TURF BLOCK PAVEMENT

We understand that Turf Block pavement is proposed on the project within some parking stalls and fire lanes adjacent to the proposed buildings. It is also our understanding that area drains will be installed within the turf blocks to direct water away from the turf block in order to avoid ponding and saturation of the underlying aggregate base material. Based on this, we have developed the following minimum recommendations for the turf block sections based on an assumed Traffic Index (T.I.) of 4.0 for parking stalls and 7.0 for fire lanes, and the tested R-value of 10 for the subgrade soil.

- Based on a T.I. of 4.0 for the parking stalls, we recommend that the proposed turf blocks be underlain by a 2-inch-thick leveling course of sand over 13 inches of Crushed Aggregate Base (CAB) or Crushed Miscellaneous Base (CMB).
- The turf block proposed within the fire lanes with a T.I. of 7.0 or less should be underlain by a 2-inch-thick leveling course consisting of sand over 22 inches of Crushed Aggregate base (CAB) or Crushed Miscellaneous Base (CMB).
- The CAB or CMB materials should meet current Greenbook and County of Orange requirements.
- The CAB or CMB should be placed at or above optimum moisture content and compacted to at least 95% relative compaction.
- The aggregate base should be underlain by a geofabric consisting of Mirafi 600x or equivalent placed over a properly prepared subgrade.

RECYCLED AC MATERIAL

The use of stockpiled, site-derived recycled AC and crushed miscellaneous base (CMB) material for new engineered fill subgrade, and CMB outside buildings and landscaped areas and under new asphalt concrete pavement and hardscape, will require GMU to conduct conformance laboratory testing on representative samples of the pulverized recycled materials to confirm that the samples meet the 2021 Greenbook Section 200-2.4 standards for Crushed Miscellaneous Base. GMU recommends that the recycled materials may be used as engineered fill for exterior subgrade structural support of new asphalt concrete and hardscape improvements outside of the building envelopes. The recycled materials are not to be used as compacted fill for support under any of the building areas or planters on the subject site.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DISINTEGRATED GRANITE WALKWAYS

Due to the expansive nature of the on-site soils, we recommend that the subgrade for the Disintegrated Granite (DG) pedestrian walkways be moisture conditioned to 2% over optimum to a depth of 18 inches below finish grade and compacted to 90% relative compaction. A 4-inch-thick section of Class 2 aggregate base (AB) or crushed miscellaneous base (CMB) should then be placed on the compacted subgrade soils, brought to optimum moisture condition, and compacted to 95% relative compaction prior to placement of the DG. We recommend that the minimum section for the new DG pedestrian walkways consists of 4 inches of DG moisture conditioned to near optimum moisture content, and compacted to at least 90% relative compaction. The DG materials should be in conformance with Section 200-2.7 of the 2021 "Greenbook" Standard Specifications for Public Works Construction.

FLATWORK DESIGN RECOMMENDATIONS

We anticipate that the proposed improvements will be constructed on previously placed compacted fill material and will require minimum processing. However, prior to construction of flatwork/hardscape, we recommend that a 4-inch-thick layer of CMB material be incorporated below the proposed flatwork/hardscape. Spoils generated from the DSM and/or LTP may be used to achieve finish subgrade elevation for the proposed hardscape/flatwork as described in the "Corrective Grading" section of this report (Page 17). The flatwork table provided within Appendix F of this report may be utilized for integration of flatwork into the grading plans.

ROOT BARRIERS

Where new trees or large shrubs are to be located in close proximity to new concrete flatwork, rigid moisture/root barriers should be placed around the perimeter of the flatwork to at least 12 inches in depth in order to offer protection of the flatwork against potential root and moisture damage. Any flatwork near existing mature trees should also incorporate a rigid moisture/root barrier placed at least 2 feet in depth below the top of the flatwork.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

PLAN REVIEW AND FUTURE SERVICES

PLAN REVIEW

Our office should review the final approved precise grading plans, DSM mitigation plans, and landscape plans for the site and comment on the anticipated effects of any major changes from the plans reviewed for this report. In addition, the final building foundation plans and final foundation loads will need to be reviewed to confirm that settlements are within tolerable limits.

FUTURE SERVICES

Construction Plan Review

GMU should review the final construction plans to confirm they are consistent with our recommendations provided in this report.

Geotechnical Testing During Grading and Construction

Given the complexity of the project, it is critical that geotechnical observation and testing is performed by GMU during the following stages of precise grading and construction:

- During site clearing and grubbing.
- During removal of any buried irrigation lines or other subsurface structures.
- During all phases of precise grading including over-excavation, temporary excavations, removals, scarification, ground preparation, moisture conditioning, proof-rolling, and placement and compaction of all fill materials.
- During installation of the DSM columns for the buttress and buildings.
- During grading for the cement treated load transfer platform.
- During installation of all foundations and floor slab elements.
- During backfill of underground utilities.
- During flatwork and paver section placement and compaction.
- During pavement section placement and compaction.
- When any unusual conditions are encountered.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

LIMITATIONS

All parties reviewing or utilizing this report should recognize that the findings, conclusions, and recommendations presented represent the results of our professional geological and geotechnical engineering efforts and judgements. Due to the inexact nature of the state of the art of these professions and the possible occurrence of undetected variables in subsurface conditions, we cannot guarantee that the conditions actually encountered during grading and foundation installation will be identical to those observed and sampled during our study or that there are no unknown subsurface conditions which could have an adverse effect on the use of the property. We have exercised a degree of care comparable to the standard of practice presently maintained by other professionals in the fields of geotechnical engineering and engineering geology, and believe that our findings present a reasonably representative description of geotechnical conditions and their probable influence on the grading and use of the property.

Because our conclusions and recommendations are based on a limited amount of current and previous geotechnical exploration and analysis, all parties should recognize the need for possible revisions to our conclusions and recommendations during grading of the project. Additionally, our conclusions and recommendations are based on the assumption that our firm will act as the geotechnical engineer of record during grading of the project to observe the actual conditions exposed, to verify our design concepts and the grading contractor's general compliance with the project geotechnical specifications, and to provide our revised conclusions and recommendations should subsurface conditions differ significantly from those used as the basis for our conclusions and recommendations presented in this report.

Detailed corrosion testing and recommendations for protecting buried ferrous metal and/or copper elements are beyond our purview.

This report has not been prepared for use by other parties or projects other than those named or described herein. This report may not contain sufficient information for other parties or other purposes.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CLOSURE

If you have any questions concerning our findings or recommendations, please do not hesitate to contact us and we will be happy to discuss them with you. The Plates and Appendices A through G that complete this report are listed in the Table of Contents.

Respectfully submitted,

David R. Atkinson
Project Manager

Katie Farrington, M.Sc., PG, CEG 2611
Senior Engineering Geologist

Gregory Silver, M.Sc., PE, GE 2336
President / CEO
Principal Geotechnical Engineer

ns/17-206-02 (5-27-21)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

SITE-SPECIFIC REFERENCES

Advanced GeoSolutions, Inc. (AGI), "Ground Improvement by Deep Soil Mixing, Dana Point Harbor Commercial Component, Dana Point, California," Submittal No. 01, AGI Reference No. L20-1748, dated May 27, 2021.

Bluewater Design Group, 2003, "Dana Point Marina Redevelopment, Bulkhead Structural Evaluation," December 17, 2003.

Dana Point Harbor, Buildings 6-12 and Surface Parking Lot Precise Grading Plan, Dana Point Harbor Revitalization, prepared by TAIT, dated May 27, 2021.

Diaz-Yourman and Associates, 2005, "Geotechnical Investigation, Dana Point Harbor Launch Ramp Rehabilitation, Dana Point, California," November 29, 2005, Project No. 2005-022.

GMU Geotechnical, Inc., "Report of Geotechnical Investigation, Dana Point Harbor Revitalization Project, Phase 1, Dana Point Harbor, County of Orange, California," July 19, 2013, Project No. 11-161-00.

GeoPentech, "Preliminary Geologic/Geotechnical Assessment Report for the Dana Point Harbor Revitalization Project Environmental Impact Report, January 14, 2004 (updated January 18, 2006).

Leighton Consulting Inc., "Preliminary Geotechnical Investigation Report for the Dana Point Harbor Master Plan, Dana Point Harbor, City of Dana Point, California," December 12, 2002, Project No. 600024-001.

Leighton Consulting Inc., "Geotechnical Engineering Exploration and Analysis for the Proposed Renovations to Dana Point Harbor, City of Dana Point, California," January 7, 2008, prepared for URS/Cash and Associates, Project No. 600024-004.

Zeiser Geotechnical, Inc., 1990, "City of Dana Point General Plan, Coastal Erosion Technical Report," Project No. PN 89312-2.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

AERIAL PHOTOGRAPHS

DATE	FLIGHT	PHOTO
4-19-99	C136-45	170-171
10-15-97	C117-45	118-119
1-2-95	C101-45	10-11
1-14-92	C85-18	2-3
1-9-92	C-7	112-113-114
11-14-87	C-1	0012-0013
1-9-87	F	294-295
5-18-83	218-11	32-33
1-31-81	211-11	24-25
2-26-80	80033	268-269
12-13-78	203-11	43-44
1-24-77	181-11	31
1-13-75	157-11	27-28
10-29-73	132-10	20-21
1-31-70	61-10	223-224-225
3-30-67	2	94-95-96
9-20-65	1FF	86-87
3-28-59	261-R25	77-78
12-12-52	3K	49-50

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TECHNICAL REFERENCES

Boore, D.M. and Atkinson, G.M., 2008, Ground-Motion Prediction Equations for the Average Horizontal Component of PGA, PGV, and 5%-Damped PSA at Spectral Periods between 0.01 s and 10 s: Earthquake Spectra, Vol. 24, No. 1, p. 99-138.

California Building Standards Commission and International Conference of Building Officials, 2019, *2019 California Building Code.*

California Department of Conservation, California Geological Survey, 2008, Guidelines for Evaluation and Mitigation of Seismic Hazards in California: Special Publication 117A, 98 pp.

California Geological Survey (CGS), 2001, Earthquake Zones of Required Investigation, Dana Point 7.5 Minute Quadrangle, dated December 21.

California Department of Conservation, Division of Mines and Geology, 2001, Seismic Hazard Zone Report for the Dana Point 7.5-Minute Quadrangle, Orange County, California, Seismic Hazard Zone Report 049.

Coduto, Donald P., 1994, Foundation Design: Principles and Practices: Prentice-Hall, Inc., Englewood Cliffs, New Jersey.

Federal Highway Administration (FHWA), 1999, "Geotechnical Engineering Circular No. 4, Ground Anchor and Anchored Systems," Publication No. FHWA-IF-99-015, June 1999.

Standard Specifications for Public Works Construction, by Public Works Standards, Inc., 2021, *The Greenbook 2021 Edition*.

U.S. Geological Survey, 2014, 2014 Interactive De-aggregations Program; website address: https://earthquake.usgs.gov/hazards/interactive/.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services Manager, County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

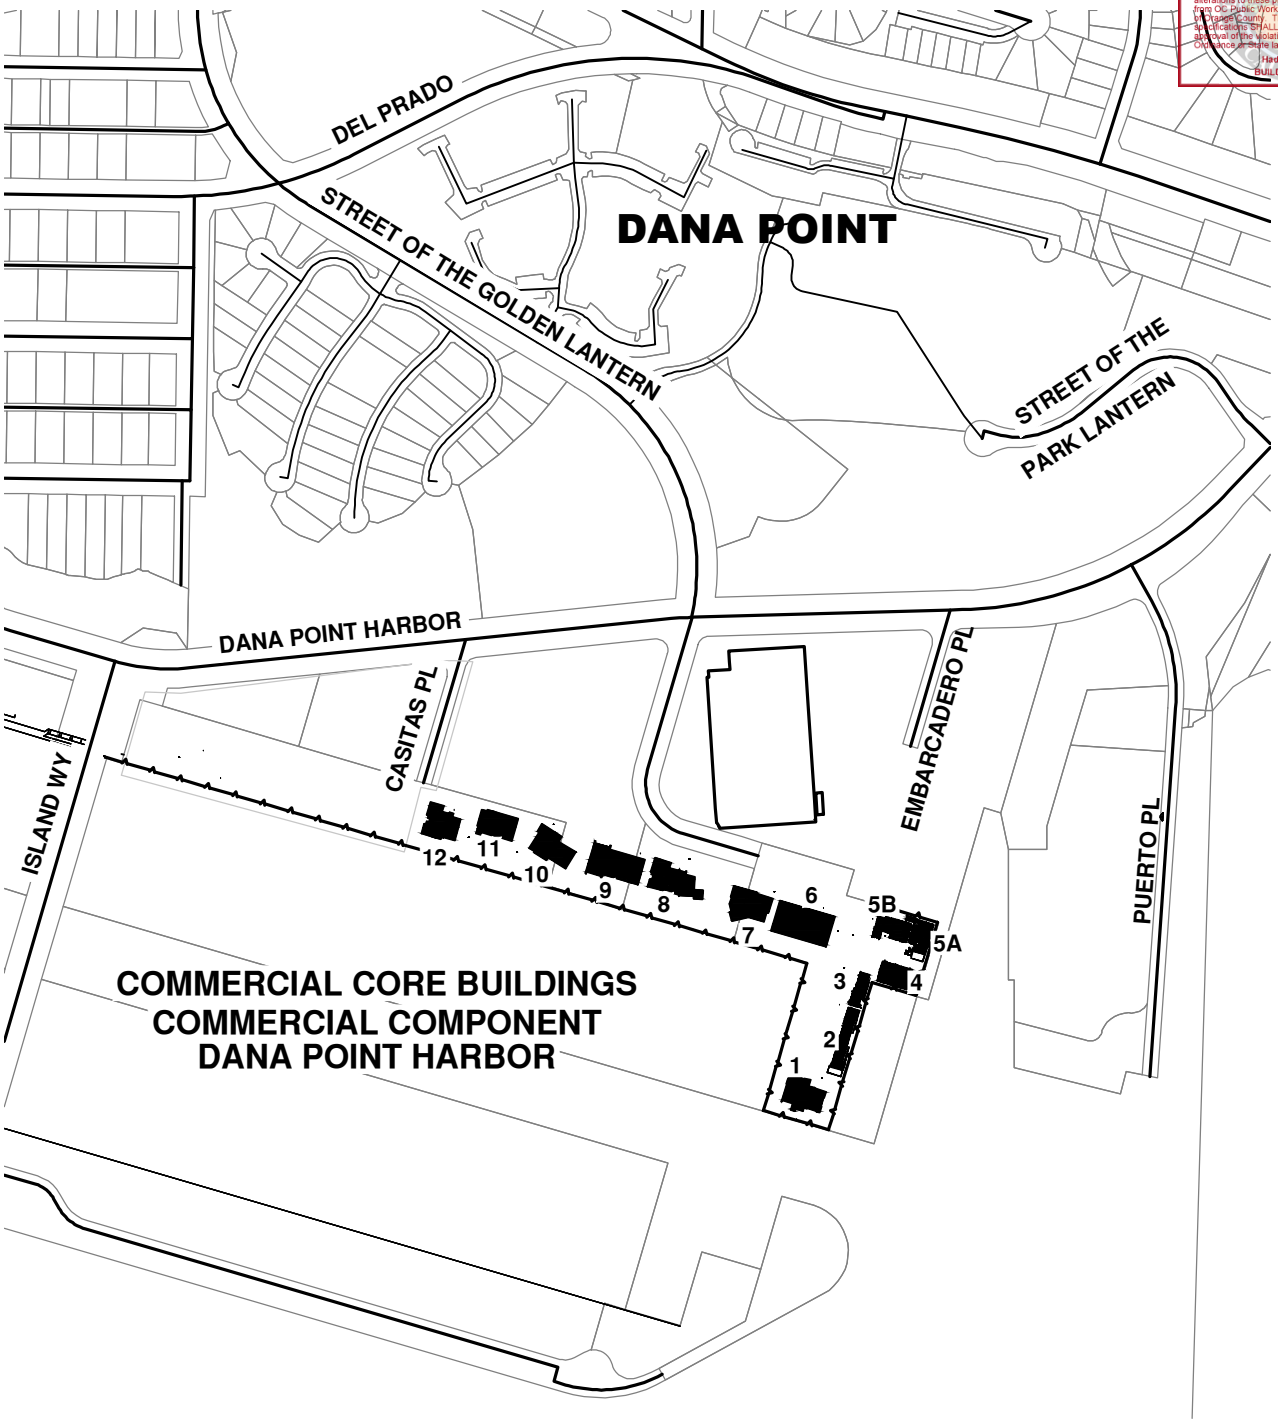

0 500'

Location Map

Commercial Buildings
Commercial Component
Dana Point Harbor Partners, LLC.

GMU	Date:	May 27, 2021	Plate 1
	Project No.:	17-206-02	

DRAWING: q:\2017\17-206-02\dwg\1720602_dph_commcor_plate 1_location map.dwg PLOTTED: 4/29/2021 11:10 AM BY: Jesus Meza

Authority(ies) Approved
Approved: Geotechnical Reports
Review
APPROVAL
County of Orange - OC Public Works
OC DEVELOPMENT SERVICES
APPROVED
THE APPROVAL OF THIS DOCUMENT DOES NOT CONSTITUTE AN AUTHORIZATION OR APPROVAL OF ANY VIOLATION OF ANY FEDERAL, STATE OR LOCAL LAW, REGULATION OR ORDINANCE. IT IS THE RESPONSIBILITY OF THE APPLICANT TO COMPLY WITH ALL LOCAL, STATE AND FEDERAL LAWS, REGULATIONS AND ORDINANCES.
Planning Application Number

LIMITS OF REPORT

CASITAS PLACE

PARKING STRUCTURE
N.A.P.

LIMITS OF REPORT

HARBOR

LIMITS OF REPORT

HARBOR

A

A'

B

B'

C

C'

D

D'

GEOTECHNICAL LEGEND

- **Qaf** — ENGINEERED ARTIFICIAL FILL
- **Qm** — MARINE DEPOSITS, CIRCLED WHEN BURIED
- **Tc** — CRISTIANITOS FORMATION, CIRCLED WHEN BURIED
- **Tm** — MONTEREY FORMATION, CIRCLED WHEN BURIED
- **DH** — APPROXIMATE DRILL HOLE LOCATIONS BY GMU GEOTECHNICAL, INC., PROJECT 17-206-02
- **DH** — APPROXIMATE INFILTRATION TEST LOCATIONS BY GMU GEOTECHNICAL, INC., PROJECT NO. 17-206-02
- **CPT-7A** — APPROXIMATE LOCATION OF GMU CONE PENETRATION TEST HOLE PROJECT 17-206-02
- **DH-4** — APPROXIMATE LOCATION OF GMU DRILL HOLE LOCATIONS (PROJECT 11-161-00)
- **DH-24** — APPROXIMATE LOCATION OF GMU INFILTRATION TESTS (PROJECT 11-161-00)
- **CPT-3** — APPROXIMATE LOCATION OF GMU CONE PENETRATION TEST HOLE (PROJECT 11-161-00)
- **C-4** — APPROXIMATE LOCATION OF GMU ASPHALT CORE HOLE (PROJECT 11-161-00)
- **B-8** — ESTIMATED LOCATION OF PREVIOUS BORING BY LEIGHTON (PROJECT 600024-004, DATED 12/6/07)
- **B-2** — ESTIMATED LOCATION OF PREVIOUS BORING BY LEIGHTON (PROJECT 600024-001, DATED 12/3/02)
- **CPT-10** — ESTIMATED LOCATION OF PREVIOUS CPT BY LEIGHTON (PROJECT 600024-004, DATED 12/6/07)
- **CPT-1** — ESTIMATED LOCATION OF PREVIOUS CPT BY LEIGHTON (PROJECT 600024-001, DATED 12/3/02)
- **DYB 12-01** — ESTIMATED LOCATION OF PREVIOUS BORING BY DIAZ YOURMAN (PROJECT 2012-034, DATED 10/05/12)
- **B-2** — ESTIMATED LOCATION OF PREVIOUS BORING BY DIAZ YOURMAN (PROJECT 2005-022, DATED 11/29/05)
- GEOLOGIC CONTACT
- BURIED GEOLOGIC CONTACT
- GEOTECHNICAL SECTION
- LIMITS OF REPORT

0 40' 80'

Composite Geotechnical Map

Commercial Buildings
Commercial Component Dana
Point Harbor Partners, LLC.

GMU | Date: May 27, 2021 | Project No.: 17-206-02 | Plate 2

DRAWING: G:\2017\17-206-02\dwg\1720602_dsh_commcse_plate 2_composite geo map.dwg PLOTTED: 4/29/2021 4:13 PM BY: Jesus Meza

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSR--B1408/BMSC-0241/BMSC-0242/BMSP-0240

County of Orange - OC Public Works
OC Development Services
APPROVED
Use of or reliance upon this document for any purpose or any portion of this document by any party other than County of Orange, OC Public Works/OC Development Services, its officers, agents, and employees, is at such party's sole risk and without liability to the County of Orange, OC Public Works/OC Development Services, its officers, agents, and employees.
Reg. Dimension
Reg. Exp. 6/30/20

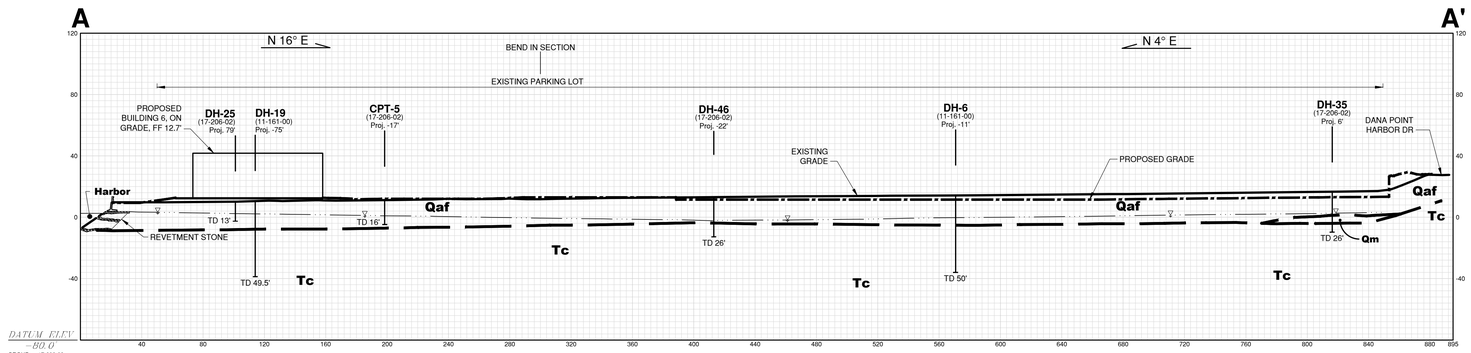

DATUM ELEV. = -80.0'
GROUP 17-206-02
SECTION A - A'
SCALE: 1" = 40'

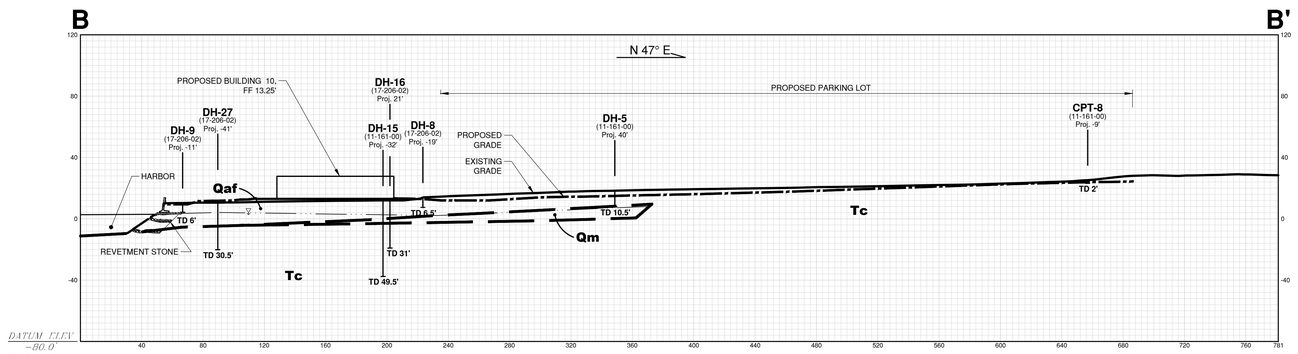

DATUM ELEV. = -80.0'
GROUP 17-206-02
SECTION B - B'
SCALE: 1" = 40'

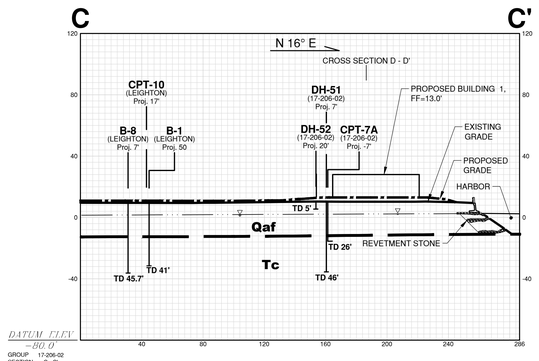

DATUM ELEV. = -80.0'
GROUP 17-206-02
SECTION C - C'
SCALE: 1" = 40'

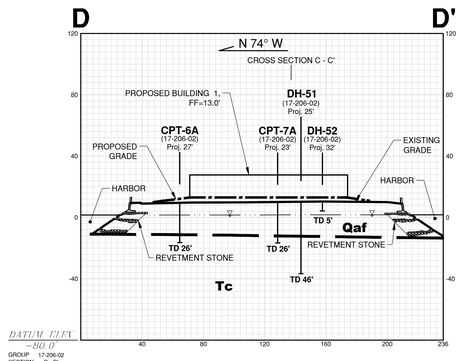

DATUM ELEV. = -80.0'
GROUP 17-206-02
SECTION D - D'
SCALE: 1" = 40'

0 40' 80'

Geotechnical Sections
Commercial Buildings
Commercial Component Dana Point Harbor Partners, LLC.

GMU

Date:	MAY 27, 2021	Plate 3
Project No.:	17-206-02	

DRAWING: q:\2017\17-206-02\dwg\1726002_dph_commcom_plate 3_geo sections.dwg PLOTTED: 4/29/2021 11:49 PM BY: Jesus Mora

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations on these plans without written permission from OC Public Works. OC Development Services of Orange County, the stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

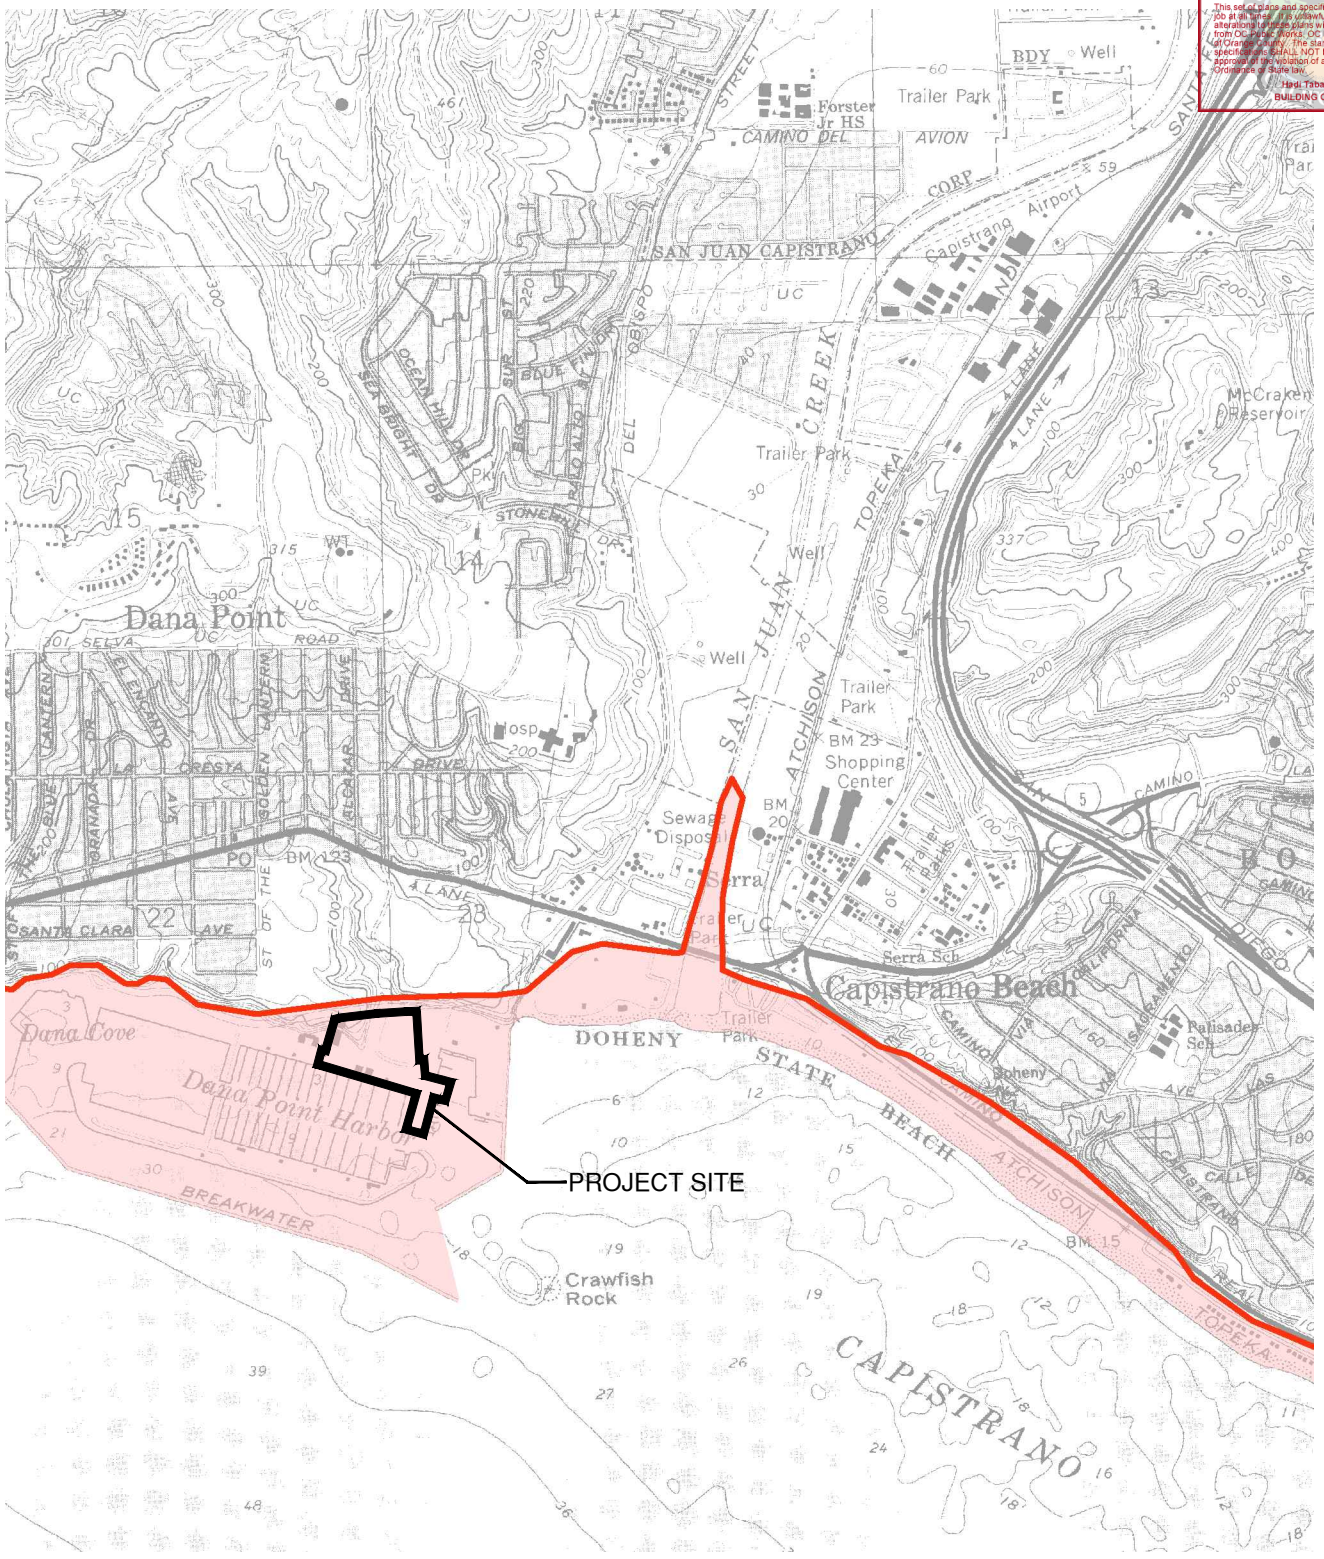

MAP EXPLANATION

- Tsunami Inundation Line
- Tsunami Inundation Area

Tsunami Inundation Map

Commercial Buildings
Commercial Component
Dana Point Harbor Partners, LLC.

GMU

Date:	May 27, 2021
Project No.:	17-206-02

Plate 4

DRAWING: q:\2017\17-206-02\dwg\1720602_plate 4_dph_commcor_tsunami inundation map.dwg PLOTTED: 4/29/2021 2:42 PM BY: Jesus Meza

Building Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits
BMSR-1548/BMSU-1541/BMSY-1542/BMSV-1543

County of Orange - OC Public Works
OC Development Services
APPROVED
Issuance of this permit does not authorize any violation of any federal, state or county law or regulation. Permittee is responsible for all construction and work conforming to all applicable codes and regulations. Permittee shall notify the Building Inspection Office at least 24 hours before needed inspection. Permit becomes null and void if work or construction authorized is not commenced within 180 days, or if construction or work is suspended or abandoned for a period of 180 days at any time after work is commenced.
Plan Dimension
Inspector: [illegible]

GOLDEN LANTERN

DANA POINT HARBOR DRIVE

DANA POINT HARBOR DRIVE

ISLAND WAY

TUBE AREA

PUERTO PLACE

15' BGS

10' BGS

8' BGS

5' BGS

3' BGS

130 TEMP. BOATER PERMIT SPACES

67 TEMP. BOATER PERMIT SPACES

DESIGN GROUNDWATER LEVEL ZONES

- 3' BGS (BELOW EXISTING GROUND SURFACE)
- 5' BGS
- 8' BGS
- 10' BGS
- 15' BGS

NOTES

1. EXISTING GROUND SURFACE IS NOTED BY SPOT ELEVATIONS ABOVE AS SURVEYED BY TAIT AND ASSOCIATES, INC. DATED NOVEMBER 2018.
2. DESIGN GROUND WATER LEVELS DETERMINED FROM GROUNDWATER MEASUREMENT ON THE DAY OF DRILLING AND ADJUSTED TO DAILY HIGH TIDE CONDITIONS. DOES NOT CONSIDER KING TIDES, MAXIMUM HIGH TIDES, AND AFFECTS TO TIDES DUE TO CLIMATE CHANGE.

0 80' 160'

Design Groundwater Level Plan

GMU

Date:	May 27, 2021
Project No.:	17-206-02

Plate 5

DRAWING: G:\2017\17-206-02\dwg\17206002_plate 1 -design gw level plan.dwg PLOTTED: 11/15/2019 9:39 AM BY: jmezes

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works - OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

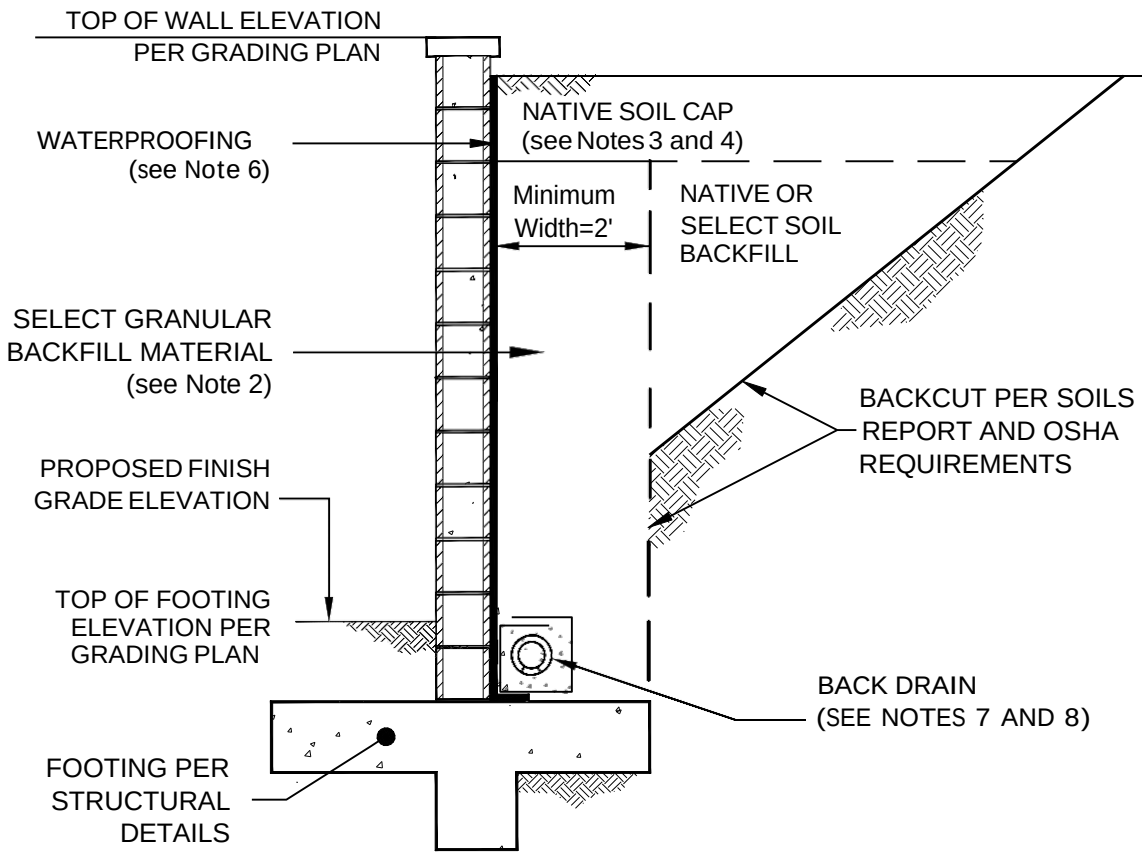

RETAINING WALL DETAIL
NOT TO SCALE

1. FINAL DETERMINATION OF THE MATERIAL TO BE USED FOR BACKFILL SHALL BE MADE BY GMU.
2. ALL SELECT BACKFILL TO WITHIN 1 TO 2 FEET OF FINAL GRADE SHOULD CONSIST OF FREE-DRAINING GRANULAR MATERIAL (I.E. SE 30 SAND, PEA GRAVEL, OR CRUSHED ROCK). CRUSHED ROCK, IF USED, SHOULD BE WRAPPED IN FILTER FABRIC (MIRAFI 140N OR EQUIVALENT) TO MINIMIZE THE POTENTIAL FOR MIGRATION OF FINES INTO THE ROCK. THE SELECT BACKFILL SHOULD BE MOISTURE CONDITIONED TO ACHIEVE OVER OPTIMUM MOISTURE CONTENT PER THE SOILS REPORT AND COMPACTED TO AT LEAST 90% RELATIVE COMPACTION AS DETERMINED BY ASTM TEST METHOD D 1557.
3. FINE-GRAINED NATIVE SOILS SHOULD BE USED TO CAP THE SELECT BACKFILL ZONE.
4. ALL NATIVE OR SELECT SOIL WALL BACKFILL SHOULD BE MOISTURE CONDITIONED AS NECESSARY TO OVER OPTIMUM MOISTURE CONTENT PER THE SOILS REPORT AND COMPACTED TO AT LEAST 90% RELATIVE COMPACTION AS DETERMINED BY ASTM TEST METHOD D 1557.
5. THE BACKSIDE OF THE WALLS SHOULD BE WATERPROOFED DOWN TO AND ACROSS THE TOP OF THE FOOTING. THE DESIGN AND SELECTION OF THE WATERPROOFING SYSTEM IS OUTSIDE OF THE PURVIEW OF GMU.
6. THE WATERPROOFING SYSTEM AND ANY DRAIN BOARDS SHOULD BE PROTECTED FROM DAMAGE BY CONSTRUCTION ACTIVITIES. THE TOP EDGE OF THE WATERPROOFING AND ANY DRAIN BOARDS SHOULD BE PROPERLY ADHERED TO THE WALL AND SEALED TO PREVENT THE POSSIBLE ACCUMULATION OF DEBRIS BETWEEN THE DRAINAGE/WATERPROOFING SYSTEM AND THE WALL.
7. THE BACKDRAIN SYSTEM SHOULD CONSIST OF 4" PERFORATED PIPE SURROUNDED BY AT LEAST ONE CUBIC FOOT OF 3/4"-1.5" OPEN GRADED GRAVEL WRAPPED IN MIRAFI 140N FILTER FABRIC (OR EQUIVALENT). THE PERFORATED PIPE SHOULD CONSIST OF SDR-35 OR SCHEDULE 40 PVC PIPE (OR APPROVED EQUIVALENT) LAID ON AT LEAST 2" OF CRUSHED ROCK WITH THE PERFORATIONS LAID DOWN. THE BACKDRAIN GRADIENT SHOULD NOT BE LESS THAN 1% WHEN POSSIBLE. THE PERFORATED PIPE SHOULD OUTLET INTO AREA DRAINS OR OTHER SUITABLE OUTLET POINTS AT RUNS OF 200 FEET OR LESS, IF PRACTICAL. IF THE BACKDRAINS CANNOT BE OUTLETED BY GRAVITY FLOW, A SUMP PUMP SYSTEM WILL NEED TO BE DESIGNED AND CONSTRUCTED. REDUNDANT BACK-UP PUMPS OR COMPONENTS ARE RECOMMENDED. DESIGN OF THIS SYSTEM IS OUTSIDE OF THE PURVIEW OF GMU.
8. THE TIE-IN LOCATIONS FOR BACKDRAIN OUTLETS SHOULD BE SHOWN ON THE PRECISE GRADING, SITE WALL, AND/OR LANDSCAPE PLANS.

GMU

RETAINING WALL CONSTRUCTION DETAIL

PLATE
6

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BRKE21-0240/BRKE21-0241/BRKE21-0242/BRKE21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

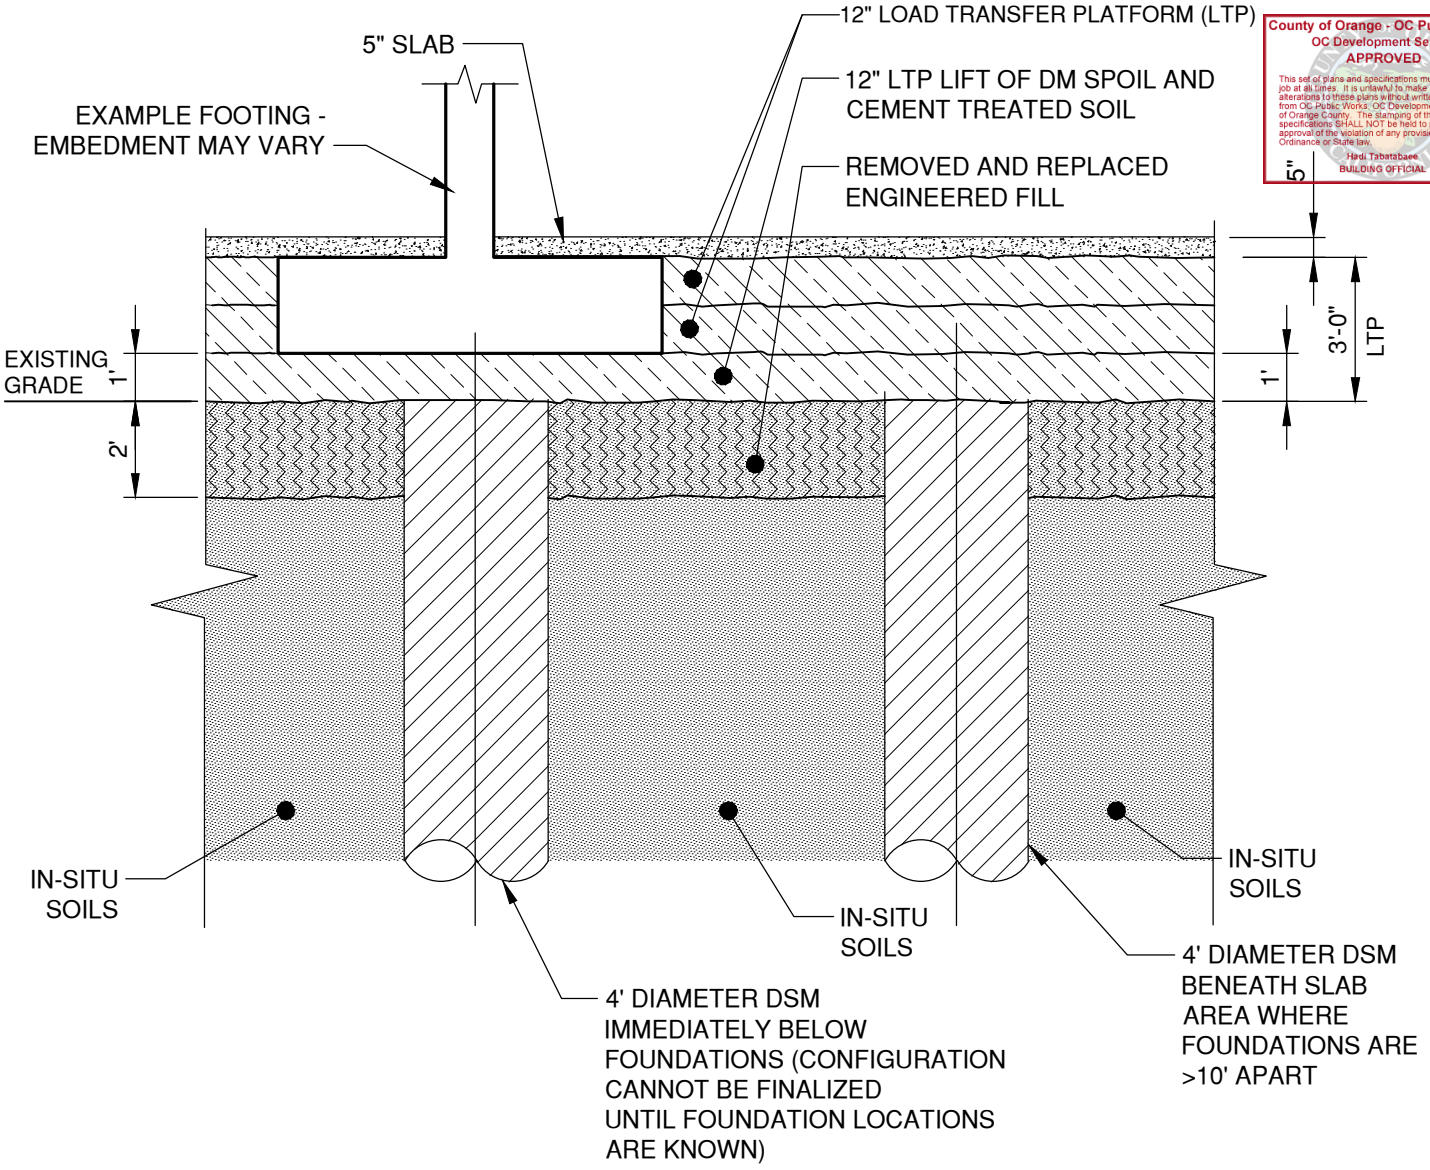

A Typical DSM Support of Buildings 1, 6-12

Scale: 1" = 4'

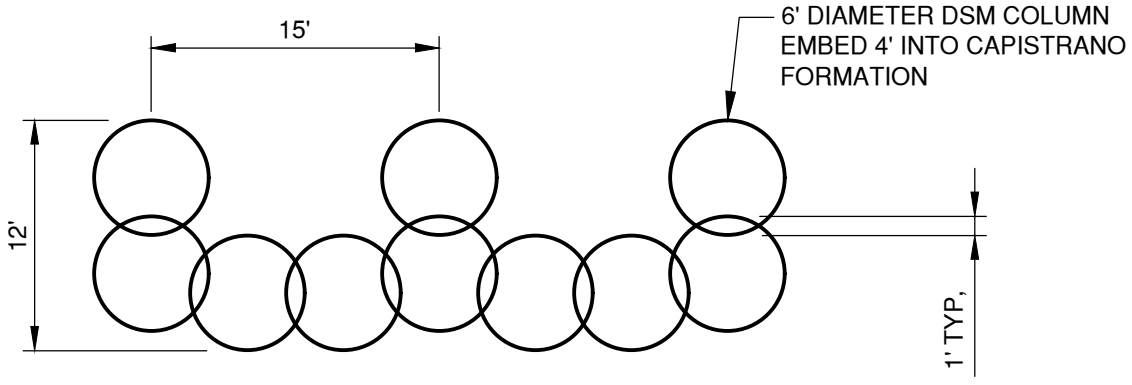

B DSM BUTTRESS Detail

Scale: 1" = 10'

DSM & LTP Installation Detail

Commercial Buildings
Commercial Component
Dana Point Harbor Partners, LLC.

GMU	Date: May 27, 2021	Plate 7
	Project No.: 17-206-02	

DRAWING: q:\2017\17-206-02\dwg\1720602_dph_commcor_plate 7_dsm-ltp installation detail.dwg PLOTTED: 4/29/2021 3:12 PM BY: Jesus Meza

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A

GMU Geotechnical Exploration Procedures and Logs

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A

GMU GEOTECHNICAL EXPLORATION PROCEDURES AND LOGS

Our exploration at the subject site consisted of twenty-eight (28) drill holes and seven (7) Cone Penetration Test soundings (CPT). The estimated locations of the explorations are shown on Plate 2 – Geotechnical Map. Our drill holes were logged by a Staff Engineer, and drive, SPT, and bulk samples of the excavated soils were collected. "Undisturbed" samples were taken using a 3.25-inch outside-diameter drive sampler which contains a 2.416-inch-diameter brass sample sleeve 6 inches in length. Standard penetration testing (SPT) with a 2.0-inch outside-diameter split spoon sampler without liners was performed in the borings during advancement. Blow counts recorded during sampling from the drive sampler and SPT are shown on the drill hole logs. The logs of each drill hole are contained in this Appendix A, and the Legend to Logs is presented as Plate A-1 and A-2. The CPT logs are presented within Appendix A-3. Previous drill hole logs by GMU are presented within Appendix A-1. "Previous Boring Logs by Others" are presented within Appendix A-2, and "CPT Logs by Others" are presented within Appendix A-4.

The geologic and engineering field descriptions and classifications that appear on these logs are prepared according to Corps of Engineers and Bureau of Reclamation standards. Major soil classifications are prepared according to the Unified Soil Classification System as modified by ASTM Standard No. 2487. Since the descriptions and classifications that appear on the Log of Borings are intended to be that which most accurately describe a given interval of a boring, frequently an interval of several feet), discrepancies do occur in the Unified Soil Classification System nomenclature between that interval and a particular sample in that interval. For example, an 8-foot-thick interval in a log may be identified as silty sand (SM) while one sample taken within the interval may have individually been identified as sandy silt (ML). This discrepancy is frequently allowed to remain to emphasize the occurrence of local textural variations in the interval.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

MAJOR DIVISIONS			Group Letter	Symbol	TYPICAL NAMES
COARSE-GRAINED SOILS More Than 50% Retained On No.200 Sieve Based on The Material Passing The 3-Inch (75mm) Sieve. Reference: ASTM Standard D2487	GRAVELS 50% or More of Coarse Fraction Retained on No.4 Sieve	Clean Gravels	GW		Well Graded Gravels and Gravel-Sand Mixtures, Little or No Fines.
			GP		Poorly Graded Gravels and Gravel-Sand Mixtures Little or No Fines.
		Gravels With Fines	GM		Silty Gravels, Gravel-Sand-Silt Mixtures.
			GC		Clayey Gravels, Gravel-Sand-Clay Mixtures.
	SANDS More Than 50% of Coarse Fraction Passes No.4 Sieve	Clean Sands	SW		Well Graded Sands and Gravelly Sands, Little or No Fines.
			SP		Poorly Graded Sands and Gravelly Sands, Little or No Fines.
		Sands With Fines	SM		Silty Sands, Sand-Silt Mixtures.
			SC		Clayey Sands, Sand-Clay Mixtures.
FINE-GRAINED SOILS 50% or More Passe The No.200 Sieve Based on The Material Passing The 3-Inch (75mm) Sieve. Reference: ASTM Standard D2487	SILTS AND CLAYS Liquid Limit Less Than 50%		ML		Inorganic Silts, Very Fine Sands, Rock Flour, Silty or Clayey Fine Sands or Clayey Silts With Slight Plasticity.
			CL		Inorganic Clays of Low To Medium Plasticity, Gravelly Clays, Sandy Clays, Silty Clays, Lean Clays.
			OL		Organic Silts and Organic Silty Clays of Low Plasticity
	SILTS AND CLAYS Liquid Limit 50% or Greater		MH		Inorganic Silts, Micaceous or Diatomaceous Fine Sandy or Silty Soils, Elastic Silts.
			CH		Inorganic Clays of High Plasticity, Fat Clays.
			OH		Organic Clays of Medium To High Plasticity, Organic Silts.
HIGHLY ORGANIC SOILS			PT		Peat and Other Highly Organic Soils.

The descriptive terminology of the logs is modified from current ASTM Standards to suit the purposes of this study

ADDITIONAL TESTS

DS = Direct Shear
HY = Hydrometer Test
TC = Triaxial Compression Test
UC = Unconfined Compression
CN = Consolidation Test
(T) = Time Rate
EX = Expansion Test
CP = Compaction Test
PS = Particle Size Distribution
EI = Expansion Index
SE = Sand Equivalent Test
AL = Atterberg Limits
FC = Chemical Tests
RV = Resistance Value
SG = Specific Gravity
SU = Sulfates
CH = Chlorides
MR = Minimum Resistivity
pH
(N) = Natural Undisturbed Sample
(R) = Remolded Sample
CS = Collapse Test/Swell-Settlement

GEOLOGIC NOMENCLATURE

B = Bedding C = Contact J = Joint
F = Fracture Flt = Fault S = Shear
RS = Rupture Surface = Seepage
= Groundwater

SAMPLE SYMBOLS

Undisturbed Sample (California Sample)
Undisturbed Sample (Shelby Tube)
Bulk Sample
Unsuccessful Sampling Attempt
SPT Sample

5
10 Blows per 6-Inches Penetration
15
10: 10 Blows for 12-Inches Penetration
6/4": 6 Blows for 4-Inches Penetration
P: Push
(13): Uncorrected Blow Counts ("N" Values) for 12-Inches Penetration- Standard Penetration Test (SPT)

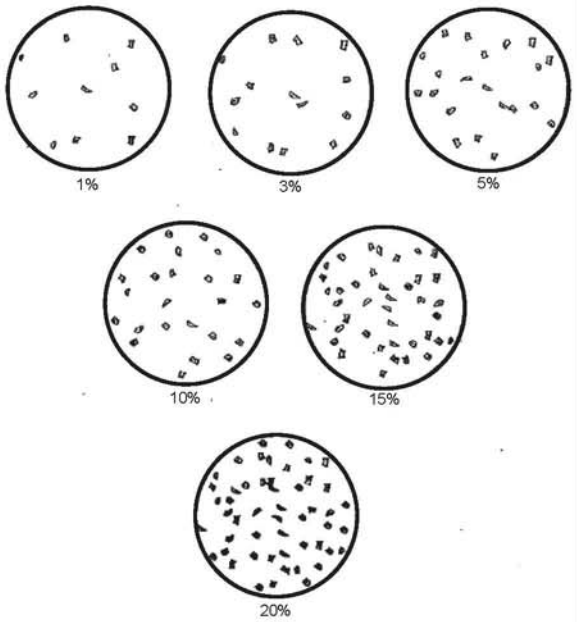

GMU

LEGEND TO LOGS

ASTM Designation: D 2487
(Based on Unified Soil Classification System)

Plate
A-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

SOIL DENSITY/CONSISTENCY

FINE GRAINED

Consistency	Field Test	SPT (#blows/foot)	Mod (#blows/foot)
Very Soft	Easily penetrated by thumb, exudes between fingers	<2	<3
Soft	Easily penetrated one inch by thumb, molded by fingers	2-4	3-6
Firm	Penetrated over 1/2 inch by thumb with moderate effort	4-8	6-12
Stiff	Penetrated about 1/2 inch by thumb with great effort	8-15	12-25
Very Stiff	Readily indented by thumbnail	15-30	25-50
Hard	Indented with difficulty by thumbnail	>30	>50

COARSE GRAINED

Density	Field Test	SPT (#blows/foot)	Mod (#blows/foot)
Very Loose	Easily penetrated with 0.5" rod pushed by hand	<4	<5
Loose	Easily penetrated with 0.5" rod pushed by hand	4-10	5-12
Medium Dense	Easily penetrated 1' with 0.5" rod driven by 5lb hammer	10-30	12-35
Dense	Dificult to penetrat 1' with 0.5" rod driven by 5lb hammer	31-50	35-60
Very Dense	Penetrated few inches with 0.5" rod driven by 5lb hammer	>50	>60

BEDROCK HARDNESS

Density	Field Test	SPT (#blows/foot)
Soft	Can be crushed by hand, soil like and structureless	1-30
Moderately Hard	Can be grooved with fingernails, crumbles with hammer	30-50
Hard	Can't break by hand, can be grooved with knife	50-100
Very Hard	Scratches with knife, chips with hammer blows	>100

MODIFIERS

Trace	1%
Few	1-5%
Some	5-12%
Numerous	12-20%
Abundant	>20%

GRAIN SIZE

Description		Sieve Size	Grain Size	Approximate Size
Boulders		>12"	>12"	Larger than a basketball
Cobbles		3-12"	3-12"	Fist-sized to basketball-sized
Gravel	Coarse	3/4-3"	3/4-3"	Thumb-sized to fist-sized
	Fine	#4-3/4"	0.19-0.75"	Pea-sized to thumb-sized
Sand	Coarse	#10-#4	0.079-0.19"	Rock-salt-sized to pea-sized
	Medium	#40-#10	0.017-0.079"	Sugar-sized to rock salt-sized
	Fine	#200-#40	0.0029-0.017"	Flour-sized to sugar-sized
Fines		passing #200	<0.0029"	Flour-sized and smaller

MOISTURE CONTENT

Dry- Very little or no moisture
Damp- Some moisture but less than optimum
Moist- Near optimum
Very Moist- Above optimum
Wet/Saturated- Contains free moisture

GMU

LEGEND TO LOGS

ASTM Designation: D 2487
(Based on Unified Soil Classification System)

Plate

A-2

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-5

Sheet 1 of 1

Date(s) Drilled	**9/10/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**8.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (approximately 3.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 3.5 inches)						
					CLAYEY SAND (SC), yellowish brown, slightly moist, dense, medium to coarse grained						
			Scattered gravel up to 2"				11 11 25	140	9	129	
5											
	5				dark yellowish brown, moist, medium dense, fine to medium grained		7 7 9	140			
			Rare gravel up to 1"								
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH- 5

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-7

Sheet 1 of 1

Date(s) Drilled	**9/10/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**7.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (approximately 4.5 inches)						
					Aggregate Base (approximately 7 inches)						
			ARTIFICIAL FILL (Qaf)		SANDY CLAY (CL), gray, moist, stiff, medium to coarse grained sand						
5			Abundant gravel up to 2"				3 7 10	140	20	101	
	5		Scattered gravel up to 1"		medium grained		6 7 12	140			
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH- 7

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-8

Sheet 1 of 1

Date(s) Drilled	**9/11/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**10.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
10					Asphalt Concrete (approximately 4.5 inches)						
					Aggregate Base (approximately 7 inches)						
			ARTIFICIAL FILL (Qaf)		CLAYEY SAND (SC), pale brown, slightly moist, dense, medium to coarse grained, some gravel						
			Gravel up to 3"				4 12 25	140	12	125	
	5										
5			Rare gravel up to 0.75"		brown, moist, loose, fine to medium grained		4 3 3	140			
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH- 8

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-9

Sheet 1 of 1

Date(s) Drilled	**9/11/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**7.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (approximately 3.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 3.5 inches)						
	5		Gravel up to 4"		CLAYEY SAND (SC), pale brown, brown, gray and orange brown, moist, medium dense, fine to medium grained, some gravel		5 7 12	140	13	111	
	5		Rare gravel up to 1"		grayish brown and gray, moist, medium dense, fine to medium grained		3 5 7	140			
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH- 9

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-10

Sheet 1 of 1

Date(s) Drilled	**9/11/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**7.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (approximately 3 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 3 inches)						
					CLAYEY SAND (SC), brown and gray, moist, medium dense, medium to coarse grained, some gravel						
5			Gravel up to 4"				5 10 12	140	11	118	
	5		Rare gravel up to 1"		fine to medium grained		4 4 8	140			
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH-10

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-11

Date(s) Drilled	**9/11/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**51.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**7.3**
Groundwater Depth [Elevation], feet	**14.3 [-7.0]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf)		Asphalt Concrete (approximately 2.5 inches)						
					CLAYEY SAND (SC), orange brown and brown, moist, very dense, medium grained						
5			Gravel up to 1"				10 12 40	140	14	112	
	5		Rare gravel up to 1"		orange brown and gray, moist, medium dense, medium to fine grained		8 12 12	140			
0					gray and dark brown, moist to wet, medium dense, medium grained		5 6 9	140	17	109	
	10		Scattered gravel up to 2"		brown, dark brown, very moist, medium dense, fine to medium grained, some gravel		7 7 10	140	17	110	
-5											
	15		**CAPISTRANO FORMATION (Tc)**		Interbedded CLAYEY SILTSTONE, SANDSTONE and SILTSTONE (ML), gray, yellow brown, dark brown and black, wet, dense/very stiff, fine to coarse grained		7 12 18	140			
-10											

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-11

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of any violation of any County Ordinance or State law.
Hadi Tabatabaee
Director, OC Development Services

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-11

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			Sandstone interbeds, white mottles, thinly bedded		SILTSTONE (ML), very dark gray, slightly moist, hard, fine grained		8 50/6"	140	19	101	
-15											
	25				SANDSTONE (SP), gray and brownish gray, wet, very dense, medium to fine grained		25 34 50	140			
-20											
	30		Pale brownish gray				50/5"	140	11	123	
-25											
	35		Pale yellowish gray and gray				50/6"	140			
-30											
	40				Interbedded CLAYEY SILTSTONE, SILTY SANDSTONE and SILTSTONE (ML), dark gray and dark brownish black, slightly moist, very dense/hard, fine grained		27 50	140	29	91	
-35											

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-11

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provision of any County Ordinance or State law.
Hadi Tabatabaee
Date: 1/16/2025

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-11

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-40			Sandstone interbeds, well bedded		SILTSTONE (ML), dark brownish black and gray, slightly moist, hard		12 18 26	140			
	50		Thinly bedded, white mottles on bedding planes		SILTSTONE (ML), dark brownish black, slightly moist, hard		13 50/3"	140	30	91	
					Total Depth = 51 feet Groundwater encountered at 14.3 feet						

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-12

Sheet 1 of 2

Date(s) Drilled	**9/11/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**31.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**8.3**
Groundwater Depth [Elevation], feet	**10.6 [-2.3]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf)		Asphalt Concrete (approximately 3 inches)						
					SANDY CLAY (CL), gray, dark brown and brown, slightly moist, soft to firm						
5			Abundant gravel up to 2"				7 4 5	140			
	5				CLAYEY SAND (SC), dark gray, moist, very dense, medium grained		30 32 30	140	13	122	
0			Gravel up to 1"		yellowish brown, moist, medium dense, fine to medium grained		6 6 7	140			
	10				dark brown, gray and yellowish brown, moist, medium grained ▽		5 6 7	140	19	109	
-5											
	15		**CAPISTRANO FORMATION (Tc)**		SANDSTONE (SP), gray and yellowish gray, wet, dense, medium to fine grained		5 19 21	140			
-10											

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of any violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
1/16/2025

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-12

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			Thinly bedded		SILTSTONE (ML), dark brownish gray, slightly moist, hard		20 39 50	140	31	87	
-15	25						10 17 20	140			
-20	30						27 50/4"	140	19	105	
					Total Depth = 31 feet Groundwater encountered at 10.6 feet						

Drill Hole DH-12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-13

Sheet 1 of 1

Date(s) Drilled	**9/11/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**17.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (approximately 4 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 7 inches)						
15			Gravel up to 1"		CLAYEY SAND (SC), dark gray, slightly moist, dense, fine to coarse grained, some gravel		3 10 17	140	13	120	
	5		Scattered gravel up to 0.5"		pale brown, slightly moist, medium dense, fine grained		2 1 2	140			
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-13

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-14

Sheet 1 of 1

Date(s) Drilled	**9/11/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**15.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
15			**ARTIFICIAL FILL (Qaf)**		CLAYEY SAND (SC); dark gray, damp to moist, medium dense, fine to coarse grained sand, gravel up to 1 inch in diameter		7 9 13	140	12	124	
10	5				dark gray and pale brown, moist, medium dense, fine grained sand, scattered gravel up to 1/2" in diameter		9 4 7	140			
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-14

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-16

Sheet 1 of 2

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**31.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**8.3**
Groundwater Depth [Elevation], feet	**10.0 [-1.7]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
					Asphalt Concrete (approximately 3.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 3 inches)						
					CLAYEY SAND (SC), brown and gray, moist, medium dense, fine grained, some gravel						
5			Gravel up to 2"				7 12 9	140			
	5		Abundant gravel up to 2"		gray, orange brown, brown and black, moist, very dense, medium grained		8 26 30	140	11	112	
0			Rare gravel up to 0.5"		brownish gray, moist, loose, medium to fine grained		3 3 4	140			
	10				grayish brown and gray, wet, medium dense, medium to fine grained	▽	6 5 7	140	16	110	
-5					gray and brownish gray, moist to wet, loose, medium to fine grained		2 2 2	140			
	15		**CAPISTRANO FORMATION (Tc)** Tip of sampler: Sandstone, dark gray, wet, medium grained, scattered gravel up to 2" standing water at completion of drilling		SANDSTONE (SP), pale brown, wet, very dense, medium grained		5 27 50/4"	140	13	120	
-10											

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-16

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of any violation of any County Ordinance or State law.
Hadi Tabatabaee
Director, OC Development Services

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-16

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					SANDSTONE (SP), orange brown, wet, very dense, medium to coarse grained		35 50/5"	140			
-15											
	25		Orange brown and dark orange brown				50/6"	140	19	110	
-20											
	30				SANDSTONE and SANDSTONE with SILT (SP), orange brown, brown and dark gray, wet, very dense		50/6"	140			
					Total Depth = 31 feet Groundwater at 10 feet						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH-16

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of any violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-17

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**11.6**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf)		Asphalt Concrete (approximately 3 inches) Aggregate Base (approximately 3 inches) CLAYEY SAND (SC), grayish brown, brown and orange brown, slightly moist, loose, fine grained						
10			Abundant gravel up to 1"				4 4 4	140			
	5		Scattered gravel up to 0.5"		pale grayish brown and brown, moist, dense, fine grained		11 10 12	140			
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH-17

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-18

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**5.1 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**11.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (approximately 2 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 5 inches)						
10					CLAYEY SAND (SC), brown, gray brown, slightly moist, medium dense, fine to medium grained, some gravel						
			Possibly highly weathered bedrock (inconclusive)				8 7 8	140			
	5										
					Total Depth = 5.1 feet Groundwater Not Encountered		50/1"	140	15	111	

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-18

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-19

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**12.6**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (Approximately 1.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 2.5 inches)						
					CLAYEY SAND (SC), brown and yellowish brown, moist, loose, fine grained						
10			Scattered gravel up to 1", possibly highly weathered bedrock (inconclusive)				5 2 4	140			
	5		Gravel up to 4"		SAND (SP), pale yellowish brown, moist, dense, fine to medium grained		15 18 8	140			
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-20

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**12.0**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (Approximately 3.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (Approximately 3.5 inches)						
10			Scattered gravel up to 2"		CLAYEY SAND (SC), brown and grayish brown, slightly moist, medium dense, fine grained		7 12 12	140			
	5		Possibly highly weathered bedrock (inconclusive)		pale yellowish brown and grayish brown, fine to medium grained		4 6 8	140	19	107	
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-20

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-21

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**11.8**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (approximately 4.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 2 inches)						
10					CLAYEY SAND (SC), brown and grayish brown, moist, loose, fine grained						
			Orange brown mottles				3 3 4	140			
	5		Orange brown mottles, gravel up to 2". Possibly highly weathered bedrock (inconclusive)		grayish brown, medium dense, fine to medium grained, some gravel		9 6 9	140	15	111	
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-21

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-22

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**11.0**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					Asphalt Concrete (approximately 3 inches)						
10			**ARTIFICIAL FILL (Qaf)**		Aggregate Base (approximately 3 inches)						
					CLAYEY SAND (SC), pale yellowish gray and orange brown, moist, medium dense, fine grained, some gravel						
			Gravel up to 2". Possibly highly weathered bedrock (inconclusive)				5 6 7	140			
	5		Scattered rounded gravel up to 2"		pale yellowish gray and brown, moist, dense, fine grained		8 9 20	140	12	118	
5					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-22

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-23

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**6.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf)		Asphalt Concrete (approximately 4 inches)						
5			Scattered gravel up to 2"		CLAYEY SAND (SC), grayish brown, moist, medium dense, fine to medium grained		4 5 6	140			
0	5				brownish gray, wet, medium dense, fine to medium grained		4 6 8	140	14	118	
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-23

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-24

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**6.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**5.3**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
5					Asphalt Concrete (approximately 4 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 3 inches)						
					CLAYEY SAND (SC), brown and grayish brown, slightly moist, loose, fine grained		3 3 6	140			
0	5				dark brownish gray, moist, medium dense, fine to medium grained		2 3 3	140	17		
					Total Depth = 6.5 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-25

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**13.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**10.8**
Groundwater Depth [Elevation], feet	**NA []**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
					Asphalt Concrete (approximately 2 inches)						
10			**ARTIFICIAL FILL (Qaf)**		Aggregate Base (approximately 3 inches)						
					CLAYEY SAND (SC), brown and brownish gray, moist, medium dense, fine to medium grained, some gravel						
			Gravel up to 3"				4 7 11	140			
	5				dark brown, moist, dense, medium to fine grained		24 15 11	140			
5											
			Possibly highly weathered bedrock (inconclusive)		SANDY FAT CLAY (CH), dark gray and gray, moist, medium dense, fine grained		4 5 5	140	13		
	10		Scattered rounded gravel up to 2", minor fine grained sand				2 4 4	140	18	109	
0											
			bedrock fragment in sampler Weakly bedded		Fragment of bedrock composed of SILTSTONE, CLAYEY SILTSTONE and SANDSTONE with GRAVEL (ML), dark gray and pale brown, slightly moist, hard, fine grained		50/5"	140			
					Total Depth = 13 feet Groundwater Not Encountered						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-25

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-26

Sheet 1 of 1

Date(s) Drilled	**9/12/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**16.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**11.8**
Groundwater Depth [Elevation], feet	**10.0 [1.8]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
					Asphalt Concrete (approximately 1.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 4 inches)						
10					CLAYEY SAND (SC), pale brownish gray, moist, medium dense, fine grained						
			Scattered gravel and cobbles up to 6". Rare orange brown mottles.				5 8 16	140			
	5		Rounded gravel up to 4", interbeds of clayey siltstone with gravel, dark gray		very dense, coarse to medium grained, some gravel		8 16 25	140	10	128	
5			Minor fine sand, rare orange brown staining, scattered gravel		loose		2 3 4	140			
	10				olive brown, wet, dense, fine grained ▽		5 9 12	140	14	113	
			MARINE DEPOSITS (Qm)		SANDY CLAY (CL), very dark gray, wet, very stiff						
0			Minor fine to medium grained sand, gravel is sub-rounded up to 1"				4 9 15	140			
	15		**CAPISTRANO FORMATION (Tc)** Gravel is sub-rounded to rounded up to 4"		SILTSTONE with SAND (ML), very dark gray, moist, hard, some clay and gravel		30 50/4"	140			
					Total Depth = 16 feet Groundwater at 10'						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-26

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-27

Sheet 1 of 2

Date(s) Drilled	**9/13/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**30.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**7.3**
Groundwater Depth [Elevation], feet	**8.0 [-0.7]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
					Asphalt Concrete (approximately 3.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 7 inches)						
					CLAYEY SAND (SC), pale grayish brown, slightly moist, medium dense, fine grained						
5			Scattered gravel to 3".				5 5 5	140			
	5		Scattered gravel to 2".		grayish brown, moist, dense, fine to medium grained		6 9 15	140	14	119	
0			Possibly highly weathered littoral deposits		brown, moist, very dense, fine to medium grained		50/2.5"	140			
	10		Scattered gravel (cobble fragments) consist of San Onofre breccia		SANDY CLAY (CL), dark gray, wet, very dense, fine to medium grained		20 22 10	140	26		
-5			Upper portion of sample: Sand with shell hash (broken shell fragments)		CLAYEY SAND (SC), brown, gray and orange brown, wet, medium dense, fine to medium grained		3 5 17	140			
	15		**CAPISTRANO FORMATION (Tc)**		SANDSTONE (SP), pale gray, gray and orange brown, wet, very dense, medium to fine grained		17 50/3"	140	16	115	
-10			standing water in hole at completion of drilling								

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH-27

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of any violation of any provision of any County Ordinance or State law.

Hadi Tabatabaee
Director, OC Development Services

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-27

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			Rare orange brown staining		SANDSTONE (SP), pale gray and pale yellowish brown, moist, very dense, medium to fine grained		36 50/4"	140			
-15											
	25						50/4"	140	15	117	
-20											
	30				SANDSTONE (SP), pale gray and pale brown, wet, very dense, medium grained		50/6"	140			
					Total Depth= 30.5 Groundwater at 8'						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-27

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-28

Sheet 1 of 2

Date(s) Drilled	**9/13/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**26.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**9.3**
Groundwater Depth [Elevation], feet	**10.3 [-1.0]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
					Asphalt Concrete (approximately 3 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 7 inches)						
					CLAYEY SAND (SC), pale brownish gray, moist, medium dense, fine grained						
			Scattered gravel to 1".				5 6 5	140			
5	5				pale brown and brown, moist, medium dense, fine grained		9 11 6	140	14	113	
			Rare siltstone interbeds. Highly weathered.		pale grayish brown and pale gray, wet, medium dense, fine to medium grained		11 6 5	140			
0	10		Sub rounded gravel up to 2"		brownish gray, moist to wet, very dense, ▽ fine to medium grained		7 19 21	140	14	121	
			CAPISTRANO FORMATION (Tc)		SANDSTONE with Gravel (SP), orange brown and brown, moist to wet, very dense		14 30 50/3"	140			
-5	15		Sub rounded gravel and cobbles up to 4"				50/1"	140	10	122	
-10											

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-28

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of any violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
Date: 1/16/2025

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-28

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					SANDSTONE (SP), pale yellowish gray and pale gray, wet, medium dense, fine to medium grained		21 50/6"	140			
-15	25		Pale gray				50/4.5"	140	9	124	
					Total Depth = 26 feet Groundwater encountered at 10.3 feet						

Drill Hole DH-28

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-29

Sheet 1 of 2

Date(s) Drilled	**9/13/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**31.5 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**16.7**
Groundwater Depth [Elevation], feet	**16.0 [0.7]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
					Asphalt Concrete (approximately 3 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 3 inches)						
15					SILTY SAND (SM), brown gray, yellowish brown, slightly moist, medium dense, medium grained, some gravel						
			Subrounded gravel up to 4"				5 10 12	140			
	5		Subrounded gravel 1 to 6"		SANDY CLAY (CL), dark brown, moist, hard, fine to medium grained, some gravel		50/0.5"	140	6	108	
10			Rounded to subrounded gravel and cobbles up to 7"		brownish gray, moist, stiff		3 4 5	140			
	10		Minor fine grained sand				4 6 7	140	29	92	
5			Scattered gravel		gray and orange brown, moist, firm to stiff, fine grained sand		3 4 4	140			
			MARINE DEPOSITS (Qm)		SANDY CLAY (CL); gray, moist, firm, medium grained sand						
	15		Rounded to subrounded gravel up to 3"			▽	2 3 4	140	23	100	
0											
			CAPISTRANO FORMATION (Tc)		SILTSTONE (ML), gray, moist, hard overlying SANDSTONE (SP), orange brown and dark orange brown, wet, very dense, fine to medium grained						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-29

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of any violation of any provision of any County Ordinance or State law.
Hadi Tabatabaee
1/16/2025

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-29

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
							12 31 50/5"	140			
-5											
	25				Interbedded SILTSTONE and SANDSTONE (SP and ML), pale brown, dark grayish brown and gray, moist, very dense/hard, fine grained		50/4"	140	21	106	
-10											
	30		Siltstone is thinly bedded with white mottles,		SANDSTONE (SP), gray, wet, dense, fine grained, overlying SILTSTONE (ML), dark brownish black, moist, very stiff		16 16 21	140			
					Total Depth = 31.5 feet Groundwater encountered at 16 feet						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH-29

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-34

Sheet 1 of 2

Date(s) Drilled	**9/14/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**26.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**15.4**
Groundwater Depth [Elevation], feet	**15.0 [0.4]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
15					Asphalt Concrete (approximately 4.5 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 4 inches)						
					SILTY SAND with GRAVEL (SM), brown, moist, medium dense, fine grained		3 6 6	140			
	5										
10					SANDY CLAY (CL), grayish brown, moist, very stiff		20 26 12	140	19		
			Scattered gravel up to 4"		brown, moist, fine to medium grained sand		3 8 9	140			
	10										
5			**MARINE DEPOSITS (Qm)** orange brown staining		SANDY CLAY (CL); gray, slightly moist, stiff to very stiff, medium grained sand		8 11 14	140	13		
					moist, very stiff, fine grained sand		6 8 10	140			
	15				▽						
0			**CAPISTRANO FORMATION (Tc)** Scattered subrounded gravel up to 4"		SANDSTONE (SP), gray, wet, medium dense, medium to fine grained		3 6 8	140			

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-34

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of any violation of any provision of any County Ordinance or State law.
Hadi Tabatabaee
Director, OC Public Works

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-34

Sheet 2 of 2

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-5			Gray and yellowish gray				24 50	140			
-10	25		Sand is fine grained				30 50/4"	140	23	101	
					Total Depth = 26 feet Groundwater at 15 feet						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH-34

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-35

Date(s) Drilled	**9/14/2018**	Logged By	**WD**	Checked By	**KMF**
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**26.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	**16.8**
Groundwater Depth [Elevation], feet	**12.5 [4.3]**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
					Asphalt Concrete (approximately 4 inches)						
			ARTIFICIAL FILL (Qaf)		Aggregate Base (approximately 4.5 inches)						
15					SANDY CLAY (CL), brown and grayish brown, moist, stiff, fine grained, some gravel		3 5 12	140			
	5		Gravel up to 4"		brownish gray, moist, stiff		3 6 9	140	27	92	
10			Orange brown staining, sand is fine grained		gray		3 4 6	140			
	10				gray and brown, moist, fine grained sand		5 7 11	140	22	102	
5					gray, wet, soft to firm, fine grained sand ▽		1 2 2	140			
	15		**MARINE DEPOSITS (Qm)**		SAND (SP), gray and pale gray, wet, dense, coarse to medium grained overlying SILT (ML), dark gray, very stiff		5 11 16	140	13	113	
0											

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH-35

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provision of any County Ordinance or State law.
Hadi Tabatabaee
Director, OC Public Works

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-35

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			CAPISTRANO FORMATION (Tc)		Interbedded SILTSTONE and SANDSTONE (SP and ML), gray and dark gray, moist, very dense/hard, fine grained		7 22 22	140			
-5											
	25		Thinly bedded, rare white mottles		SILTSTONE (ML), dark gray, moist, very dense/hard		17 50/4"	140	21	105	
					Total Depth = 26 feet Groundwater encountered at 12.5 feet						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-35

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-46

Sheet 1 of 2

Date(s) Drilled	9/18/2018	Logged By	WD	Checked By	KMF
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling	Total Depth of Drill Hole	26.0 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	13.0
Groundwater Depth [Elevation], feet	15.0 [-2.0]	Sampling Method(s)	Cal-mod sampler with 6-inch sleeve, SPT, and bulk	Drill Hole Backfill	Native and Quickrete
Remarks				Driving Method and Drop	Autohammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE	NUMBER OF BLOWS / 6"	DRIVING WEIGHT, lbs	MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
					Asphalt Concrete (approximately 3 inches)						
			ARTIFICIAL FILL (Qaf) Cobbles up to 8" in spoils pile		Aggregate Base (approximately 3 inches)						
					SILTY SAND (SM), brown and pale brown, moist, medium dense, fine grained						
10			Scattered gravel				5 7 11	140			
	5						5	140	11	118	
					CLAYEY SAND (SC), brown, moist, dense, fine to medium grained		14 20				
5			Rare gravel up to 1"		brown and orange brown, moist, medium dense, fine grained		9 9 9	140			
	10				brownish gray, wet, dense, fine grained		7 11 17	140	14	114	
0			**MARINE DEPOSITS (Qm)**		SAND (SP), gray, brownish gray and orange brown, moist, very dense, fine grained		4 23 35	140			
	15		**CAPISTRANO FORMATION (Tc)** Minor siltstone, subtle bedding		SANDSTONE (SP), grayish brown, wet, very dense, medium to fine grained		33 50/4"	140	16	116	
-5											

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-46

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of any violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
Date: 01/16/2025

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-46

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					SANDSTONE (SP), pale gray and pale yellowish gray, wet, very dense, fine to medium grained		16 37 50	140			
-10											
	25						50/5"	140			
					Total Depth = 26 feet Groundwater at 15 feet						

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-51

Date(s) Drilled	**10/9/2019**	Logged By	**MTF**	Checked By	
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**46.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	
Groundwater Depth [Elevation], feet	**5.9**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ASPHALT		5" AC				13		
			ARTIFICIAL FILL (Qaf)		SANDY CLAY (CL); brown, light brown, and gray, very moist, stiff, medium to coarse grained sand		9 9 15		23	102	
	5				SANDY CLAY / CLAYEY SAND (CL/SC); light brown, gray, and light reddish brown, very moist, stiff, medium to coarse grained sand		4 6 7		28	94	
	10		**MARINE DEPOSITS (Qm)**		SANDY CLAY (CL); gray and light brown, saturated, soft, medium to coarse grained sand		1 2 3		31	89	
	15				becomes soft to firm		1 2 3		29		

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Drill Hole DH-51

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of any violation of any provision of any County Ordinance or State law.
Hadi Tabatabaee
Date: 1/16/2025

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-51

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
					becomes firm		2 4 6		22	100	
			CAPISTRANO FORMATION (Tc)		POORLY GRADED SAND (SP); light brown, light yellowish brown, and light reddish brown, saturated, very dense, fine to coarse grained sand with some fine gravel						
	25						25 50/6"				
	30				CLAYEY SAND (SC); light gray and light yellowish brown, very moist to saturated, very dense, medium grained sand with trace coarse grained sand		42 50/3.5"		19	110	
	35				POORLY GRADED SAND with trace CLAY (SP); light yellowish brown, gray, and light redsdish brown, saturated, very dense, fine to medium grained sand		35 50/6"				
	40						50/5"				

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of any violation of any provision of any County Ordinance or State law.
Hadi Tabatabaee
Director, OC Public Works

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-51

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
							35 50/6"				
					Total Depth = 46' No Caving GWT @ 5.9' Below Ground Surface						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor, Commercial Component
Project Location: Dana Point Harbor Drive
Project Number: 17-206-02

Log of Drill Hole DH-52

Sheet 1 of 1

Date(s) Drilled	**10/9/2019**	Logged By	**MTF**	Checked By	
Drilling Method	**Hollow Stem Auger**	Drilling Contractor	**2R Drilling**	Total Depth of Drill Hole	**5.0 feet**
Drill Rig Type	**CME 75**	Diameter(s) of Hole, inches	**8**	Approx. Surface Elevation, ft MSL	
Groundwater Depth [Elevation], feet	**NA**	Sampling Method(s)	**Cal-mod sampler with 6-inch sleeve, SPT, and bulk**	Drill Hole Backfill	**Native and Quickrete**
Remarks				Driving Method and Drop	**Autohammer**

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS / 6"	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			FILL (Qaf)		SANDY CLAY (CL); brown and light yellowish browm, very moist, firm to stiff, fine to coarse grained sand						
					CLAYEY SAND (SC); brown, gray, and yellowish brown, very moist, loose to medium dense, fine to medium grained sand						
	5				Total Depth = 5' No Caving No GWT						

DH_REV3 17-206-02 (UPDATED ELEV.).GPJ GMULAB.GPJ 2/8/21

GMU

Drill Hole DH-52

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A-1

Previous Drill Hole Logs by GMU

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
Building & Safety

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH- 1

Sheet 1 of 2

Date(s) Drilled	8-29-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	43.0 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	15.0
Groundwater Depth [Elevation], feet	12.0 [3.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 2 inches AC over 4 inches AB		SANDY CLAY (CL), brown to dark brown, moist, firm		5 6 4	140	14	112	EI
10	5				CLAYEY SAND (SC), brown to dark brown, moist, medium dense		3 5 9	140	16	115	CN
5	10				SANDY CLAY (CL), brown to gray brown, damp to moist, firm Groundwater at 12 feet. ▽		5 5 8	140	21		PS AL
0	15				SAND (SP), gray, wet, dense, coarse grained		6 9 23	140	16	107	
			CAPISTRANO FORMATION (Tc)		SAND (SP), gray, wet, very dense, medium to coarse grained		8 18 28	140			

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH- 1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-1

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			Sample is unoxidized claystone at 20 feet		CLAY (CL), very dark gray, moist, very firm						
-10	25				SAND (SP), gray, wet, very dense, medium grained, some clay		50/6"	140	22	107	
-15	30				Becomes coarse to very coarse grained		35 50/3"	140			
-20	35						50/5"	140			
-25	40				Becomes very coarse grained with some pebbles		19 50/4"	140			
			Refusal at 43 feet on very hard bedrock, unable to make forward progress								
					Total Depth 43 feet Groundwater at 12 feet						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH- 1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH- 2

Sheet 1 of 1

Date(s) Drilled	8-29-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	10.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	13.0
Groundwater Depth [Elevation], feet	8.5 [4.5]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 1.5 inches AC over 5 inches AB		CLAYEY SAND (SC), brown to gray, moist, medium dense to dense		7 7 23	140	15	115	
10											
	5				SANDY CLAY (CL), brown to gray, moist, firm		9 9 16	140	20	106	
5			Very rocky at 8 feet		Groundwater at 8.5 feet. ▽						
	10				CLAYEY SAND (SC), brownish gray to gray, wet, dense, scattered pebbles		5 18 25	140	8	128	
					Total Depth 10.5 feet. Groundwater at 8.5 feet.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH- 2

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-4

Sheet 1 of 1

Date(s) Drilled	8-29-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	10.0 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	20.0
Groundwater Depth [Elevation], feet	N/A [0.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 2 inches AC over 7 inches AB		SANDY CLAY (CL), dark brown, damp to moist, firm to very firm		12 20 50/4"	140	8	126	RV
15	5		**CAPISTRANO FORMATION (Tc)** Fine grained sandstone, locally laminated, poorly cemented		SAND (SM), yellow brown, damp to moist, dense, fine grained, minor silt		20 40 50/4"	140	9	103	
10	10				As above, slightly silty, moist to wet		22 50/3"	140	7	97	
					Total Depth 10.5 feet. No groundwater.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH- 4

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-5

Sheet 1 of 1

Date(s) Drilled	8-28-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	10.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	16.0
Groundwater Depth [Elevation], feet	10.0 [6.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
15			**ARTIFICIAL FILL (Qaf)** 2 inches AC over 6 inches AB		SANDY CLAY (CL), brown to dark brown, moist, firm		4 11 17	140	10	119	
	5				CLAYEY SAND (SC), brown, moist, dense		8 12 18	140	9	107	
10					SAND (SP), brown, moist, loose, tip of sampler is wet Groundwater at 10 feet. ▽		1 1 1	140	15	115	
	10				Total Depth 10.5 feet. Groundwater at 10 feet.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-5

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or Building
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH- 6

Date(s) Drilled	8-29-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	50.0 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	11.5
Groundwater Depth [Elevation], feet	12.0 [-0.5]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
10			**ARTIFICIAL FILL (Qaf)** 2 inches AC over 5 inches AB		SAND (SM), brown, moist, medium dense, medium to coarse grained, minor silt		5 13 15	140	9	102	
	5				SANDY CLAY (CL), brown to dark brown, moist, firm, medium grained		5 8 18	140	20	101	DS
5											
	10				Scattered pebbles at 9 feet		14 8 11	140	13	114	CN
0					Groundwater at 12 feet. ▽						
	15				Some black and orange staining, wet at 14 feet		4 5 4	140	26		PS AL
-5					Groundwater at 12 feet.						
			CAPISTRANO FORMATION (Tc)		SILTY SAND (SM), light brown to brown, wet, fine to medium grained		21 50	140	23	103	

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH- 6

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-6

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-10											
	25		Some bedding within unoxidized claystone, dipping 0 to 10 degrees at 24 feet		CLAY (CL/CH), dark gray, moist, very firm to hard		17 22 27	140			
-15											
	30		Interbedded claystone and sandstone at 29 feet		CLAY (CL/CH), and SAND (SP), dark gray and brown, moist, hard, medium to coarse grained		20 50/3"	140	17	118	DS
-20											
	35				SAND (SP), light gray to gray, wet, very dense, medium to very coarse grained		20 30 40	140			
-25											
	40						50/5"	140	20	113	
-30											
					SILTY SAND (SM), gray to dark gray, wet, very dense, fine to medium grained		16 27 50	140			

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH- 6

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-6

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-35											
					SAND (SP), gray, wet, very dense, coarse grained		37 50/6"	140	20	112	
	50				Total Depth 50 feet. Groundwater at 12 feet.						

GMU GEOTECHNICAL, INC.

Drill Hole DH- 6

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-10

Sheet 1 of 1

Date(s) Drilled	8-27-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	10.0 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	10.0
Groundwater Depth [Elevation], feet	N/A [0.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 3 inches AC over 3 inches AB		SANDY CLAY (CL), dark gray, moist, firm, scattered rock fragments, roots, pockets of coarse sand		7 10 15	140	13	107	
5	5						14 18 22	140	13	114	
					Abundant rock fragments below 8 feet						
							34 50/3"	140			
0	10				Total Depth 10 feet. No groundwater.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-10

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-12

Date(s) Drilled	8-27-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	49.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	11.0
Groundwater Depth [Elevation], feet	9.0 [2.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
10			**ARTIFICIAL FILL (Qaf)** 4 inches AC over 4 inches AB Difficult drilling, probable boulders and cobbles below 0 feet		SANDY GRAVEL (GP), light brown to brown, damp to moist, medium dense						
					Some clay at 2 feet		8 8 11	140	14	109	
	5		Very poorly consolidated material, falling out of sampler, appears very loose with abundant mechanically fractured rock fragments		SANDY CLAY (CL), dark gray, damp, loose, abundant rock fragments, organics		9 21 21	140	17	105	PS AL
5					Groundwater at 9 feet. ▽						
	10				CLAYEY SAND (SC), dark gray, wet, loose to medium dense, abundant rock fragments		4 4 4	140	17		CN PS AL
0											
	15		Unconsolidated material, falling out of sampler, appears extremely loose with abundant mechanically fractured rock fragments		Sample contains rock fragments, black unoxidized shale, in dense, very wet, clayey sand, very little fines		19 22 21	140	13		
-5											
			CAPISTRANO FORMATION (Tc)		SAND (SP), yellow brown to gray, wet, dense to very dense, medium to coarse grained		18 30 38	140			

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-12

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
-10											
	25						30 50/2.5"	140	19	108	DS
-15											
					Becomes coarse grained at 29 feet		22 33 40	140			
-20	30										
							50/4"	140			
-25	35		Very difficult drilling, vary hard material, 1 foot thick, probable very dense sand, no rock fragments in cuttings at 35 feet								
					Becomes brown to yellow brown, some pebbles at 39 feet		(50/5")	140			
-30	40										
					Some manganese oxide staining at 44 feet		50/6"	140	14	122	

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or Building
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-12

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
-35					Becomes medium to coarse grained		(50/5")	140			
					Total Depth 49.5 feet. Groundwater at 9 feet.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-13

Sheet 1 of 3

Date(s) Drilled	8-30-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	49.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	14.0
Groundwater Depth [Elevation], feet	13.5 [0.5]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
10	5		**ARTIFICIAL FILL (Qaf)** 6 inches of concrete above the fill		SANDY CLAY (CL), brown to dark gray, damp, firm to very firm		19 19 15	140	14		PS AL
					SAND (SP), light brown, dry, loose, abundant rock fragments		13 25 28	140	8	117	
5	10				CLAYEY SAND (SC), light brown to yellow brown, damp to moist, medium dense		7 10 9	140			
					Groundwater at 13.5 feet. ▽						
0	15				SAND (SP), light reddish brown, moist, dense, scattered rock fragments, some clay		36 39 12	140	14	128	
-5			**CAPISTRANO FORMATION (Tc)**		SAND (SP), light brown, wet, very dense, medium to coarse grained		42 50/4"	140			

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-13

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-13

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
-10	25				Becomes coarse grained at 24 feet		50/4"	140	14	121	
-15	30		Very rocky zone, 1 foot thick at 31 feet		Some iron oxide staining at 29 feet		(50/5")	140			
-20	35				Becomes coarse grained to pebbly at 34 feet		50/3"	140	13	125	
-25	40				Becomes fine to coarse grained at 39 feet		35 50/5"	140			
-30							50/3"	140	15	119	

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-13

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-13

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-35					Becomes medium grained to pebbly at 49 feet		(50/5")	140			
					Total Depth 49.5 feet. Groundwater at 13.5 feet.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-13

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinances or Building
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-14

Sheet 1 of 3

Date(s) Drilled	8-28-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	49.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	12.0
Groundwater Depth [Elevation], feet	13.5 [-1.5]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
10			**ARTIFICIAL FILL (Qaf)** About 18 inches of concrete over fill		SANDY CLAY (CL), dark brown to reddish brown, damp to moist, firm		9 11 9	140	10	117	CP DS(R) EI SU CH PH MR
5	5				CLAYEY SAND (SC), dark brown to reddish brown, moist, medium dense		8 11 13	140	13	114	CN
0	10				SANDY CLAY (CL), dark brown to brown, damp to moist, firm Groundwater at 13.5 feet. ▽		7 12 16	140	21	113	PS AL
-5	15				SAND (SP), light gray to light brown, wet, dense, medium to coarse grained		1 2 6	140			
			CAPISTRANO FORMATION (Tc)		SAND (SP), light gray to light brown, wet, dense, medium to coarse grained		22 22 50/4"	140	20	104	DS

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-14

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or Building
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-14

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
-10											
	25				SAND (SM), some SILT, light brown to orange brown, wet, very dense, medium to coarse grained		28 50/6"	140			
-15											
							50/3"	140	12	122	
	30										
-20											
							(50/6")	140			
	35										
-25											
					Coarse sand in waste barrel at 39 feet		50/4"	140			
	40										
-30											
					Becomes light brown, fine grained at 44 feet		35 50/4"	140			

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or Building
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-14

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-35						◯	50/4"	140			
					Total Depth 49.5 feet. Groundwater at 13.5 feet.						

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-15

Date(s) Drilled	8-30-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	49.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	9.5
Groundwater Depth [Elevation], feet	12.0 [-2.5]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 2 inches AC over 5 inches AB		SANDY CLAY (CL), dark gray, damp to moist, firm, fine grained		6 11 22	140	13	115	
5	5				CLAYEY SAND (SC), brown to gray, moist, medium dense to dense, fine to medium grained		9 11 11	140	12	106	DS
0	10				SILTY SAND (SM), light brown, wet, loose, fine to medium grained Groundwater at 12 feet. ▽		2 2 3	140	17	110	CN
-5	15		**CAPISTRANO FORMATION (Tc)**		SAND (SM), light gray to gray, wet, very dense, medium grained		4 28 44	140			
-10					Becomes brown with orange staining at 19 feet		50/5"	140	17		

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-15

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
Director of OC Public

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-15

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-15	25				SAND (SP), brown to reddish brown, wet, very dense, medium grained		(50/6")	140			
-20	30				Some iron oxide staining at 29 feet		50/5"	140	20	110	
			Very rocky between 33 and 36 feet								
-25	35		Some interbeds of unoxidized claystone in sample at 34 feet		With some CLAY (CL/CH), dark gray, at 34 feet		(50/6")	140			
-30	40				SILTY SAND (SM), brown, wet, very dense, fine to medium grained		50/5"	140	22	110	
-35							40 50/2"	140			

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-15

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-15

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-40						◯	50/5"	140			
					Total Depth 49.5 feet. Groundwater at 12 feet.						

GMU GEOTECHNICAL, INC.

Drill Hole DH-15

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-16

Sheet 1 of 1

Date(s) Drilled	8-28-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	10.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	7.0
Groundwater Depth [Elevation], feet	10.0 [-3.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 1.5 inches AC over 5 inches AB		CLAYEY SAND (SC), brown to dark brown, moist, dense, medium to coarse grained						
5							10 16 14	140	8	115	
	5						11 14 28	140	11	122	
0			Rocky at 6 feet								
	10				Becomes wet at 9 feet, sample not recovered. Groundwater at 10 feet.		10 9 9	140			
					Total Depth 10.5 feet. Groundwater at 10 feet.						

GMU GEOTECHNICAL, INC.

Drill Hole DH-16

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-17

Sheet 1 of 3

Date(s) Drilled	8-28-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	49.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	9.0
Groundwater Depth [Elevation], feet	13.0 [-4.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 3 inches AC over 4 inches AB		CLAYEY SAND (SC), brown, dark brown, and orange brown, damp to moist, dense		9 12 14	140			
			Becomes rocky at 3 feet								
5	5				Scattered rock fragments at 4 feet		5 10 16	140	11	113	CN
0	10				Sample not recovered.		6 7 8	140			
			Becomes rocky at 12 feet								
					Groundwater at 13 feet. ▽						
-5	15		Very difficult drilling due to rocks between 15 and 18 feet		SAND (SP), brown, light gray, dark gray mottled, moist to wet, loose, abundant rock fragments and gravels, scattered clayey sand pockets		50/5"	140	11	128	
-10			**CAPISTRANO FORMATION (Tc)**		SAND (SP), brown to light brown, wet, very dense, coarse grained		25 45 46	140			

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-17

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or Building Law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-17

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
-15	25						50/5"	140	17		
-20	30				Scattered orange staining at 29 feet		(50/6")	140			
-25	35				Minor clay at 34 feet		50/1.5"	140	13	127	
-30	40				Becomes medium to coarse grained at 39 feet		(50/6")	140			
-35							50/4"	140	16	116	

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-17

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-17

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-40					SAND (SM), brown, wet, very dense, fine grained		(50/5")	140			
					Total Depth 49.5 feet. Groundwater at 13 feet. Caving at 3 feet.						

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-18

Sheet 1 of 1

Date(s) Drilled	8-27-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	10.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	9.0
Groundwater Depth [Elevation], feet	N/A [0.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 3 inches of AC, no AB		CLAYEY SAND (SC), light brown to gray, moist, dense, fine grained		7 12 14	140	12	112	CP EI DS(R) SU CH pH MR
					SAND (SM), light brown to gray, moist, dense, coarse grained						
5					CLAYEY SAND (SC), gray to dark gray, moist, dense to very dense, medium to coarse grained		20 27 50/2"	140	15	101	
	5		Difficult drilling, probable boulders at 5 feet								
0							14 20 22	140	11	121	
	10		Fragments of unoxidized bedrock within the fill at 9 feet								
					Total depth 10.5 feet. No groundwater.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-18

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or California
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-19

Sheet 1 of 3

Date(s) Drilled	8-27-12	Logged By	LLB	Checked By	DH
Drilling Method	Hollow Stem Auger	Drilling Contractor	2R Drilling, Inc	Total Depth of Drill Hole	49.5 feet
Drill Rig Type	CME 75	Diameter(s) of Hole, inches	8	Approx. Surface Elevation, ft MSL	8.0
Groundwater Depth [Elevation], feet	9.0 [-1.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve/SPT	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	Auto Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 2.5 inches AC		CLAYEY SAND (SC), brown to dark brown, moist, dense, fine to medium grained		6 14 17	140			
5											
	5				SAND (SM), brown to dark brown, moist, medium dense, fine to coarse grained		9 10 11	140	13	112	
0					Groundwater at 9 feet. ▽						
	10				CLAYEY SAND (SC), brown to light gray, moist to wet, loose, medium to coarse grained		3 4 5	140	25	95	CN
-5											
	15				SILTY SAND (SM), brown to light gray, wet, loose, coarse grained		2 3 3	140			
-10			Difficult drilling, probable boulders, at 17 feet								
			CAPISTRANO FORMATION (Tc)		SAND (SP), brown to gray, wet, very dense, coarse grained		50/5"	140	15	116	

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-19

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	NUMBER OF BLOWS	DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	DRY UNIT WEIGHT, pcf	ADDITIONAL TESTS
-15											
	25		Abundant orange and yellow staining along laminations below 24 feet		SAND (SM), light gray, moist, very dense, coarse grained		14 27 37	140			
-20							50/5"	140	21	108	
	30										
-25							25 45 50/3"	140			
	35										
-30							50/3"	140	15	122	
	40										
-35							36 50/3"	140			

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-19

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
-40							50/4"	140	18	117	
					Total Depth 49.5 feet. Groundwater at 9 feet. Caving at 3 feet.						

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
By: [illegible]
BUILDING OFFICIAL

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole DH-20

Sheet 1 of 1

Date(s) Drilled	8-28-12	Logged By	DRA	Checked By	DH
Drilling Method	Hand Auger	Drilling Contractor	Earthworks Techniques	Total Depth of Drill Hole	4.5 feet
Drill Rig Type	N/A	Diameter(s) of Hole, inches	4	Approx. Surface Elevation, ft MSL	8.0
Groundwater Depth [Elevation], feet	N/A [0.0]	Sampling Method(s)	Open drive sampler with 6-inch sleeve	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	40 lb Hammer

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) Upper 1 foot is planting soil from landscape planter		CLAYEY SAND (SC), with some SANDY CLAY (CL), light brown mottled, moist, medium dense		16	40	16	101	CP CN
5					Hard zone at 3.2 feet SILTY SAND (SM), yellow brown, moist, dense, some gravel up to 2 inches in diameter		22	40	20	100	
					Total Depth 4.5 feet. Slight Caving. No Groundwater.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole DH-20

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole C-2

Sheet 1 of 1

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
Building & Safety

Date(s) Drilled	8-28-12	Logged By	LLB	Checked By	DH
Drilling Method	Hand Auger	Drilling Contractor	Earthworks Techniques	Total Depth of Drill Hole	2.5 feet
Drill Rig Type	N/A	Diameter(s) of Hole, inches	5	Approx. Surface Elevation, ft MSL	20.0
Groundwater Depth [Elevation], feet	N/A [0.0]	Sampling Method(s)	Bulk samples only	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 3 inches AC over 4 inches AB		Silty Sand (SM), light gray brown, damp to moist, medium dense to dense						RV SU CH pH MR
					Total depth 2.5 feet. No groundwater.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole C-2

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
Building Official

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole C-3

Sheet 1 of 1

Date(s) Drilled	8-28-12	Logged By	LLB	Checked By	DH
Drilling Method	Hand Auger	Drilling Contractor	Earthworks Techniques	Total Depth of Drill Hole	3.0 feet
Drill Rig Type	N/A	Diameter(s) of Hole, inches	5	Approx. Surface Elevation, ft MSL	20.0
Groundwater Depth [Elevation], feet	N/A [0.0]	Sampling Method(s)	Bulk samples only	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
			ARTIFICIAL FILL (Qaf) 4 inches AC over 12 inches AB		Sandy Clay (CL), brown, damp to moist, firm to very firm						CP EI RV
					Total depth 3 feet. No groundwater.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole C-3

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
Date: 8/1/2025

Project: Dana Point Harbor Revitalization
Project Location: Dana Point, CA
Project Number: 11-161-00

Log of Drill Hole C-4

Sheet 1 of 1

Date(s) Drilled	8-28-12	Logged By	LLB	Checked By	DH
Drilling Method	Hand Auger	Drilling Contractor	Earthworks Techniques	Total Depth of Drill Hole	2.5 feet
Drill Rig Type	N/A	Diameter(s) of Hole, inches	5	Approx. Surface Elevation, ft MSL	16.0
Groundwater Depth [Elevation], feet	N/A [0.0]	Sampling Method(s)	Bulk samples only	Drill Hole Backfill	Native
Remarks				Driving Method and Drop	

ELEVATION, feet	DEPTH, feet	GRAPHIC LOG	GEOLOGICAL CLASSIFICATION AND DESCRIPTION	ORIENTATION DATA	ENGINEERING CLASSIFICATION AND DESCRIPTION	SAMPLE DATA: SAMPLE	SAMPLE DATA: NUMBER OF BLOWS	SAMPLE DATA: DRIVING WEIGHT, lbs	TEST DATA: MOISTURE CONTENT, %	TEST DATA: DRY UNIT WEIGHT, pcf	TEST DATA: ADDITIONAL TESTS
15			**ARTIFICIAL FILL (Qaf)** 2.5 inches AC over 5.5 inches AB		Clayey Sand (SC), brown, damp to moist, medium dense to dense						PS HY RV
					Total depth 3 feet. No groundwater.						

DH_REV3 11-161-00.GPJ GMULAB.GPJ 10/23/12

GMU GEOTECHNICAL, INC.

Drill Hole C-4

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A-2

Previous Boring Logs by Others

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hani Hamdaee
BUILDING OFFICIAL

GEOTECHNICAL BORING LOG B-8

Date 11-6-07 **Sheet** 1 **of** 2

Project Dana Point Harbor Renovation, Dana Point, CA. **Project No.** 600024-004

Drilling Co. Martini Drilling, Coporation **Type of Rig** CME-75

Hole Diameter HSA 8-inch **Drive Weight** 140 lbs (Auto Hammer) **Drop** 30"

Elevation Top of Hole 7.8' **Location** Sport Fishing Dock

Logged By SP

Sampled By SP

Elevation Feet	Depth Feet	Graphic Log (N S)	Attitudes	Sample No.	Blows Per 6 inches	Dry Density pcf	Moisture Content, %	Soil Class. (U.S.C.S.)	DESCRIPTION	Type of Tests
	0							SC	@0': 4 inches of asphalt over 4 inches of base course. **Fill:** @0.75': Clayey SAND, olive gray brown, slightly moist.	EI, CR
5	5			Bag-1 R-1	5 12 16	105.7	18.5	CL	@2.5': Sandy CLAY, very stiff, olive gray brown, some moist, fine to medium grained.	
0	5			R-2	4 4 6	99.1	25.7	CL	@5': Sandy CLAY, firm, olive gray brown, some moist, fine to medium grained sand. [LL = 41, PI = 20]	AL, DS
	10			R-3	5 8 8	99.1	25.7	CL	@7.5': Sandy CLAY, stiff, olive green, moist, fine grained sand. [LL = 49, PI = 26]	AL, CN
-5				S-1	2 3 4			CL	@10': Sandy CLAY, firm, olive green, moist, fine grained sand.	
	15			R-4	1 5 7	112.4	14.1	SM	@15': Silty SAND, loose, olive green, moist, fine to medium grained. [P200 = 16.0%]	SA
-10	20			S-2	push 1 2			SC	**Possible Alluvium:** @20': Clayey SAND, very loose, olive green, very moist to wet, fine to medium grained. [P200 = 19.5%]	P200
-15	25			R-5	31 50/4"	113.3	17.5		**Bedrock:** @25': SANDSTONE, very dense, yellowish olive green, wet, medium to coarse grained.	
-20	30									

MPLE TYPES:
SPLIT SPOON
R RING SAMPLE
B BULK SAMPLE
T TUBE SAMPLE
G GRAB SAMPLE
C CORE SAMPLE

TYPE OF TESTS:
DS DIRECT SHEAR
Tx TRIAXIAL COMPRESSION
CN CONSOLIDATION
CR CORROSION
SA SIEVE ANALYSIS
AL ATTERBERG LIMITS
EI EXPANSION INDEX
UC UNCONFINED COMPRESSION

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance.
BUILDING OFFICIAL

GEOTECHNICAL BORING LOG B-8

Date 11-6-07 Sheet 2 of 2

Project Dana Point Harbor Renovation, Dana Point, CA. Project No. 600024-004

Drilling Co. Martini Drilling, Coporation Type of Rig CME-75

Hole Diameter HSA 8-inch Drive Weight 140 lbs (Auto Hammer) Drop 30"

Elevation Top of Hole 7.8' Location Sport Fishing Dock

Logged By SP

Sampled By SP

Elevation Feet	Depth Feet	Graphic Log (N S)	Attitudes	Sample No.	Blows Per 6 inches	Dry Density pcf	Moisture Content, %	Soil Class. (U.S.C.S.)	DESCRIPTION	Type of Tests
	30			S-3	28 50/6"				30': SANDSTONE, very dense, yellowish olive green, wet, medium to coarse grained.	
-25										
	35			R-6	44 50/3"	118.6	20.6		@35': SANDSTONE, very dense, yellowish olive green, wet, medium to coarse grained.	CN, CU
-30										
	40			S-4	35 50/4"				@40': SANDSTONE, very dense, yellowish olive green, wet, medium to coarse grained.	
-35										
	45			R-7	44 50/2"	112.7	12.4		@45': SANDSTONE, very dense, yellowish olive green, wet, medium to coarse grained.	
-40									Total Depth of borehole: 45.7 feet Free ground water encountered at 12 feet during drilling. Borehole backfilled with soil cuttings and patched with bentonite chips and rapid set concrete.	
	50									
-45										
	55									
-50										
	60									

MPLE TYPES:
SPLIT SPOON
R RING SAMPLE
B BULK SAMPLE
T TUBE SAMPLE
G GRAB SAMPLE
C CORE SAMPLE

TYPE OF TESTS:
DS DIRECT SHEAR
Tx TRIAXIAL COMPRESSION
CN CONSOLIDATION
CR CORROSION
SA SIEVE ANALYSIS
AL ATTERBERG LIMITS
EI EXPANSION INDEX
UC UNCONFINED COMPRESSION

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GEOTECHNICAL BORING LOG B-1

Date 11-6-02 Sheet 1 of 2
Project WRT/Dana Point Project No. 600024-001
Drilling Co. Martini Drilling Company Type of Rig CME-75 HSA
Hole Diameter 6" Drive Weight 140 lbs. Drop 30"
Elevation Top of Hole ' Location See Boring Location Map.

Elevation Feet	Depth Feet	Graphic Log	Attitudes	Sample No.	Blows Per Foot	Dry Density pcf	Moisture Content, %	Soil Class. (U.S.C.S.)	DESCRIPTION	Type of Tests
		N S							Logged By DAG Sampled By DAG	
	0								@ 0' ASPHALT, about 3" @ 3" **FILL** CLAYEY SAND, moist, olive-brown, fine- to medium-grained, rounded pebbles to 1/2"	CR,EI
				B-1					@ 3' encoutering occasional rocks to 3"	
	5			R-1	14 13 12			SC CL	@ 5' upper 3": CLAYEY SAND, as above, dark gray, rounded gravels to 1" lower 4": SANDY CLAY, stiff, moist, olive-brown, high plasticity, medium-grained sands, sub-grounded gravels to 1/2" note: partial recovery from R-1	
	10			S-1	2 4 5		17.3	CL-ML	@ 10' SILTY CLAY, stiff, moist (sat?), medium gray, mottled, contains some fine sands, staining,rounded pebbles to 1/2", fractured rock in middle of sampler, fine sands at top 2" of sampler	
	15			R-2	2 3 6			SC	@ 15' CLAYEY SAND, loose, wet, olive-brown, medium-grained, contains silt, minor pebbles, minor amounts of sandy clay in sampler	
	20			S-2	N/A			SM	@ 20' **CAPISTRANO FORMATION** SILTY SANDSTONE, saturated, olive-brown, medium- to coarse-grained, mottled, stained, some fine sands present, minor amounts of clay	
				S-3	15 40 50/4"			SP	@ 22.5' SANDSTONE, very dense, saturated, brown, medium- to coarse-grained, some fines present, rounded pebbles to 1/2", heavily mottled and stained	
	25			S-4	10 42 50			SP	@ 25' SANDSTONE, very dense, saturated, olive-brown, medium-grained, contains low-plasticity fines, mottling, staining	
	30									

SAMPLE TYPES:
S SPLIT SPOON
R RING SAMPLE
B BULK SAMPLE
T TUBE SAMPLE
G GRAB SAMPLE
C CORE SAMPLE

TYPE OF TESTS:
DS DIRECT SHEAR
MD MAXIMUM DENSITY
CN CONSOLIDATION
CR CORROSION
SA SIEVE ANALYSIS
AL ATTERBERG LIMITS
EI EXPANSION INDEX
RV R-VALUE

LEIGHTON AND ASSOCIATES, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GEOTECHNICAL BORING LOG B-1

Date 11-6-02 Sheet 2 of 2

Project WRT/Dana Point Project No. 600024-001

Drilling Co. Martini Drilling Company Type of Rig CME-75 HSA

Hole Diameter 6" Drive Weight 140 lbs. Drop 30"

Elevation Top of Hole ' Location See Boring Location Map.

Logged By DAG

Sampled By DAG

Elevation Feet	Depth Feet	Graphic Log (N S)	Attitudes	Sample No.	Blows Per Foot	Dry Density pcf	Moisture Content, %	Soil Class. (U.S.C.S.)	DESCRIPTION	Type of Tests
	30			S-5	8 16/6"			SP	@ 30' SANDSTONE, as above, minor rounded pebbles, laminated "staining" pattern appears as horizontal bands Note: S-5 driven 12" only	
	35			S-6	45 50/5"			SM	@ 35' SILTY SANDSTONE, very dense, wet, brown, medium- to coarse-grained, some fine sands present	
	40			S-7	32 50/3"			SM	@ 40' SILTY SANDSTONE, as above	
	45								Total Depth of hole : 41 feet below ground surface (bgs). Groundwater was encountered within the hole during drilling at an approximate depth of 6 feet bgs. Backfilled with soil cuttings and surface finished with cold asphalt patch. Note: Sea Level measured at approximately 2.5 feet bgs	
	50									
	55									
	60									

SAMPLE TYPES:
- S SPLIT SPOON
- R RING SAMPLE
- B BULK SAMPLE
- T TUBE SAMPLE
- G GRAB SAMPLE
- C CORE SAMPLE

TYPE OF TESTS:
- DS DIRECT SHEAR
- MD MAXIMUM DENSITY
- CN CONSOLIDATION
- CR CORROSION
- SA SIEVE ANALYSIS
- AL ATTERBERG LIMITS
- EI EXPANSION INDEX
- RV R-VALUE

LEIGHTON AND ASSOCIATES, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GEOTECHNICAL BORING LOG B-3

Date 11-6-02 Sheet 1 of 2

Project WRT/Dana Point Project No. 600024-001

Drilling Co. Martini Drilling Company. Type of Rig CME-75 HSA

Hole Diameter 6" Drive Weight 140 lbs. Drop 30"

Elevation Top of Hole ' Location See Boring Location Map.

Logged By DAG

Sampled By DAG

Elevation Feet	Depth Feet	Graphic Log (N / S)	Attitudes	Sample No.	Blows Per Foot	Dry Density pcf	Moisture Content, %	Soil Class. (U.S.C.S.)	DESCRIPTION	Type of Tests
	0								ASPHALT, about 3"	
									@ 3" FILL CLAYEY SAND, moist, dark brown, fine- to medium-grained, sub-rounded gravels to 1" gravelly, high-plasticity clay, contains some rounded rocks to 3"	RV
				B-1					@ 2.5' SANDY CLAY, moist, dark brown, highly plastic, contains fine-grained sands, some gravel to 1/2",less gravel than above	
	5			R-1	10 19 18	112.5	12.6	SC	@ 5' CLAYEY SAND, medium dense, moist, fine-grained, high-plasticity clay, rounded pebbles to 1/4", sample contained one (1) rounded 2" rock, sampler was wet on outside	SA,MD
				B-2						
	10			S-I	2 2 6			SM	@ 10' SILTY SAND, loose, saturated, olive-brown, fine-grained, contains minor high-plasticity clay, 2" black clay at top of sampler (may be sluff)	
	15			S-2	16 25 12			SP	@ 15' ALLUVIUM GRAVELLY SAND, dense, wet, medium gray, medium- to coarse-grained, gravels to 1.5", contains low-plasticity silt	
									@ 16.5' to 18' driller encountered rough drilling	
	20			S-3	48 50/3"			SP	@ 20' CAPISTRANO FORMATION SANDSTONE, very dense, saturated, tan, medium-grained, minor silt, minor pebbles, difficult to remove from sampler	
	25			R-2	25 50/6"	117.3	13.3	SP	@ 27.5' SANDSTONE, very dense, wet, medium gray, medium- to coarse-grained, contains some silt	
	30									

SAMPLE TYPES:
- S SPLIT SPOON
- R RING SAMPLE
- B BULK SAMPLE
- T TUBE SAMPLE
- G GRAB SAMPLE
- C CORE SAMPLE

TYPE OF TESTS:
- DS DIRECT SHEAR
- MD MAXIMUM DENSITY
- CN CONSOLIDATION
- CR CORROSION
- SA SIEVE ANALYSIS
- AL ATTERBERG LIMITS
- EI EXPANSION INDEX
- RV R-VALUE

LEIGHTON AND ASSOCIATES, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GEOTECHNICAL BORING LOG B-3

Date 11-6-02 Sheet 2 of 2

Project WRT/Dana Point Project No. 600024-001

Drilling Co. Martini Drilling Company. Type of Rig CME-75 HSA

Hole Diameter 6" Drive Weight 140 lbs. Drop 30"

Elevation Top of Hole ' Location See Boring Location Map.

Logged By DAG

Sampled By DAG

Elevation Feet	Depth Feet	Graphic Log (N S)	Attitudes	Sample No.	Blows Per Foot	Dry Density pcf	Moisture Content, %	Soil Class. (U.S.C.S.)	DESCRIPTION	Type of Tests
	30			S-4	N/A			SP	@ 30' SANDSTONE,wet, brown, fine-grained, some fines present, samples may consist of "heaved" material only	
	35			S-5	34 50/6"			SP	@ 35' SANDSTONE, very dense, wet, olive-brown, medium-grained, contains some silt, may have minor mottling, yellow staining appears as horizontal rings	
	40			S-6	50/6"			SP	@ 40' SANDSTONE, very dense, wet, brown, medium-grained, orange and red staining, "rust" particles, rocks to 1", some coarse sand, 1/2" muscovite fragment	
	45			S-7A S-7	6 25 25/3"			SP	@ 45' SANDSTONE, very dense, saturated, blue-gray, orange and yellow mottling, 3" siltstone fragment in tip of sampler (black clay or claystone)	
	50			R-3A R-3	28 50/3"			CL	@ 50' CLAYSTONE, hard, black, fissile, some mottling, tiny shell fragments, similar to material found in tip of S-7, upper 3" of sample is Sand as above	
	55								Total Depth 51 feet below ground surface (bgs). Groundwater was encountered within the hole during drilling at an approximate depth of 9 feet (bgs). Backfilled with soil cuttings and surface finished with cold asphalt patch.	
	60									

SAMPLE TYPES:
- S SPLIT SPOON
- R RING SAMPLE
- B BULK SAMPLE
- T TUBE SAMPLE
- G GRAB SAMPLE
- C CORE SAMPLE

TYPE OF TESTS:
- DS DIRECT SHEAR
- MD MAXIMUM DENSITY
- CN CONSOLIDATION
- CR CORROSION
- SA SIEVE ANALYSIS
- AL ATTERBERG LIMITS
- EI EXPANSION INDEX
- RV R-VALUE

LEIGHTON AND ASSOCIATES, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Template: DYLG1; Prj ID: 2005-022.GPJ

BORING LOCATION: See Figure 2 **ELEVATION AND DATUM (feet):** 7 MSL

LATITUDE: 33° 27' 38.0" N **LONGITUDE:** 117° 41' 31.4" W

DRILLING EQUIPMENT: Mayhew 1000 **DRILLING METHOD:** Rotary Wash

BORING DIAMETER (inches): 5 **BORING DEPTH (feet):** 22

DATE STARTED: 6/2/05 **DATE COMPLETED:** 6/2/05

SPT HAMMER DROP: 30 inches **WT:** 140 lbs **DRIVE HAMMER DROP:** 30 inches **WT:** 140 lbs

LOGGED BY: JL **CHECKED BY:** QL **DRIVE SAMPLER DIAMETER (inches)** **ID:** 2.4 **OD:** 3

Elevation (feet)	Depth (feet)	Sampler	Symbol	Blows per 6 Inches	SPT N Blows per Foot	Field Unc. Comp. Str. (tsf)	DESCRIPTION	Dry Density (pcf)	Moisture Content (%)	Liquid Limit (%)	Plasticity Index (%)	Percent Passing #200 Sieve	Other Tests [PID]
							ASPHALT CONCRETE - 4 inches SILTY SAND (SM); olive, moist, medium dense, fine-grained sand, trace fine gravel - FILL						
5													CA
	5			11 20 23	21			103	17	NP	NP	16	DS
0													
	10			3 3 3	6		light brown, loose, trace corase gravel						
-5							wet						
	15			11 25 50/3 inches	62		dark brown, very dense, fine- to coarse-grained sand, trace fine to coarse gravel	108	19				
-10							SANDSTONE (Capistrano Formation); olive, wet, very dense, fine-to coarse-grained sand, trace fine gravel						
	20			50/6 inches	100								
-15							Boring terminated at 22 feet due to refusal. Groundwater encountered at 12 feet during drilling. Boring backfilled with cement/bentonite grout. Surface patched with cold patch asphalt.						
	25												
-20													

LOG OF BORING B-1

Page 1 of 1

Dana Point Boat Launch

Project No. 2005-022

PLATE

A2

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Template: DYLG1; Prj ID: 2005-022.GPJ

BORING LOCATION:	See Figure 2	**ELEVATION AND DATUM (feet):**	7 MSL
LATITUDE:	33° 27' 39.8" N	**LONGITUDE:**	117° 41' 31.4" W
DRILLING EQUIPMENT:	Mayhew 1000	**DRILLING METHOD:**	Rotary Wash
BORING DIAMETER (inches):	5	**BORING DEPTH (feet):**	15
DATE STARTED:	6/2/05	**DATE COMPLETED:**	6/2/05
SPT HAMMER DROP:	30 inches **WT:** 140 lbs	**DRIVE HAMMER DROP:**	30 inches **WT:** 140 lbs
LOGGED BY:	JL **CHECKED BY:** QL	**DRIVE SAMPLER DIAMETER (inches)**	ID: 2.4 OD: 3

Elevation (feet)	Depth (feet)	Sampler	Symbol	Blows per 6 Inches	SPT N Blows per Foot	Field Unc. Comp. Str. (tsf)	DESCRIPTION	Dry Density (pcf)	Moisture Content (%)	Liquid Limit (%)	Plasticity Index (%)	Percent Passing #200 Sieve	Other Tests [PID]
							CONCRETE - 7 inches						
5							SILTY SAND (SM); olive, moist, medium dense, fine-grained sand - FILL						
				9	20			91	10			31	CA
	5			16									RV
				25									
				9	14			109	20				DS
0				9									
				20			wet						
							SILTY GRAVEL with SAND (GM); dark gray, wet, medium dense, fine to coarse gravel, fine-grained sand						
	10			6	12								
				7									
-5				17									
							SILTSTONE (Capistrano Formation); dark gray, wet, very dense, nonplastic						
				15	100								
	15			27/3 inches									
							Boring terminated at 14.75 feet due to refusal.						
							Groundwater encountered at 7 feet during drilling.						
							Boring backfilled with cement/bentonite grout.						
-10							Surface patched with rapid set concrete.						
	20												
-15													
	25												
-20													

LOG OF BORING B- 2

Page 1 of 1
Dana Point Boat Launch
Project No. 2005-022

PLATE
A3

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times; it is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Template: DYLG1; Prj ID: 2005-022.GPJ

BORING LOCATION:	See Figure 2	**ELEVATION AND DATUM (feet):**	7 MSL
LATITUDE:	33° 27' 38.7" N	**LONGITUDE:**	117° 41' 32.0" W
DRILLING EQUIPMENT:	Mayhew 1000	**DRILLING METHOD:**	Rotary Wash
BORING DIAMETER (inches):	5	**BORING DEPTH (feet):**	21
DATE STARTED:	6/2/05	**DATE COMPLETED:**	6/2/05
SPT HAMMER DROP:	30 inches **WT:** 140 lbs	**DRIVE HAMMER DROP:**	30 inches **WT:** 140 lbs
LOGGED BY:	JL **CHECKED BY:** QL	**DRIVE SAMPLER DIAMETER (inches)**	**ID:** 2.4 **OD:** 3

Elevation (feet)	Depth (feet)	Sampler	Symbol	Blows per 6 Inches	SPT N Blows per Foot	Field Unc. Comp. Str. (tsf)	DESCRIPTION	Dry Density (pcf)	Moisture Content (%)	Liquid Limit (%)	Plasticity Index (%)	Percent Passing #200 Sieve	Other Tests [PID]
							CONCRETE - 7 inches						
5							SILTY SAND (SM); olive, moist, medium dense, fine-grained sand, trace fine gravel - FILL			NP	NP	17	CA COMP RV
	5			7 8 11	9								
0							wet						
	10			6 9 21	30		SILTY GRAVEL with SAND (GM); dark greenish gray, wet, medium dense to dense, fine to coarse gravel, fine-grained sand						
-5													
	15			27/1 inch 75/6 inches	100 100								
-10							SANDSTONE (Capistrano Formation); olive, wet, very dense, fine-grained sand						
	20			20 50/6 inches	100								
-15							Boring terminated at 21 feet due to refusal. Groundwater encountered at 7 feet during drilling. Boring backfilled with cement/bentonite grout. Surface patched with rapid set concrete.						
	25												
-20													

LOG OF BORING B- 3

Page 1 of 1
Dana Point Boat Launch
Project No. 2005-022

PLATE
A4

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Template: DYLG1; Prj ID: 2005-022.GPJ

BORING LOCATION: See Figure 2 **ELEVATION AND DATUM (feet):** 10 MSL

LATITUDE: 33° 27' 39.2" N **LONGITUDE:** 117° 41' 33.4" W

DRILLING EQUIPMENT: Mayhew 1000 **DRILLING METHOD:** Rotary Wash

BORING DIAMETER (inches): 5 **BORING DEPTH (feet):** 7

DATE STARTED: 6/2/05 **DATE COMPLETED:** 6/2/05

SPT HAMMER DROP: 30 inches **WT:** 140 lbs **DRIVE HAMMER DROP:** 30 inches **WT:** 140 lbs

LOGGED BY: JL **CHECKED BY:** QL **DRIVE SAMPLER DIAMETER (inches)** ID: 2.4 OD: 3

Elevation (feet)	Depth (feet)	Sampler	Symbol	Blows per 6 Inches	SPT N Blows per Foot	Field Unc. Comp. Str. (tsf)	DESCRIPTION	Dry Density (pcf)	Moisture Content (%)	Liquid Limit (%)	Plasticity Index (%)	Percent Passing #200 Sieve	Other Tests [PID]
							ASPHALT CONCRETE - 4 inches						
				6	13		SILTY GRAVEL with SAND (GM); brown, moist, medium dense, fine to coarse gravel, fine-grained sand, few cobbles - FILL	104	8	30	10	18	CA
				9			CLAYEY SAND (SC); olive, moist, medium dense, fine-to coarse-grained sand, trace coarse gravel - FILL	104	10				COMP
				18									RV
5	5			8	15		Increased fines, brown, few SANDY SILT (ML)	111	13				
				15				119	14				
				15			Boring terminated at 6.5 feet.						
							No groundwater encountered during drilling.						
							Boring backfilled with cement/bentonite grout.						
							Surface patched with cold patch asphalt.						

0 10

-5 15

-10 20

-15 25

-20

LOG OF BORING B- 4

Page 1 of 1

Dana Point Boat Launch

Project No. 2005-022

PLATE

A5

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A-3

Cone Penetration Testing (CPT) Logs by GMU

Kehoe Testing and Engineering
714-901-7270
steve@kehoetesting.com
www.kehoetesting.com

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

Project: GMU Geotechnical
Location: 34571 Golden Lantern, Dana Point, CA

CPT-1A
Total depth: 19.37 ft, Date: 7/12/2019

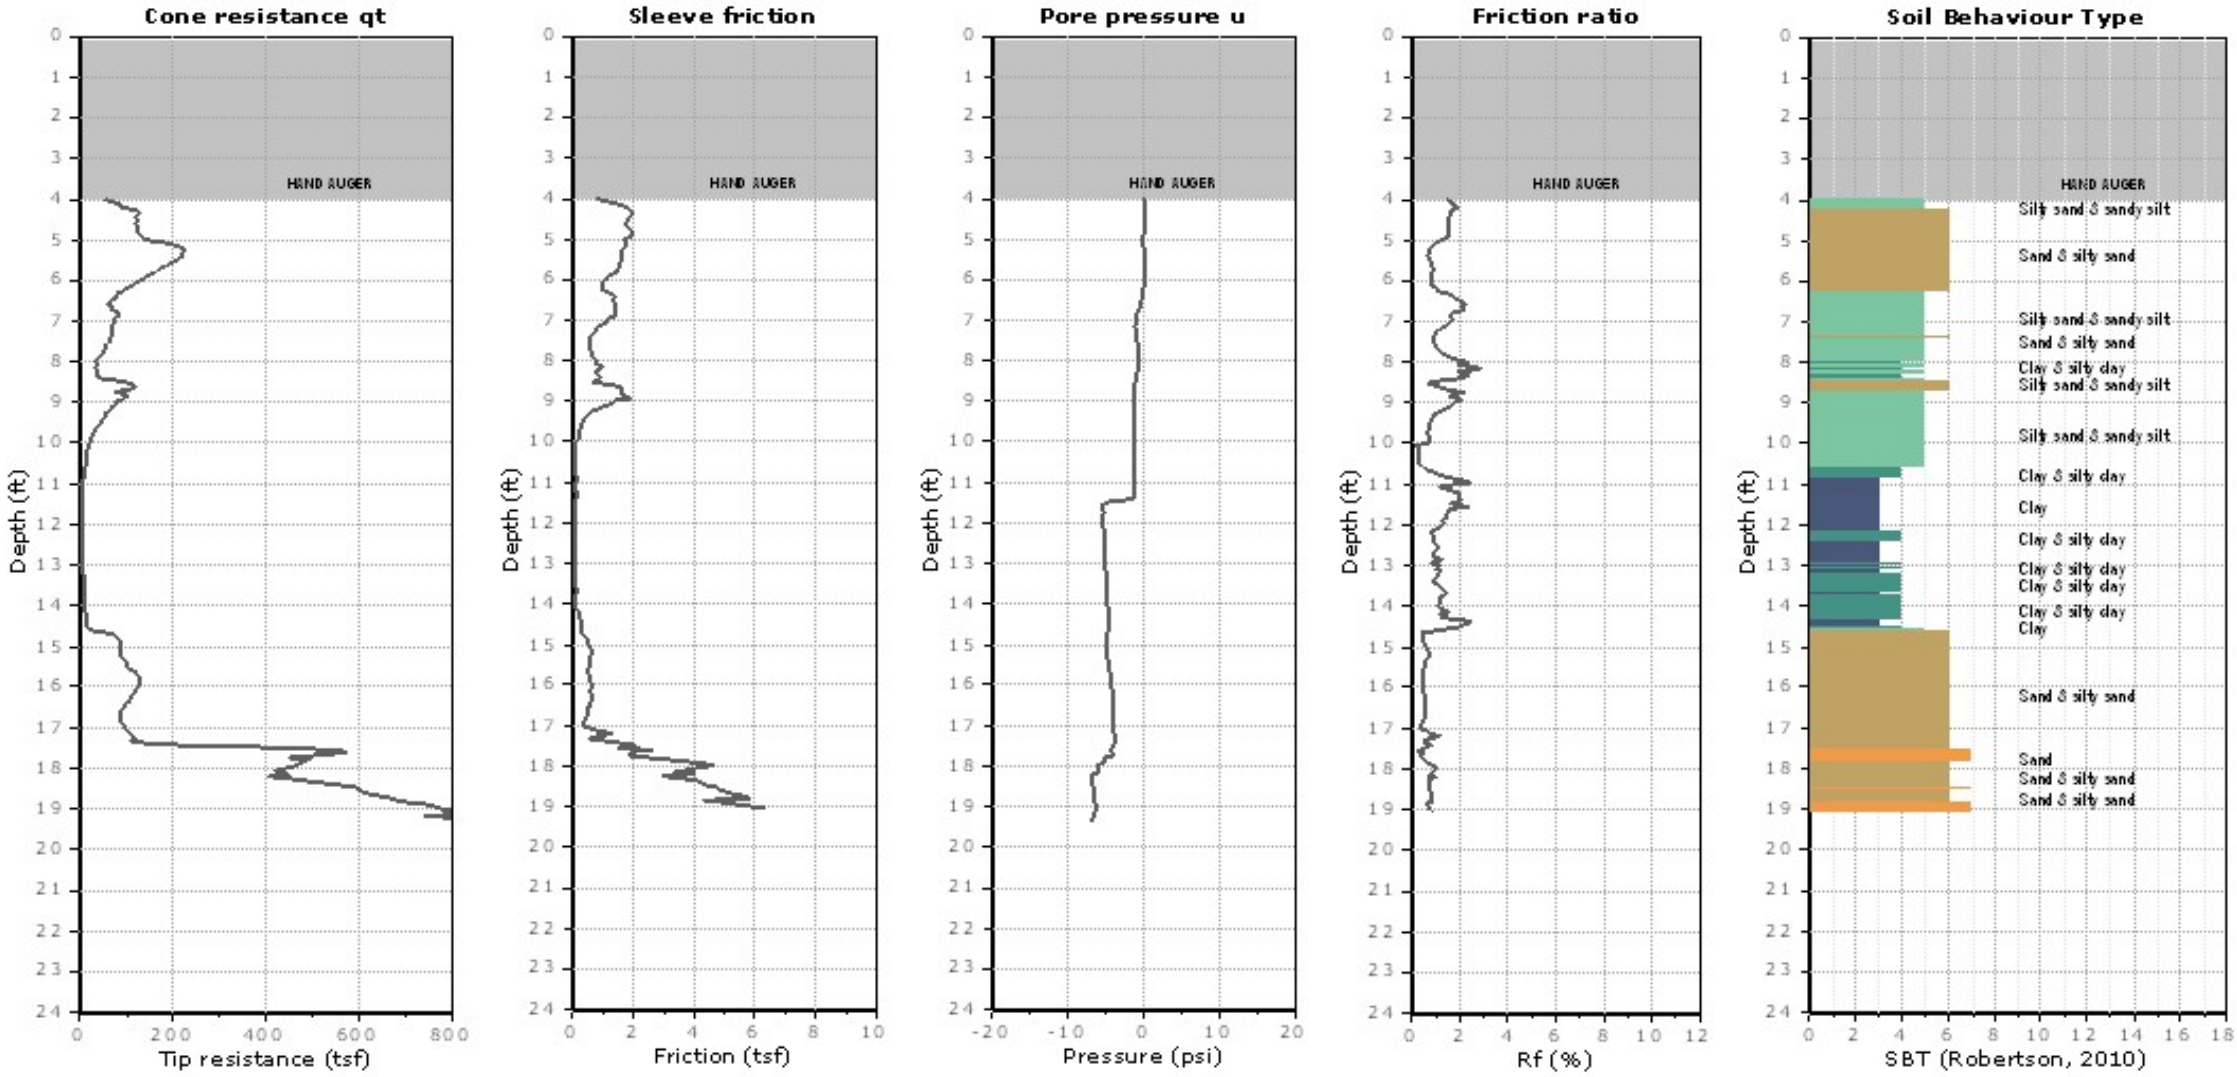

Kehoe Testing and Engineering
714-901-7270
steve@kehoetesting.com
www.kehoetesting.com

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: **GMU Geotechnical**
Location: **34571 Golden Lantern, Dana Point, CA**

CPT-2A
Total depth: 4.27 ft, Date: 7/12/2019

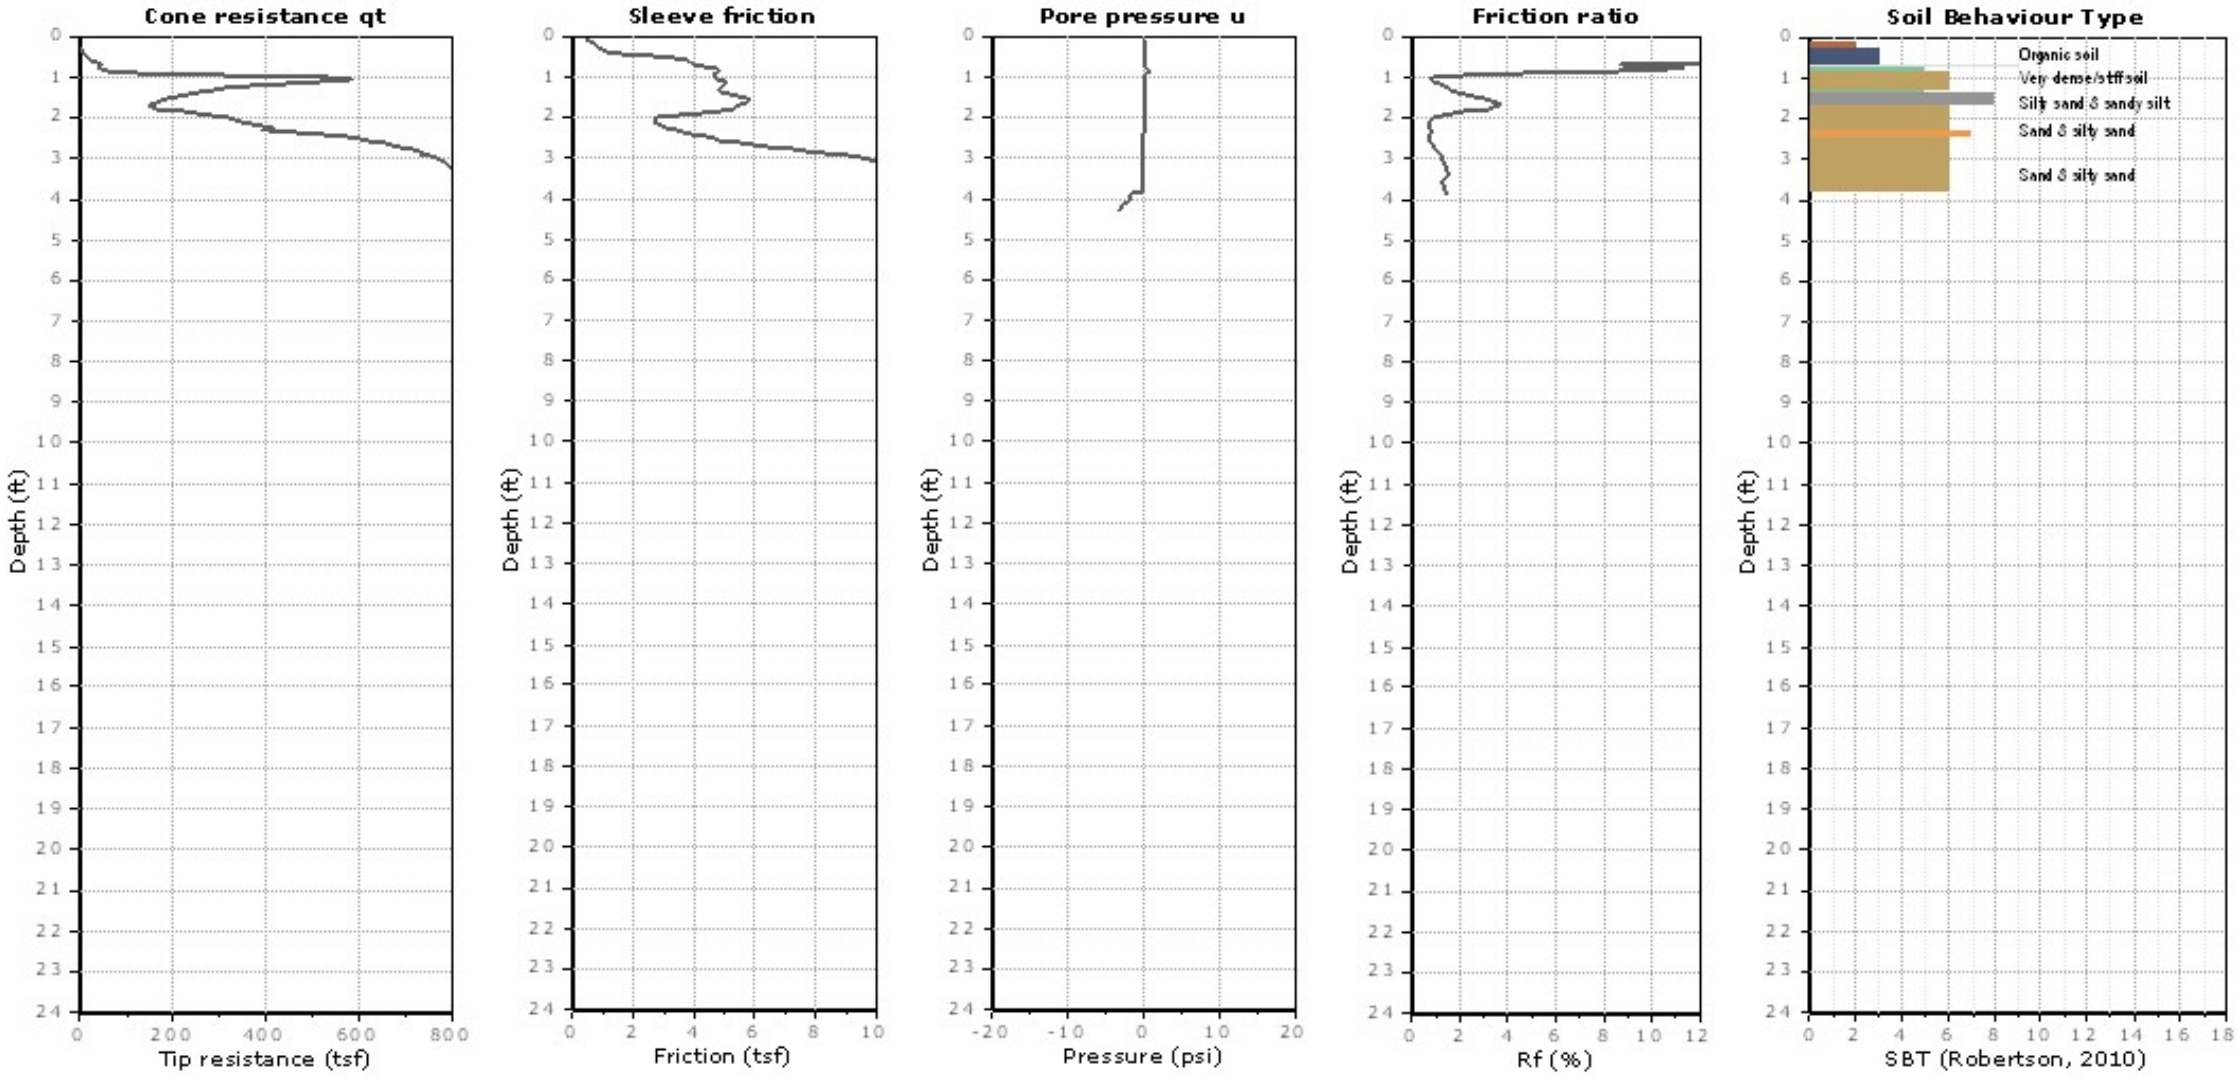

Kehoe Testing and Engineering
714-901-7270
steve@kehoetesting.com
www.kehoetesting.com

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

Project: **GMU Geotechnical**
Location: **34571 Golden Lantern, Dana Point, CA**

CPT-3A
Total depth: 23.11 ft, Date: 7/12/2019

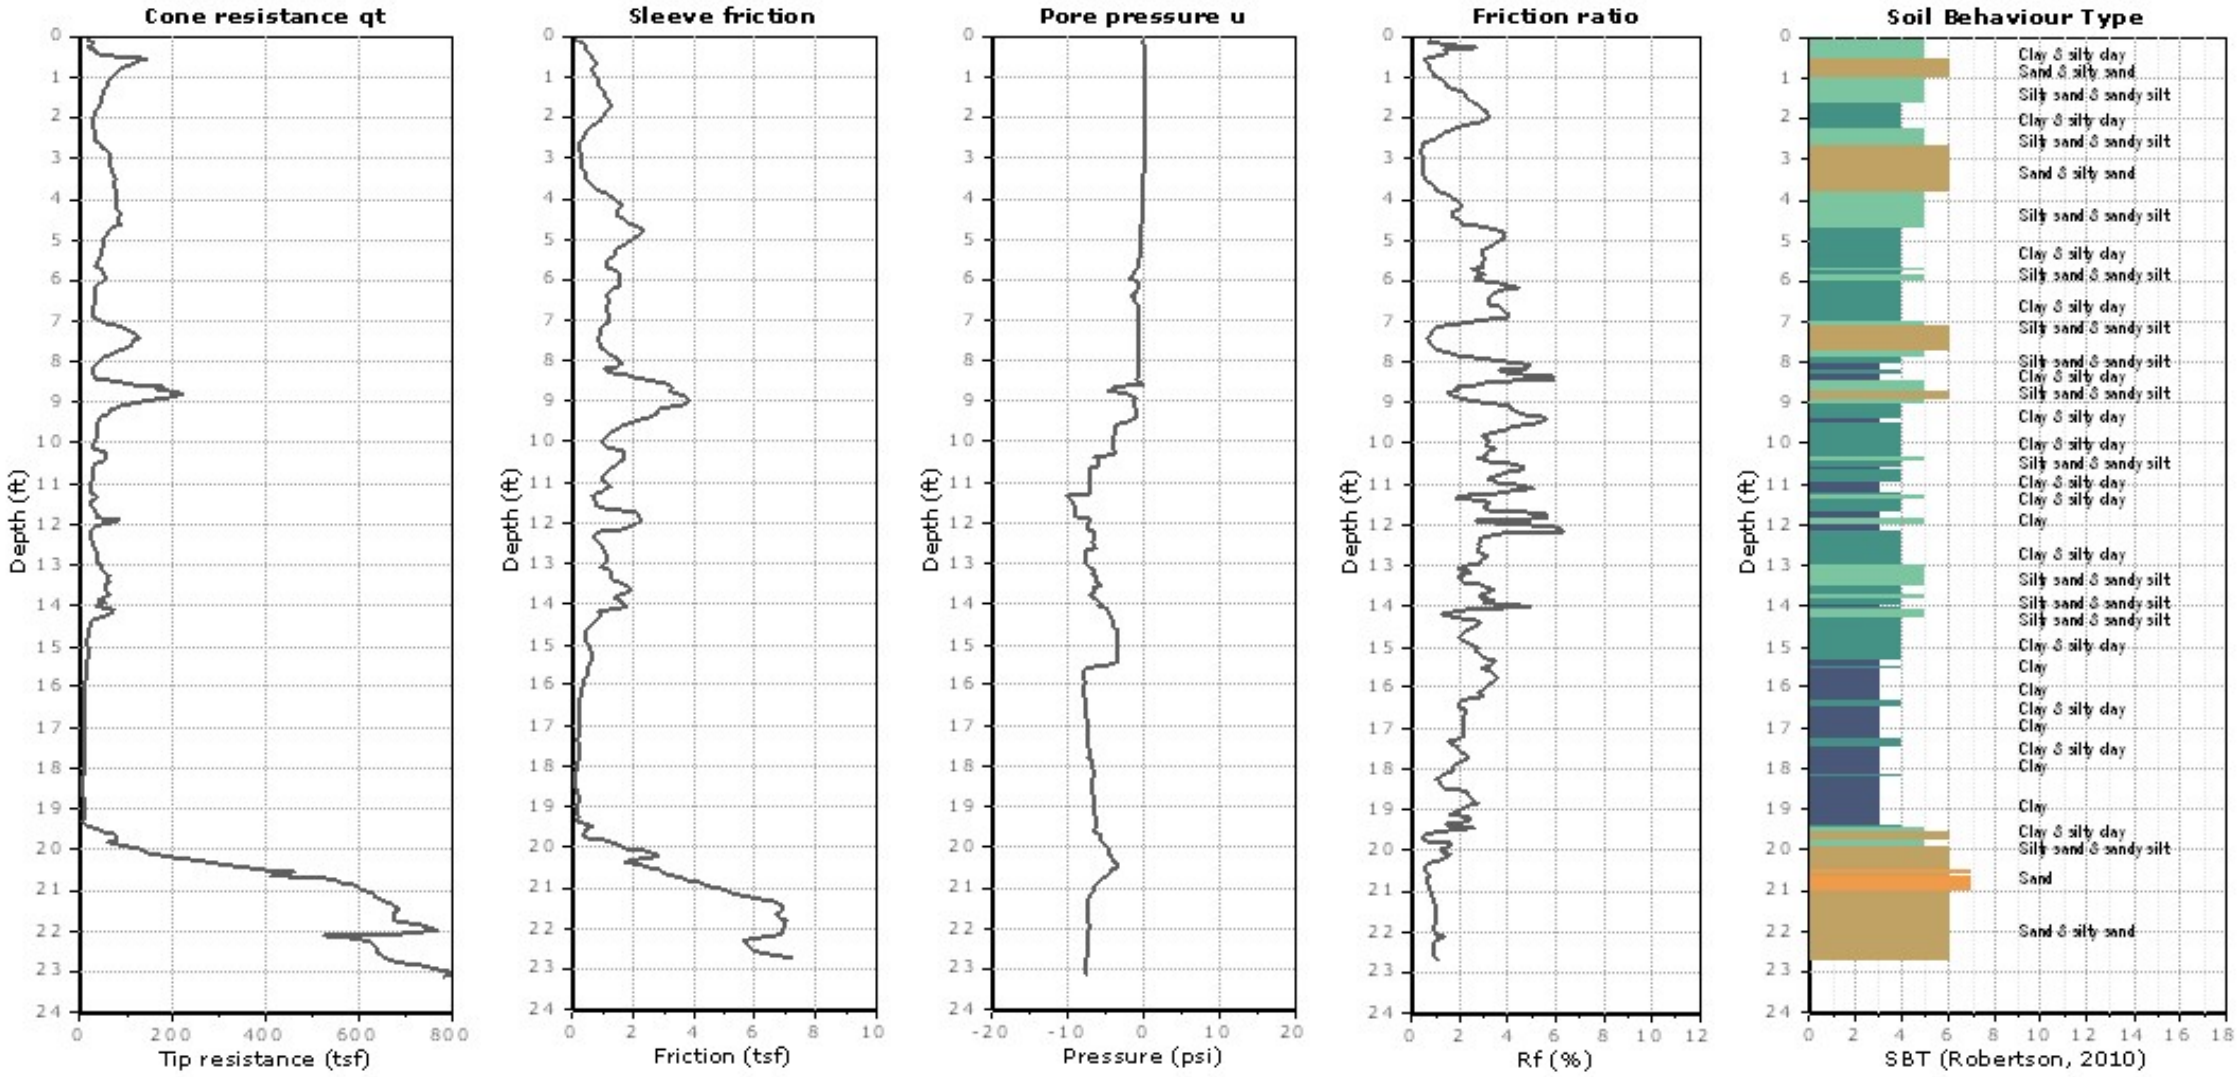

Kehoe Testing and Engineering
714-901-7270
steve@kehoetesting.com
www.kehoetesting.com

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: **GMU Geotechnical**
Location: **34571 Golden Lantern, Dana Point, CA**

CPT-4A
Total depth: 18.83 ft, Date: 7/12/2019

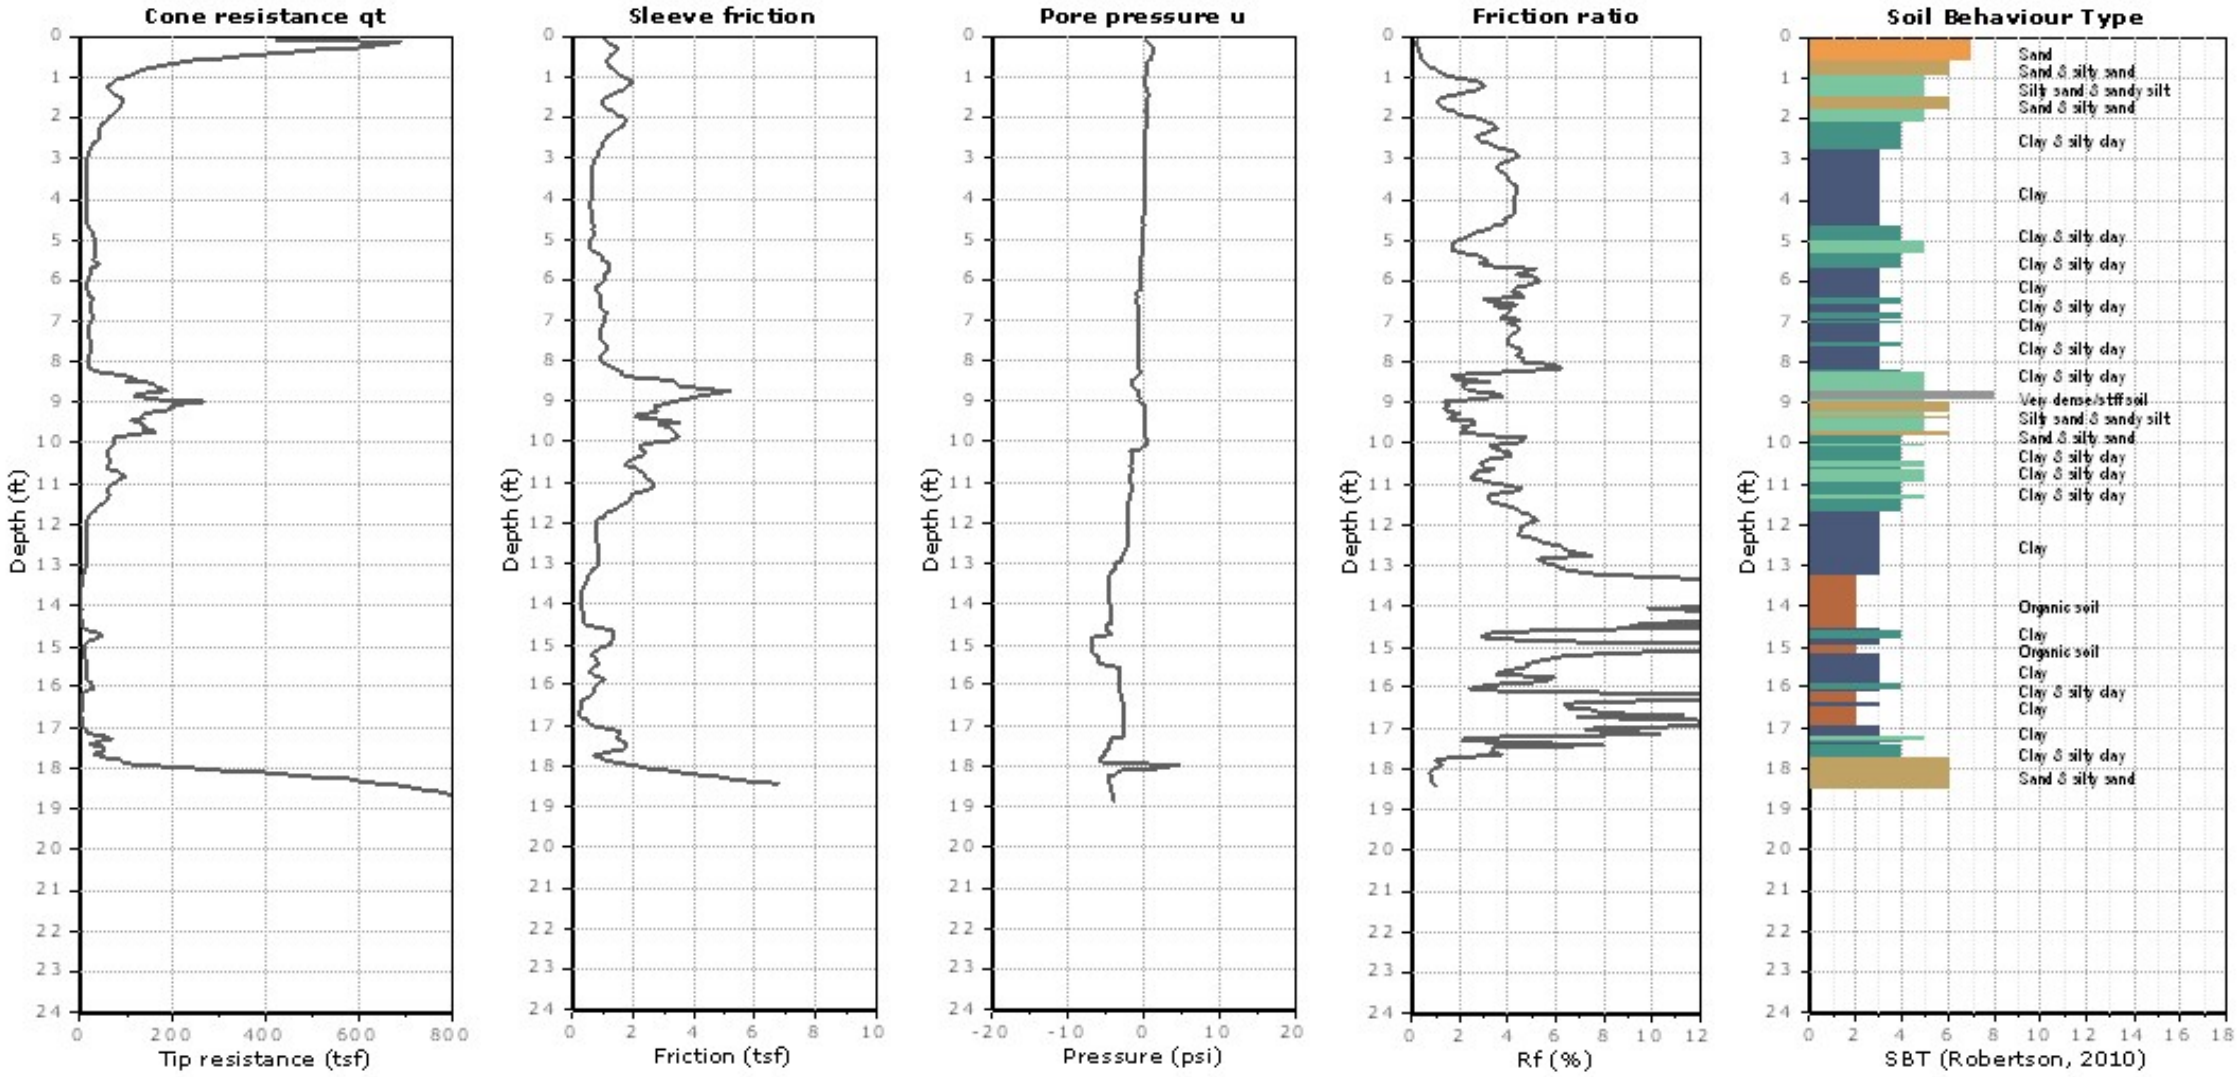

Kehoe Testing and Engineering
714-901-7270
steve@kehoetesting.com
www.kehoetesting.com

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project: **GMU Geotechnical**
Location: **34571 Golden Lantern, Dana Point, CA**

CPT-5A
Total depth: 18.52 ft, Date: 7/12/2019

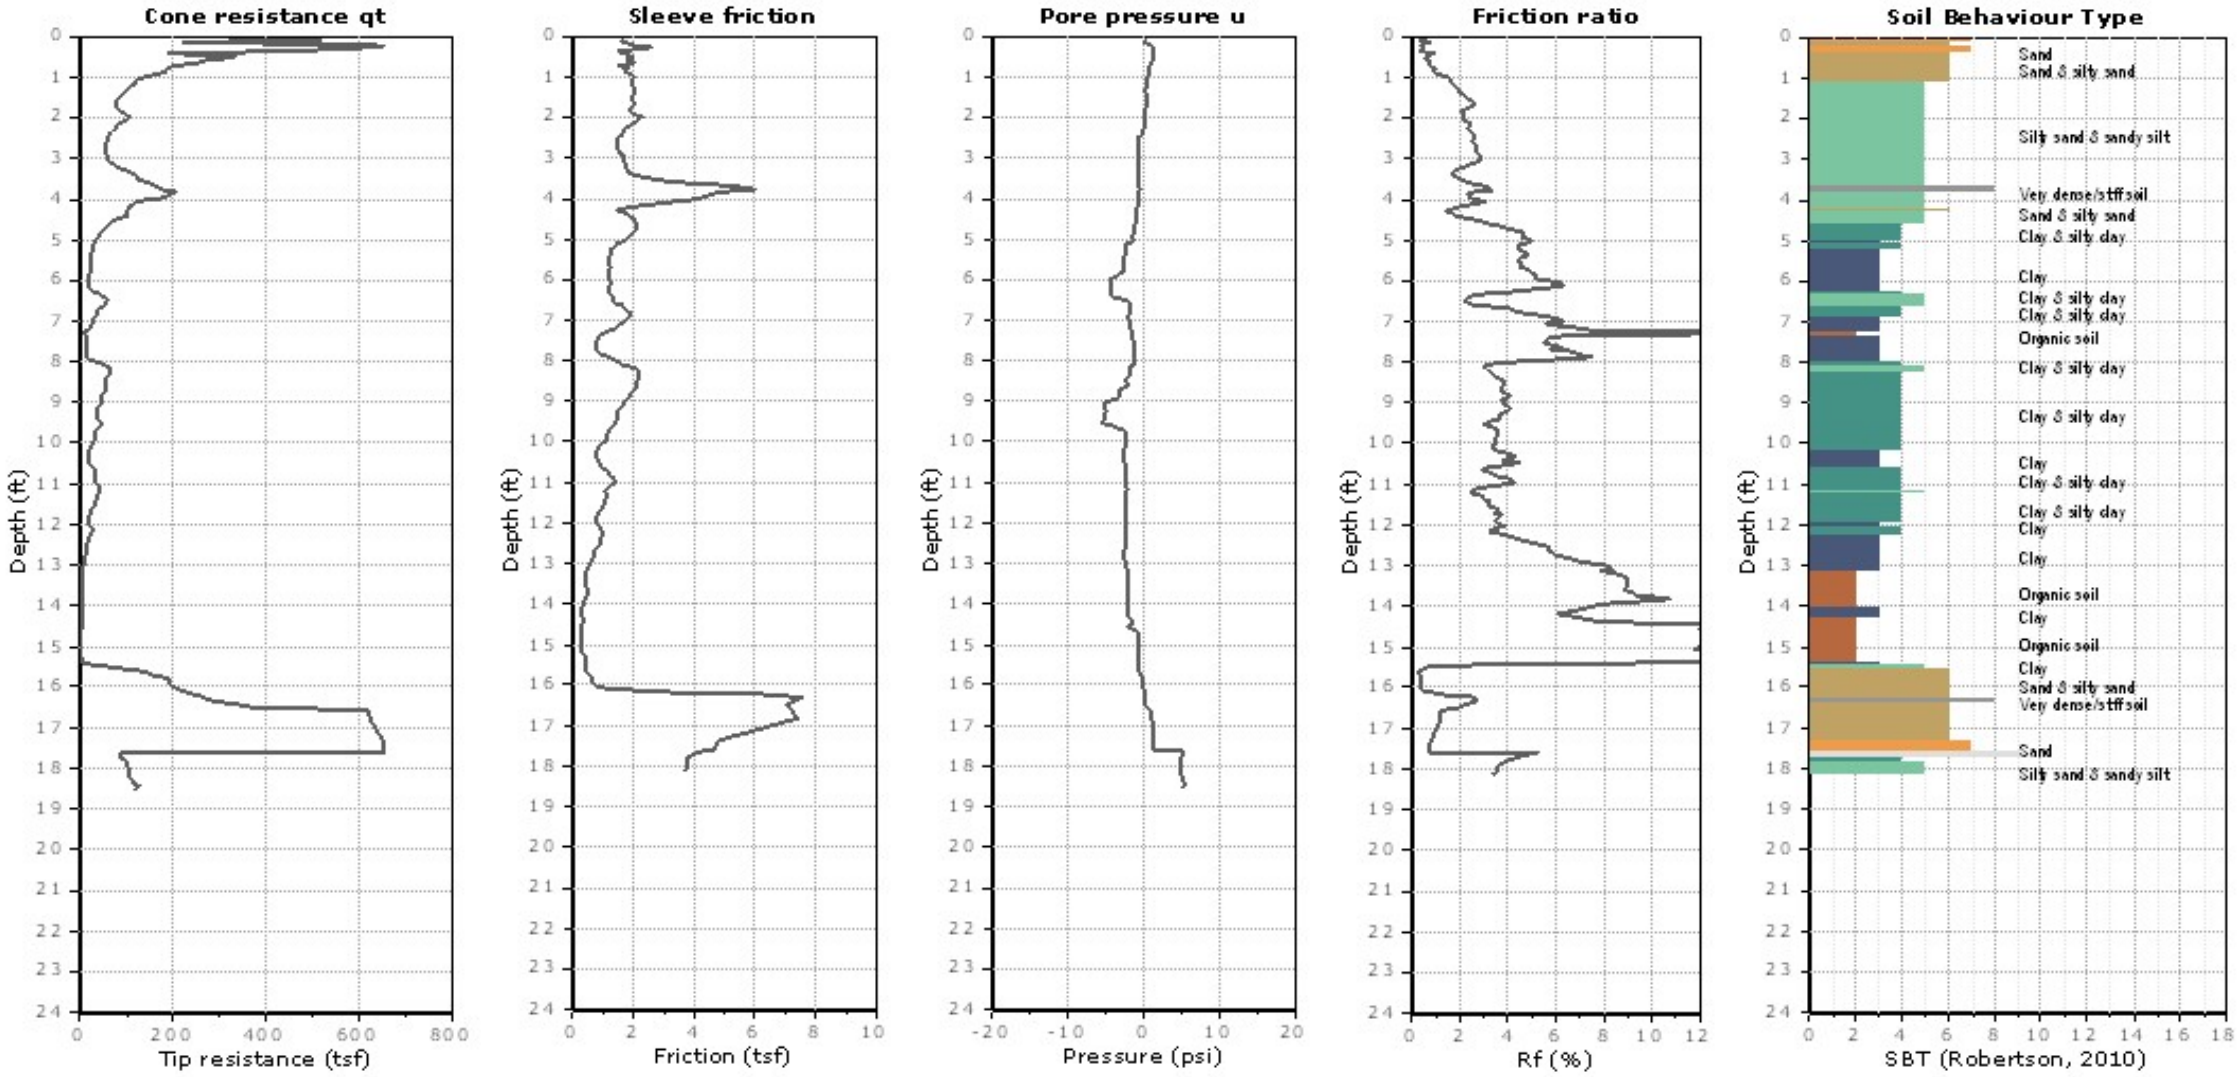

Kehoe Testing and Engineering
714-901-7270
steve@kehoetesting.com
www.kehoetesting.com

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

Project: **GMU Geotechnical**
Location: **34699 Golden Latern, Dana Point, CA**

CPT-6A
Total depth: 24.62 ft, Date: 10/9/2019

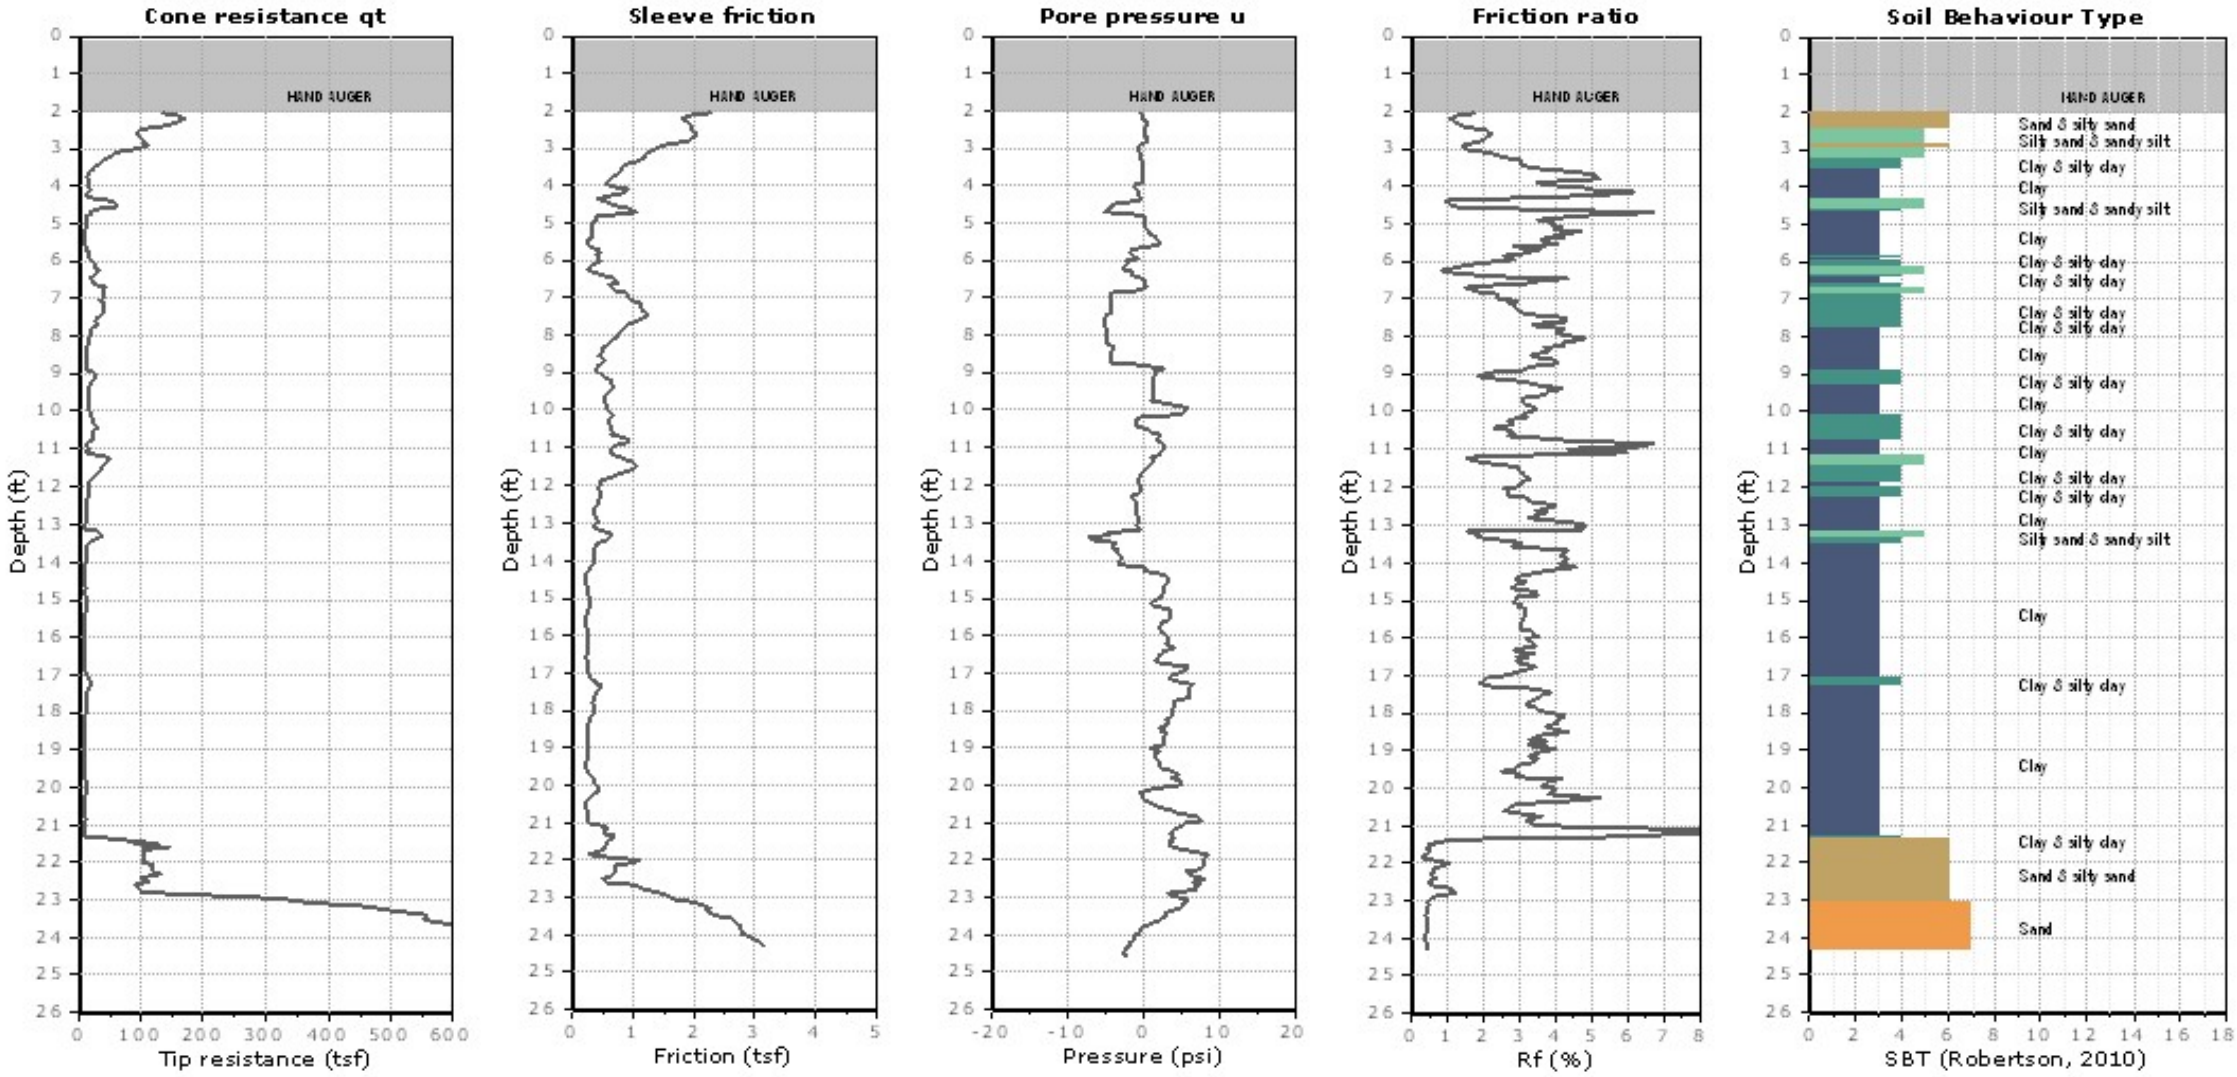

Kehoe Testing and Engineering
714-901-7270
steve@kehoetesting.com
www.kehoetesting.com

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

Project: **GMU Geotechnical**
Location: **34699 Golden Latern, Dana Point, CA**

CPT-7A
Total depth: 25.72 ft, Date: 10/9/2019

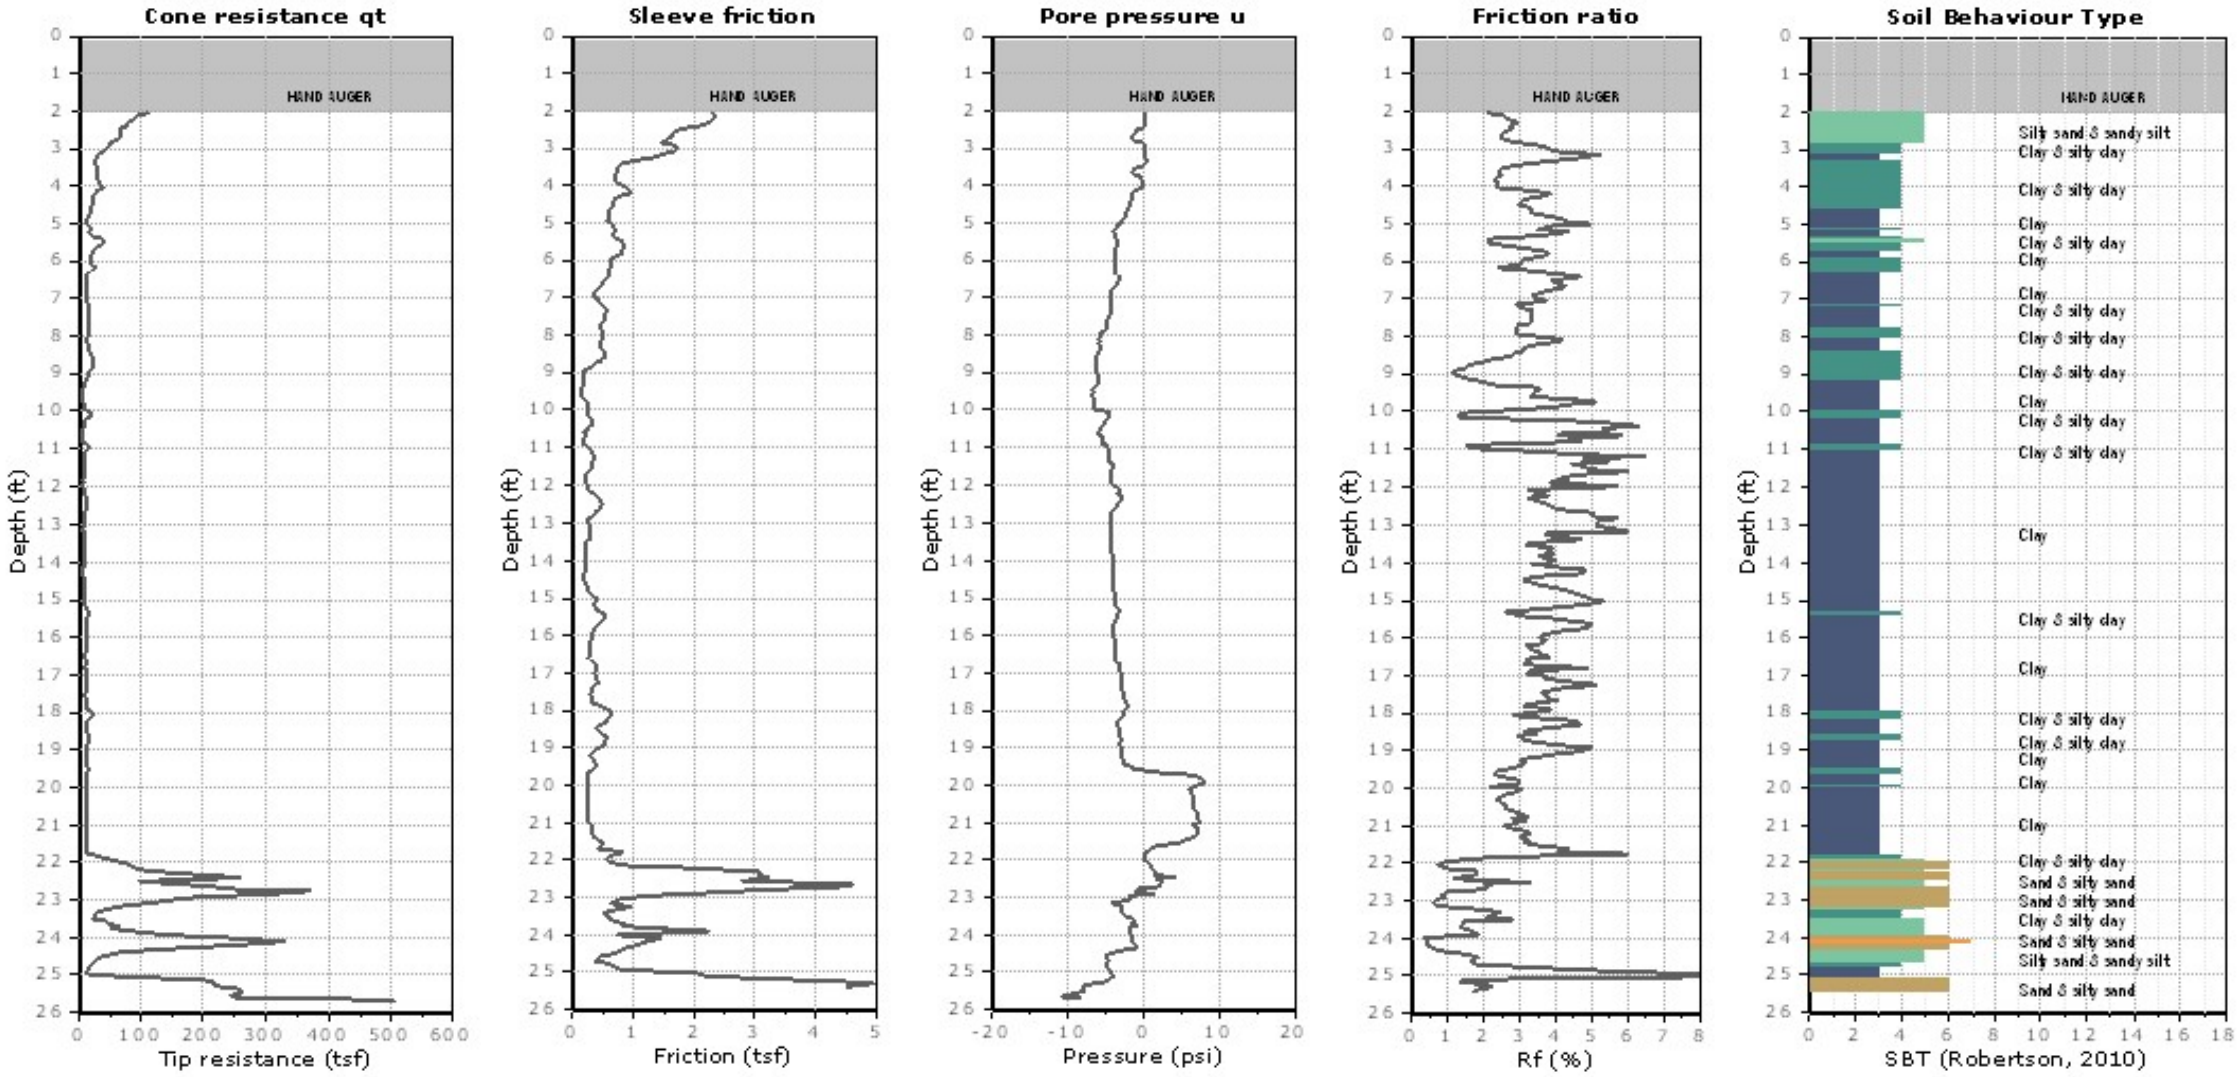

Kehoe Testing & Engineering
Office: (714) 901-7270
Fax: (714) 901-7289
rich@kehoetesting.com
www.kehoetesting.com

CPT Data
30 ton rig

Date: 29/Aug/2012
Test ID: CPT-1
Project: DanaPoint

Customer: GMU Geotechnical, Inc.
Job Site: OCDPH Revitalization

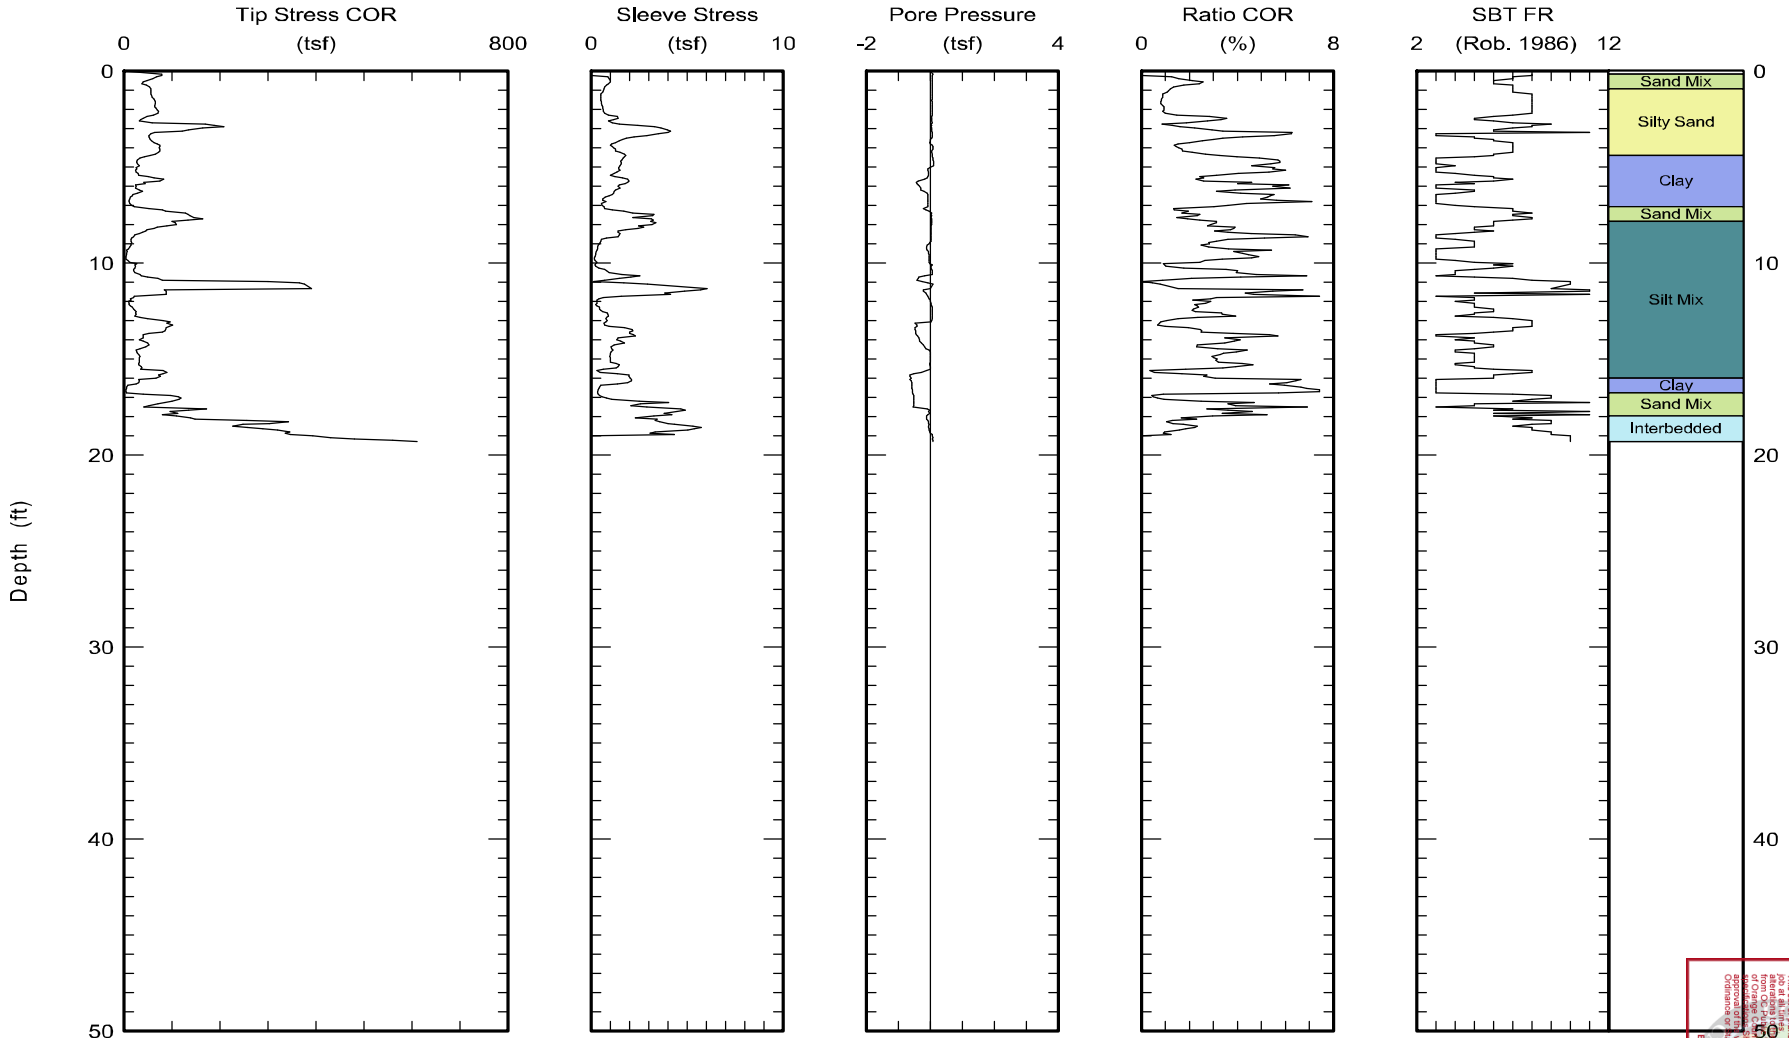

Maximum depth: 19.32 (ft)

County of Orange - OC Public Works
OC Development Services
APPROVED
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2013

Test ID: CPT-1
File: Z29G1209C.ECP

Kehoe Testing & Engineering
Office: (714) 901-7270
Fax: (714) 901-7289
rich@kehoetesting.com
www.kehoetesting.com

CPT Data
30 ton rig

Date: 29/Aug/2012
Test ID: CPT-4
Project: DanaPoint

Customer: GMU Geotechnical, Inc.
Job Site: OCDPH Revitalization

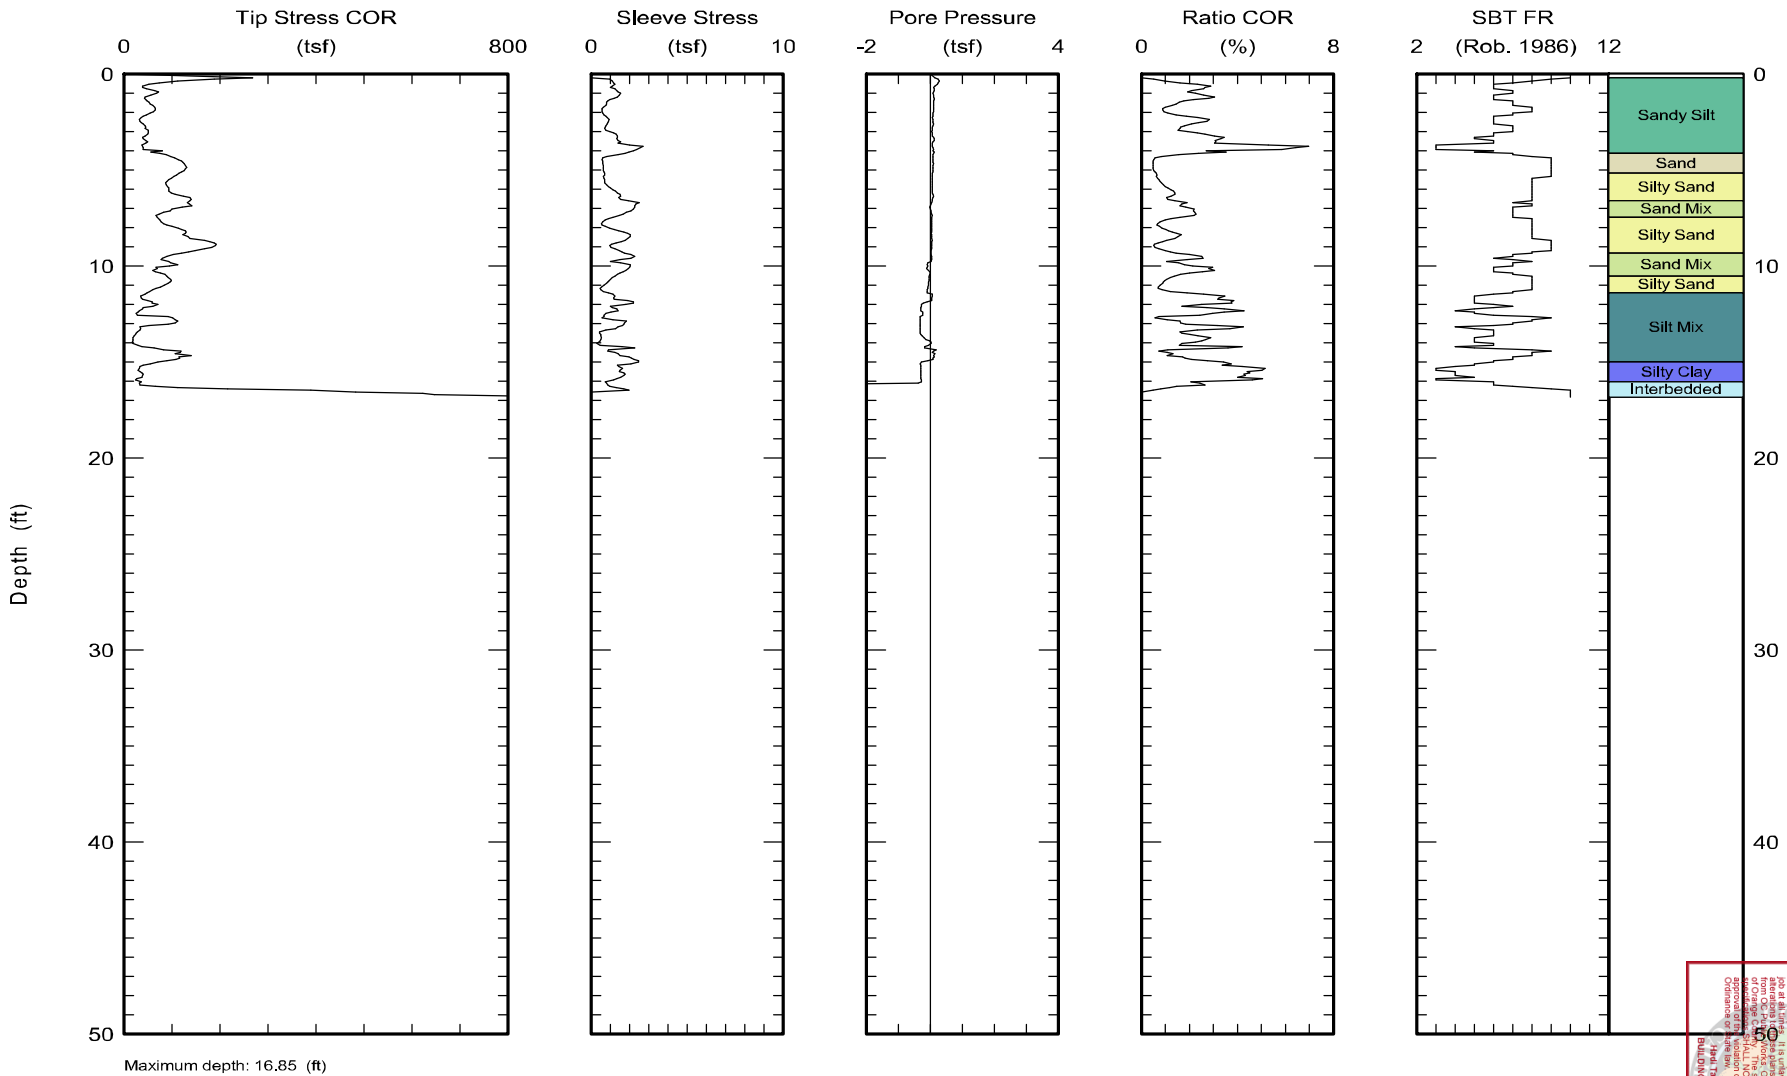

Maximum depth: 16.85 (ft)

County of Orange - OC Public Works
OC Development Services
APPROVED
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2013

Test ID: CPT-4
File: Z29G1207C.ECP

Kehoe Testing & Engineering
Office: (714) 901-7270
Fax: (714) 901-7289
rich@kehoetesting.com
www.kehoetesting.com

CPT Data
30 ton rig

Date: 29/Aug/2012
Test ID: CPT-5
Project: DanaPoint

Customer: GMU Geotechnical, Inc.
Job Site: OCDPH Revitalization

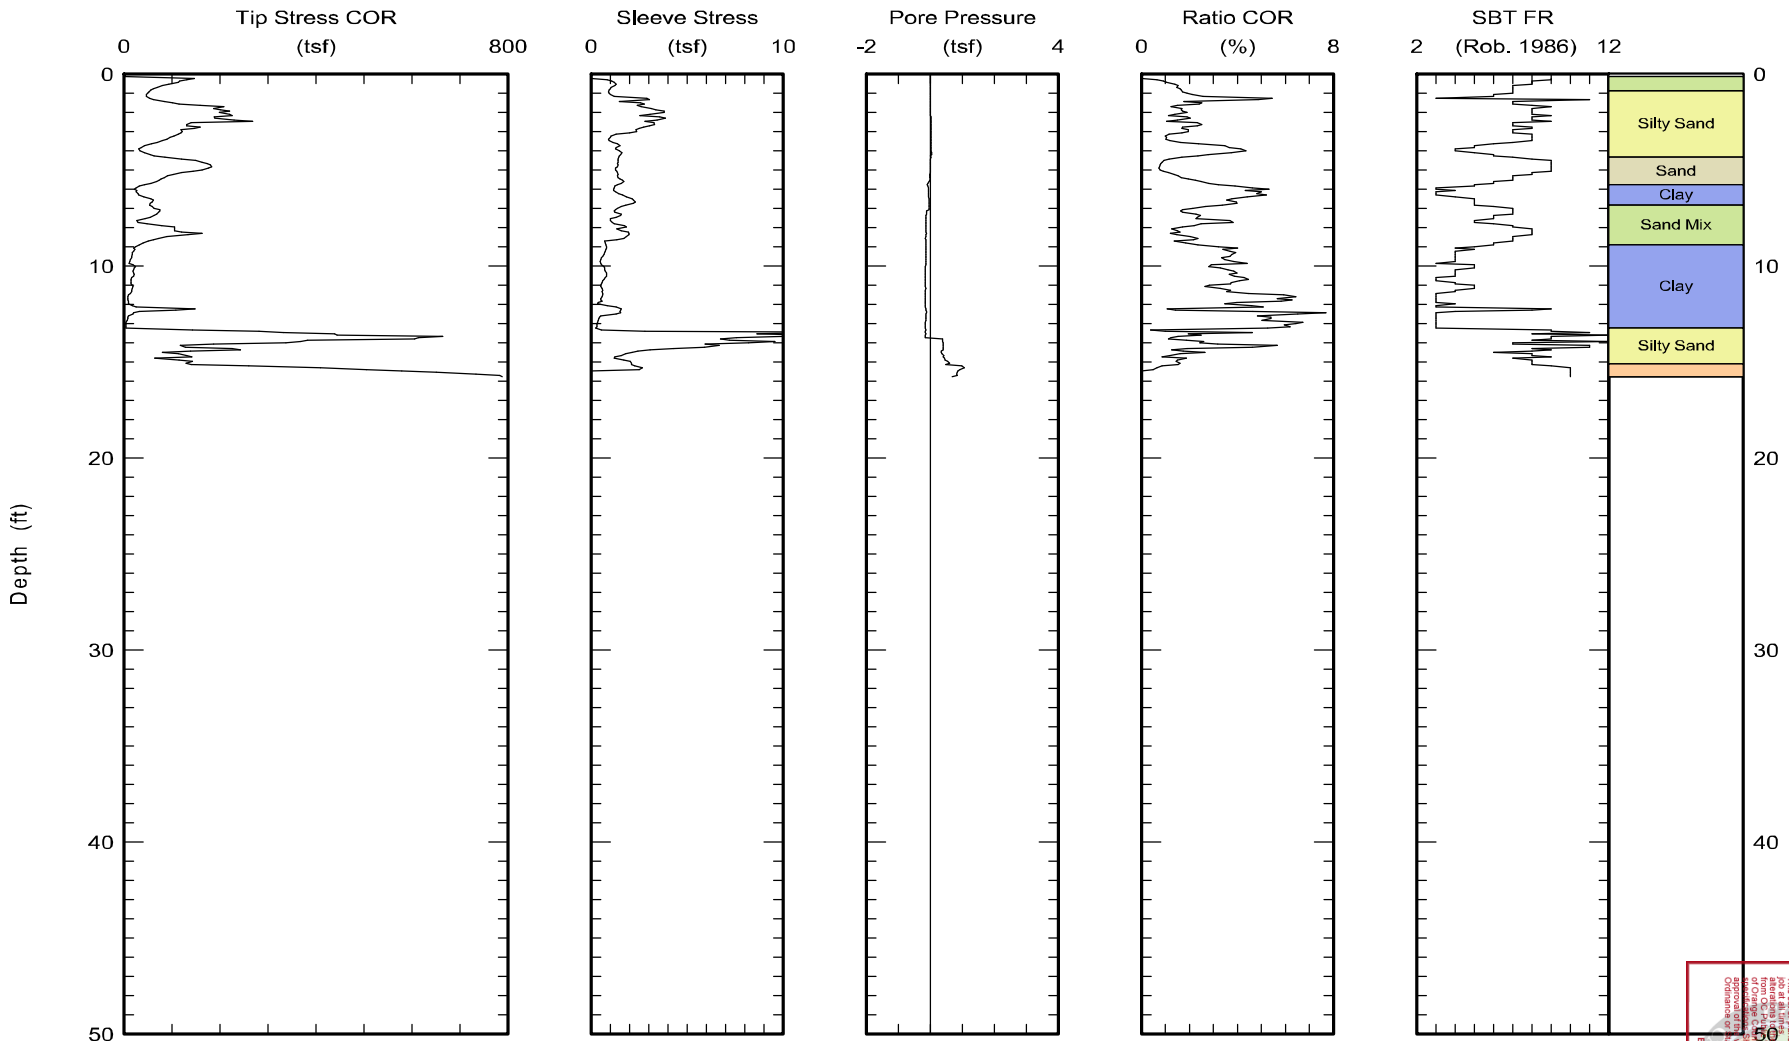

Maximum depth: 15.79 (ft)

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times. No plans without written permission from OC Public Works, OC Development Services
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2013

Test ID: CPT-5
File: Z29G1206C.ECP

Kehoe Testing & Engineering
Office: (714) 901-7270
Fax: (714) 901-7289
rich@kehoetesting.com
www.kehoetesting.com

CPT Data
30 ton rig

Date: 29/Aug/2012
Test ID: CPT-6
Project: DanaPoint

Customer: GMU Geotechnical, Inc.
Job Site: OCDPH Revitalization

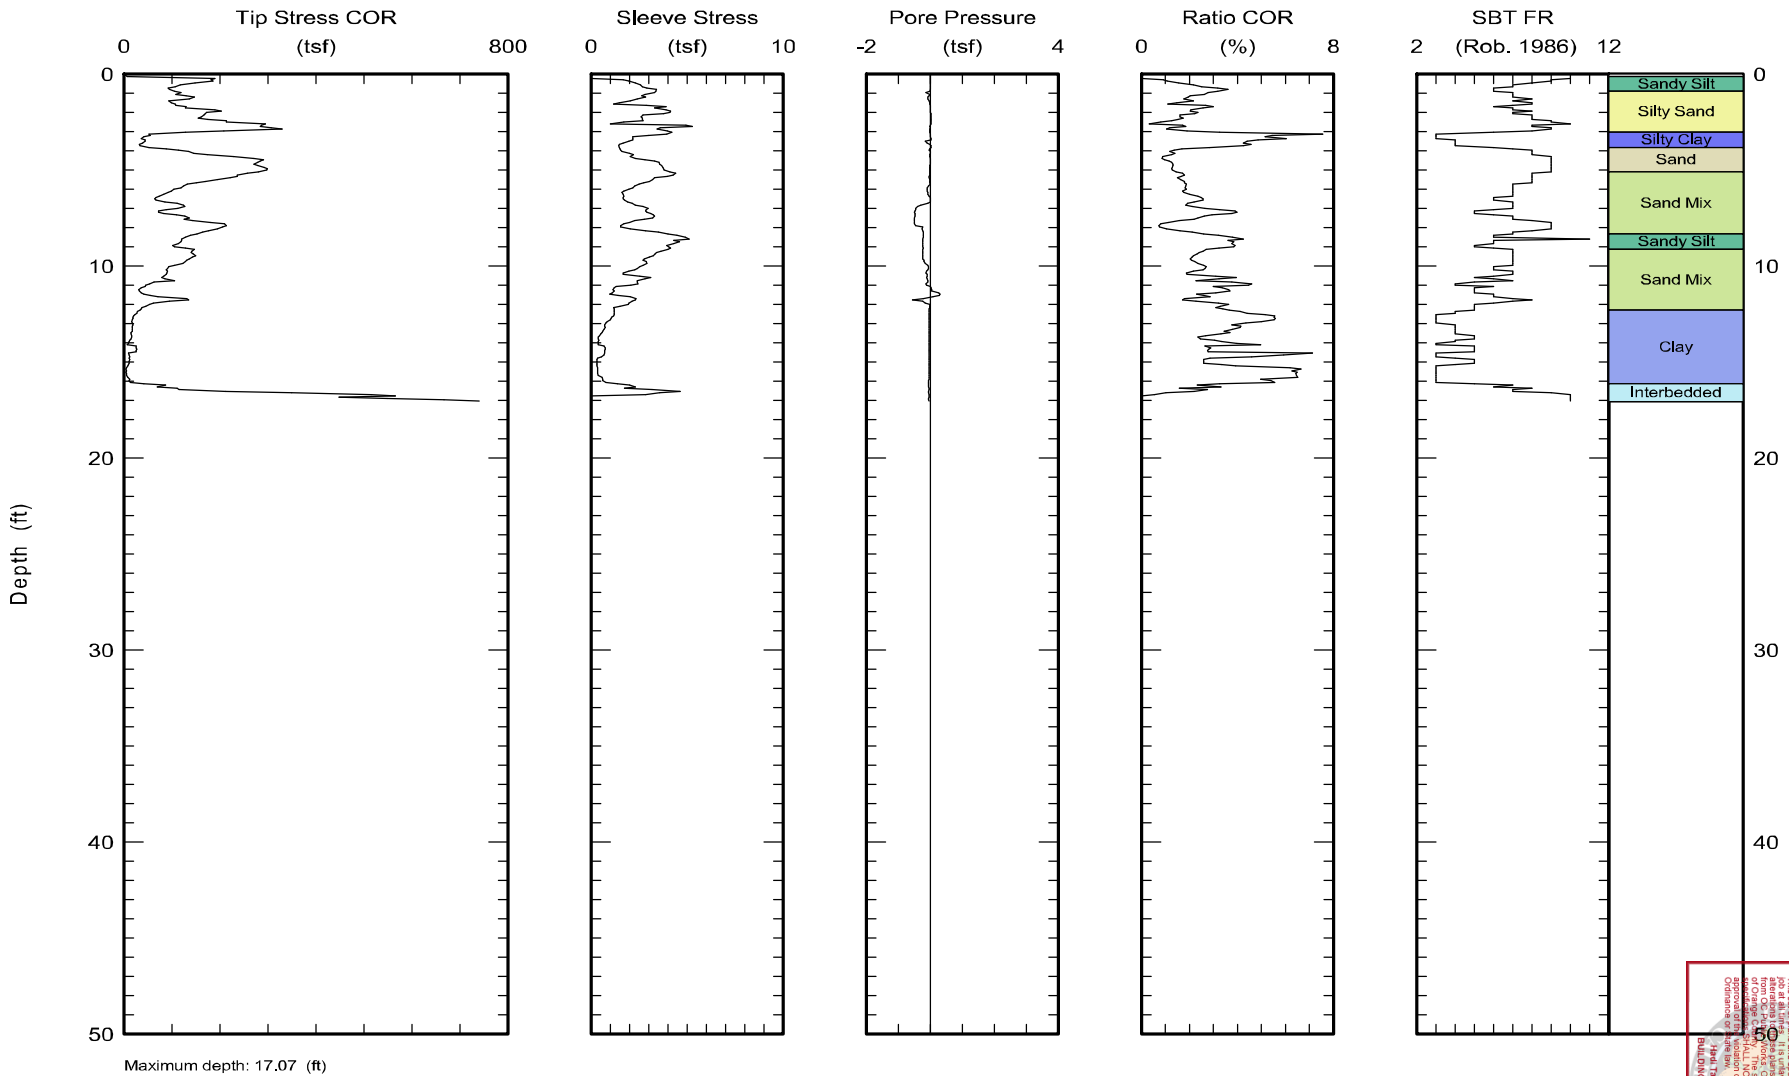

Maximum depth: 17.07 (ft)

County of Orange - OC Public Works
OC Development Services
APPROVED
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2013

Test ID: CPT-6
File: Z29G1204C.ECP

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX A-4

Cone Penetration Testing (CPT) Logs by Others

Kehoe Testing & Engineering
Office: (714) 901-7270
Fax: (714) 901-7289
skehoe@msn.com

CPT Data
30 ton rig

Date: 05/Nov/2007
Test ID: CPT-10
Project: DanaPoint

Customer: Leighton
Job Site: Dana Point Harbor

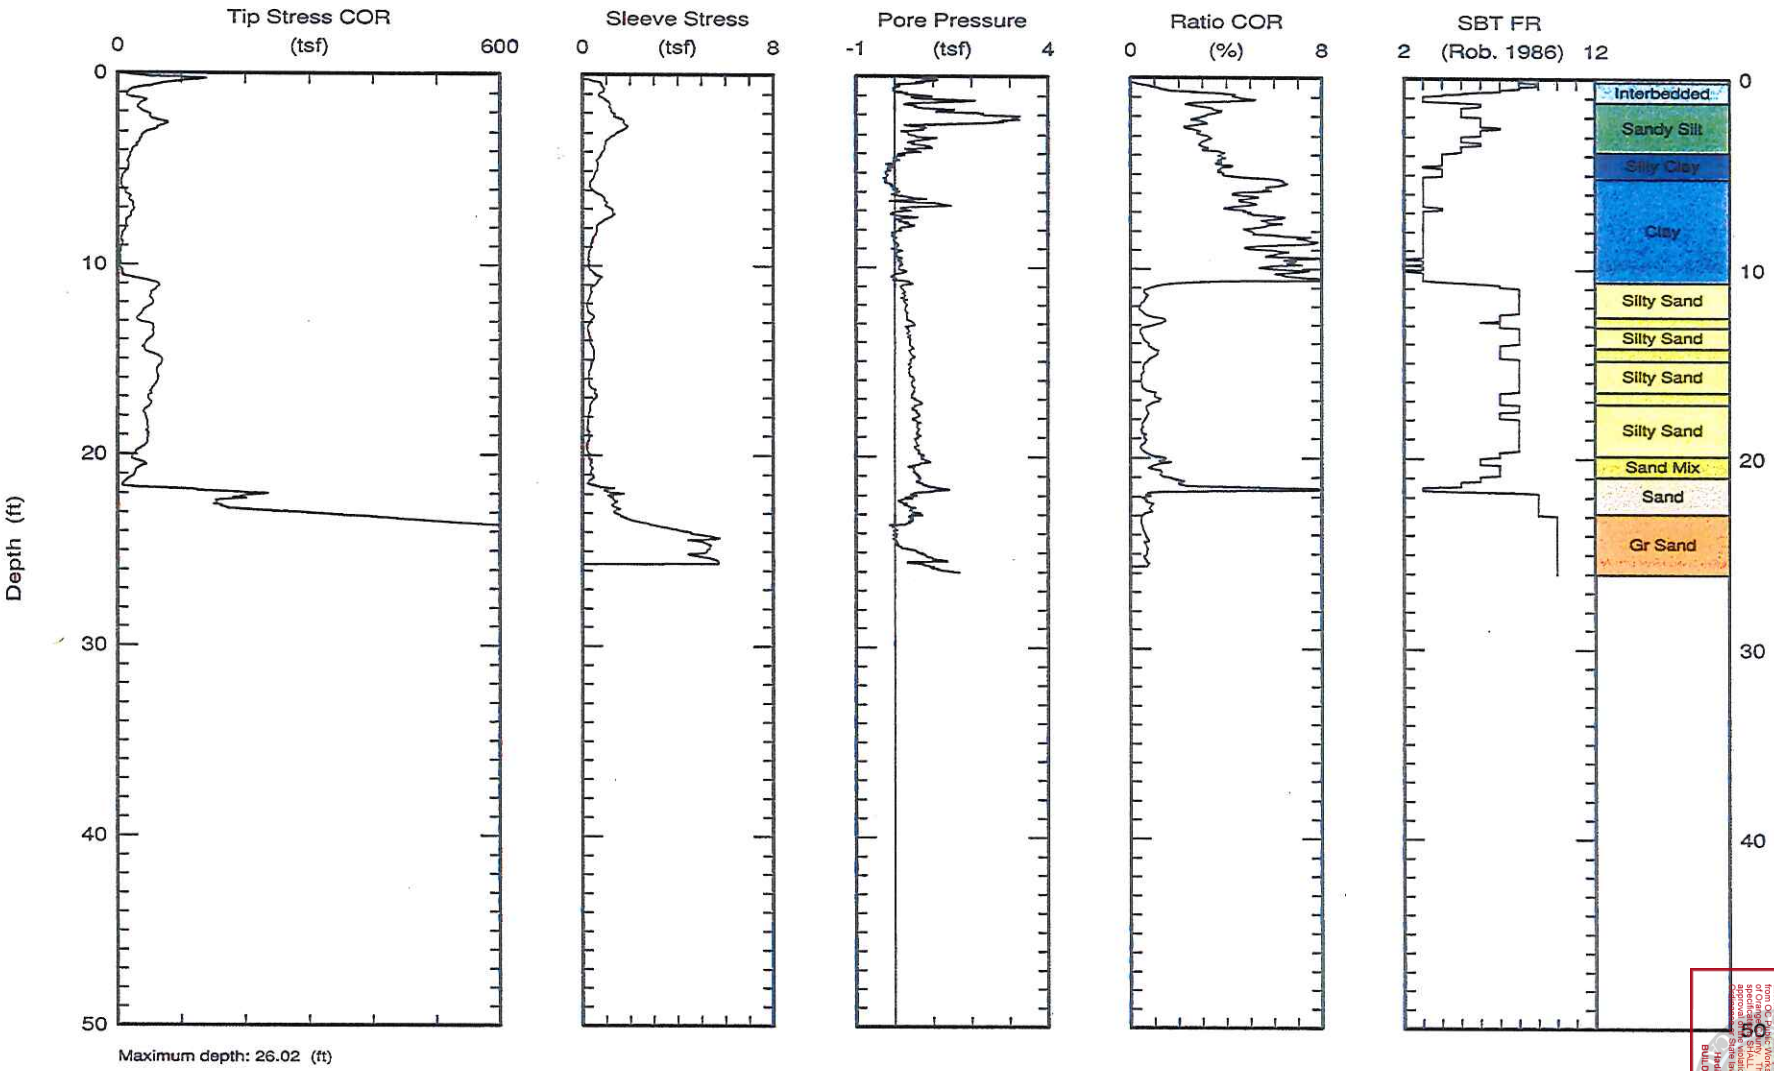

Maximum depth: 26.02 (ft)

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times. It is unlawful to make any alterations to these plans without written permission from OC Public Works, OC Development Services
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025
Hal Thornhave
BUILDING OFFICIAL

Leighton Consul.ng, Inc.

Operator: Bobby-Victor
Sounding: CPT-01
Cone Used: 468/BH-VO/R#3

CPT Date/Time: 11-15-02 08:31
Location: WRT/Dana Point
Job Number: 600027-001

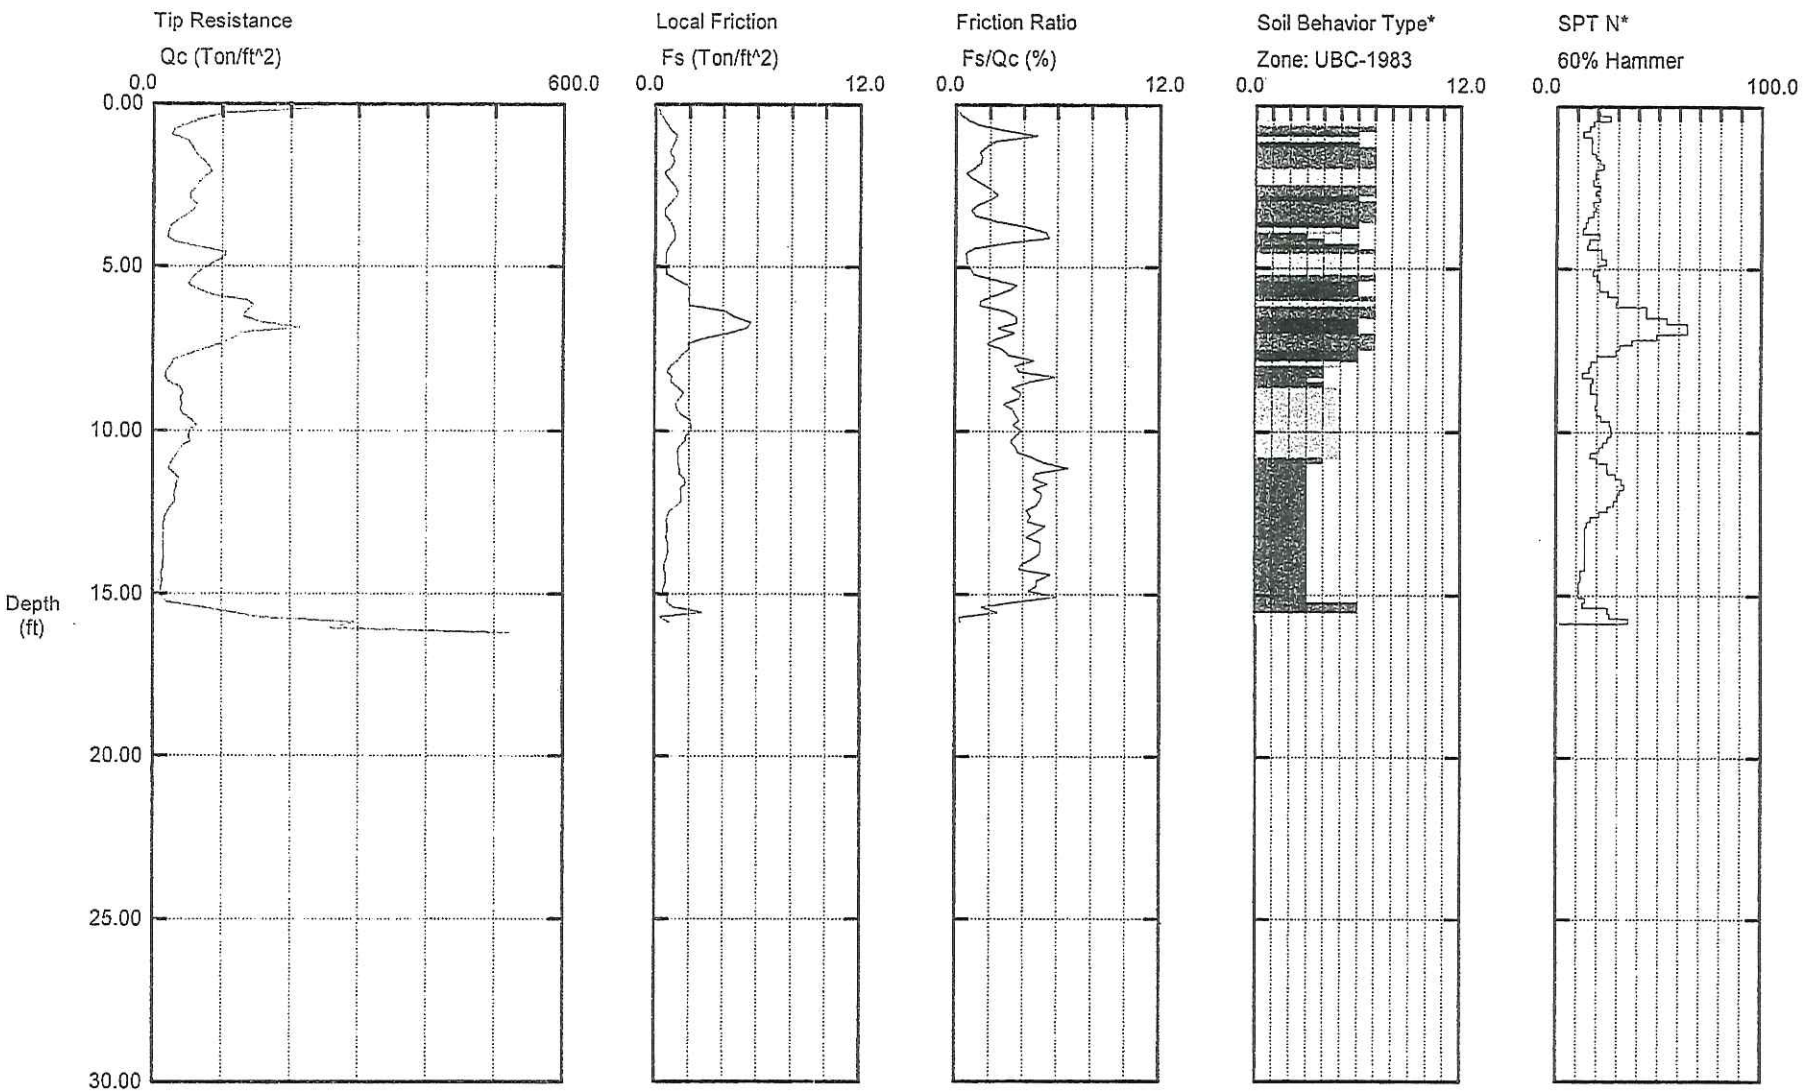

Maximum Depth = 16.24 feet

Depth Increment = 0.16 feet

1 sensitive fine grained
2 organic material
3 clay
4 silty clay to clay
5 clayey silt to silty clay
6 sandy silt to clayey silt
7 silty sand to sandy silt
8 sand to silty sand
9 sand
10 gravelly sand to sand
11 very stiff fine grained (*)
12 sand to clayey sand (*)

sdf-500

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the construction site at all times. Changes, revisions or alterations to these plans without written permission from OC Public Works/ OC Development Services may require that new plans be submitted for approval and permit. The approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hani Thanbhan
BUILDING OFFICIAL
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

Leighton Consu...ng, Inc.

Operator: Bobby-Victor
Sounding: CPT-02
Cone Used: 468/BH-VO/R#3

CPT Date/Time: 11-15-02 09:05
Location: WRT/Dana Point
Job Number: 600027-001

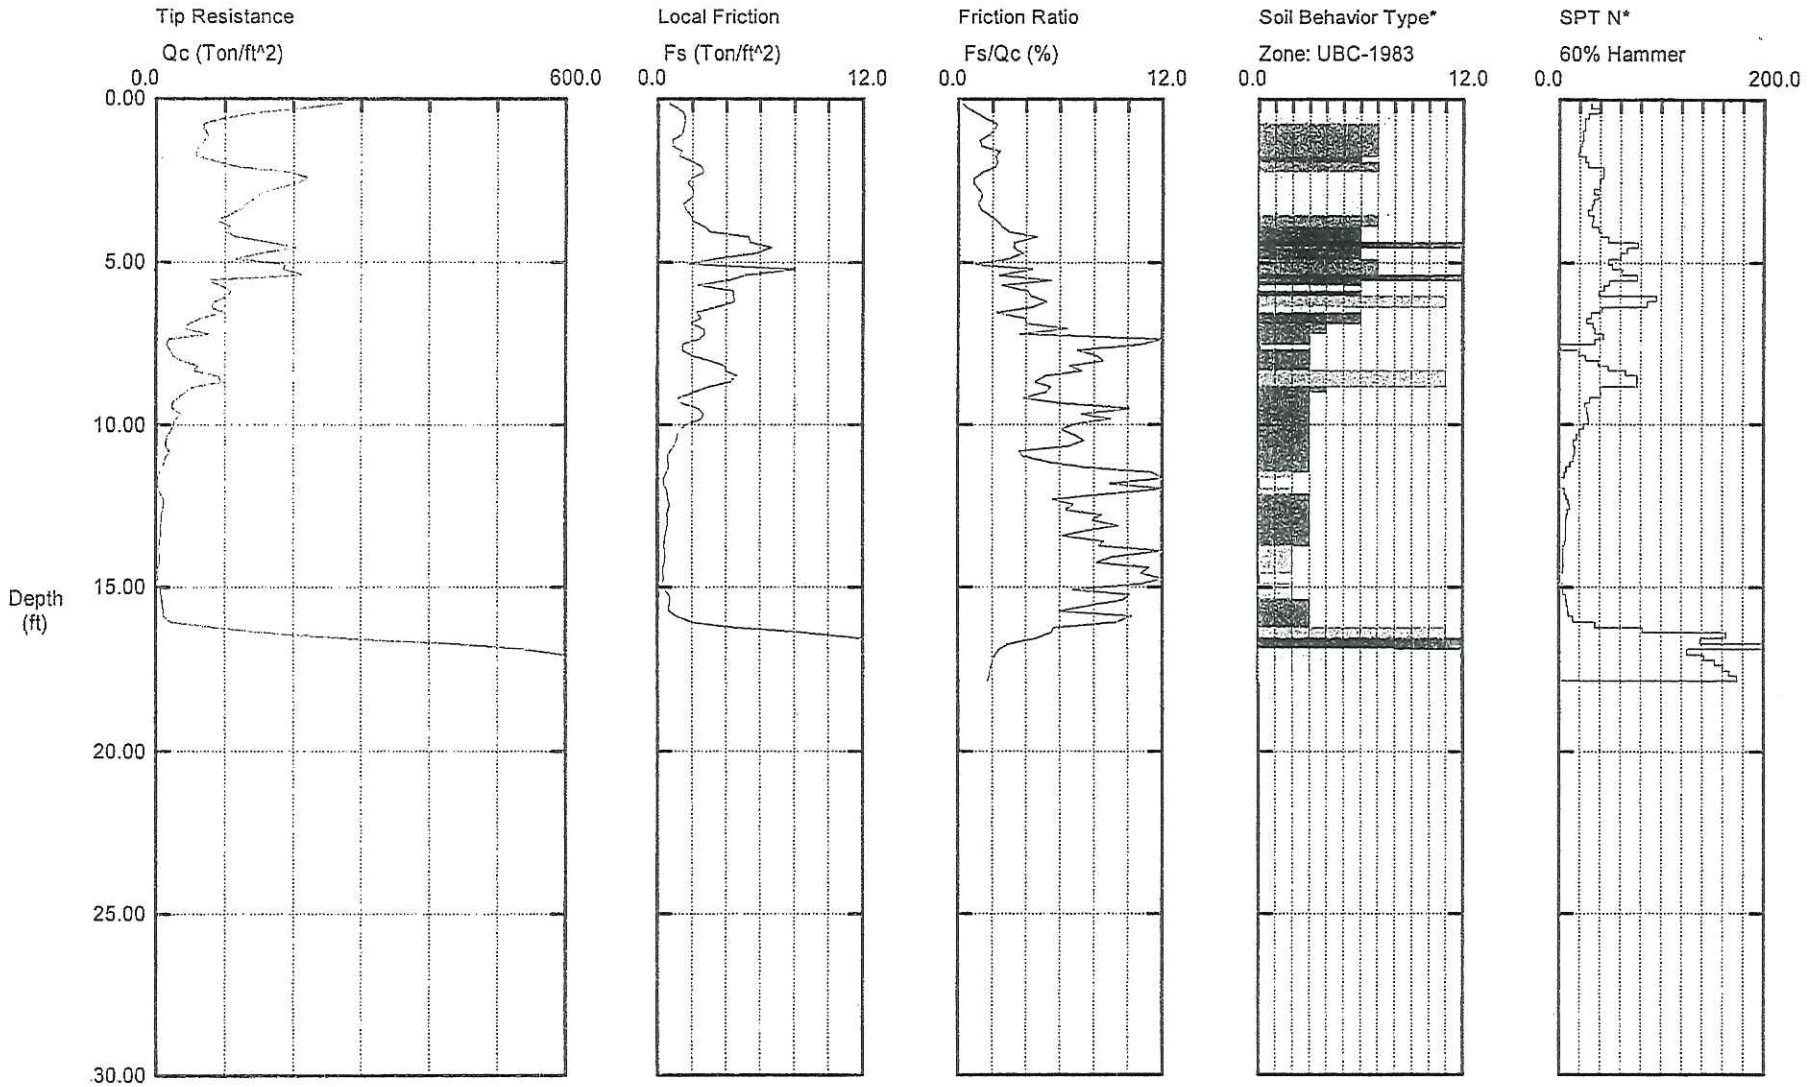

Maximum Depth = 18.21 feet

Depth Increment = 0.16 feet

1 sensitive fine grained
2 organic material
3 clay
4 silty clay to clay
5 clayey silt to silty clay
6 sandy silt to clayey silt
7 silty sand to sandy silt
8 sand to silty sand
9 sand
10 gravelly sand to sand
11 very stiff fine grained (*)
12 sand to clayey sand (*)

sdf-501

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times and it is unlawful to make any alterations to these plans without written permission from OC Public Works/ OC Development Services. Any work not in conformance with these approved plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hani Thanbhaw
BUILDING OFFICIAL
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

Leighton Consulting, Inc.

Operator: Bobby-Victor
Sounding: CPT-03
Cone Used: 468/BH-VO/R#3

CPT Date/Time: 11-15-02 09:35
Location: WRT/Dana Point
Job Number: 600027-001

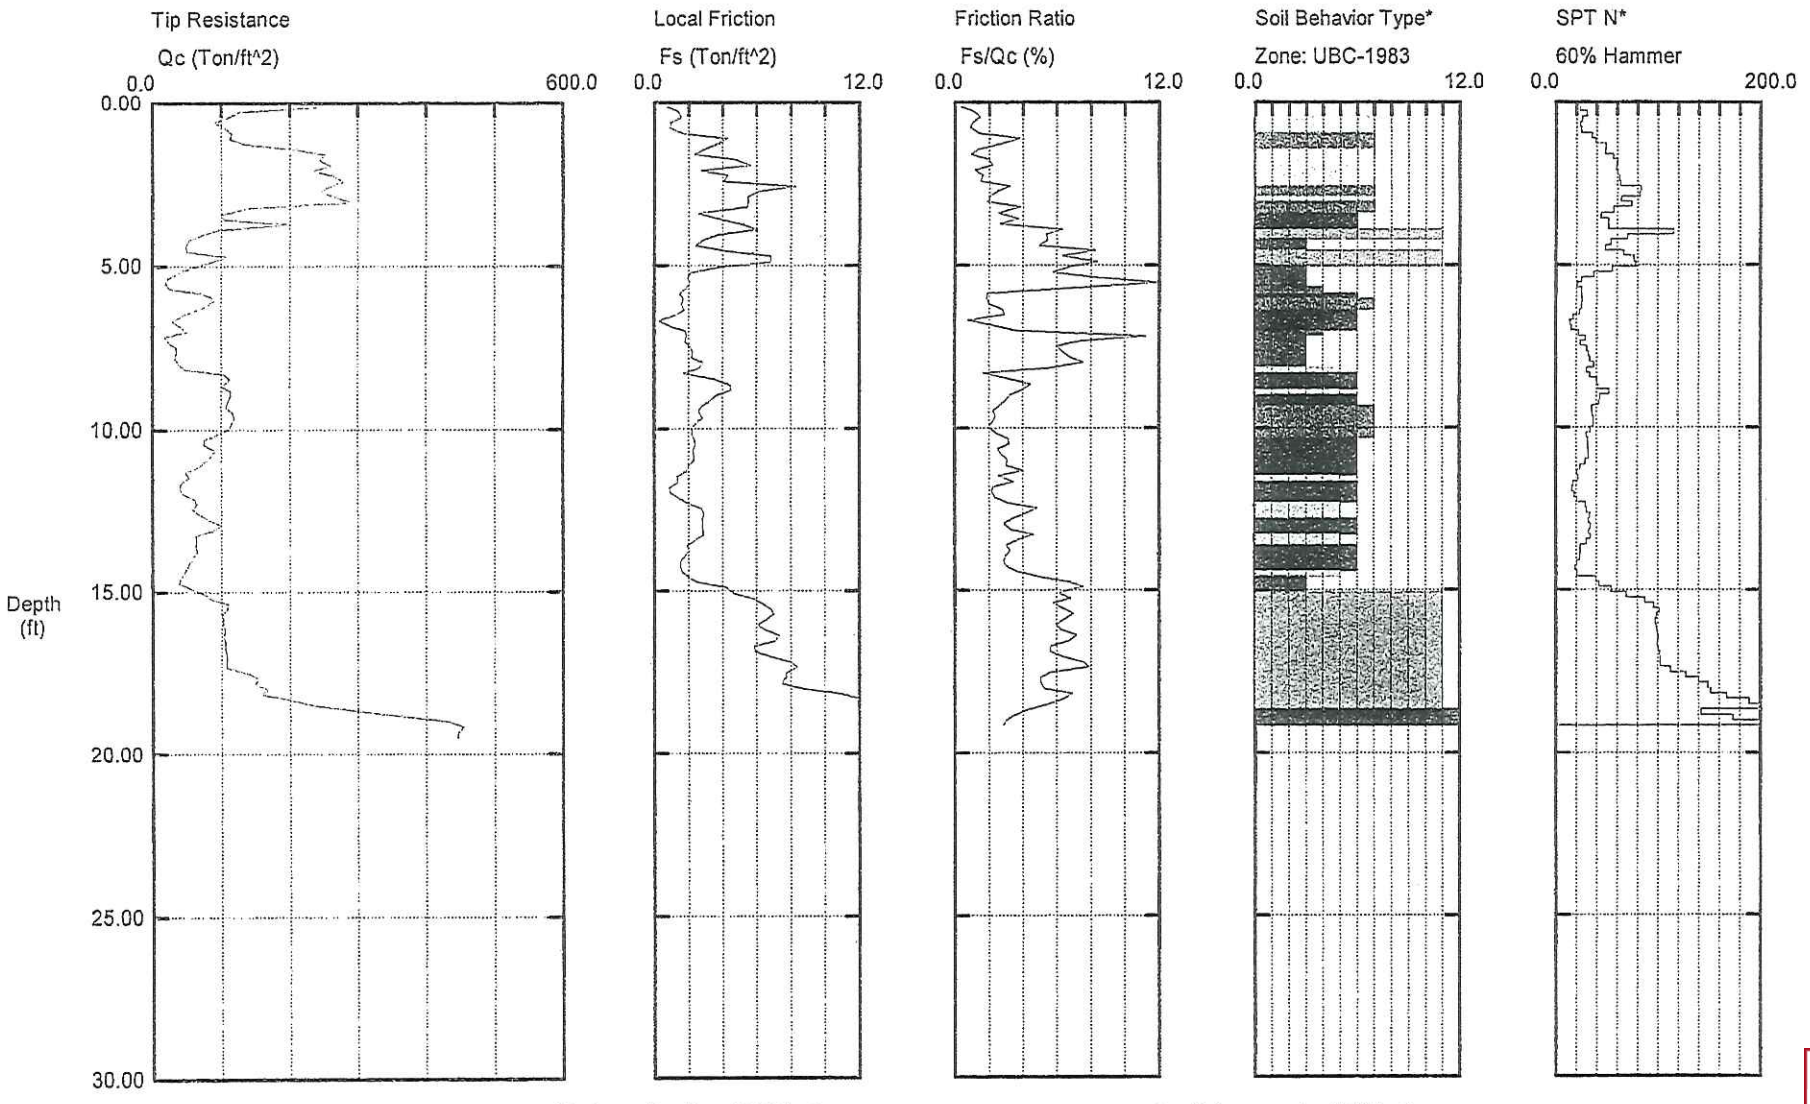

Maximum Depth = 19.52 feet

Depth Increment = 0.16 feet

1 sensitive fine grained
2 organic material
3 clay
4 silty clay to clay
5 clayey silt to silty clay
6 sandy silt to clayey silt
7 silty sand to sandy silt
8 sand to silty sand
9 sand
10 gravelly sand to sand
11 very stiff fine grained (*)
12 sand to clayey sand (*)

sdf-502

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the construction site at all times and shall not be changed, altered or deviated from without the written permission from OC Public Works/ OC Development Services. Any changes, alterations or deviations from these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hani Thanbhan
BUILDING OFFICIAL
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

il behavior type and SPT b: n data from UBC-1983

Leighton Consu..ng, Inc.

Operator: Bobby-Victor
Sounding: CPT-04A
Cone Used: 468/BH-VO/R#3

CPT Date/Time: 11-15-02 10:28
Location: WRT/Dana Point
Job Number: 600027-001

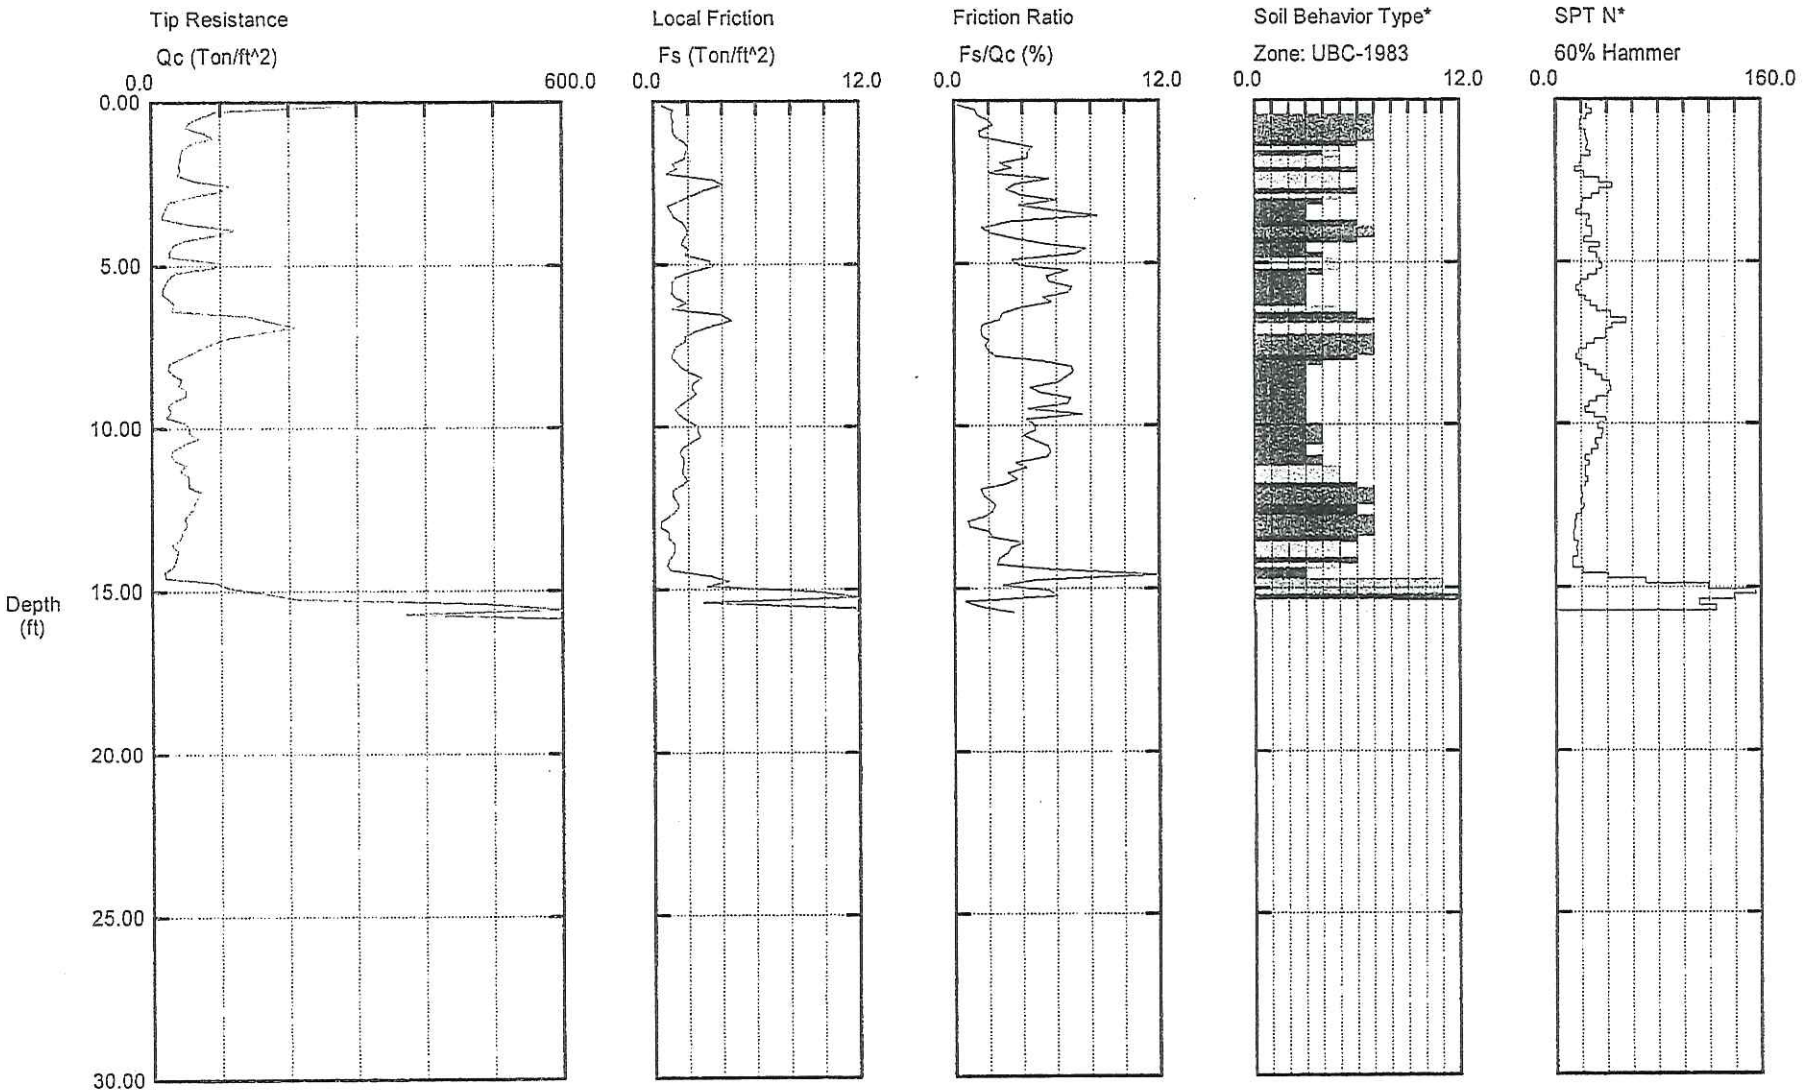

Maximum Depth = 16.08 feet

Depth Increment = 0.16 feet

1 sensitive fine grained
2 organic material
3 clay
4 silty clay to clay
5 clayey silt to silty clay
6 sandy silt to clayey silt
7 silty sand to sandy silt
8 sand to silty sand
9 sand
10 gravelly sand to sand
11 very stiff fine grained (*)
12 sand to clayey sand (*)

sdf-504

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times and it is unlawful to make any alterations to these plans without written permission from OC Public Works/ OC Development Services. Any work not in conformance with these approved plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hal Thomshen
BUILDING OFFICIAL
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

Leighton Consulting, Inc.

Operator: Bobby-Victor
Sounding: CPT-05A
Cone Used: 468/BH-VO/R#3

CPT Date/Time: 11-15-02 11:16
Location: WRT/Dana Point
Job Number: 600027-001

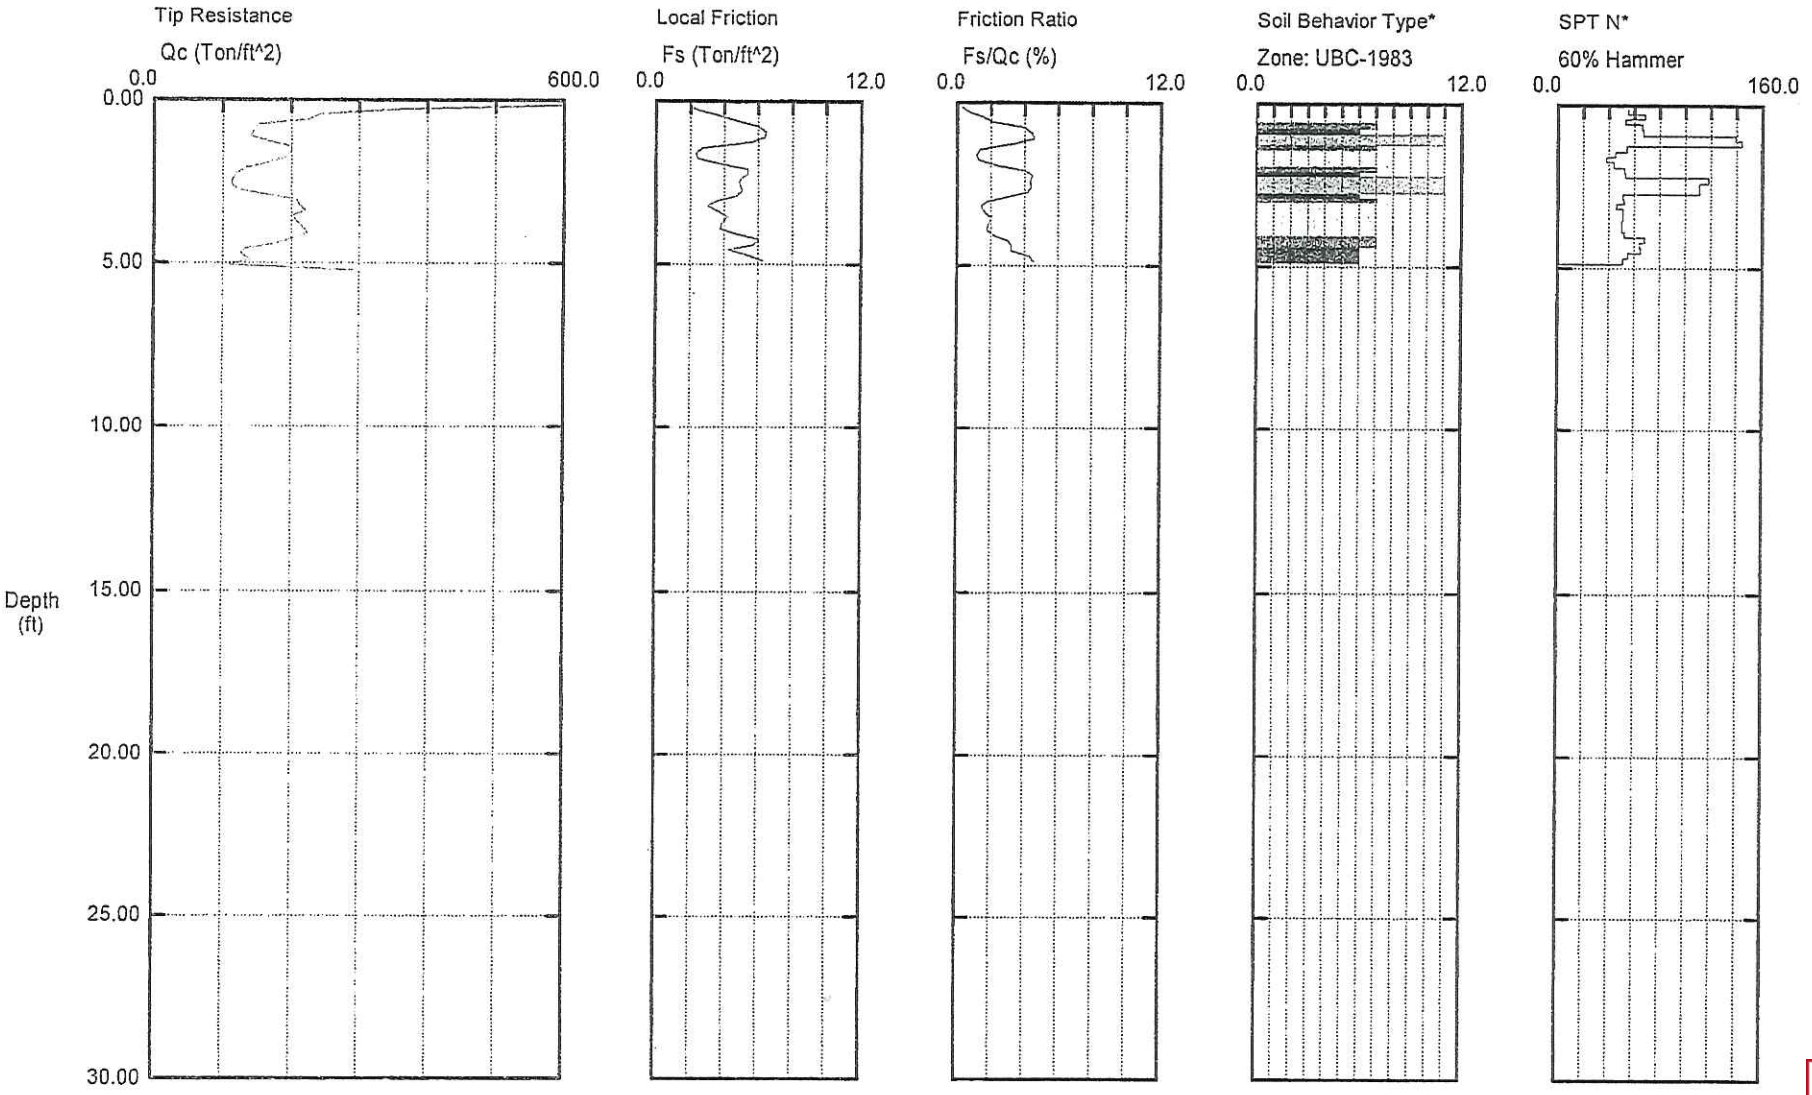

Maximum Depth = 5.25 feet

Depth Increment = 0.16 feet

1 sensitive fine grained
2 organic material
3 clay
4 silty clay to clay
5 clayey silt to silty clay
6 sandy silt to clayey silt
7 silty sand to sandy silt
8 sand to silty sand
9 sand
10 gravelly sand to sand
11 very stiff fine grained (*)
12 sand to clayey sand (*)

sdf-506

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times and it is unlawful to make any alterations to these plans without written permission from OC Public Works/ OC Development Services. The holder of this permit may be held responsible for any violation of these plans and specifications. SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or state law.
Hani Thanthawi
BUILDING OFFICIAL
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

Leighton Consulting, Inc.

Operator: Bobby-Victor
Sounding: CPT-06
Cone Used: 468/BH-VO/R#3

CPT Date/Time: 11-15-02 11:34
Location: WRT/Dana Point
Job Number: 600027-001

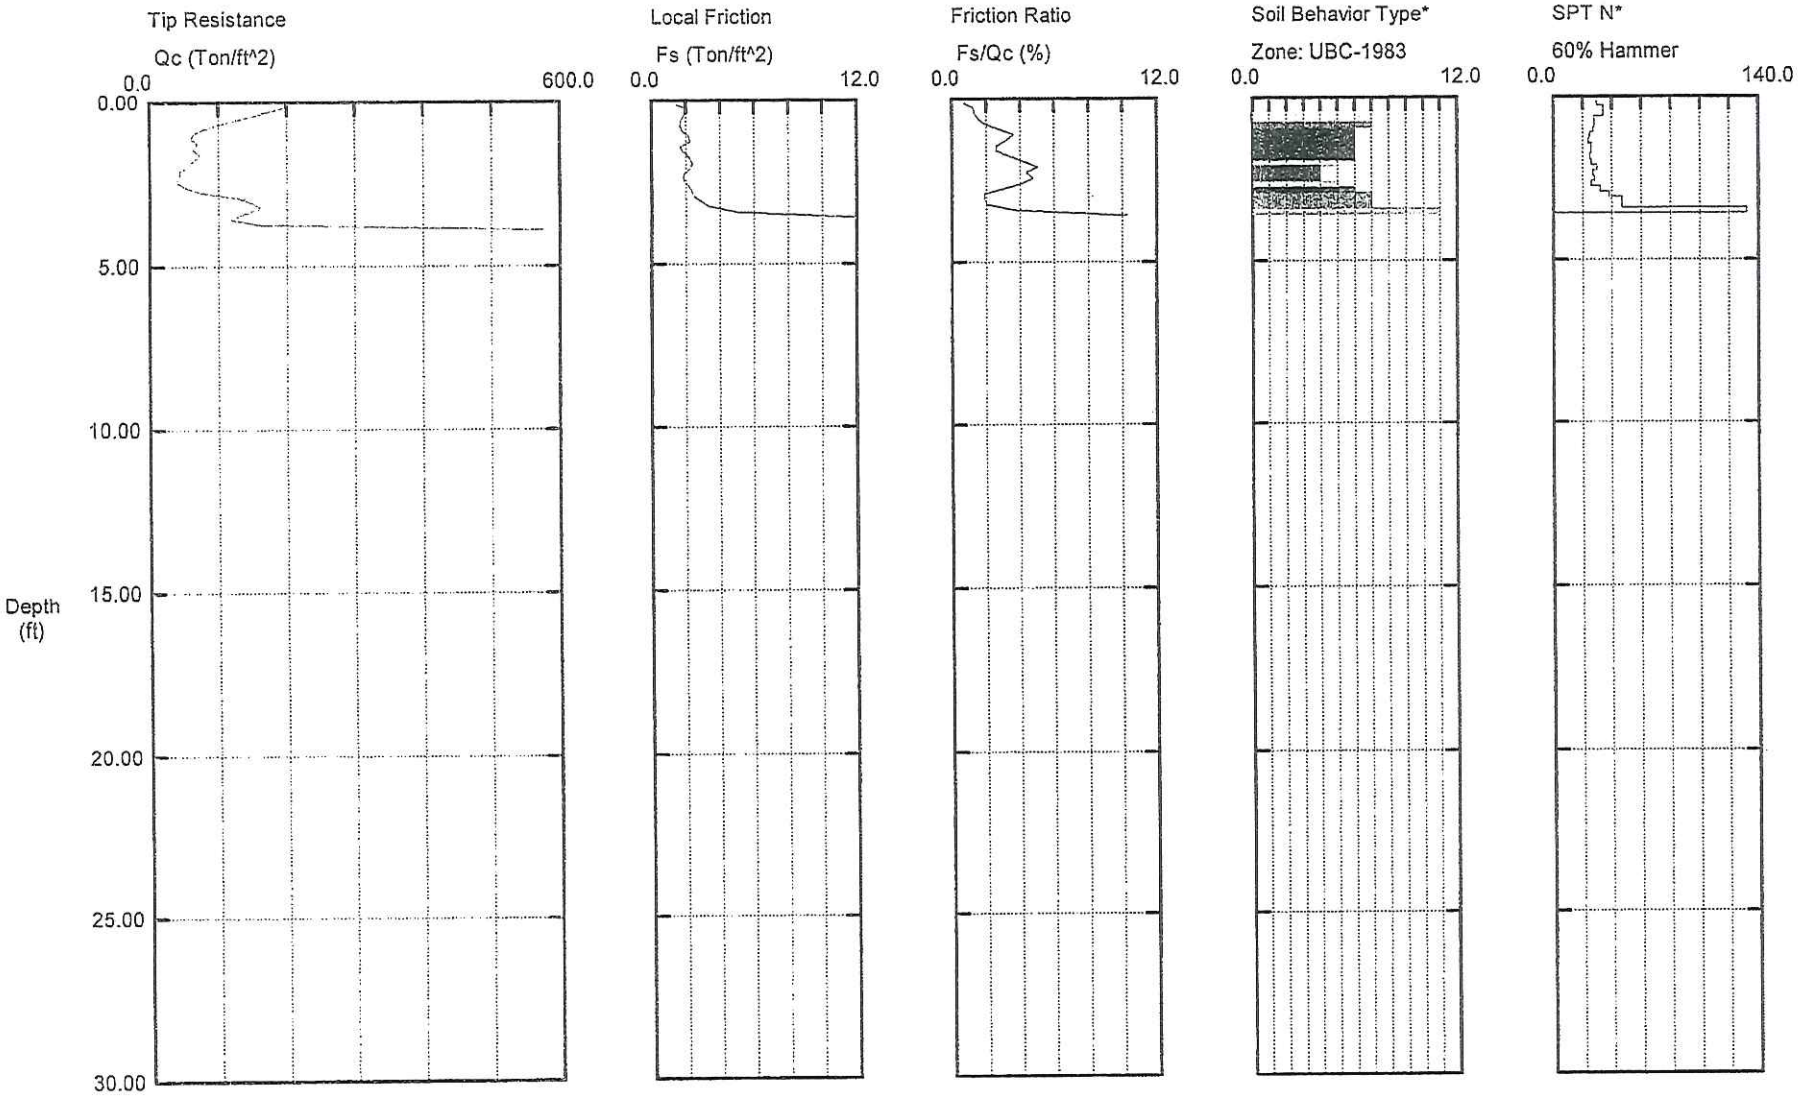

Maximum Depth = 3.94 feet

Depth Increment = 0.16 feet

1 sensitive fine grained
2 organic material
3 clay
4 silty clay to clay
5 clayey silt to silty clay
6 sandy silt to clayey silt
7 silty sand to sandy silt
8 sand to silty sand
9 sand
10 gravelly sand to sand
11 very stiff fine grained (*)
12 sand to clayey sand (*)

sdf-507

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times. It is unlawful to make any alterations to these plans without written permission from OC Public Works/ OC Development Services. Any such alterations, omissions, or deviations from these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hani Thanthawi
BUILDING OFFICIAL
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

il behavior type and SPT b n data from UBC-1983

Leighton Consulting, Inc.

Operator: Bobby-Victor
Sounding: CPT-07
Cone Used: 468/BH-VO/R#3

CPT Date/Time: 11-15-02 11:44
Location: WRT/Dana Point
Job Number: 600027-001

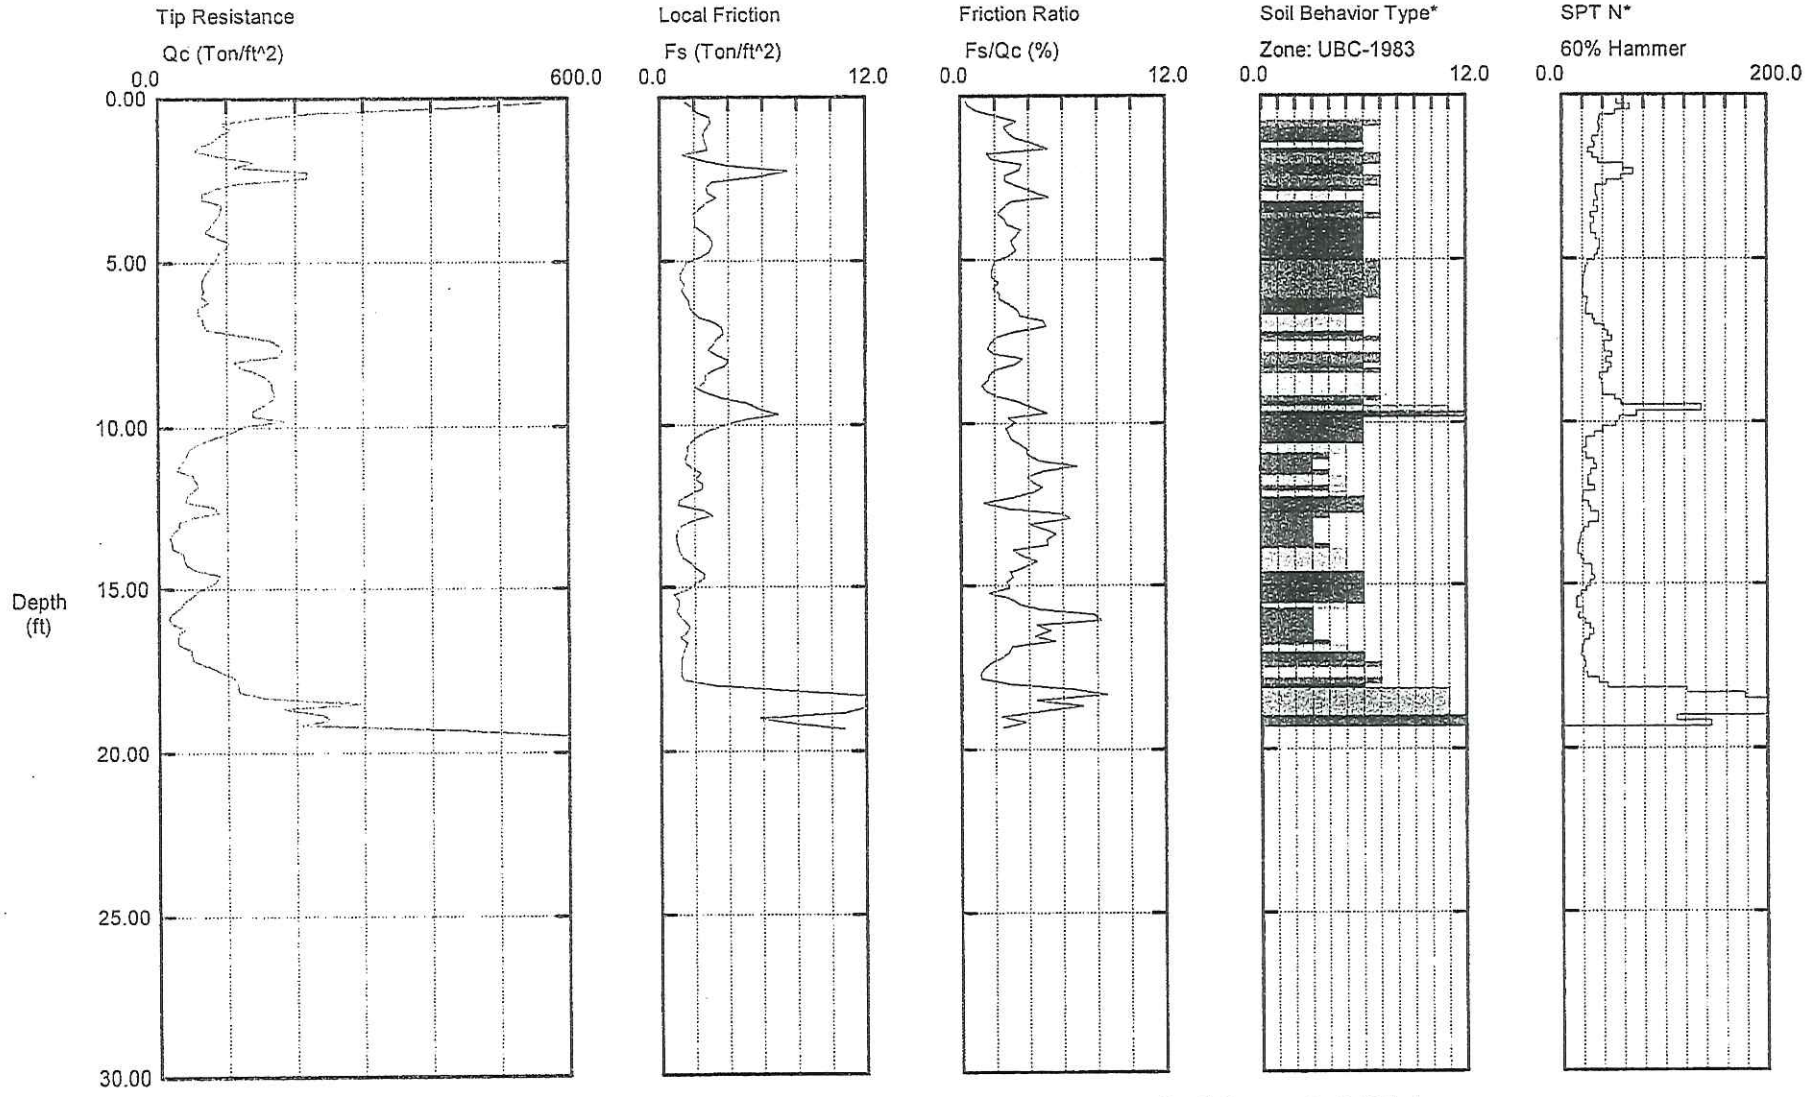

Maximum Depth = 19.69 feet

Depth Increment = 0.16 feet

1 sensitive fine grained
2 organic material
3 clay
4 silty clay to clay
5 clayey silt to silty clay
6 sandy silt to clayey silt
7 silty sand to sandy silt
8 sand to silty sand
9 sand
10 gravelly sand to sand
11 very stiff fine grained (*)
12 sand to clayey sand (*)

sdf-508

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the construction job site at all times. No changes, alterations or erasures may be made on these plans without written permission from OC Public Works/ OC Development Services. The approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hal Thomshen
BUILDING OFFICIAL
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

ı data from UBC-1983

Leighton Consu..ng, Inc.

Operator: Bobby-Victor
Sounding: CPT-08
Cone Used: 468/BH-VO/R#3

CPT Date/Time: 11-15-02 12:25
Location: WRT/Dana Point
Job Number: 600027-001

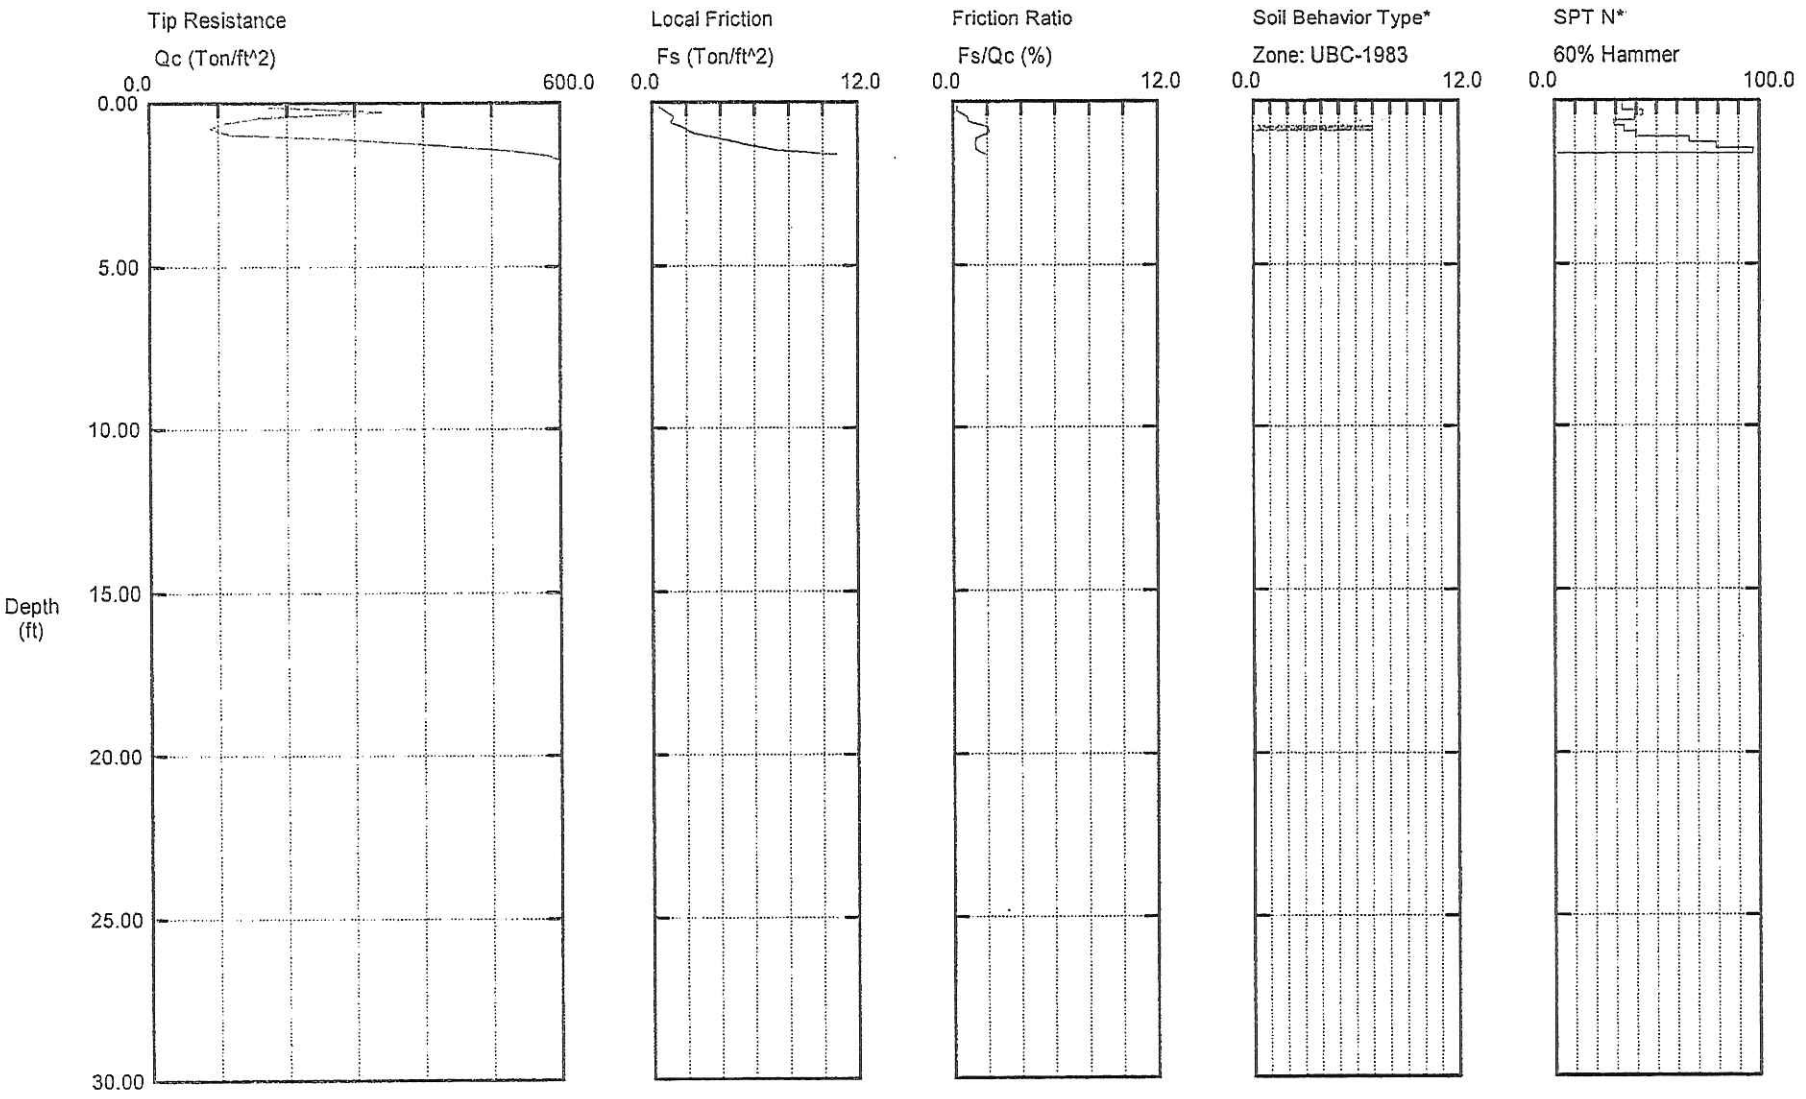

Maximum Depth = 1.97 feet

Depth Increment = 0.16 feet

1 sensitive fine grained
2 organic material
3 clay
4 silty clay to clay
5 clayey silt to silty clay
6 sandy silt to clayey silt
7 silty sand to sandy silt
8 sand to silty sand
9 sand
10 gravelly sand to sand
11 very stiff fine grained (*)
12 sand to clayey sand (*)

sdf-509

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times. It is unlawful to make any alterations to these plans without written permission from OC Public Works/ OC Development Services. Any such alterations, modifications or deviations from these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hani Thanthawi
BUILDING OFFICIAL

Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B

Recent Geotechnical Laboratory Procedures and Test Results by GMU

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B

GMU GEOTECHNICAL LABORATORY PROCEDURES AND TEST RESULTS

MOISTURE AND DENSITY

Field moisture content and in-place density were determined for each 6-inch sample sleeve of undisturbed soil material obtained from the drill holes. The field moisture content was determined in general accordance with ASTM Test Method D 2216 by obtaining one-half the moisture sample from each end of the 6-inch sleeve. The in-place dry density of the sample was determined by using the wet weight of the entire sample.

At the same time the field moisture content and in-place density were determined, the soil material at each end of the sleeve was classified according to the Unified Soil Classification System. The results of the field moisture content and in-place density determinations are presented on the right-hand column of the Log of Drill Hole and are summarized on Table B-1. The results of the visual classifications were used for general reference.

PARTICLE SIZE DISTRIBUTION

As part of the engineering classification of the materials underlying the site, samples were tested to determine the distribution of particle sizes. The distribution was determined in general accordance with ASTM Test Method D 422 using U.S. Standard Sieve Openings 3", 1.5", 3/4, 3/8, and U.S. Standard Sieve Nos. 4, 10, 20, 40, 60, 100, and 200. In addition, on some samples, a standard hydrometer test was performed to determine the distribution of particle sizes passing the No. 200 sieve (i.e., silt and clay-size particles). The results of the tests are contained in this Appendix B. Key distribution categories (% gravel; % sand, etc.) are contained on Table B-1.

ATTERBERG LIMITS

As part of the engineering classification of the soil material, a representative sample of the on-site soil material was tested to determine relative plasticity. This relative plasticity is based on the Atterberg limits determined in general accordance with ASTM Test Method D 4318. The results of these tests are contained in this Appendix B and also on Table B-1.

EXPANSION TESTS

To provide a standard definition of one-dimensional expansion, a test was performed on typical on-site materials in general accordance with ASTM Test Method D 4829. The result from this test procedure is reported as an “expansion index”. The results of this test are contained in this Appendix B and also on Table B-1.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CHEMICAL TESTS

The corrosion potential of typical on-site materials under long-term contact with both metal and concrete was determined by chemical and electrical resistance tests. The soluble sulfate test for potential concrete corrosion was performed in general accordance with California Test Method 417, the minimum resistivity test for potential metal corrosion was performed in general accordance with California Test Method 643, and the concentration of soluble chlorides was determined in general accordance with California Test Method 422. The results of these tests are contained in this Appendix B and also on Table B-1.

COMPACTION TESTS

Bulk samples representative of the on-site materials were tested to determine the maximum dry density and optimum moisture content of the soil. These compactive characteristics were determined in general accordance with ASTM Test Method D 1557. The results of this test are contained in this Appendix B and also on Table B-1.

DIRECT SHEAR STRENGTH TESTS

Direct shear tests were performed on typical on-site materials. The general philosophy and procedure of the tests were in accord with ASTM Test Method D 3080 - "Direct Shear Tests for Soils Under Consolidated Drained Conditions".

The tests are single shear tests and are performed using a sample diameter of 2.416 inches and a height of 1.00 inch. The normal load is applied by a vertical dead load system. A constant rate of strain is applied to the upper one-half of the sample until failure occurs. Shear stress is monitored by a strain gauge-type precision load cell and deflection is measured with a digital dial indicator. This data is transferred electronically to data acquisition software which plots shear strength vs. deflection. The shear strength plots are then interpreted to determine either peak or ultimate shear strengths. Residual strengths were obtained through multiple shear box reversals. A strain rate compatible with the grain size distribution of the soils was utilized. The interpreted results of these tests are shown in this Appendix B.

CONSOLIDATION TESTS

The one-dimensional consolidation properties of "undisturbed" native soil and bedrock samples were evaluated according to the provisions of ASTM Test Method D 2435. Sample diameter was 2.416 inches and sample height was 1.00 inch. Water was added during the test at approximate insitu normal loads to evaluate the potential for hydro-collapse and to produce saturation during the remainder of the testing. Consolidation readings were taken regularly during each load increment until the change in sample height was less than approximately 0.0001 inch over a two-hour period. The graphic presentation of consolidation data is a representation of volume change in axial load. As a result, both expansion and consolidation are

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

illustrated. The results of the consolidation load tests are summarized in this Appendix B and Appendix B-1.

R-VALUE TESTS

Bulk samples representative of the underlying on-site materials were tested to measure the response of a compacted sample to a vertically applied pressure under specific conditions. The R-value of a material is determined when the material is in a state of saturation such that water will be exuded from the compacted test specimen when a 16.8 kN load (2.07 MPa) is applied. The results from these test procedures are reported in Appendix B-1 and also on Table B-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TABLE B-1
SUMMARY OF SOIL LABORATORY DATA

Sample Information								Sieve/Hydrometer				Atterberg Limits			Compaction						
Boring Number	Depth, feet	Elevation, feet	Geologic Unit	USCS Group Symbol	In Situ Water Content, %	In Situ Dry Unit Weight, pcf	In Situ Satur-ation, %	Gravel, %	Sand, %	<#200, %	<2μ, %	LL	PL	PI	Maximum Dry Unit Weight, pcf	Optimum Water Content, %	Expansion Index	R-Value	pH	Sulfate (ppm)	Chloride (ppm)	Min. Resistivity (ohm/cm)
DH- 5	2.5	5.8	Af	SC	8.6	129	82															
DH- 7	2.5	4.8	Af	CL	19.6	101	80												7.6	934	336	796
DH- 8	2.5	7.8	Af	SC	11.7	125	96															
DH- 9	2.5	4.8	Af	SC	13.3	111	71															
DH-10	2.5	4.8	Af	SC	10.8	118	72															
DH-11	2.5	4.8	Af	SC	14.0	112	78															
DH-11	7.5	-0.2	Af	SC	16.5	109	84	2	76	22	7											
DH-11	10	-2.7	Af	SC	17.3	110	91															
DH-11	20	-12.7	Tc	ML	19.0	101	78															
DH-11	30	-22.7	Tc	SP	10.6	123	81															
DH-11	40	-32.7	Tc	ML	28.8	91	92															
DH-11	50	-42.7	Tc	ML	29.9	91	96															
DH-12	5	3.3	Af	SC	12.6	122	95	9	65	25												
DH-12	10	-1.7	Af	SC	19.1	109	98	0	81	18	8	28	19	9								
DH-12	20	-11.7	Tc	ML	31.1	87	91															
DH-12	30	-21.7	Tc	ML	19.2	105	89															
DH-13	2.5	14.8	Af	SC	12.8	120	91											18				
DH-14	2.5	12.8	Af	SC	11.6	124	92															
DH-16	5	3.3	Af	SC	10.6	112	60															
DH-16	7.5	0.8	Af	SC				0	88	12												
DH-16	10	-1.7	Af	SC	15.6	110	83															
DH-16	12.5	-4.2	Af	SC				2	79	19												
DH-16	15	-6.7	Tc	SP	12.8	120	89															
DH-16	25	-16.7	Tc	SP	19.0	110	99															
DH-18	5	6.3	Af	SC	14.8	111	81															

GMU_TABLE_SOIL_LAB_DATA 17-206-02 (UPDATED ELEV.).GPJ FNC.AB GWGN01.GDT 2/8/21

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TABLE B-1
SUMMARY OF SOIL LABORATORY DATA

Sample Information								Sieve/Hydrometer				Atterberg Limits			Compaction							
Boring Number	Depth, feet	Elevation, feet	Geologic Unit	USCS Group Symbol	In Situ Water Content, %	In Situ Dry Unit Weight, pcf	In Situ Satur-ation, %	Gravel, %	Sand, %	<#200, %	<2μ, %	LL	PL	PI	Maximum Dry Unit Weight, pcf	Optimum Water Content, %	Expansion Index	R-Value	pH	Sulfate (ppm)	Chloride (ppm)	Min. Resistivity (ohm/cm)
DH-20	5	7.0	Af	SC	19.1	107	92											16				
DH-21	5	6.8	Af	SC	14.9	111	79															
DH-22	5	6.0	Tc	SC	12.1	118	81															
DH-23	5	1.3	Af	SC	14.3	118	95															
DH-24	5	0.3	Af	SC	17.3																	
DH-25	2.5	8.3	Af	SC				3	61	36												
DH-25	7.5	3.3	Af	CH	13.3			1	45	53	16	50	25	25								
DH-25	10	0.8	Af	CH	17.9	109	92															
DH-26	5	6.8	Af	SC	10.0	128	89															
DH-26	10	1.8	Af	SC	14.0	113	81															
DH-27	5	2.3	Af	SC	14.3	119	96															
DH-27	10	-2.7	Af	CL	25.9																	
DH-27	15	-7.7	Tc	SP	15.9	115	97															
DH-27	25	-17.7	Tc	SP	14.8	117	96															
DH-28	5	4.3	Af	SC	14.0	113	81															
DH-28	7.5	1.8	Af	SC				1	85	15												
DH-28	10	-0.7	Af	SC	13.7	121	99															
DH-28	15	-5.7	Tc	SP	9.5	122	72															
DH-28	25	-15.7	Tc	SP	9.3	124	74															
DH-29	0	16.7	Af	CL											126.0	10.0			8.7	365	1272	439
DH-29	5	11.7	Af	CL	6.5	108	32															
DH-29	7.5	9.2	Af	CL				7	36	57												
DH-29	10	6.7	Af	CL	29.5	92	97															
DH-29	12.5	4.2	Af	CL								44	22	22								
DH-29	15	1.7	Tc	ML	22.6	100	90															

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TABLE B-1
SUMMARY OF SOIL LABORATORY DATA

Sample Information			Geologic Unit	USCS Group Symbol	In Situ Water Content, %	In Situ Dry Unit Weight, pcf	In Situ Saturation, %	Sieve/Hydrometer				Atterberg Limits			Compaction		Expansion Index	R-Value	Chemical Test Results			
Boring Number	Depth, feet	Elevation, feet						Gravel, %	Sand, %	<#200, %	<2μ, %	LL	PL	PI	Maximum Dry Unit Weight, pcf	Optimum Water Content, %			pH	Sulfate (ppm)	Chloride (ppm)	Min. Resistivity (ohm/cm)
DH-29	25	-8.3	Tc	ML	20.9	106	99															
DH-34	0	15.4	Af	SM											127.5	10.0						
DH-34	5	10.4	Af	CL	18.7																	
DH-34	10	5.4	Af	CL	12.7																	
DH-34	25	-9.6	Tc	SP	22.8	101	95															
DH-35	0	16.8	Af	CL											129.5	9.0	29		7.9	1763	792	457
DH-35	5	11.8	Af	CL	27.4	92	92															
DH-35	10	6.8	Af	CL	22.4	102	95															
DH-35	15	1.8	Tc	SP	13.1	113	76															
DH-35	25	-8.2	Tc	ML	21.4	105	99															
DH-46	5	8.0	Af	SM	11.1	118	73															
DH-46	10	3.0	Af	SC	13.9	114	81															
DH-46	15	-2.0	Tc	SP	16.2	116	99															
DH-51	0	NA	Qaf	CL	13.4										128.5	9.0	64		7.8	1205	984	800
DH-51	2	NA	Qaf	CL	23.1	102	98															
DH-51	5	NA	Qaf	CL	28.1	94	97															
DH-51	10	NA	Qm	CL	30.6	89	94					47	22	25								
DH-51	15	NA	Qm	CH	29.2			1	33	66	24	52	21	31								
DH-51	20	NA	Qm	CH	21.7	100	88					51	22	29								
DH-51	30	NA	Tc	SM	18.7	110	100															

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinances or Section.
Hadi Tabatabaei
BUILDING OFFICIAL

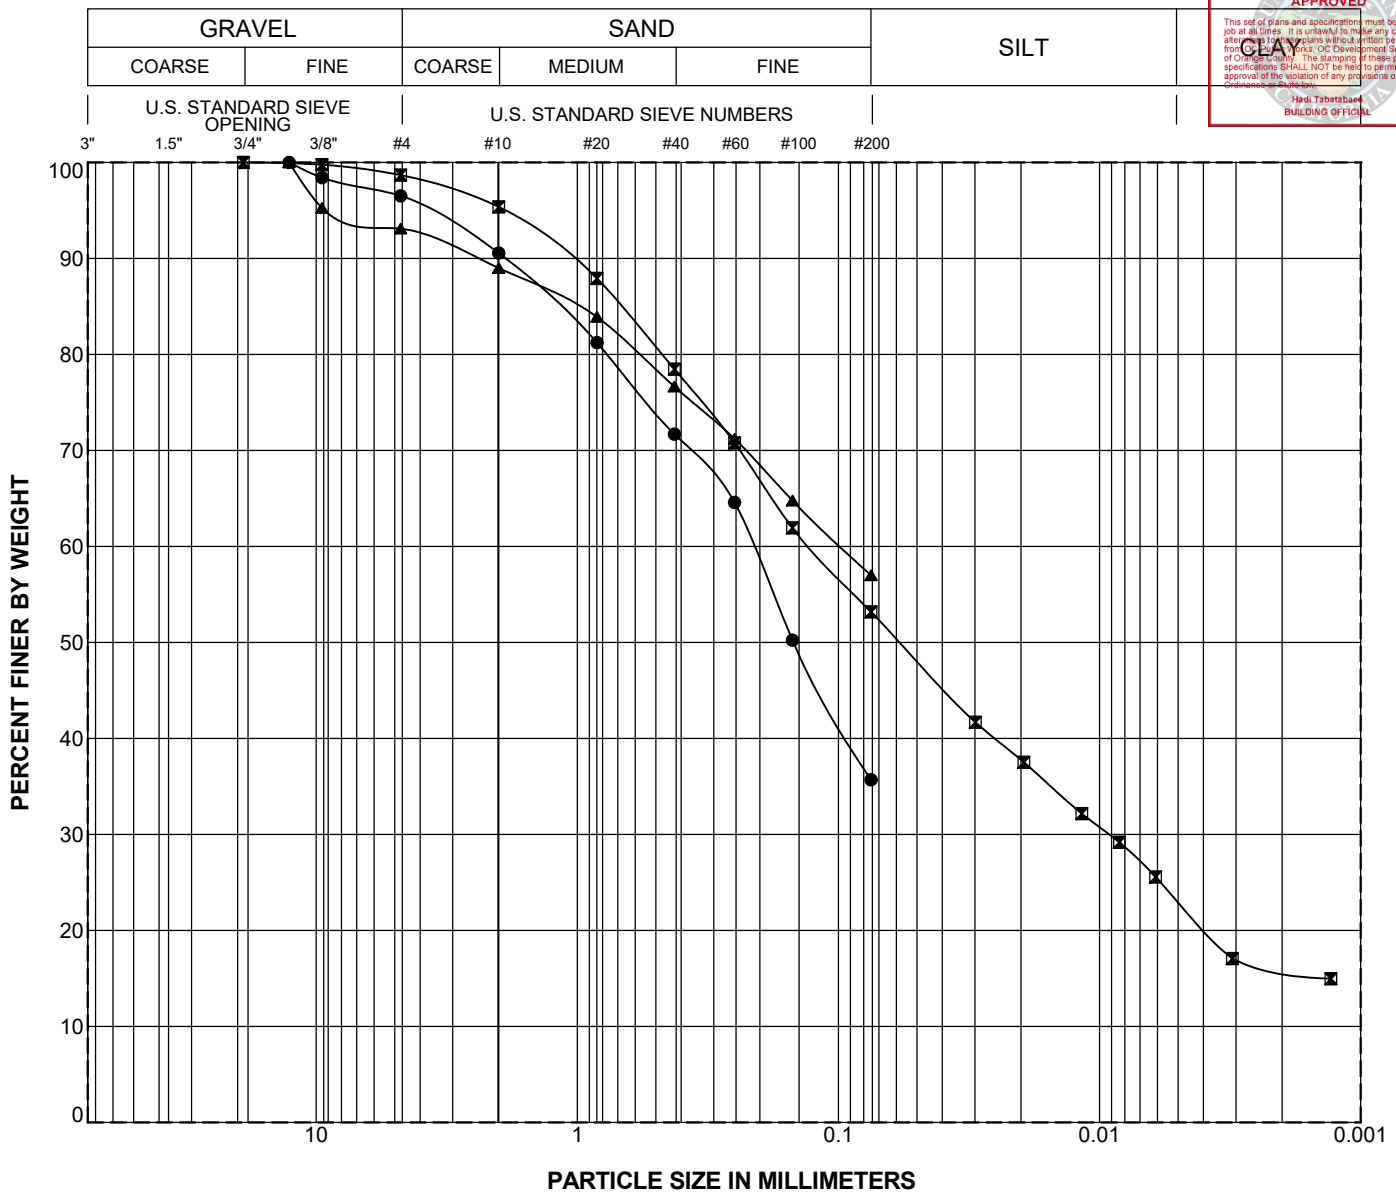

Boring Number	Depth (feet)	Geologic Unit	Symbol	LL	PI	Classification
DH-25	2.5	Af	●			CLAYEY SAND (SC)
DH-25	7.5	Af	⊠	50	25	SANDY FAT CLAY (CH)
DH-29	7.5	Af	▲			SANDY CLAY (CL)

GMU_GRAIN_SIZE 17-206-02 (UPDATED ELEV.).GPJ 11/26/19

PARTICLE SIZE DISTRIBUTION

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job site at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

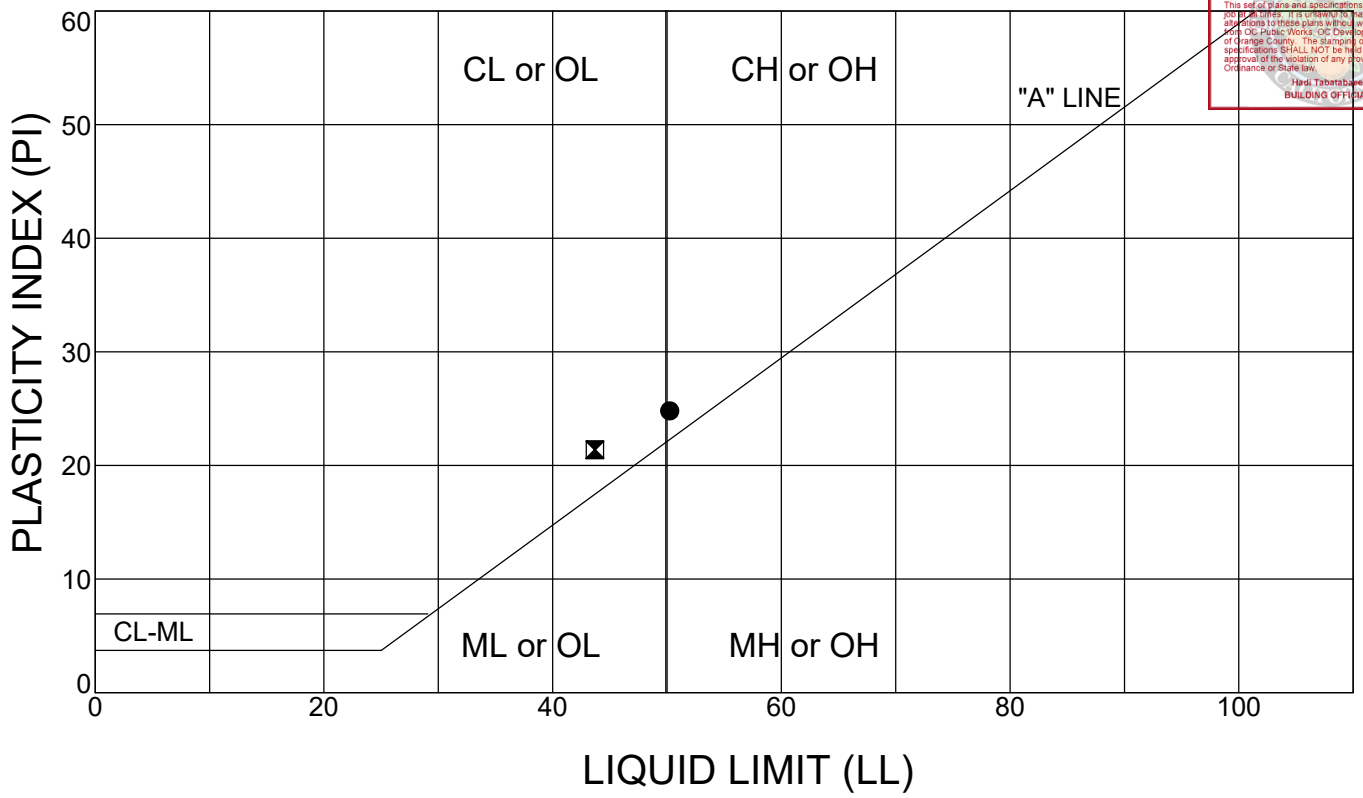

Boring Number	Depth (feet)	Geologic Unit	Test Symbol	Insitu Water Content (%)	LL	PL	PI	Classification
DH-25	7.5	Af	●	13	50	25	25	SANDY FAT CLAY (CH)
DH-29	12.5	Af	⊠		44	22	22	SANDY CLAY (CL)

LIMITS 17-206-02 (UPDATED ELEV.).GPJ 11/26/19

ATTERBERG LIMITS

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or Subdivision.
Hadi Tabatabaee
BUILDING OFFICIAL

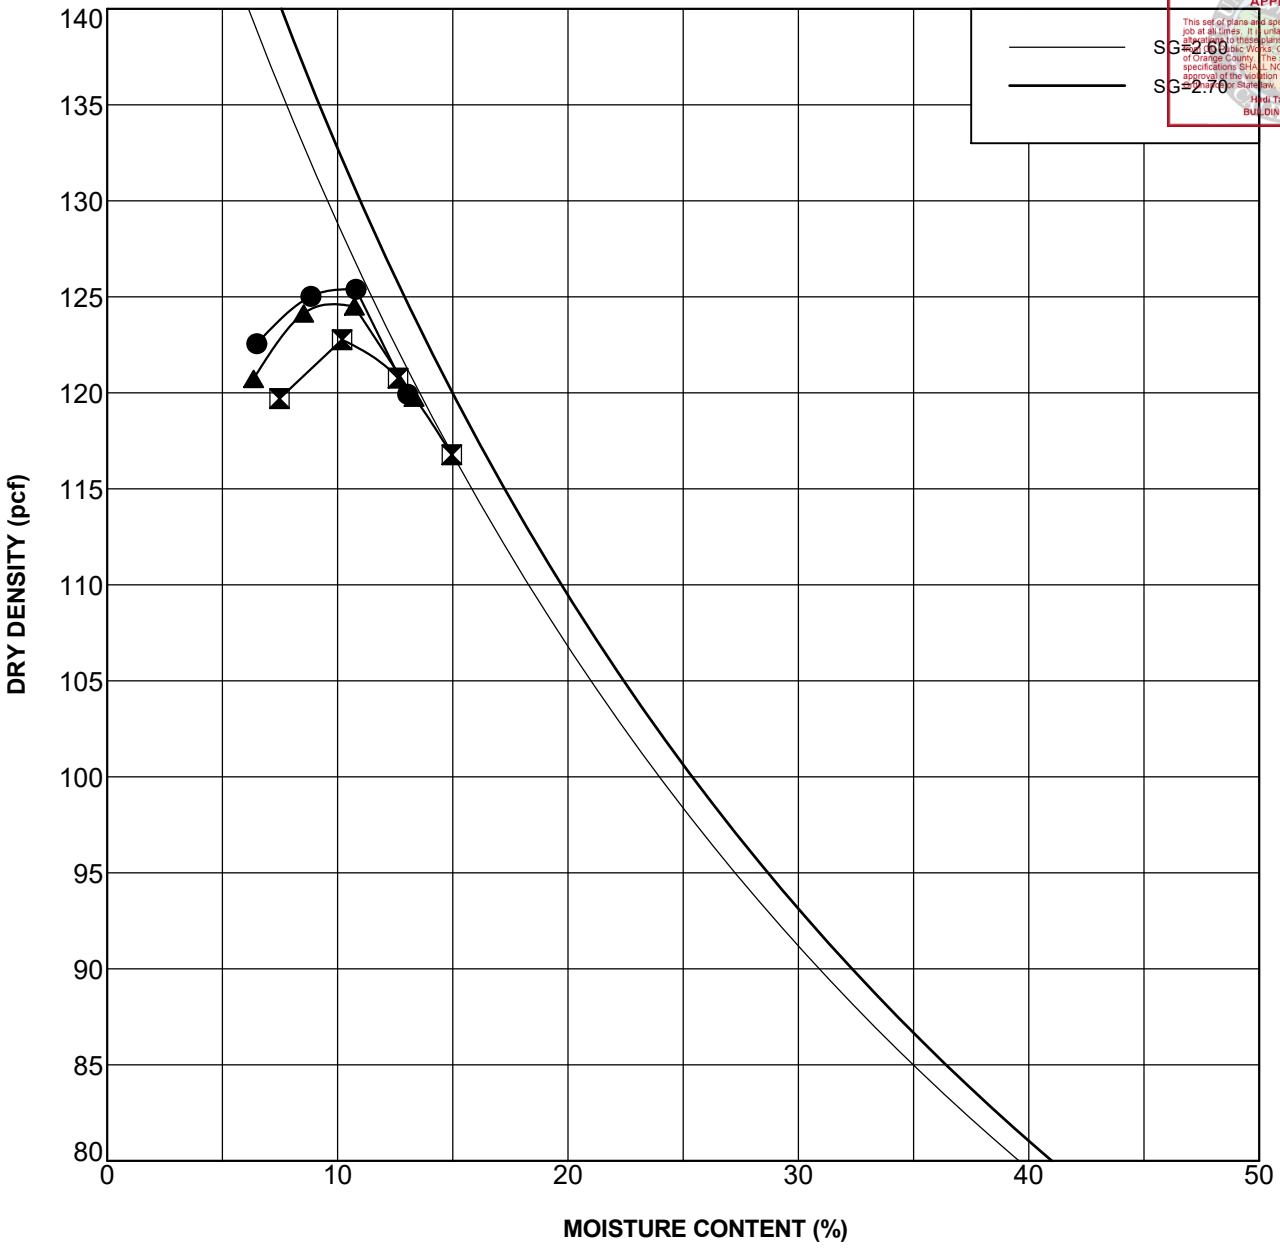

Boring Number	Depth (feet)	Geologic Unit	Symbol	Maximum Dry Density, pcf	Optimum Moisture Content, %	Classification
DH-29	0.0	Af	●	126	10	SANDY CLAY (CL)
DH-34	0.0	Af	⊠	127.5	10	SILTY SAND (SM)
DH-35	0.0	Af	▲	129.5	9	SANDY CLAY (CL)

COMPACTION TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

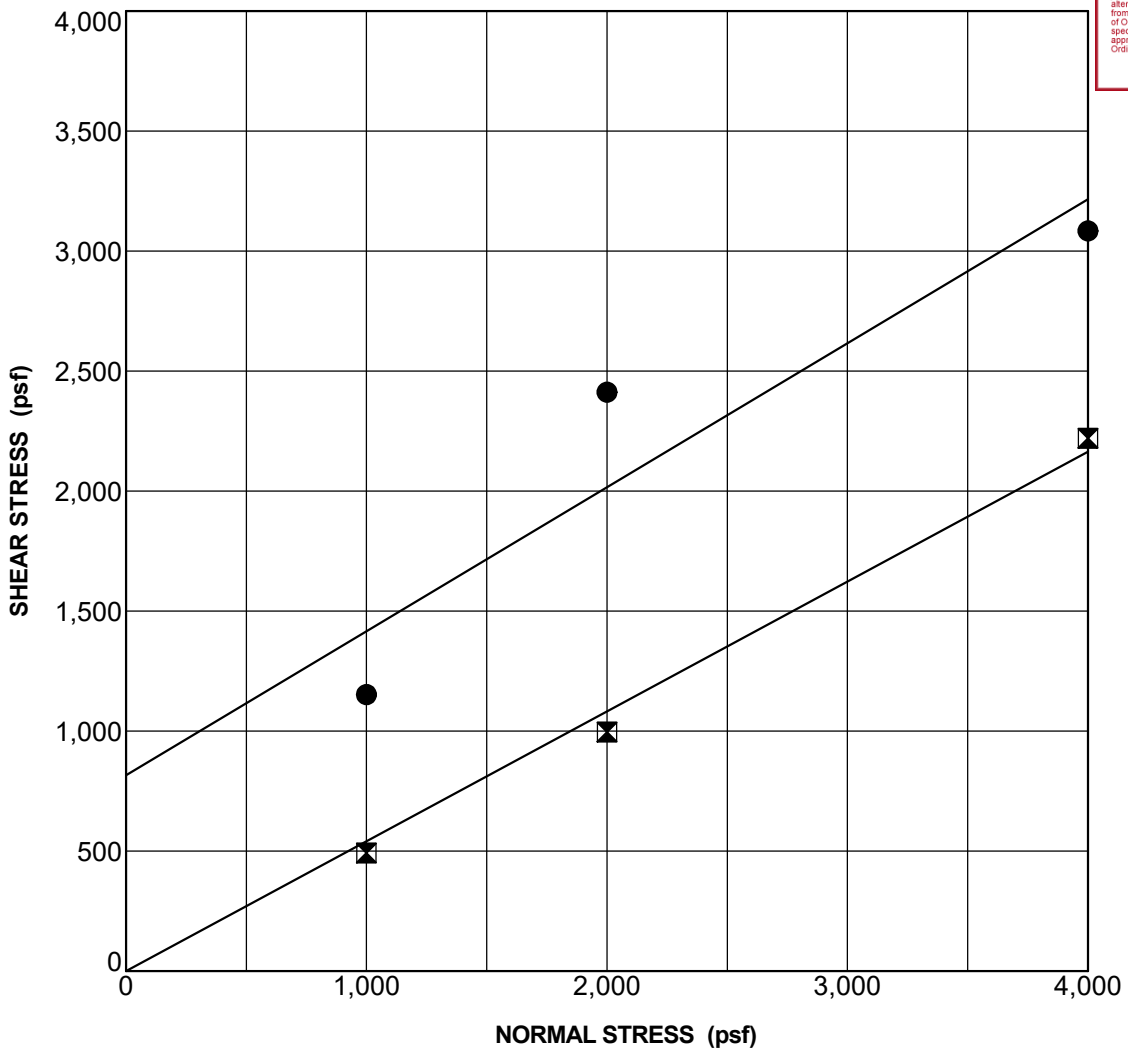

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-11 @ 2.5 ft **Geologic Unit:** Af **Classification:** CLAYEY SAND (SC)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes: Sample saturated prior and during shearing

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	816	31.0
⊠ Ultimate Strength	0	28.0

SHEAR TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

GMU_DIRECT_SHEAR 17-206-02 (UPDATED ELEV.).GPJ GM&U.GDT 11/25/19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

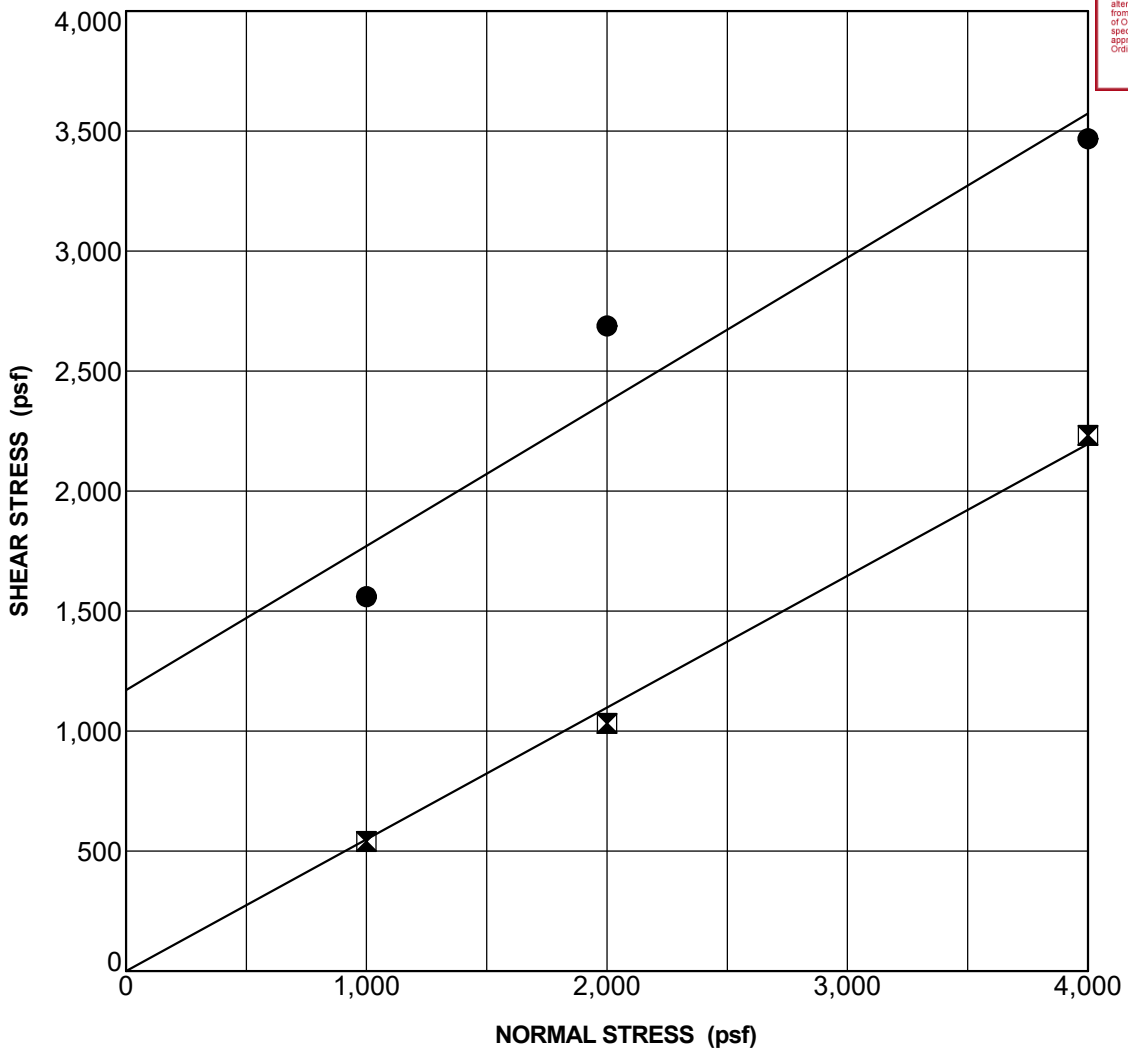

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-11 @ 20.0 ft **Geologic Unit:** Tc **Classification:** CLAYEY SILT (ML)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes: Sample saturated prior and during shearing

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	1170	31.0
⊠ Ultimate Strength	0	29.0

SHEAR TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

GMU_DIRECT_SHEAR 17-206-02 (UPDATED ELEV.).GPJ GM&U.GDT 11/25/19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

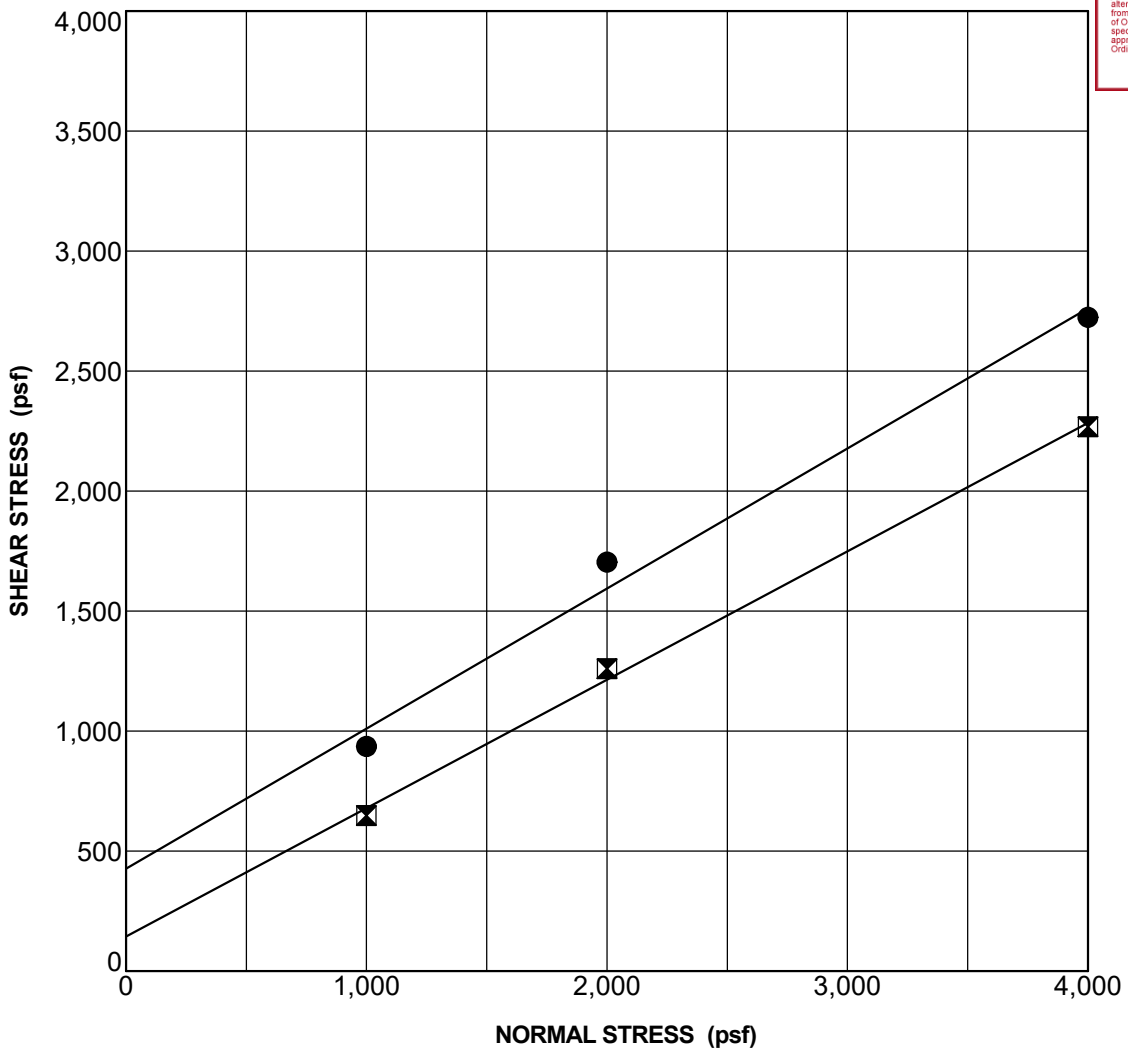

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-12 @ 10.0 ft **Geologic Unit:** Af **Classification:** CLAYEY SAND (SC)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes: Sample saturated prior and during shearing

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	426	30.0
⊠ Ultimate Strength	144	28.0

SHEAR TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

GMU_DIRECT_SHEAR 17-206-02 (UPDATED ELEV.).GPJ GM&U.GDT 11/25/19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

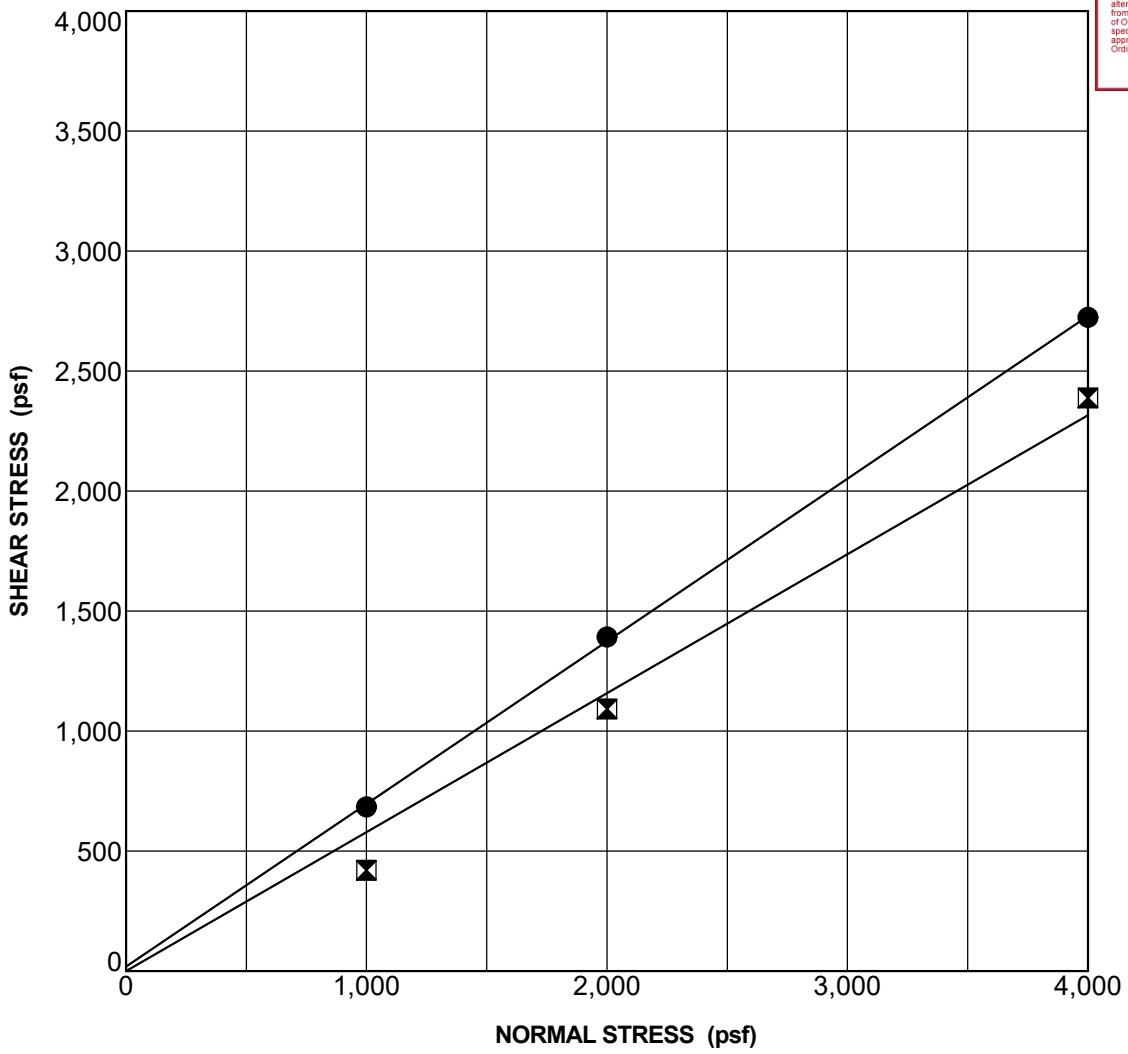

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-21 @ 5.0 ft **Geologic Unit:** Af **Classification:** CLAYEY SAND (SC)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes: Sample saturated prior and during shearing

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	18	34.0
⊠ Ultimate Strength	0	30.0

SHEAR TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

GMU_DIRECT_SHEAR 17-206-02 (UPDATED ELEV.).GPJ GM&U.GDT 11/25/19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

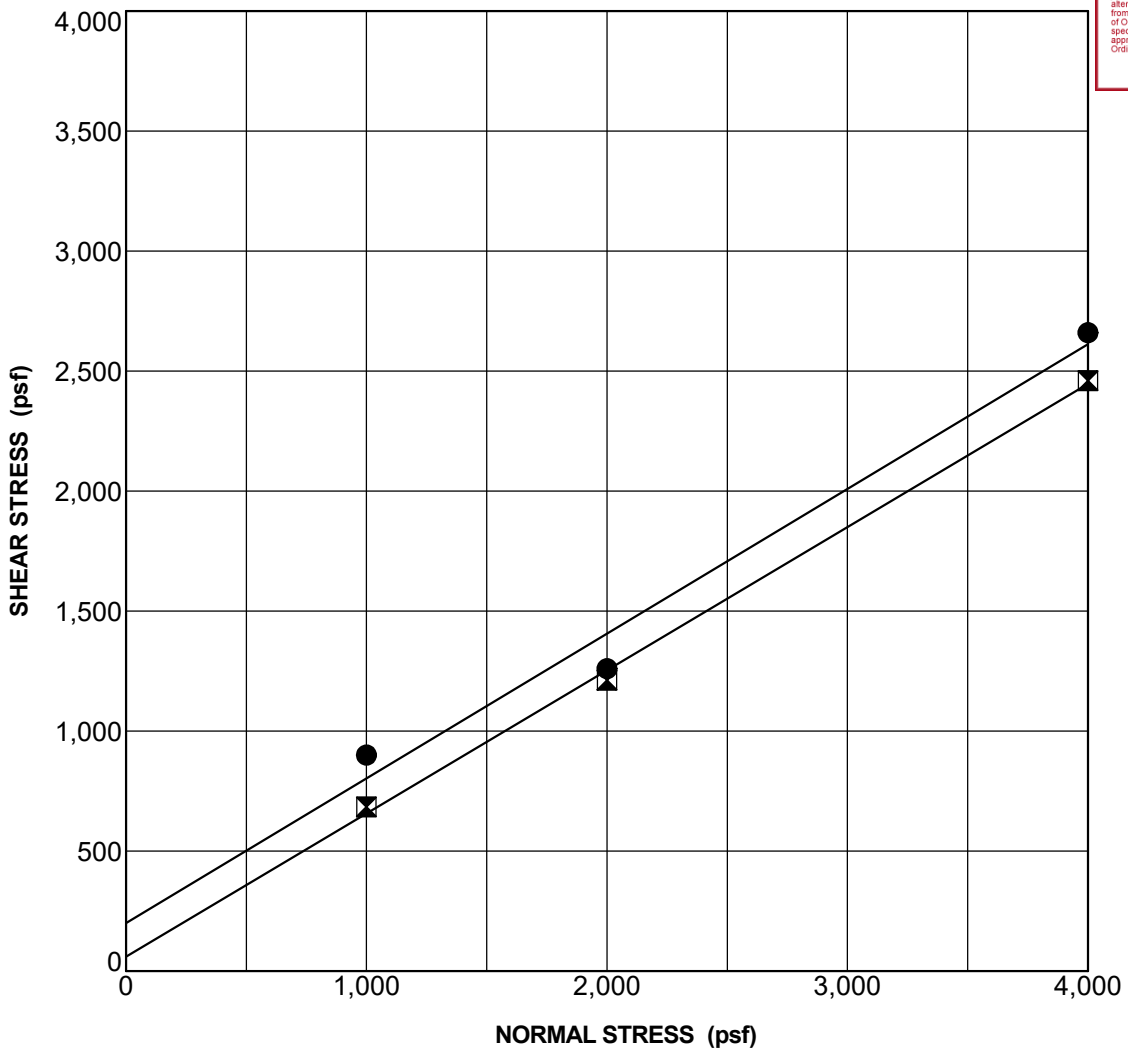

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-29 @ 0.0 ft **Geologic Unit:** Af **Classification:** SANDY CLAY (CL)
Strain Rate (in/min): 0.005 **Sample Preparation:** Remolded
Notes: 90% Compaction at optimum

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	200	31.0
⊠ Ultimate Strength	60	30.8

SHEAR TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

GMU_DIRECT_SHEAR 17-206-02 (UPDATED ELEV.).GPJ GM&U.GDT 11/25/19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

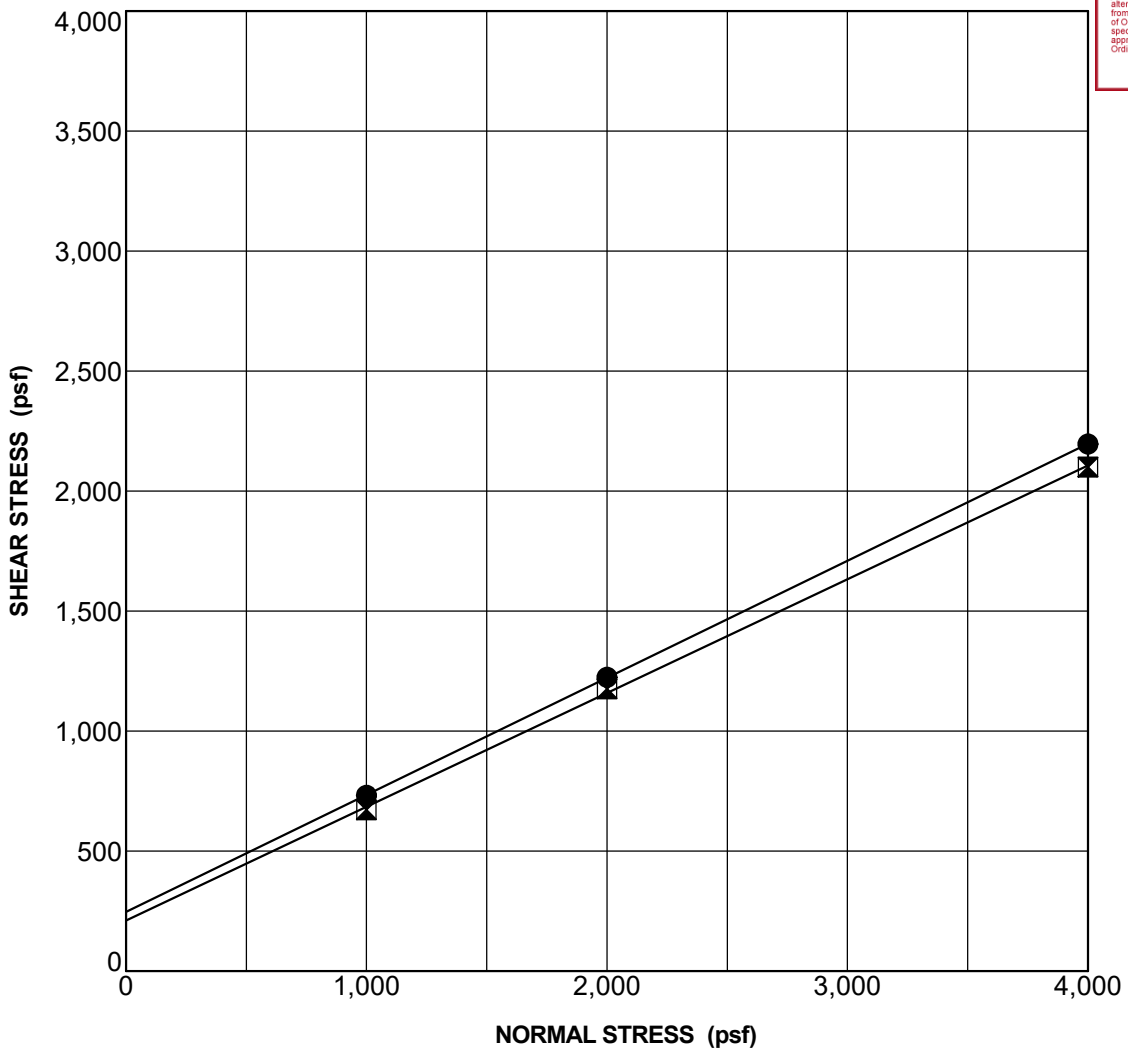

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-34 @ 0.0 ft **Geologic Unit:** Af **Classification:** SILTY SAND (SM)
Strain Rate (in/min): 0.005 **Sample Preparation:** Remolded
Notes: 90% Compaction at optimum

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	246	26.0
⊠ Ultimate Strength	210	25.0

SHEAR TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

GMU_DIRECT_SHEAR 17-206-02 (UPDATED ELEV.).GPJ GM&U.GDT 11/25/19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

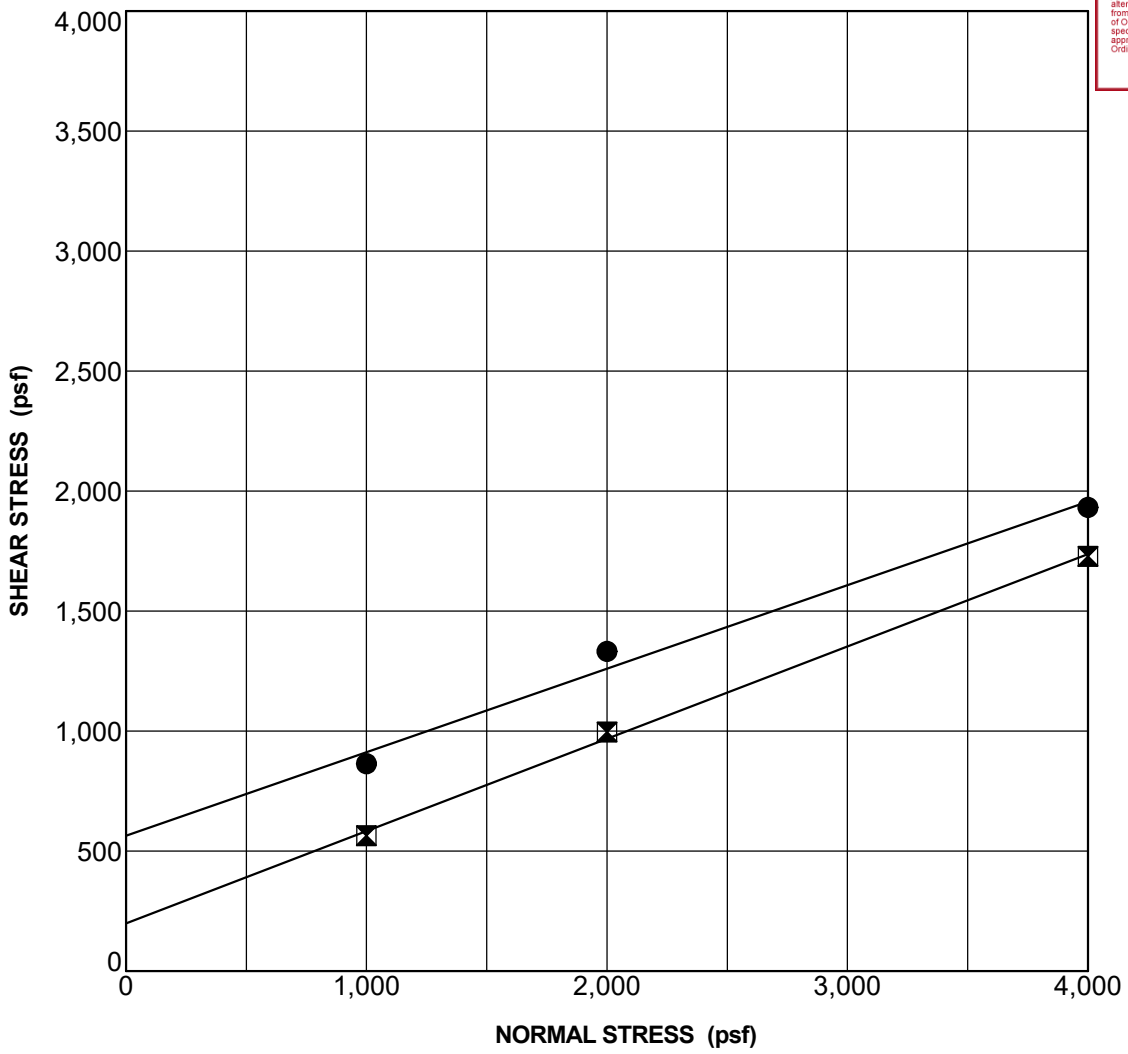

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-35 @ 5.0 ft **Geologic Unit:** Af **Classification:** SANDY CLAY (CL)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes: Sample saturated prior and during shearing

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	564	19.0
⊠ Ultimate Strength	198	21.0

SHEAR TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

GMU_DIRECT_SHEAR 17-206-02 (UPDATED ELEV.).GPJ GM&U.GDT 11/25/19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

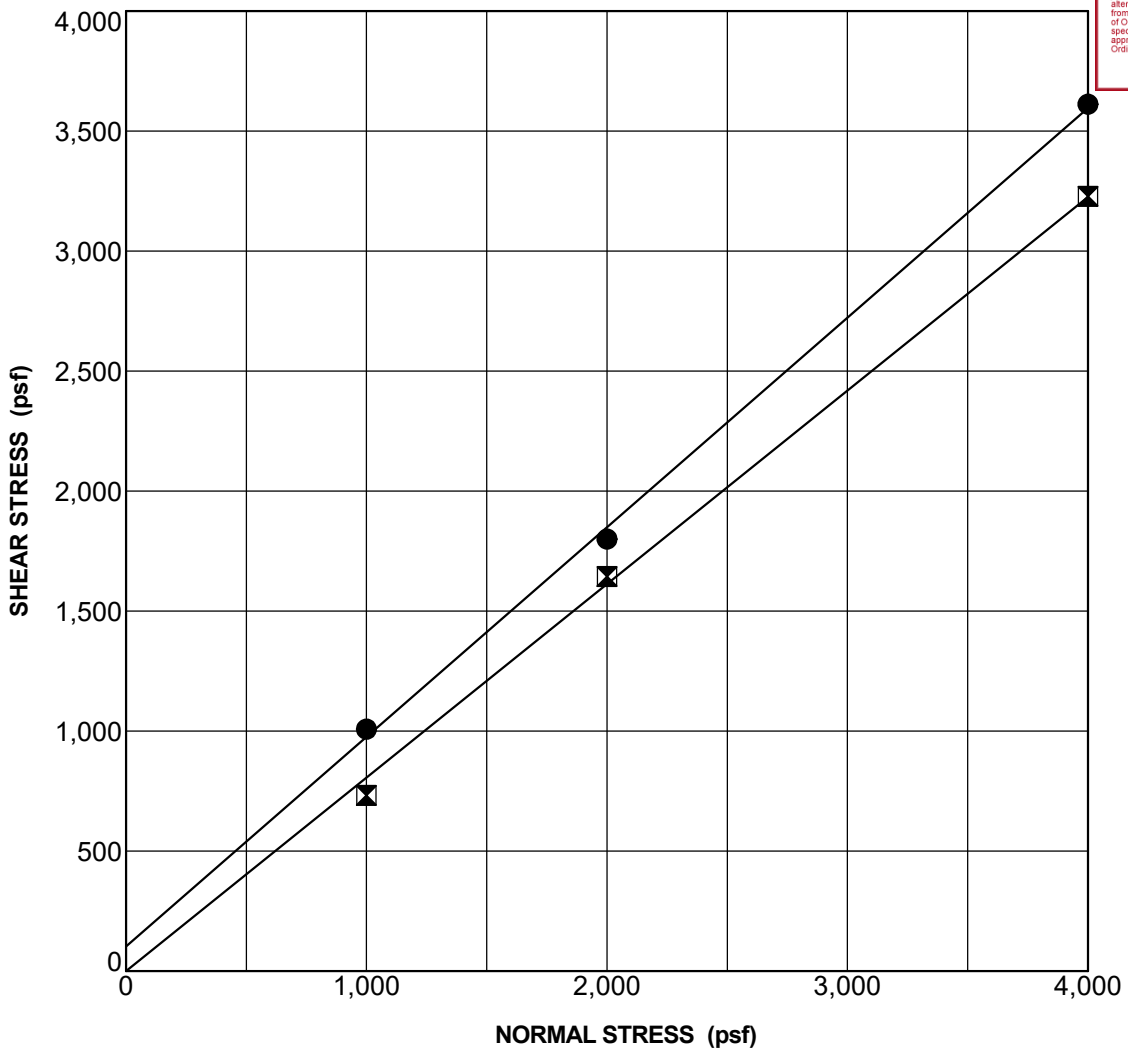

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-46 @ 5.0 ft **Geologic Unit:** Af **Classification:** SILTY SAND (SM)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes: Sample saturated prior and during shearing

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	102	41.0
⊠ Ultimate Strength	0	39.0

SHEAR TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

GMU_DIRECT_SHEAR 17-206-02 (UPDATED ELEV.).GPJ GM&U.GDT 11/25/19

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

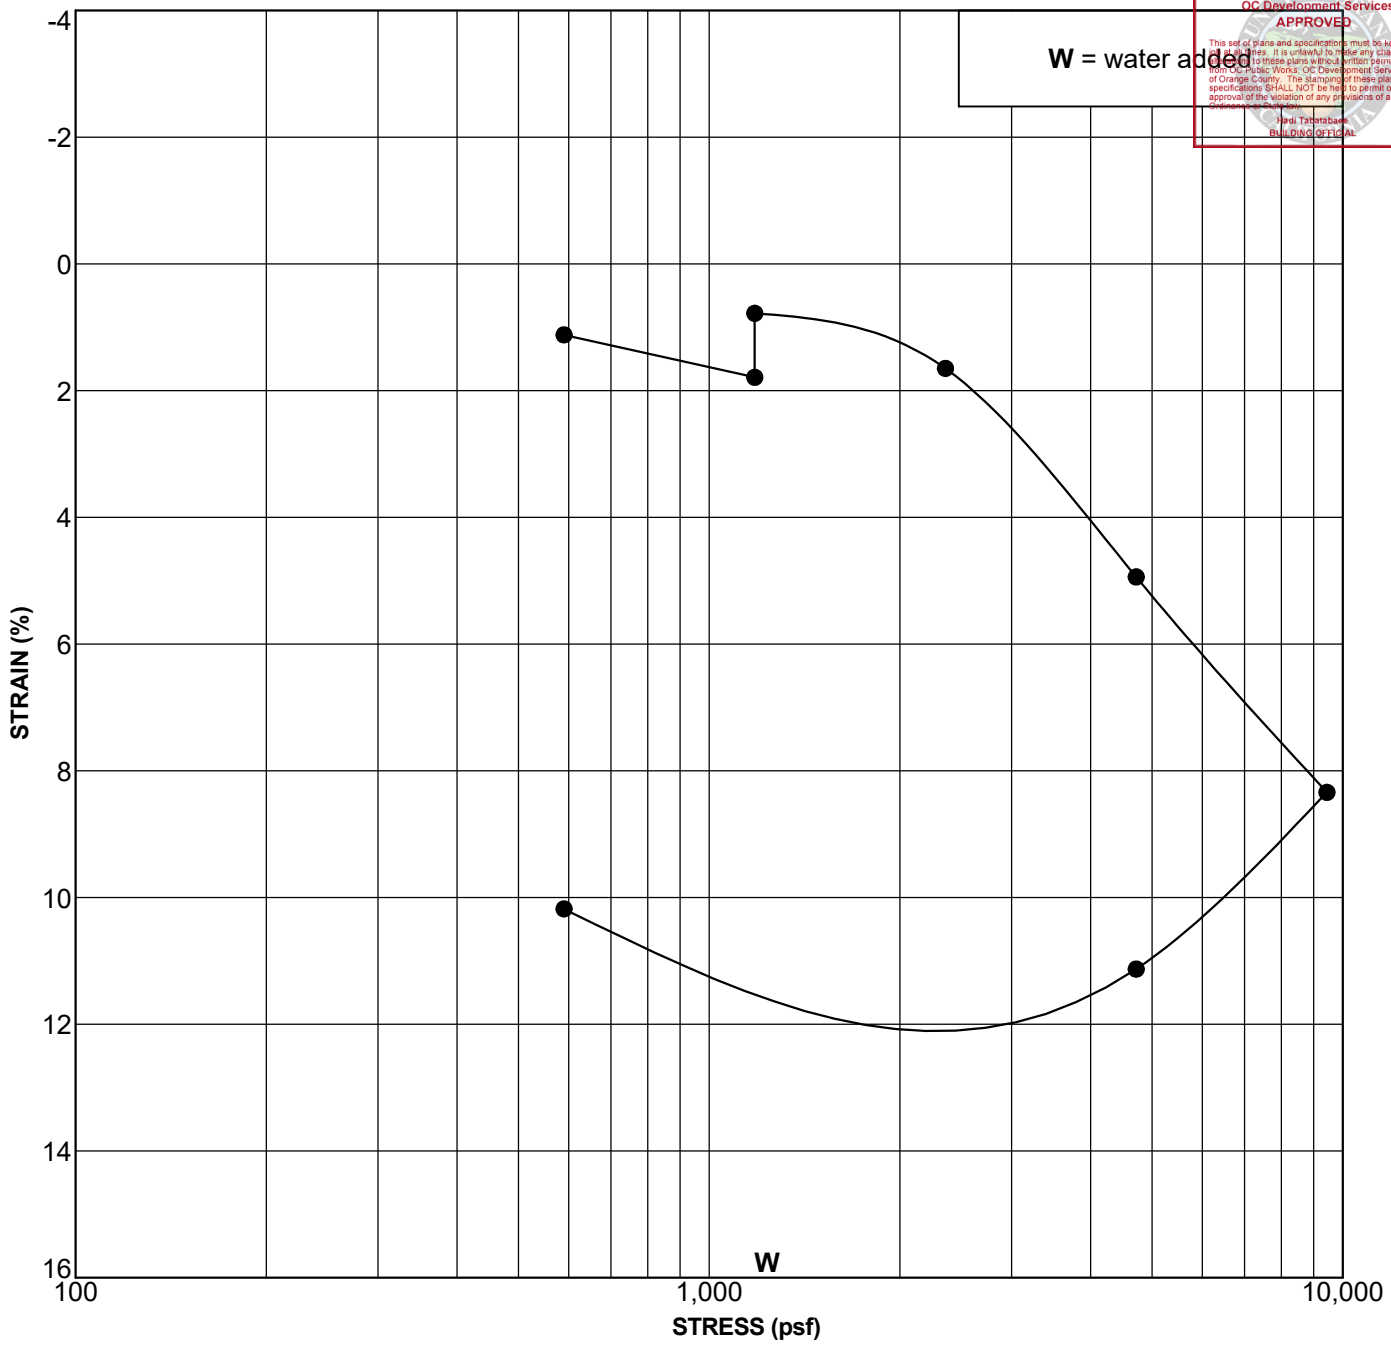

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH-25	10.0	Af	●	In Situ	-1.01	SANDY FAT CLAY (CH)

CONSOLIDATION TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

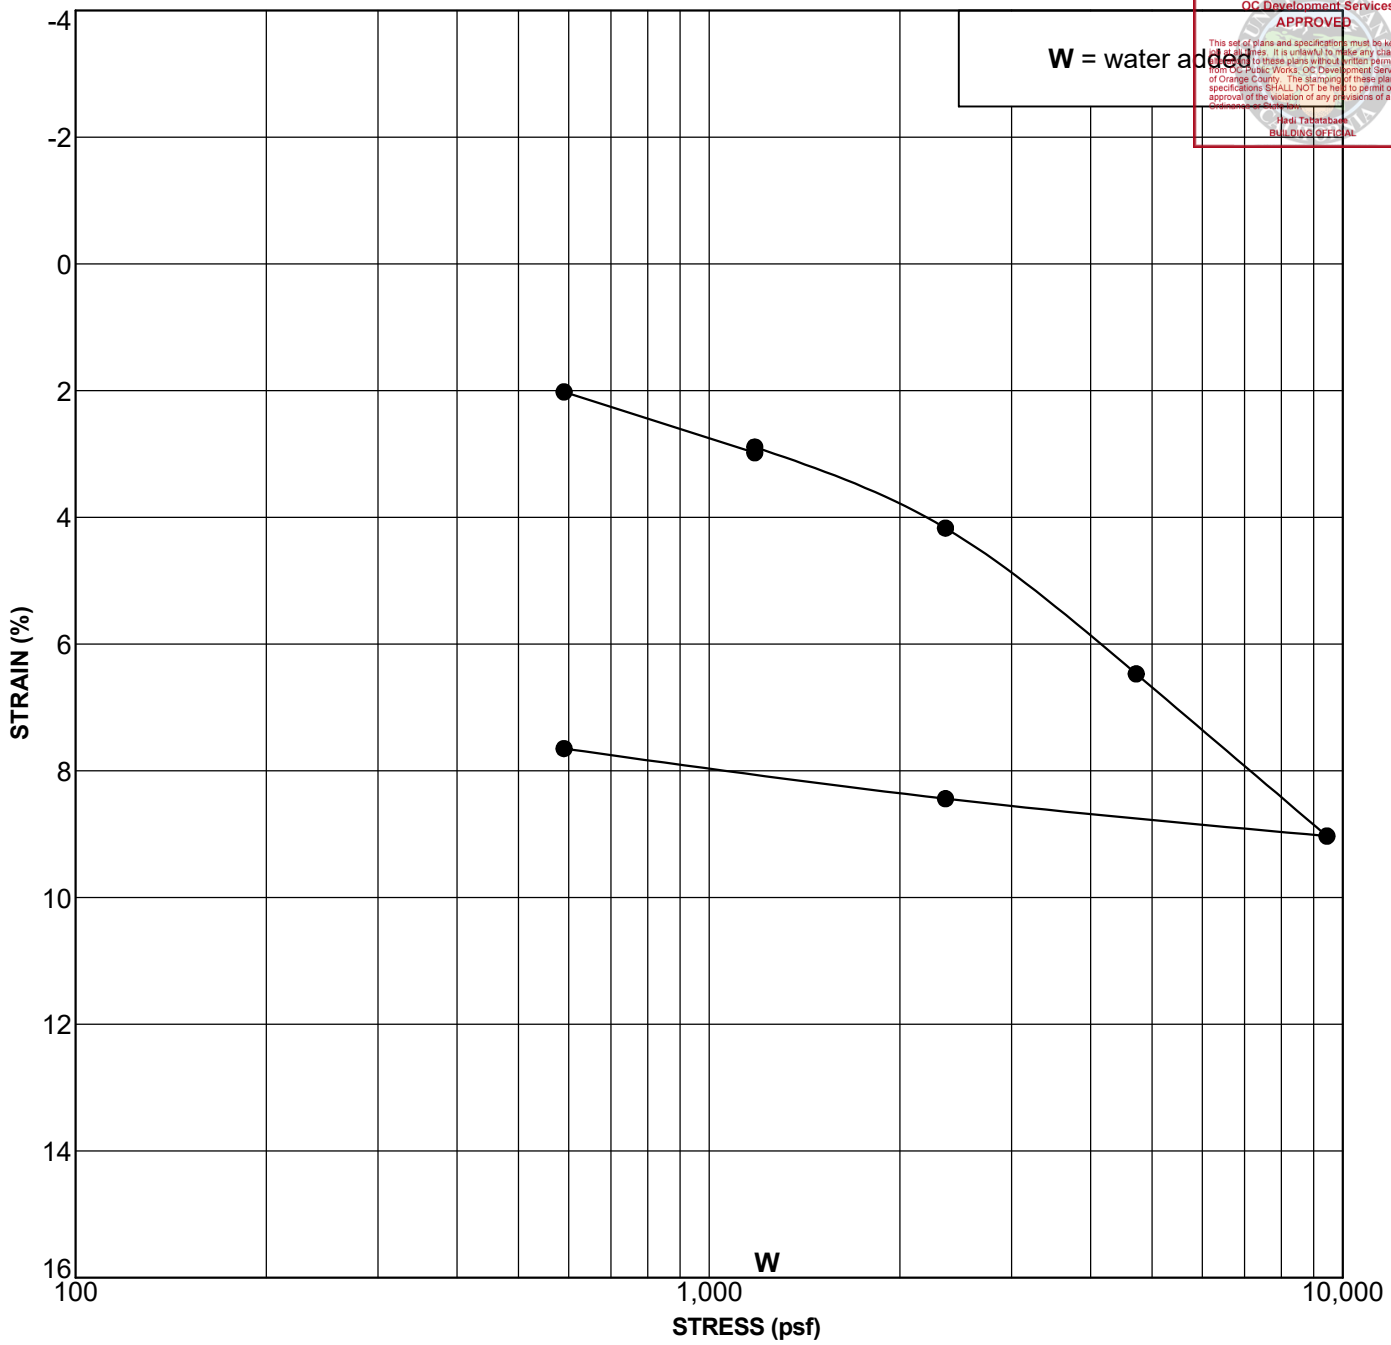

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH-51	10.0	Qm	●	In Situ	-0.09	SANDY LEAN CLAY (CL)

CONSOLIDATION TEST DATA

Project: Dana Point Harbor, Commercial Component
Project No. 17-206-02

GMU

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations thereon unless authorized by written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TIME RATE CONSOLIDATION RESULTS

PROJECT NAME:	Dana Point Harbor	PROJECT NUMBER:	17-206-02
SAMPLE LOCATION:	DH-25	SAMPLE DEPTH:	10
SAMPLE DESCRIPTION:	Sandy Clay with Gravel (CL)	LOAD (PSF)	2360

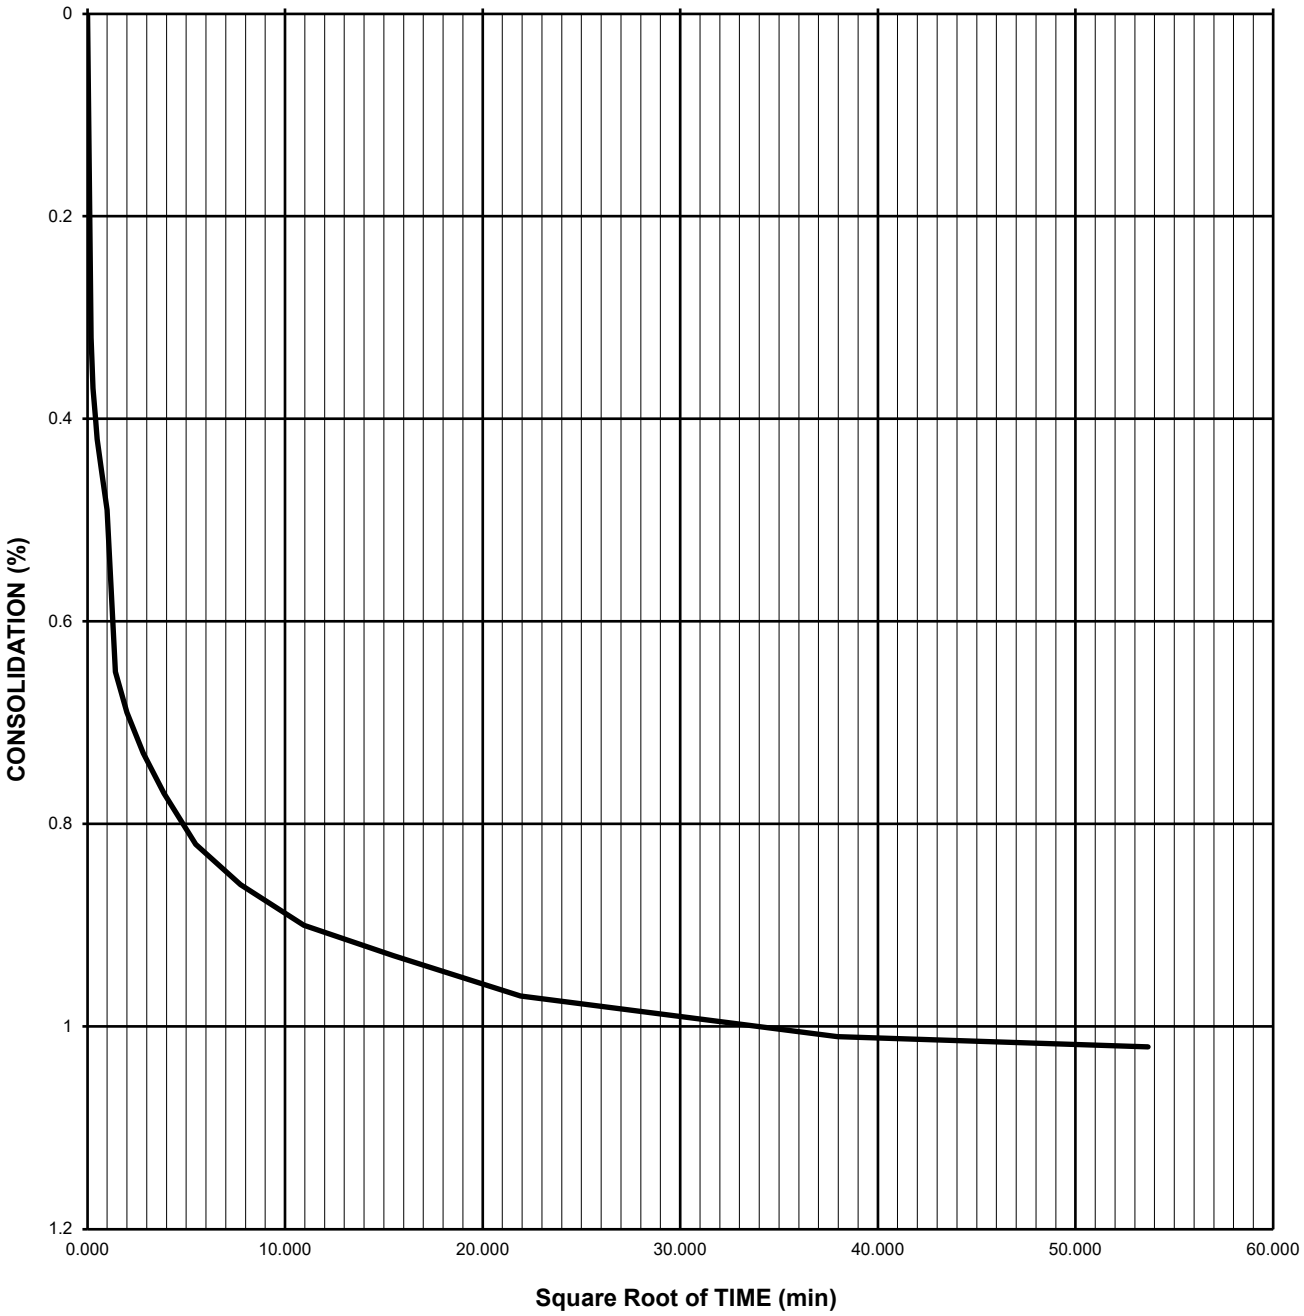

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B-1

Previous Laboratory Test Results by GMU

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TABLE B-1
SUMMARY OF SOIL LABORATORY DATA

Sample Information								Sieve/Hydrometer				Atterberg Limits			Compaction				Chemical Test Results			
Boring Number	Depth, feet	Elevation, feet	Geologic Unit	USCS Group Symbol	In Situ Water Content, %	In Situ Dry Unit Weight, pcf	In Situ Saturation, %	Gravel, %	Sand, %	<#200, %	<2μ, %	LL	PL	PI	Maximum Dry Unit Weight, pcf	Optimum Water Content, %	Expansion Index	R-Value	pH	Sulfate (ppm)	Chloride (ppm)	Min. Resistivity (ohm/cm)
C-2	0.5	21.8		ML															6.75	69	1740	6300
C-3	1.5	20.8	Qaf	CL-ML											115.5	13.5	84	12				
C-4	1	17.3	Qaf	SM				4	70	26	11	23	20	3				20				
DH- 1	0	17.3		SC-CL													55					
DH- 1	2	15.3		SC	14.3	112	80															
DH- 1	4	13.3	Qaf	SC	15.9	115	96															
DH- 1	9	8.3	Qaf	CL	21.2			2	46	52	24	41	23	18								
DH- 1	14	3.3		SP	16.2	107	78															
DH- 1	24	-6.7		SP	22.2	107	108															
DH- 2	2	13.3		SC	14.6	115	87															
DH- 2	4	11.3		CL	19.6	106	93															
DH- 2	9	6.3		GC	7.6	128	69															
DH- 4	0	22.3		SC-CL														10				
DH- 4	2	20.3		SP	7.5	126	64															
DH- 4	4	18.3		SP	8.9	103	39															
DH- 4	9	13.3		SP	7.1	97	27															
DH- 5	2	16.3		SC	9.9	119	67															
DH- 5	4	14.3		SC/SP	8.6	107	41															
DH- 5	9	9.3		SC	14.9	115	90															
DH- 6	2	11.8		SC/SP	9.3	102	40															
DH- 6	4	9.8	Qaf	ML	20.4	101	86															
DH- 6	9	4.8	Qaf	CL-SC	13.2	114	77															
DH- 6	14	-0.2	Qaf	CL	26.4			6	41	53	25	38	21	17								
DH- 6	19	-5.2		SP	22.6	103	99															
DH- 6	29	-15.2	Tc	SP/CL	16.6	118	111															

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TABLE B-1
SUMMARY OF SOIL LABORATORY DATA

Sample Information								Sieve/Hydrometer				Atterberg Limits			Compaction				Chemical Test Results			
Boring Number	Depth, feet	Elevation, feet	Geologic Unit	USCS Group Symbol	In Situ Water Content, %	In Situ Dry Unit Weight, pcf	In Situ Satur-ation, %	Gravel, %	Sand, %	<#200, %	<2μ, %	LL	PL	PI	Maximum Dry Unit Weight, pcf	Optimum Water Content, %	Expansion Index	R-Value	pH	Sulfate (ppm)	Chloride (ppm)	Min. Resistivity (ohm/cm)
DH- 6	39	-25.2		SC	19.7	113	112															
DH- 6	49	-35.2		SP	20.3	112	114															
DH-10	2	10.3		SM/SC	12.5	107	61															
DH-10	4	8.3		SP-SM	13.5	114	80															
DH-12	2	11.3		SC	14.3	109	73															
DH-12	4	9.3	Qaf	SM/CL	16.8	105	78	12	62	26	8	39	21	18								
DH-12	9	4.3	Qaf	SC	16.6			9	46	45	22	33	20	13								
DH-12	14	-0.7		GC	12.7																	
DH-12	24	-10.7	Tc	SP-SM/SC	18.6	108	93															
DH-12	44	-30.7		SP-SM/ML	14.4	122	108															
DH-13	2	14.3	Qaf	SC	14.5			9	65	26	12	33	22	11								
DH-13	4	12.3		SC	7.6	117	49															
DH-13	14	2.3		SM	13.5	128	124															
DH-13	24	-7.7		SP	13.6	121	98															
DH-13	34	-17.7		SC	13.4	125	110															
DH-13	44	-27.7		SM	14.6	119	98															
DH-14	0	14.3	Qaf	SC											135.0	8.0	34		7.9	727	246	1060
DH-14	2	12.3		GC/SC	9.6	117	61															
DH-14	4	10.3	Qaf	SM/SM-SC	13.0	114	76															
DH-14	9	5.3	Qaf	SC	20.6	113	119	2	69	29	9	32	23	9								
DH-14	19	-4.7	Tc	CL/SM	20.5	104	91															
DH-14	29	-14.7		SP-SM	12.1	122	92															
DH-15	2	9.8		SC	13.1	115	79															
DH-15	4	7.8	Qaf	ML-SM	11.7	106	56															
DH-15	9	2.8	Qaf	SM	16.5	110	87															

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

TABLE B-1
SUMMARY OF SOIL LABORATORY DATA

Sample Information								Sieve/Hydrometer				Atterberg Limits			Compaction				Chemical Test Results			
Boring Number	Depth, feet	Elevation, feet	Geologic Unit	USCS Group Symbol	In Situ Water Content, %	In Situ Dry Unit Weight, pcf	In Situ Satur-ation, %	Gravel, %	Sand, %	<#200, %	<2μ, %	LL	PL	PI	Maximum Dry Unit Weight, pcf	Optimum Water Content, %	Expansion Index	R-Value	pH	Sulfate (ppm)	Chloride (ppm)	Min. Resistivity (ohm/cm)
DH-15	19	-7.2		SM	16.7																	
DH-15	30	-18.2		SM	20.2	110	105															
DH-15	39	-27.2		SC	22.5	110	119															
DH-16	2	7.3		SP-SM	8.4	115	50															
DH-16	4	5.3		SP-SM	10.9	122	80															
DH-17	4	7.3	Qaf	SP-SM	10.8	113	63															
DH-17	14	-2.7		GM	11.3	128	103															
DH-17	24	-12.7		SP-SM	16.6																	
DH-17	35	-23.7		SC	13.2	127	114															
DH-17	44	-32.7		SP-SM	15.6	116	97															
DH-18	0	11.3	Qaf	SC											127.5	10.0	19		8.3	635	264	820
DH-18	2	9.3		SM/CL	11.8	112	65															
DH-18	4	7.3		CL-CH	15.1	101	62															
DH-18	9	2.3		CL	11.3	121	82															
DH-19	4	6.3		SP-SM	12.9	112	72															
DH-19	9	1.3	Qaf	CL/SP-SM	25.5	95	91															
DH-19	19	-8.7		SP-SM	15.3	116	94															
DH-19	29	-18.7		SP-SM	21.0	108	104															
DH-19	39	-28.7		SP	14.8	122	111															
DH-19	49	-38.7		SP	17.8	117	115															
DH-20	2	8.3	Qaf	SC	15.7	101	65															
DH-20	3	7.3	Qaf	ML-CL											107.0	14.5						
DH-20	3.5	6.8		ML	19.9	100	81															

GMU_TABLE_SOIL_LAB_DATA 11-161-00 (UPDATED ELEV.).GPJ FNC AB GWGN01.GDT 2/8/21

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of these plans and specifications shall NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Paul Townsend
BUILDING OFFICIAL

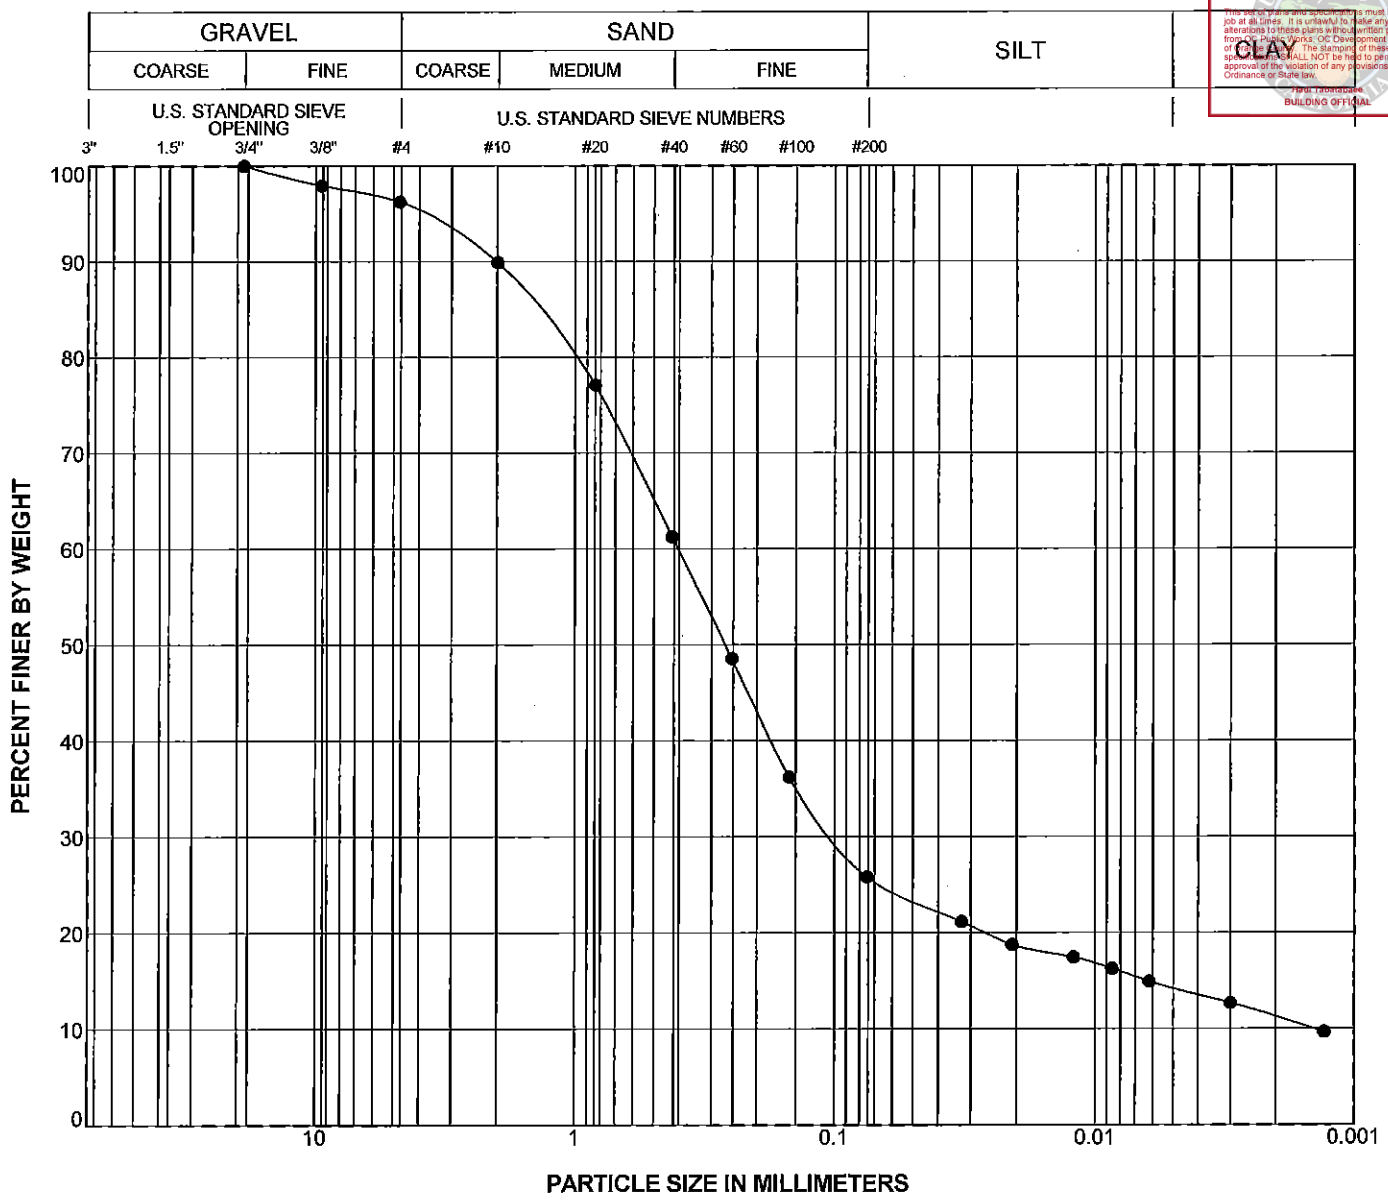

Boring Number	Depth (feet)	Geologic Unit	Symbol	LL	PI	Classification
C-4	1.0	Qaf	●	23	3	Silty Sand (SM)

GMU_GRAIN_SIZE 11-161-00.GPJ 10/23/12

PARTICLE SIZE DISTRIBUTION

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaei
BUILDING OFFICIAL

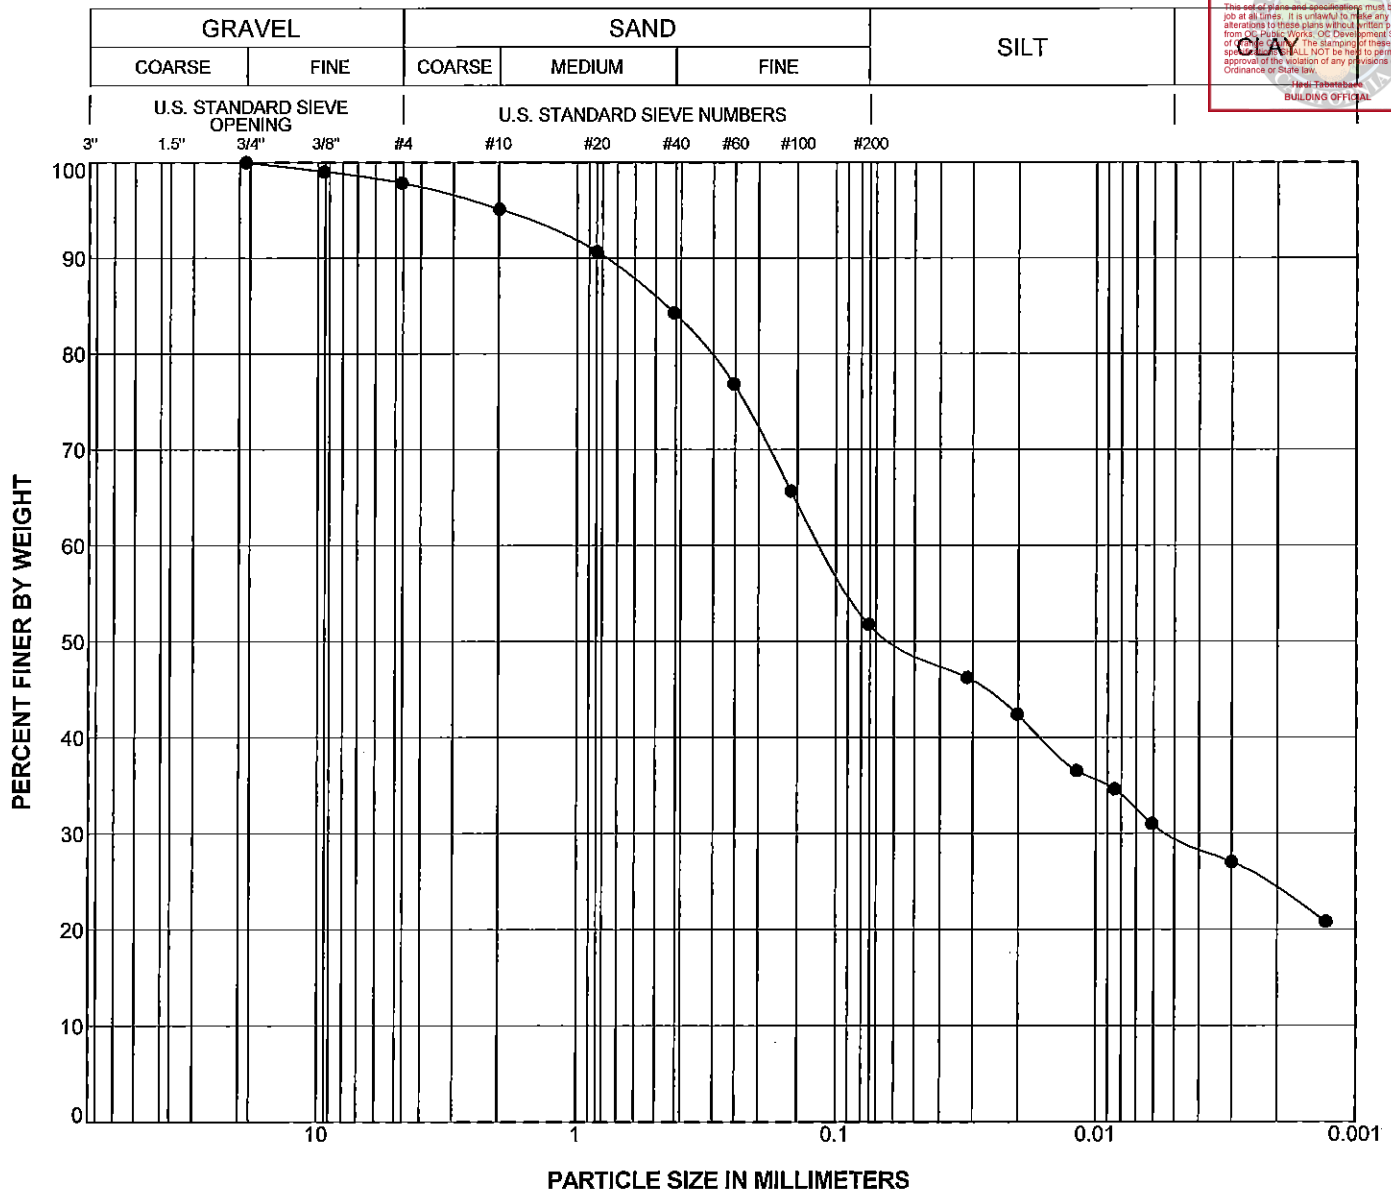

Boring Number	Depth (feet)	Geologic Unit	Symbol	LL	PI	Classification
DH- 1	9.0	Qaf	●	41	18	Sandy Lean Clay (CL)

GMU_GRAIN_SIZE 11-161-00.GPJ 10/23/12

PARTICLE SIZE DISTRIBUTION

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of County of Orange. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

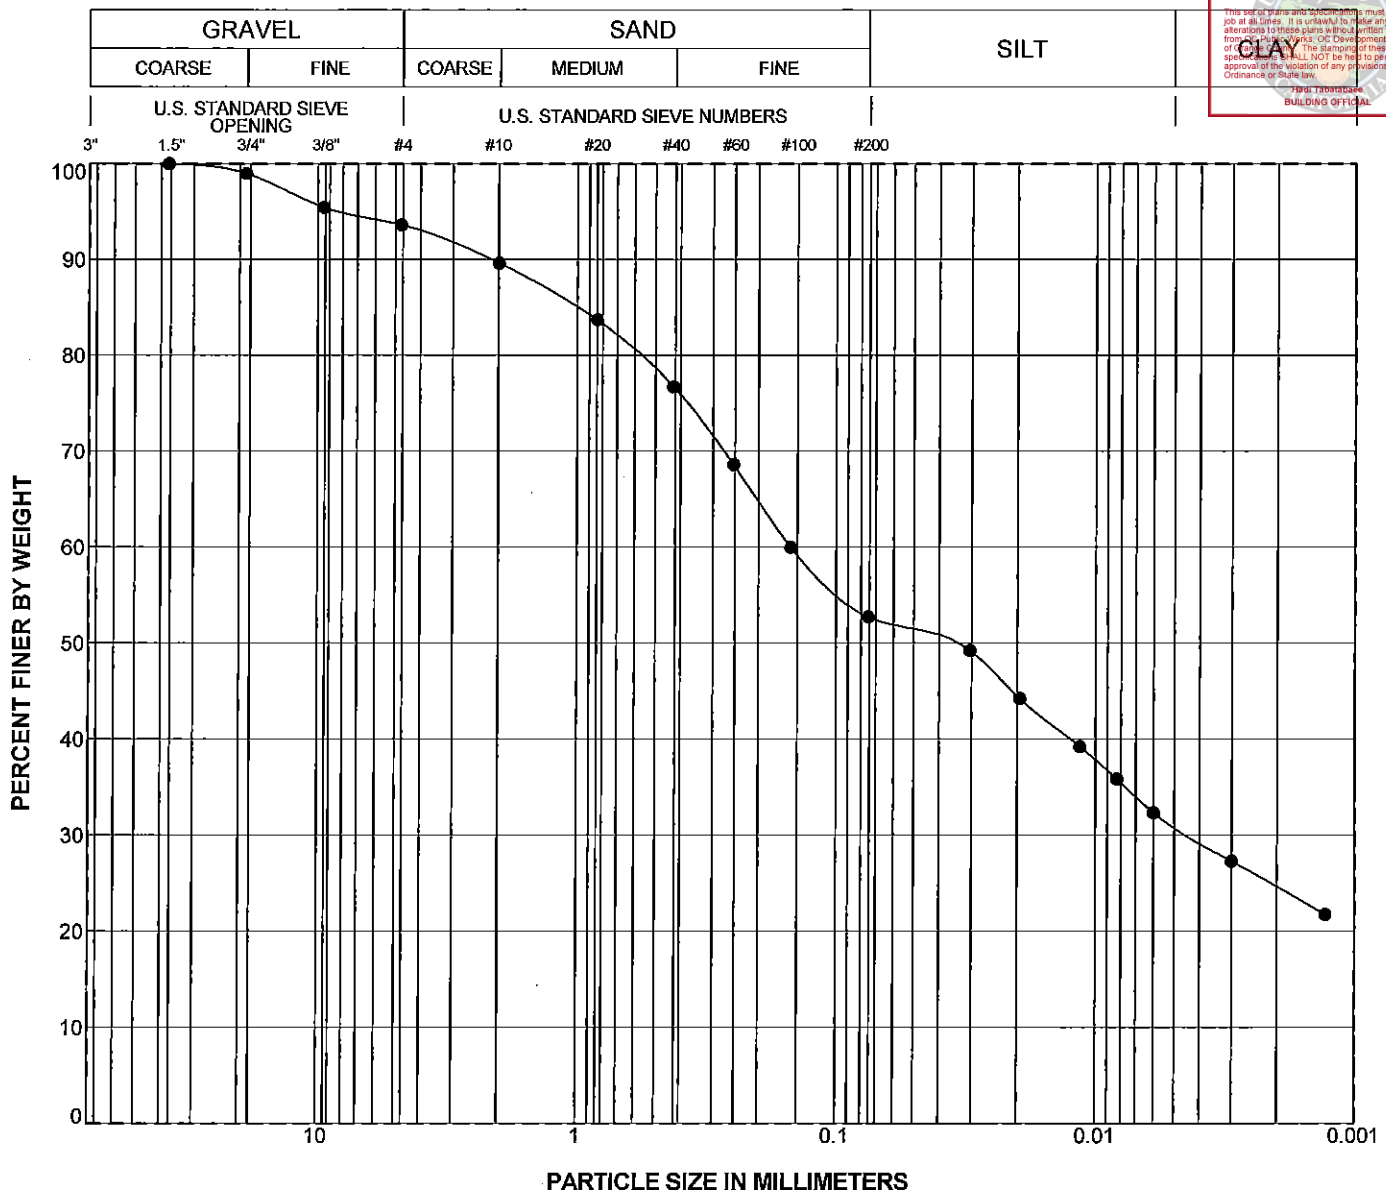

Boring Number	Depth (feet)	Geologic Unit	Symbol	LL	PI	Classification
DH- 6	14.0	Qaf	●	38	17	Sandy Lean Clay (CL)

GMU_GRAIN_SIZE 11-161-00.GPJ 10/23/12

PARTICLE SIZE DISTRIBUTION

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of the County of Orange. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Paul Tabatabaee
BUILDING OFFICIAL

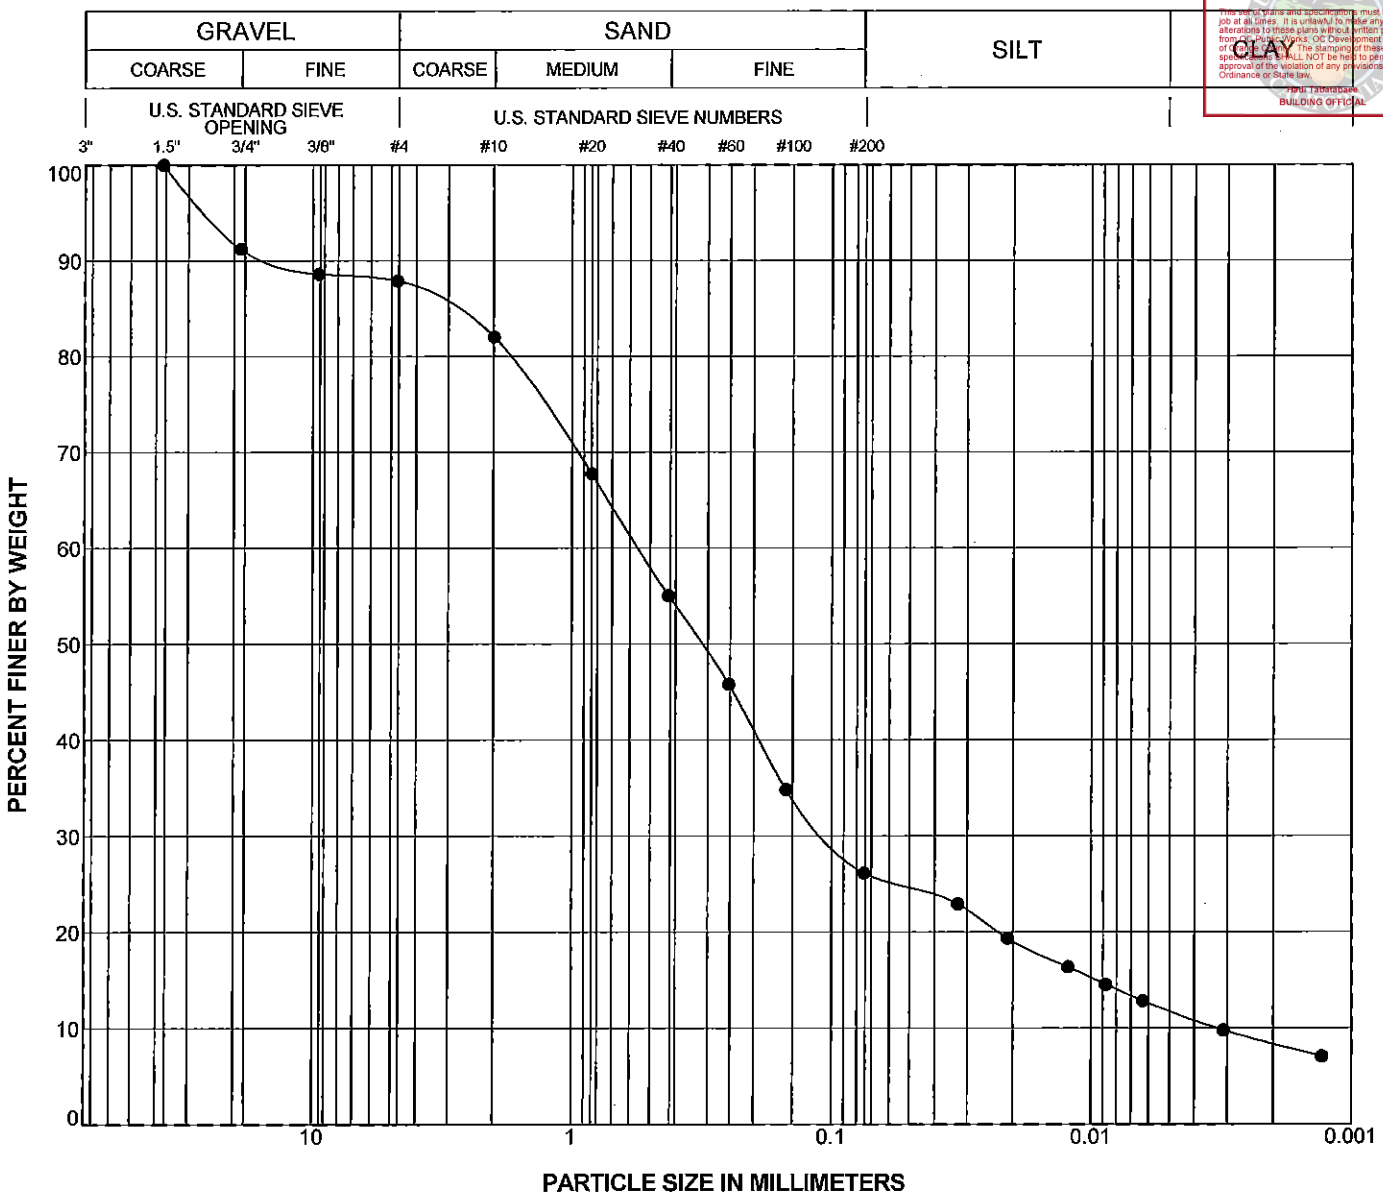

Boring Number	Depth (feet)	Geologic Unit	Symbol	LL	PI	Classification
DH-12	4.0	Qaf	●	39	18	Silty Sand and Silty Clay (SM/CL)

GMU_GRAIN_SIZE 11-161-00.GPJ 10/23/12

PARTICLE SIZE DISTRIBUTION

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of OC Public Works. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Paul Tabatabaie
BUILDING OFFICIAL

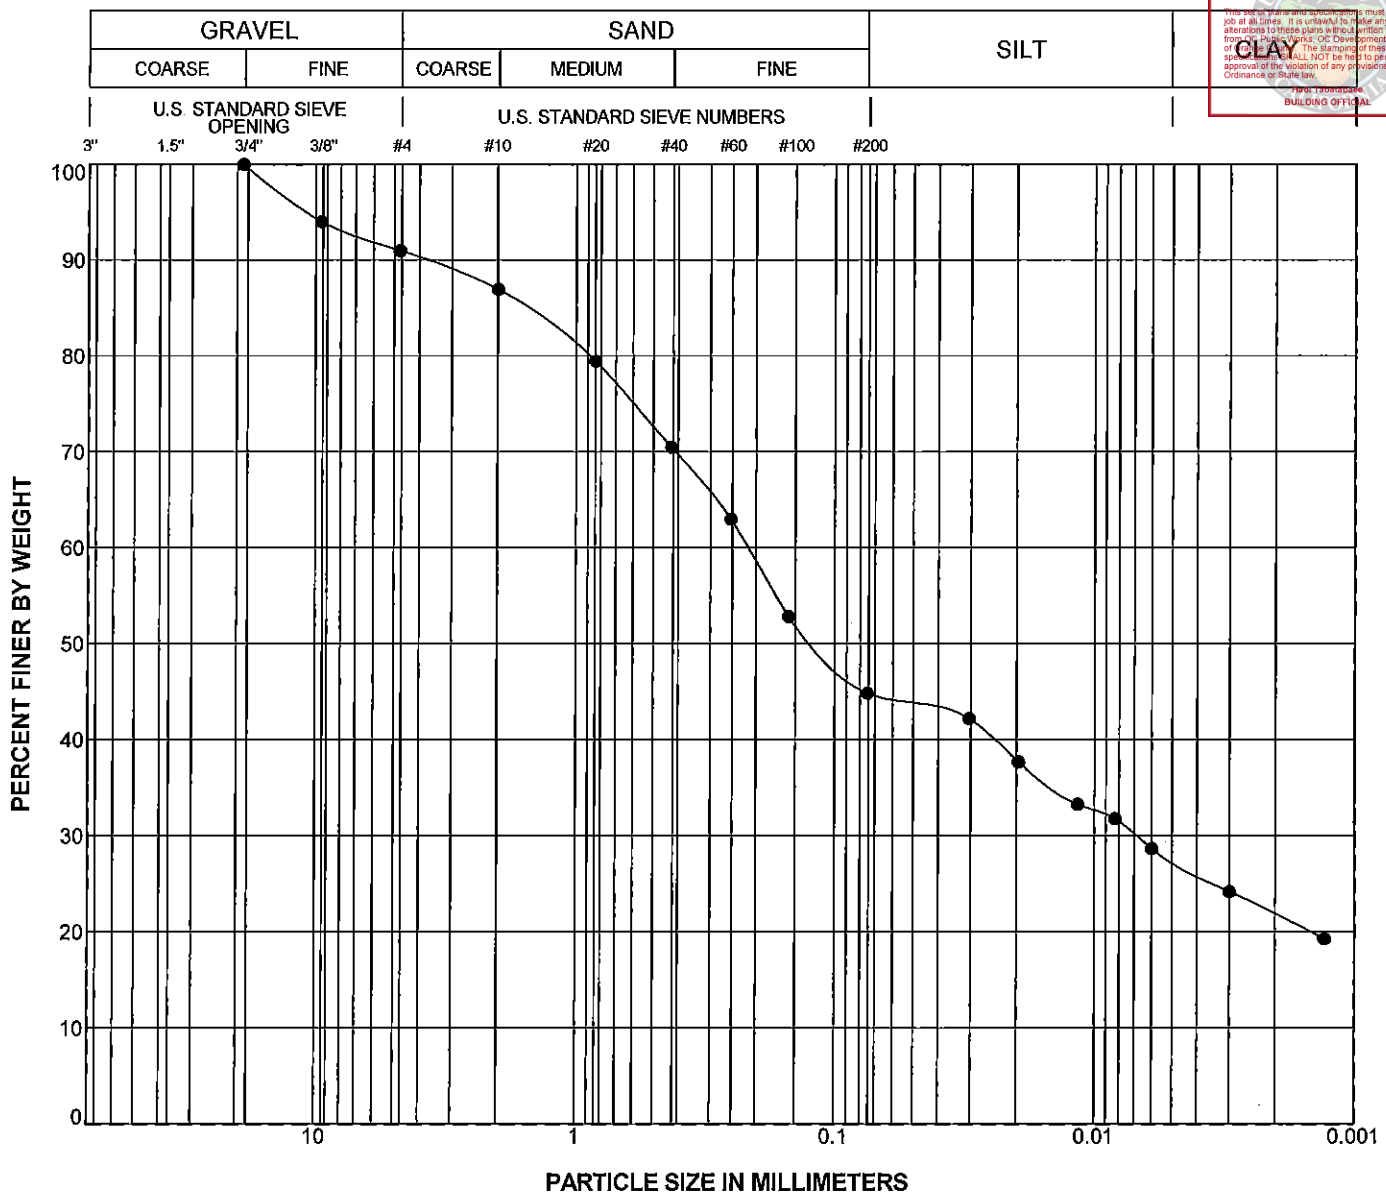

Boring Number	Depth (feet)	Geologic Unit	Symbol	LL	PI	Classification
DH-12	9.0	Qaf	●	33	13	Clayey Sand (SC)

GMU_GRAIN_SIZE 11-161-00.GPJ 10/23/12

PARTICLE SIZE DISTRIBUTION

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of changes, if any. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaei
BUILDING OFFICIAL

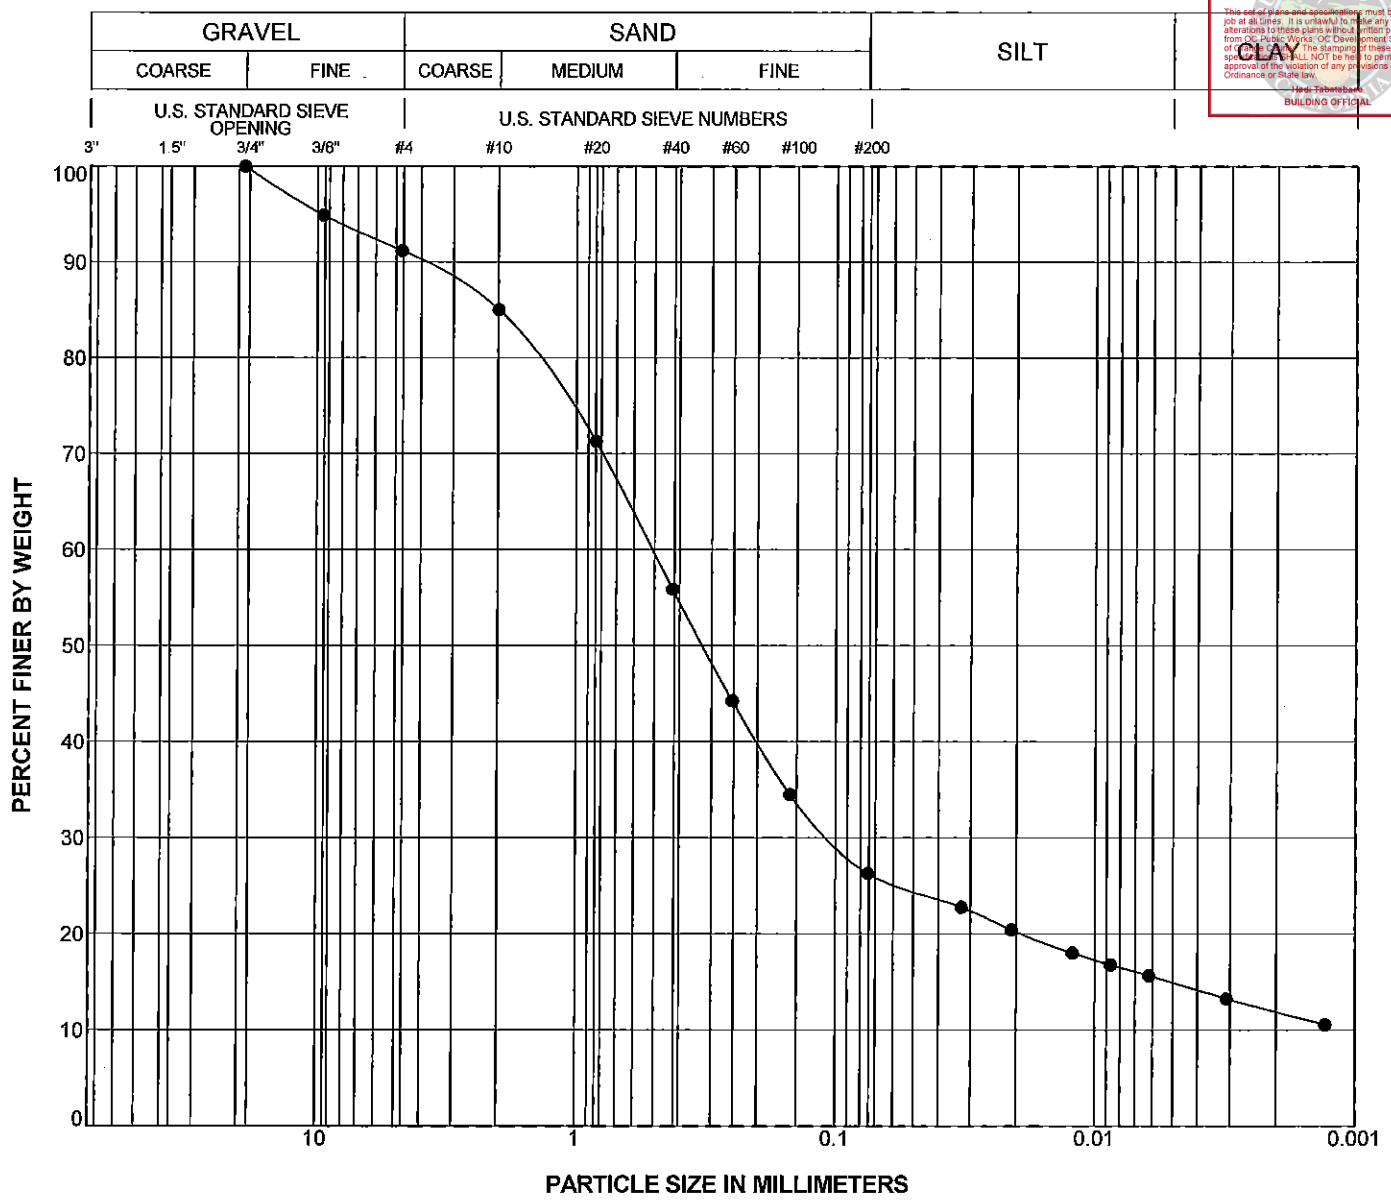

Boring Number	Depth (feet)	Geologic Unit	Symbol	LL	PI	Classification
DH-13	2.0	Qaf	●	33	11	Clayey Sand (SC)

GMU_GRAIN_SIZE 11-161-00.GPJ 10/23/12

PARTICLE SIZE DISTRIBUTION

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of OC Public Works. The stamping of these plans, specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hank Tobmann
BUILDING OFFICIAL

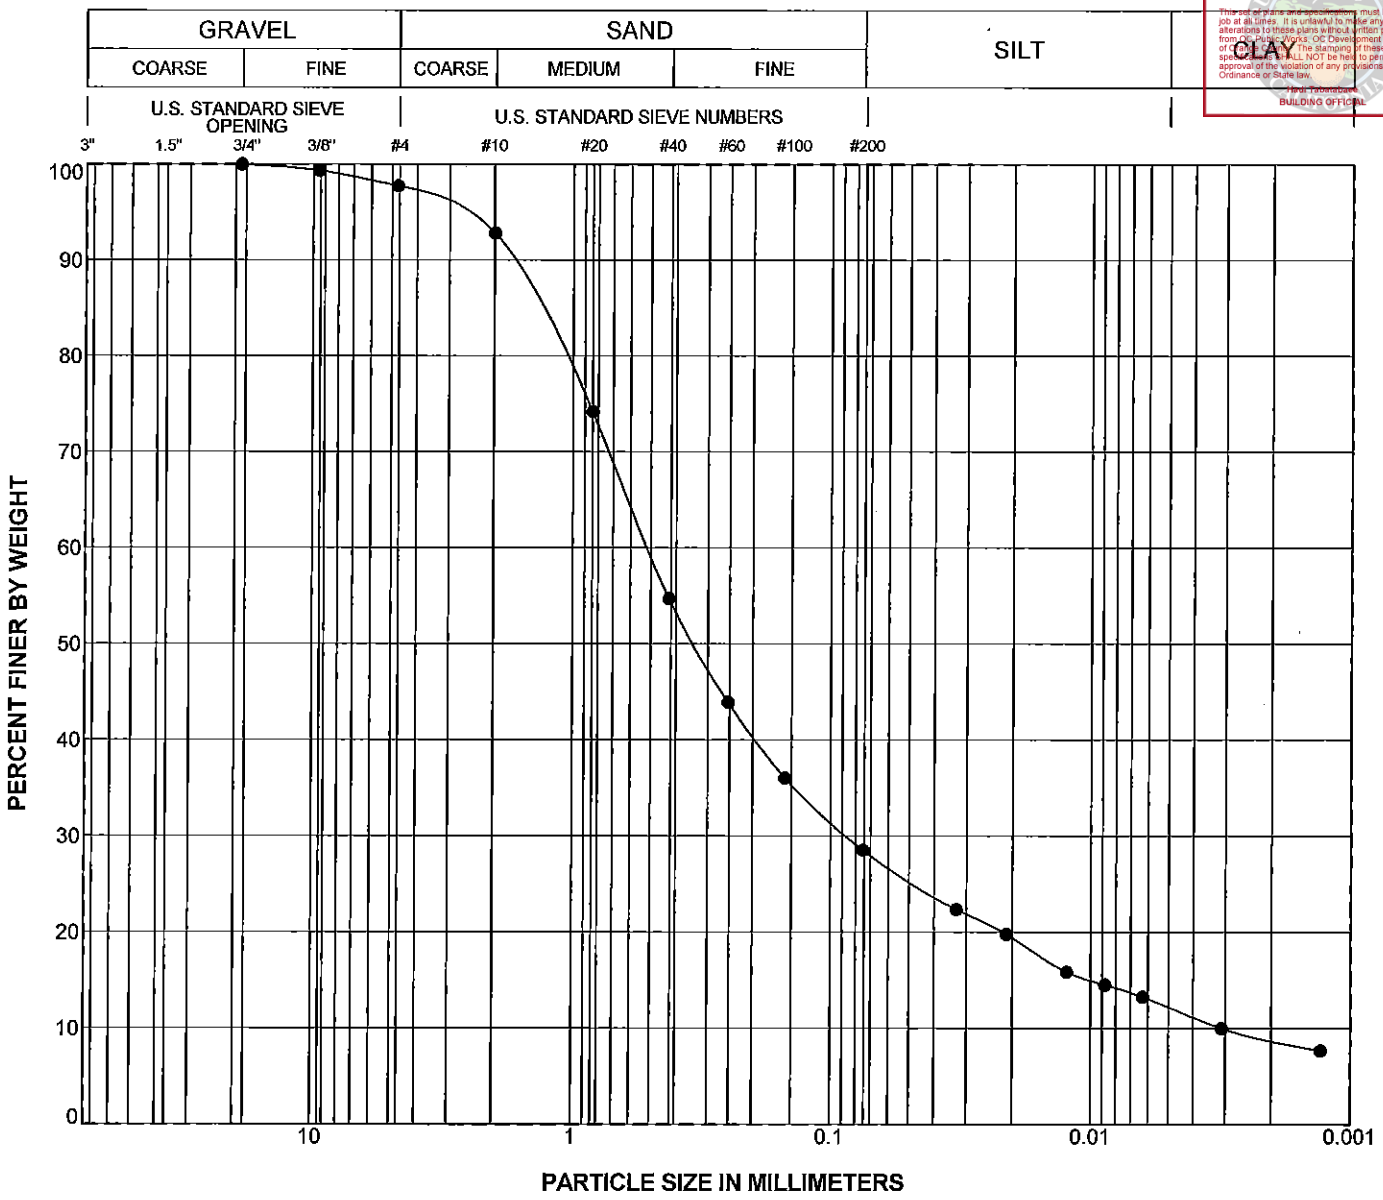

Boring Number	Depth (feet)	Geologic Unit	Symbol	LL	PI	Classification
DH-14	9.0	Qaf	●	32	9	Clayey Sand (SC)

GMU_GRAIN_SIZE 11-161-00.GPJ 10/23/12

PARTICLE SIZE DISTRIBUTION

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

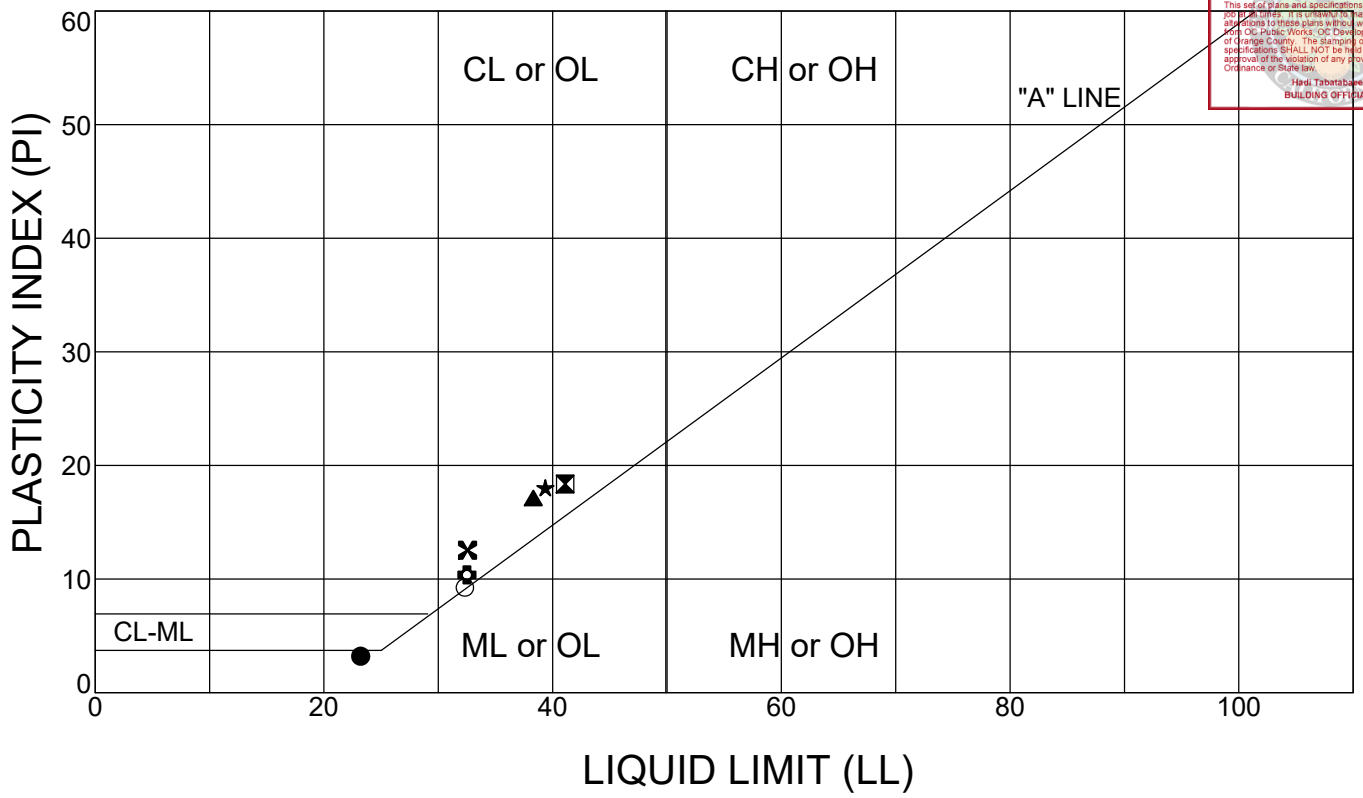

Boring Number	Depth (feet)	Geologic Unit	Test Symbol	Insitu Water Content (%)	LL	PL	PI	Classification
C-4	1.0	Qaf	●		23	20	3	Silty Sand (SM)
DH- 1	9.0	Qaf	⊠	21	41	23	18	Sandy Lean Clay (CL)
DH- 6	14.0	Qaf	▲	26	38	21	17	Sandy Lean Clay (CL)
DH-12	4.0	Qaf	★	17	39	21	18	Silty Sand and Silty Clay (SM/CL)
DH-12	9.0	Qaf	✕	17	33	20	13	Clayey Sand (SC)
DH-13	2.0	Qaf	✿	14	33	22	11	Clayey Sand (SC)
DH-14	9.0	Qaf	○	21	32	23	9	Clayey Sand (SC)

LIMITS 11-161-00 (UPDATED ELEV.).GPJ 2/8/21

ATTERBERG LIMITS

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services Department, County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Linda Tomlinson
BUILDING OFFICIAL

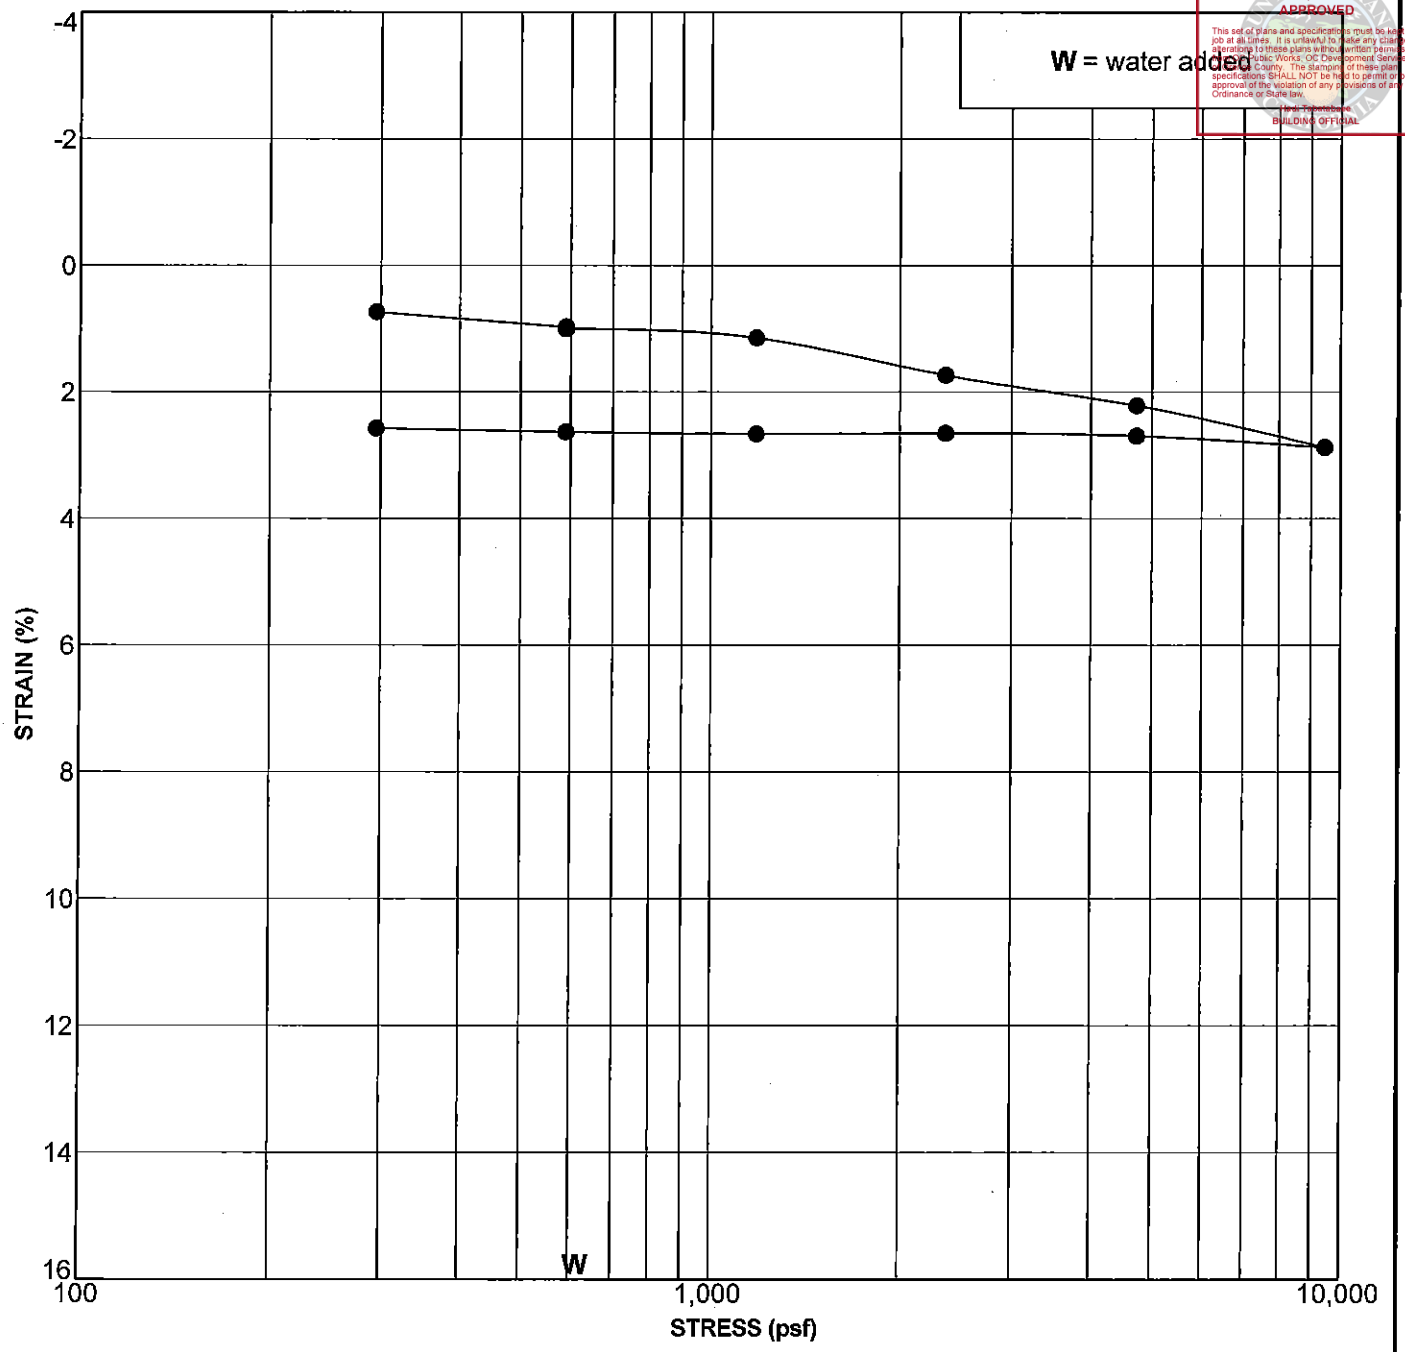

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH- 1	4.0	Qaf	●	In Situ	0.03	Clayey Sand (SC)
			⊠	In Situ		
			▲	In Situ		
			★	In Situ		

CONSOLIDATION TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

GMU_CONSOL 11-161-00.GPJ GM&U.GDT 10/23/12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
BUILDING OFFICIAL

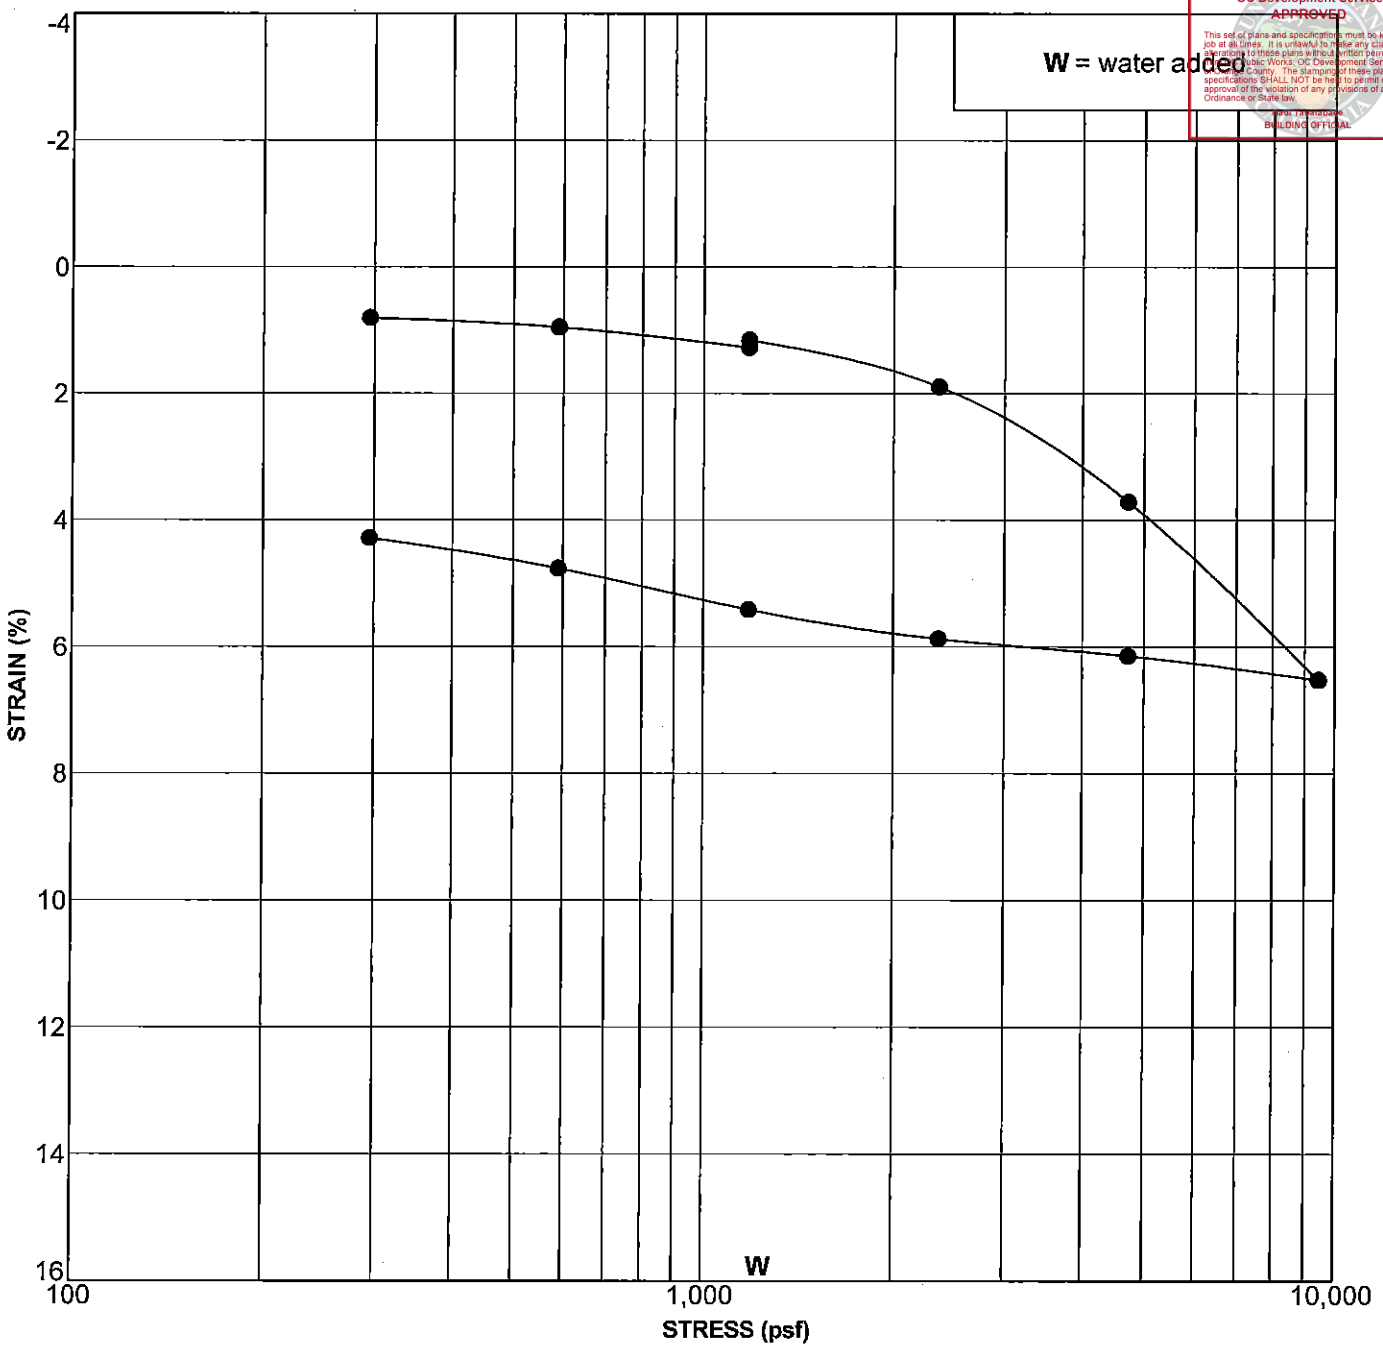

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH- 6	9.0		●	In Situ	-0.12	Sandy Clay to Clayey Sand (CL-SC)
			⊠	In Situ		
			▲	In Situ		
			★	In Situ		

GMU_CONSOL 11-161-00.GPJ GM&U.GDT 10/23/12

CONSOLIDATION TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of the County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Linda Tomerlin
BUILDING OFFICIAL

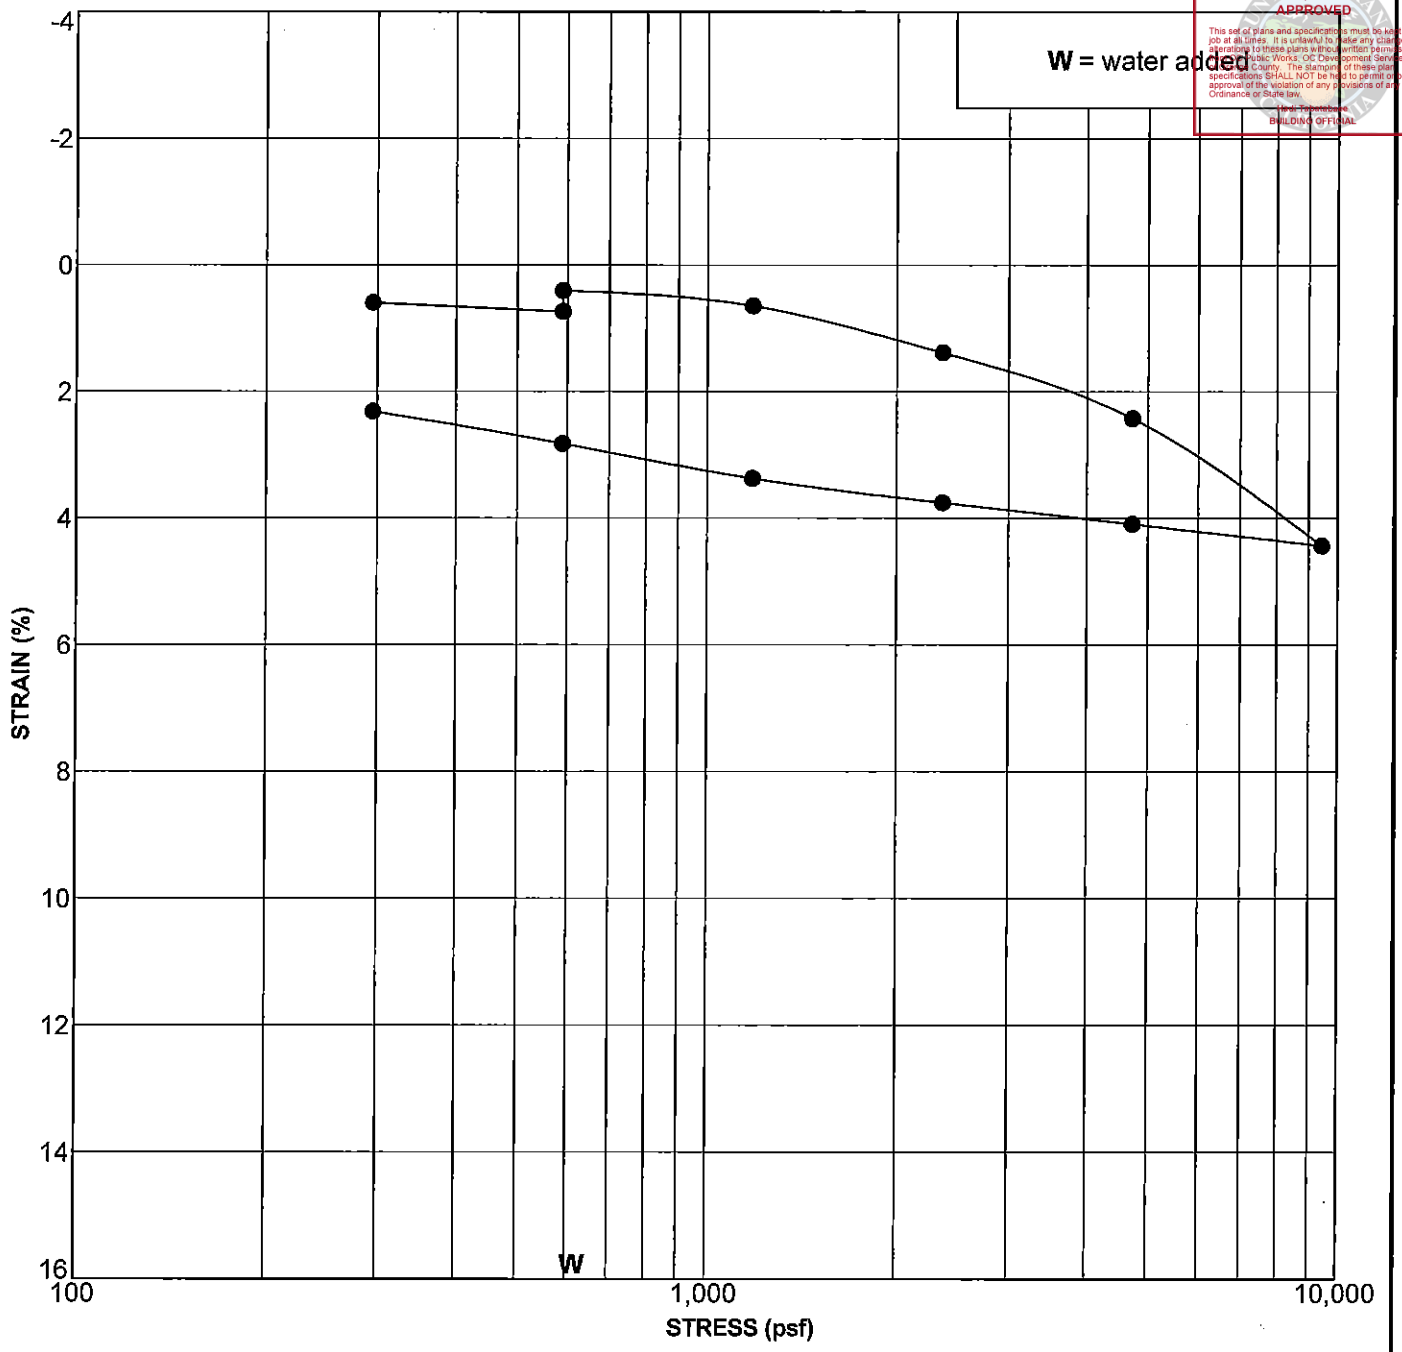

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH-12	4.0	Qaf	●	In Situ	0.14	Silty Sand and Silty Clay (SM/CL)
			⊠	In Situ		
			▲	In Situ		
			★	In Situ		

GMU_CONSOL 11-161-00.GPJ GM&U.GDT 10/23/12

CONSOLIDATION TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of the County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Date
BUILDING OFFICIAL

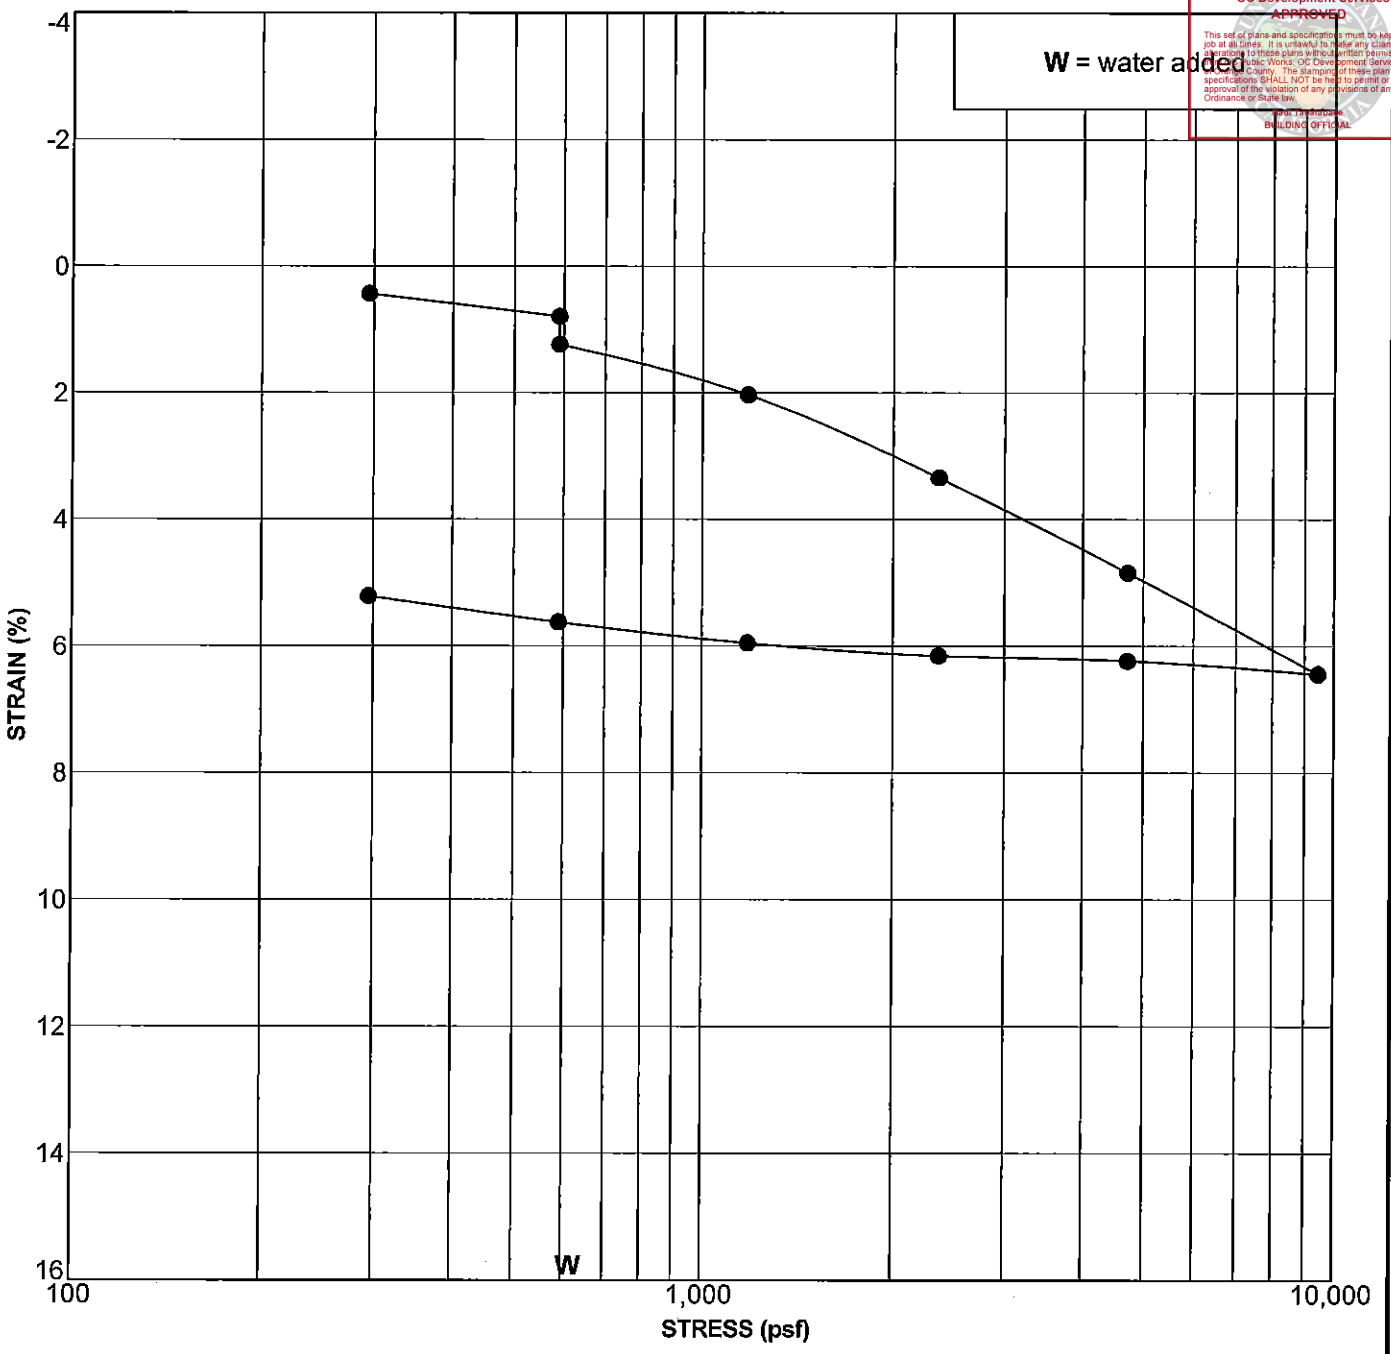

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH-14	4.0	Qaf	●	In Situ	0.44	Silty Sand with some Clay (SM)
			⊠	In Situ		
			▲	In Situ		
			★	In Situ		

GMU_CONSOL 11-161-00.GPJ GM&U.GDT 10/23/12

CONSOLIDATION TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services Director, County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

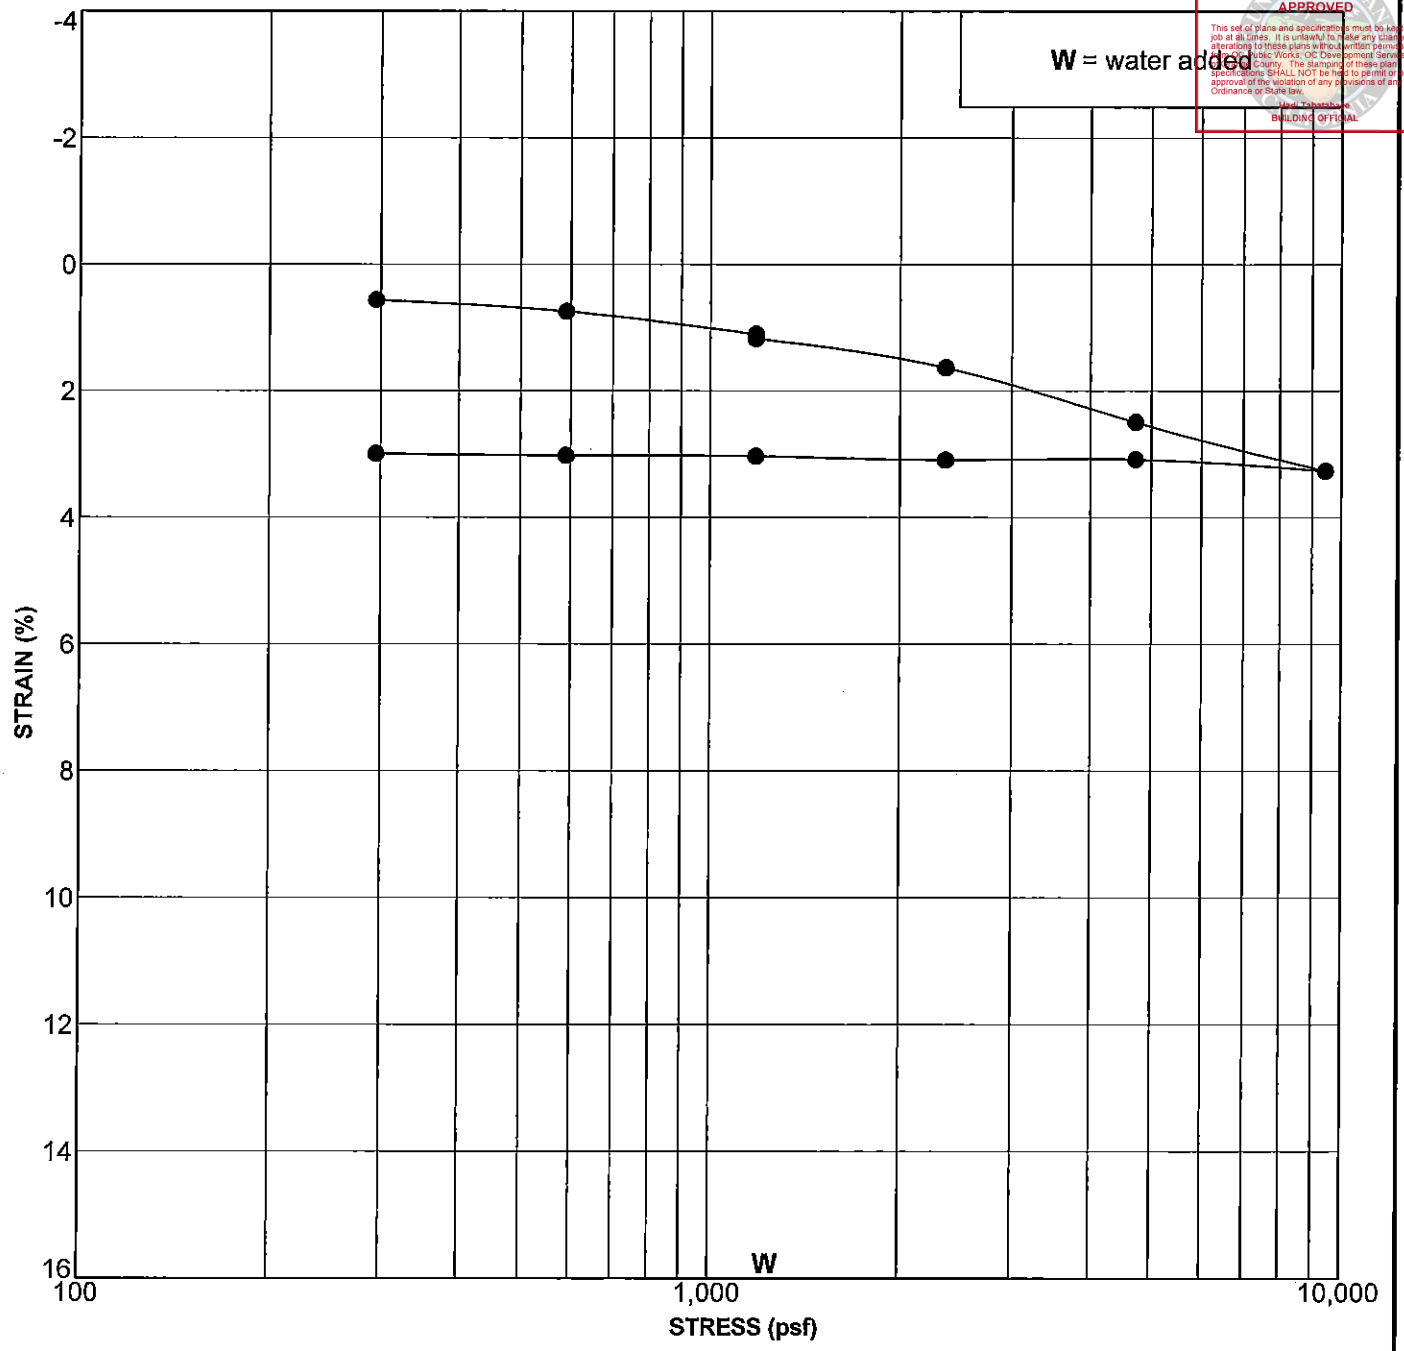

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH-15	9.0	Qaf	●	In Situ	0.07	Silty Sand (SM)
			⊠	In Situ		
			▲	In Situ		
			★	In Situ		

GMU_CONSOL 11-161-00.GPJ GM&U.GDT 10/23/12

CONSOLIDATION TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services Building County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

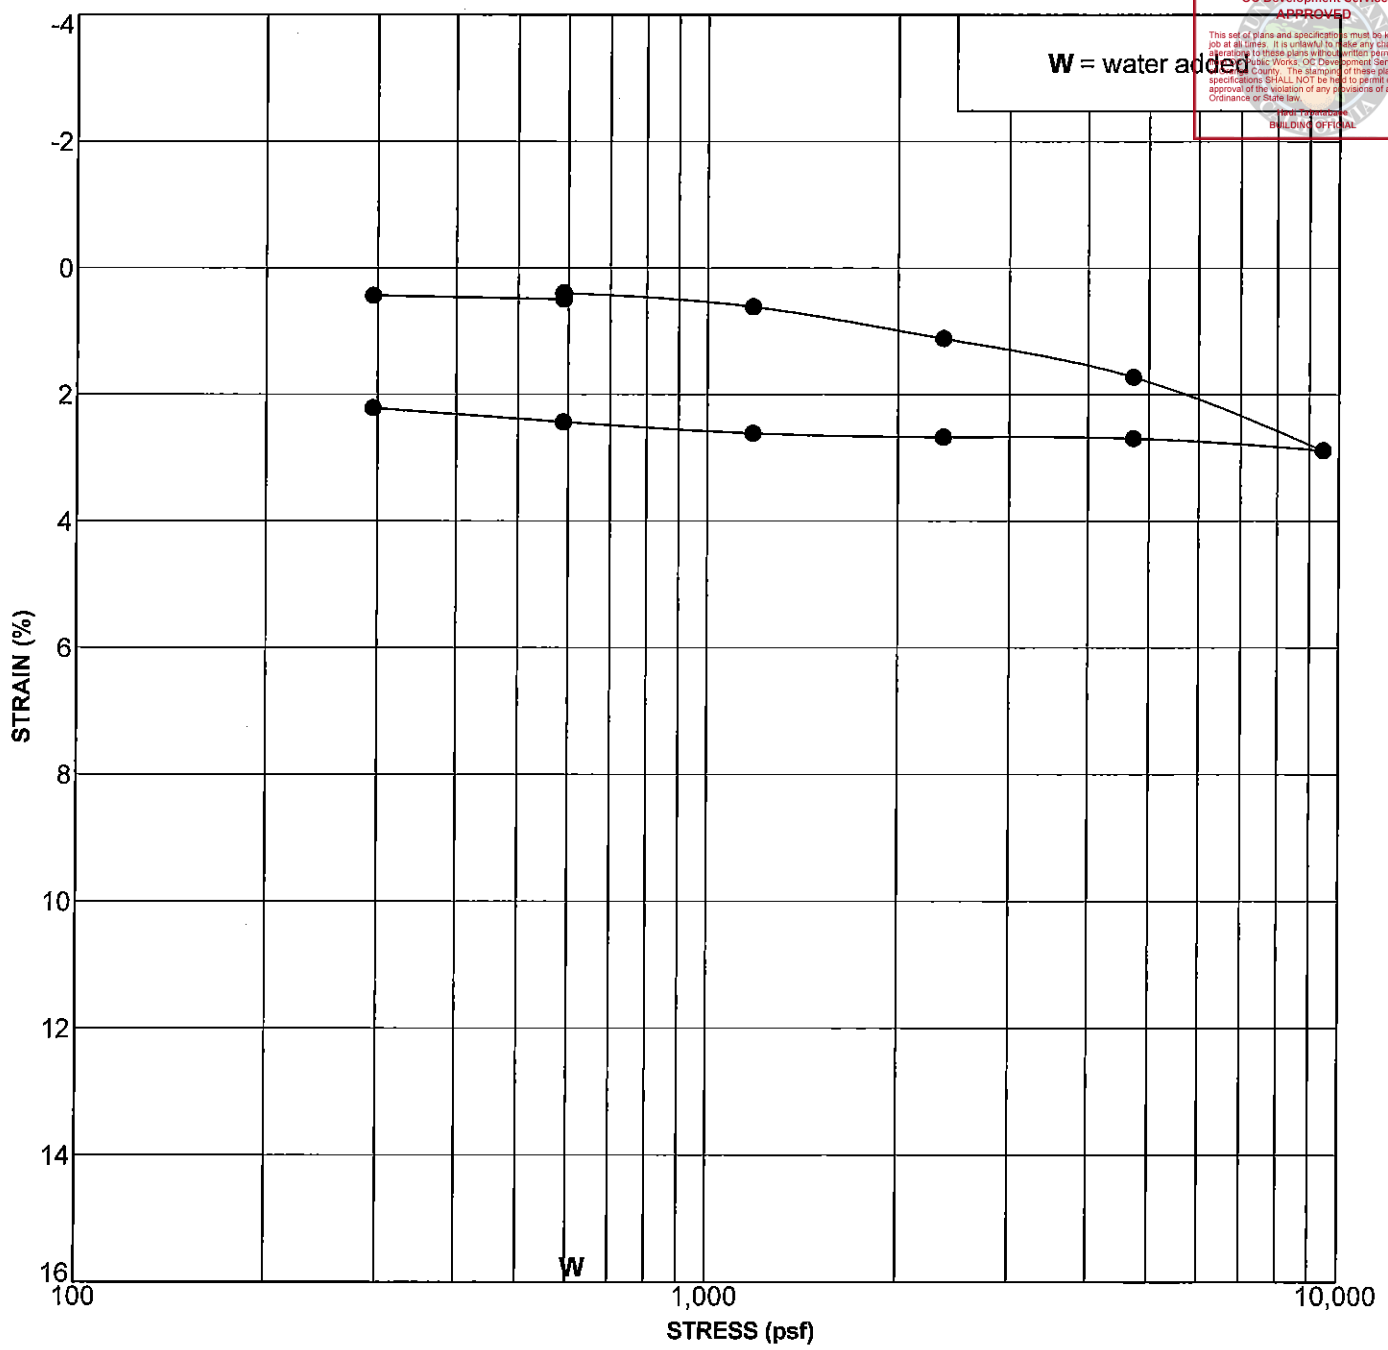

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH-17	4.0	Qaf	●	In Situ	-0.1	Silty Sand and Sandy Clay (SM/SC)
			⊠	In Situ		
			▲	In Situ		
			★	In Situ		

GMU_CONSOL 11-161-00.GPJ GM&U.GDT 10/23/12

CONSOLIDATION TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services Division, County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Nick Tabbabaee
BUILDING OFFICIAL

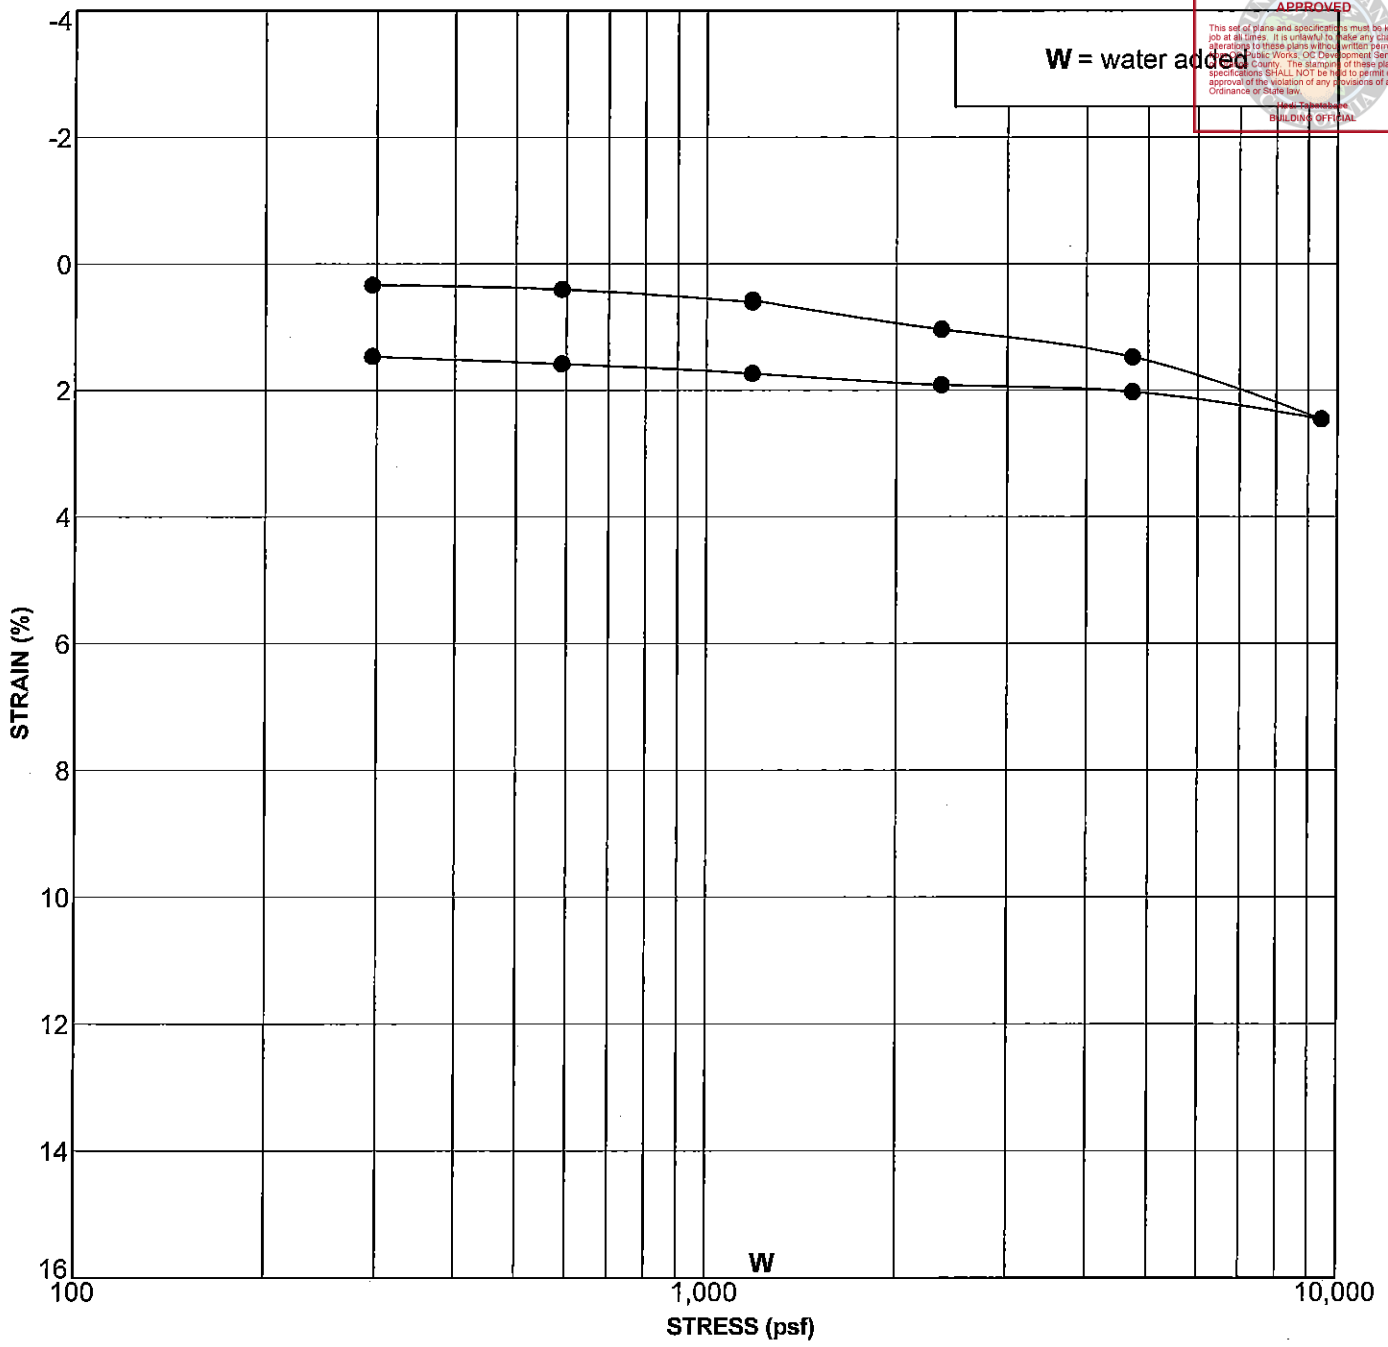

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH-19	9.0	Qaf	●	In Situ	-0.03	Silty Clay and Silty Sand (CL/SM)
			⊠	In Situ		
			▲	In Situ		
			★	In Situ		

GMU_CONSOL 11-161-00.GPJ GMU.GDT 10/23/12

CONSOLIDATION TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services Division, County. The stamping of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

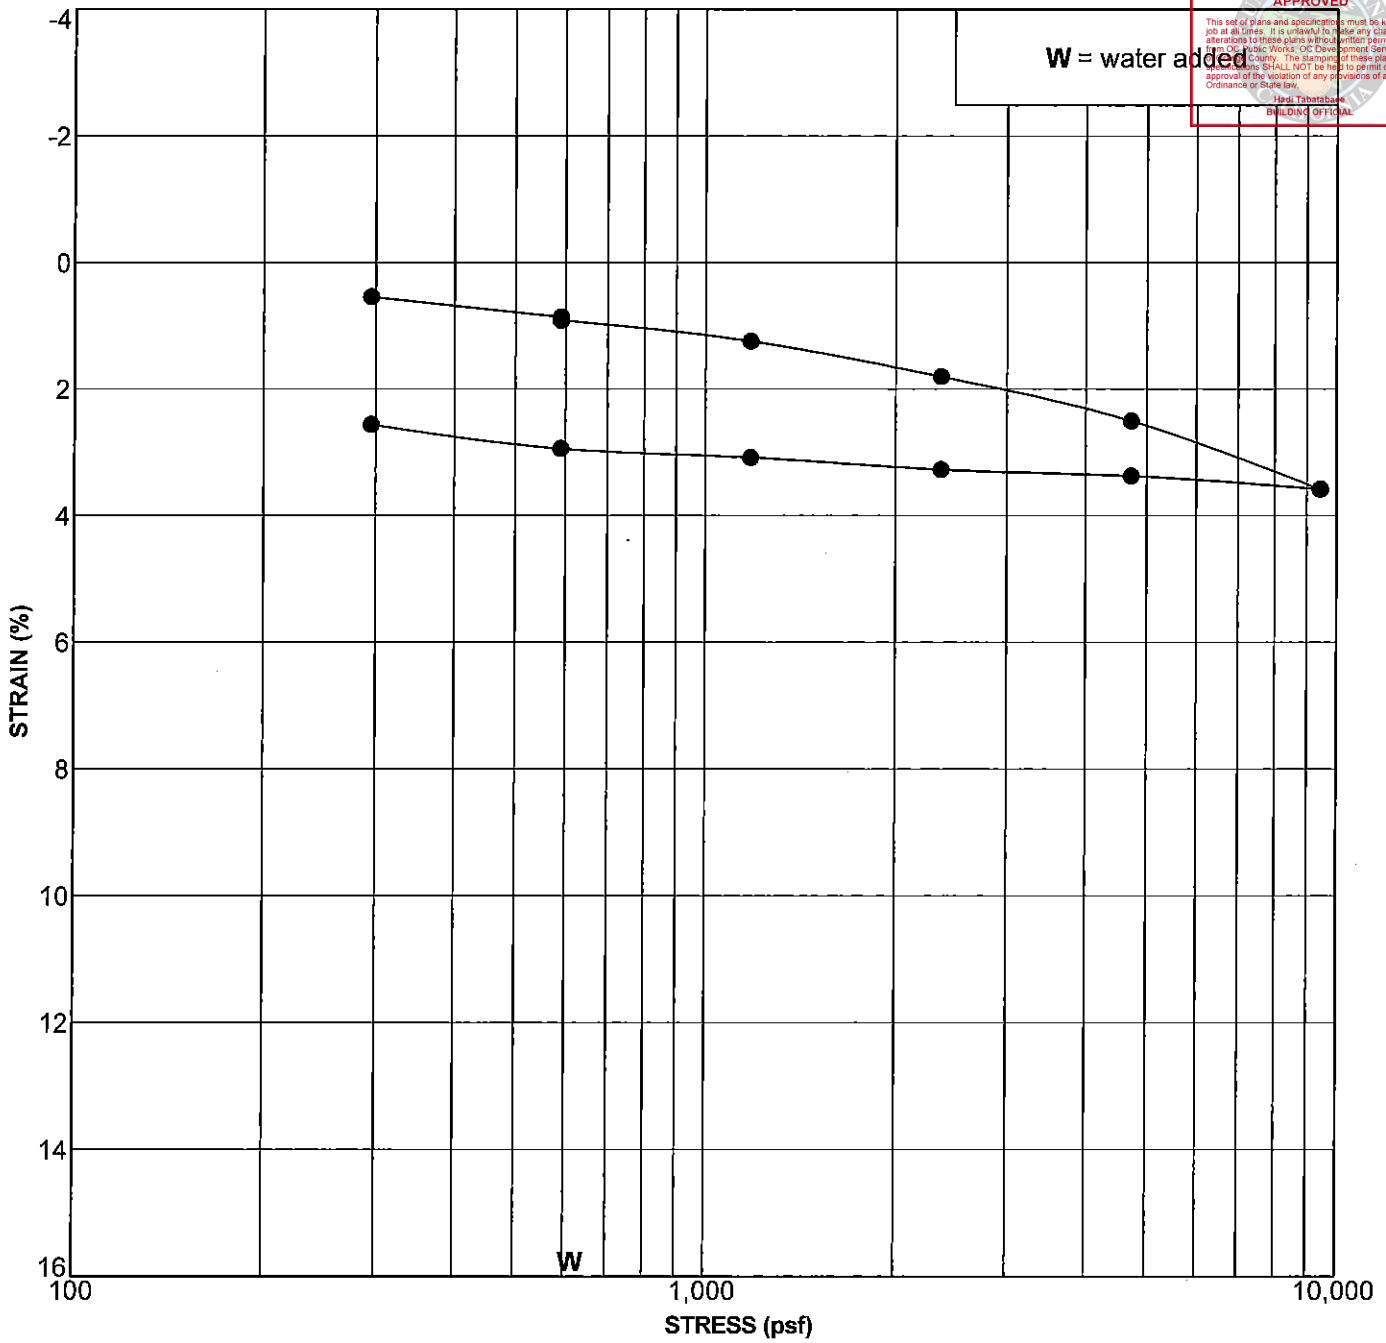

Boring Number	Depth (feet)	Geologic Unit	Symbol	In Situ or Remolded Sample	% Hydro-Collapse	Classification
DH-20	2.0	Qaf	●	In Situ	0.05	Clayey Sand (SC)
			⊠	In Situ		
			▲	In Situ		
			★	In Situ		

GMU_CONSOL 11-161-00.GPJ GM&U.GDT 10/23/12

CONSOLIDATION TEST DATA

Project: Dana Point Harbor Revitalization

Project No. 11-161-00

GMU GEOTECHNICAL, INC.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or Statutes.
Hadi Tabatabaee
BUILDING OFFICIAL

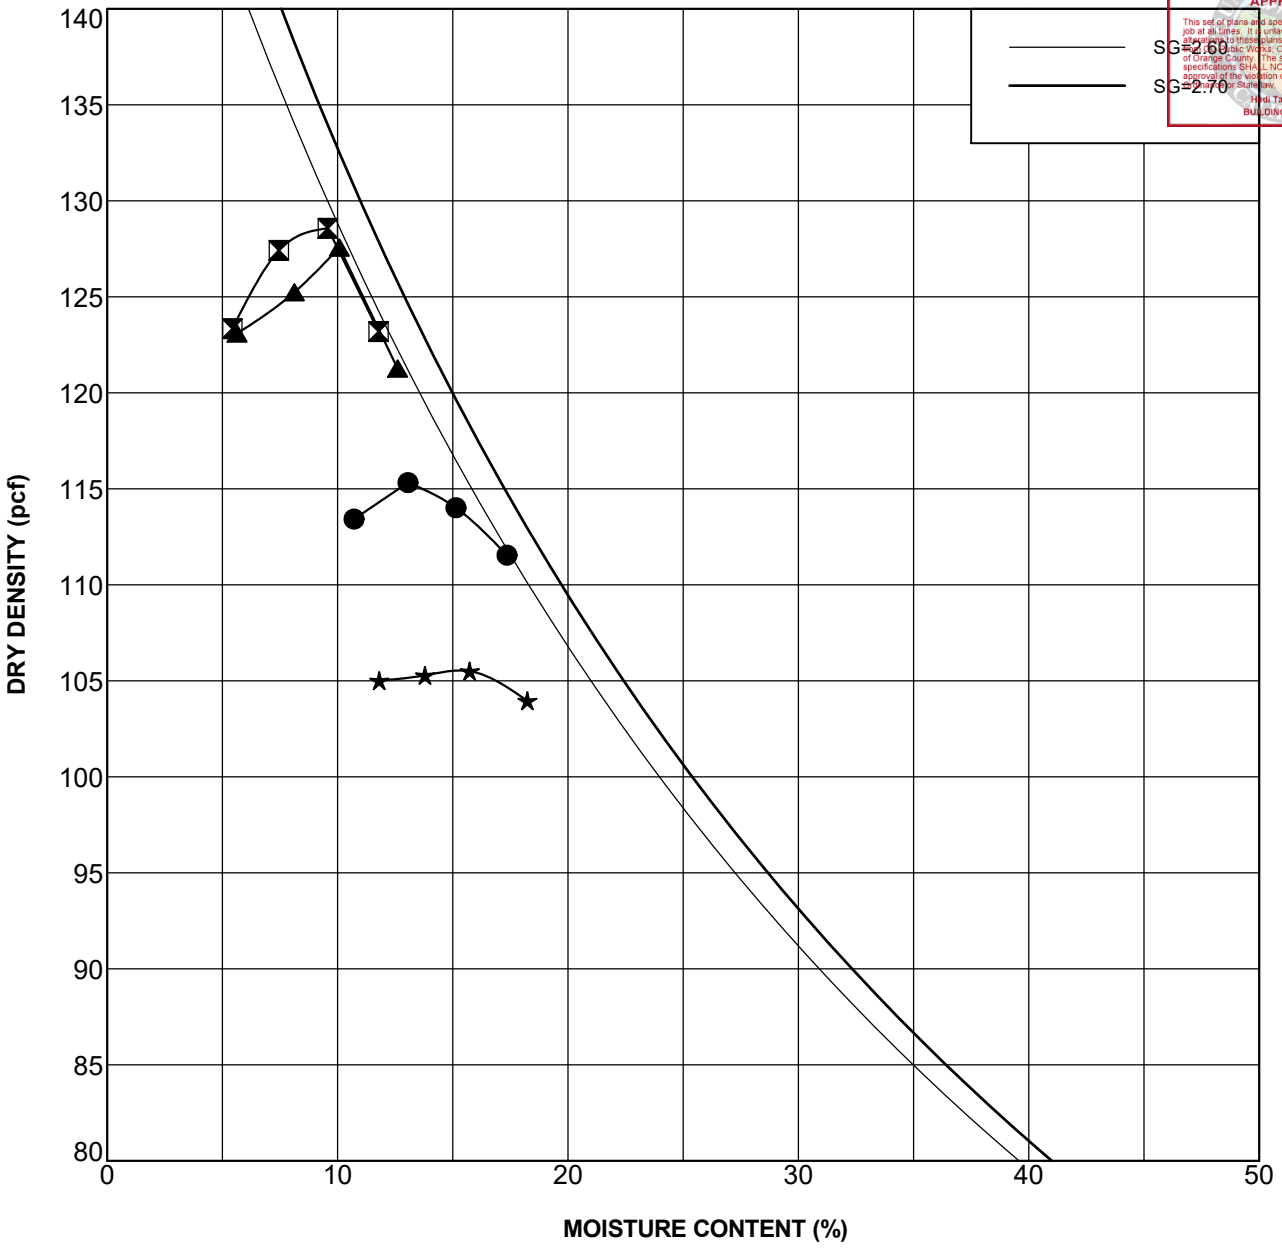

Boring Number	Depth (feet)	Geologic Unit	Symbol	Maximum Dry Density, pcf	Optimum Moisture Content, %	Classification
C-3	1.5	Qaf	●	115.5	13.5	Sandy Silty Clay (CL-ML)
DH-14	0.0	Qaf	⊠	135	8	Clayey Sand w/ some Gravel (SC)
DH-18	0.0	Qaf	▲	127.5	10	Clayey Sand (SC)
DH-20	3.0	Qaf	★	107	14.5	Sandy Clayey Silt (ML-CL)

COMPACTION TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

DVTCOMP 11-161-00 (UPDATED ELEV.).GPJ 2/8/21

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

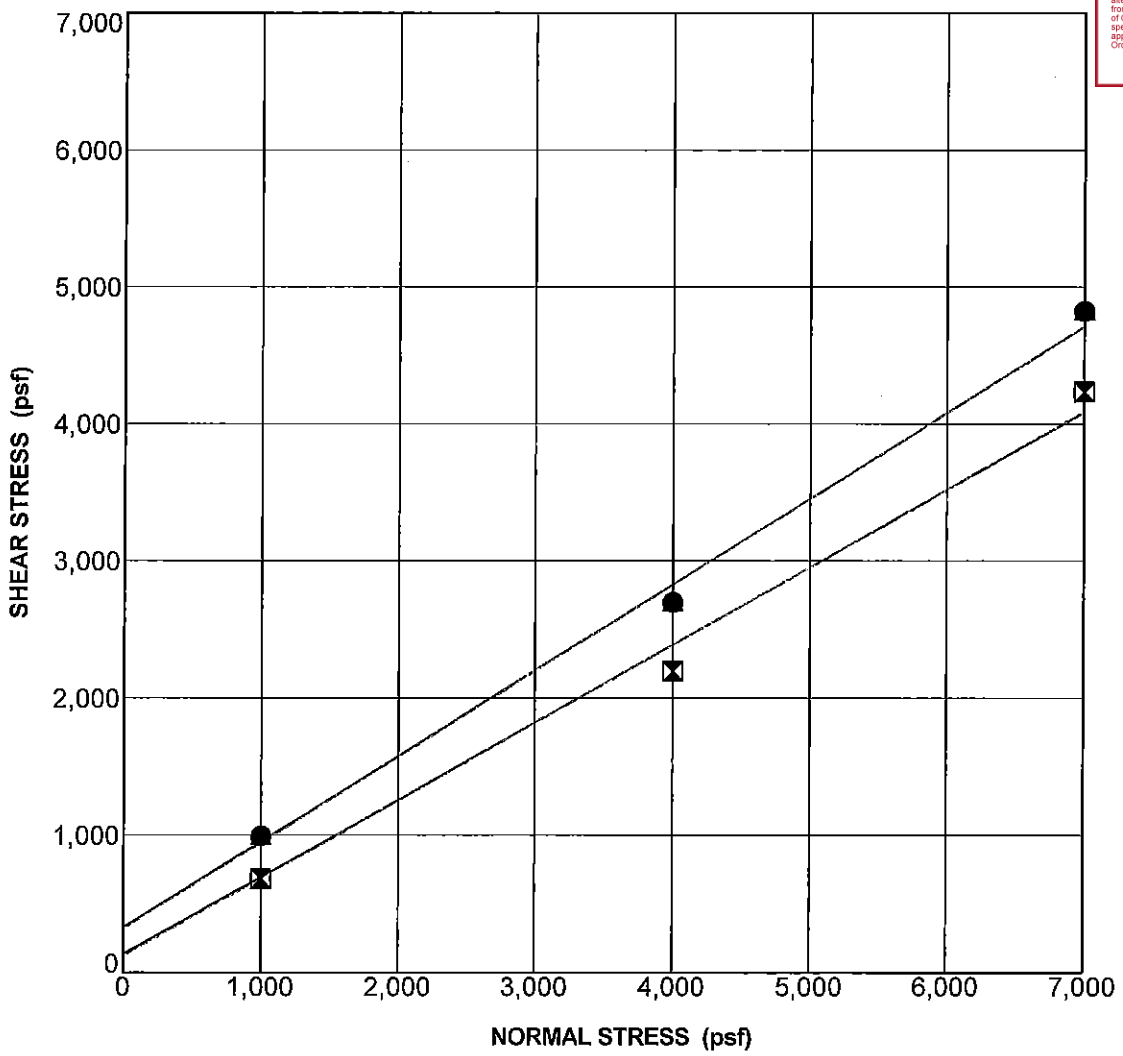

SAMPLE AND TEST DESCRIPTION
Sample Location: DH- 6 @ 4.0 ft **Geologic Unit:** Qaf **Classification:** Sandy Silty Clay (ML-CL)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes:

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	290	32.0
⊠ Ultimate Strength	100	29.0

SHEAR TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

GMU_DIRECT_SHEAR 11-161-00.GPJ GM&U.GDT 10/23/12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

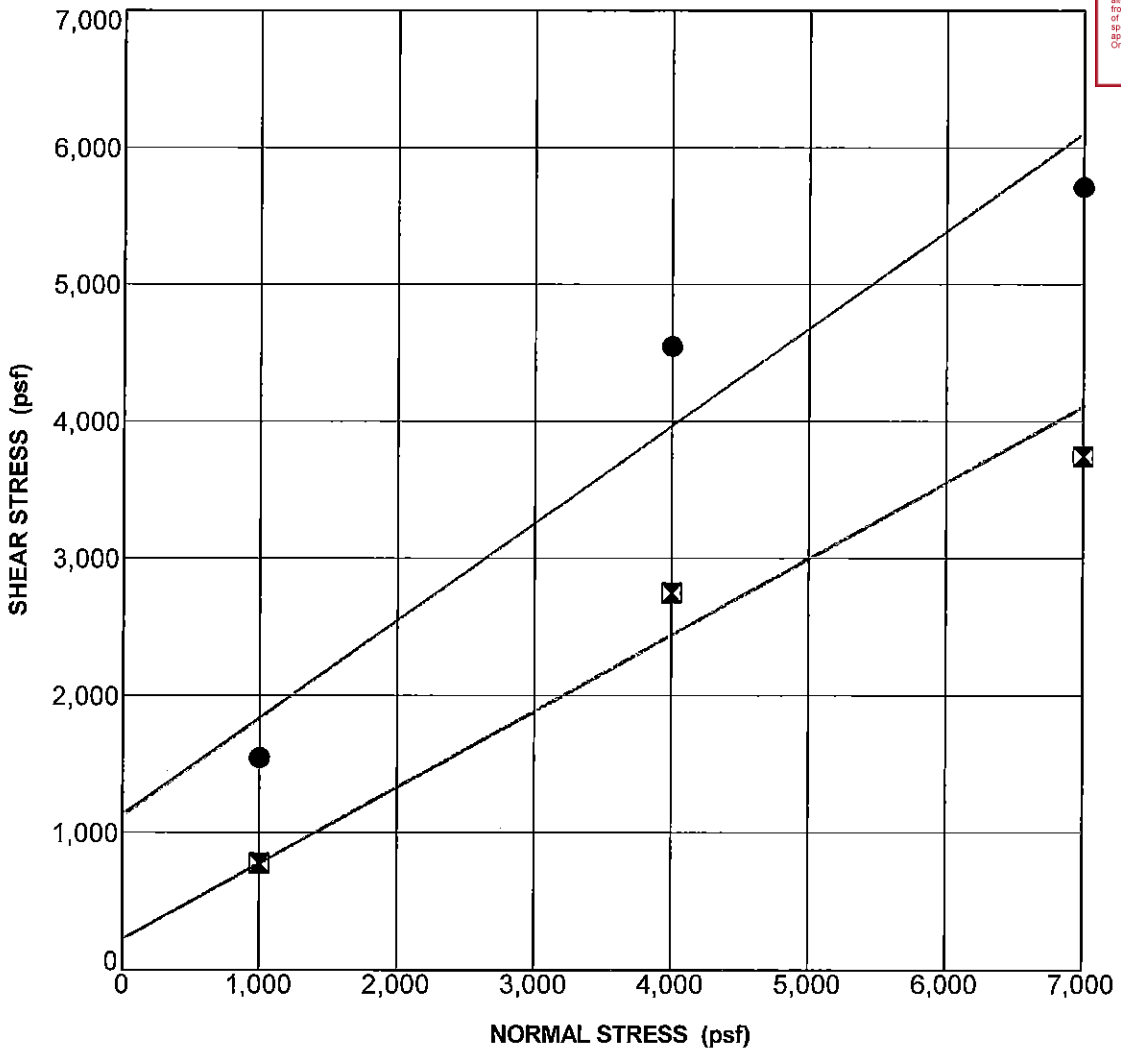

SAMPLE AND TEST DESCRIPTION
Sample Location: DH- 6 @ 29.0 ft **Geologic Unit:** Tc **Classification:** Sity Clay and Silty Sand (CL/SM-SP)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes:

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	1160	35.0
⊠ Ultimate Strength	210	29.0

SHEAR TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

GMU_DIRECT_SHEAR 11-161-00.GPJ GM&U.GDT 10/23/12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans/ specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

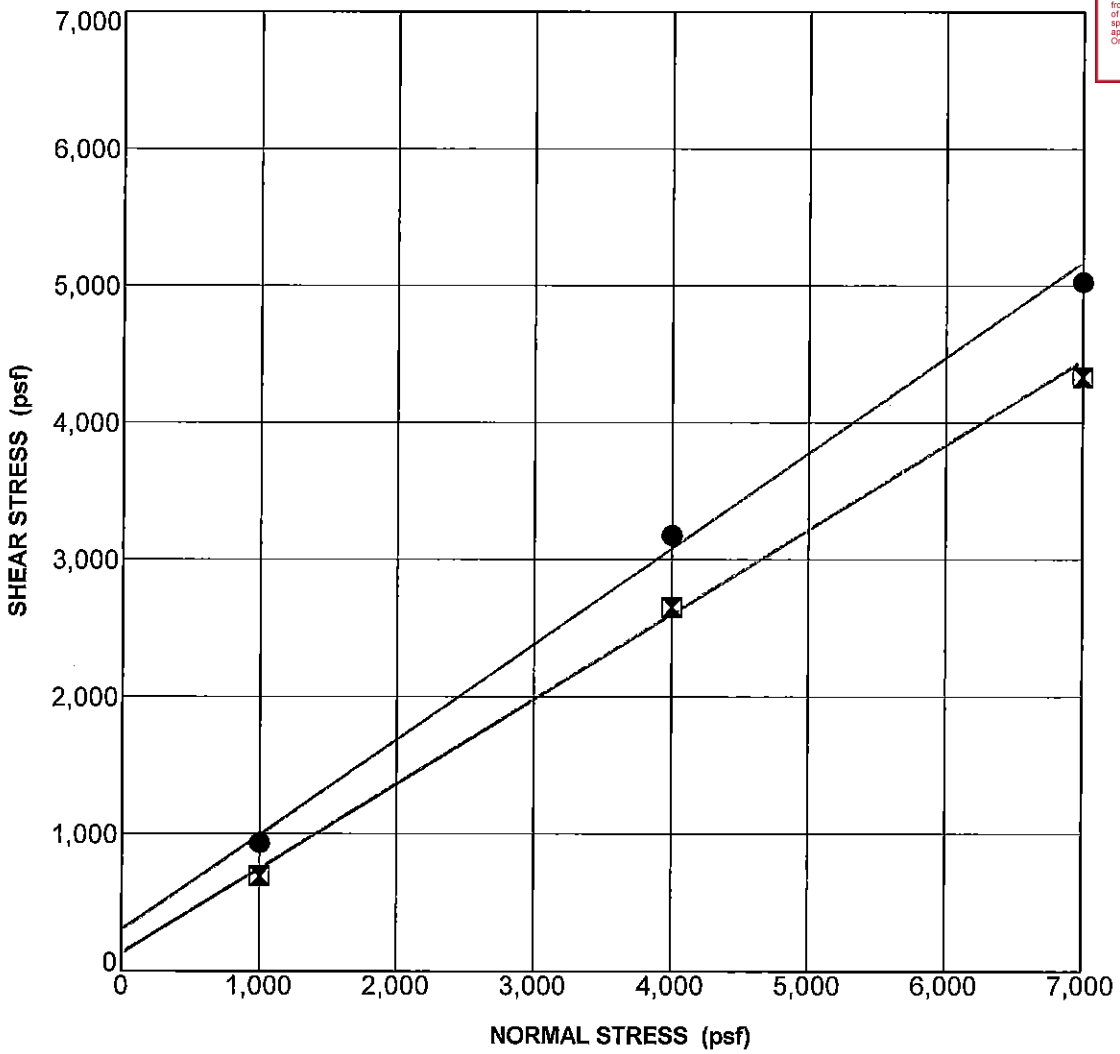

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-12 @ 24.0 ft **Geologic Unit:** Tc **Classification:** Poorly Graded Sand with some Clay (S
Strain Rate (in/min): 0.01 **Sample Preparation:** Undisturbed
Notes:

STRENGTH PARAMETERS		
STRENGTH TYPE	COHESION (psf)	FRICTION ANGLE (degrees)
● Peak Strength	320	34.0
⊠ Ultimate Strength	137	31.0

SHEAR TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

GMU_DIRECT_SHEAR 11-161-00.GPJ GM&U.GDT 10/23/12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

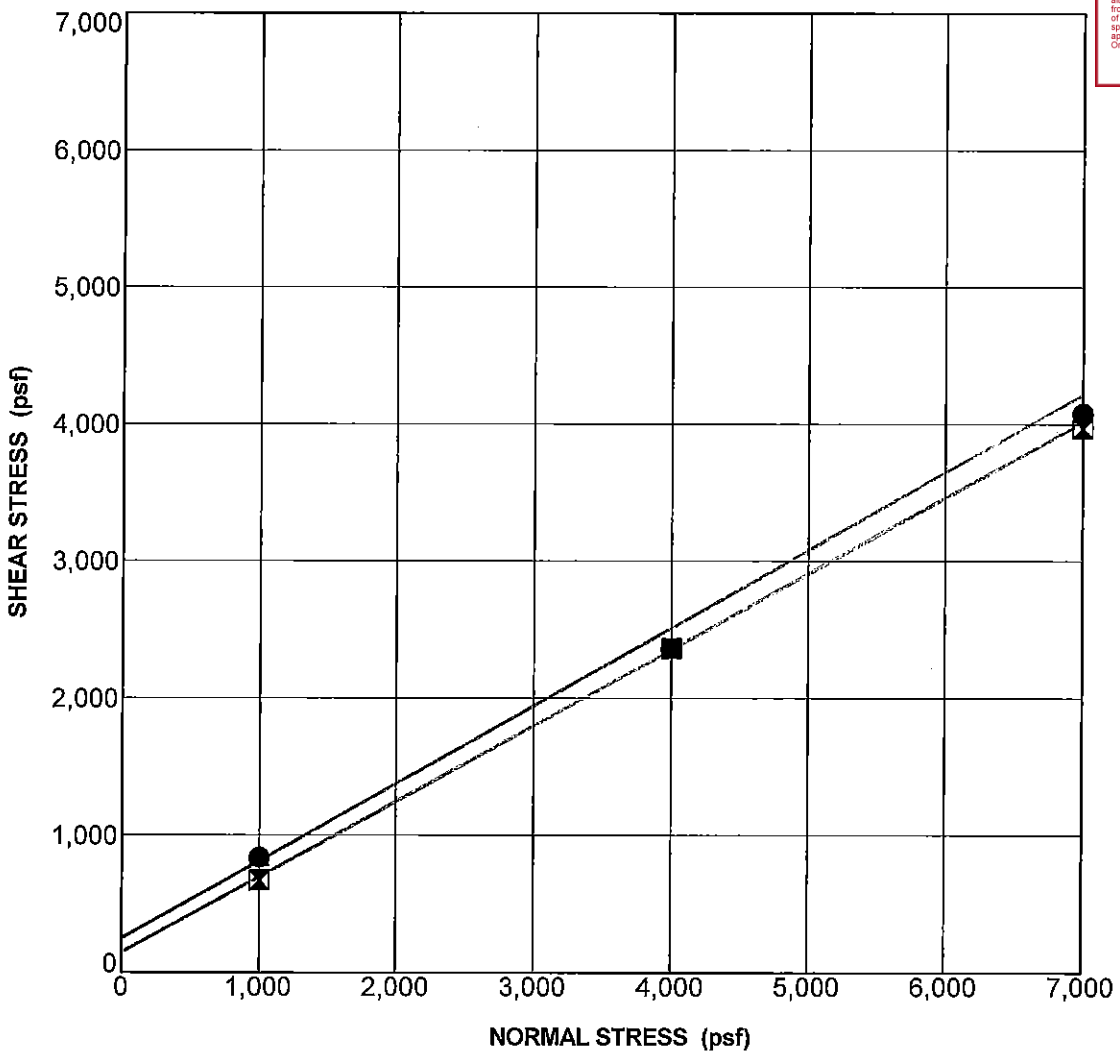

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-14 @ 0.0 ft **Geologic Unit:** Qaf **Classification:** Clayey Sand w/ some Gravel (SC)
Strain Rate (in/min): 0.005 **Sample Preparation:** Remolded
Notes: 90 % Compaction at Optimum

STRENGTH PARAMETERS		
STRENGTH TYPE	COHESION (psf)	FRICTION ANGLE (degrees)
● Peak Strength	268	28.0
⊠ Ultimate Strength	140	28.0

SHEAR TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

GMU_DIRECT_SHEAR 11-161-00.GPJ GM&U.GDT 10/23/12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

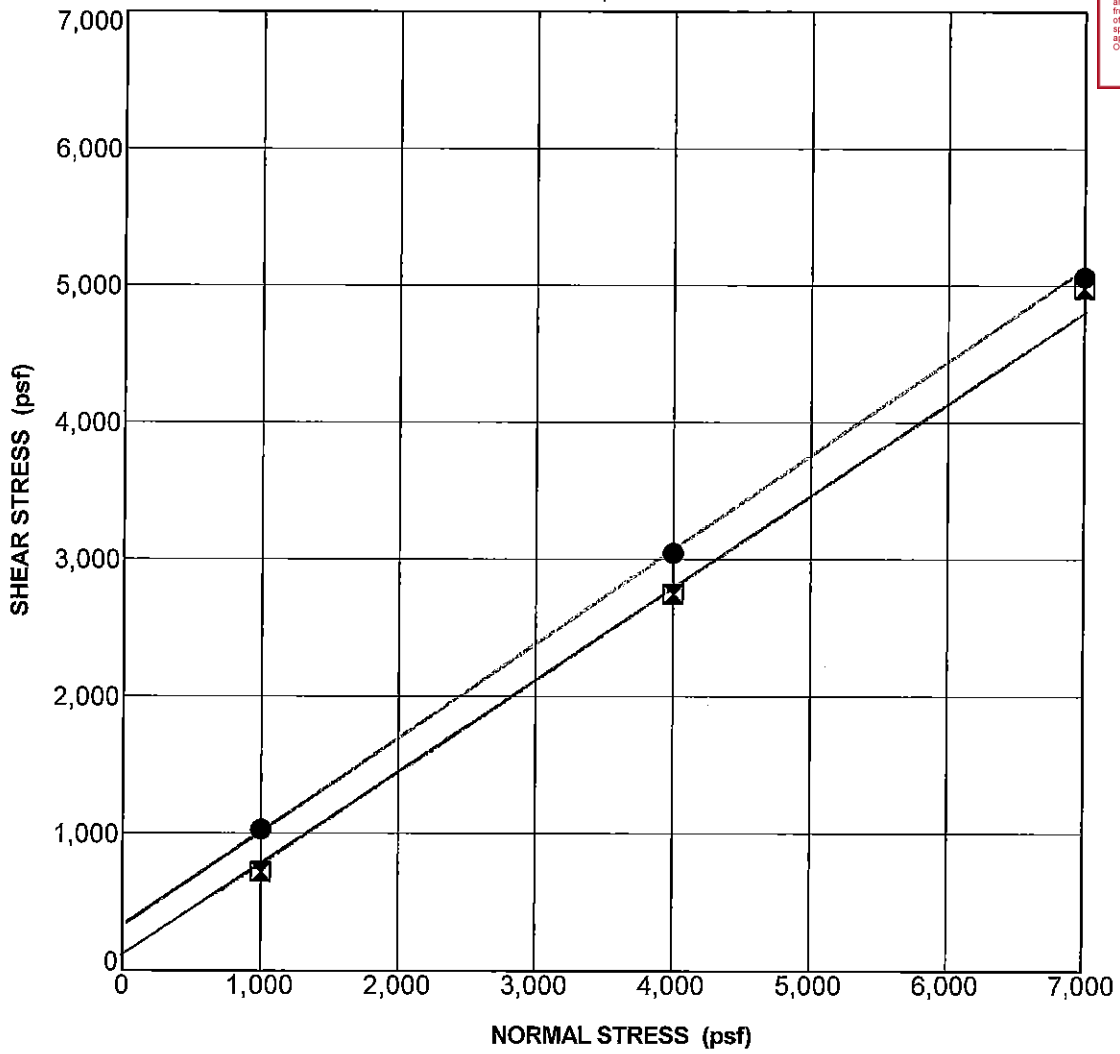

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-14 @ 19.0 ft **Geologic Unit:** Tc **Classification:** Silty Clay / Silty Sand (CL/SM)
Strain Rate (in/min): 0.005 **Sample Preparation:** Undisturbed
Notes:

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	360	34.0
⊠ Ultimate Strength	110	34.0

SHEAR TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

GMU_DIRECT_SHEAR 11-161-00.GPJ GM&U GDT 10/23/12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

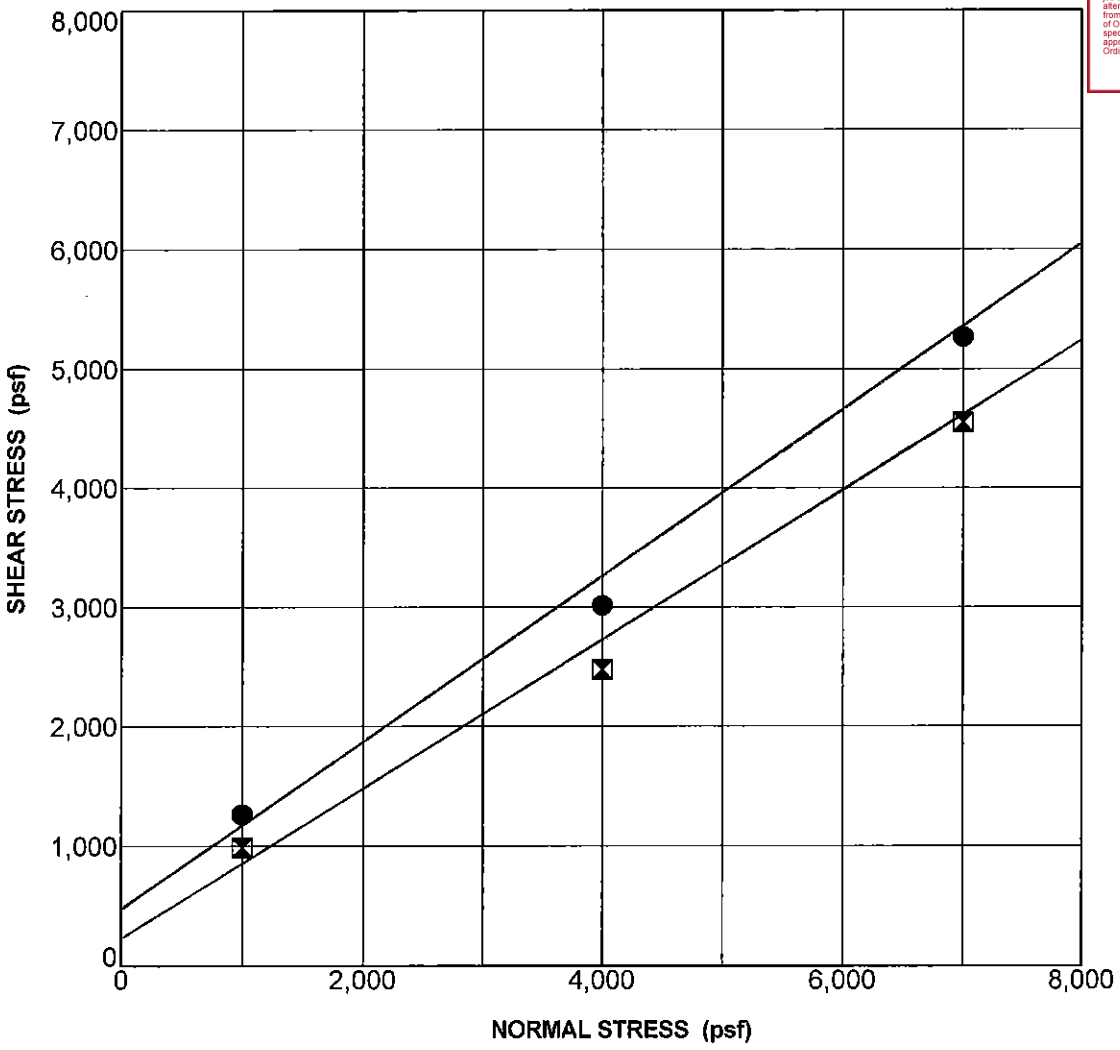

SAMPLE AND TEST DESCRIPTION		
Sample Location: DH-15 @ 4.0 ft	**Geologic Unit:**	**Classification:** Sandy Silt to Silty Sand (ML-SM)
Strain Rate (in/min): 0.005	**Sample Preparation:**	Undisturbed
Notes:		

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	508	34.0
⊠ Ultimate Strength	292	31.0

SHEAR TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

GMU_DIRECT_SHEAR 11-161-00.GPJ GM&U.GDT 10/8/12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

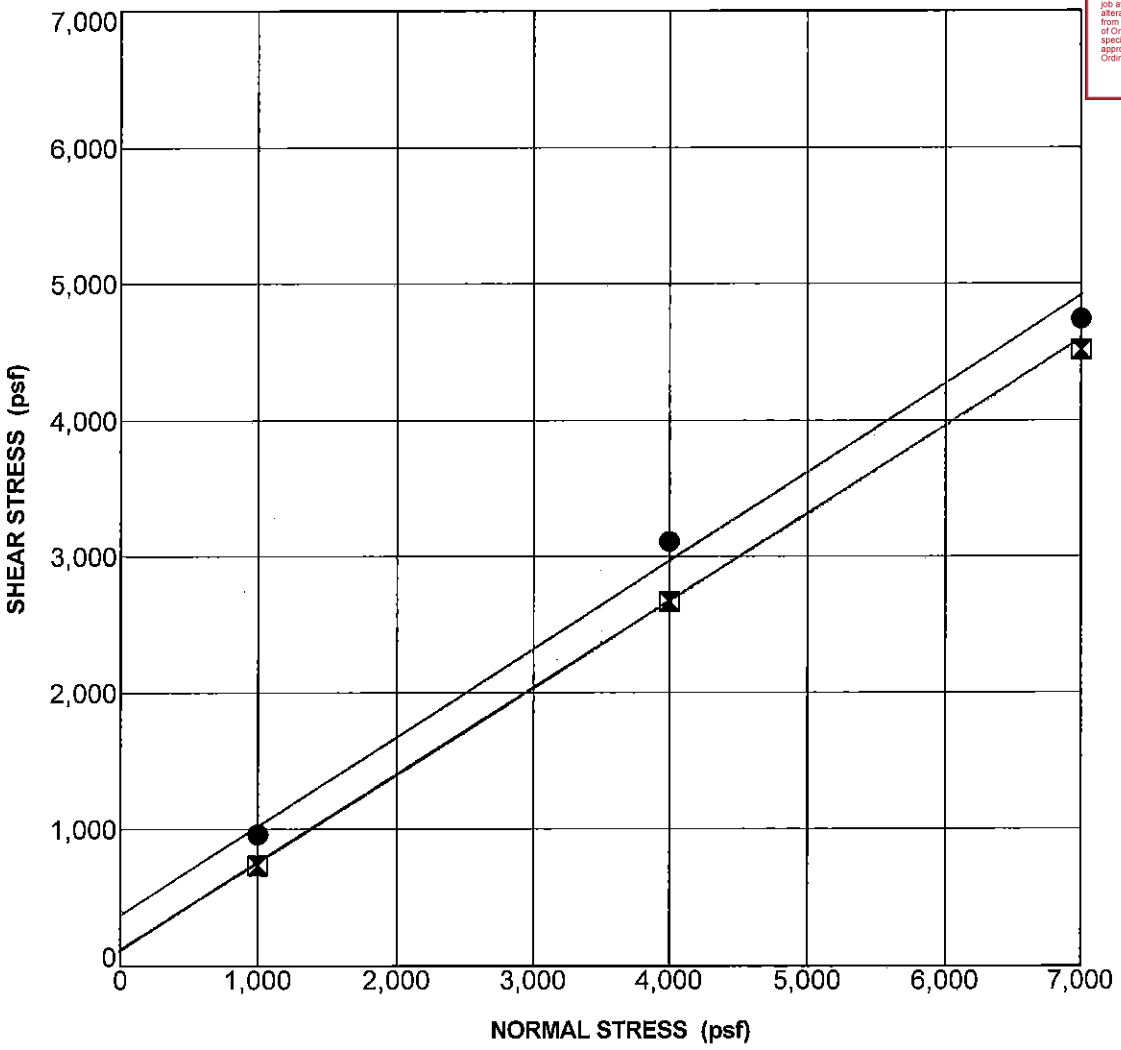

SAMPLE AND TEST DESCRIPTION
Sample Location: DH-18 @ 0.0 ft **Geologic Unit:** **Classification:** Clayey Sand (SC)
Strain Rate (in/min): 0.005 **Sample Preparation:** Remolded
Notes: 90 % Compaction at Optimum

STRENGTH PARAMETERS		
STRENGTH TYPE	**COHESION (psf)**	**FRICTION ANGLE (degrees)**
● Peak Strength	416	32.0
⊠ Ultimate Strength	116	32.0

SHEAR TEST DATA

Project: Dana Point Harbor Revitalization
Project No. 11-161-00

GMU GEOTECHNICAL, INC.

GMU_DIRECT_SHEAR 11-161-00.GPJ GM&U.GDT 10/8/12

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B-2

Previous Laboratory Test Results by Others

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton Consulting, Inc.

SOIL RESISTIVITY TEST
DOT CA TEST 532 / 643

Project Name: WRT / Dana Point
Project No. : 600024-001
Boring No.: B-1
Sample No. : B-1
Visual Soil Identification: Olive Clayey Sand (SC)

Tested By : VJ Date: 11/13/02
Data Input By: FT Date: 11/18/02
Checked By: FT Date: 11/18/02
Depth (ft.) : 1-6

Initial Moisture Content (%)

Wet Wt. of Soil + Cont. (gm	199.50
Dry Wt. of Soil + Cont. (gm.)	187.46
Wt. of Container (gm	67.01
Moisture Content (%) (MC	10.00

Initial Soil Weight (gm)(Wt	1300.00
Box Constant:	6.7460

MC =(((1+Mci/100)x(Wa/Wt+1))-1)x100

Remolded Specimen	Moisture Adjustments				
Water Added (ml) (Wa)	200	300	400	500	
Adj. Moisture Content (MC)	26.92	35.38	43.84	52.30	
Resistance Rdg. (ohm)	57	54	54	55	
Soil Resistivity (ohm-cm)	381	364	364	371	

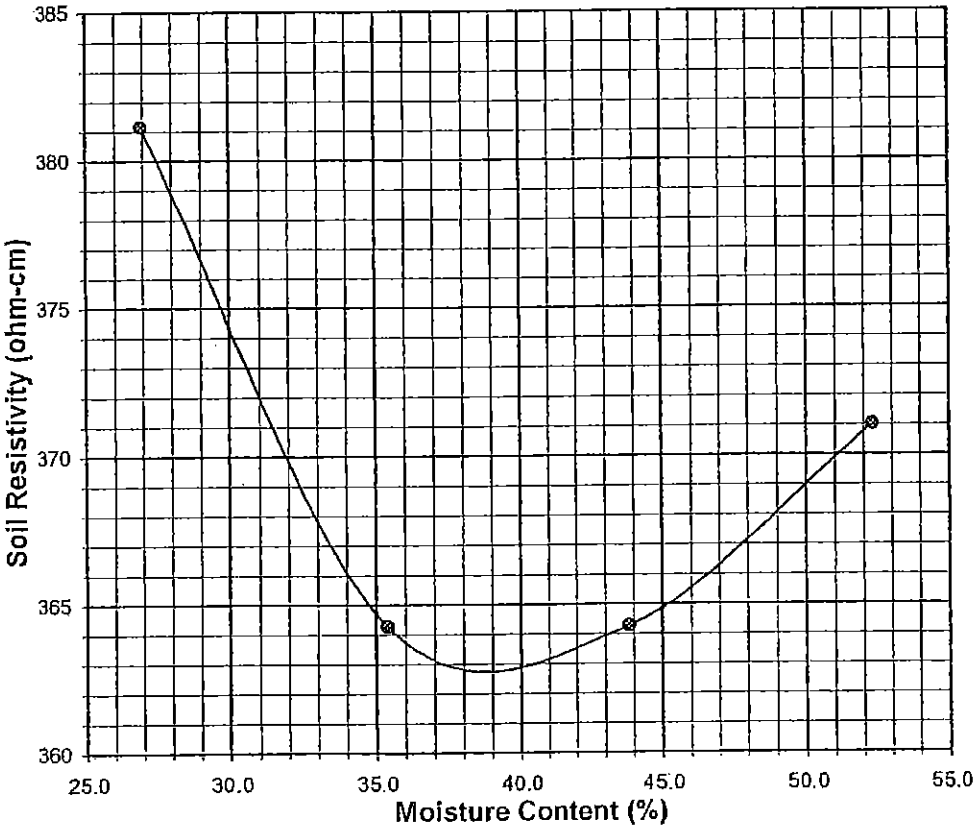

Minimum Resistivity	Moisture Content	Sulfate Content	Chloride Content	Soil pH
DOT CA Test 532 / 643		DOT CA Test 417 Part	DOT CA Test	DOT CA Test 532/643
363	38.5	764	733	7.76 @ 21.3 °C

Figure C-1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

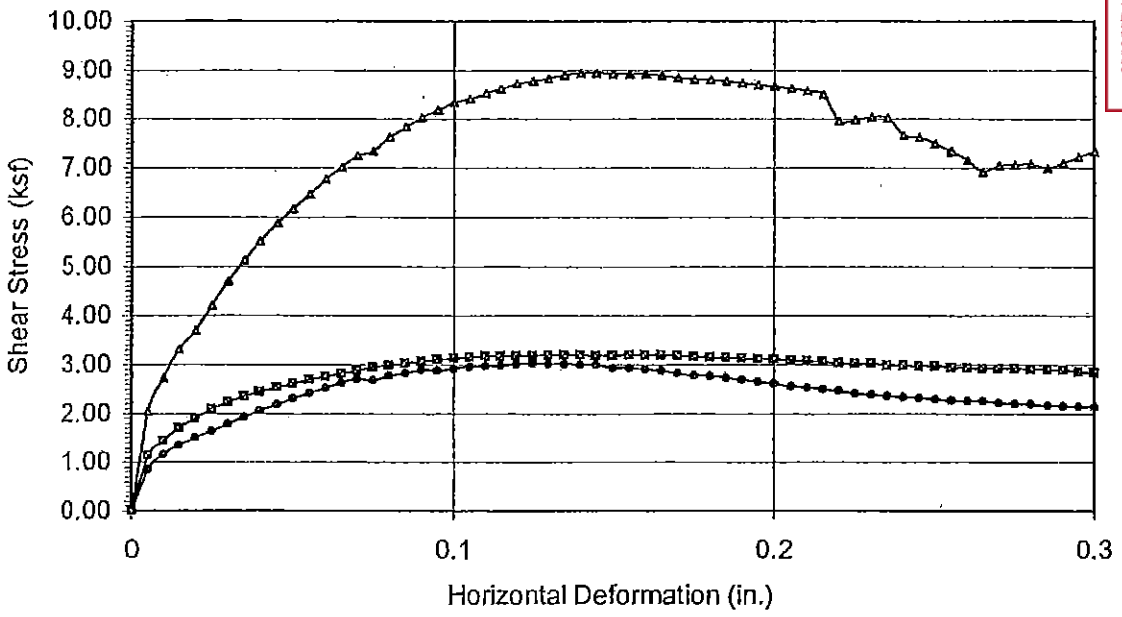

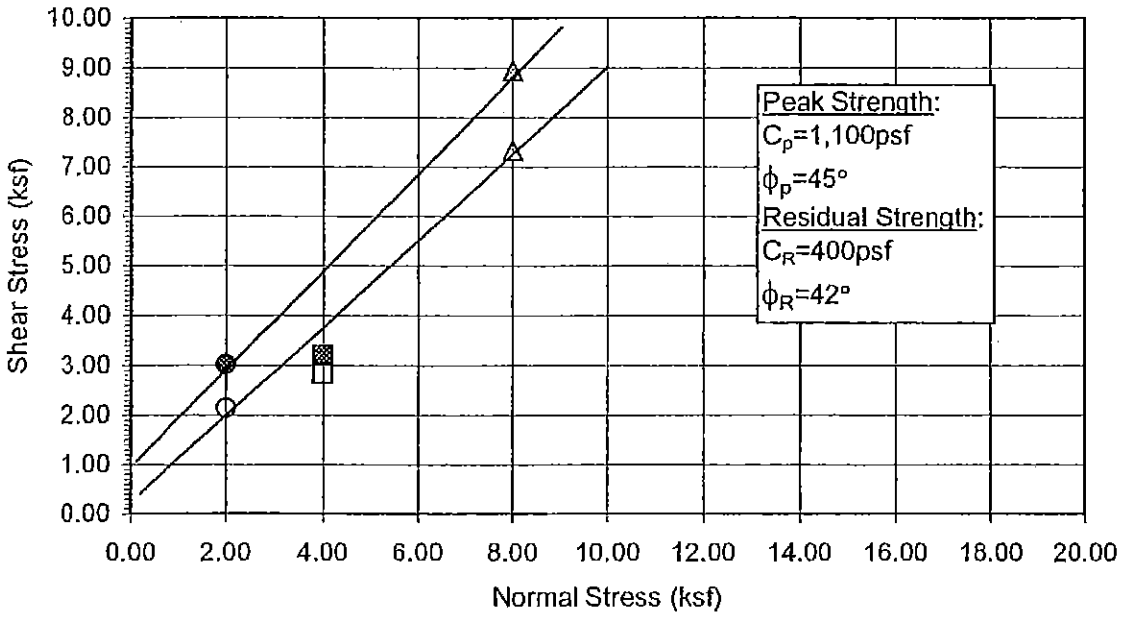

Normal Stress (kip/ft²)	2.000	4.000	8.000
Peak Shear Stress (kip/ft²)	● 3.021	■ 3.196	▲ 8.948
Shear Stress @ End of Test (ksf)	○ 2.139	□ 2.834	△ 7.342
Deformation Rate (in./min.)	0.050	0.050	0.050
Initial Sample Height (in.)	1.000	1.000	1.000
Diameter (in.)	2.415	2.415	2.415
Initial Moisture Content (%)	12.59	12.59	12.59
Dry Density (pcf)	120.2	120.3	123.3
Saturation (%)	84.5	84.6	92.6
Soil Height Before Shearing (in.)	0.9893	0.9839	0.9740
Final Moisture Content (%)	13.9	13.8	12.4

DIRECT SHEAR TEST RESULTS

Consolidated Drained - ASTM D 3080

Leighton Consulting, Inc.

Boring No.: B-3
Sample No.: R-1
Depth (ft) 5
Soil Description: Grayish Olive Brown Sandy Lean Clay (CL) with 1/2 To 3/4" Sandstone

Project No.: 600024-001

WRT / Dana Point

Figure C-2b 12-02

DS B-3 R-1@5

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton Consulting, Inc.

EXPANSION INDEX of SOILS

ASTM D 4829

Project Name:	WRT / Dana Point	Tested By:	JHW	Date:	11/14/02
Project No. :	600024-001	Checked By:	FT	Date:	11/18/02
Boring No.:	B-1	Depth (ft.)	1-6		
Sample No. :	B-1				

Visual Sample Description: Brown Clayey Sand (SC)

Dry Wt. of Soil + Cont. (gm.)	1000.00
Wt. of Container No. (gm.)	0.00
Dry Wt. of Soil (gm.)	1000.00
Weight Soil Retained on #4 Sieve	0.00
Percent Passing # 4	100.00

MOLDED SPECIMEN	Before Test	After Test
Specimen Diameter (in.)	4.01	4.01
Specimen Height (in.)	1.0000	1.0205
Wt. Comp. Soil + Mold (gm.)	624.80	441.80
Wt. of Mold (gm.)	206.10	0.00
Specific Gravity (Assumed)	2.70	2.70
Container No.	0	0
Wet Wt. of Soil + Cont. (gm.)	843.70	647.90
Dry Wt. of Soil + Cont. (gm.)	781.90	594.10
Wt. of Container (gm.)	0.00	206.10
Moisture Content (%)	7.90	13.87
Wet Density (pcf)	126.3	130.6
Dry Density (pcf)	117.0	114.7
Void Ratio	0.440	0.470
Total Porosity	0.306	0.320
Pore Volume (cc)	63.3	67.5
Degree of Saturation (%) [S_{meas}]	**48.5**	79.7

SPECIMEN INUNDATION in distilled water for the period of 24 h or expansion rate < 0.0002 in./h.

Date	Time	Pressure (psi)	Elapsed Time (min.)	Dial Readings (in.)
11/14/02	16:37	1.0	0	0.0785
11/14/02	16:47	1.0	0	0.0780
Add Distilled Water to the Specimen				
11/15/02	8:22	1.0	0	0.0990
11/15/02	10:54	1.0	0	0.0990

Expansion Index (EI_{meas}) = ((Final Rdg - Initial Rdg) / Initial Thick.) x 1000	21.0
Expansion Index ($EI)_{50}$ = EI_{meas} - (50 -S_{meas})x((65+EI_{meas}) / (220-S_{meas}))	**20**

Figure C-3b

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations on these plans without written permission from OC Public Works / OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton Consulting, Inc.

R-VALUE TEST RESULTS

PROJECT NAME:	WRT / Dana Point	PROJECT NUMBER:	600024-001
SAMPLE NUMBER:	B-1	SAMPLE LOCATION:	B-3 1-6'
SAMPLE DESCRIPTION:	Sandy Clay (CLS)	TECHNICIAN:	SCF
		DATE SAMPLED	11/6/2002

TEST SPECIMEN	a	b	c
MOISTURE AT COMPACTION %	11.0	11.5	11.7
HEIGHT OF SAMPLE, Inches	2.47	2.49	2.47
DRY DENSITY, pcf	123.1	122.3	122.3
COMPACTOR AIR PRESSURE, psf	150	100	75
EXUDATION PRESSURE, psf	362	299	278
EXPANSION, Inches x 10exp-4	14	10	0
STABILITY Ph 2,000 lbs (160 psi)	43	68	86
TURNS DISPLACEMENT	3.70	3.91	4.02
R-VALUE UNCORRECTED	65	46	35
R-VALUE CORRECTED	65	46	35

DESIGN CALCULATION DATA	a	b	c
GRAVEL EQUIVALENT FACTOR	1.0	1.0	1.0
TRAFFIC INDEX	5.0	5.0	5.0
STABILOMETER THICKNESS, ft.	0.56	0.86	1.04
EXPANSION PRESSURE THICKNESS, ft.	0.47	0.33	0.00

EXPANSION PRESSURE CHART

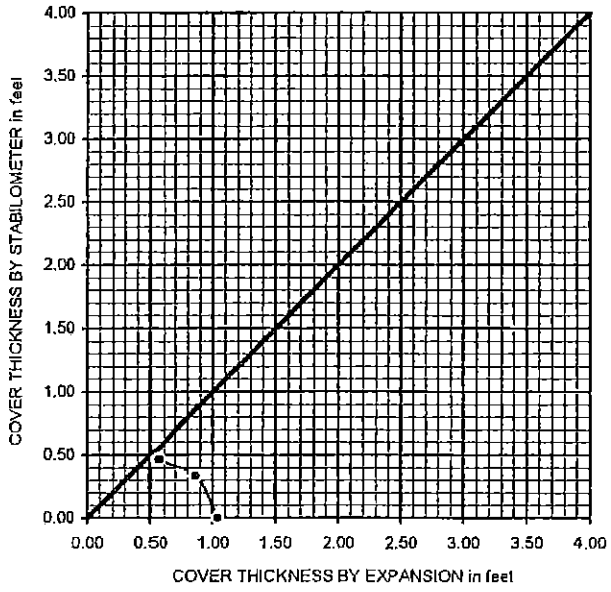

EXUDATION PRESSURE CHART

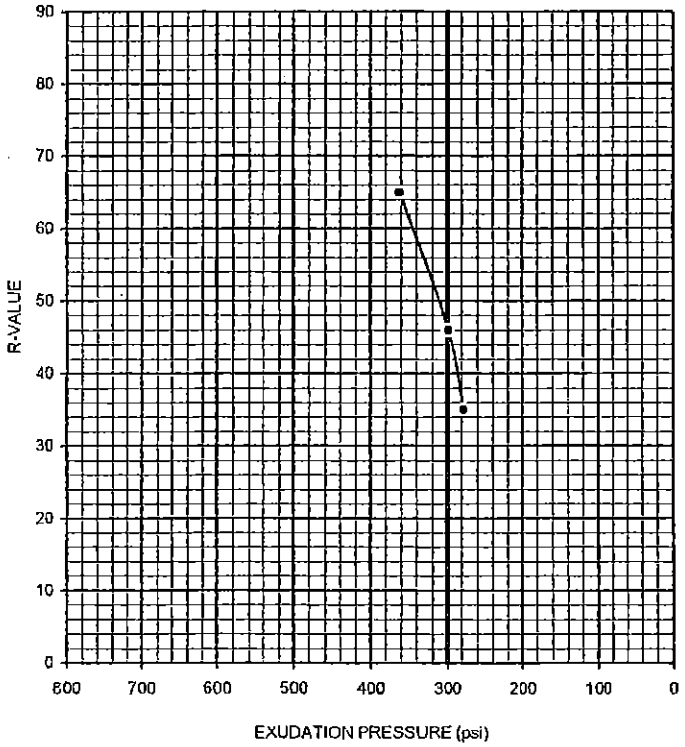

R-VALUE BY EXPANSION:	69
R-VALUE BY EXUDATION:	46
EQUILIBRIUM R-VALUE:	46

Figure C-4b

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

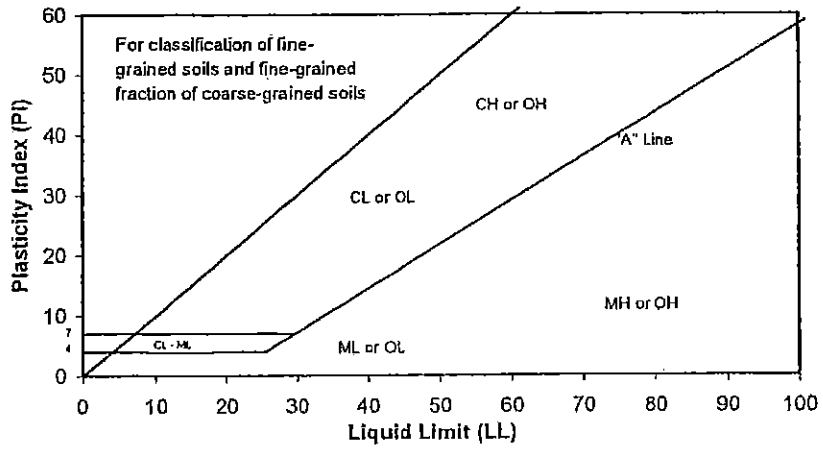

GRAVEL		SAND			FINES
COARSE	FINE	CRSE	MEDIUM	FINE	SILT
U.S. STANDARD SIEVE OPENING		U.S. STANDARD SIEVE NUMBER			HYDROMETER

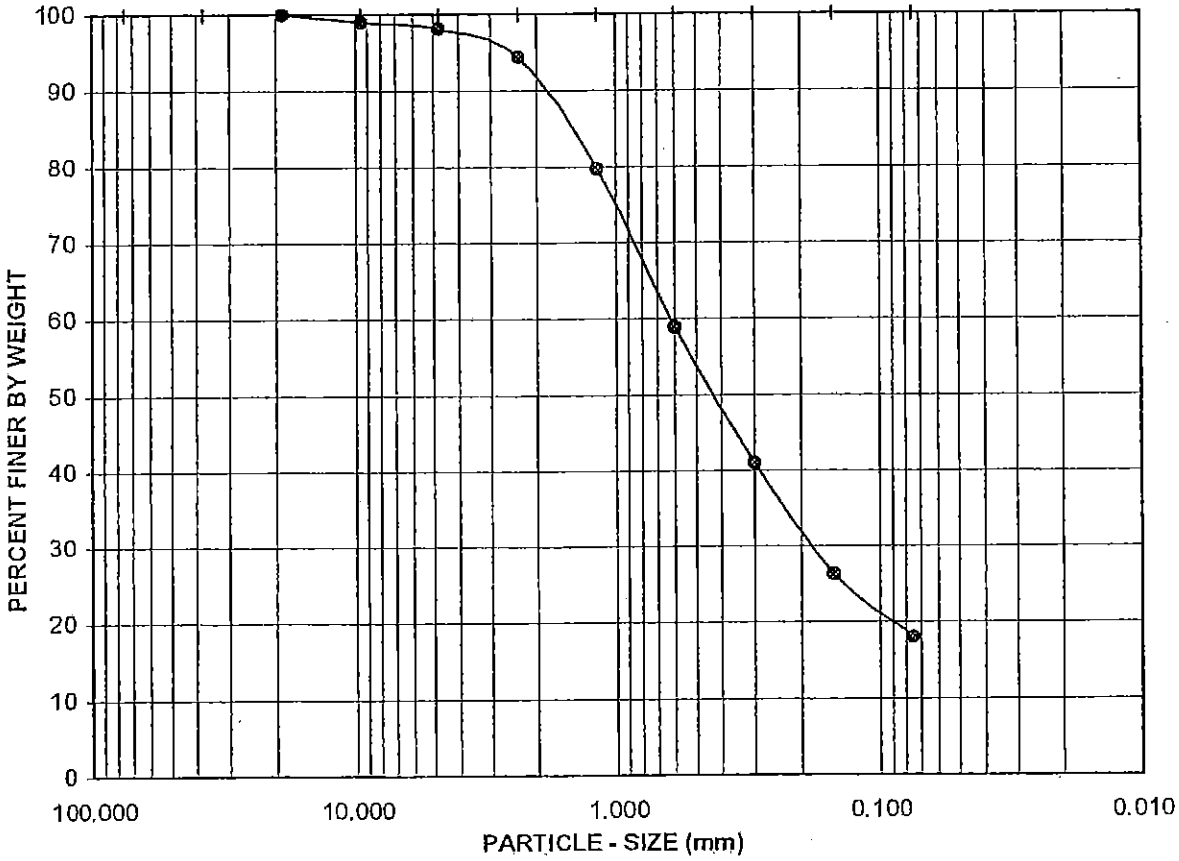

Boring No.:	Sample No.:	Depth (ft.):	Soil Type	GR:SA:FI	LL,PL,PI
B-3	R-2	6-10	(SC)	2 : 80 : 18	N/A

Visual Sample Description:
Clayey Sand (SC)

Leighton Consulting, Inc.

Project No.:	600024-001
WRT / Dana Point	
ATTERBERG LIMITS, PARTICLE - SIZE CURVE ASTM D 4318, D 422	
Figure C-5	12-02

Sieve B-3, B-2@ 6_10

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX B - LABORATORY TESTING

Diaz•Yourman & Associates (DYA) selected soil samples to be tested and the tests to be performed on the selected samples. Laboratory testing was performed by Hushmand Associates, Inc. Laboratory data are summarized on the boring logs in Appendix A and presented on Plates B1 through B14. We have reviewed and concur with the test results and accept full responsibility for their use in our analysis. A summary of the geotechnical laboratory testing is presented in Table B1. Corrosion potential test results are summarized in Table B2.

Table B1 - LABORATORY TESTING SUMMARY

TEST NAME	PROCEDURE	PURPOSE	LOCATION
Percent Passing the No. 200 Sieve	ASTM D1140-92	Classification, index properties	Boring Logs
Moisture Content, Dry Density	ASTM D2216-92	Classification, index properties	Boring Logs
Grain-Size Distribution	ASTM D422-63	Classification, index properties	Plate B1
Atterberg Limits	ASTM D-4318-93	Expansion potential, classification, index properties	Plate B2
Direct Shear	ASTM D3080-90	Shear strength	Plates B3 and B4
Compaction	ASTM D1557-91	Earthwork	Plates B5 and B6
Resistance (R-) Value	ASTM D2844-69 CTM 301	Pavement thickness design	Plates B7 through B10
pH	CTM 532	Corrosion potential	Plates B11 through B14 and Table B2
Resistivity	CTM 532	Corrosion potential	Plates B11 through B14 and Table B2
Soluble Sulfates	CTM 417-B	Corrosion potential	Plates B11 through B14 and Table B2
Soluble Chlorides	CTM 422	Corrosion potential	Plates B11 through B14 and Table B2

Notes:
- ASTM = American Society for Testing and Materials
- CTM = Caltrans Test Method

Table B2 - CORROSION POTENTIAL TEST RESULTS

Boring No.	B-1	B-2	B-3	B-4
Depth (feet)	5	0-5	0-5	0-5
pH	7.52	9.26	7.35	7.41
Water Soluble Sulfate Content (ppm)	291	190	250	471
Water Soluble Chloride Content (ppm)	311	1387	702	2420
Minimum Resistivity/Moisture Content (ohms-cm / %)	666/24.5	341/34	511/34	179/28.6

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission of the Director, Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Template: DY_SIEVE_WIN

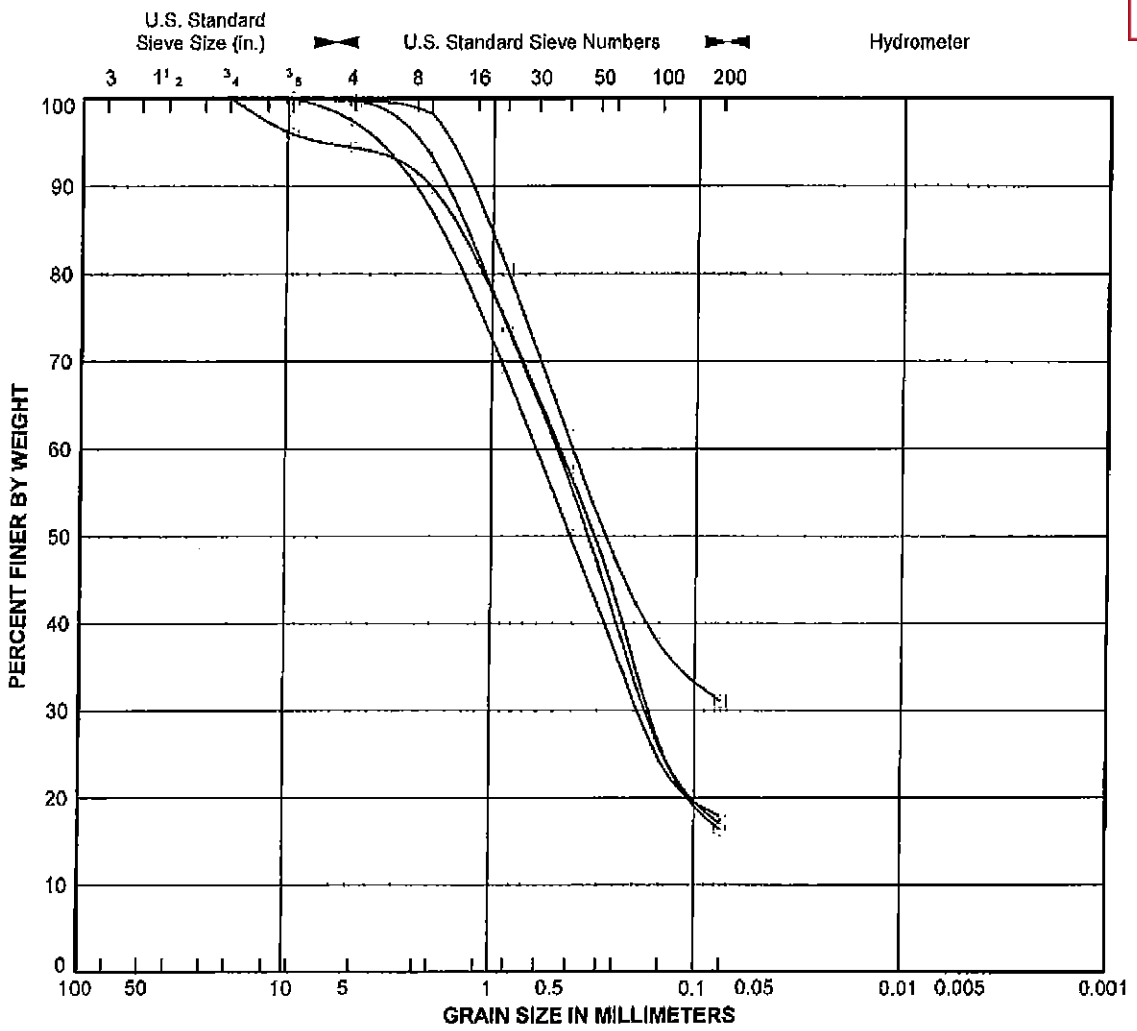

COBBLES	GRAVEL: Coarse / Fine	SAND: Coarse / Medium / Fine	SILT or CLAY

Laboratory Testing by: Hushmand Associates, Inc.

Symbol	Source	Depth (feet)	Classification	Natural M. C. (%)	Liquid Limit (%)	Plasticity Index (%)	% Passing #200 Sieve
	B- 1	5.0	SILTY SAND (SM)	17	NP	NP	16
	B- 2	3.0	SILTY SAND (SM)	10			31
	B- 3	2.5	SILTY SAND (SM)		NP	NP	17
	B- 4	2.0	CLAYEY SAND (SC)	8	30	10	18

PARTICLE SIZE ANALYSIS

Dana Point Boat Launch

Project No. 2005-022

PLATE

B1

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the construction site at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Template: DY_ATTERBERG_CHART_WIN

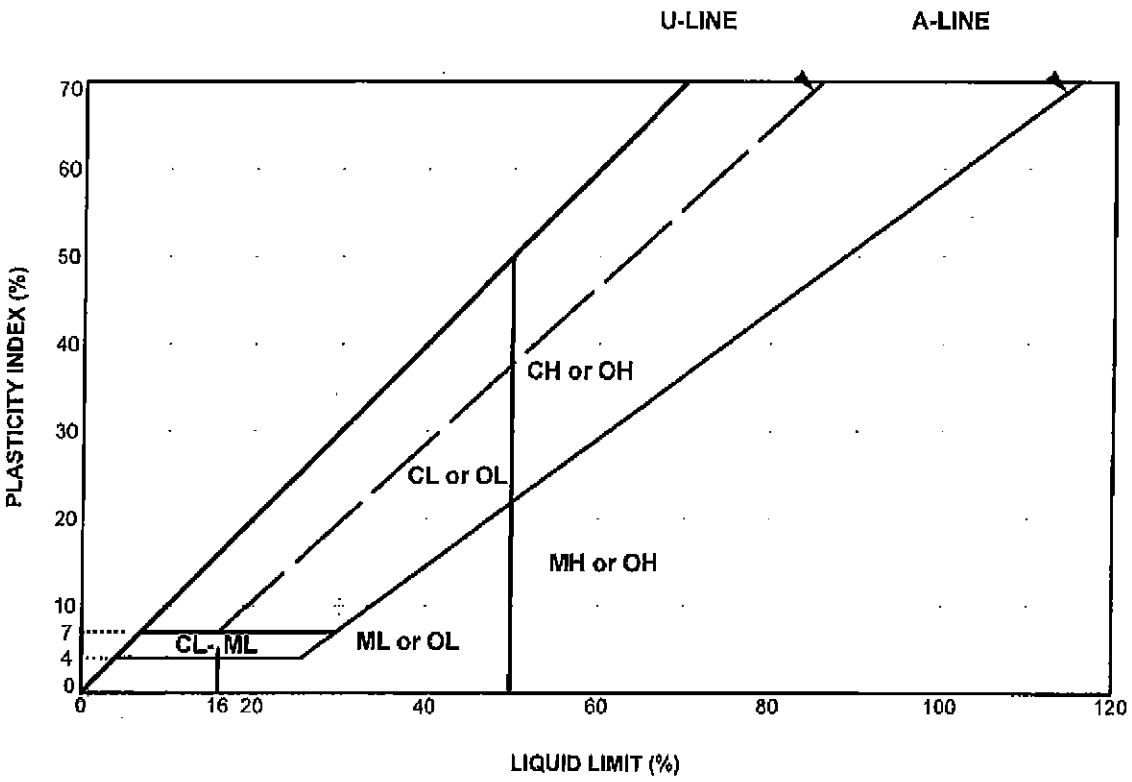

Laboratory Testing by: Hushmand Associates, Inc.

Symbol	Source	Depth (feet)	Classification	Natural M. C. (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	% Passing #200 Sieve
	B- 1	5.0	SILTY SAND (SM)	17	NP	NP	NP	16
	B- 3	2.5	SILTY SAND (SM)		NP	NP	NP	17
	B- 4	2.0	CLAYEY SAND (SC)	8	30	20	10	18

PLASTICITY CHART

Dana Point Boat Launch
Project No. 2005-022

PLATE
B2

HAI HUSHMAND ASSOCIATES, INC.
Geotechnical and Earthquake Engineers

DIRECT SHEAR TEST
(ASTM D3080)

Client: Diaz Yourman & Associates
Project Name: Dana Point Boat Launch
Project Number: 2005-022

HAI Project No.: 03-0417
Tested by: PM
Checked by: JT
Date: 06/12/05

Boring No.: B 1 **Sample No.:** 1 **Depth:** 5'
Sample Description: Olive, Clayey Sand (SC)

Type of test: Consolidated. Drained.
Rate of Displacement: 0.002 in/min.

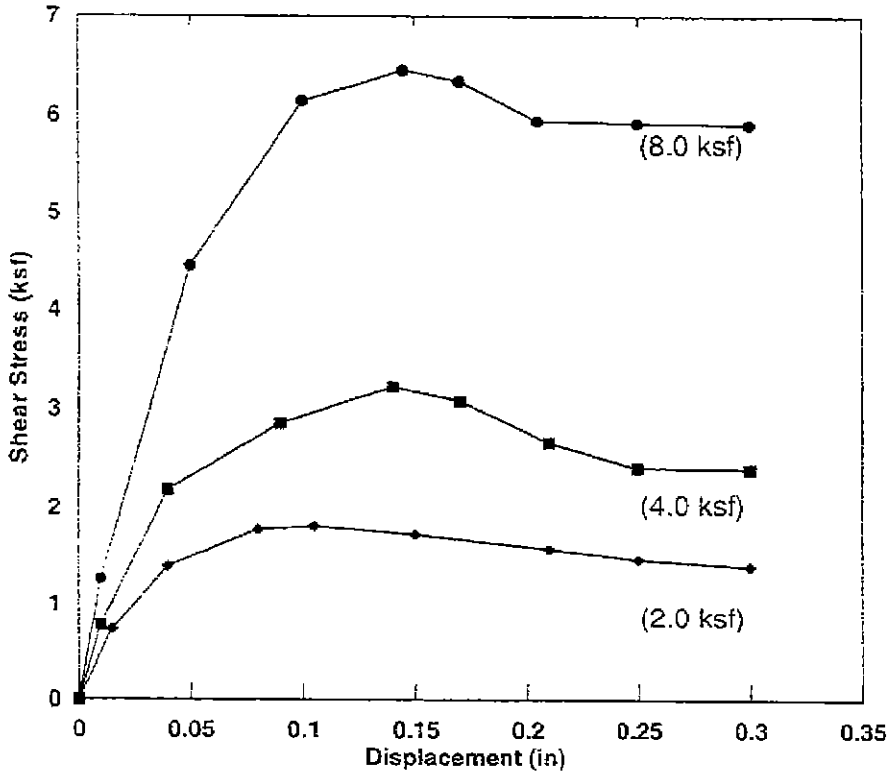

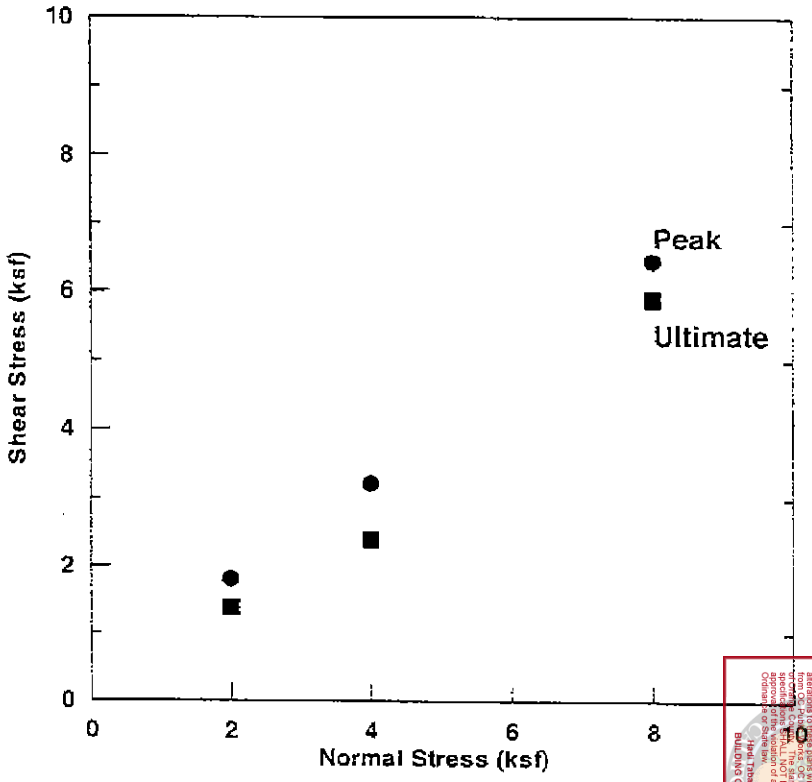

County of Orange - OC Public Works
OC Development Services
APPROVED
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

HAI HUSHMAND ASSOCIATES, INC.
Geotechnical and Earthquake Engineers

DIRECT SHEAR TEST
(ASTM D3080)

Client: Diaz Yourman & Associates
Project Name: Dana Point Boat Launch
Project Number: 2005-022

HAI Project No.: 03-0417
Tested by: PM
Checked by: JT
Date: 06/12/05

Boring No.: B 2 **Sample No.:** 2 **Depth:** 9'
Sample Description: Dark Olive, Clayey Sand (SC)

Type of test: Consolidated, Drained.
Rate of Displacement: 0.002 in/min.

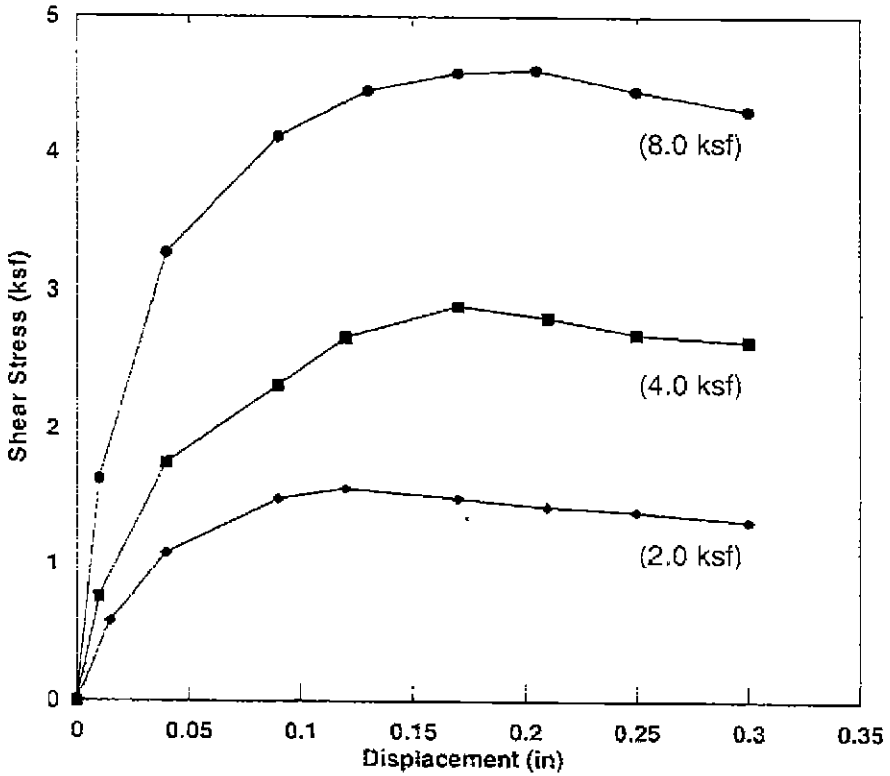

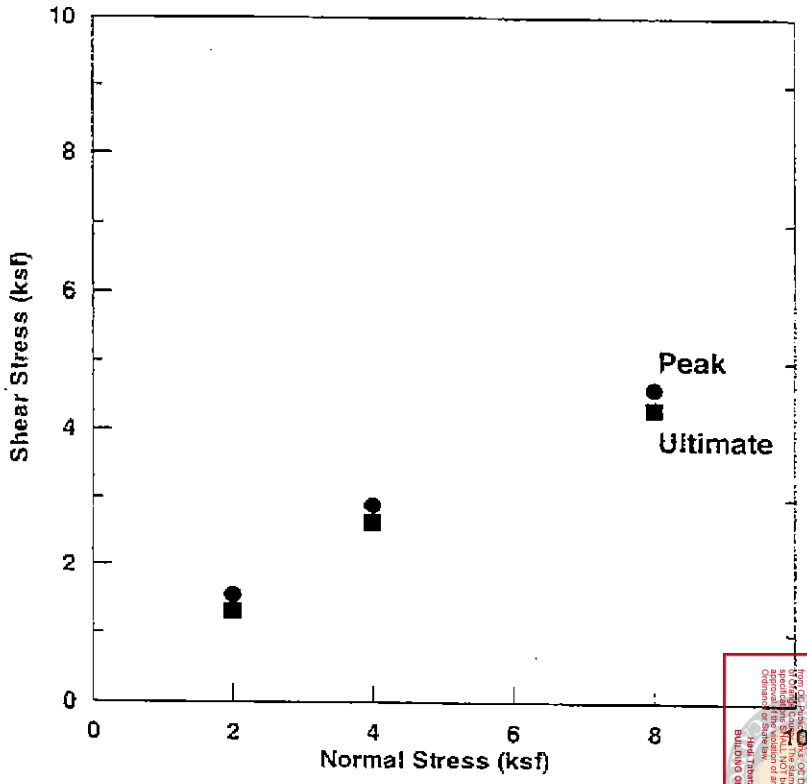

County of Orange - OC Public Works
OC Development Services
APPROVED
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

HAI HUSHMAND ASSOCIATES, INC.
Geotechnical and Earthquake Engineers

COMPACTION CURVE
ASTM D1557

Client :	Diaz Yourman & Associates	***HAI Project No.:***	03-0417
Project Name:	Dana Point Boat Launch	***Tested by:***	PM
Project No.:	2005-022	***Checked by:***	JT
Boring No.:	B 3	***Date:***	6/11/2005
Sample No.:	Bulk ***Depth:*** ---	***Procedure:***	A
Soil Description:	Light Olive, Silty Sand (SM)	***Mold Size:***	4 in

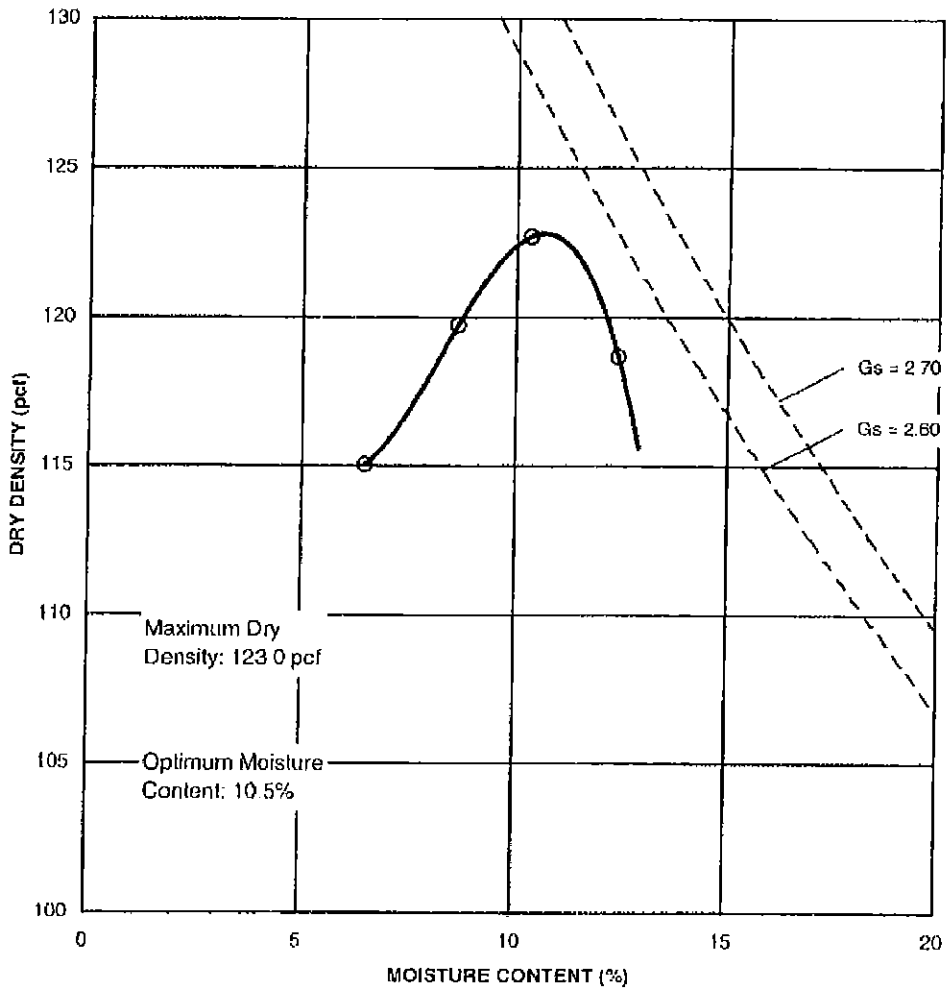

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

HAI HUSHMAND ASSOCIATES, INC.
Geotechnical and Earthquake Engineers

COMPACTION CURVE
ASTM D1557

Client :	Diaz Yourman & Associates	***HAI Project No.:***	03-0417
Project Name:	Dana Point Boat Launch	***Tested by:***	PM
Project No.:	2005-022	***Checked by:***	JT
Boring No.:	B 4	***Date:***	6/11/2005
Sample No.:	Bulk ***Depth:*** ---	***Procedure:***	A
Soil Description:	Light Olive, Clayey Sand (SC)	***Mold Size:***	4 in

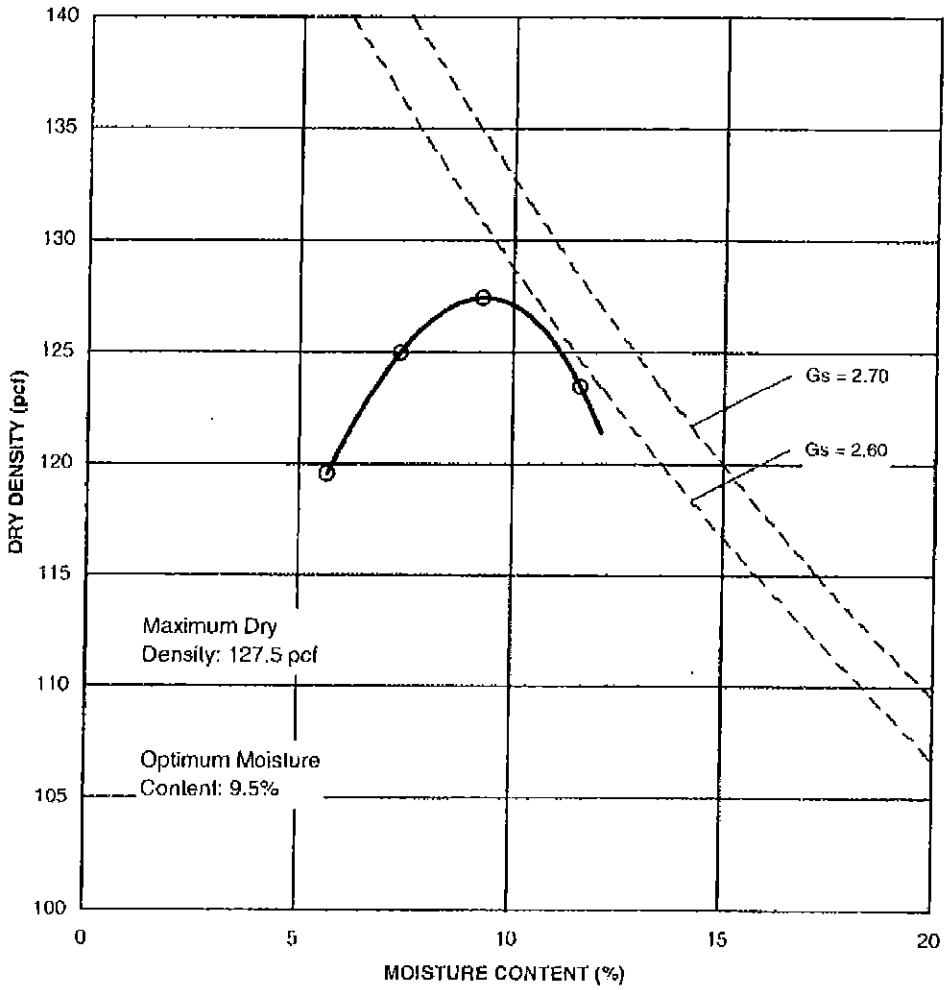

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

RECEIVED SEP 07 2005

County of Orange, OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

R - VALUE DATA SHEET

P.N. 2005-022
Boat Launch

PROJECT NUMBER 32230 BORING NUMBER: B-2 Dana Point

SAMPLE DESCRIPTION: Brown Clayey Sand

Item	SPECIMEN		
	a	b	c
Mold Number	13	14	15
Water added, grams	52	37	31
Initial Test Water, %	13.9	12.6	12.0
Compact Gage Pressure,psi	150	285	350
Exudation Pressure, psi	216	351	484
Height Sample, Inches	2.54	2.56	2.49
Gross Weight Mold, grams	3199	3209	3185
Tare Weight Mold, grams	2089	2080	2076
Sample Wet Weight, grams	1110	1129	1109
Expansion, Inches x 10exp-4	21	43	48
Stability 2,000 lbs (160psi)	31 / 69	27 / 59	26 / 55
Turns Displacement	4.50	4.25	4.03
R-Value Uncorrected	42	50	54
R-Value Corrected	42	51	54
Dry Density, pcf	116.2	118.7	120.5
	DESIGN CALCULATION DATA		
Traffic Index Given:	12.0	12.0	12.0
G.E. by Stability	1.78	1.51	1.41
G. E. by Expansion	0.70	1.43	1.60

Equilibrium R-Value 48 by EXUDATION

Examined & Checked: 8 /26/ 05

REMARKS: Gf = 1.25
1.1% Retained on the 3/4" sieve.

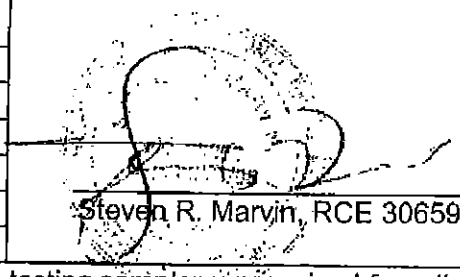

Steven R. Marvin, RCE 30659

The data above is based upon processing and testing samples as received from the field. Test procedures in accordance with latest revisions to Department of Transportation, State of California, Materials & Research Test Method No. 301.

LaBelle • Marvin

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

R-VALUE GRAPHICAL PRESENTATION

PROJECT NO. 32230-R2 P.N. 2005-022

BORING NO. B-2 Down Pt. Boat Launch

DATE 8-26-05

TRAFFIC INDEX Given 12.0

R-VALUE BY EXUDATION 48

R-VALUE BY EXPANSION 2

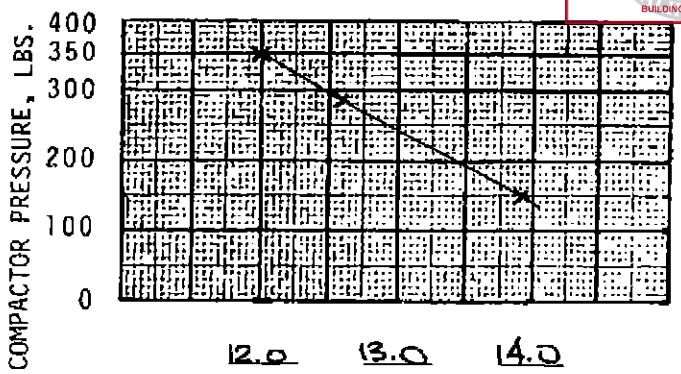

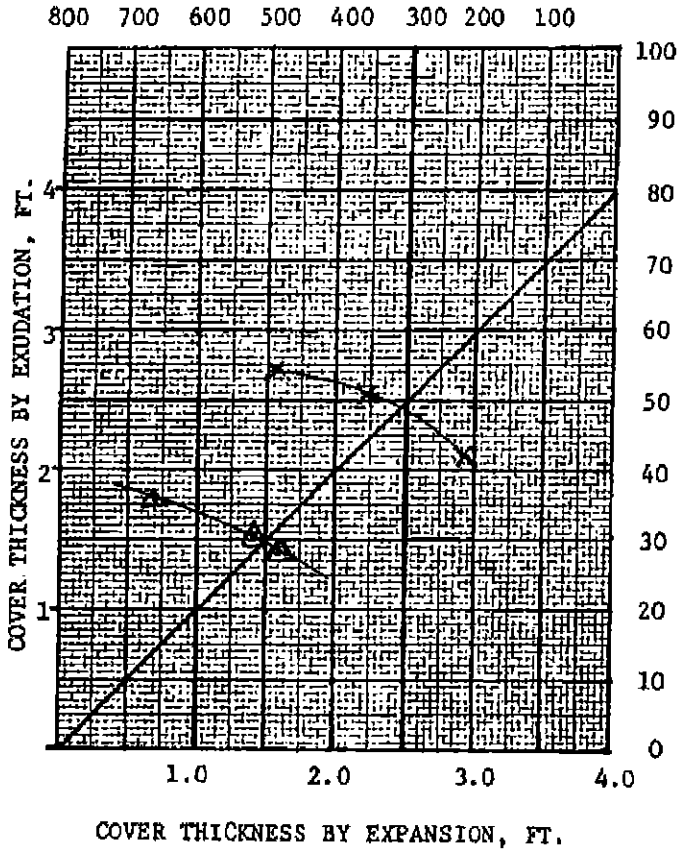

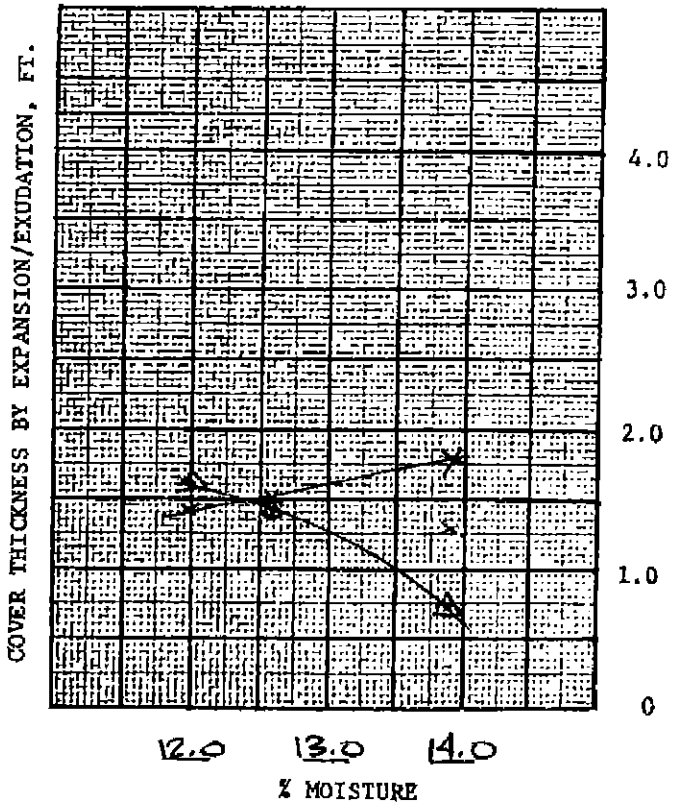

R-VALUE vs. EXUD. PRES.

T by EXUDATION

EXUD. T vs. EXPAN. T

T by EXPANSION

REMARKS GF=1.25

LaBelle • Marvin
PROFESSIONAL PAVEMENT ENGINEERING

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

R - VALUE DATA SHEET

P.N. 2005-022
Boat Launch

PROJECT NUMBER 32230 BORING NUMBER: B-3&4 Dana Point

SAMPLE DESCRIPTION: Brown Slightly Clayey Sand

Item	SPECIMEN		
	a	b	c
Mold Number	10	11	12
Water added, grams	42	50	33
Initial Test Water, %	10.6	11.3	9.8
Compact Gage Pressure,psi	350	160	350
Exudation Pressure, psi	283	168	548
Height Sample, Inches	2.55	2.63	2.55
Gross Weight Mold, grams	3265	3269	3255
Tare Weight Mold, grams	2123	2101	2117
Sample Wet Weight, grams	1142	1168	1138
Expansion, Inches x 10exp-4	7	2	17
Stability 2,000 lbs (160psi)	20 / 39	26 / 51	17 / 33
Turns Displacement	4.16	4.53	4.11
R-Value Uncorrected	65	54	70
R-Value Corrected	65	58	70
Dry Density, pcf	122.7	120.9	123.2
DESIGN CALCULATION DATA			
Traffic Index Given:	12.0	12.0	12.0
G.E. by Stability	1.08	1.29	0.92
G. E. by Expansion	0.23	0.07	0.57

Equilibrium R-Value 66 by EXUDATION

Examined & Checked: 8 /26/ 05

REMARKS:
Gf = 1.25
0.0% Retained on the 3/4" sieve.

Steven R. Marvin, RCE 30659
CIVIL

The data above is based upon processing and testing samples as received from the field. Test procedures in accordance with latest revisions to Department of Transportation, State of California, Materials & Research Test Method No. 301.

LaBelle • Marvin

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

R-VALUE GRAPHICAL PRESENTATION

PROJECT NO. 32230 P.N. 2005-022

BORING NO. B-3&4 Dana Point Boat Launch

DATE 8-26-05

TRAFFIC INDEX Given 12.0

R-VALUE BY EXUDATION 66

R-VALUE BY EXPANSION [illegible]

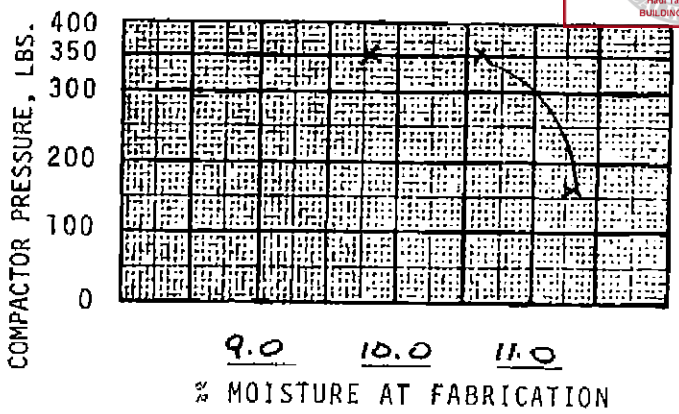

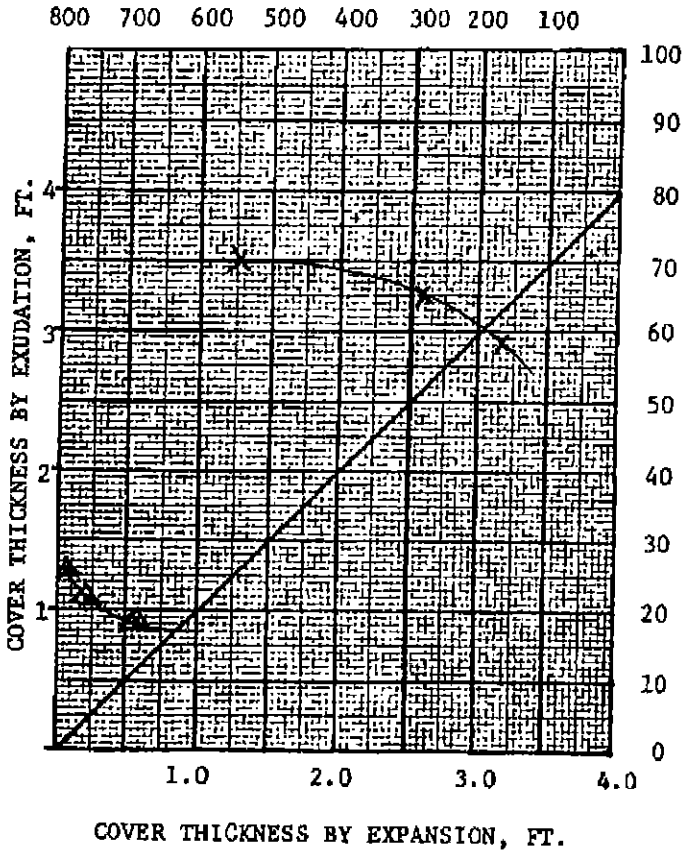

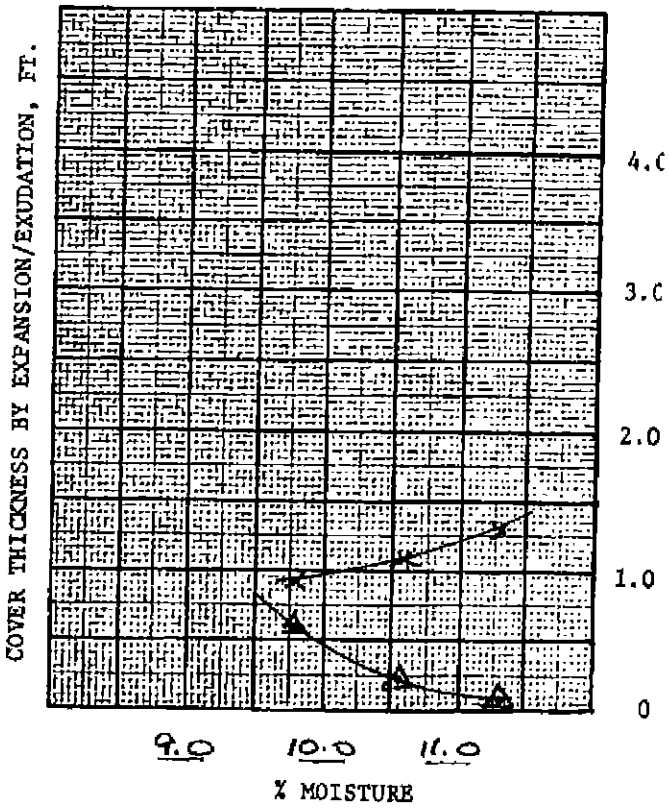

R-VALUE vs. EXUD. PRES.

T by EXUDATION

EXUD. T vs. EXPAN. T

T by EXPANSION

REMARKS

GF=1.25

LaBelle • Marvin
PROFESSIONAL PAVEMENT ENGINEERING

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

HAI HUSHMAND ASSOCIATES, INC.
Geotechnical and Earthquake Engineers

SOIL RESISTIVITY TEST
DOT CA TEST 532 / 643

Client : Diaz Yourman & Associates
Project Name: Dana Point Boat Launch
Project No.: 2005-022
Boring No.: B 1
Sample No.: 1
Depth: 5'
Soil Description: Olive, Clayey Sand (SC)

HAI Project No.: 03-0417
Checked by: JT
Date: 6/15/2005

Specimen No.	Water Added (ml) (Wa)	Adjusted Moisture Content (MC)	Resistance Reading (ohm)	Soil Resistivity (ohm-cm)
1	100	14.86	140	944
2	200	23.06	100	675
3	300	31.26	110	742
4				
5				

Moisture Content (%) (MCI)	6.65
Wet WT. of Soil + Cont. (g)	134.04
Dry Wt. of Soil + Cont. (g)	129.72
Wt. of Container (g)	64.78
Container No.	
Initial Soil Wt. (g) (Wt)	1300.00
Box Constant	6.746
MC=(((1+Mci/100)x(Wa/Wt+1))-1)x100	

Min. Resistivity (ohm-cm)	Moisture Content (%)	Sulfate Content (ppm)	Chloride Content (ppm)	Soil pH	
				pH	Temp. (°C)
DOT CA Test 532 / 643		DOT CA Test 417 Part II	DOT CA Test 422	DOT CA Test 532 / 643	
666	**24.5**	**291**	**311**	**7.52**	**22**

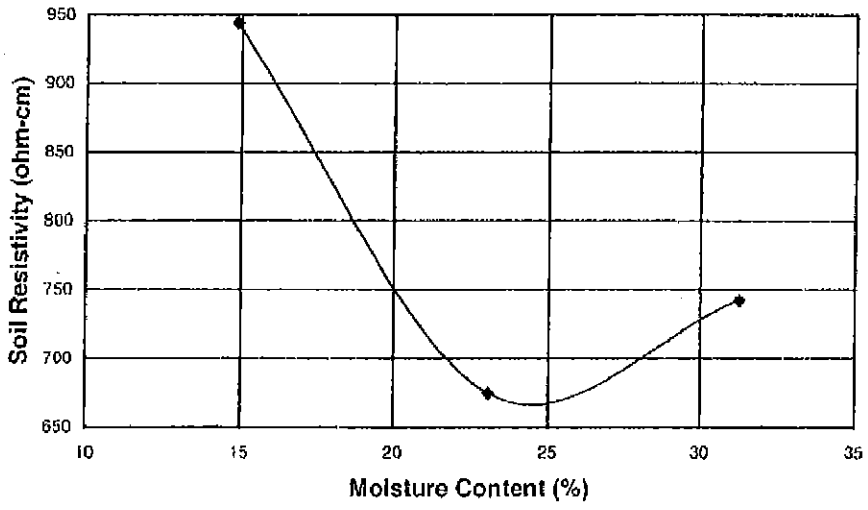

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

HAI HUSHMAND ASSOCIATES, INC.
Geotechnical and Earthquake Engineers

SOIL RESISTIVITY TEST
DOT CA TEST 532 / 643

Client : Diaz Yourman & Associates
Project Name: Dana Point Boat Launch
Project No.: 2005-022
Boring No.: B 4
Sample No.: Bulk
Depth: --
Soil Description: Light Brown, Clayey Sand (SC)

HAI Project No.: 03-0417
Checked by: JT
Date: 6/15/2005

Specimen No.	Water Added (ml) (Wa)	Adjusted Moisture Content (MC)	Resistance Reading (ohm)	Soil Resistivity (ohm-cm)
1	100	16.60	42	283
2	200	24.93	28	189
3	300	33.26	27	182
4	400	41.59	28	189
5				

Moisture Content (%) (MCI)	8.28
Wet WT. of Soil + Cont. (g)	108.62
Dry Wt. of Soil + Cont. (g)	105.31
Wt. of Container (g)	65.31
Container No.	
Initial Soil Wt. (g) (Wt)	1300.00
Box Constant	6.746
MC=(((1+McI/100)x(Wa/Wt+1))-1)x100	

Min. Resistivity (ohm-cm)	Moisture Content (%)	Sulfate Content (ppm)	Chloride Content (ppm)	Soil pH	
				pH	Temp. (°C)
DOT CA Test 532 / 643		DOT CA Test 417 Part II	DOT CA Test 422	DOT CA Test 532 / 643	
179	**28.6**	**471**	**2420**	**7.41**	**21.8**

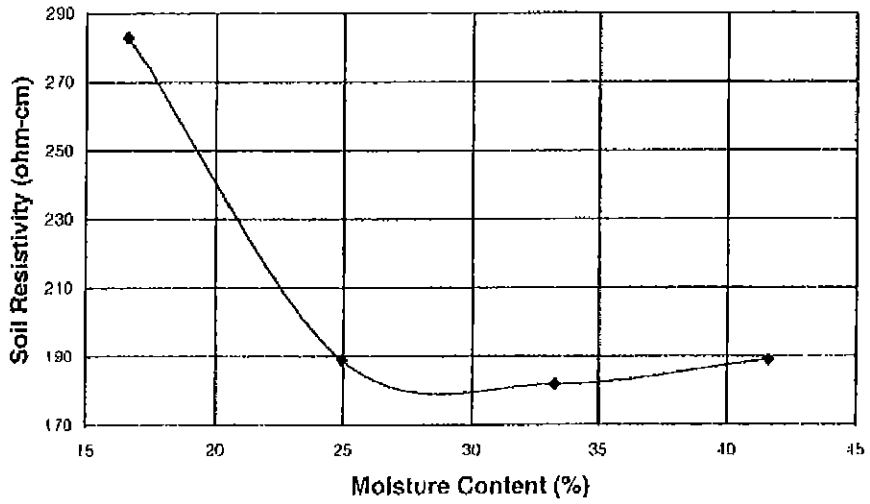

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

HAI HUSHMAND ASSOCIATES, INC.
Geotechnical and Earthquake Engineers

SOIL RESISTIVITY TEST
DOT CA TEST 532 / 643

Client : Diaz Yourman & Associates
Project Name: Dana Point Boat Launch
Project No.: 2005-022
Boring No.: B 2
Sample No.: Bulk
Depth: --
Soil Description: Light Brown, Clayey Sand (SC)

HAI Project No.: 03-0417
Checked by: JT
Date: 6/15/2005

Specimen No.	Water Added (ml) (Wa)	Adjusted Moisture Content (MC)	Resistance Reading (ohm)	Soil Resistivity (ohm-cm)
1	100	22.22	56	378
2	200	30.96	51	344
3	300	36.69	51	344
4	400	48.42	52	351
5				

Moisture Content (%) (MCl)	13.49
Wet WT. of Soil + Cont. (g)	168.04
Dry Wt. of Soil + Cont. (g)	152.52
Wt. of Container (g)	37.51
Container No.	
Initial Soil Wt. (g) (Wt)	1300.00
Box Constant	6.746
MC=(((1+Mcl/100)x(Wa/Wt+1))-1)x100	

Min. Resistivity (ohm-cm)	Moisture Content (%)	Sulfate Content (ppm)	Chloride Content (ppm)	Soil pH	
				pH	Temp. (°C)
DOT CA Test 532 / 643		DOT CA Test 417 Part II	DOT CA Test 422	DOT CA Test 532 / 643	
341	**34**	**190**	**1387**	**9.26**	**21.9**

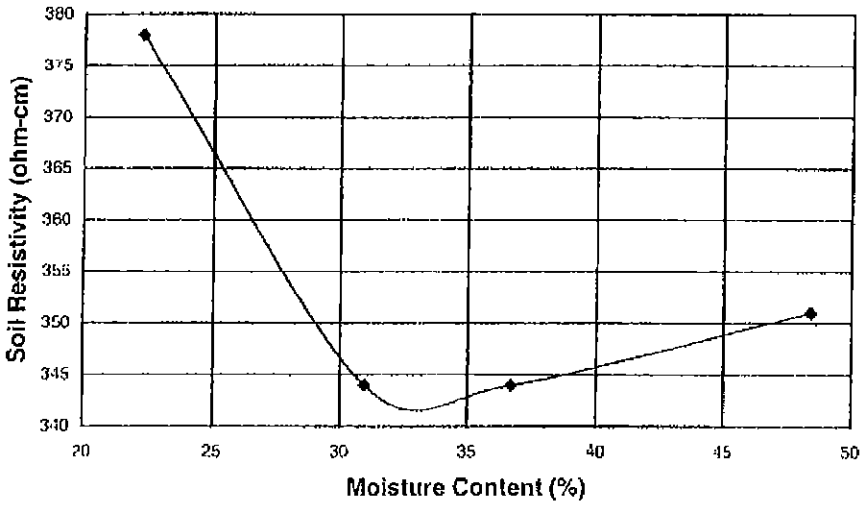

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

HAI HUSHMAND ASSOCIATES, INC.
Geotechnical and Earthquake Engineers

SOIL RESISTIVITY TEST
DOT CA TEST 532 / 643

Client : Diaz Yourman & Associates
Project Name: Dana Point Boat Launch
Project No.: 2005-022
Boring No.: B 3
Sample No.: Bulk
Depth: --
Soil Description: Light Brown, Silty Sand (SM)

HAI Project No.: 03-0417
Checked by: JT
Date: 6/15/2005

Specimen No.	Water Added (ml) (Wa)	Adjusted Moisture Content (MC)	Resistance Reading (ohm)	Soil Resistivity (ohm-cm)
1	100	23.35	81	546
2	200	32.17	76	513
3	300	40.98	77	519
4				
5				

Moisture Content (%) (Mcl)	14.54
Wet WT. of Soil + Cont. (g)	168.63
Dry Wt. of Soil + Cont. (g)	155.57
Wt. of Container (g)	65.77
Container No.	
Initial Soil Wt. (g) (Wt)	1300.00
Box Constant	6.746
MC=(((1+Mcl/100)x(Wa/Wt+1))-1)x100	

Min. Resistivity (ohm-cm)	Moisture Content (%)	Sulfate Content (ppm)	Chloride Content (ppm)	Soil pH	
				pH	Temp. (°C)
DOT CA Test 532 / 643		DOT CA Test 417 Part II	DOT CA Test 422	DOT CA Test 532 / 643	
511	**34**	**250**	**702**	**7.35**	**21.8**

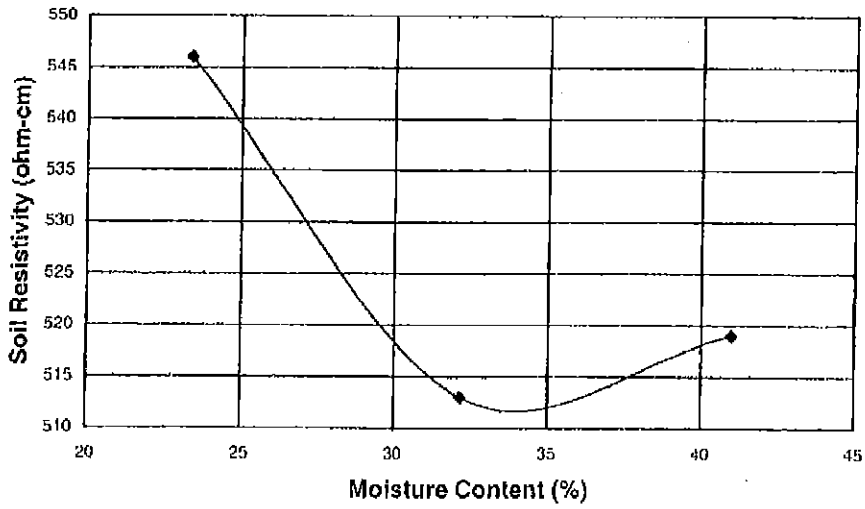

Boring No.	B-5	B-6	B-6	B-6	B-7	B-8		
Sample No.	R-3	R-3	S-2	R-5	S-3	S-2		
Depth (ft.)	15	7.5	20	25	30	20		
Sample Type	Drive	Drive	SPT	Drive	SPT	SPT		
Soil Identification	Olive gray (SM)	Grayish brown (SM)	Pale olive (SP-SC)	Gray (SP)	Pale olive (SC)	Light olive gray (SC)		
Moisture Correction								
Wet Weight of Soil + Container (g)	0.00	0.00	0.00	0.00	0.00	0.00		
Dry Weight of Soil + Container (g)	0.00	0.00	0.00	0.00	0.00	0.00		
Weight of Container (g)	1.00	1.00	1.00	1.00	1.00	1.00		
Moisture Content (%)	0.00	0.00	0.00	0.00	0.00	0.00		
Sample Dry Weight Determination								
Weight of Sample + Container (g)	412.50	451.70	740.70	414.80	766.40	561.50		
Weight of Container (g)	144.80	137.70	110.80	140.20	108.40	108.70		
Weight of Dry Sample (g)	267.70	314.00	629.90	274.60	658.00	452.80		
Container No.:								
After Wash								
Method (A or B)	B	B	B	B	B	B		
Dry Weight of Sample + Cont. (g)	376.10	405.00	702.70	411.00	687.10	473.00		
Weight of Container (g)	144.80	137.70	110.80	140.20	108.40	108.70		
Dry Weight of Sample (g)	231.30	267.30	591.90	270.80	578.70	364.30		
% Passing No. 200 Sieve	**13.6**	**14.9**	**6.0**	**1.4**	**12.1**	**19.5**		
% Retained No. 200 Sieve	86.4	85.1	94.0	98.6	87.9	80.5		

Leighton

PERCENT PASSING
No. 200 SIEVE
ASTM D 1140

Project Name: Dana Point Harbor Renovation
Project No.: 600024-004
Client Name: LCI / Irvine
Tested By: A. Santos Date: 11/15/07

County of Orange - OC Public Works
OC Development Services
APPROVED
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits: BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025

GRAVEL		SAND			FINES	
COARSE	FINE	CRSE	MEDIUM	FINE	SILT	CLAY

U.S. STANDARD SIEVE OPENING — U.S. STANDARD SIEVE NUMBER — HYDROMETER

3.0" 1 1/2" 3/4" 3/8" #4 #8 #16 #30 #50 #100 #200

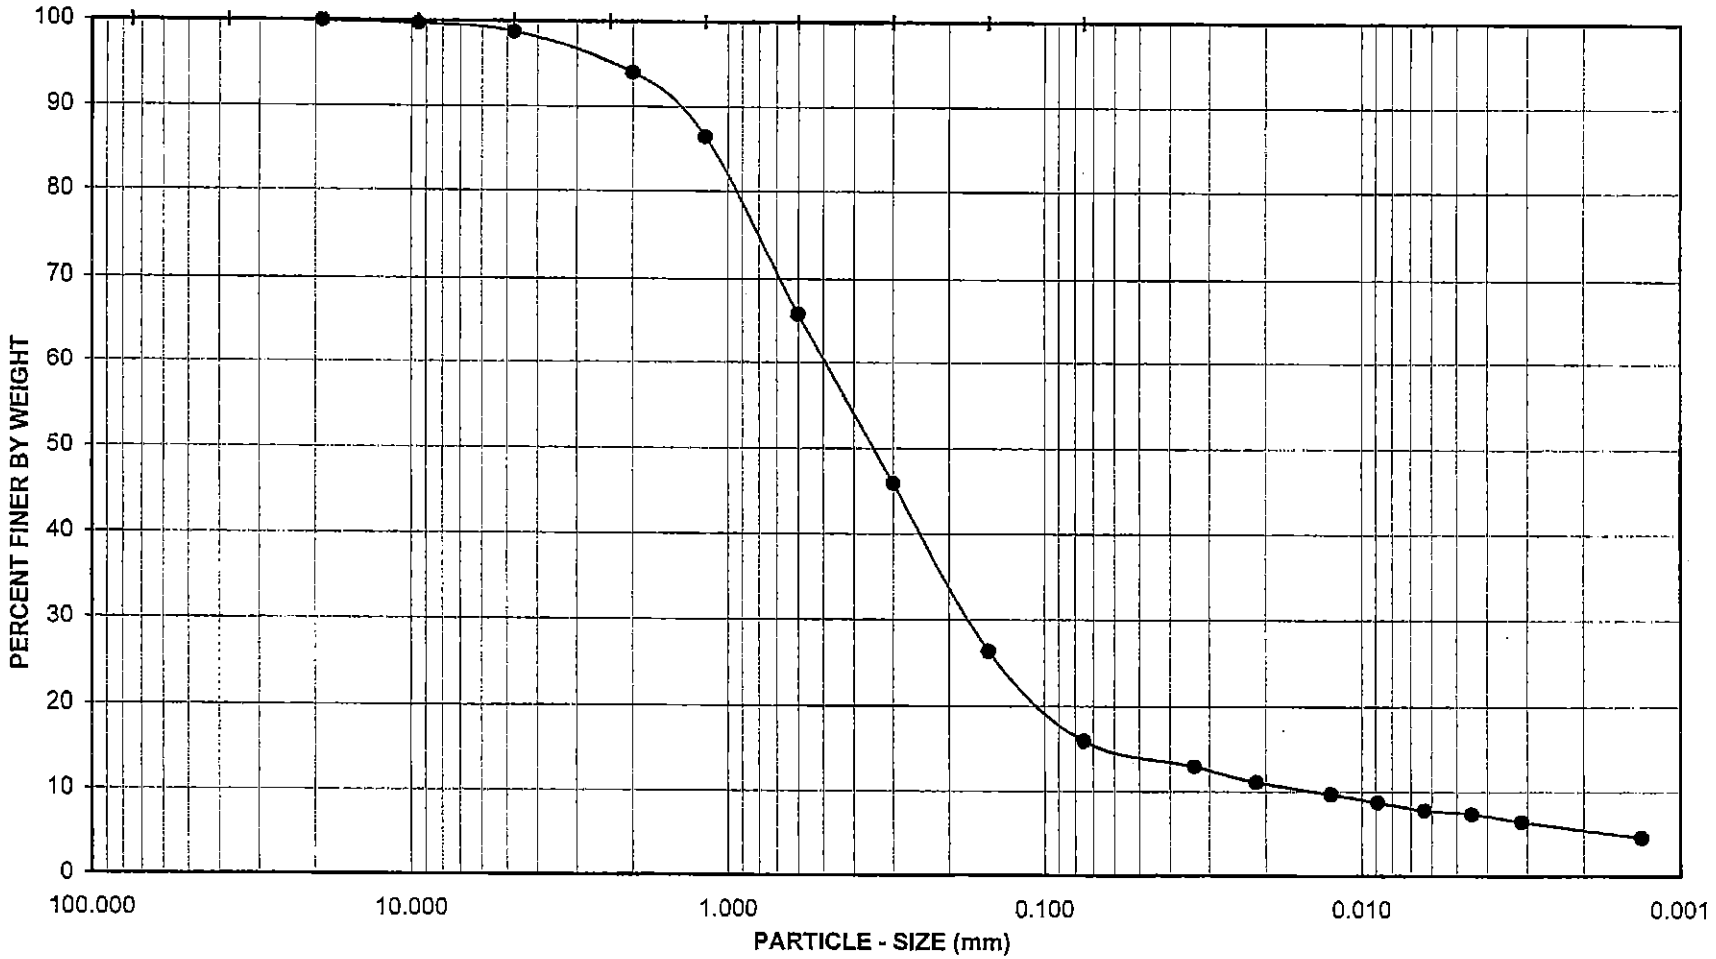

Project Name: Dana Point Harbor Renovation

Project No.: 600024-004

Exploration No.: B-8 Sample No.: R-4

Depth (feet) : 15.0 Soil Type : SM

Soil Identification: Pale olive silty sand (SM)

GR:SA:FI : (%) 1 : 83 : 16

Leighton

PARTICLE - SIZE DISTRIBUTION ASTM D 422

County of Orange - OC Public Works
OC Development Services
APPROVED
Building&Safety: Ryan Rose
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
1/16/2025
Nov-02

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton

ATTERBERG LIMITS

ASTM D 4318

Project Name:	Dana Point Harbor Renovation	Tested By:	A. Santos	Date:	11/28/07
Project No. :	600024-004	Input By:	LF	Date:	11/29/07
Boring No.:	B-8	Checked By:	LF		
Sample No.:	R-2	Depth (ft.)	5.0		
Soil Identification:	Brownish gray sandy lean clay s(CL)				

TEST	PLASTIC LIMIT		LIQUID LIMIT			
NO.	1	2	1	2	3	4
Number of Blows [N]			27	19	13	
Wet Wt. of Soil + Cont. (g)	9.81	9.17	18.38	18.91	19.88	
Dry Wt. of Soil + Cont. (g)	8.29	7.76	13.37	13.56	13.98	
Wt. of Container (g)	1.10	1.04	1.08	1.08	1.04	
Moisture Content (%) [Wn]	21.14	20.98	40.76	42.87	45.60	

Liquid Limit	**41**
Plastic Limit	**21**
Plasticity Index	**20**
Classification	**CL**

PI at "A" - Line = 0.73(LL-20) 15.33

One - Point Liquid Limit Calculation

$LL = Wn(N/25)^{0.12}$

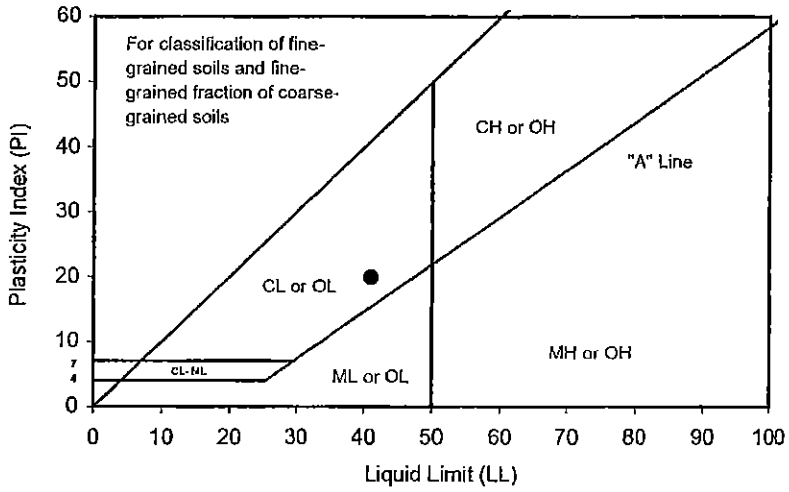

PROCEDURES USED

- [ ] Wet Preparation
  Multipoint - Wet
- [X] Dry Preparation
  Multipoint - Dry
- [X] Procedure A
  Multipoint Test
- [ ] Procedure B
  One-point Test

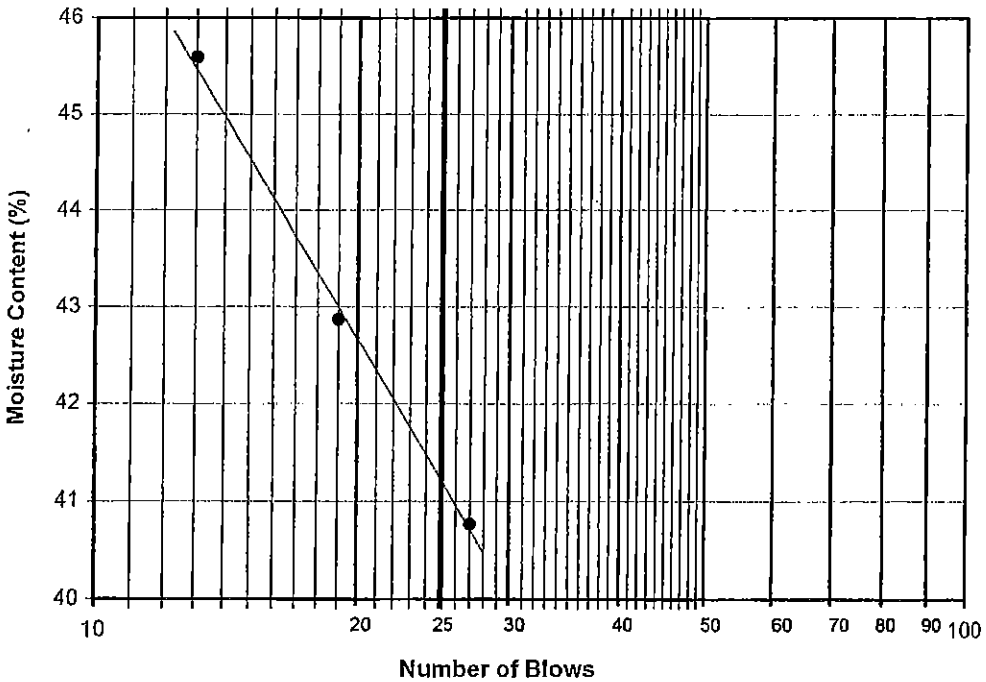

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton

ATTERBERG LIMITS

ASTM D 4318

Project Name:	Dana Point Harbor Renovation	Tested By:	V. Juliano	Date:	11/27/07
Project No. :	600024-004	Input By:	LF	Date:	11/28/07
Boring No.:	B-8	Checked By:	LF		
Sample No.:	R-3	Depth (ft.)	7.5		
Soil Identification:	Grayish brown lean clay (CL)				

TEST	PLASTIC LIMIT		LIQUID LIMIT			
NO.	1	2	1	2	3	4
Number of Blows [N]			30	23	16	
Wet Wt. of Soil + Cont. (g)	11.66	12.08	14.54	15.00	16.69	
Dry Wt. of Soil + Cont. (g)	9.70	10.04	10.13	10.38	11.40	
Wt. of Container (g)	1.02	1.06	1.06	1.05	1.07	
Moisture Content (%) [Wn]	22.58	22.72	48.62	49.52	51.21	

Liquid Limit	**49**
Plastic Limit	**23**
Plasticity Index	**26**
Classification	**CL**

PI at "A" - Line = 0.73(LL-20) 21.17

One - Point Liquid Limit Calculation

$LL = Wn(N/25)^{0.12}$

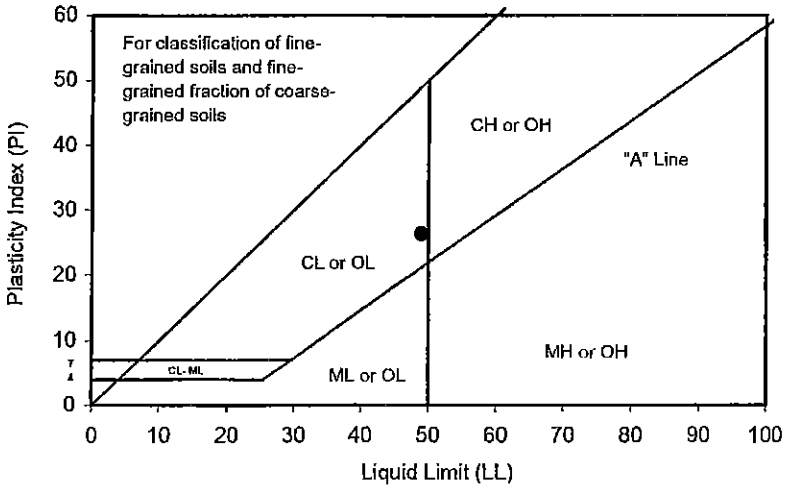

PROCEDURES USED

- [ ] Wet Preparation
  Multipoint - Wet
- [X] Dry Preparation
  Multipoint - Dry
- [X] Procedure A
  Multipoint Test
- [ ] Procedure B
  One-point Test

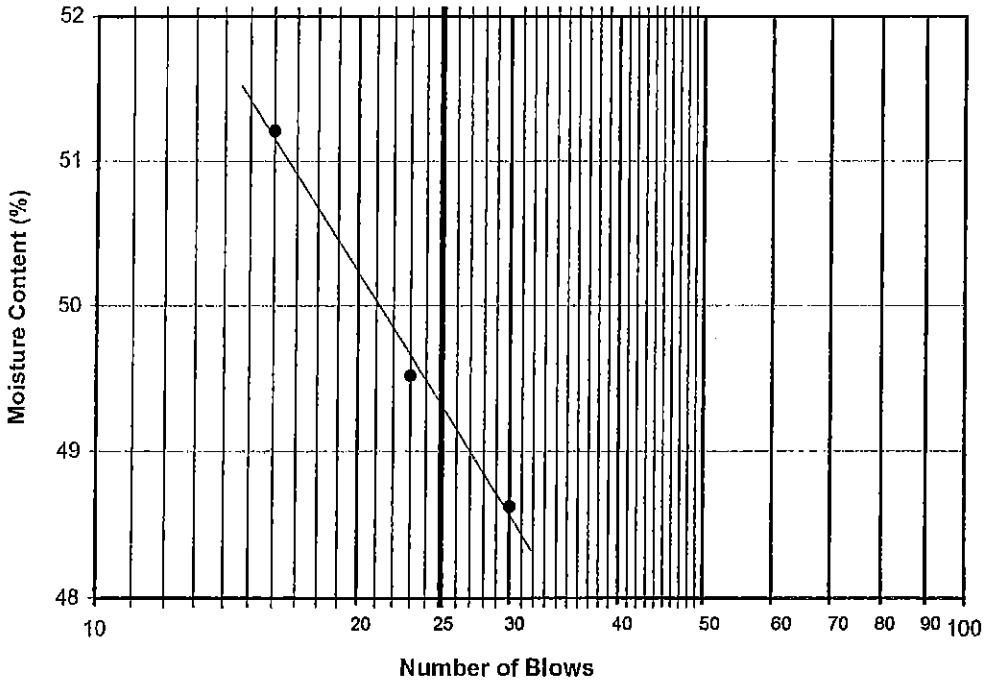

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton

EXPANSION INDEX of SOILS

ASTM D 4829

Project Name:	Dana Point Harbor Renovation	Tested By:	G. Berdy	Date:	11/14/07
Project No. :	600024-004	Checked By:	LF	Date:	11/20/07
Boring No.:	B-8	Depth (ft.)	0-5		
Sample No. :	Bag-1				
Soil Identification:	Olive clayey sand (SC)				

Dry Wt. of Soil + Cont.	(g)	1000.00
Wt. of Container No.	(g)	0.00
Dry Wt. of Soil	(g)	1000.00
Weight Soil Retained on #4 Sieve		0.00
Percent Passing # 4		100.00

MOLDED SPECIMEN		Before Test	After Test
Specimen Diameter	(in.)	4.01	4.01
Specimen Height	(in.)	1.0000	1.0420
Wt. Comp. Soil + Mold	(g)	586.40	421.30
Wt. of Mold	(g)	204.80	0.00
Specific Gravity (Assumed)		2.70	2.70
Container No.		O	O
Wet Wt. of Soil + Cont.	(g)	741.90	626.10
Dry Wt. of Soil + Cont.	(g)	656.60	542.50
Wt. of Container	(g)	0.00	204.80
Moisture Content	(%)	12.99	24.76
Wet Density	(pcf)	115.1	122.0
Dry Density	(pcf)	101.9	97.8
Void Ratio		0.655	0.724
Total Porosity		0.396	0.420
Pore Volume	(cc)	81.9	90.6
Degree of Saturation (%) [S_{meas}]		**53.6**	92.3

SPECIMEN INUNDATION in distilled water for the period of 24 h or expansion rate < 0.0002 in./h

Date	Time	Pressure (psi)	Elapsed Time (min.)	Dial Readings (in.)
11/14/07	13:39	1.0	0	0.2400
11/14/07	13:49	1.0	10	0.2395
Add Distilled Water to the Specimen				
11/14/07	13:54	1.0	5	0.2450
11/15/07	7:29	1.0	1060	0.2820
11/15/07	8:33	1.0	1124	0.2820

Expansion Index (EI_{meas}) = ((Final Rdg - Initial Rdg) / Initial Thick.) x 1000	42.5
Expansion Index (EI)$_{50}$ = EI_{meas} - (50 -S_{meas})x((65+EI_{meas}) / (220-S_{meas}))	**45**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services employee's name. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

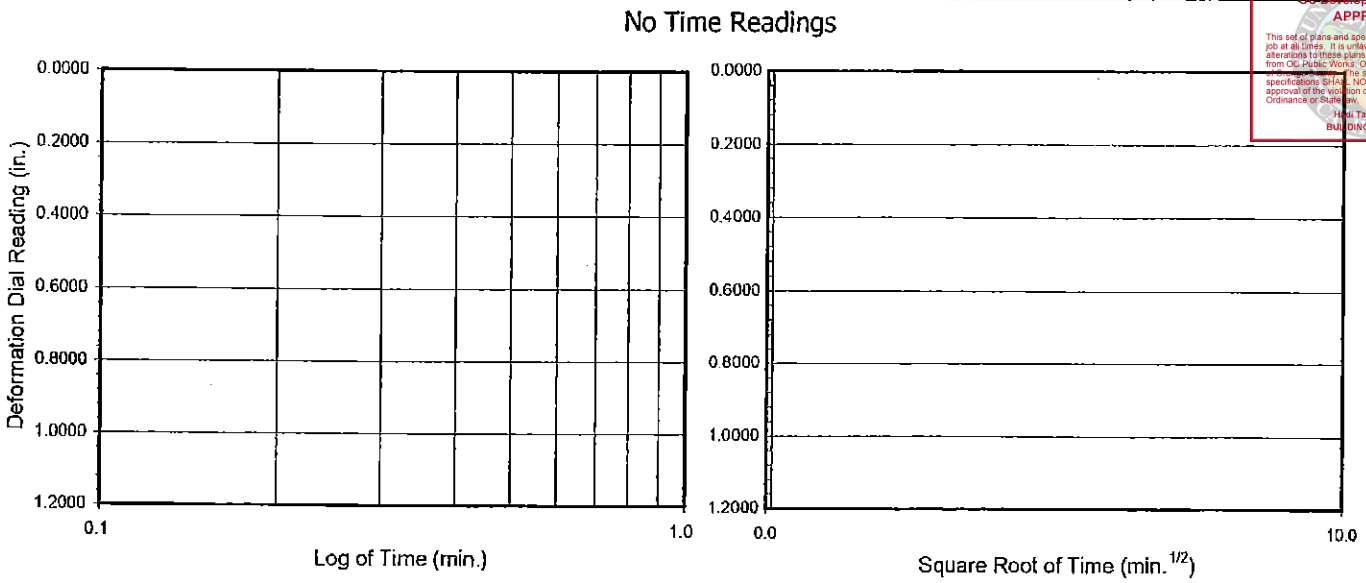

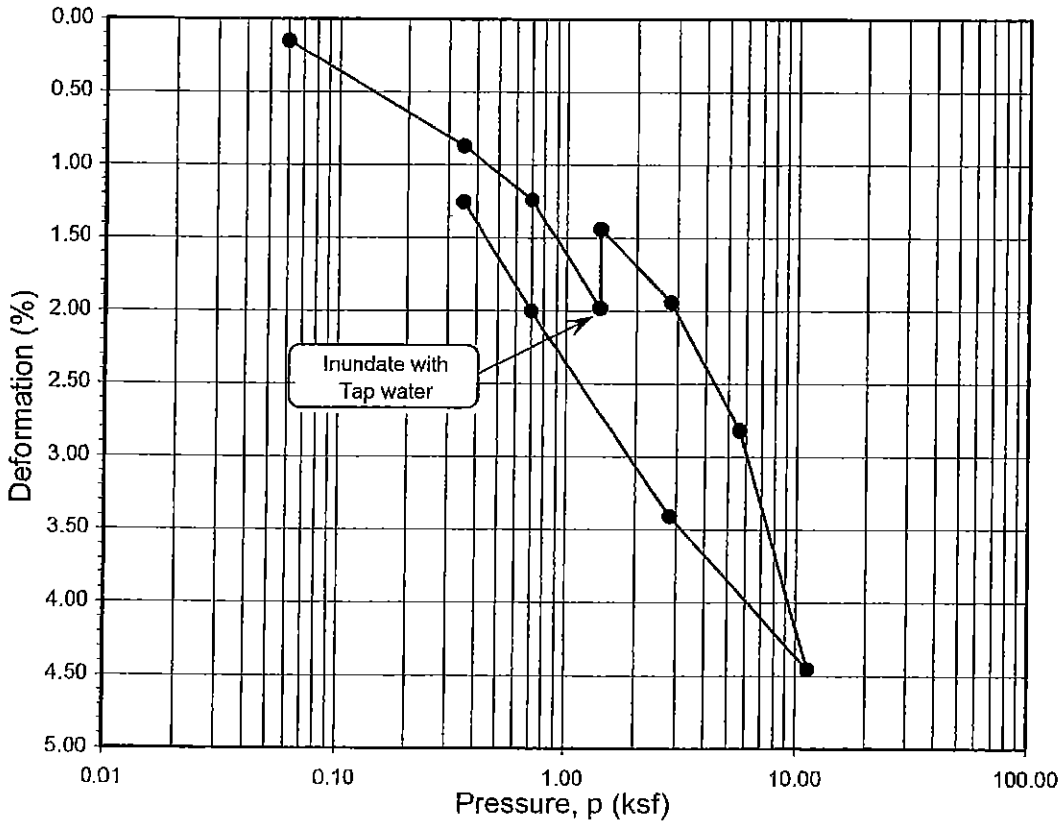

Boring No.	Sample No.	Depth (ft.)	Moisture Content (%)		Dry Density (pcf)		Void Ratio		Degree of Saturation (%)	
			Initial	Final	Initial	Final	Initial	Final	Initial	Final
B-8	**R-3**	**7.5**	**25.7**	**25.3**	**99.1**	**101.0**	**0.700**	**0.679**	**99**	**100**

Soil Identification: Grayish brown lean clay (CL)

Leighton

ONE-DIMENSIONAL CONSOLIDATION PROPERTIES of SOILS
(ASTM D 2435)

Project No.: 600024-004

Dana Point Harbor Renovation

11-07

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaei
BUILDING OFFICIAL

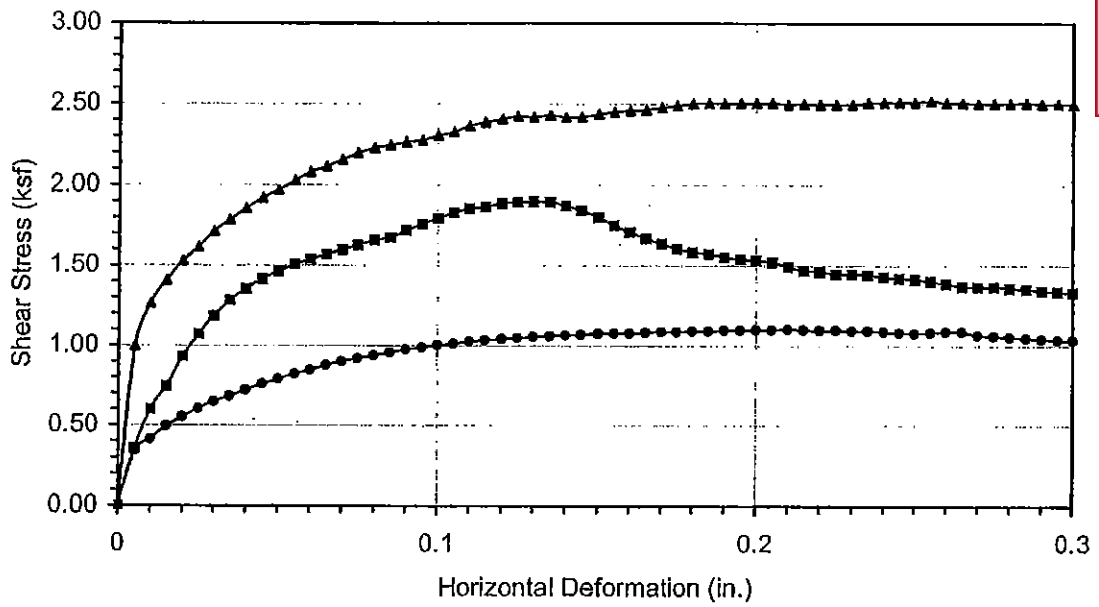

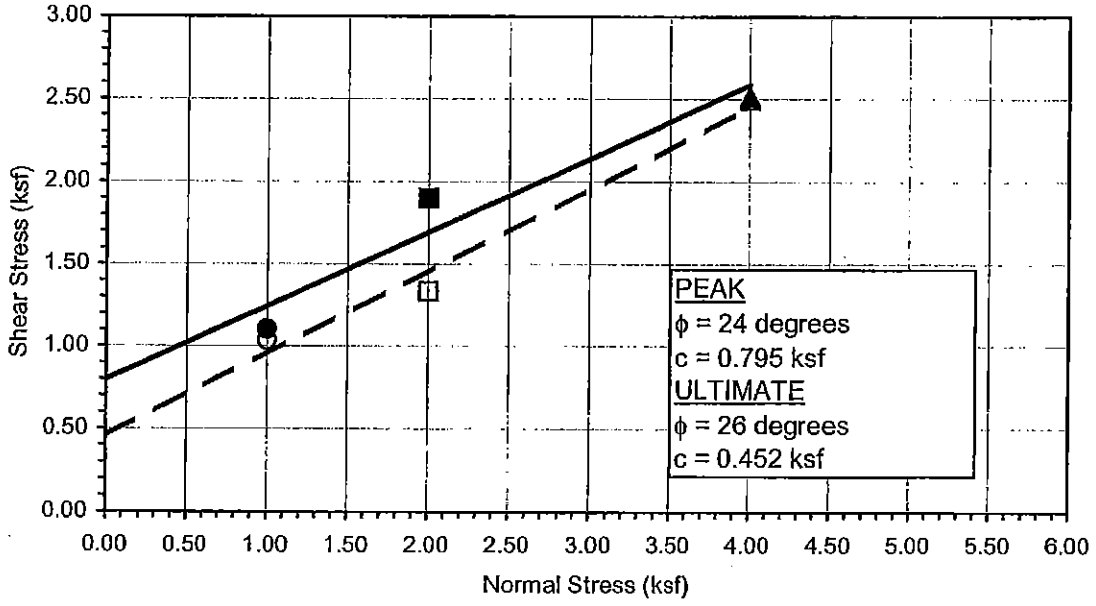

Boring No.	**B-8**
Sample No.	**R-2**
Depth (ft)	**5**
Sample Type: Drive	
Soil Identification: Brownish gray sandy lean clay s(CL)	

Normal Stress (kip/ft²)	1.000	2.000	4.000
Peak Shear Stress (kip/ft²)	● 1.103	■ 1.899	▲ 2.515
Shear Stress @ End of Test (ksf)	○ 1.034	□ 1.333	△ 2.496
Deformation Rate (in./min.)	0.0500	0.0500	0.0500
Initial Sample Height (in.)	1.000	1.000	1.000
Diameter (in.)	2.415	2.415	2.415
Initial Moisture Content (%)	23.79	23.79	23.79
Dry Density (pcf)	97.1	101.1	101.0
Saturation (%)	87.3	96.2	95.9
Soil Height Before Shearing (in.)	0.9997	0.9858	0.9604
Final Moisture Content (%)	27.6	25.6	22.0

Leighton

DIRECT SHEAR TEST RESULTS
Consolidated Undrained

Project No.: 600024-004
Dana Point Harbor Renovation

11-07

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton

Unconsolidated-Undrained Triaxial Compression Test on Cohesive Soils

ASTM D 2850

Project Name:	Dana Point Harbor Renovation		Tested by:	ACS	Date: 11/26/07
Project No:	600024-004		Checked by:	LF	Date: 11/28/07
Boring No.:	B-6		Sample Type:		Drive
Sample No.:	R-4		Depth(ft):	15	
Sample Description:	Pale olive poorly graded sand with clay (SP-SC)				

Diameter (in)	1	2.413
	2	2.41
	3	2.409
	Average	2.411
Height (in)	1	5.504
	2	5.506
	3	5.495
	Average	5.502
Weight of Sample + Tube / Rings (g)		881.30
Weight of Tube / Rings (g)		0.00
Weight of Wet Sample + Container (g)		987.60
Weight of Dry Sample + Container (g)		881.20
Weight of Container (g)		107.80
Specific Gravity (assumed)		2.70
Confining Pressure (psi)		5.5
Rate of Deformation (in/min)		0.045

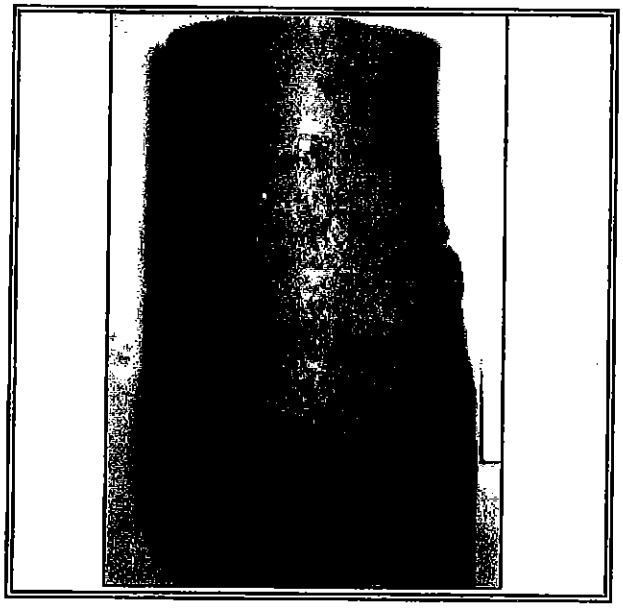

Sample Properties	
Moisture Content (%)	13.76
Dry Density (pcf)	117.7
Void Ratio	0.432
% Saturation	86.0

At Failure*	
Deviator stress (psi)	**20.60**
Minor principal total stress (psi)	**5.50**
Major principal total stress (psi)	**26.10**
Axial strain (%)	**14.36**

* Stress values have been corrected for membrane effects

Stress - Strain Curve

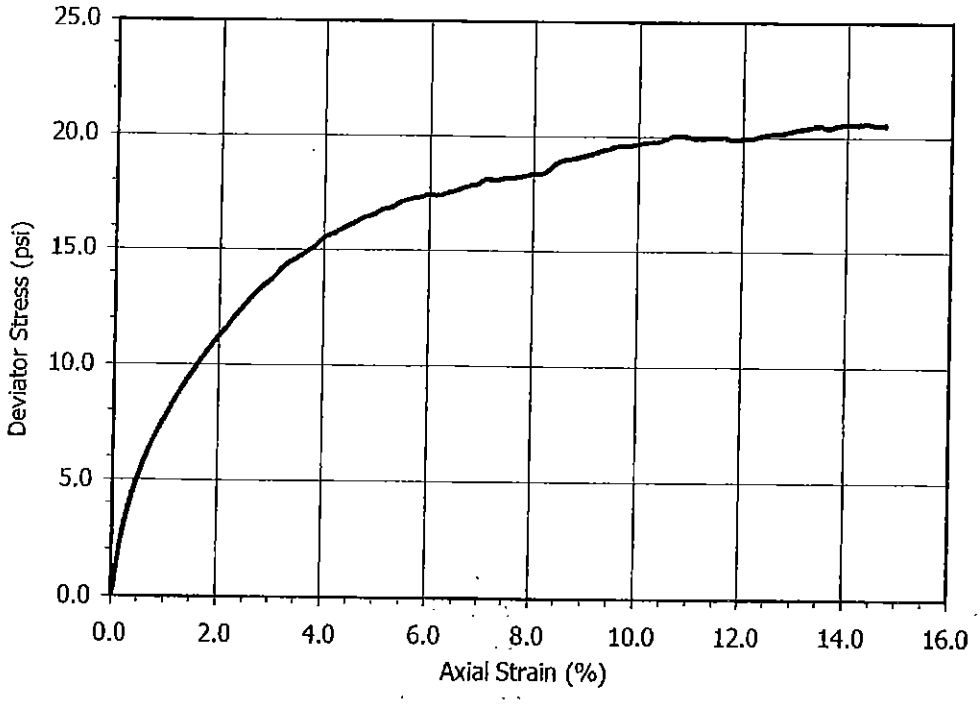

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton

Unconsolidated-Undrained Triaxial Compression Test on Cohesive Soils

ASTM D 2850

Project Name:	Dana Point Harbor Renovation		Tested by:	ACS	Date: 11/26/07
Project No:	600024-004		Checked by:	LF	Date: 11/28/07
Boring No.:	B-7		Sample Type:		Drive
Sample No.:	R-7		Depth(ft):	45	
Sample Description:	Gray silty sand (SM)				

Diameter (in)	1	2.415
	2	2.41
	3	2.410
	Average	2.412
Height (in)	1	5.545
	2	5.566
	3	5.543
	Average	5.551
Weight of Sample + Tube / Rings (g)		905.70
Weight of Tube / Rings (g)		0.00
Weight of Wet Sample + Container (g)		1010.00
Weight of Dry Sample + Container (g)		894.80
Weight of Container (g)		108.10
Specific Gravity (assumed)		2.70
Confining Pressure (psi)		12.0
Rate of Deformation (in/min)		0.045

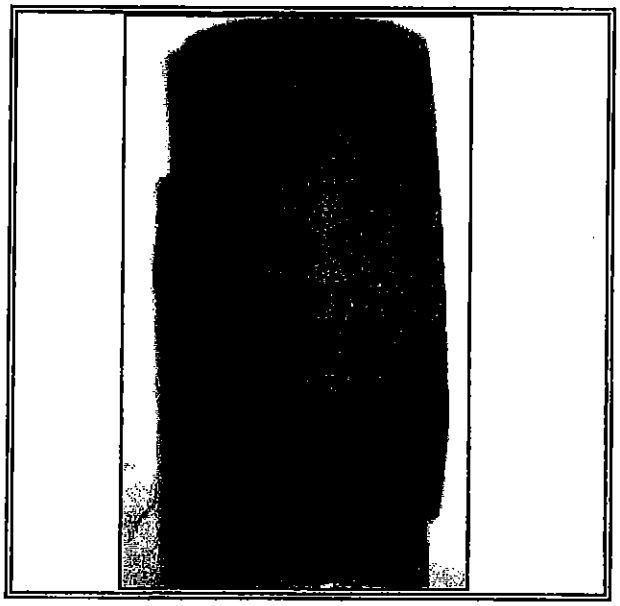

Sample Properties	
Moisture Content (%)	14.64
Dry Density (pcf)	118.9
Void Ratio	0.417
% Saturation	94.8

At Failure*	
Deviator stress (psi)	**119.03**
Minor principal total stress (psi)	**12.00**
Major principal total stress (psi)	**131.03**
Axial strain (%)	**6.13**

* Stress values have been corrected for membrane effects

Stress - Strain Curve

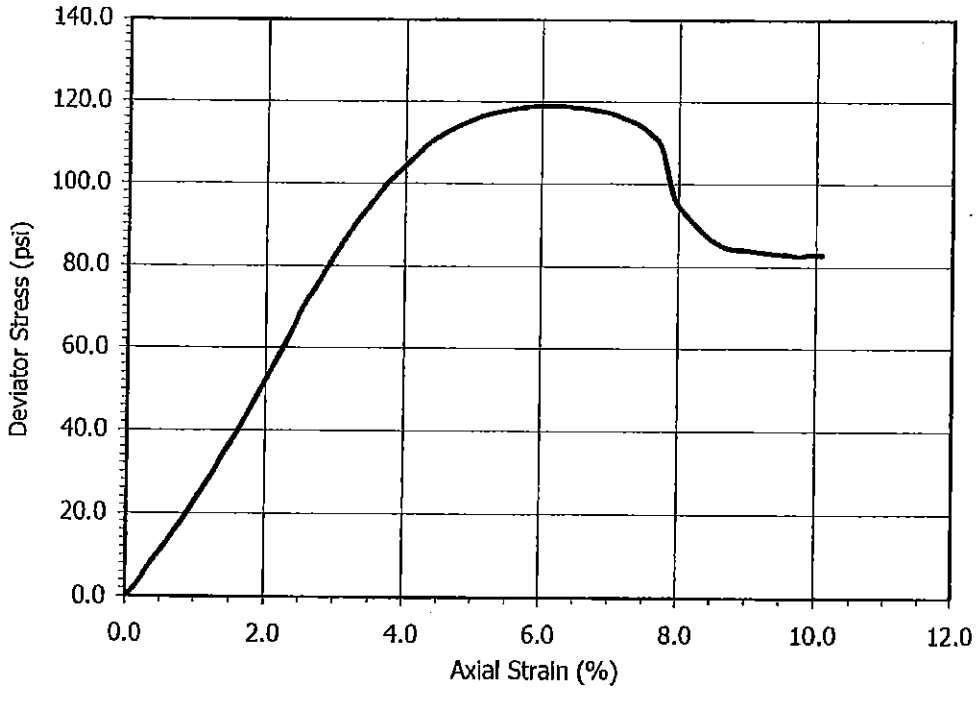

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

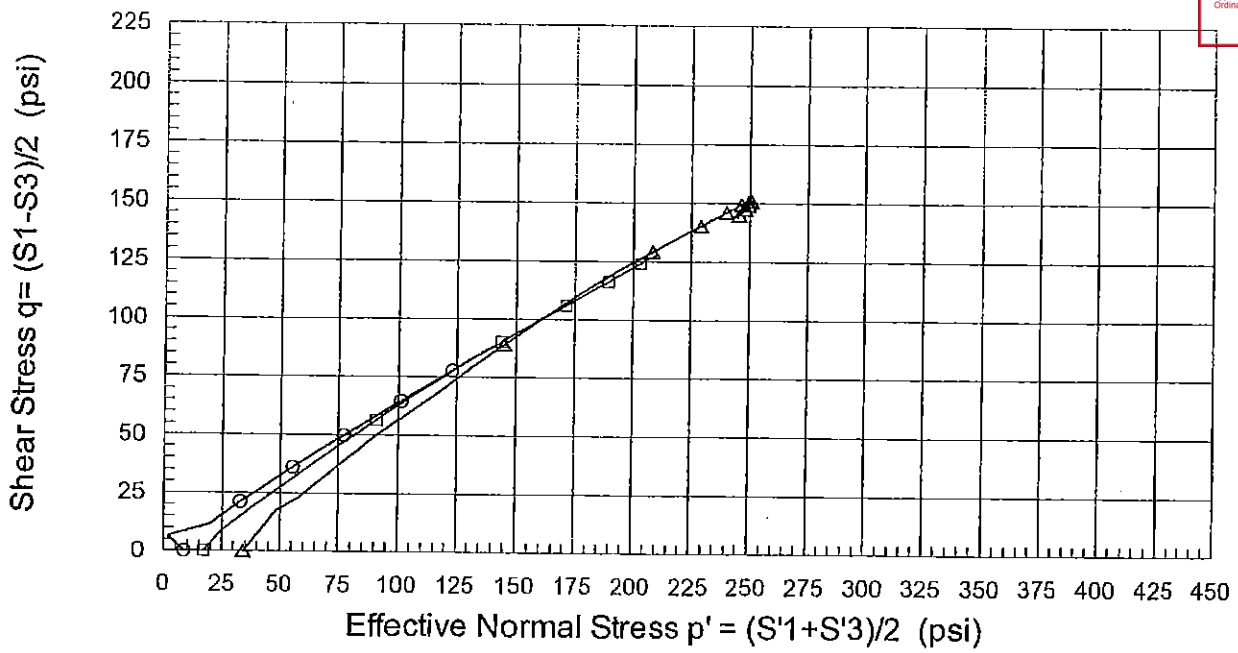

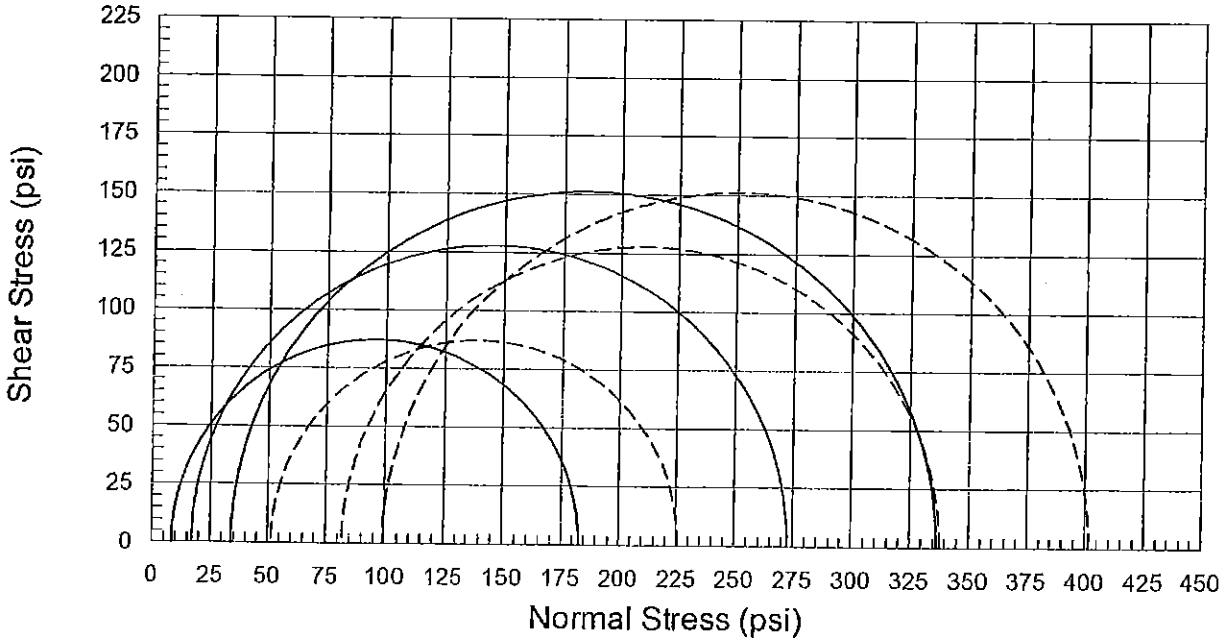

	Boring No.	Sample No.	Depth (ft.)	Eff. Conf. Pressure (psi)	Max. Dev. Stress (psi)
○	B-8	R-6	35.0	8.5	174.2
□	B-8	R-6	35.0	17.0	255.8
△	B-8	R-6	35.0	34.0	302.5

——— Mohr Circle based on Total Stress
– – – – – – Mohr Circle based on Effective Stress

Leighton

Project No.: 600024-004
Dana Point Harbor Renovation

Consolidated Undrained
Triaxial Compression Test
(Three Stage)
ASTM D 4767 mod.

11-07

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CONSOLIDATED UNDRAINED TRIAXIAL TEST
Three Stage (ASTM D 4767 mod.)

Project Name:	Dana Point Harbor Renovation	Tested By:	A. Santos	Date: 11/13/07
roject No:	600024-004	Checked By:	J. Ward	Date: 11/26/07
Boring No.:	B-8			
Sample No.:	R-6			
Depth (ft.):	35			
Sample Type:	Drive			

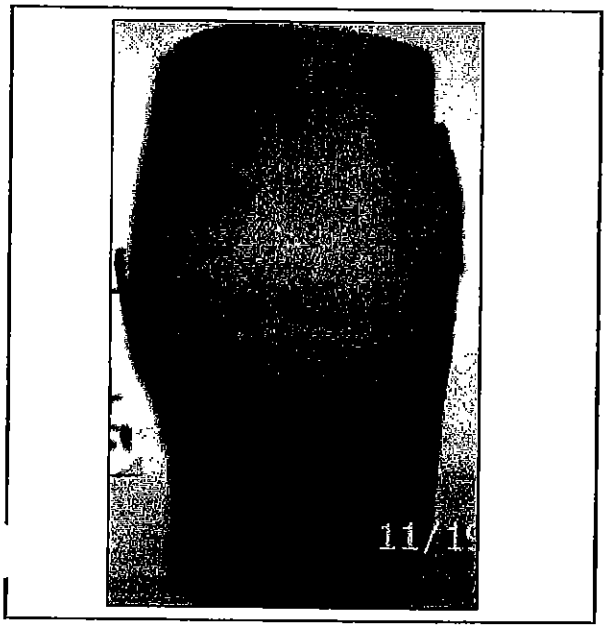

34 psi

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

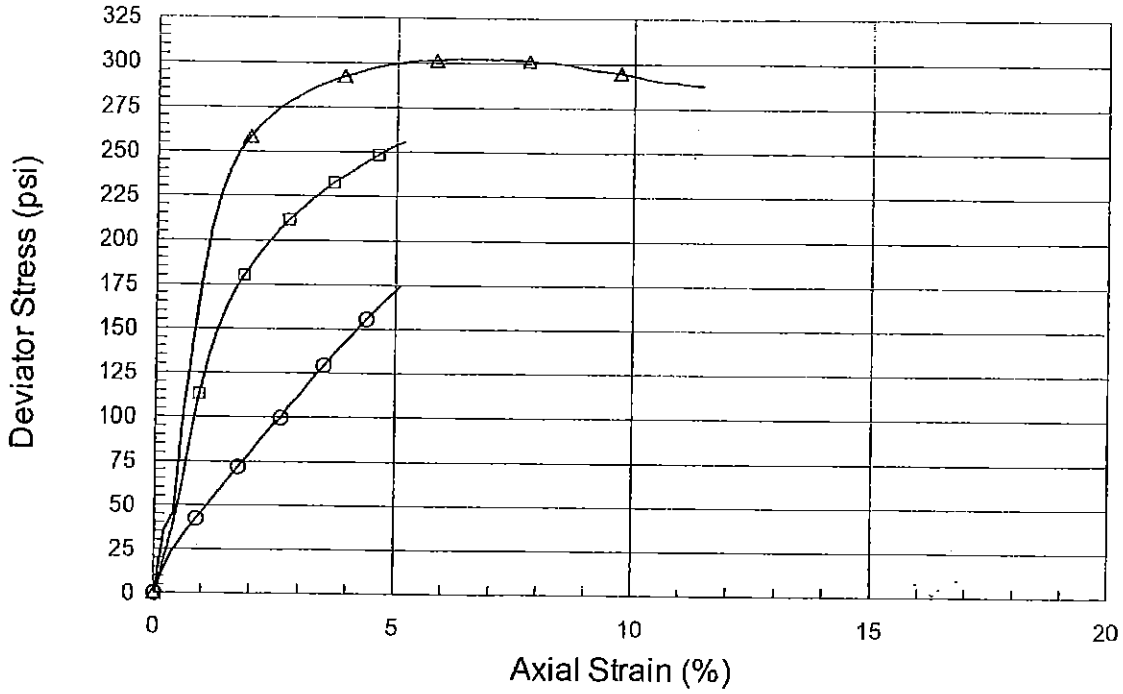

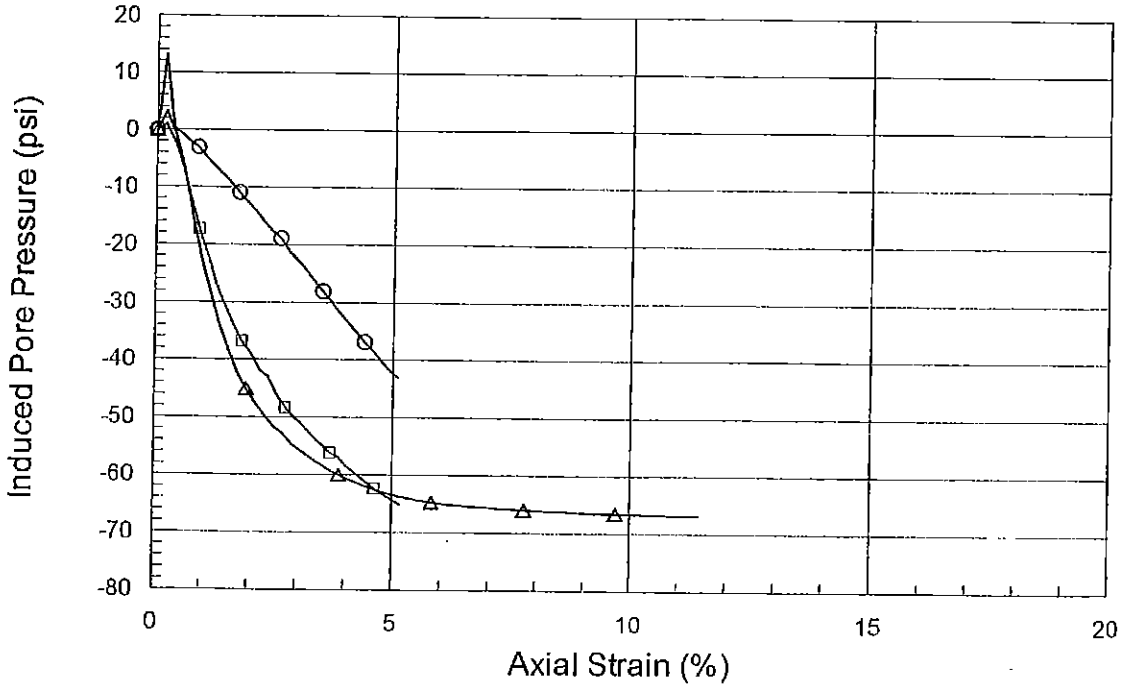

	Boring No.	Sample No.	Depth (ft.)	Eff. Conf. Pressure (psi)	Max. Dev. Stress (psi)
○	B-8	R-6	35.0	8.5	174.2
□	B-8	R-6	35.0	17.0	255.8
△	B-8	R-6	35.0	34.0	302.5

Leighton

Project No.: 600024-004
Dana Point Harbor Renovation

Consolidated Undrained
Triaxial Compression Test
(Three Stage)
ASTM D 4767 mod.

11-07

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Leighton

SOIL RESISTIVITY TEST

DOT CA TEST 532 / 643

Project Name: Dana Point Harbor Renovation
Project No. : 600024-004
Boring No.: B-8
Sample No. : Bag-1
Soil Identification: SC

Tested By : V. Juliano Date: 11/14/07
Data Input By: LF Date: 11/20/07
Depth (ft.) : 0-5

Specimen No.	Water Added (ml) (Wa)	Adjusted Moisture Content (MC)	Resistance Reading (ohm)	Soil Resistivity (ohm-cm)
1	200	26.27	56	378
2	300	34.69	46	310
3	400	43.11	44	297
4	500	51.53	45	304
5				

Moisture Content (%) (MCi)	9.44
Wet Wt. of Soil + Cont. (g)	181.20
Dry Wt. of Soil + Cont. (g)	169.87
Wt. of Container (g)	49.80
Container No.	
Initial Soil Wt. (g) (Wt)	1300.00
Box Constant	6.746
MC =(((1+Mci/100)x(Wa/Wt+1))-1)x100	

Min. Resistivity (ohm-cm)	Moisture Content (%)	Sulfate Content (ppm)	Chloride Content (ppm)	Soil pH	
				pH	Temp. (°C)
DOT CA Test 532 / 643		DOT CA Test 417 Part II	DOT CA Test 422	DOT CA Test 532 / 643	
297	**43.1**	**1013**	**651**	**6.06**	**21.8**

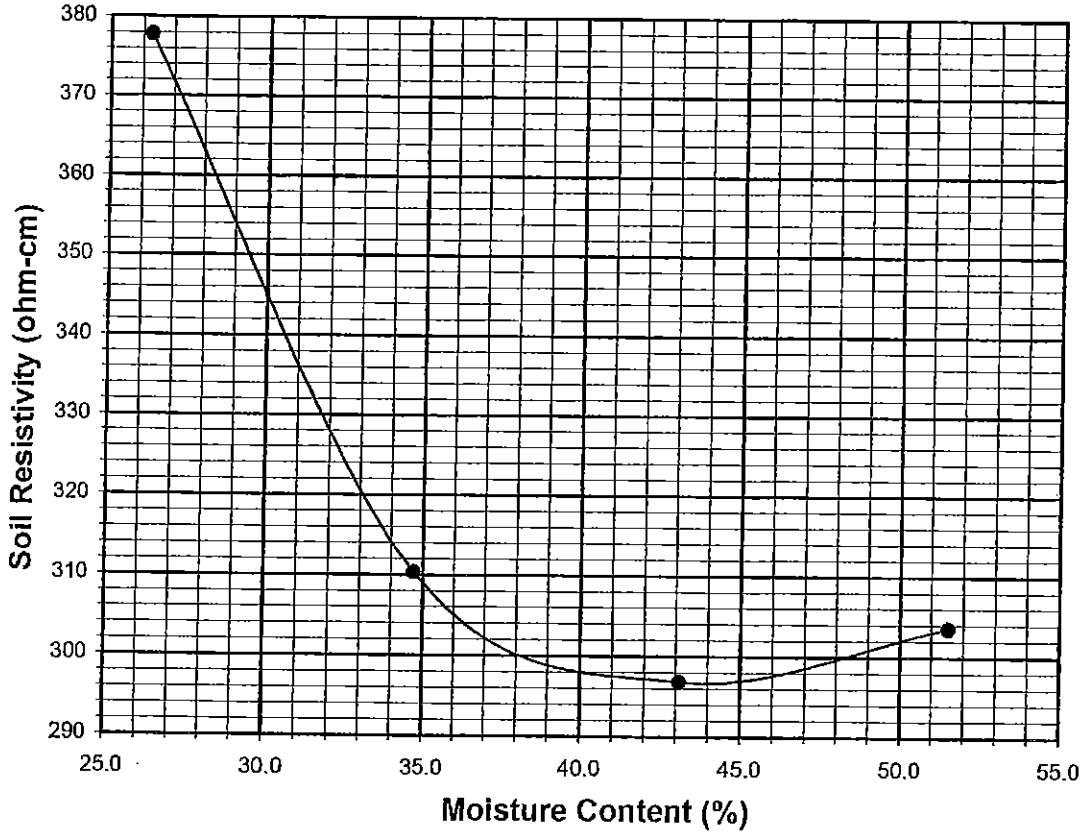

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C

Infiltration Test Results

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services review and approval of the stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/11/2018
Project Number:	17-206-02			**Tested By:**	KMF
Test Hole Number:	DH-5			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	9:57	10:32	35.0	35.0	0.67	0.75	52.00	51.00	1.00	51.50	0.06
2	10:32	11:02	30.0	65.0	0.75	0.83	51.00	50.00	1.00	50.50	0.08
3	11:02	11:32	30.0	95.0	0.75	0.75	51.00	51.00	0.00	51.00	0.00
4	11:32	12:02	30.0	125.0	0.75	0.83	51.00	50.00	1.00	50.50	0.08
5	12:02	12:32	30.0	155.0	0.75	0.83	51.00	50.00	1.00	50.50	0.08
6	12:32	13:02	30.0	185.0	0.75	0.75	51.00	51.00	0.00	51.00	0.00
7	13:02	13:32	30.0	215.0	0.75	0.77	51.00	50.75	0.25	50.88	0.02
8	13:32	14:02	30.0	245.0	0.75	0.83	51.00	50.00	1.00	50.50	0.08
9	14:02	14:32	30.0	275.0	0.67	0.71	52.00	51.50	0.50	51.75	0.04
10	14:32	15:02	30.0	305.0	0.67	0.75	52.00	51.00	1.00	51.50	0.07
11	15:02	15:32	30.0	335.0	0.67	0.75	51.96	51.00	0.96	51.48	0.07
12	15:32	16:32	60.0	395.0	0.67	0.75	51.96	51.00	0.96	51.48	0.04
13	15:32	16:32	60.0	455.0	0.67	0.75	51.96	51.00	0.96	51.48	0.04

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.04
FACTORED INFILTRATION RATE (IN/HR):	0.02

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services review and approval, the stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/11/2018
Project Number:	17-206-02			**Tested By:**	KMF
Test Hole Number:	DH-7			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	10:18	10:43	25.0	25.0	0.83	0.92	50.00	49.00	1.00	49.50	0.09
2	10:43	11:13	30.0	55.0	0.85	0.88	49.80	49.50	0.30	49.65	0.02
3	11:13	11:43	30.0	85.0	0.84	0.87	49.90	49.60	0.30	49.75	0.02
4	11:43	12:13	30.0	115.0	0.86	0.92	49.70	48.95	0.75	49.33	0.06
5	12:13	12:43	30.0	145.0	0.83	0.83	50.00	50.00	0.00	50.00	0.00
6	12:43	13:13	30.0	175.0	0.83	0.85	50.00	49.75	0.25	49.88	0.02
7	13:13	13:43	30.0	205.0	0.85	0.92	49.75	49.00	0.75	49.38	0.06
8	13:43	14:13	30.0	235.0	0.79	0.87	50.50	49.56	0.94	50.03	0.07
9	14:13	14:43	30.0	265.0	0.83	0.90	50.00	49.20	0.80	49.60	0.06
10	14:43	15:13	30.0	295.0	0.83	0.90	50.00	49.20	0.80	49.60	0.06
11	15:13	15:43	30.0	325.0	0.83	0.90	50.00	49.20	0.80	49.60	0.06
12	15:43	16:13	30.0	355.0	0.83	0.90	50.00	49.20	0.80	49.60	0.06
13	16:13	16:43	30.0	385.0	0.83	0.90	50.00	49.20	0.80	49.60	0.06

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.05
FACTORED INFILTRATION RATE (IN/HR):	0.02

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services Coverage is only for the stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/12/2018
Project Number:	17-206-02			**Tested By:**	KMF
Test Hole Number:	DH-8			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	6:01	6:26	25.0	25.0	0.58	0.63	53.00	52.50	0.50	52.75	0.04
2	6:26	6:56	30.0	55.0	0.56	0.56	53.25	53.25	0.00	53.25	0.00
3	6:56	7:26	30.0	85.0	0.56	0.60	53.25	52.75	0.50	53.00	0.04
4	7:26	7:56	30.0	115.0	0.56	0.58	53.25	53.00	0.25	53.13	0.02
5	7:56	8:26	30.0	145.0	0.56	0.58	53.25	53.00	0.25	53.13	0.02
6	8:26	8:56	30.0	175.0	0.56	0.56	53.25	53.25	0.00	53.25	0.00
7	8:56	9:26	30.0	205.0	0.56	0.58	53.25	53.00	0.25	53.13	0.02
8	9:26	9:56	30.0	235.0	0.56	0.56	53.25	53.25	0.00	53.25	0.00
9	9:56	10:26	30.0	265.0	0.56	0.58	53.25	53.00	0.25	53.13	0.02
10	10:26	10:56	30.0	295.0	0.56	0.65	53.25	52.25	1.00	52.75	0.07
11	10:56	11:26	30.0	325.0	0.50	0.54	54.00	53.50	0.50	53.75	0.04
12	11:26	11:56	30.0	355.0	0.50	0.54	54.00	53.50	0.50	53.75	0.04
13	11:56	12:26	30.0	385.0	0.50	0.53	54.00	53.64	0.36	53.82	0.03

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.03
FACTORED INFILTRATION RATE (IN/HR):	0.01

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services in Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization				**Date:**	9/12/2018	
Project Number:	17-206-02				**Tested By:**	MF	
Test Hole Number:	DH-9				**USCS Soil Classification:**	SC	
Total Depth :	5.00	feet			**Water Temperature:**	75	°F
Test Hole Diameter:	8.00	inches	radius=	4	inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	5:58	6:23	25.0	25.0	0.75	0.83	51.00	50.00	1.00	50.50	0.09
2	6:23	6:53	30.0	55.0	0.75	0.77	51.00	50.75	0.25	50.88	0.02
1	6:53	7:23	30.0	85.0	0.75	0.81	51.00	50.25	0.75	50.63	0.06
2	7:23	7:53	30.0	115.0	0.75	0.81	51.00	50.25	0.75	50.63	0.06
3	7:53	8:23	30.0	145.0	0.75	0.79	51.00	50.50	0.50	50.75	0.04
4	8:23	8:53	30.0	175.0	0.75	0.79	51.00	50.50	0.50	50.75	0.04
5	8:53	9:23	30.0	205.0	0.75	0.79	51.00	50.50	0.50	50.75	0.04
6	9:23	9:53	30.0	235.0	0.75	0.77	51.00	50.75	0.25	50.88	0.02
7	9:53	10:23	30.0	265.0	0.75	0.81	51.00	50.25	0.75	50.63	0.06
8	10:23	10:53	30.0	295.0	0.75	0.81	51.00	50.25	0.75	50.63	0.06
9	10:53	11:23	30.0	325.0	0.75	0.77	51.00	50.75	0.25	50.88	0.02
10	11:23	11:53	30.0	355.0	0.75	0.77	51.00	50.75	0.25	50.88	0.02
11	11:53	12:23	30.0	385.0	0.75	0.77	51.00	50.75	0.25	50.88	0.02
12	12:23	12:53	30.0	415.0	0.75	0.79	51.00	50.50	0.50	50.75	0.04
13	12:53	13:23	30.0	445.0	0.75	0.77	51.00	50.75	0.25	50.88	0.02
14	13:23	13:53	30.0	475.0	0.75	0.79	51.00	50.50	0.50	50.75	0.04

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.03
FACTORED INFILTRATION RATE (IN/HR):	0.01

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization				**Date:**	9/12/2018	
Project Number:	17-206-02				**Tested By:**	MF	
Test Hole Number:	DH-10				**USCS Soil Classification:**	SC	
Total Depth :	5.00	feet			**Water Temperature:**	75	°F
Test Hole Diameter:	8.00	inches	radius=	4	inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	5:57	7:52	115.0	115.0	1.83	1.83	38.00	38.00	0.00	38.00	0.00
2	6:22	8:19	117.0	232.0	1.83	1.83	38.00	38.00	0.00	38.00	0.00
1	6:52	7:22	30.0	262.0	1.83	1.88	38.00	37.50	0.50	37.75	0.05
2	7:22	7:52	30.0	292.0	1.83	1.88	38.00	37.44	0.56	37.72	0.06
3	7:52	8:22	30.0	322.0	1.83	1.88	38.00	37.44	0.56	37.72	0.06
4	8:22	8:52	30.0	352.0	1.83	1.88	38.00	37.44	0.56	37.72	0.06
5	8:52	9:22	30.0	382.0	1.83	1.88	38.00	37.44	0.56	37.72	0.06
6	9:22	9:52	30.0	412.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08
7	9:52	10:22	30.0	442.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08
8	10:22	10:52	30.0	472.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08
9	10:52	11:22	30.0	502.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08
10	11:22	11:52	30.0	532.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08
11	11:52	12:22	30.0	562.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08
12	12:22	12:52	30.0	592.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08
13	12:52	13:22	30.0	622.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08
14	13:22	13:52	30.0	652.0	1.83	1.90	38.00	37.20	0.80	37.60	0.08

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.07
FACTORED INFILTRATION RATE (IN/HR):	0.03

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services Coverage exempt. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/12/2018
Project Number:	17-206-02			**Tested By:**	KMF
Test Hole Number:	DH-13			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	6:06	6:31	25.0	25.0	2.63	2.68	28.44	27.84	0.60	28.14	0.10
2	6:31	7:01	30.0	55.0	2.50	2.65	30.00	28.20	1.80	29.10	0.23
3	7:01	7:31	30.0	85.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
4	7:31	8:01	30.0	115.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
5	8:01	8:31	30.0	145.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
6	8:31	9:01	30.0	175.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
7	9:01	9:31	30.0	205.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
8	9:31	10:01	30.0	235.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
9	10:01	10:31	30.0	265.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
10	10:31	11:01	30.0	295.0	2.50	2.75	30.00	27.00	3.00	28.50	0.39
11	11:01	11:31	30.0	325.0	2.50	2.75	30.00	27.00	3.00	28.50	0.39
12	11:31	12:01	30.0	355.0	2.50	2.75	30.00	27.00	3.00	28.50	0.39
13	12:01	12:31	30.0	385.0	2.50	2.75	30.00	27.00	3.00	28.50	0.39
14	12:31	13:01	30.0	415.0	2.51	2.67	29.88	27.96	1.92	28.92	0.25

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.29
FACTORED INFILTRATION RATE (IN/HR):	0.13

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services review and approval, the stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/12/2018
Project Number:	17-206-02			**Tested By:**	KMF
Test Hole Number:	DH-14			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	6:09	6:34	25.0	25.0	2.08	2.25	35.04	33.00	2.04	34.02	0.27
2	6:31	7:04	33.0	58.0	2.08	2.25	35.04	33.00	2.04	34.02	0.21
3	7:04	7:34	30.0	88.0	2.08	2.25	35.04	33.00	2.04	34.02	0.23
4	7:34	8:04	30.0	118.0	2.08	2.25	35.04	33.00	2.04	34.02	0.23
5	8:04	8:34	30.0	148.0	2.08	2.25	35.04	33.00	2.04	34.02	0.23
6	8:34	9:04	30.0	178.0	2.08	2.25	35.04	33.00	2.04	34.02	0.23
7	9:04	9:34	30.0	208.0	2.08	2.25	35.04	33.00	2.04	34.02	0.23
8	9:34	10:04	30.0	238.0	2.08	2.25	35.04	33.00	2.04	34.02	0.23
9	10:04	10:34	30.0	268.0	2.08	2.25	35.04	33.00	2.04	34.02	0.23
10	10:34	11:04	30.0	298.0	2.08	2.25	35.04	33.00	2.04	34.02	0.23
11	11:04	11:34	30.0	328.0	2.08	2.17	35.04	33.96	1.08	34.50	0.12
12	11:34	12:04	30.0	358.0	2.08	2.17	35.04	33.96	1.08	34.50	0.12
13	12:04	12:34	30.0	388.0	2.08	2.17	35.04	33.96	1.08	34.50	0.12

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.10
FACTORED INFILTRATION RATE (IN/HR):	0.04

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services in Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization				**Date:**	9/12/2018	
Project Number:	17-206-02				**Tested By:**	MF	
Test Hole Number:	DH-17				**USCS Soil Classification:**	SC	
Total Depth :	5.00	feet			**Water Temperature:**	75	°F
Test Hole Diameter:	8.00	inches	radius=	4	inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	7:25	7:50	25.0	25.0	2.58	3.57	29.04	17.16	11.88	23.10	2.27
2	7:51	8:16	25.0	50.0	2.57	3.67	29.16	15.96	13.20	22.56	2.58
1	8:16	8:46	30.0	80.0	2.25	3.17	33.00	21.96	11.04	27.48	1.50
2	8:48	9:18	30.0	110.0	2.42	3.33	30.96	20.04	10.92	25.50	1.59
3	9:18	9:48	30.0	140.0	2.29	3.17	32.52	21.96	10.56	27.24	1.44
4	9:48	10:18	30.0	170.0	2.42	3.17	30.96	21.96	9.00	26.46	1.26
5	10:18	10:48	30.0	200.0	2.40	3.29	31.20	20.52	10.68	25.86	1.53
6	10:48	11:18	30.0	230.0	2.46	3.71	30.48	15.48	15.00	22.98	2.40
7	11:18	11:48	30.0	260.0	2.40	3.33	31.20	20.04	11.16	25.62	1.62
8	11:48	12:18	30.0	290.0	2.50	3.48	30.00	18.24	11.76	24.12	1.80
9	12:18	12:48	30.0	320.0	2.33	3.19	32.04	21.72	10.32	26.88	1.43
10	12:48	13:18	30.0	350.0	2.67	3.58	27.96	17.04	10.92	22.50	1.78
11	13:18	13:48	30.0	380.0	2.38	3.13	31.44	22.44	9.00	26.94	1.24
12	13:48	14:18	30.0	410.0	2.42	3.13	30.96	22.44	8.52	26.70	1.19

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	1.19
FACTORED INFILTRATION RATE (IN/HR):	0.53

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services in Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/12/2018
Project Number:	17-206-02			**Tested By:**	MF
Test Hole Number:	DH-18			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	7:30	7:55	25.0	25.0	2.16	2.79	34.08	26.52	7.56	30.30	1.12
2	7:56	8:21	25.0	50.0	2.16	2.83	34.08	26.04	8.04	30.06	1.20
1	8:21	8:51	30.0	80.0	1.91	2.58	37.08	29.04	8.04	33.06	0.92
2	8:51	9:21	30.0	110.0	2.16	2.41	34.08	31.08	3.00	32.58	0.35
3	9:21	9:51	30.0	140.0	2.16	2.37	34.08	31.56	2.52	32.82	0.29
4	9:51	10:21	30.0	170.0	2.16	2.41	34.08	31.08	3.00	32.58	0.35
5	10:21	10:51	30.0	200.0	2.16	2.41	34.08	31.08	3.00	32.58	0.35
6	10:51	11:21	30.0	230.0	1.98	2.29	36.24	32.52	3.72	34.38	0.41
7	11:21	11:51	30.0	260.0	1.91	2.29	37.08	32.52	4.56	34.80	0.50
8	11:51	12:21	30.0	290.0	1.99	2.37	36.12	31.56	4.56	33.84	0.51
9	12:21	12:51	30.0	320.0	1.99	2.25	36.12	33.00	3.12	34.56	0.34
10	12:51	13:21	30.0	350.0	1.99	2.29	36.12	32.52	3.60	34.32	0.40
11	13:21	13:51	30.0	380.0	1.91	2.14	37.08	34.32	2.76	35.70	0.29
12	13:51	14:21	30.0	410.0	1.91	2.14	37.08	34.32	2.76	35.70	0.29

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.28
FACTORED INFILTRATION RATE (IN/HR):	0.12

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services in Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization				**Date:**	9/12/2018	
Project Number:	17-206-02				**Tested By:**	MF	
Test Hole Number:	DH-19				**USCS Soil Classification:**	SC	
Total Depth :	4.00	feet			**Water Temperature:**	75	°F
Test Hole Diameter:	8.00	inches	radius=	4	inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	7:27	7:52	25.0	25.0	2.58	2.62	17.04	16.56	0.48	16.80	0.12
2	7:54	8:19	25.0	50.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
1	8:19	8:49	30.0	80.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
2	8:49	9:19	30.0	110.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
3	9:19	9:49	30.0	140.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
4	9:49	10:19	30.0	170.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
5	10:19	10:49	30.0	200.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
6	10:49	11:19	30.0	230.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
7	11:19	11:49	30.0	260.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
8	11:49	12:19	30.0	290.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
9	12:19	12:49	30.0	320.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
10	12:49	13:19	30.0	350.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
11	13:19	13:49	30.0	380.0	2.58	2.59	17.04	16.92	0.12	16.98	0.03
12	13:51	2:19	-692.0	-312.0	2.58	2.59	17.04	16.92	0.12	16.98	0.00

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.01
FACTORED INFILTRATION RATE (IN/HR):	0.01

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services in Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization				**Date:**	9/12/2018	
Project Number:	17-206-02				**Tested By:**	MF	
Test Hole Number:	DH-20				**USCS Soil Classification:**	SC	
Total Depth :	5.00	feet			**Water Temperature:**	75	°F
Test Hole Diameter:	8.00	inches	radius=	4	inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	7:20	7:45	25.0	25.0	2.67	2.67	27.96	27.96	0.00	27.96	0.00
2	7:46	8:11	25.0	50.0	2.67	2.67	27.96	27.96	0.00	27.96	0.00
1	8:11	8:41	30.0	80.0	2.67	2.67	27.96	27.96	0.00	27.96	0.00
2	8:41	9:11	30.0	110.0	2.67	2.67	27.96	27.96	0.00	27.96	0.00
3	9:11	9:41	30.0	140.0	2.67	2.67	27.96	27.96	0.00	27.96	0.00
4	9:41	10:11	30.0	170.0	2.67	2.67	27.96	27.96	0.00	27.96	0.00
5	10:11	10:41	30.0	200.0	2.67	2.67	27.96	27.96	0.00	27.96	0.00
6	10:41	11:11	30.0	230.0	2.67	2.67	27.96	27.96	0.00	27.96	0.00
7	11:11	11:41	30.0	260.0	2.67	2.92	27.96	24.96	3.00	26.46	0.42
8	11:41	12:11	30.0	290.0	2.67	2.83	27.96	26.04	1.92	27.00	0.26
9	12:11	12:41	30.0	320.0	2.50	2.65	30.00	28.20	1.80	29.10	0.23
10	12:41	13:11	30.0	350.0	2.50	2.67	30.00	27.96	2.04	28.98	0.26
11	13:11	13:41	30.0	380.0	2.56	2.67	29.28	27.96	1.32	28.62	0.17
12	13:41	14:11	30.0	410.0	2.50	2.58	30.00	29.04	0.96	29.52	0.12

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.16
FACTORED INFILTRATION RATE (IN/HR):	0.07

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
By: K. Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/12/2018
Project Number:	17-206-02			**Tested By:**	MF
Test Hole Number:	DH-21			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	7:21	7:46	25.0	25.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
2	7:49	8:14	25.0	50.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
1	8:14	8:44	30.0	80.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
2	8:44	9:14	30.0	110.0	2.50	2.58	30.00	29.04	0.96	29.52	0.12
3	9:14	9:44	30.0	140.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
4	9:44	10:14	30.0	170.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
5	10:14	10:44	30.0	200.0	2.50	2.54	30.00	29.52	0.48	29.76	0.06
6	10:44	11:14	30.0	230.0	2.50	2.54	30.00	29.52	0.48	29.76	0.06
7	11:14	11:44	30.0	260.0	2.50	2.50	30.00	30.00	0.00	30.00	0.00
8	11:44	12:14	30.0	290.0	2.50	2.52	30.00	29.76	0.24	29.88	0.03
9	12:14	12:44	30.0	320.0	2.52	2.56	29.76	29.28	0.48	29.52	0.06
10	12:44	13:14	30.0	350.0	2.50	2.58	30.00	29.04	0.96	29.52	0.12
11	13:14	13:44	30.0	380.0	2.50	2.58	30.00	29.04	0.96	29.52	0.12
12	13:44	14:14	30.0	410.0	2.50	2.58	30.00	29.04	0.96	29.52	0.12

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.10
FACTORED INFILTRATION RATE (IN/HR):	0.05

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
By: K. Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/12/2018	
Project Number:	17-206-02			**Tested By:**	MF	
Test Hole Number:	DH-22			**USCS Soil Classification:**	SC	
Total Depth :	5.00	feet		**Water Temperature:**	75	°F
Test Hole Diameter:	8.00 inches	radius=	4 inches			

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	7:43	8:08	25.0	25.0	2.42	3.65	30.96	16.20	14.76	23.58	2.77
2	8:09	8:34	25.0	50.0	2.42	3.50	30.96	18.00	12.96	24.48	2.35
1	8:34	9:04	30.0	80.0	2.42	3.08	30.96	23.04	7.92	27.00	1.09
2	9:04	9:34	30.0	110.0	2.42	3.17	30.96	21.96	9.00	26.46	1.26
3	9:34	10:04	30.0	140.0	2.42	3.17	30.96	21.96	9.00	26.46	1.26
4	10:04	10:34	30.0	170.0	2.42	3.33	30.96	20.04	10.92	25.50	1.59
5	10:34	11:04	30.0	200.0	2.25	3.17	33.00	21.96	11.04	27.48	1.50
6	11:04	11:34	30.0	230.0	2.25	2.88	33.00	25.44	7.56	29.22	0.97
7	11:34	12:04	30.0	260.0	2.38	2.85	31.44	25.80	5.64	28.62	0.74
8	12:04	12:34	30.0	290.0	2.25	2.47	33.00	30.36	2.64	31.68	0.31
9	12:34	13:04	30.0	320.0	2.23	2.43	33.24	30.84	2.40	32.04	0.28
10	13:04	13:34	30.0	350.0	2.25	2.49	33.00	30.12	2.88	31.56	0.34
11	13:34	14:04	30.0	380.0	2.27	2.42	32.76	30.96	1.80	31.86	0.21
12	14:04	14:34	30.0	410.0	2.28	2.49	32.64	30.12	2.52	31.38	0.30

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.24
FACTORED INFILTRATION RATE (IN/HR):	0.11

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services Engineering review and stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State Law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/12/2018
Project Number:	17-206-02			**Tested By:**	KMF
Test Hole Number:	DH-23			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_r	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	9:31	9:56	25.0	25.0	3.42	3.58	18.96	17.04	1.92	18.00	0.46
2	9:58	10:28	30.0	55.0	3.42	3.56	18.96	17.28	1.68	18.12	0.33
3	10:30	11:09	39.0	94.0	3.43	3.60	18.84	16.80	2.04	17.82	0.32
4	11:10	11:37	27.0	121.0	3.37	3.42	19.56	18.96	0.60	19.26	0.13
5	11:38	12:08	30.0	151.0	3.42	3.53	18.96	17.64	1.32	18.30	0.26
6	12:10	12:40	30.0	181.0	3.42	3.51	18.96	17.88	1.08	18.42	0.21
7	12:41	13:10	29.0	210.0	3.43	3.47	18.84	18.36	0.48	18.60	0.10
8	13:11	13:45	34.0	244.0	3.42	3.50	18.96	18.00	0.96	18.48	0.17
9	13:46	14:11	25.0	269.0	3.41	3.48	19.08	18.24	0.84	18.66	0.20
10	14:12	14:41	29.0	298.0	3.41	3.48	19.08	18.24	0.84	18.66	0.17
11	14:43	15:13	30.0	328.0	3.42	3.48	18.96	18.24	0.72	18.60	0.14
12	15:14	15:44	30.0	358.0	3.41	3.45	19.08	18.60	0.48	18.84	0.09

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.11
FACTORED INFILTRATION RATE (IN/HR):	0.05

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services Engineering review and stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State Law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	9/12/2018
Project Number:	17-206-02			**Tested By:**	KMF
Test Hole Number:	DH-24			**USCS Soil Classification:**	SC
Total Depth :	5.00	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_r	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	9:35	10:02	27.0	27.0	3.40	3.45	19.20	18.60	0.60	18.90	0.13
2	10:04	10:34	30.0	57.0	3.38	3.40	19.44	19.20	0.24	19.32	0.05
3	10:36	11:13	37.0	94.0	3.40	3.46	19.20	18.48	0.72	18.84	0.11
4	11:14	11:41	27.0	121.0	3.37	3.41	19.56	19.08	0.48	19.32	0.10
5	11:42	12:12	30.0	151.0	3.41	3.41	19.08	19.08	0.00	19.08	0.00
6	12:12	12:42	30.0	181.0	3.41	3.45	19.08	18.60	0.48	18.84	0.09
7	12:42	13:13	31.0	212.0	3.45	3.47	18.60	18.36	0.24	18.48	0.05
8	13:14	13:48	34.0	246.0	3.47	3.50	18.36	18.00	0.36	18.18	0.06
9	13:49	14:14	25.0	271.0	3.39	3.43	19.32	18.84	0.48	19.08	0.11
10	14:15	14:44	29.0	300.0	3.45	3.47	18.60	18.36	0.24	18.48	0.05
11	14:45	15:16	31.0	331.0	3.47	3.49	18.36	18.12	0.24	18.24	0.05
12	15:17	15:46	29.0	360.0	3.37	3.40	19.56	19.20	0.36	19.38	0.07

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.05
FACTORED INFILTRATION RATE (IN/HR):	0.02

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX C-1

Previous Infiltration Testing Results

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works. OC Development Services personnel may inspect stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	8/27/2012
Project Number:	11-161-00			**Tested By:**	N/A
Test Hole Number:	DH-10			**USCS Soil Classification:**	SC
Total Depth :	3.25	feet		**Water Temperature:**	75 °F
Test Hole Diameter:	8.00 inches	radius=	4 inches		

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	8:54	9:35	41.0	91.0	1.19	1.82	24.72	17.16	7.56	20.94	0.96
2	9:38	10:06	28.0	119.0	1.23	1.65	24.24	19.20	5.04	21.72	0.91
3	10:09	10:38	29.0	148.0	1.27	1.63	23.76	19.44	4.32	21.60	0.76
4	10:40	11:08	28.0	176.0	1.26	1.56	23.88	20.28	3.60	22.08	0.64
5	11:10	11:39	29.0	205.0	1.27	1.55	23.76	20.40	3.36	22.08	0.58
6	11:41	12:22	41.0	246.0	1.25	1.53	24.00	20.64	3.36	22.32	0.40
7	12:25	12:59	34.0	280.0	1.16	1.41	25.08	22.08	3.00	23.58	0.41
8	13:01	13:40	39.0	319.0	1.10	1.42	25.80	21.96	3.84	23.88	0.46
9	13:42	14:34	52.0	371.0	1.05	1.42	26.40	21.96	4.44	24.18	0.39
10	14:34	15:09	35.0	406.0	1.00	1.25	27.00	24.00	3.00	25.50	0.37

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.35
FACTORED INFILTRATION RATE (IN/HR):	0.15

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
By: K. Tabatabaee
BUILDING OFFICIAL

Falling Head Borehole Infiltration Test

Project Name:	Dana Point Harbor Revitalization			**Date:**	4/8/2025	
Project Number:	11-161-03			**Tested By:**	N/A	
Test Hole Number:	DH-22			**USCS Soil Classification:**	SC	
Total Depth :	7.00	feet		**Water Temperature:**	75	°F
Test Hole Diameter:	8.00 inches	radius=	4 inches			

Trial	Start Time	End Time	ΔT	Total Time	Initial Depth of Water	Final Depth of Water	H_0	H_f	ΔH	H_{avg}	Unfactored Percolation Rate
			(min)	*(min)*	*(ft)*	*(ft)*	*(in)*	*(in)*	*(in)*	*(in)*	*(in/hour)*
1	7:10	7:40	30.0	80.0	4.50	4.57	30.00	29.16	0.84	29.58	0.11
2	7:41	8:11	30.0	110.0	4.51	4.53	29.88	29.64	0.24	29.76	0.03
3	8:12	8:42	30.0	140.0	4.48	4.51	30.24	29.88	0.36	30.06	0.04
4	8:42	9:12	30.0	170.0	4.46	4.49	30.48	30.12	0.36	30.30	0.04
5	9:13	9:43	30.0	200.0	4.49	4.51	30.12	29.88	0.24	30.00	0.03
6	9:44	10:14	30.0	230.0	4.45	4.48	30.60	30.24	0.36	30.42	0.04
7	10:15	10:45	30.0	260.0	4.45	4.48	30.60	30.24	0.36	30.42	0.04
8	10:45	11:15	30.0	290.0	4.45	4.48	30.60	30.24	0.36	30.42	0.04
9	11:16	11:46	30.0	320.0	4.44	4.47	30.72	30.36	0.36	30.54	0.04
10	11:47	12:17	30.0	350.0	4.39	4.42	31.32	30.96	0.36	31.14	0.04
11	12:18	12:48	30.0	320.0	4.37	4.40	31.56	31.20	0.36	31.38	0.04
12	12:50	13:20	30.0	350.0	4.37	4.40	31.56	31.20	0.36	31.38	0.04

WATER TEMPERATURE CORRECTION FACTOR:	0.85
SAFETY FACTOR*:	2.25
UNFACTORED INFILTRATION RATE (IN/HR):	0.04
FACTORED INFILTRATION RATE (IN/HR):	0.02

Factor Category	Factor Description	Assigned Weight (w)	Factor Value (v)	Product (p) = w x v
Suitability Assessment	Soil assessment methods	0.25	3	0.75
	Predominant soil texture	0.25	2	0.5
	Site soil variablity	0.25	2	0.5
	Depth to groundwater	0.25	2	0.5
			Geotechnical Factor of Safety (SA):	2.25

Concern Level	Factor Value (v)
Low	1
Medium	2
High	3

Factor Description	High Concern	Medium Concern	Low Concern
Soil assessment methods	Use of borhole methods to estimate vertical infiltration rate (not recommended, but may be necessary at a planning level). Less than 2 tests per BMP	At least 2 tests per BMP. Use of borehole tests for dry wells or infiltration trenches. Use of infiltrometer or small scale PIT methods for vertical infiltration BMPs.	Extensive infiltration testing such as: PIT testing or infiltrometer testing at 3+ locations per BMP, and/or commitment to construction phase testing and design adaption if necessary.
Predominant soil texture	Silty and clayey soils with significant fines	Finer sandy soils with some loam content	Clean, granular soils (sands)
Site soil variablity	Highly variable soils indicated from site assessment or limited soil borings collected during site assessment.	Soil borings/test pits indicate moderately homogeneous soils.	Multiple soil borings/test pits indicate relatively homogeneous soils.
Depth to groundwater	Groundwater conditions or movement not well understood.	Seasonal high GW at least 10 ft below facility bottom.	Seasonal high GW at least 15 ft below facility bottom.

***Factor of safety should not be less than 2. Additional factor of safety in accordance with Table D-7 of the South Orange County Technical Guidance Document should be applied by the project civil engineer.**

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX D

CPT Liquefaction Analysis

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-
County of Orange - OC Public Wo
OC Development Services
APPROVED
This set of plans and specifications must be kept on job at all times. It is unlawful to make any changes alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be a approval of the violation of any provisions of any Co Ordinance or State law.
Jitu Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 11-161-00 CPT-1t

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A		
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth applied:	No
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	Limit depth:	N/A
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No	MSF method:	Method based

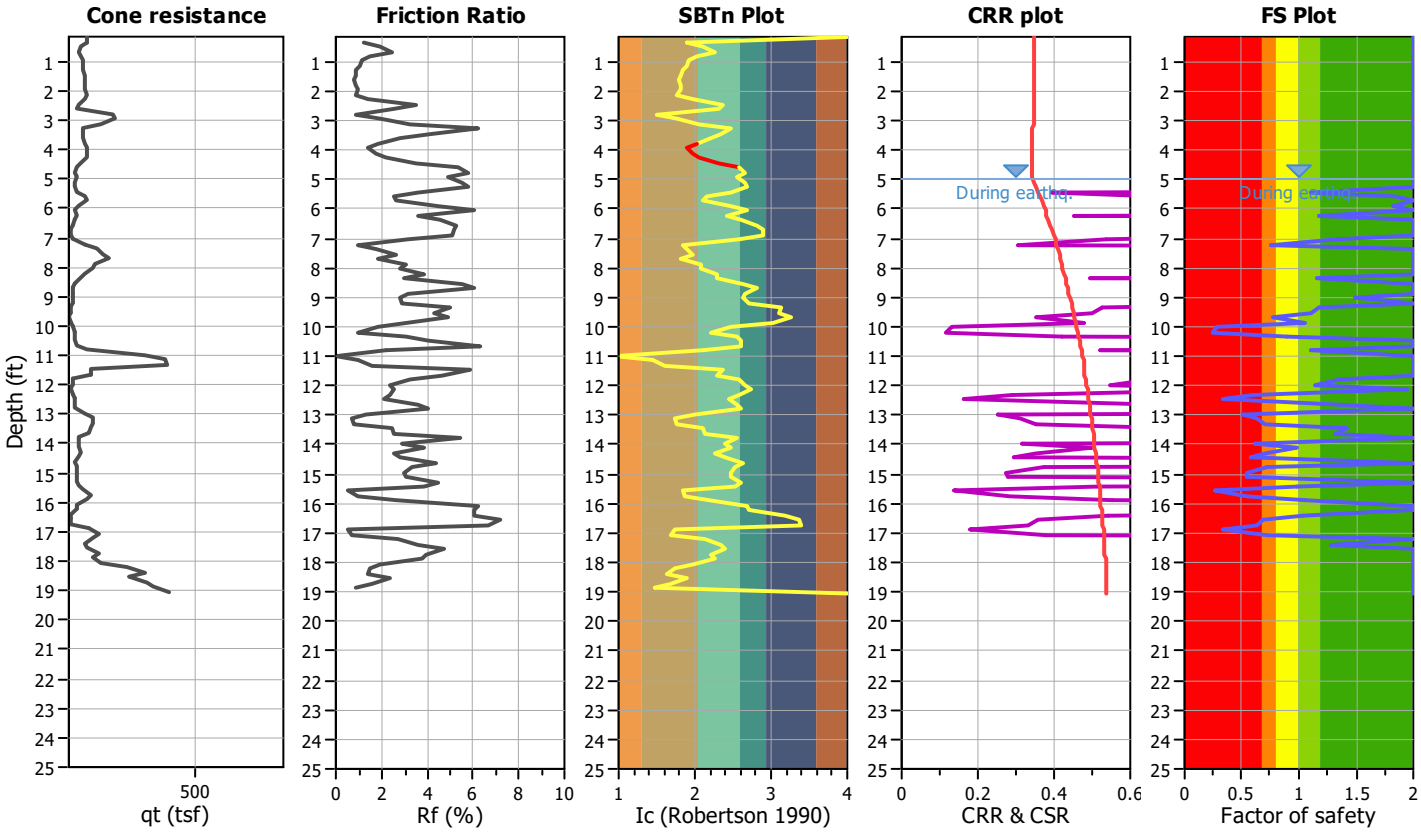

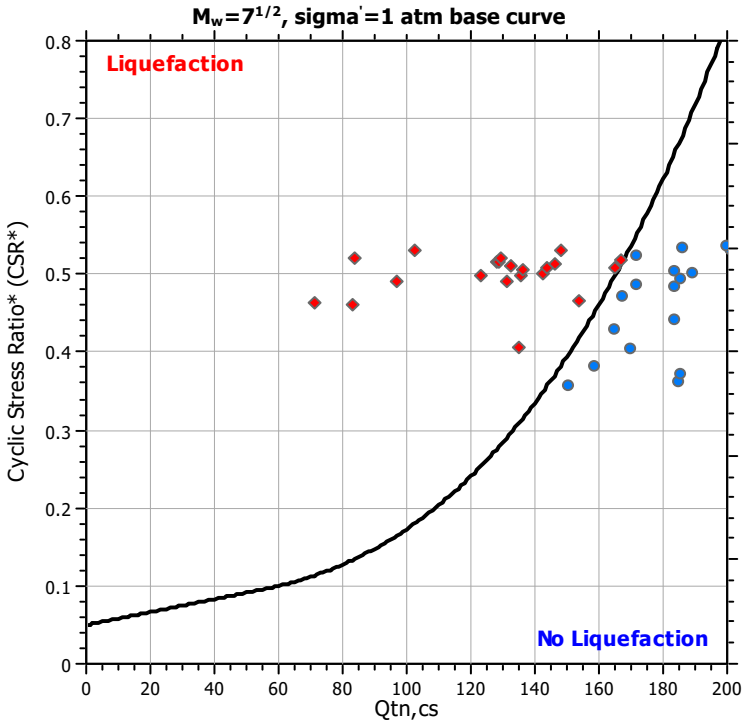

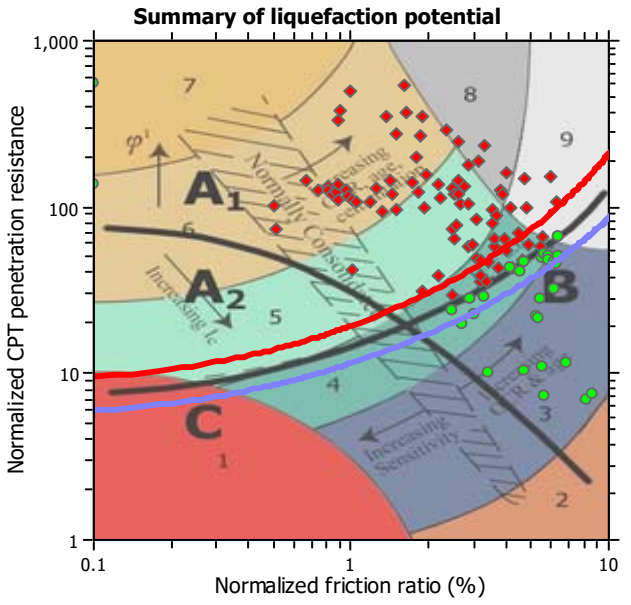

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Changes of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The issuance of these plan specification is SPACE NOT intended to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots

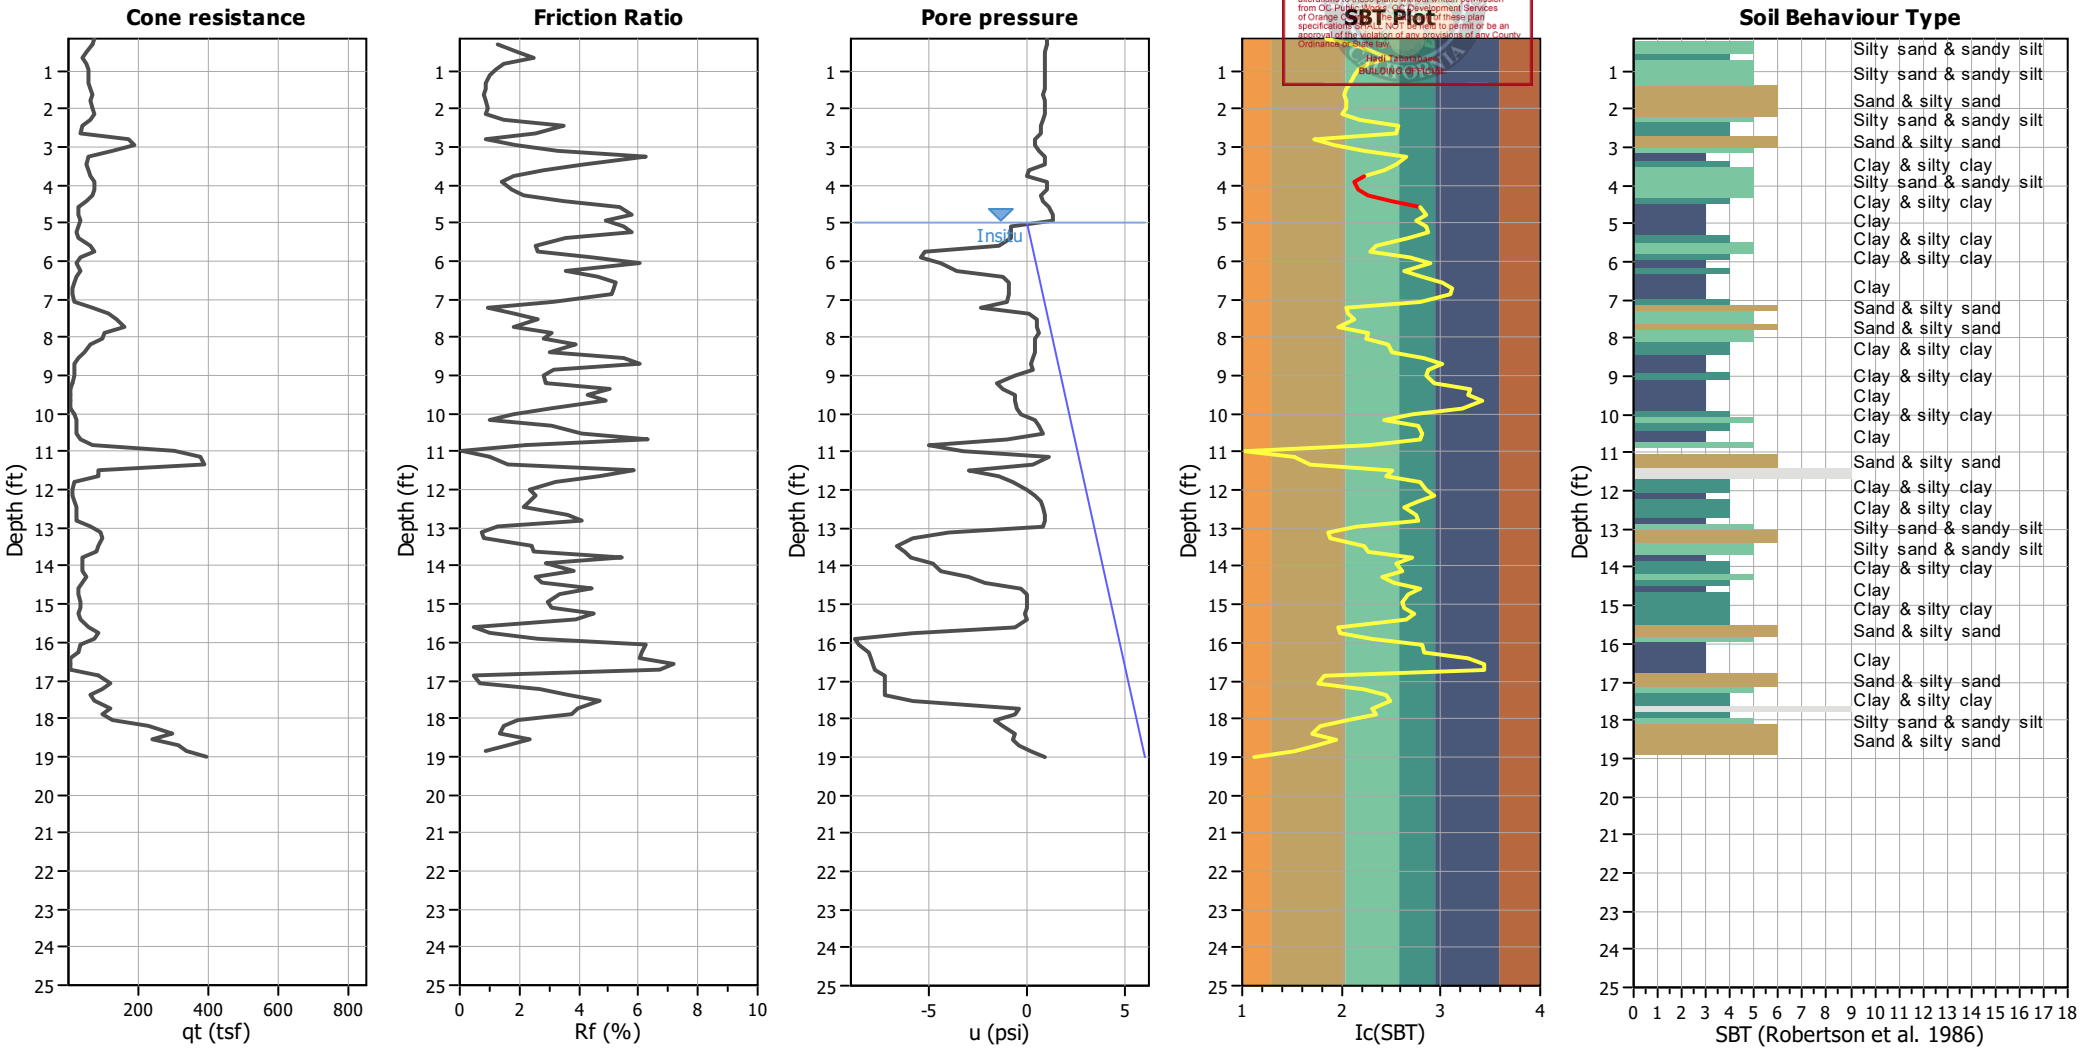

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots (normalized)

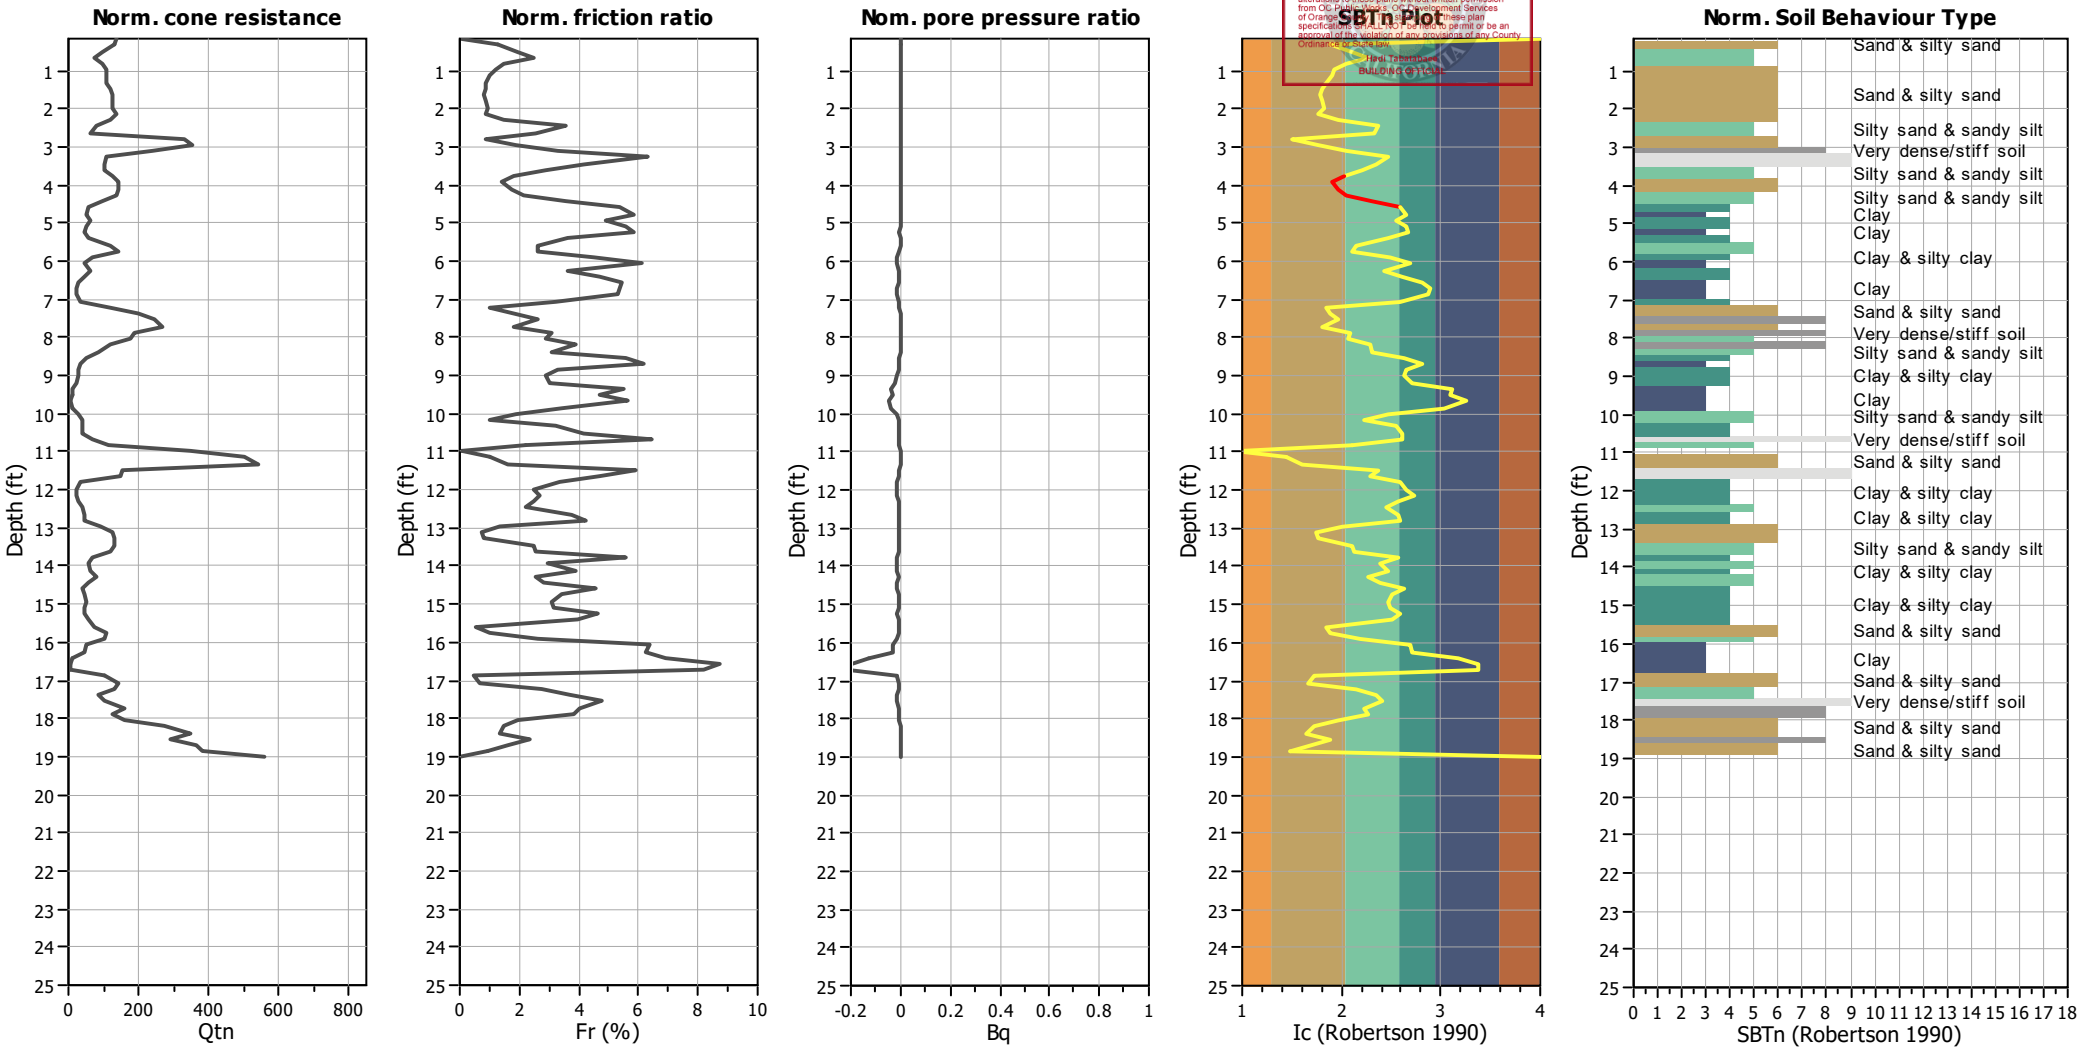

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. Approval of these plans and specifications SHALL NOT be construed to permit the an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

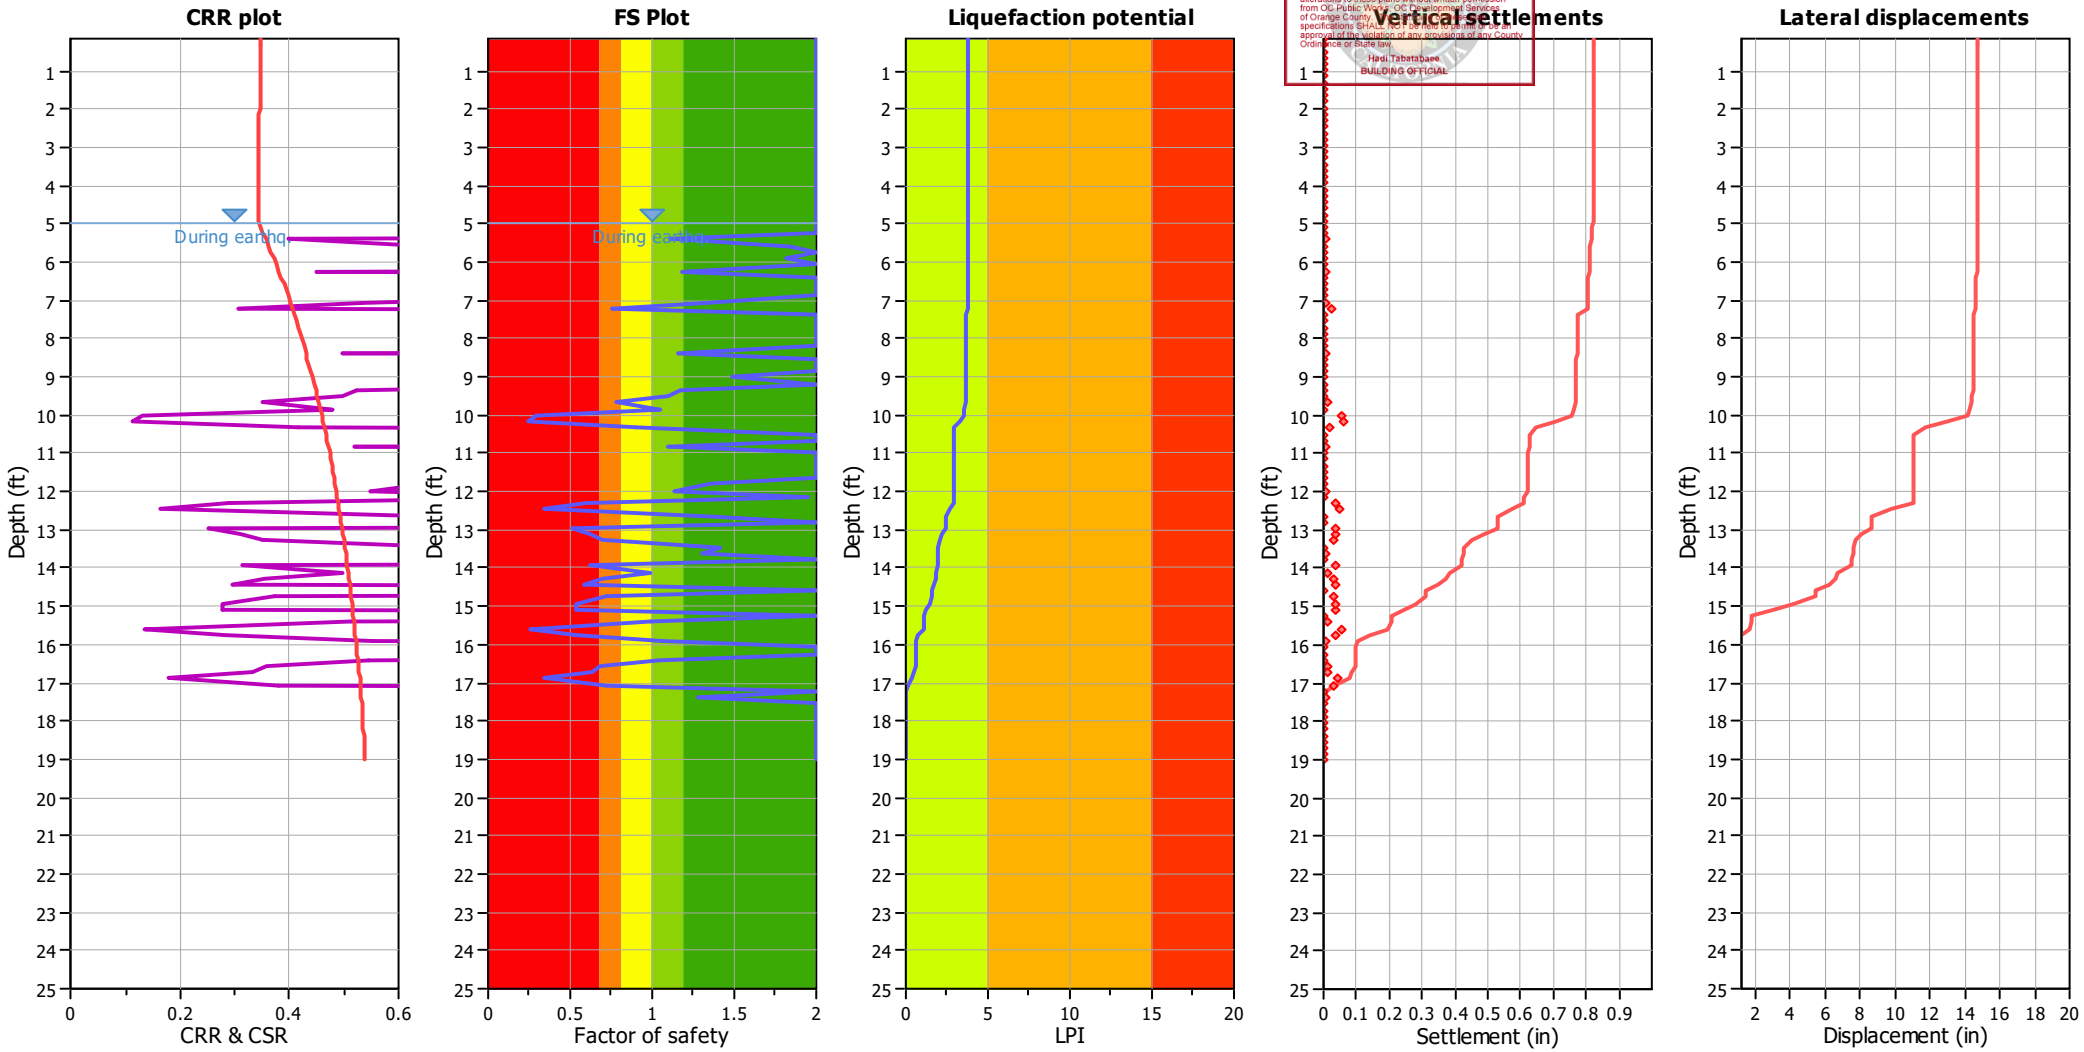

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Check for strength loss plots (Robertson (2010))

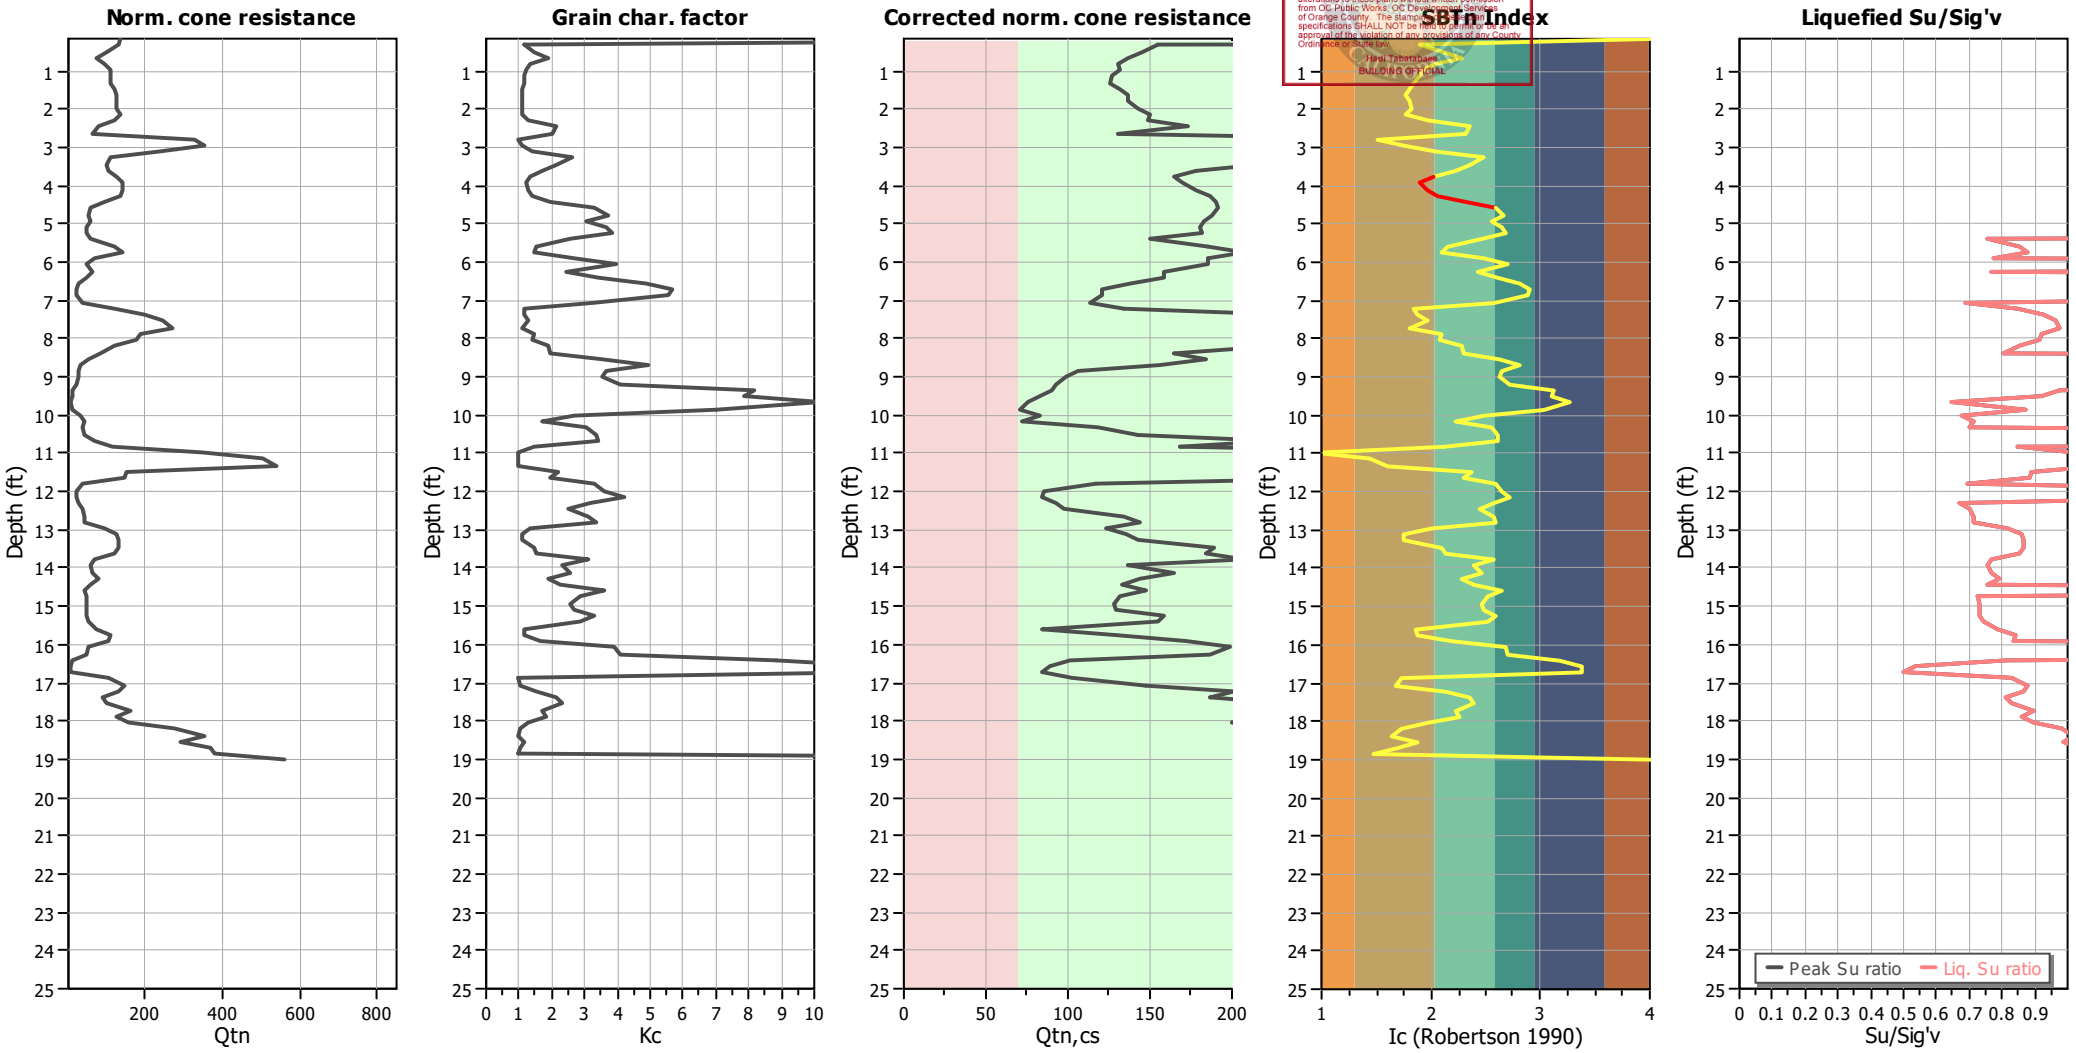

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-
County of Orange - OC Public Wo
OC Development Services
APPROVED
This set of plans and specifications must be kept on job at all times. It is unlawful to make any changes alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be a approval of the violation of any provisions of any Co Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 11-161-00 CPT-4t

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A		
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth applied:	No
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	Limit depth:	N/A
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No	MSF method:	Method based

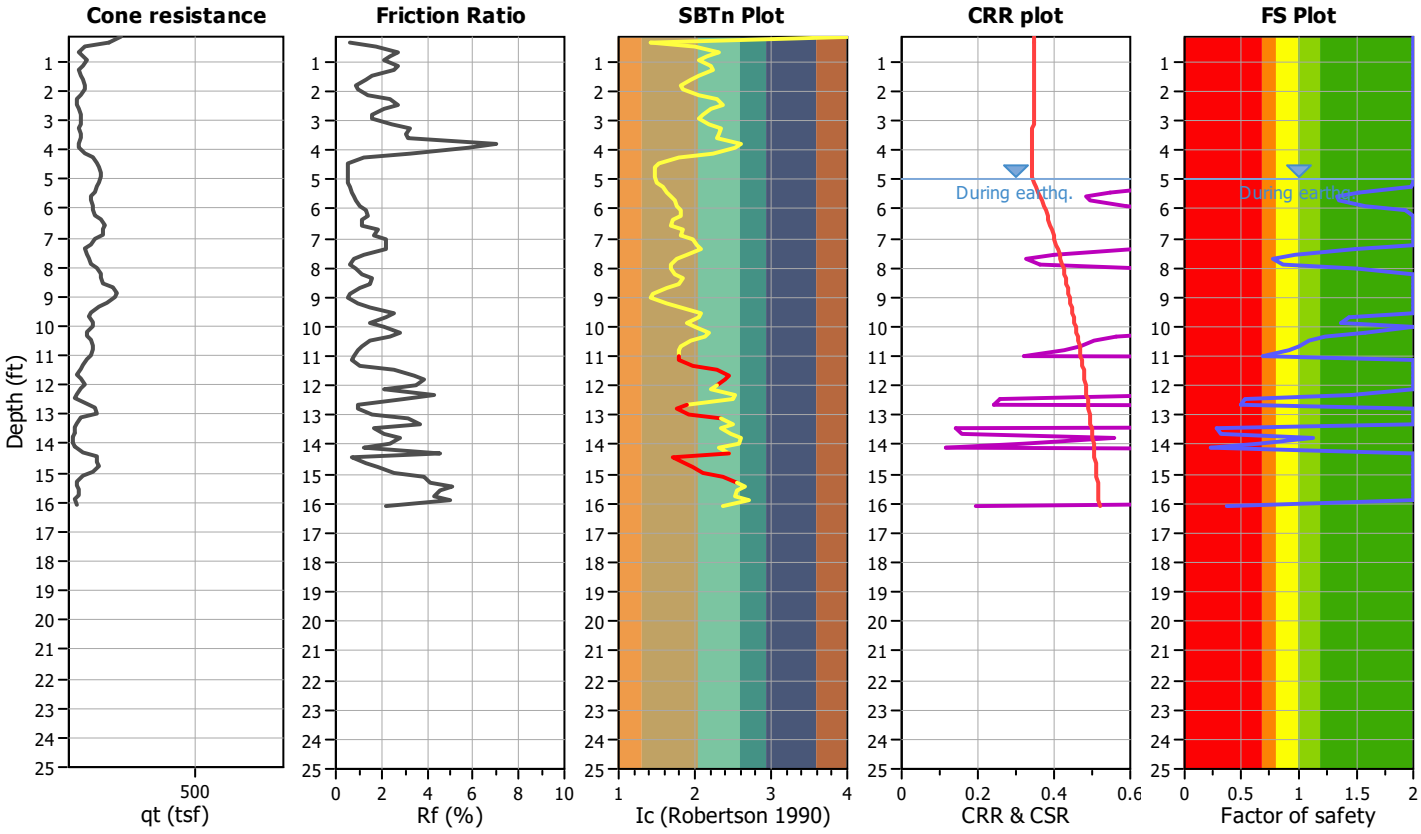

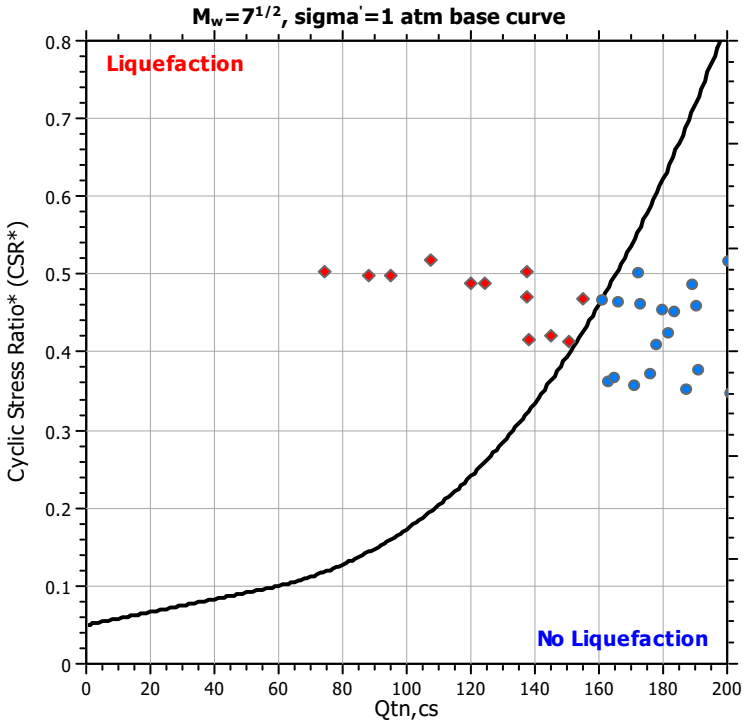

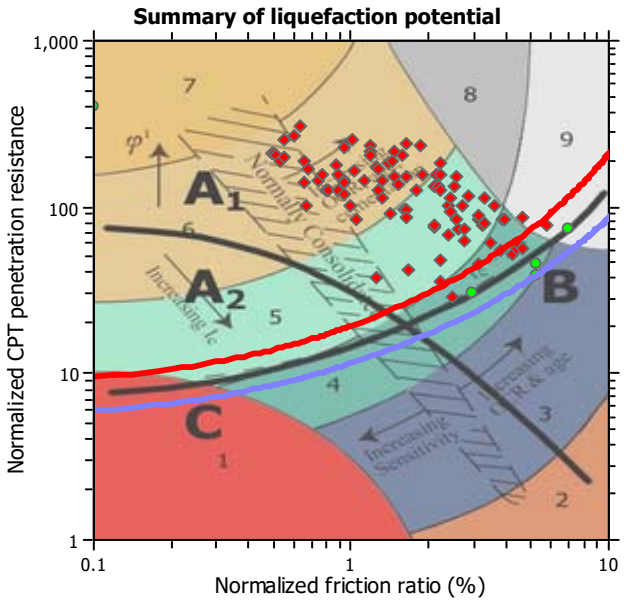

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Changes of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The issuance of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
Building Official

CPT basic interpretation plots

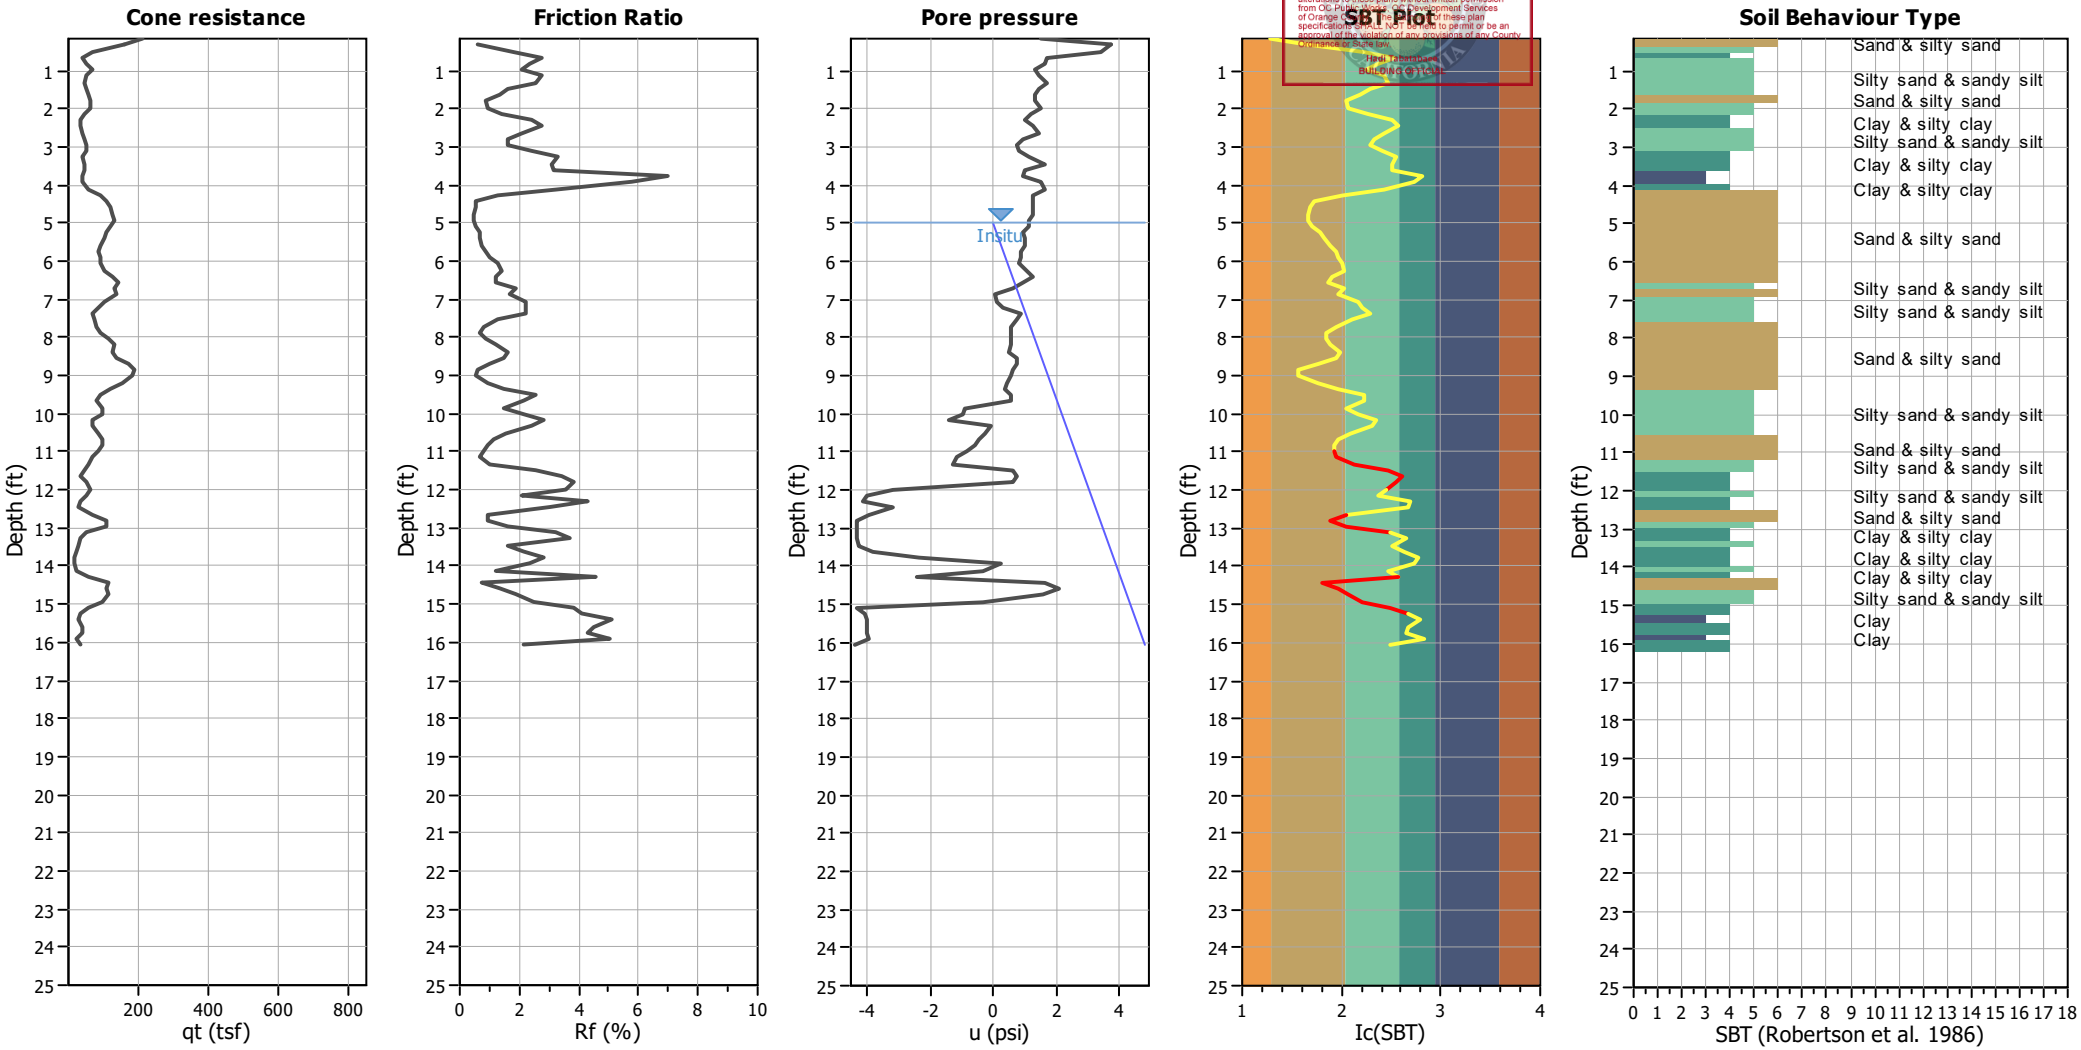

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots (normalized)

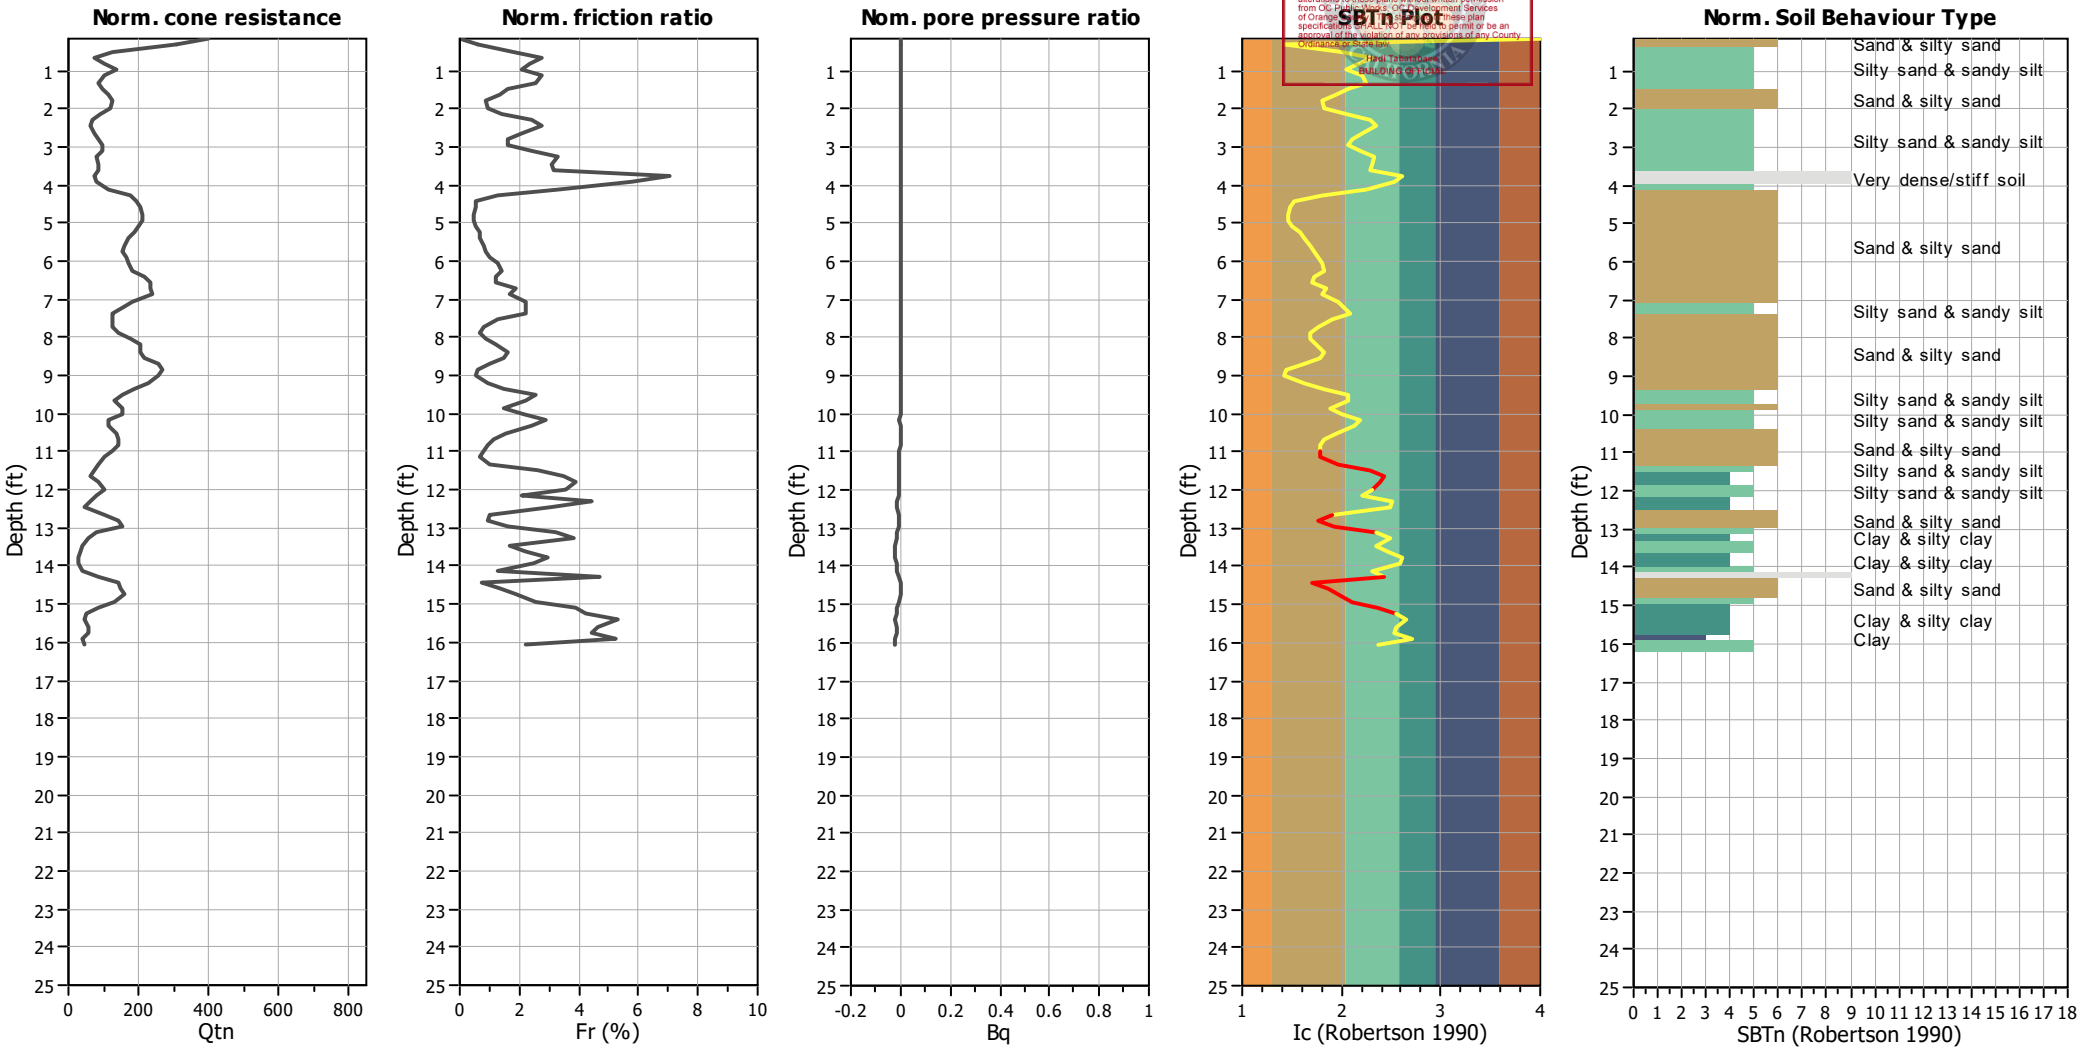

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

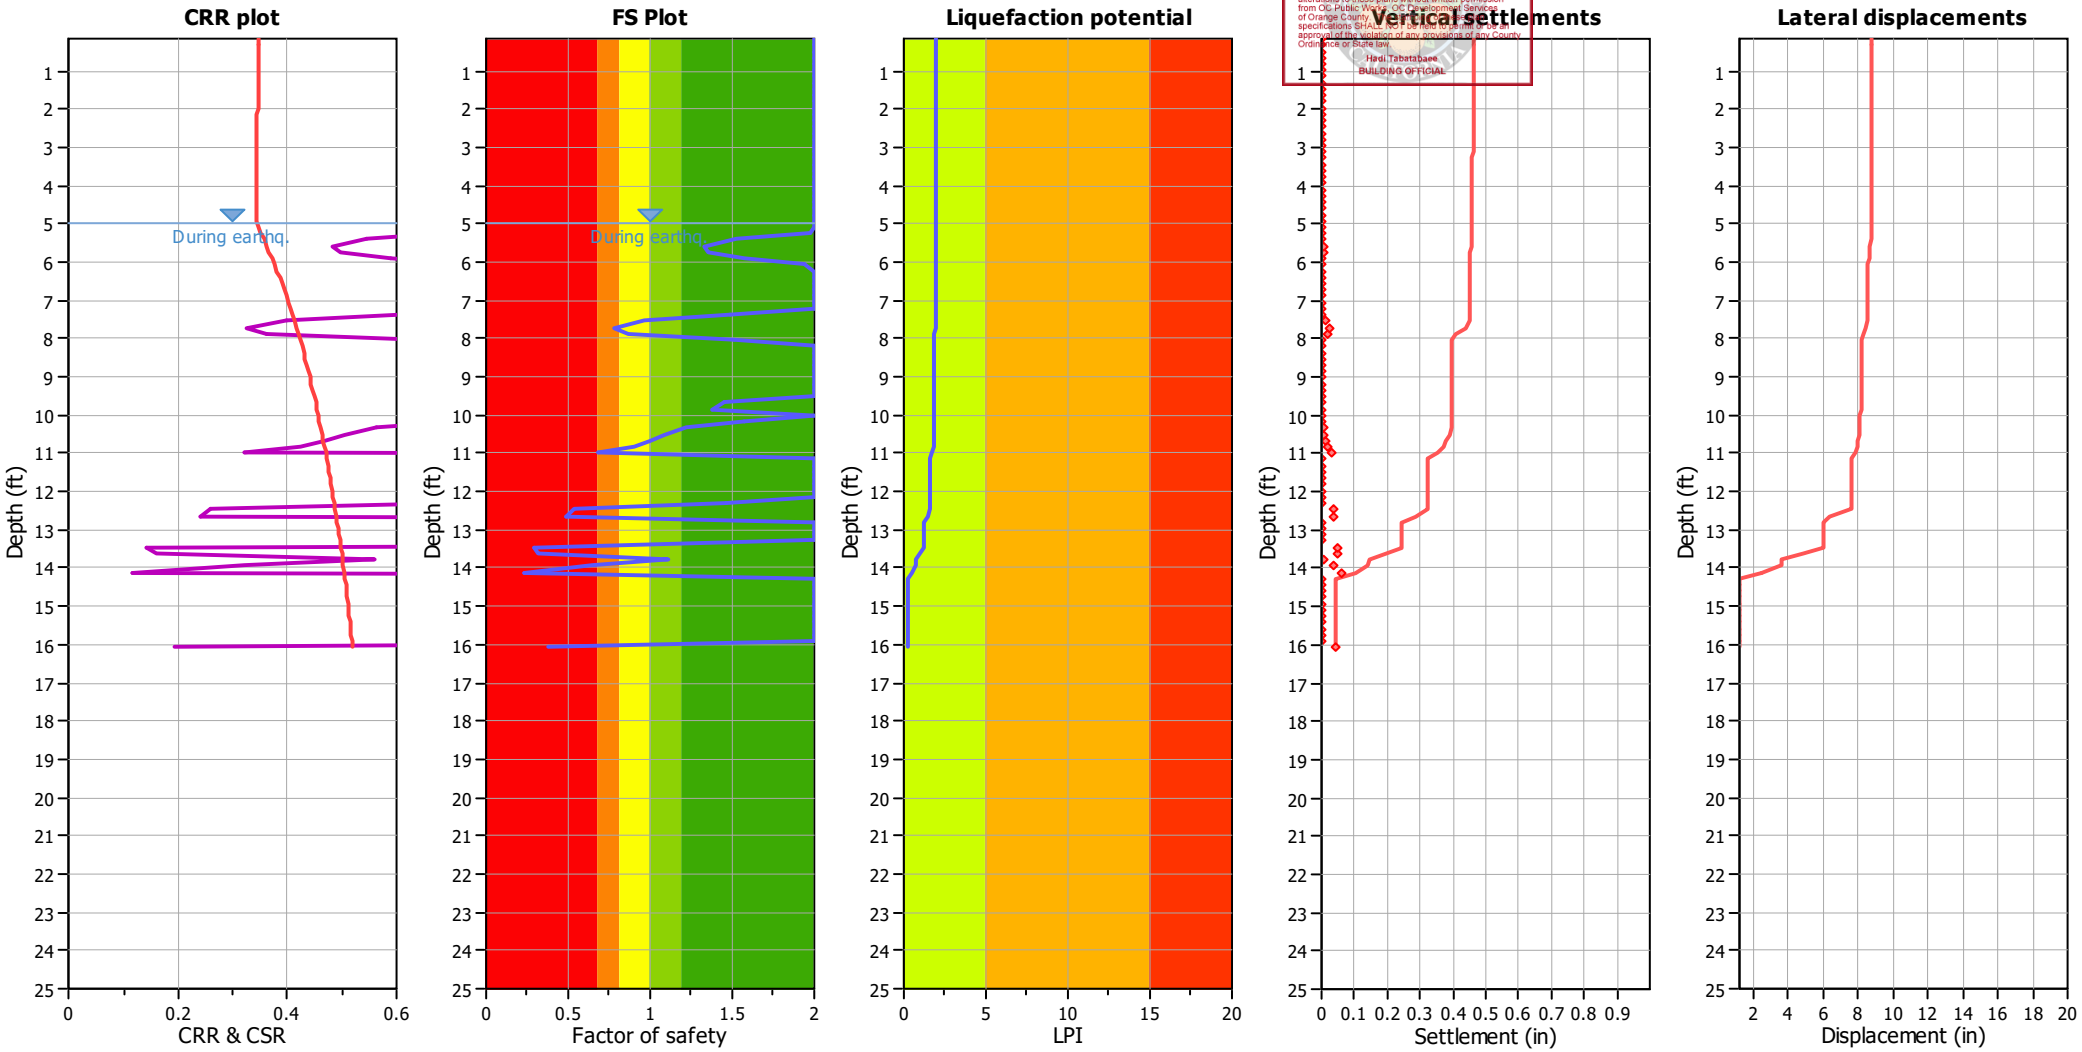

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Check for strength loss plots (Robertson (2010))

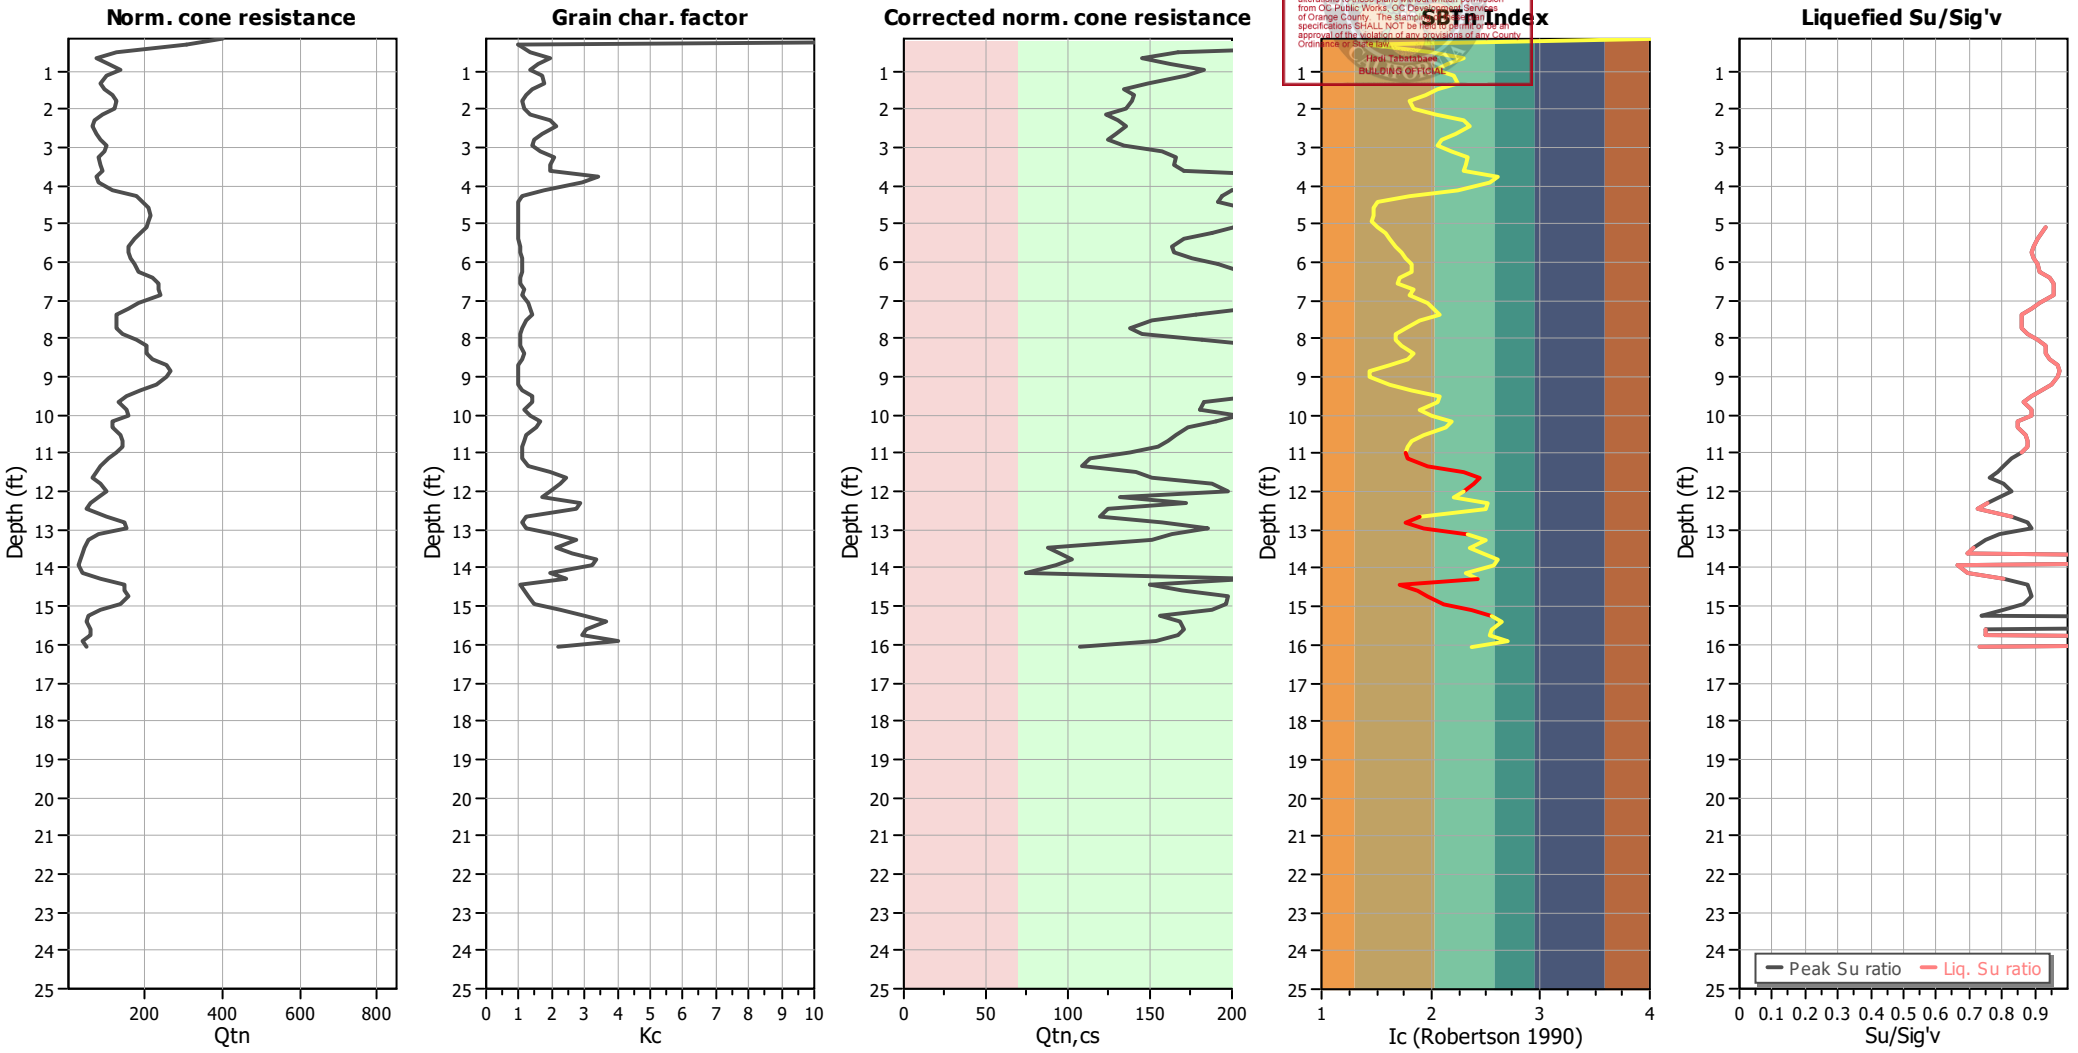

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-
County of Orange - OC Public Wo
OC Development Services
APPROVED
This set of plans and specifications must be kept on job at all times. It is unlawful to make any changes alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be a approval of the violation of any provisions of any Co Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 11-161-00 CPT-5t

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A	Limit depth applied:	No
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth:	N/A
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	MSF method:	Method based
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No		

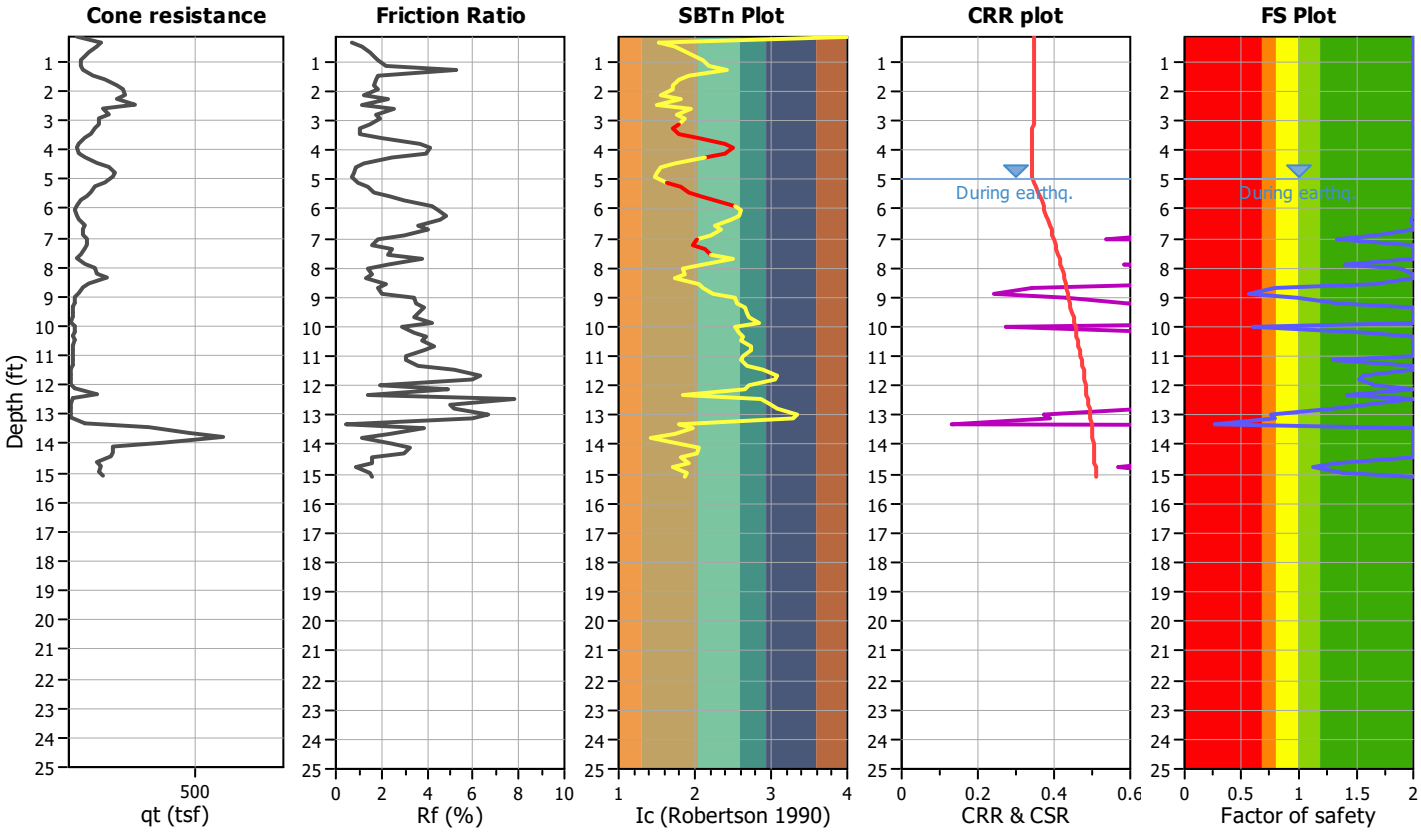

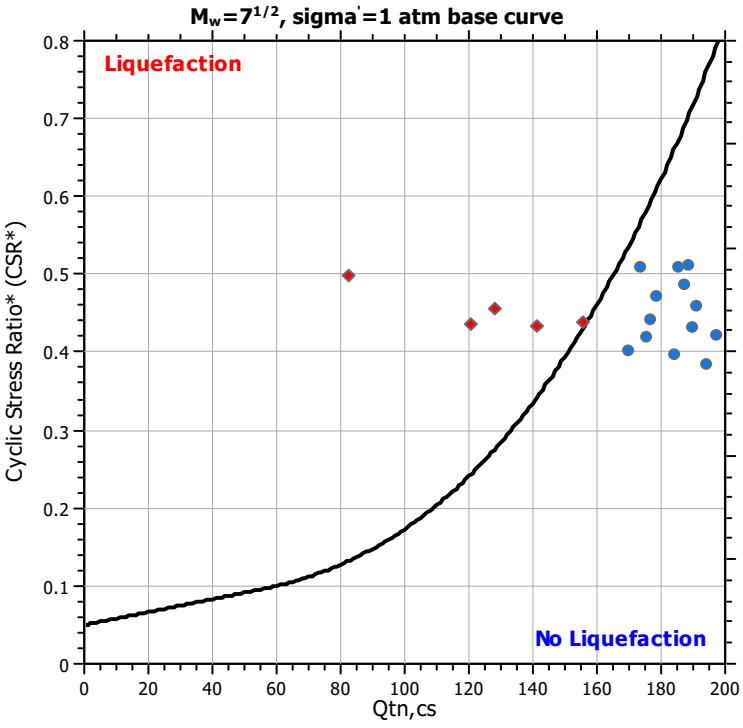

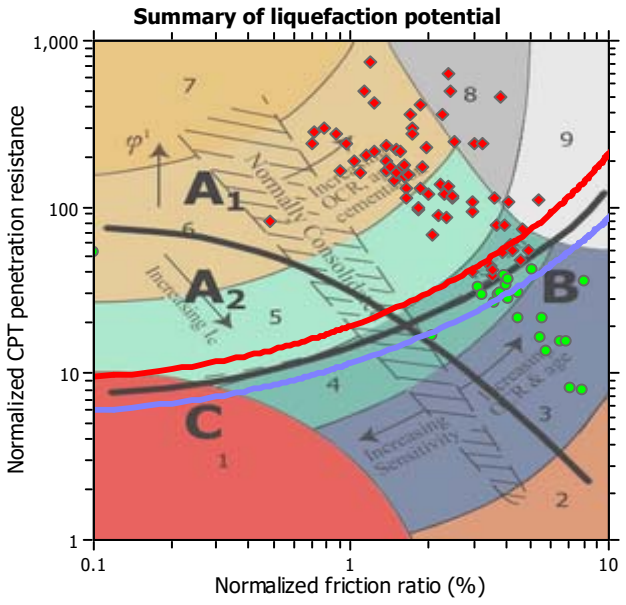

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Changes of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. Issuance of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots

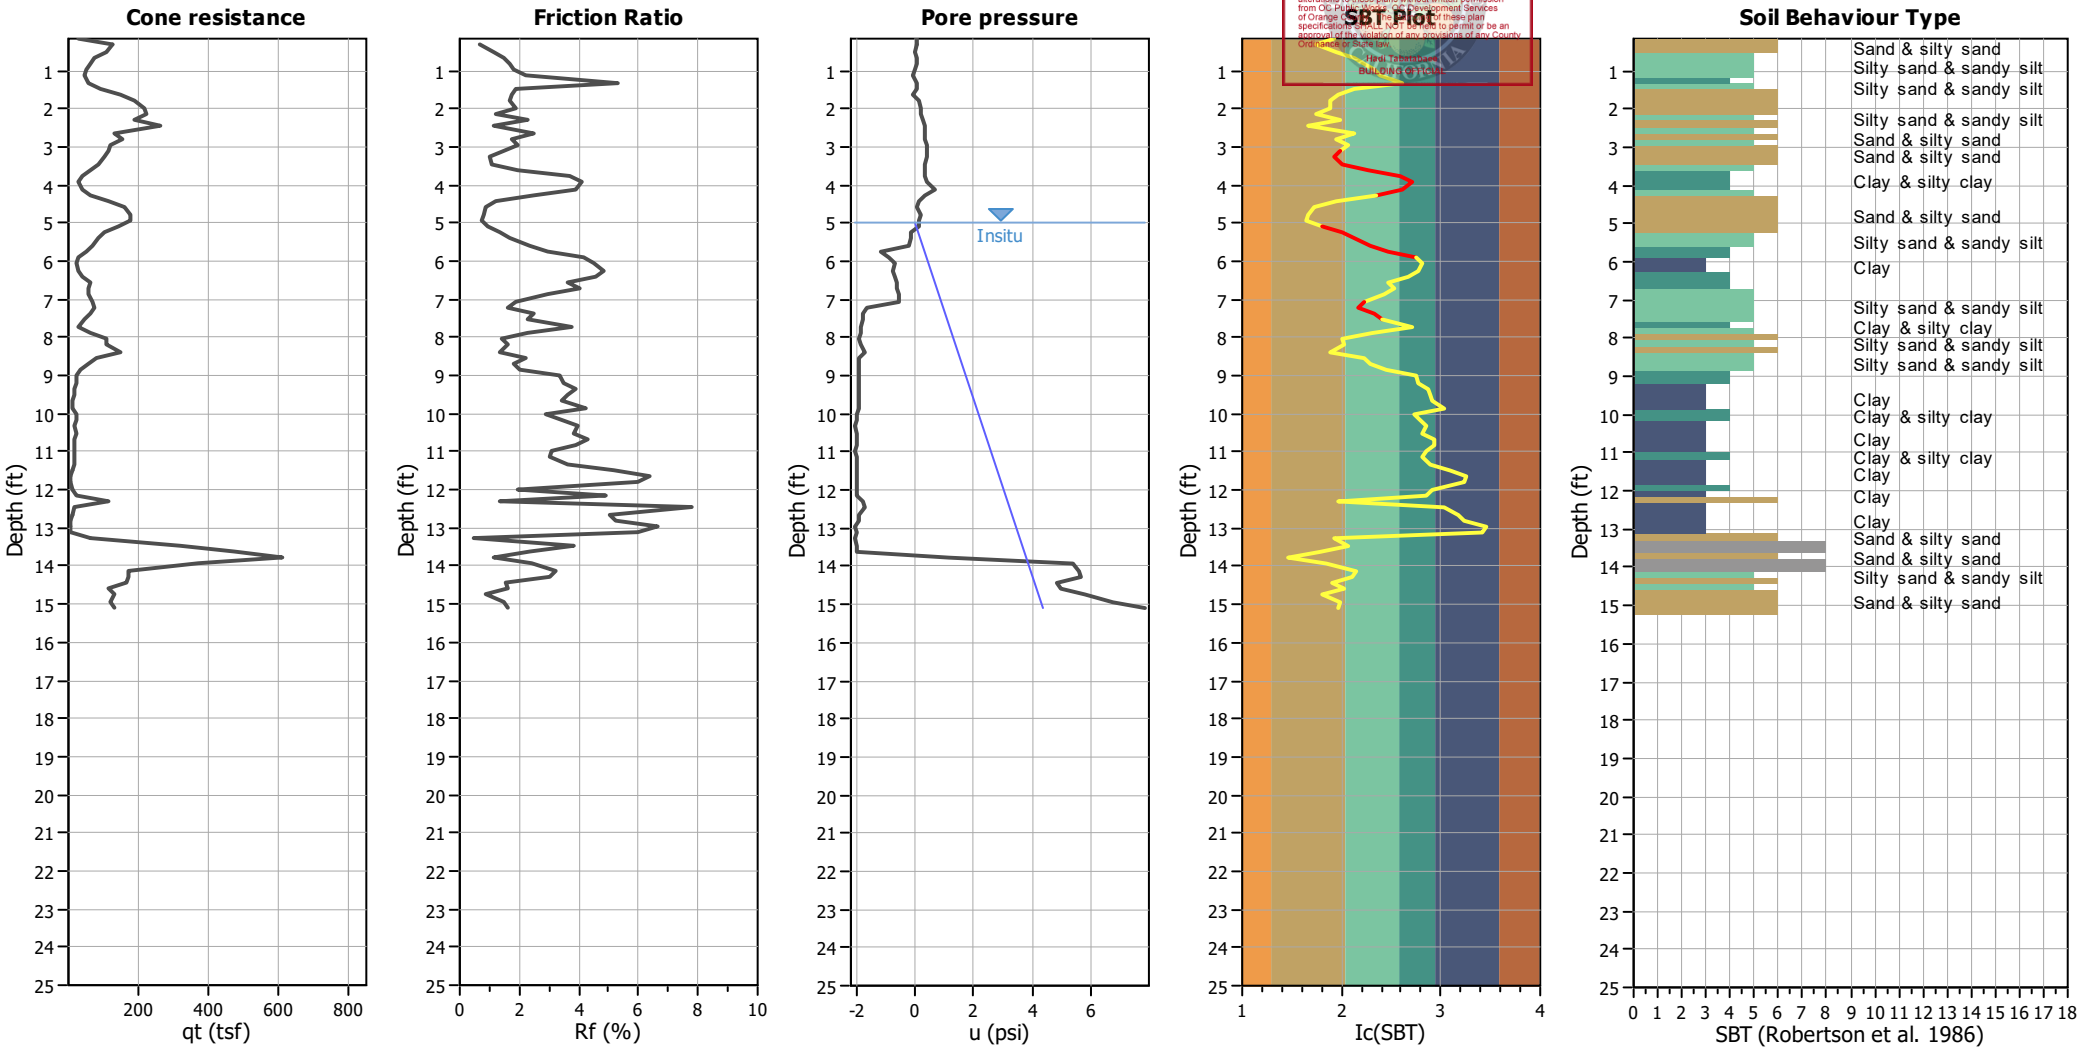

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots (normalized)

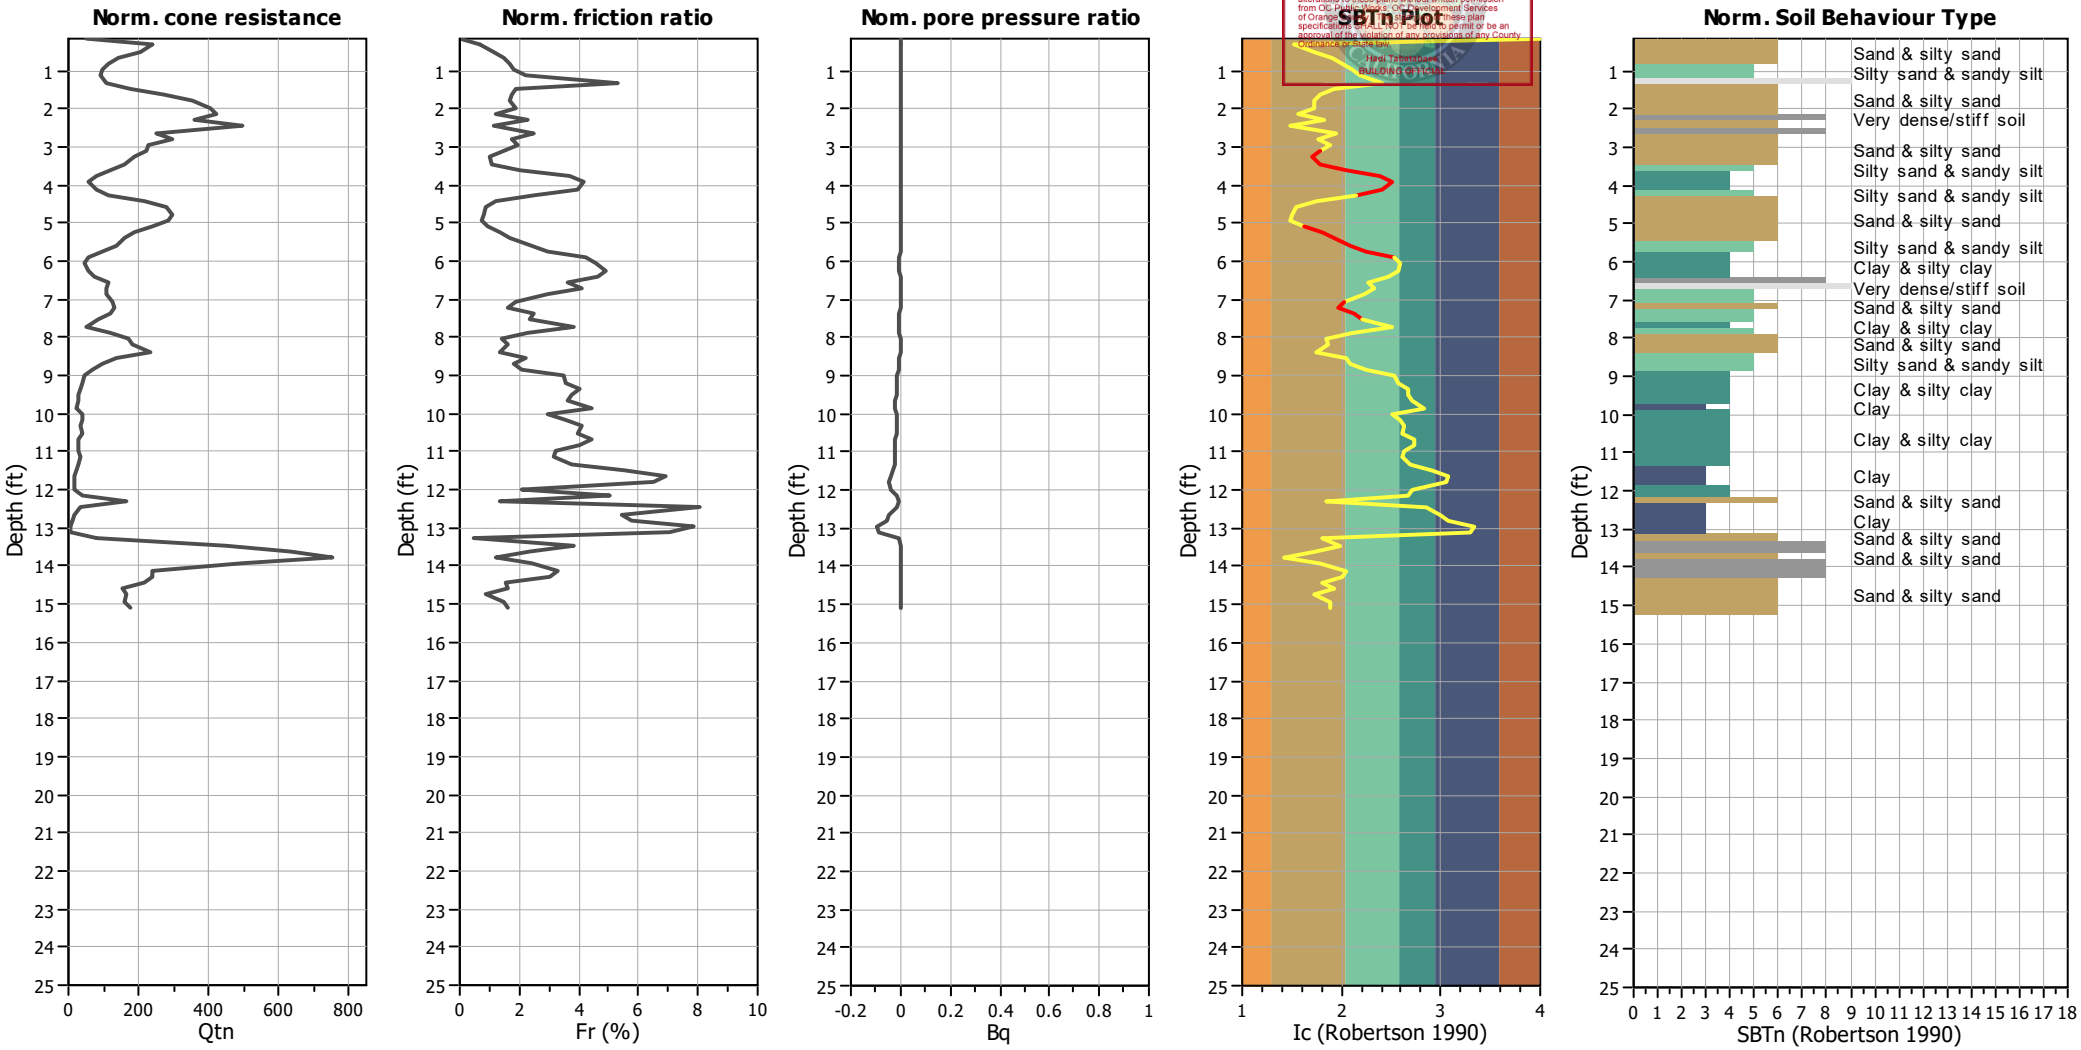

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

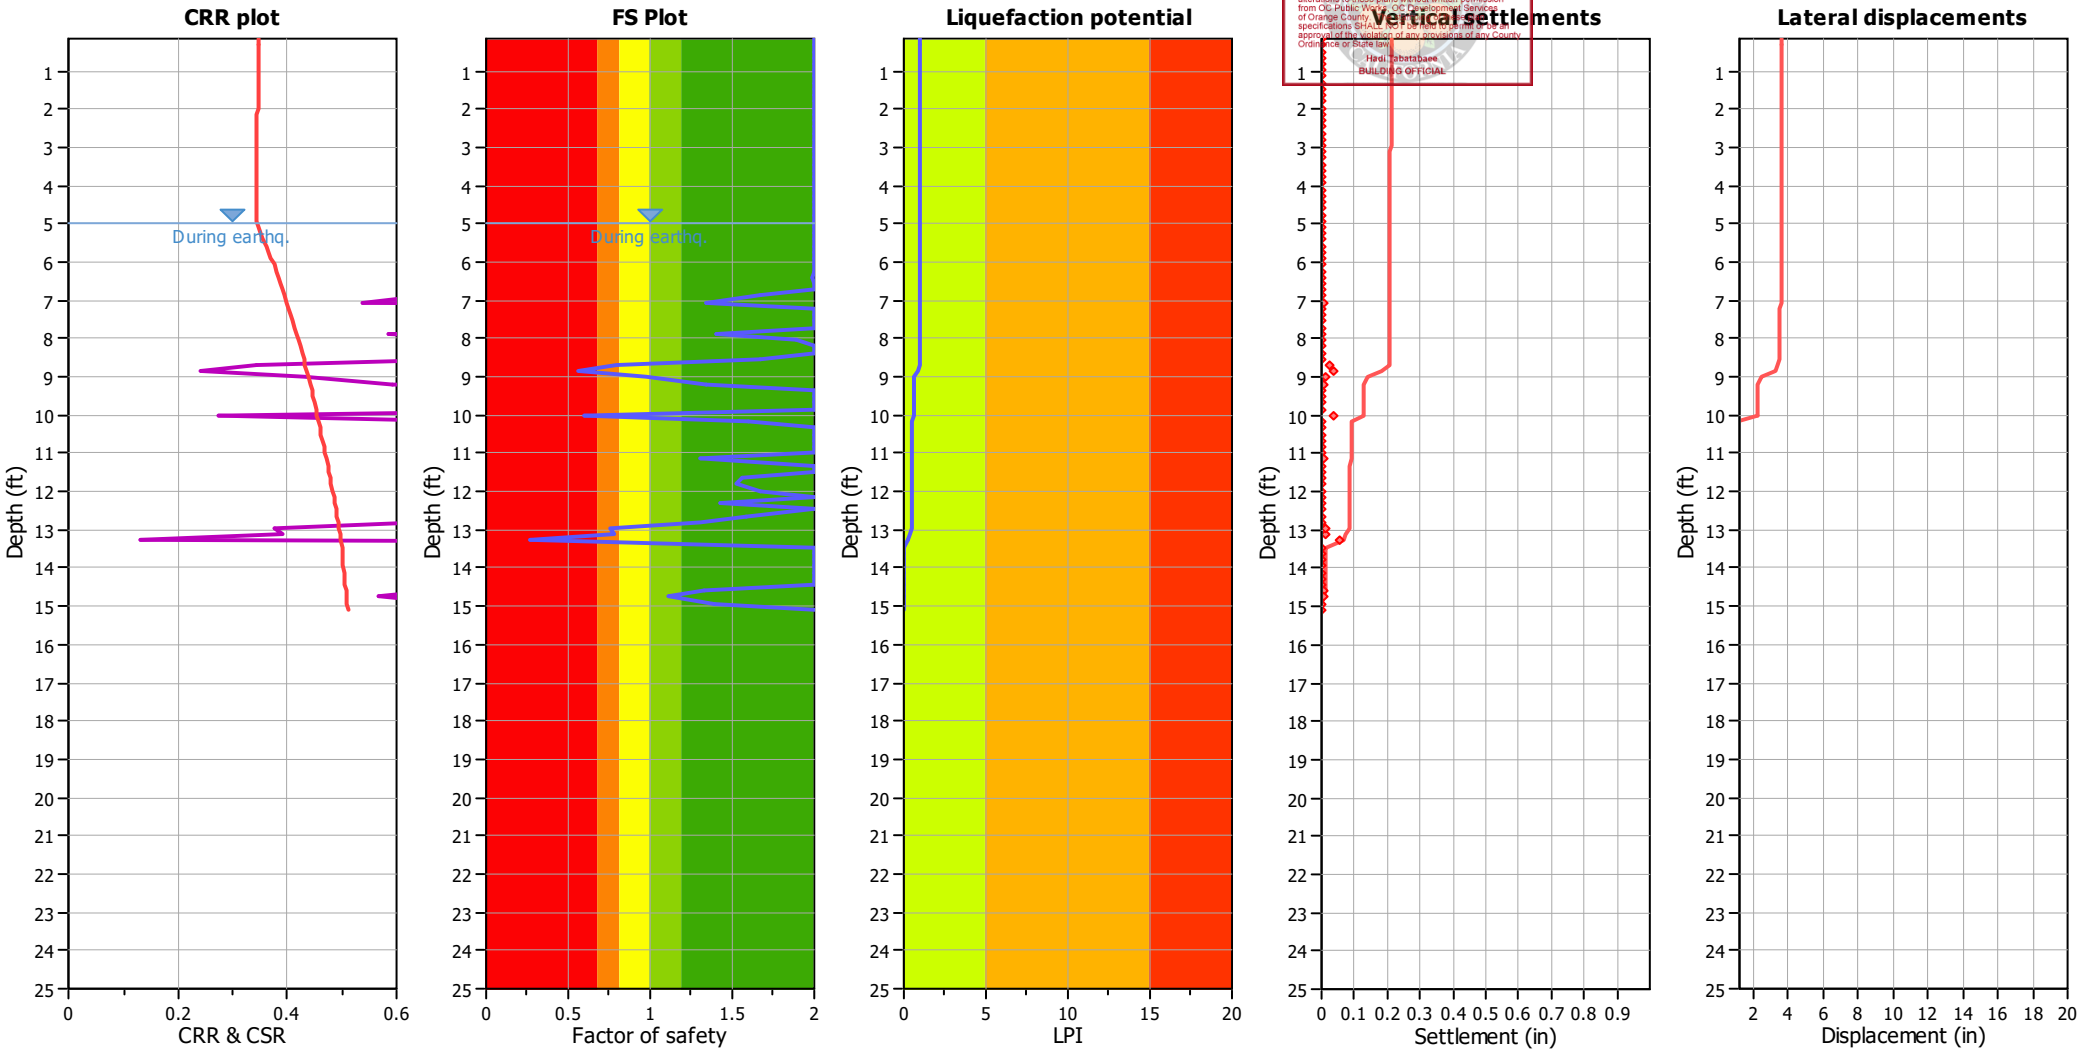

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Check for strength loss plots (Robertson (2010))

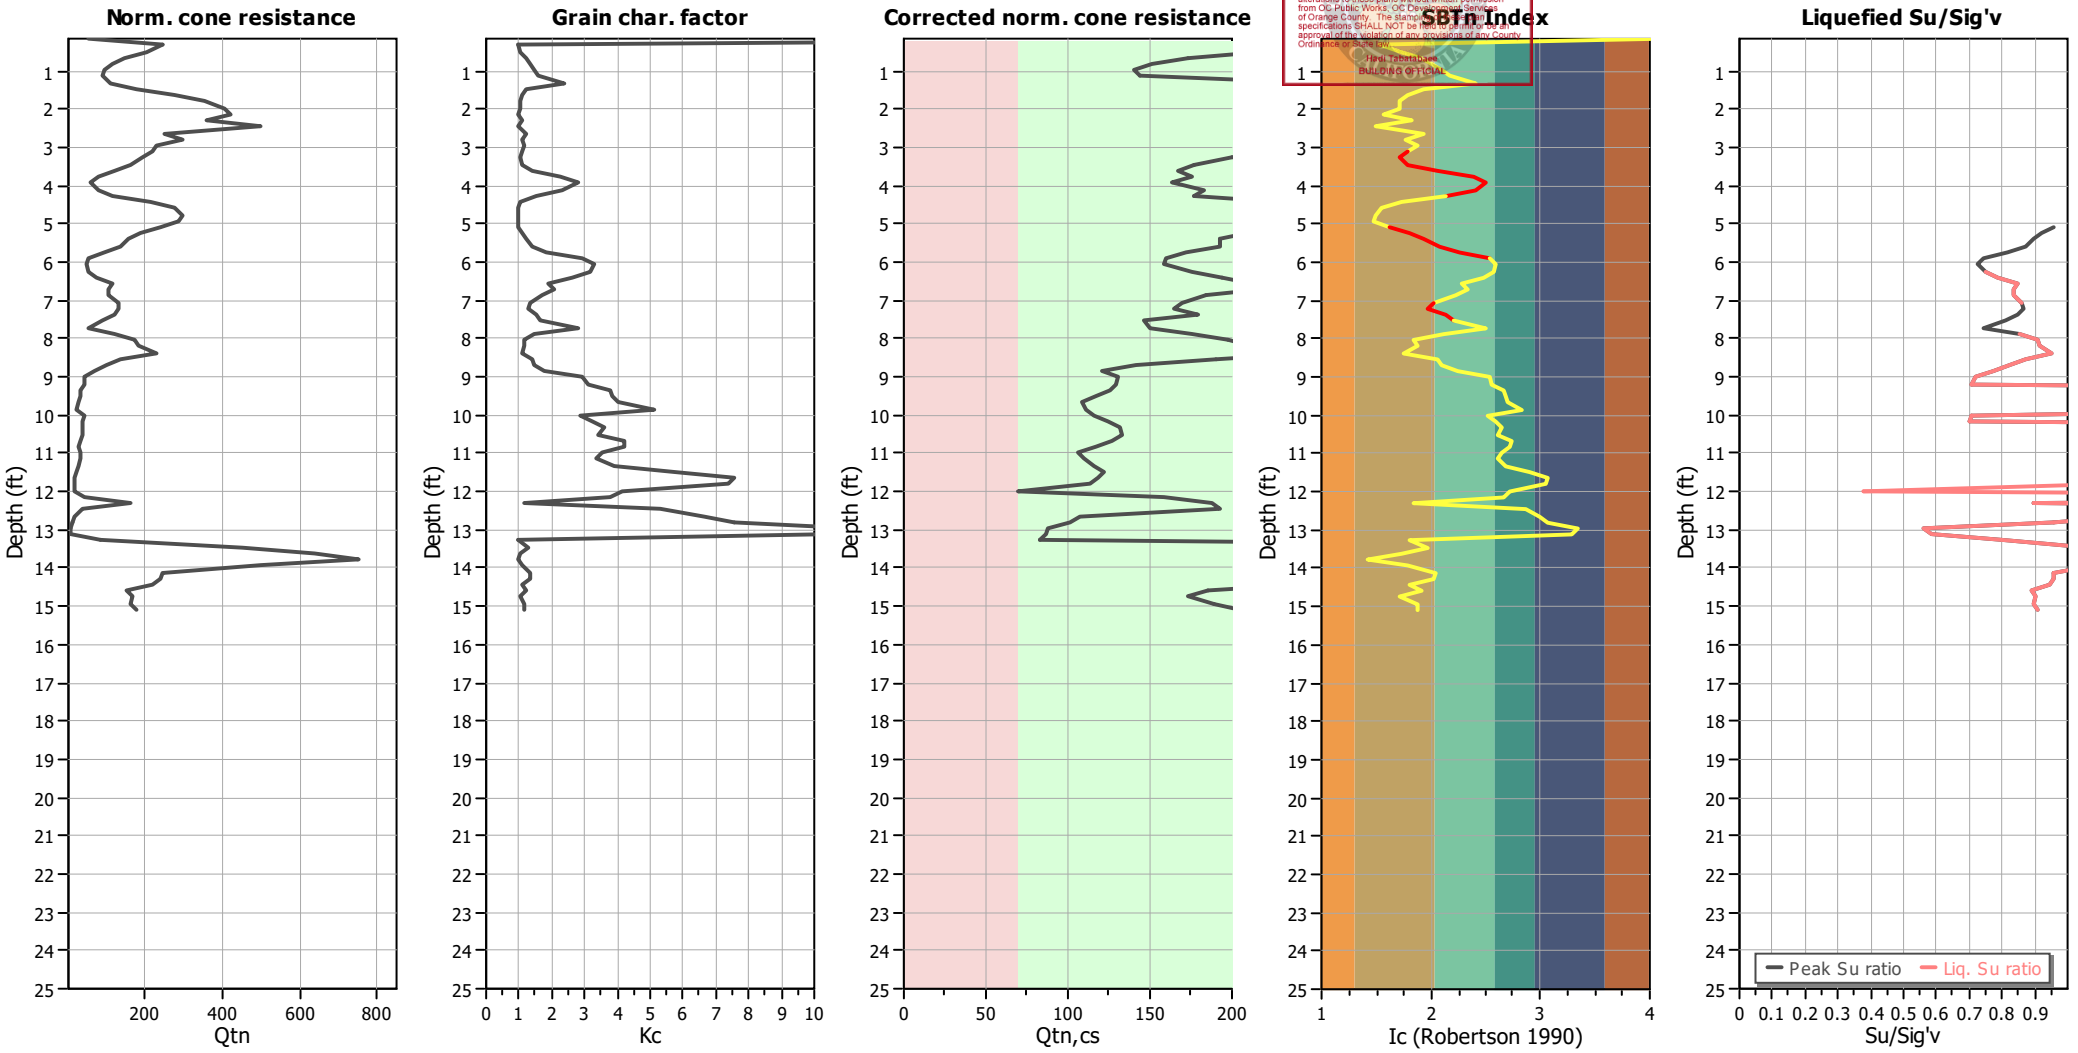

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0
County of Orange - OC Public Wo
OC Development Services
APPROVED
This set of plans and specifications must be kept on job at all times. It is unlawful to make any changes alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be a approval of the violation of any provisions of any Co Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 11-161-00 CPT-6t

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A		
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth applied:	No
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	Limit depth:	N/A
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No	MSF method:	Method based

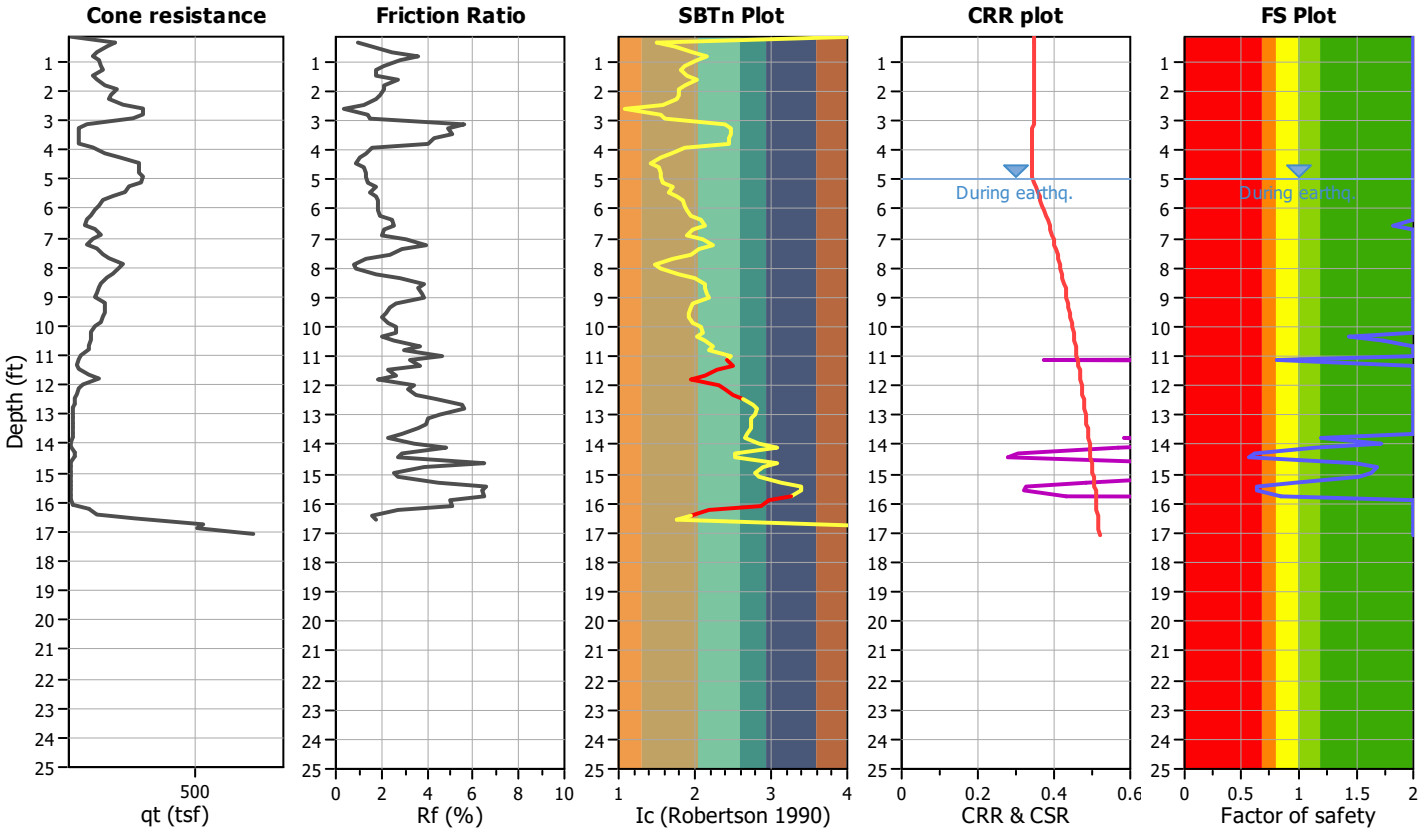

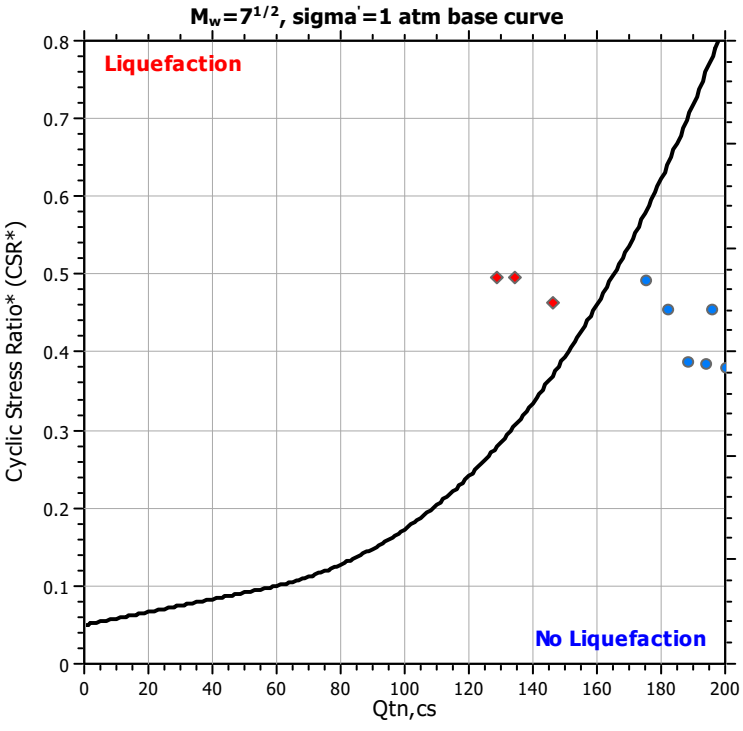

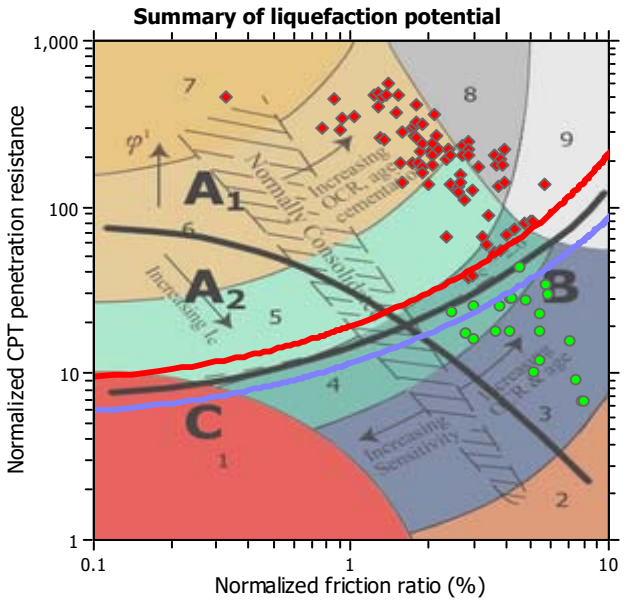

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Copies of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The approval of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots

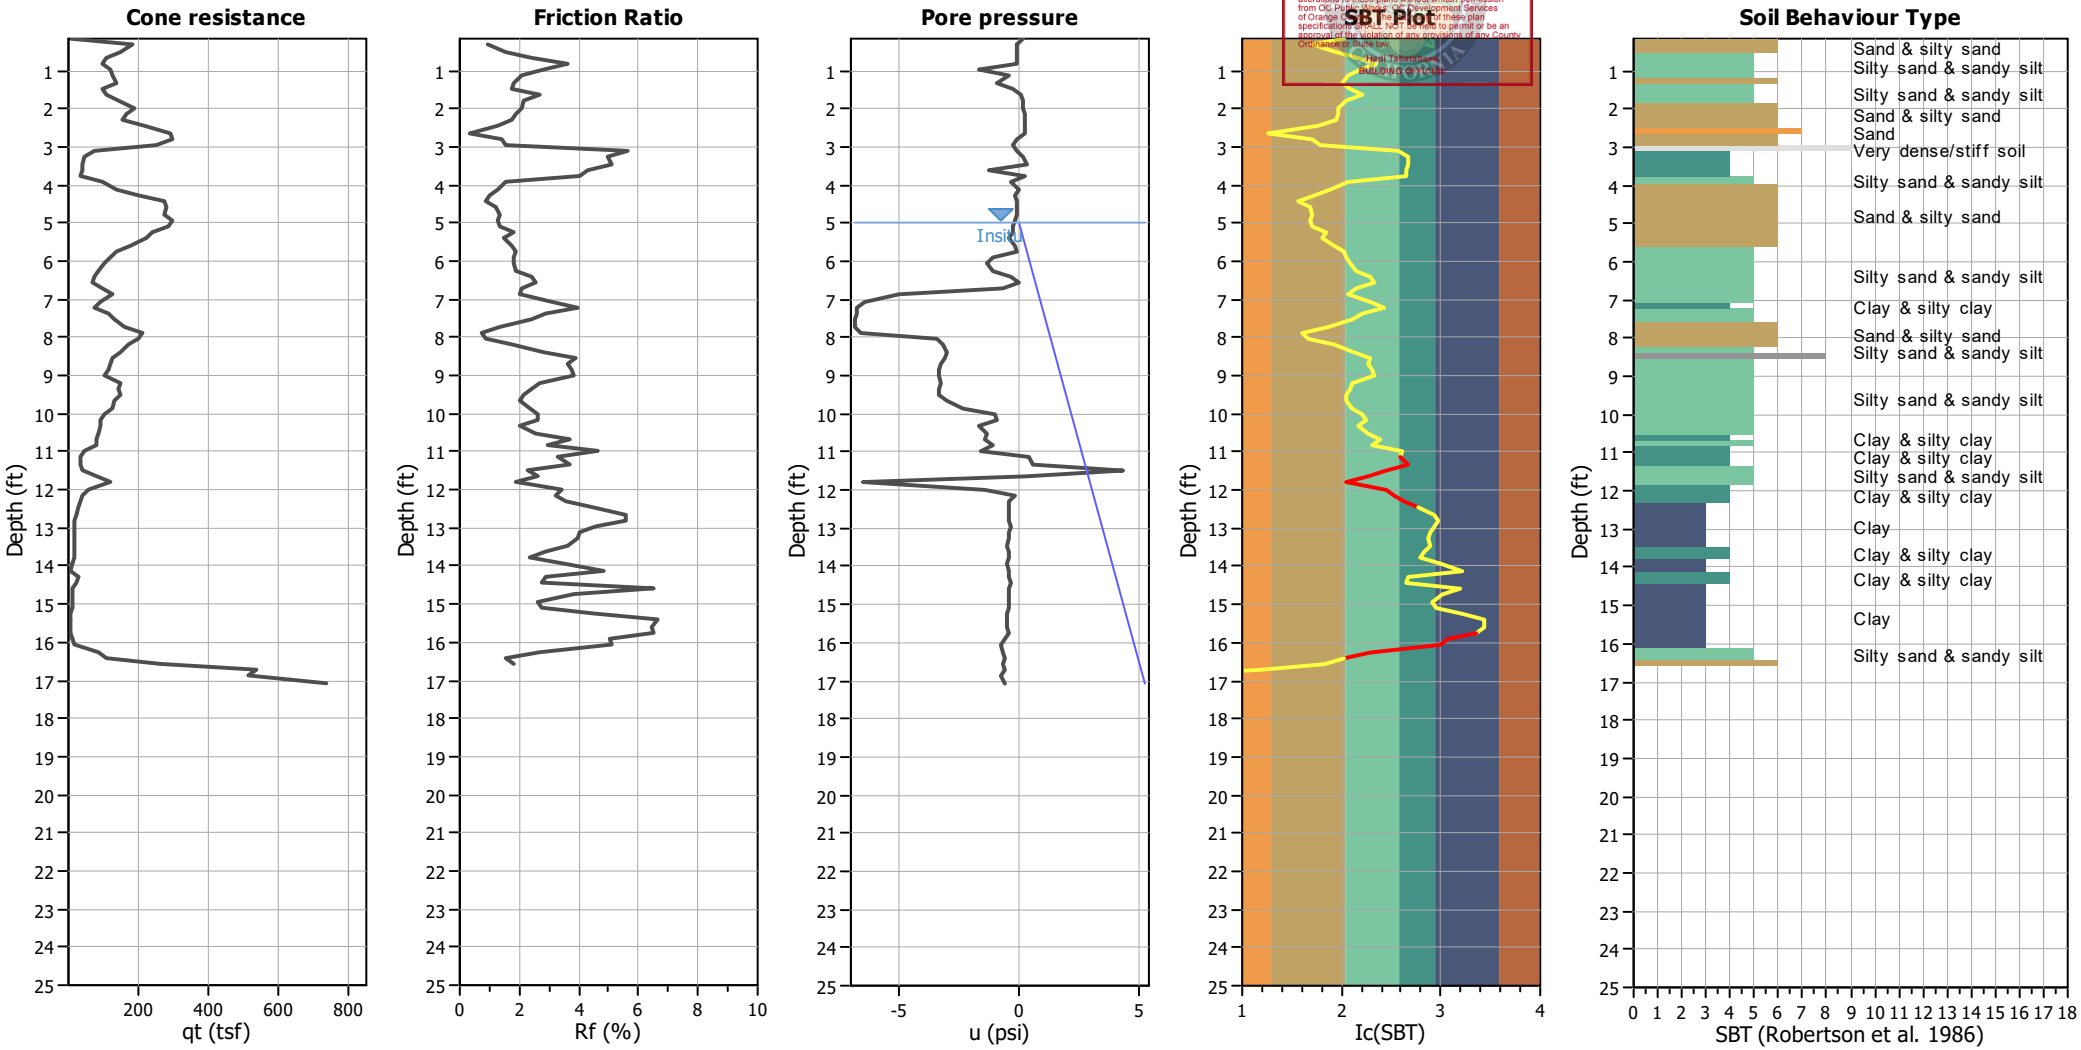

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots (normalized)

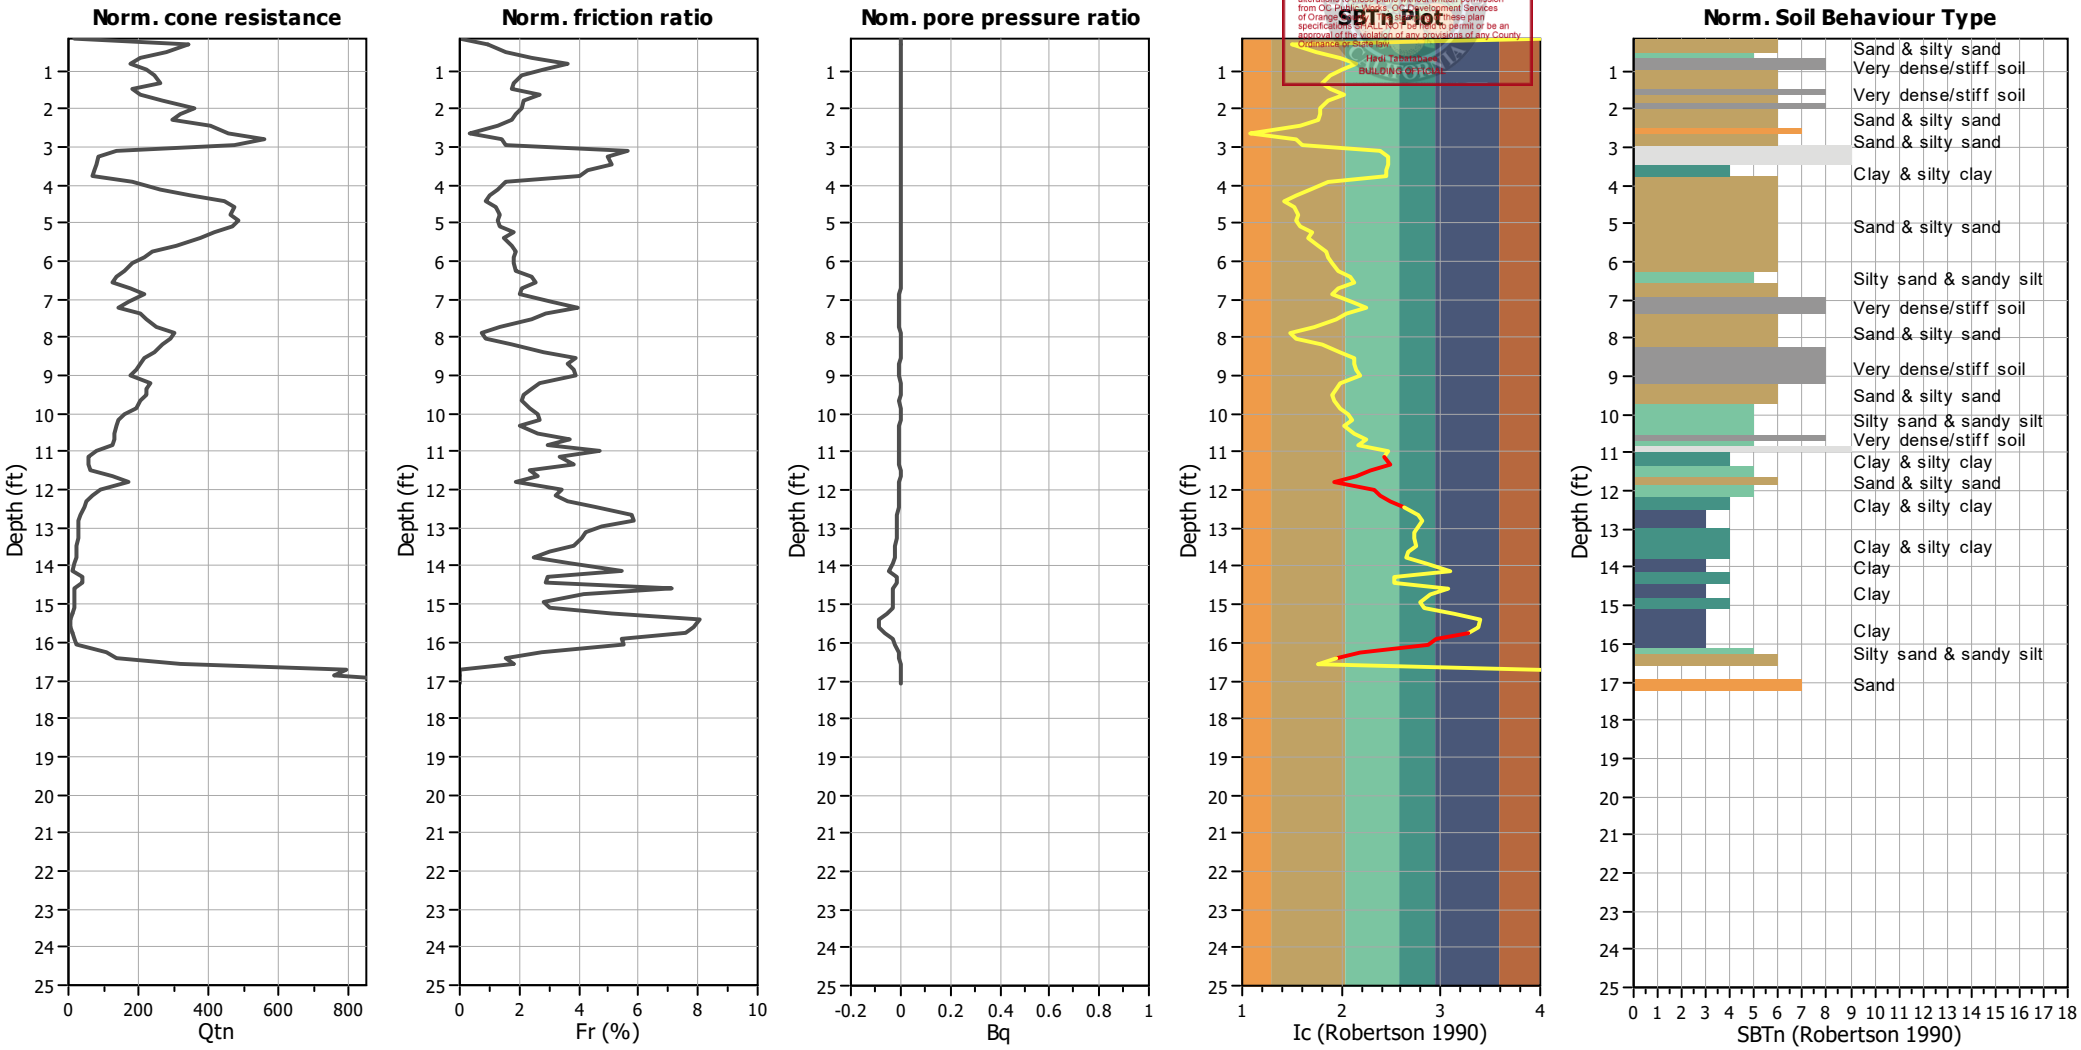

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

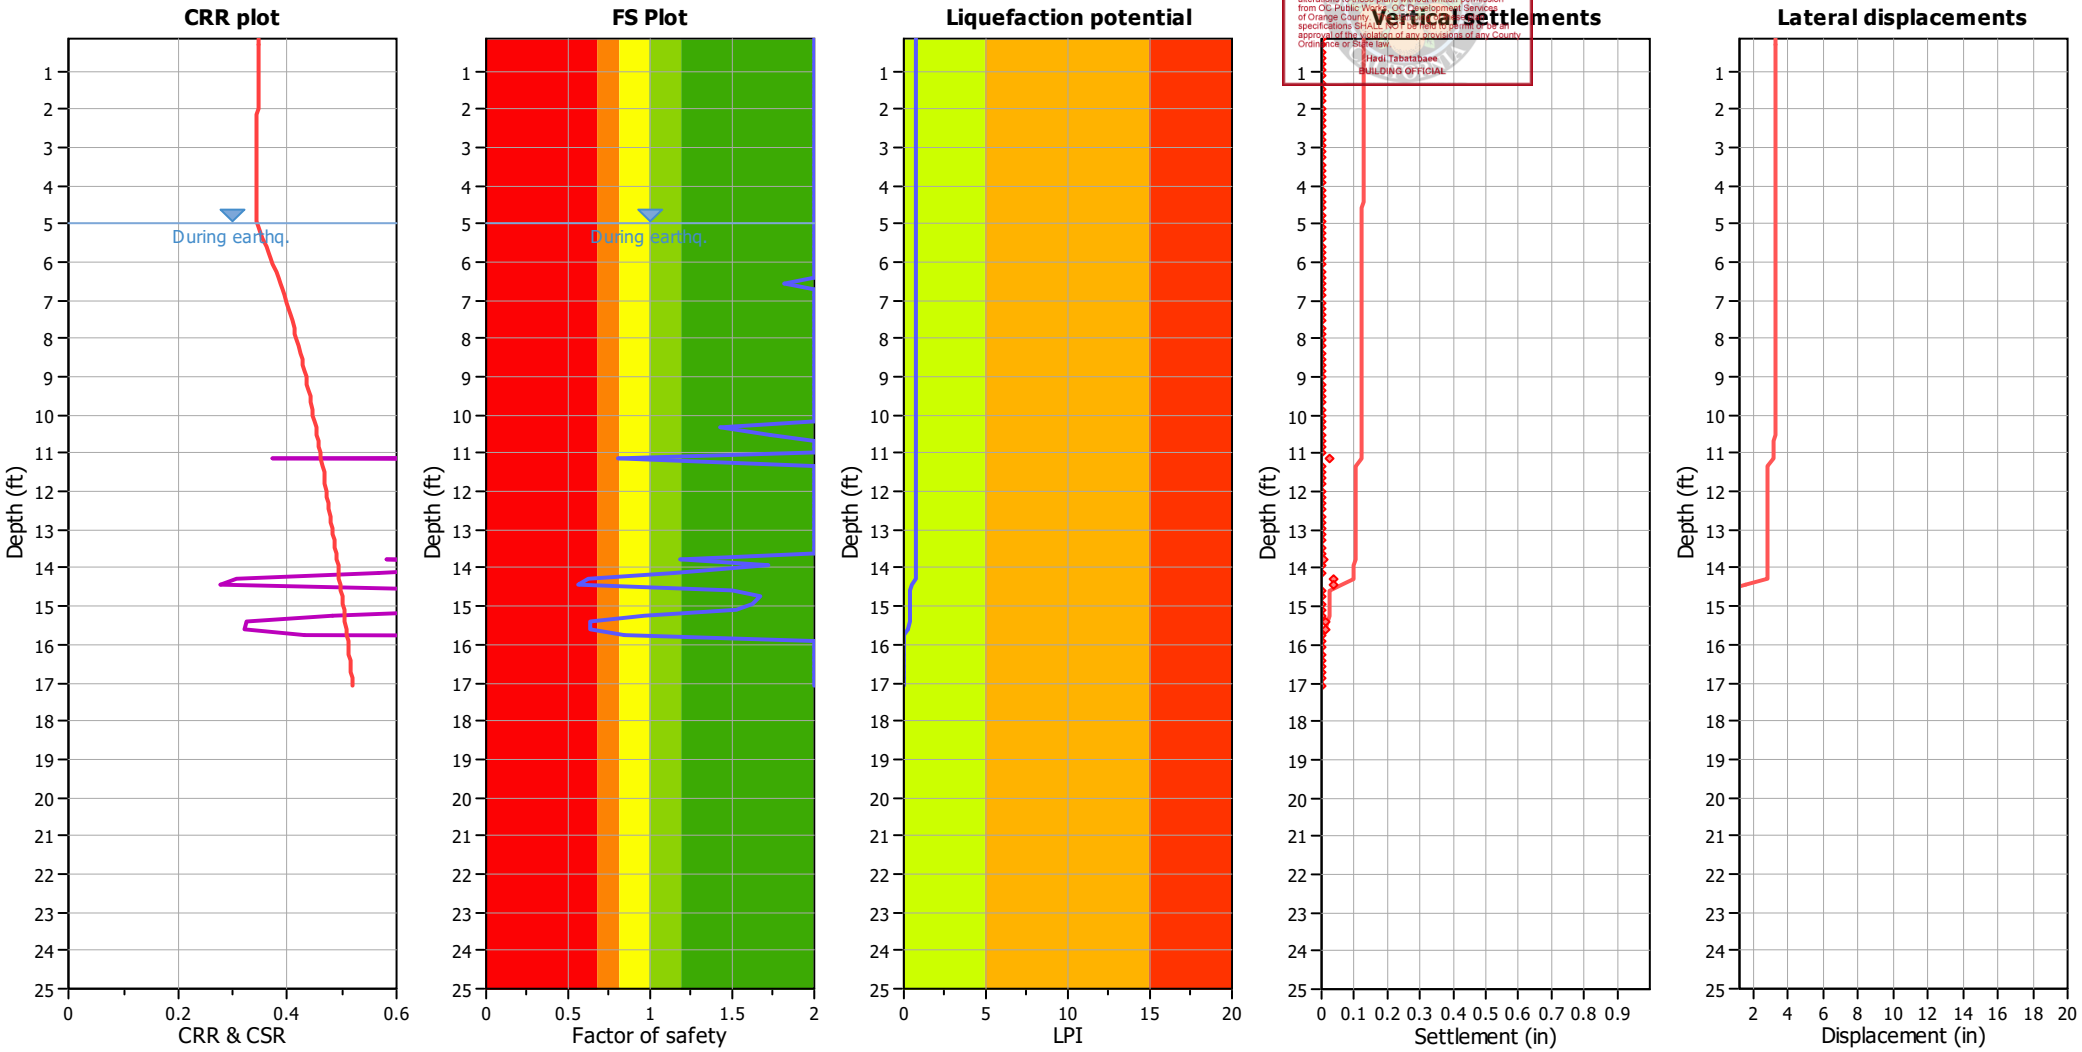

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Check for strength loss plots (Robertson (2010))

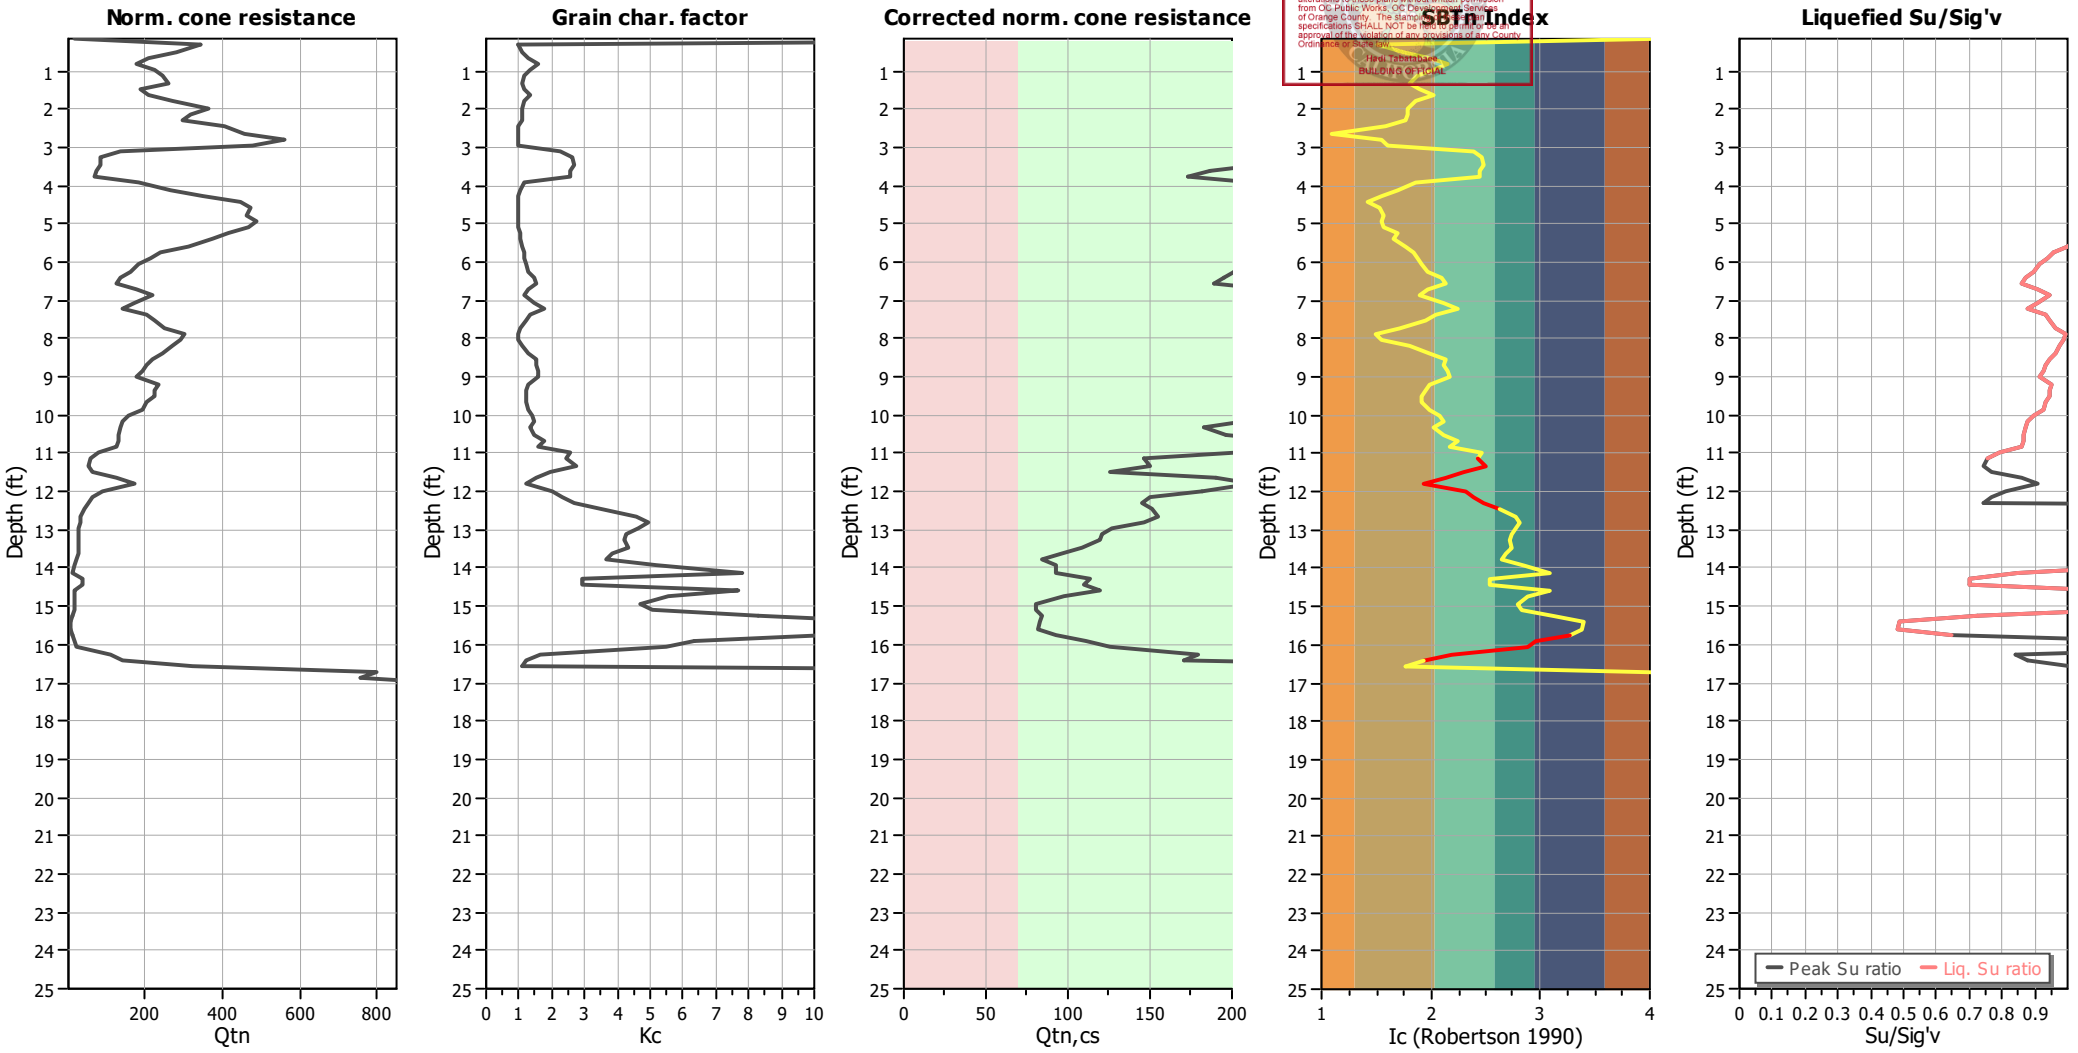

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0
County of Orange - OC Public Wo
OC Development Services
APPROVED
This set of plans and specifications must be kept on job at all times. It is unlawful to make any changes alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be a approval of the violation of any provisions of any Co Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 17-206-02 CPT-6A

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A		
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth applied:	No
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	Limit depth:	N/A
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No	MSF method:	Method based

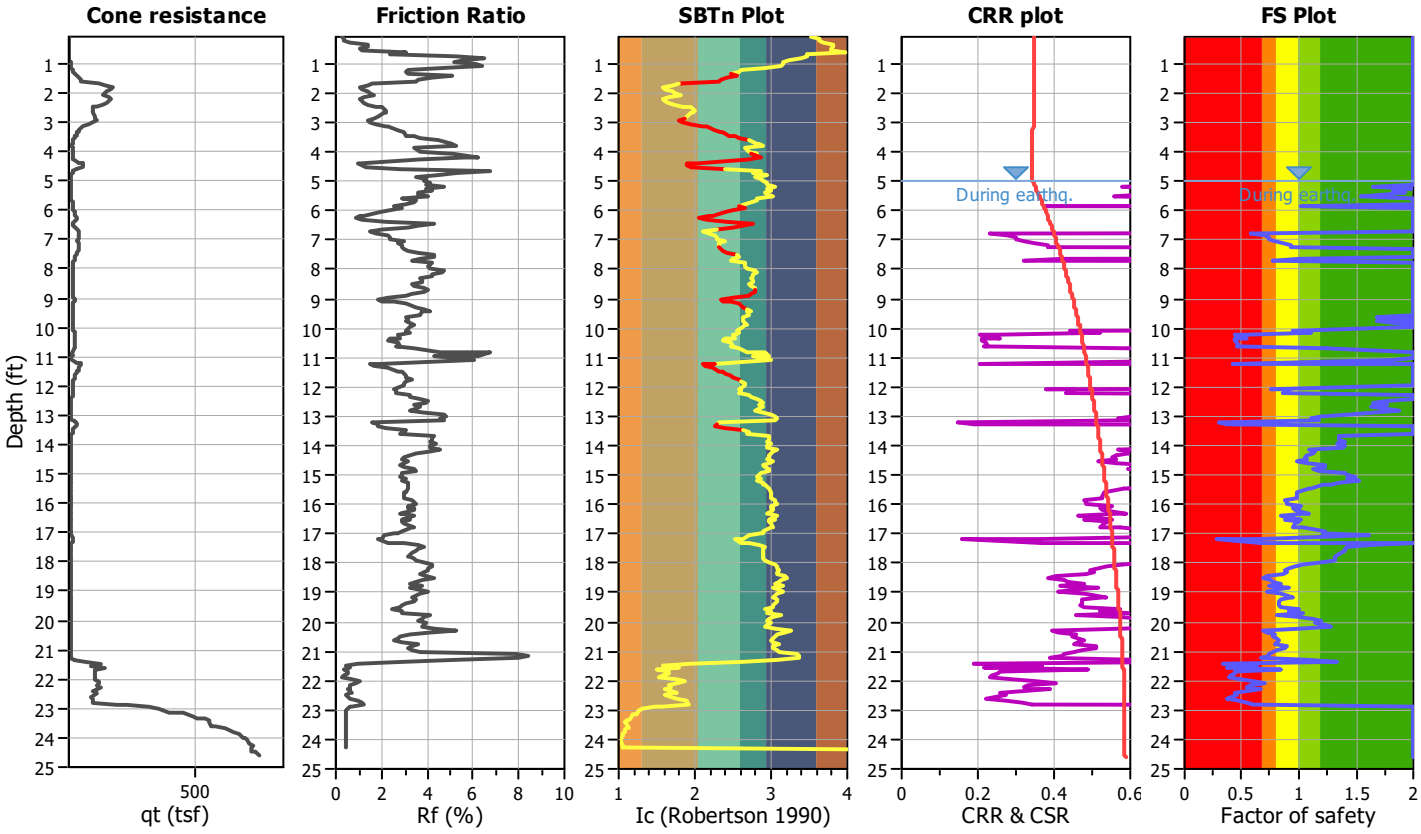

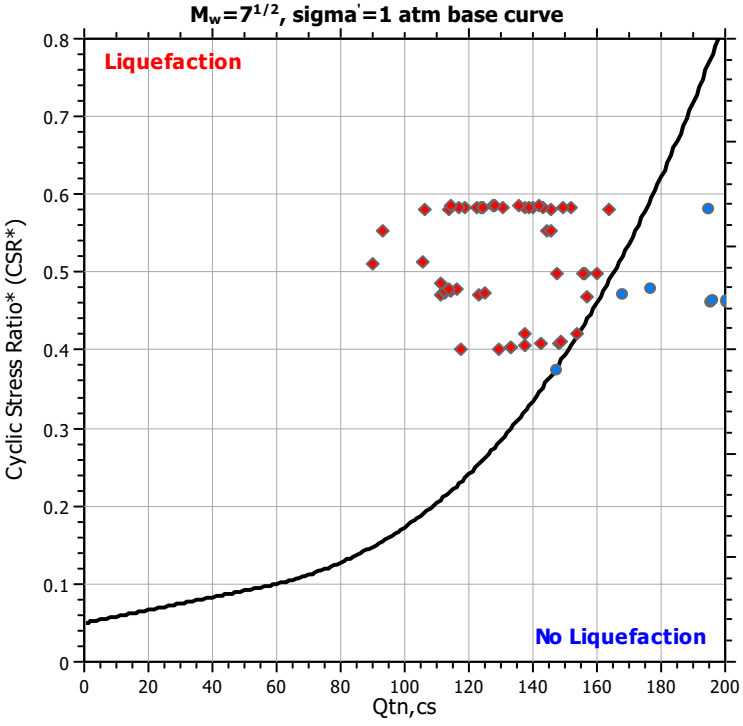

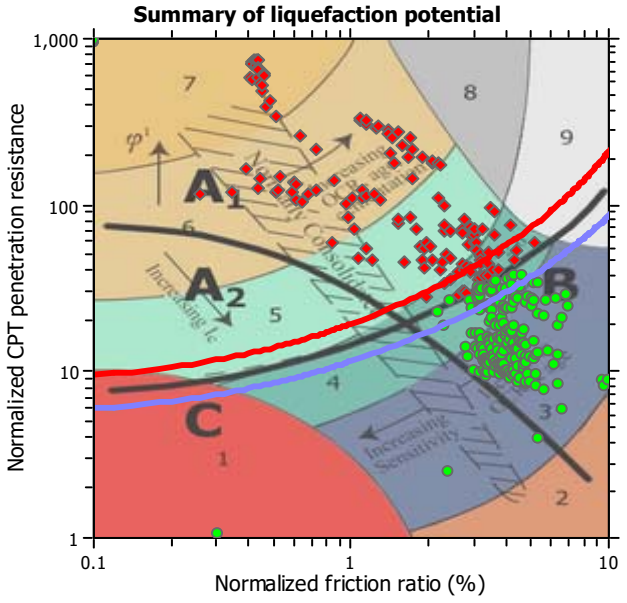

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The issuance of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots

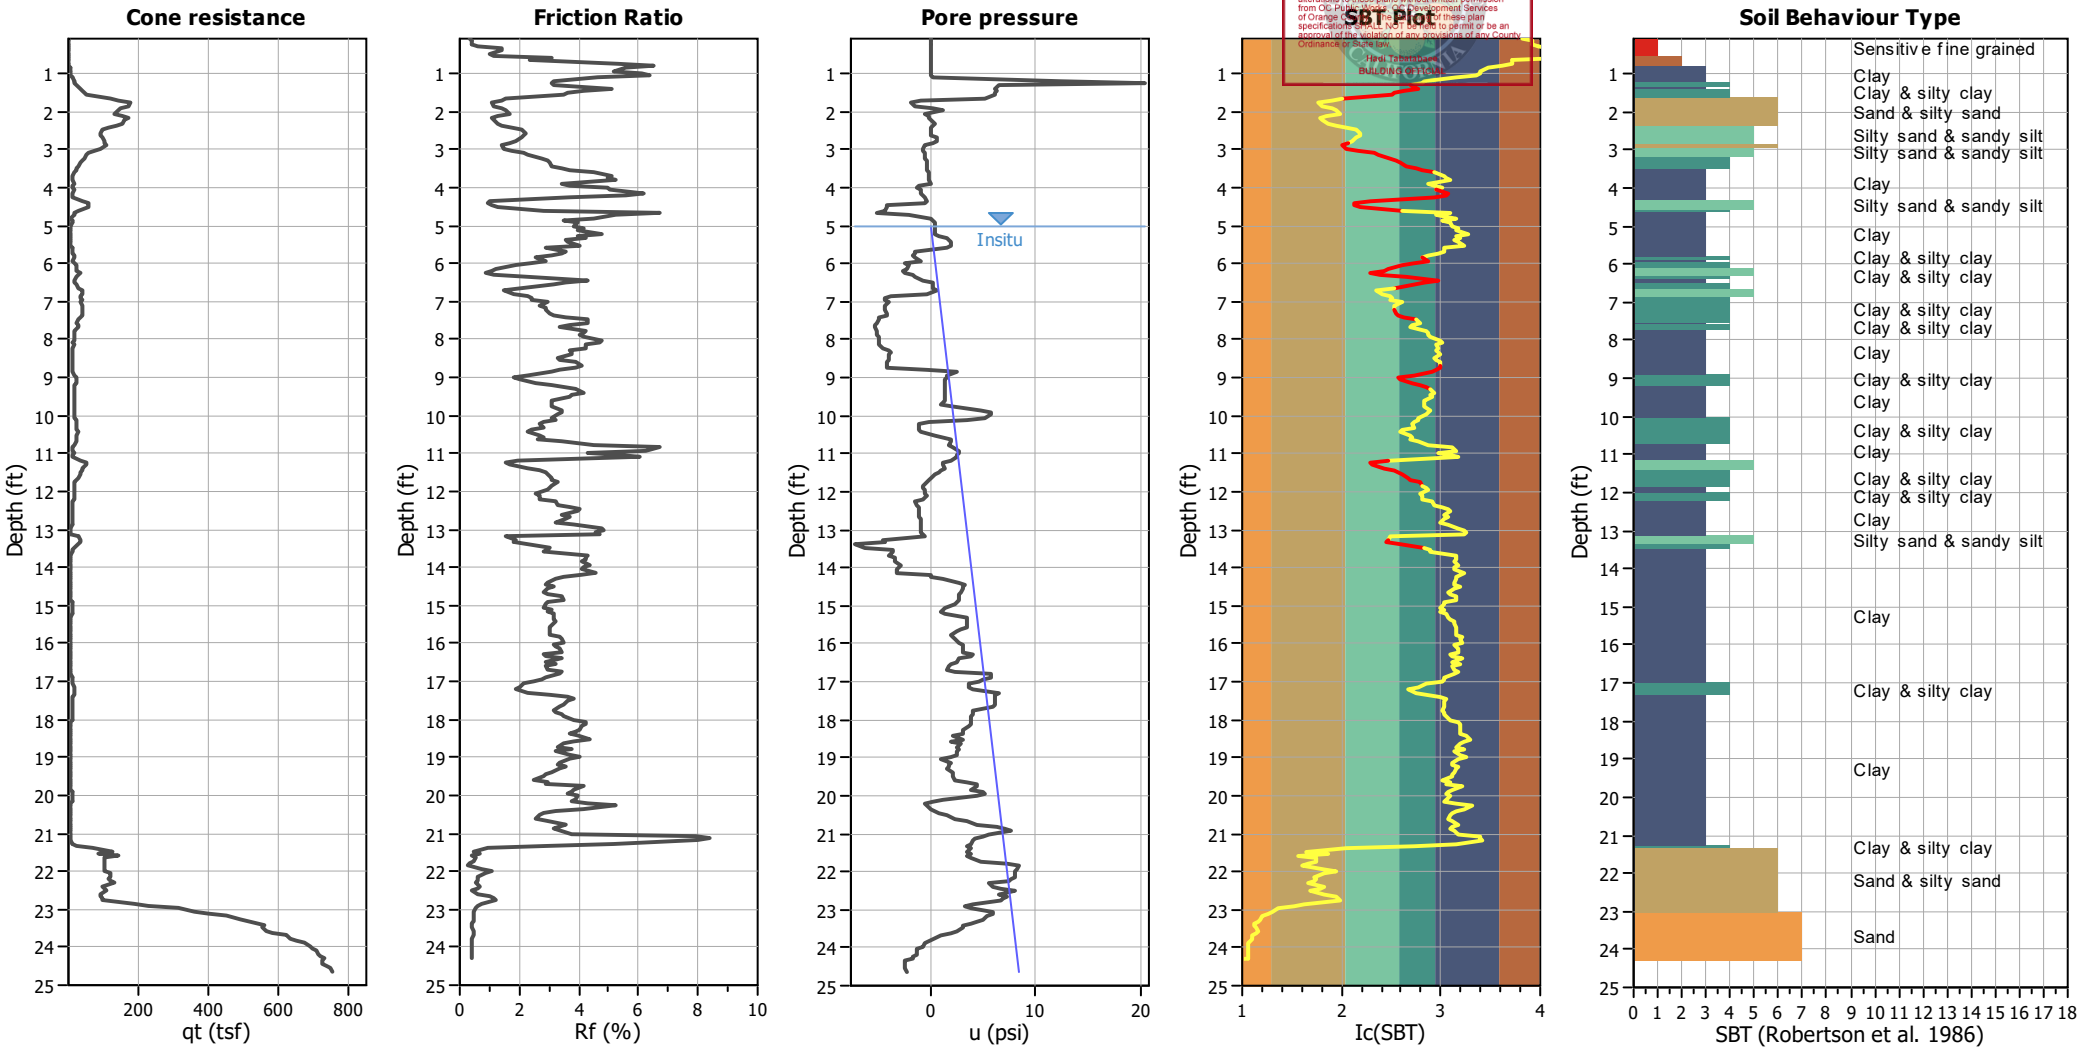

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots (normalized)

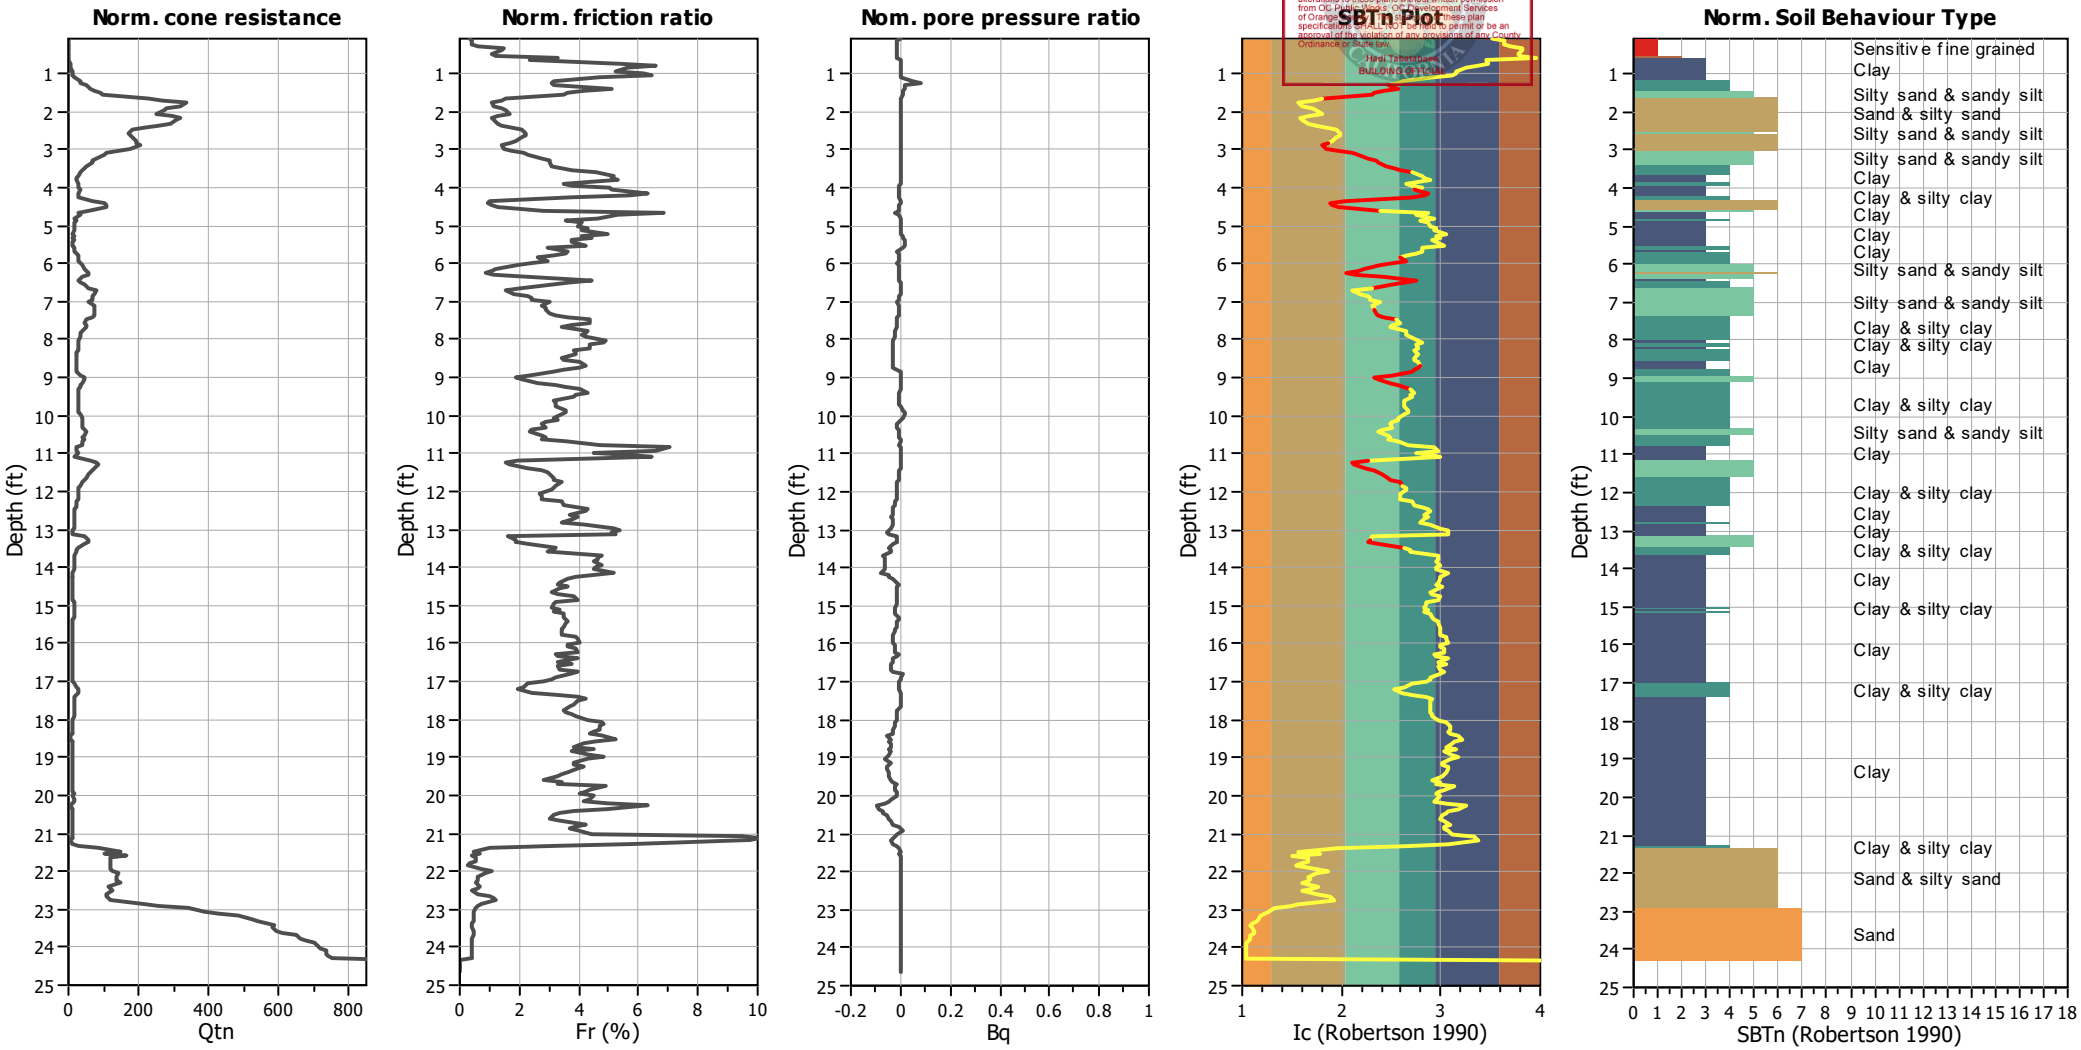

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

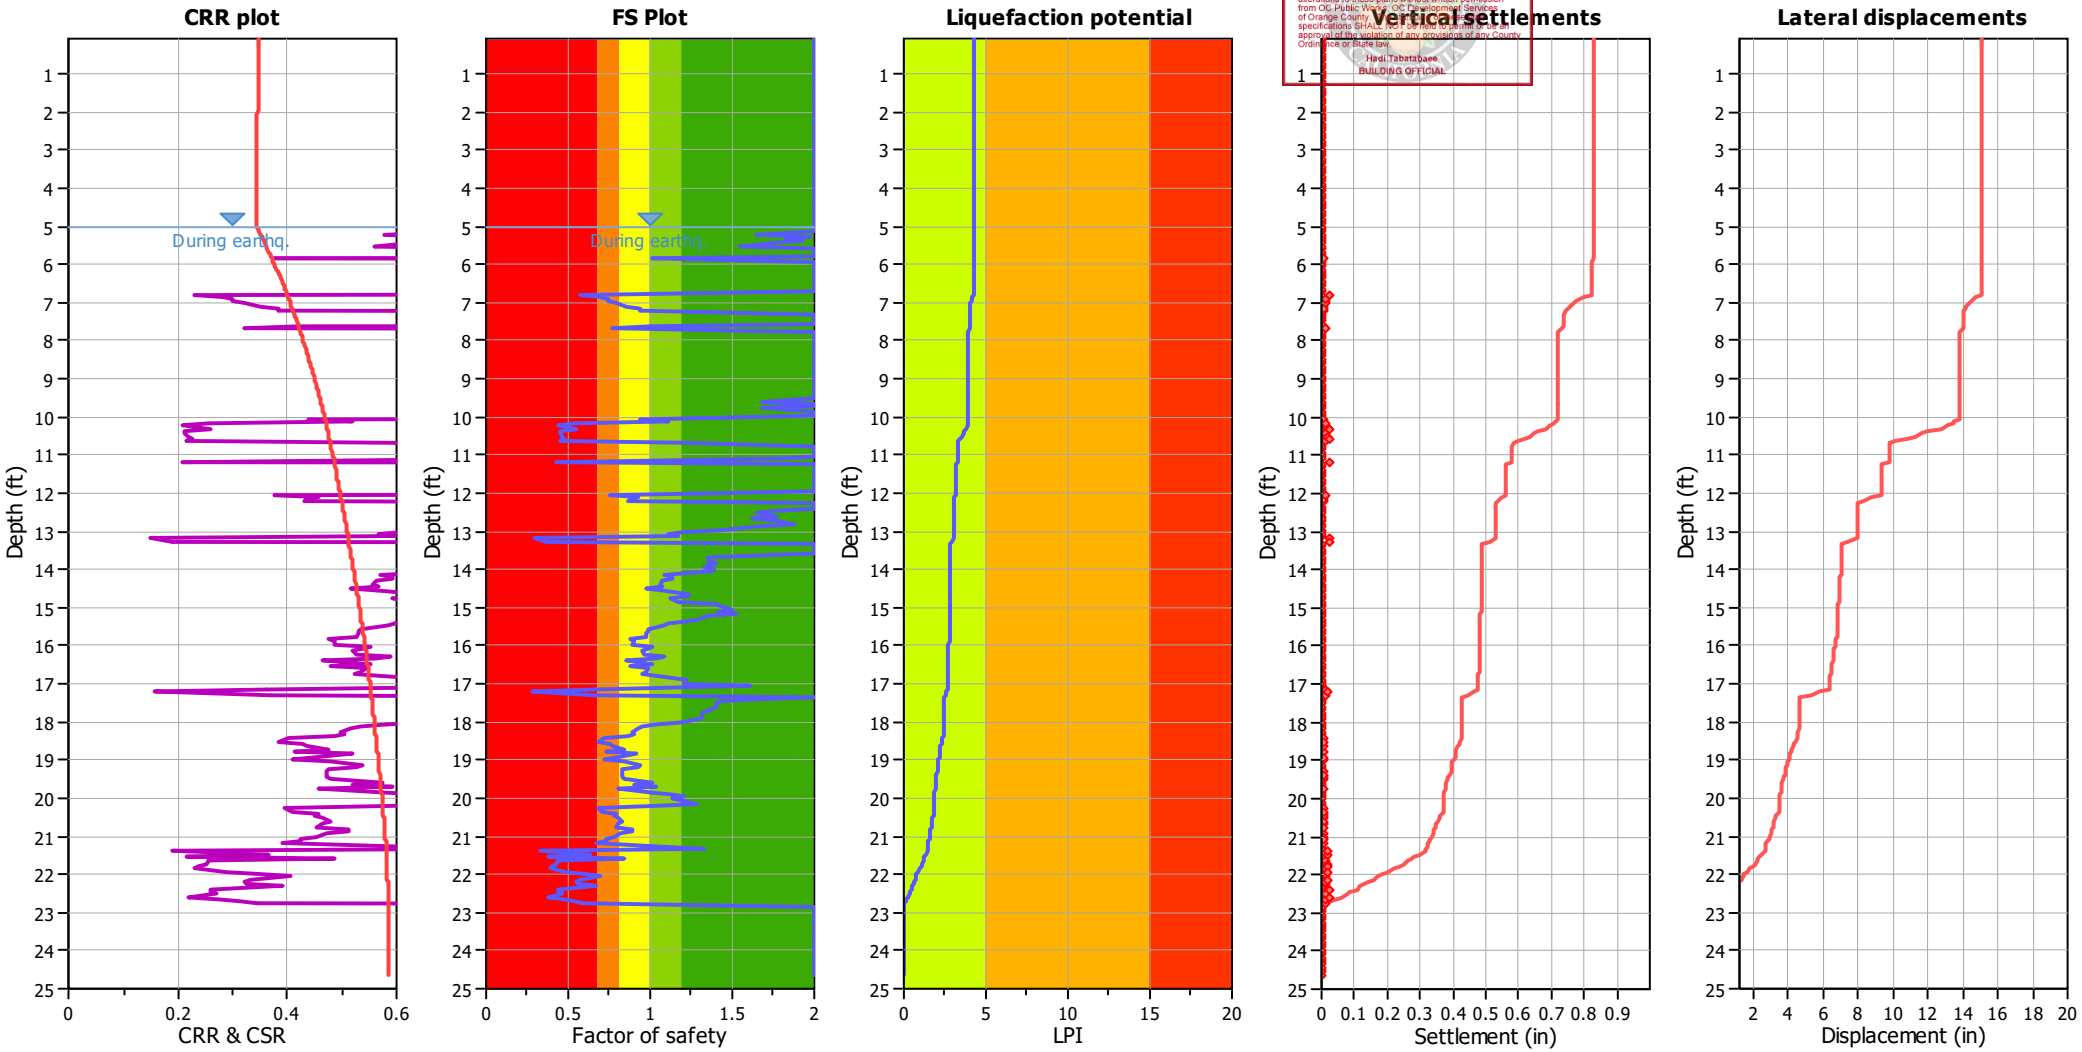

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Check for strength loss plots (Robertson (2010))

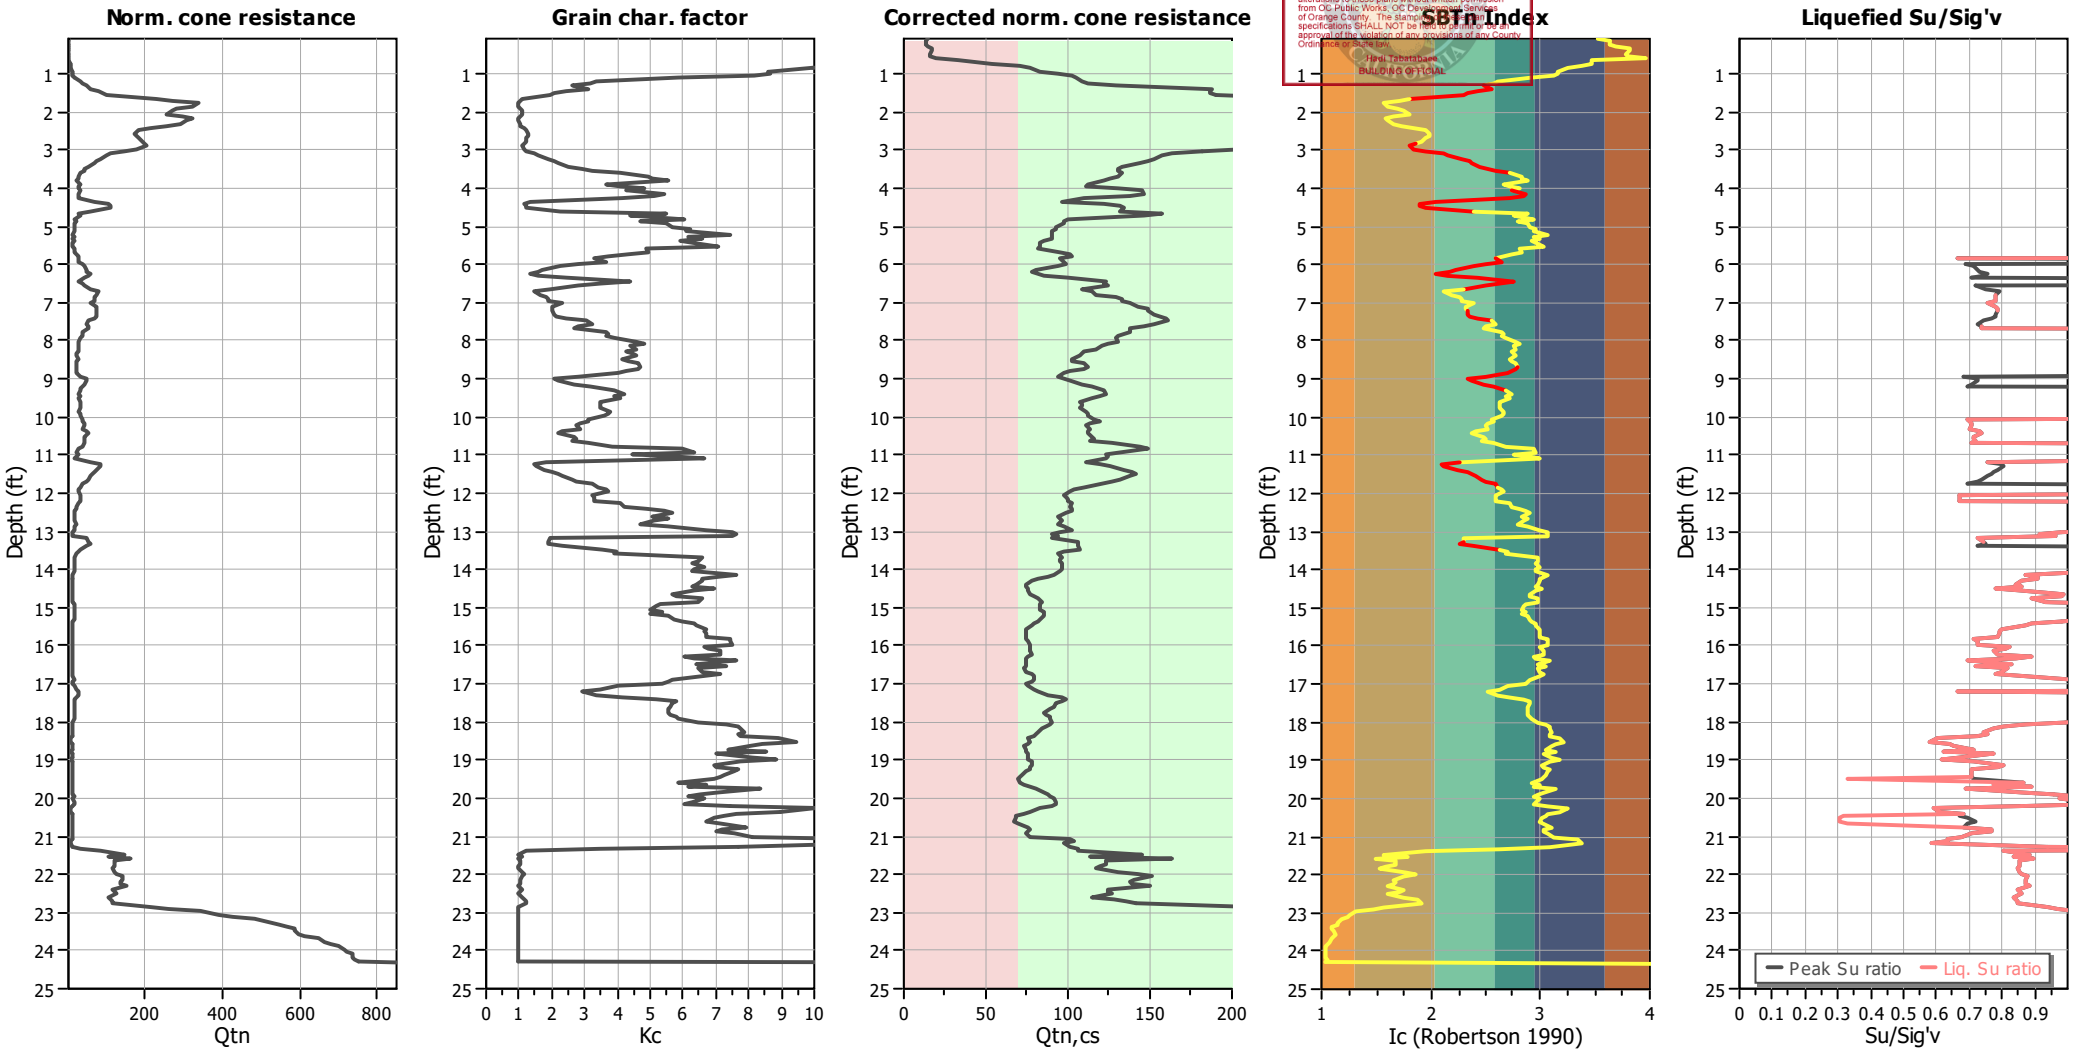

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0
County of Orange - OC Public Wo
OC Development Services
APPROVED
This set of plans and specifications must be kept on job at all times. It is unlawful to make any changes alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be a approval of the violation of any provisions of any Co Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 17-206-02 CPT-7A

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A		
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth applied:	No
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	Limit depth:	N/A
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No	MSF method:	Method based

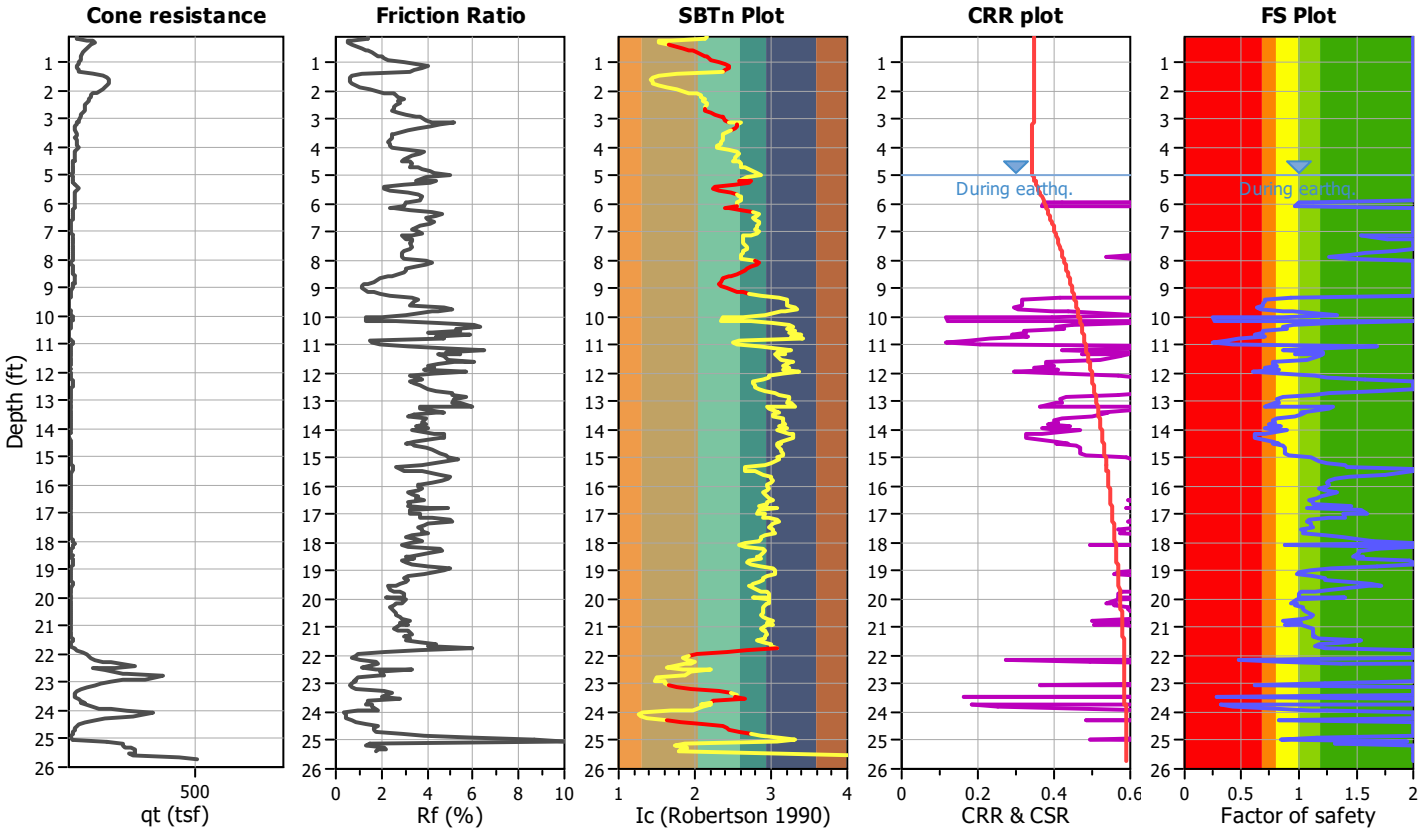

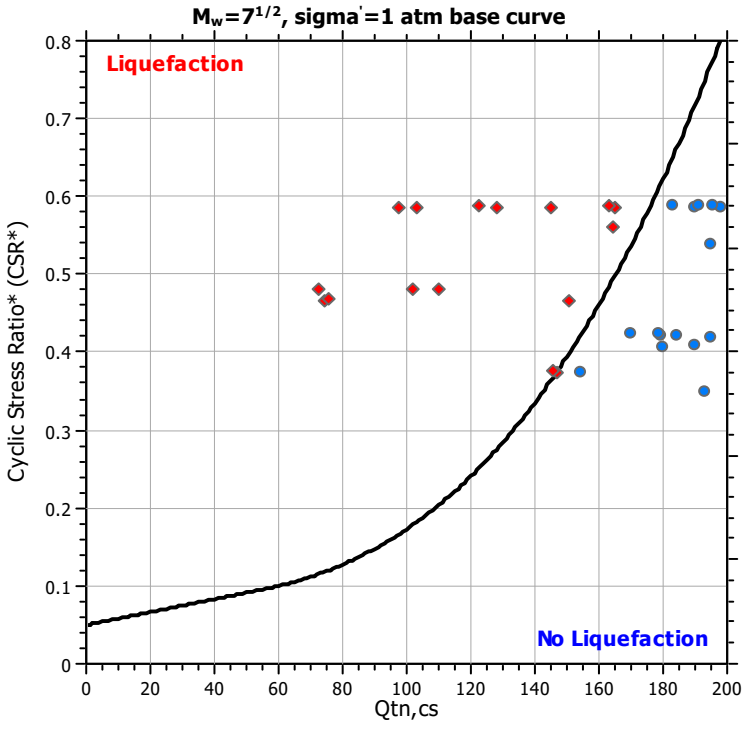

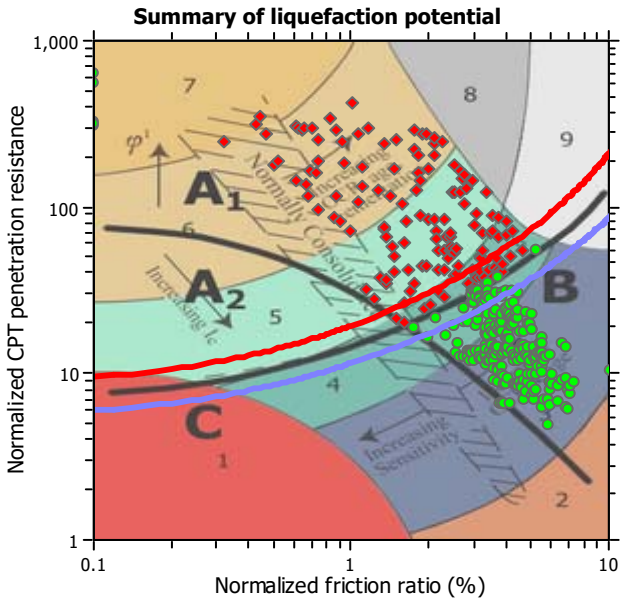

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
One set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The issuance of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or Section.

CPT basic interpretation plots

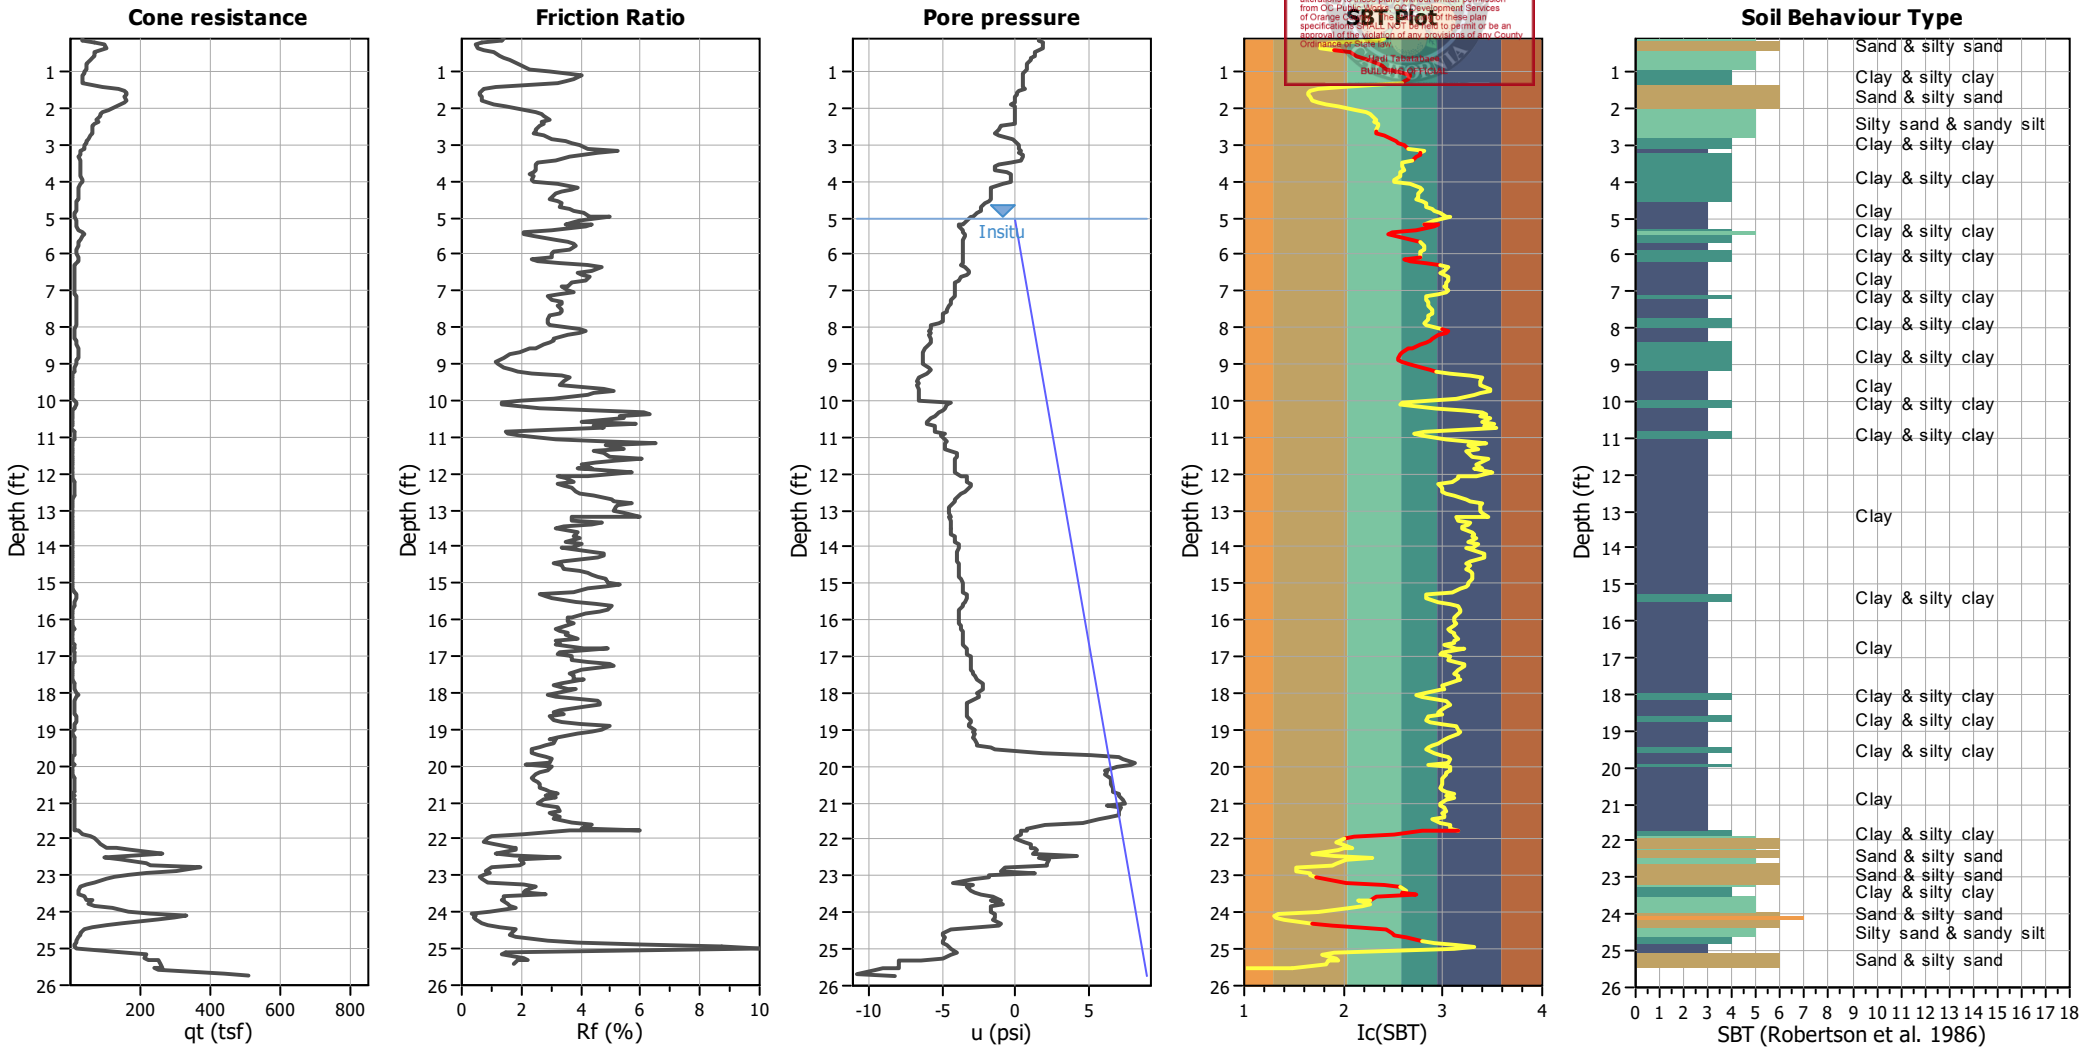

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
Building&Safety

CPT basic interpretation plots (normalized)

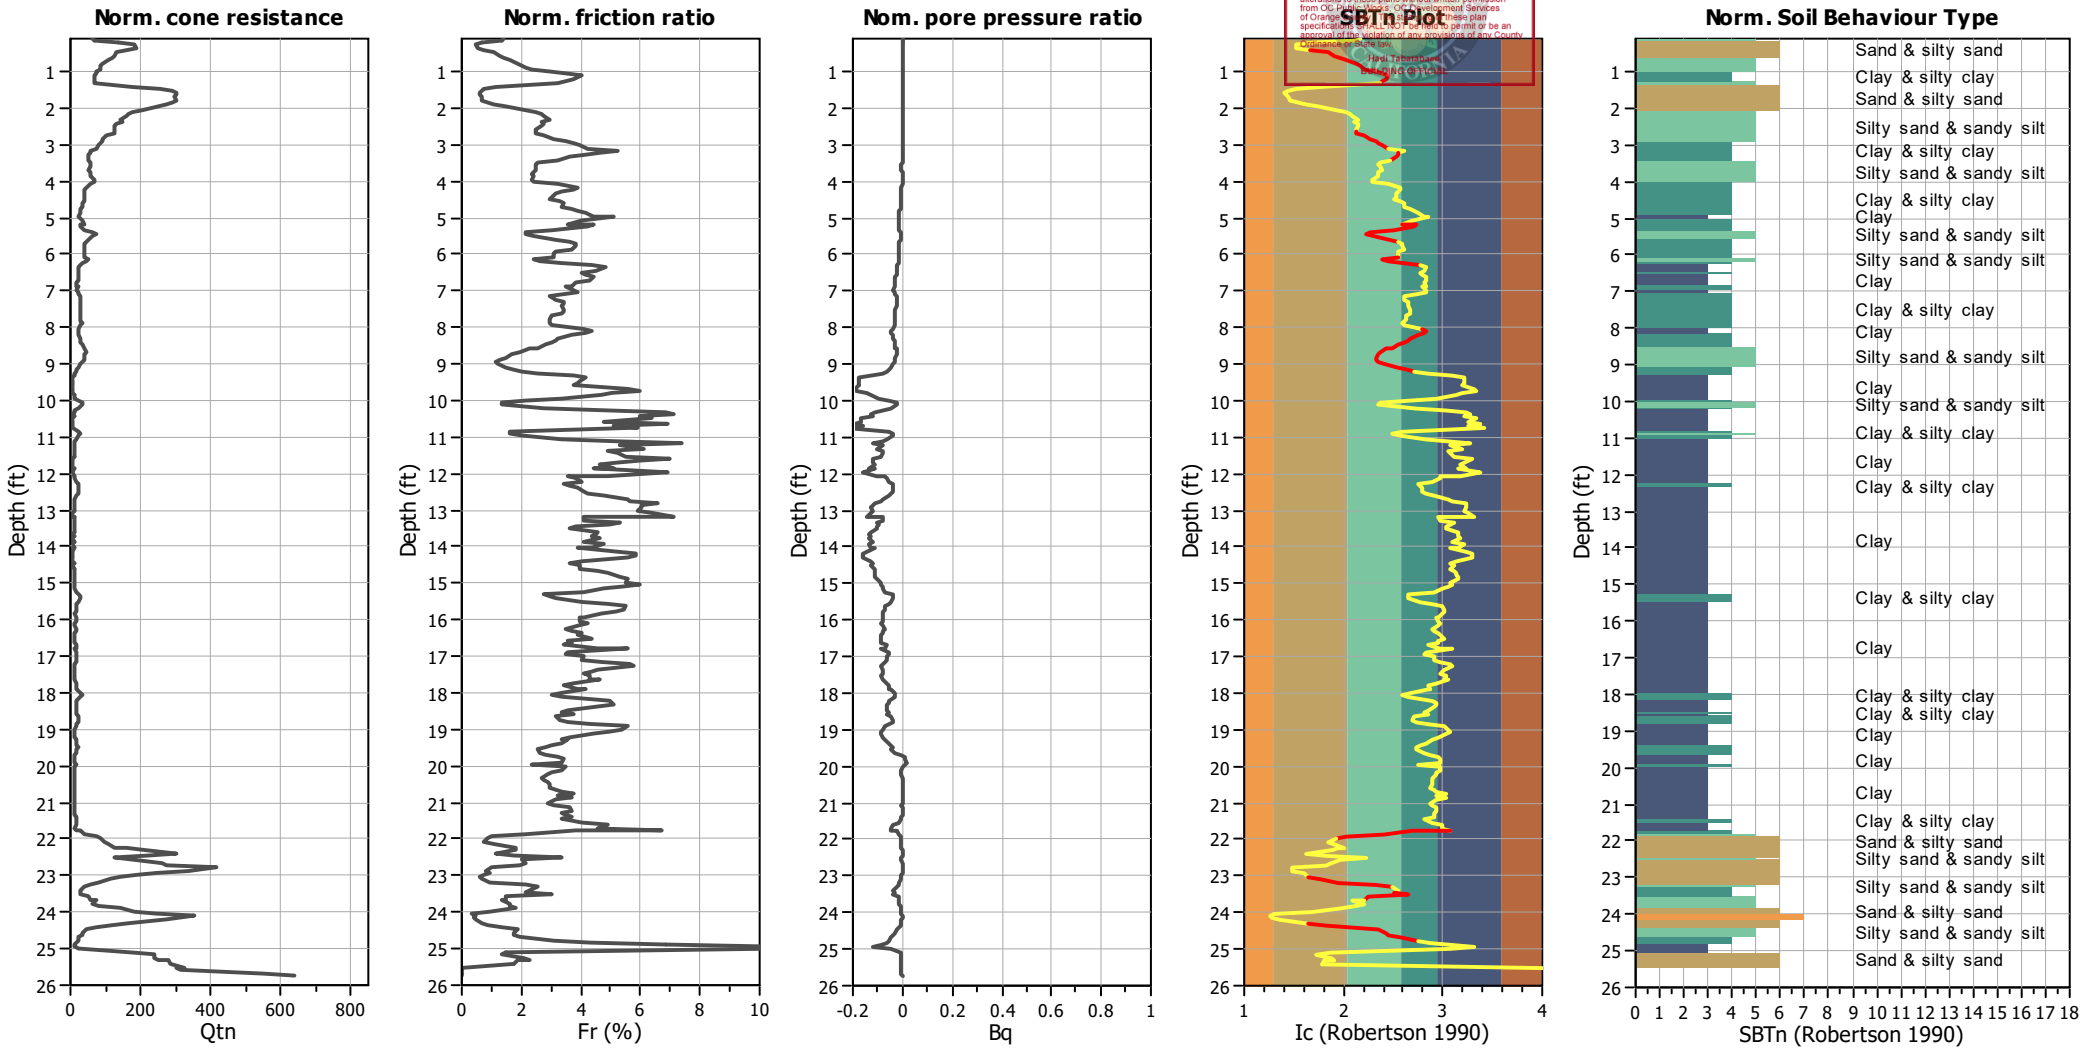

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

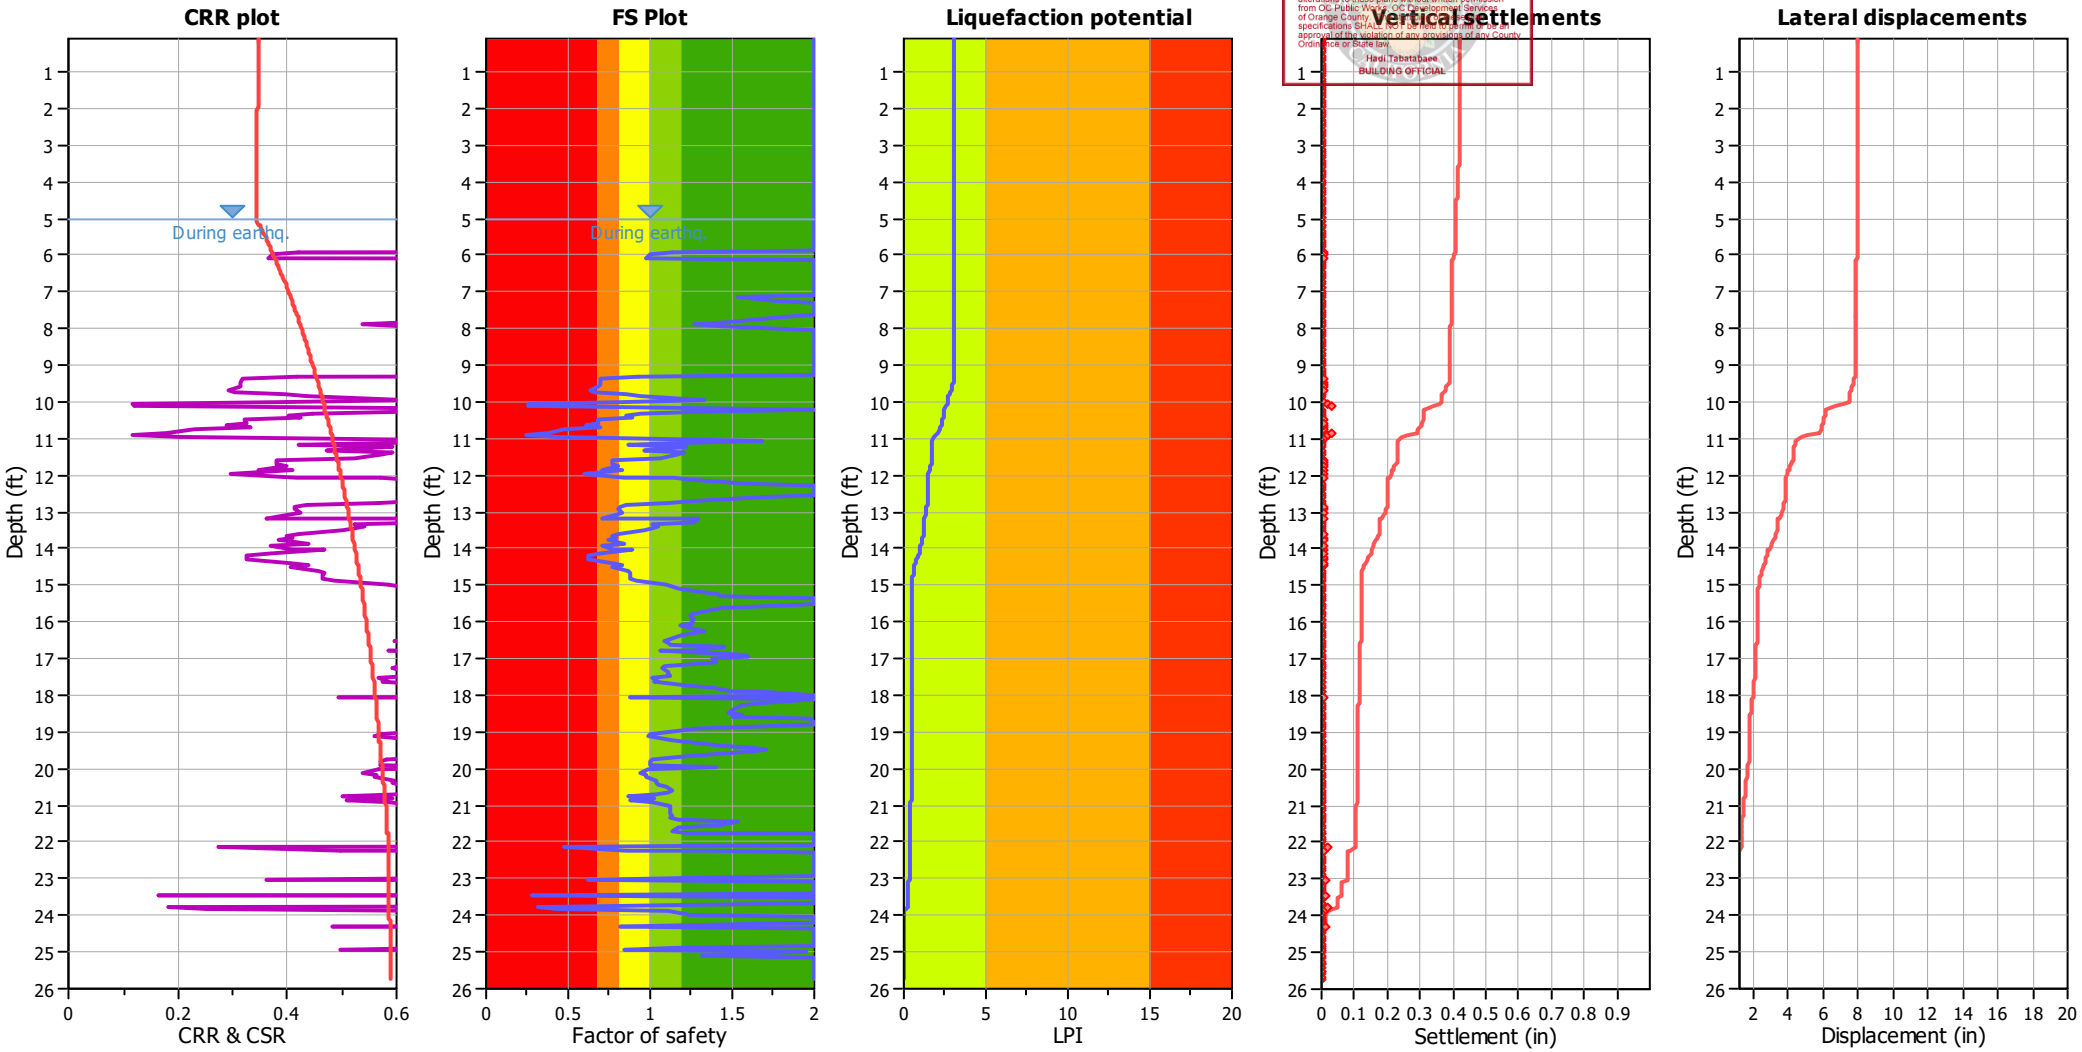

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED

Check for strength loss plots (Robertson (2010))

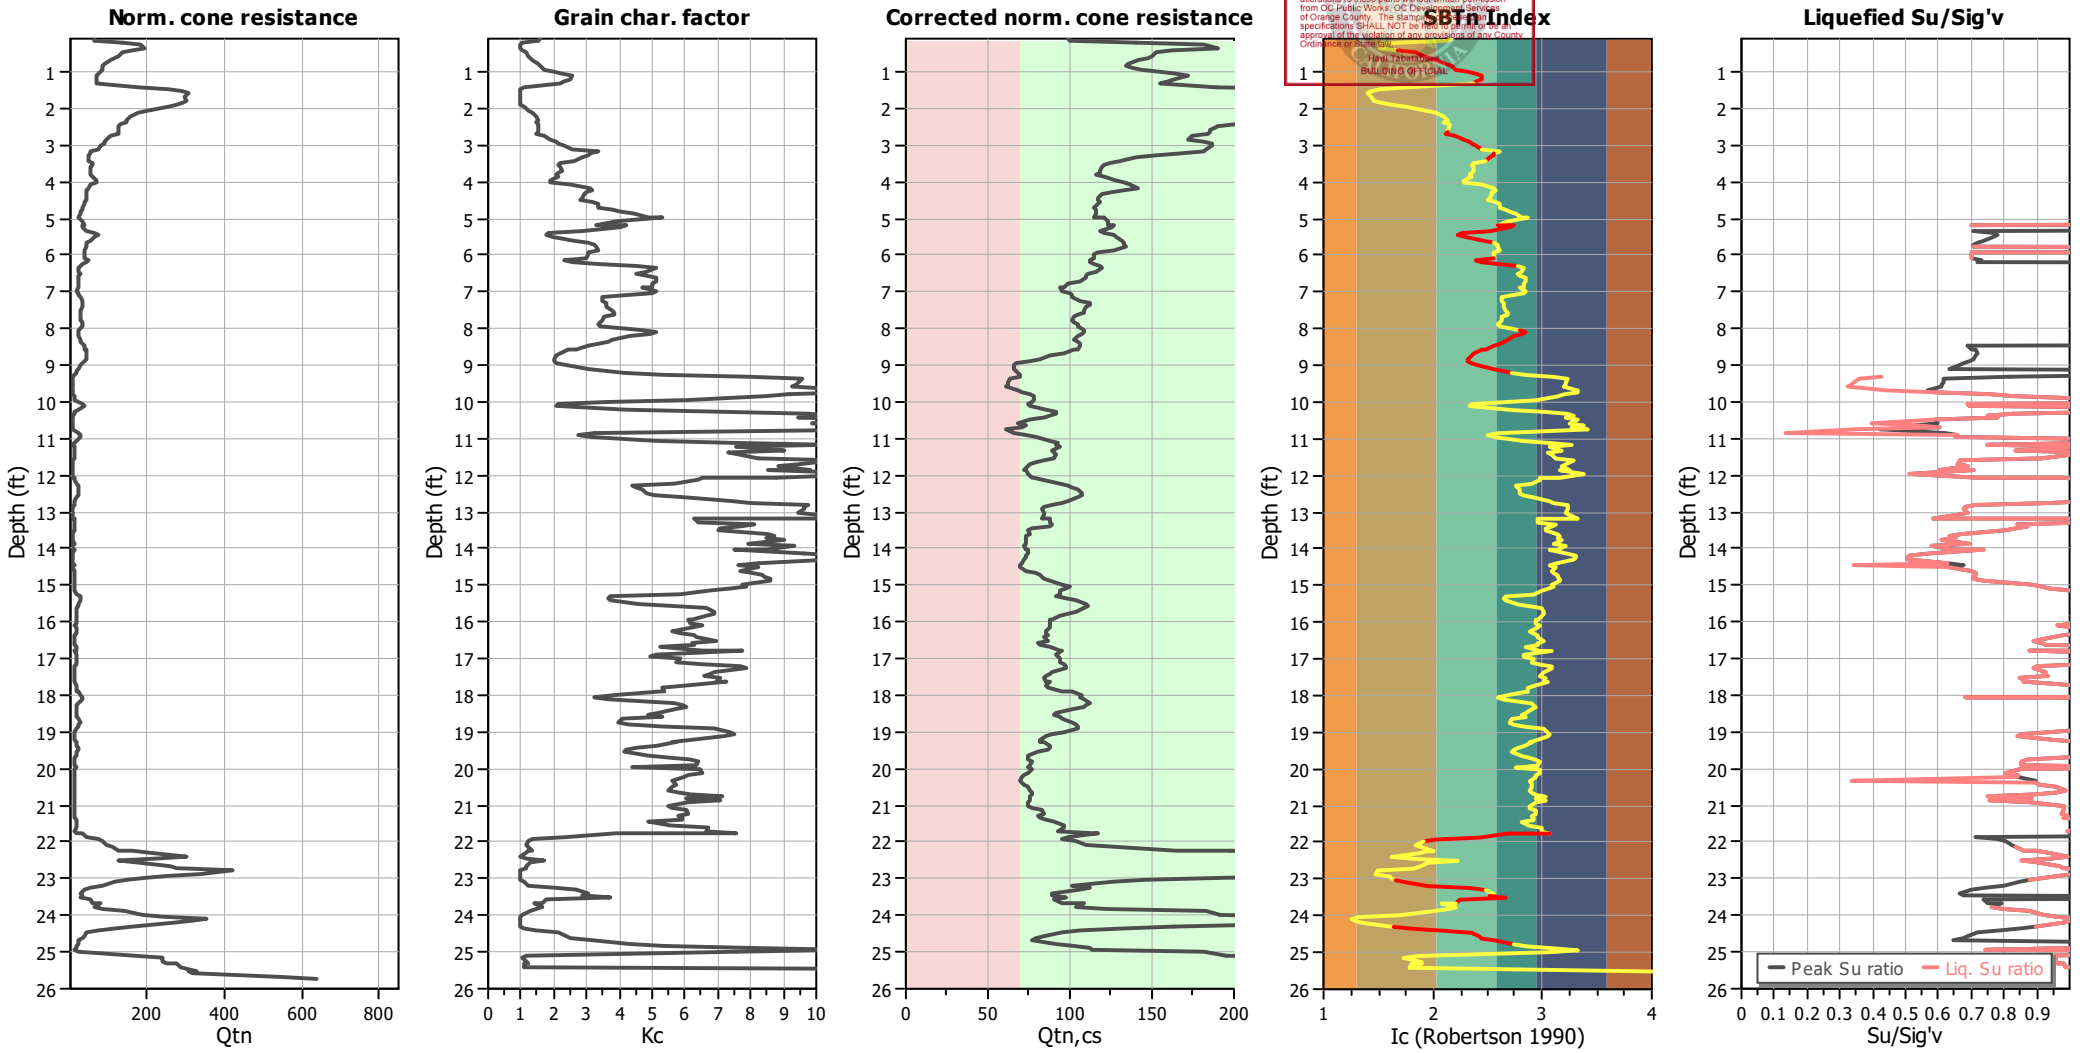

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-
County of Orange - OC Public Wo
OC Development Services
APPROVED
This set of plans and specifications must be kept on job at all times. It is unlawful to make any changes alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be a approval of the violation of any provisions of any Co Ordinance or State law.
Jitu Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 17-206-02 CPT-3A

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A	Limit depth applied:	No
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth:	N/A
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	MSF method:	Method based
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No		

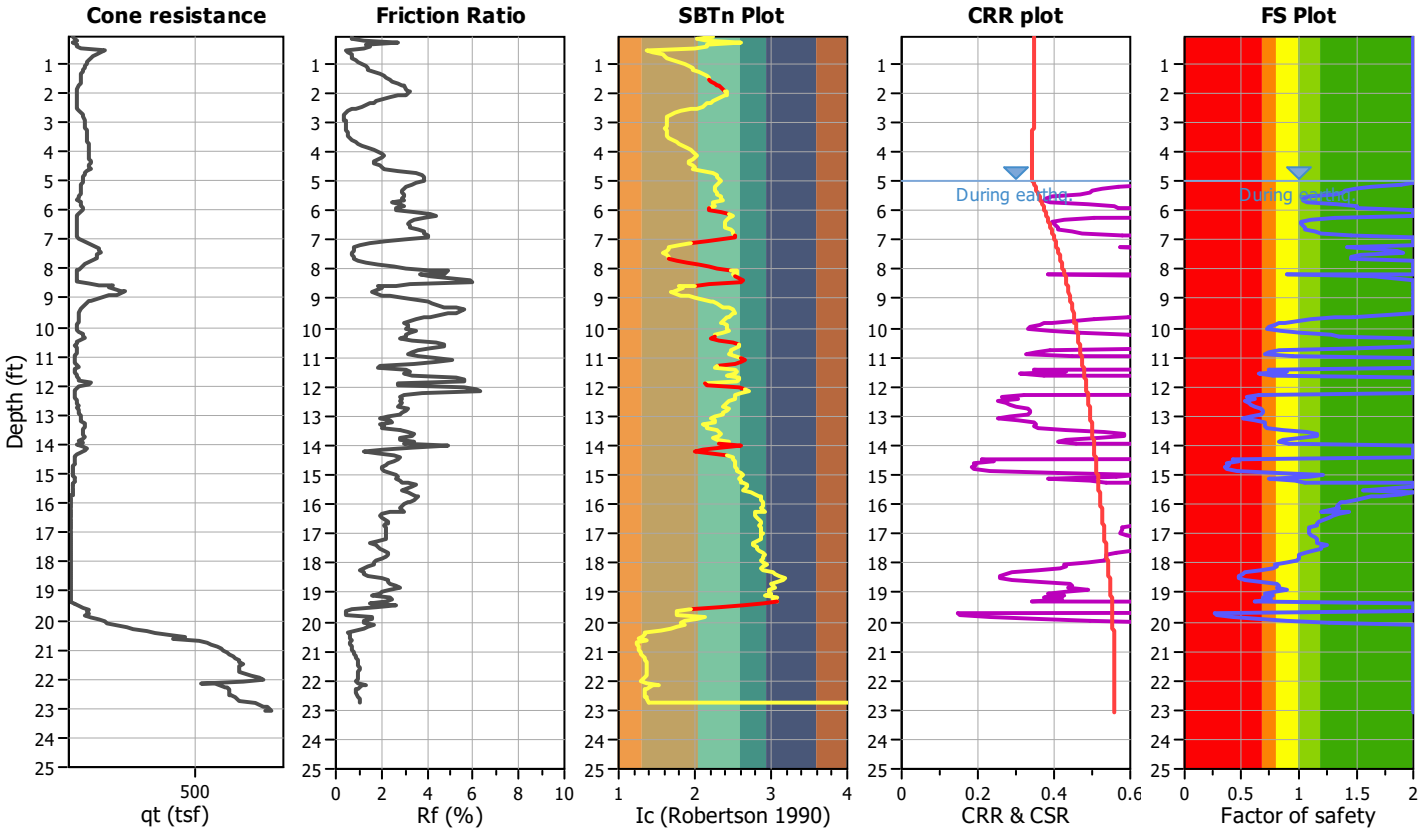

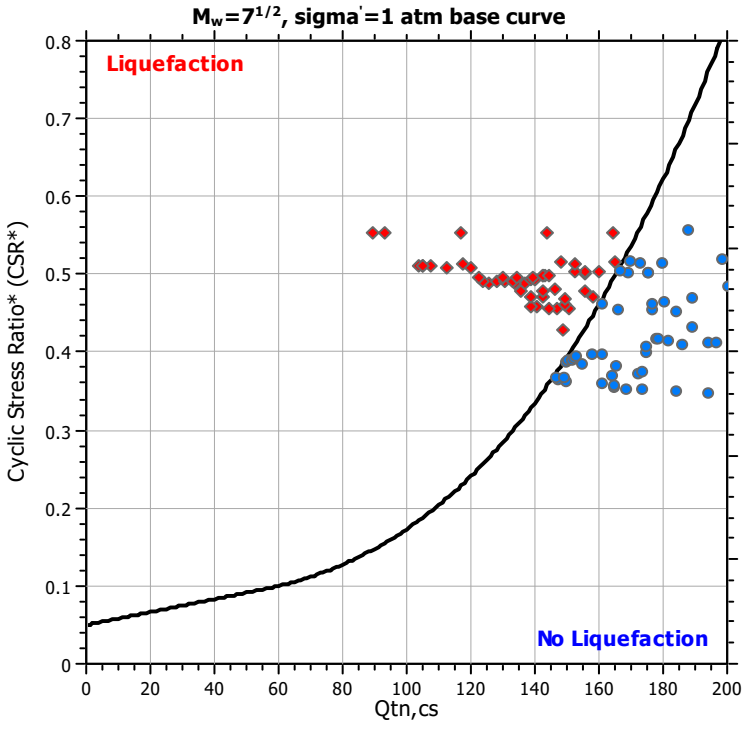

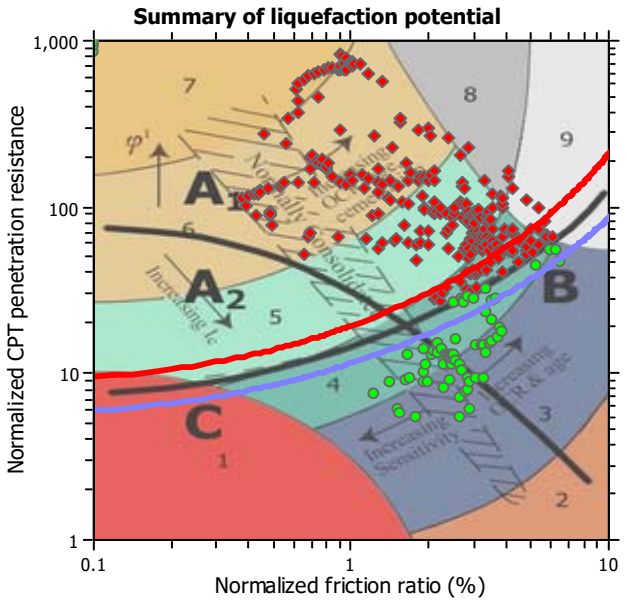

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Copies of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. Approval of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots

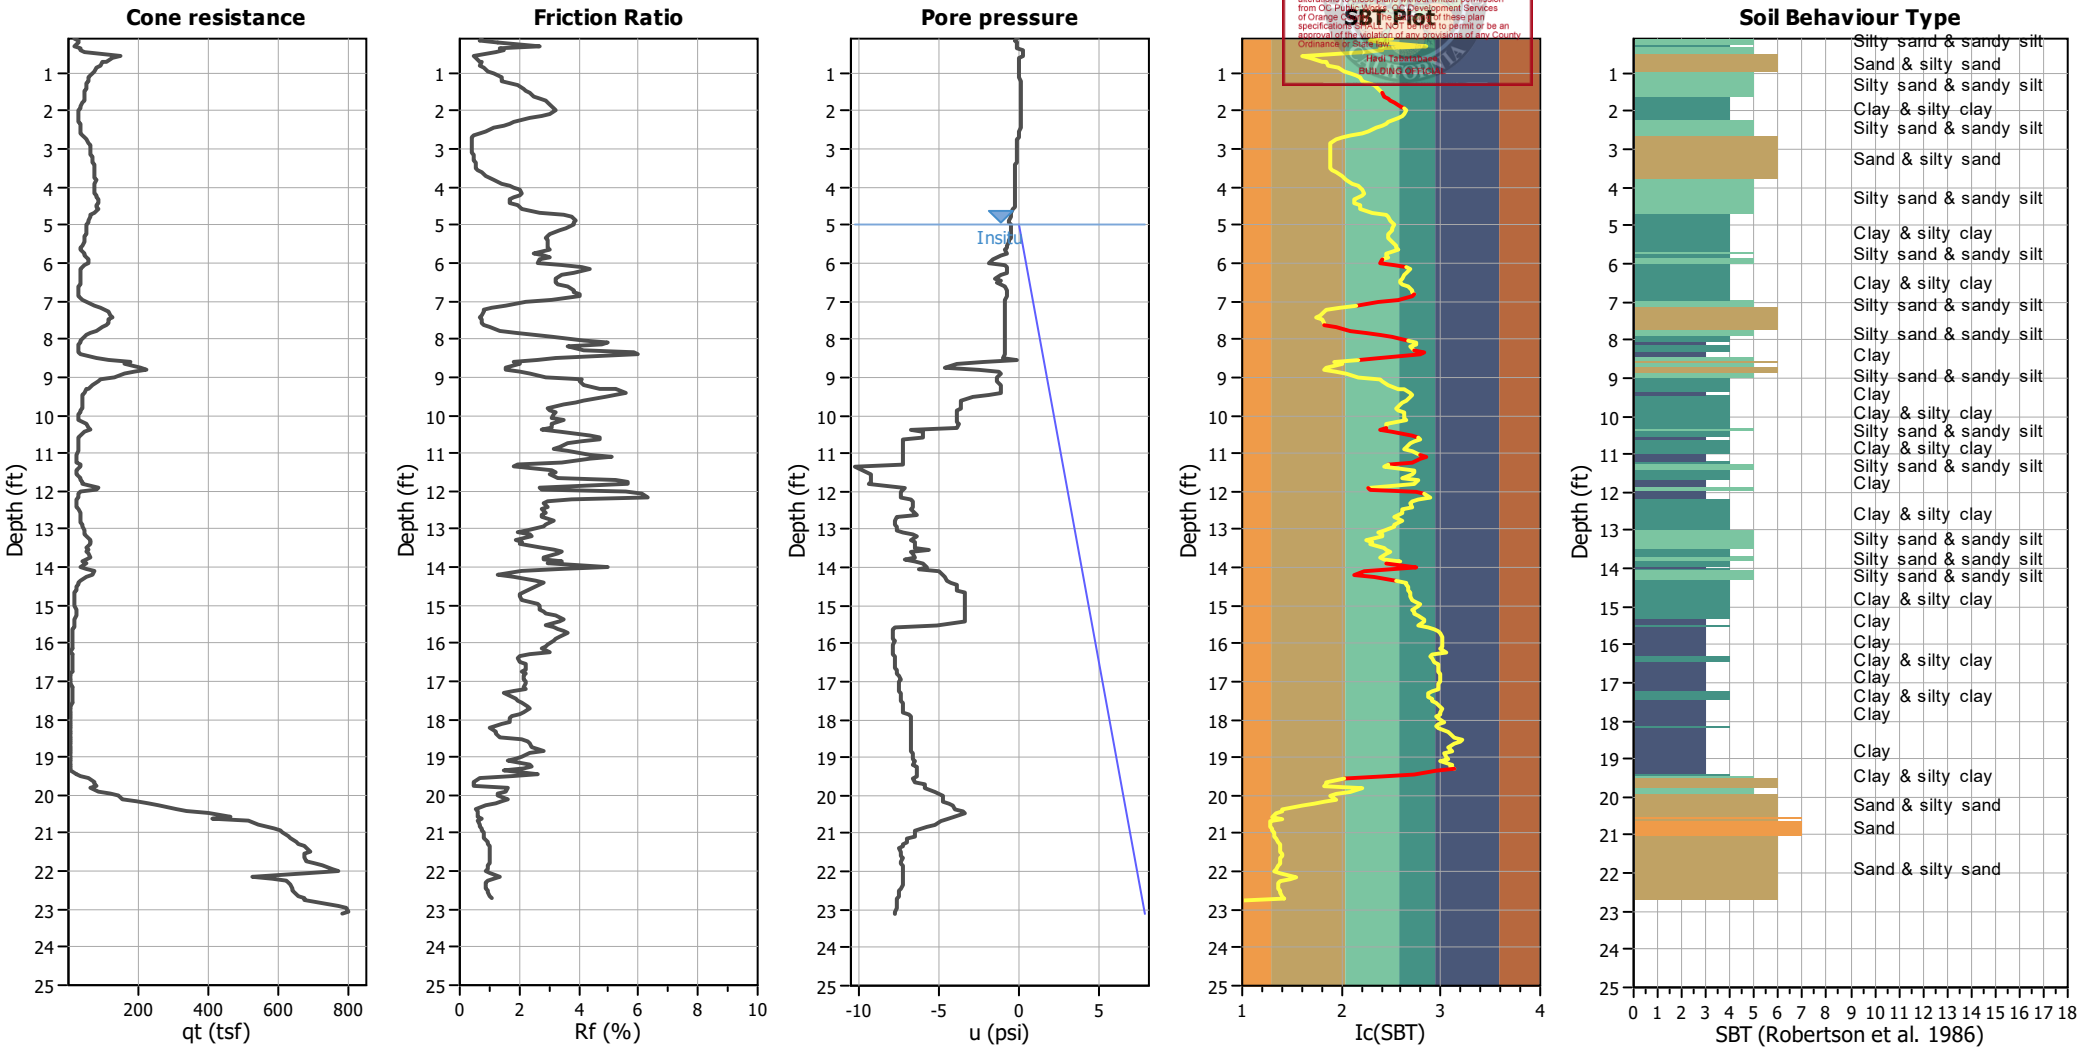

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED

CPT basic interpretation plots (normalized)

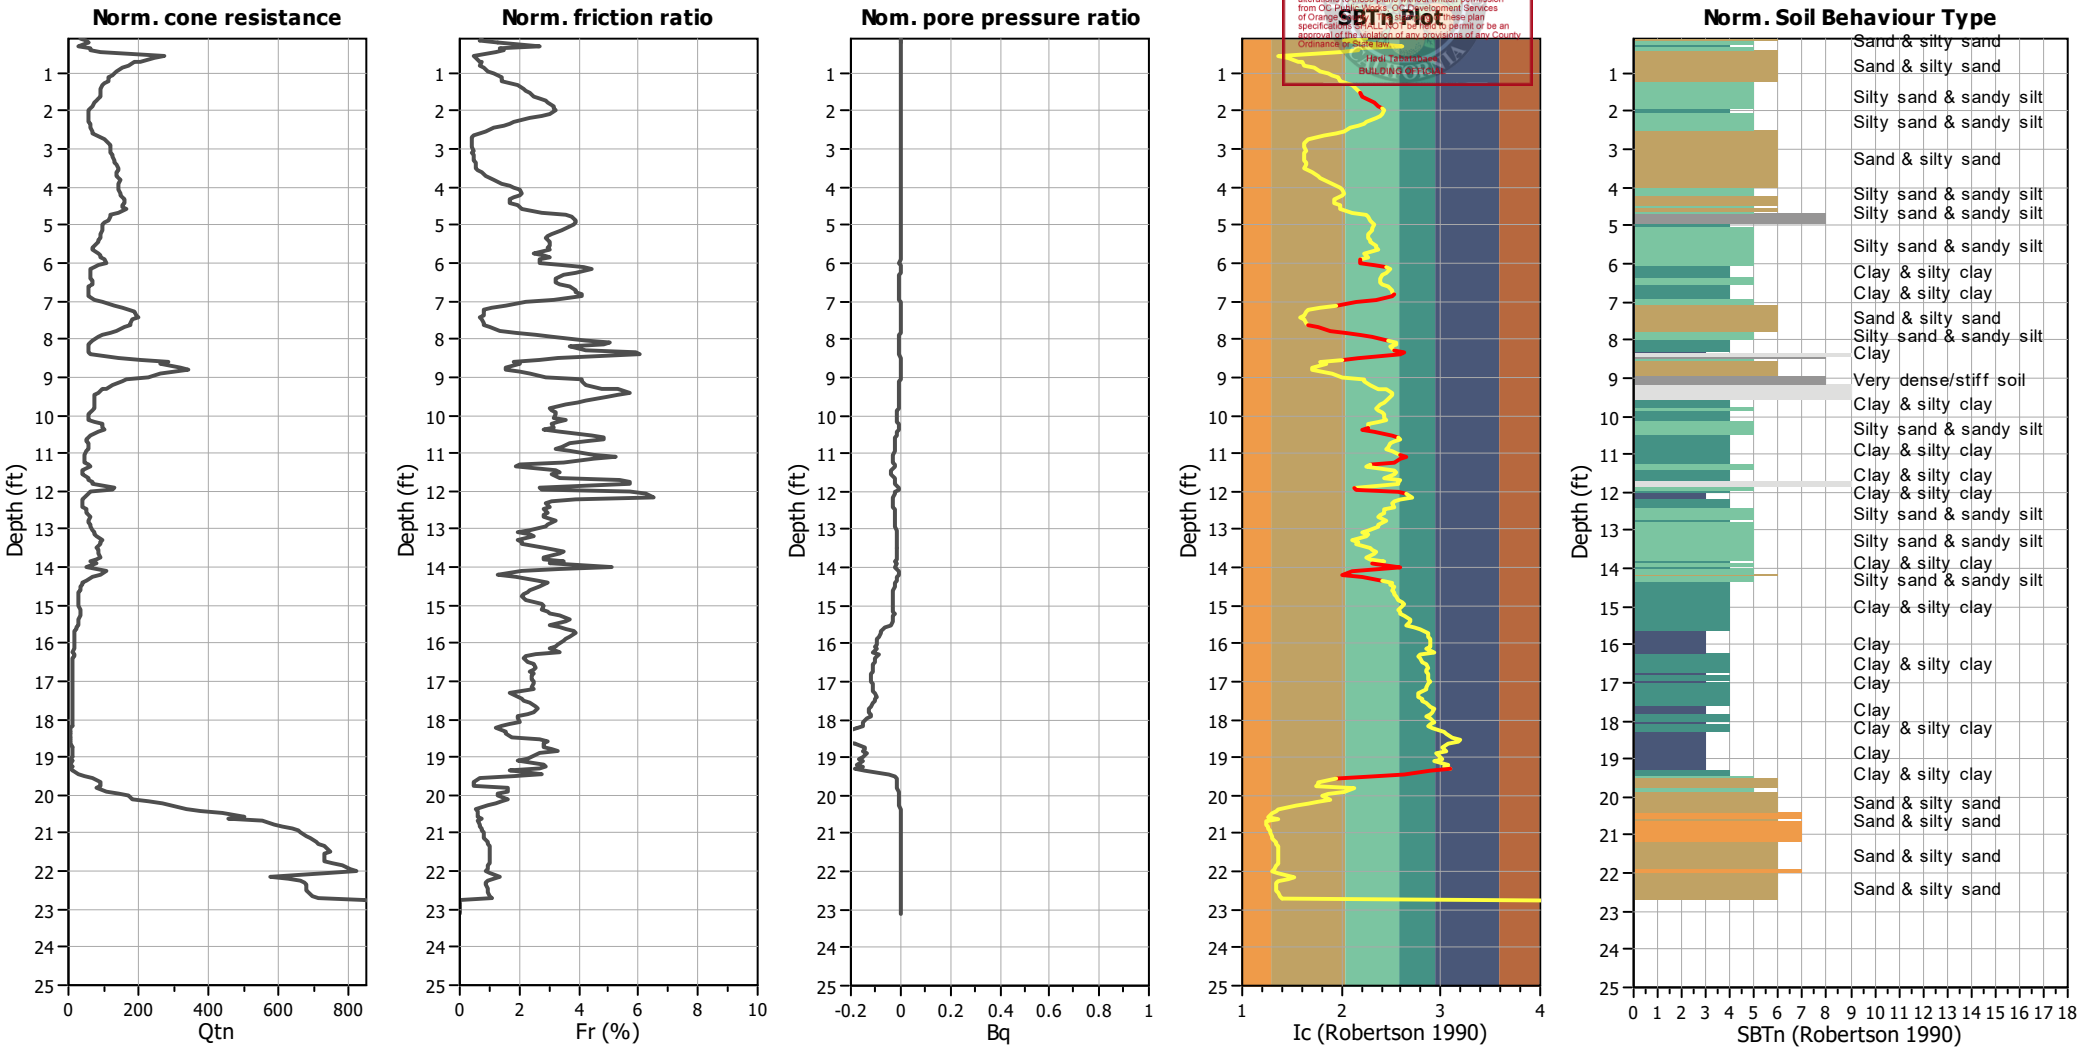

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. Approval of these plans and specifications SHALL NOT be construed to permit the an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

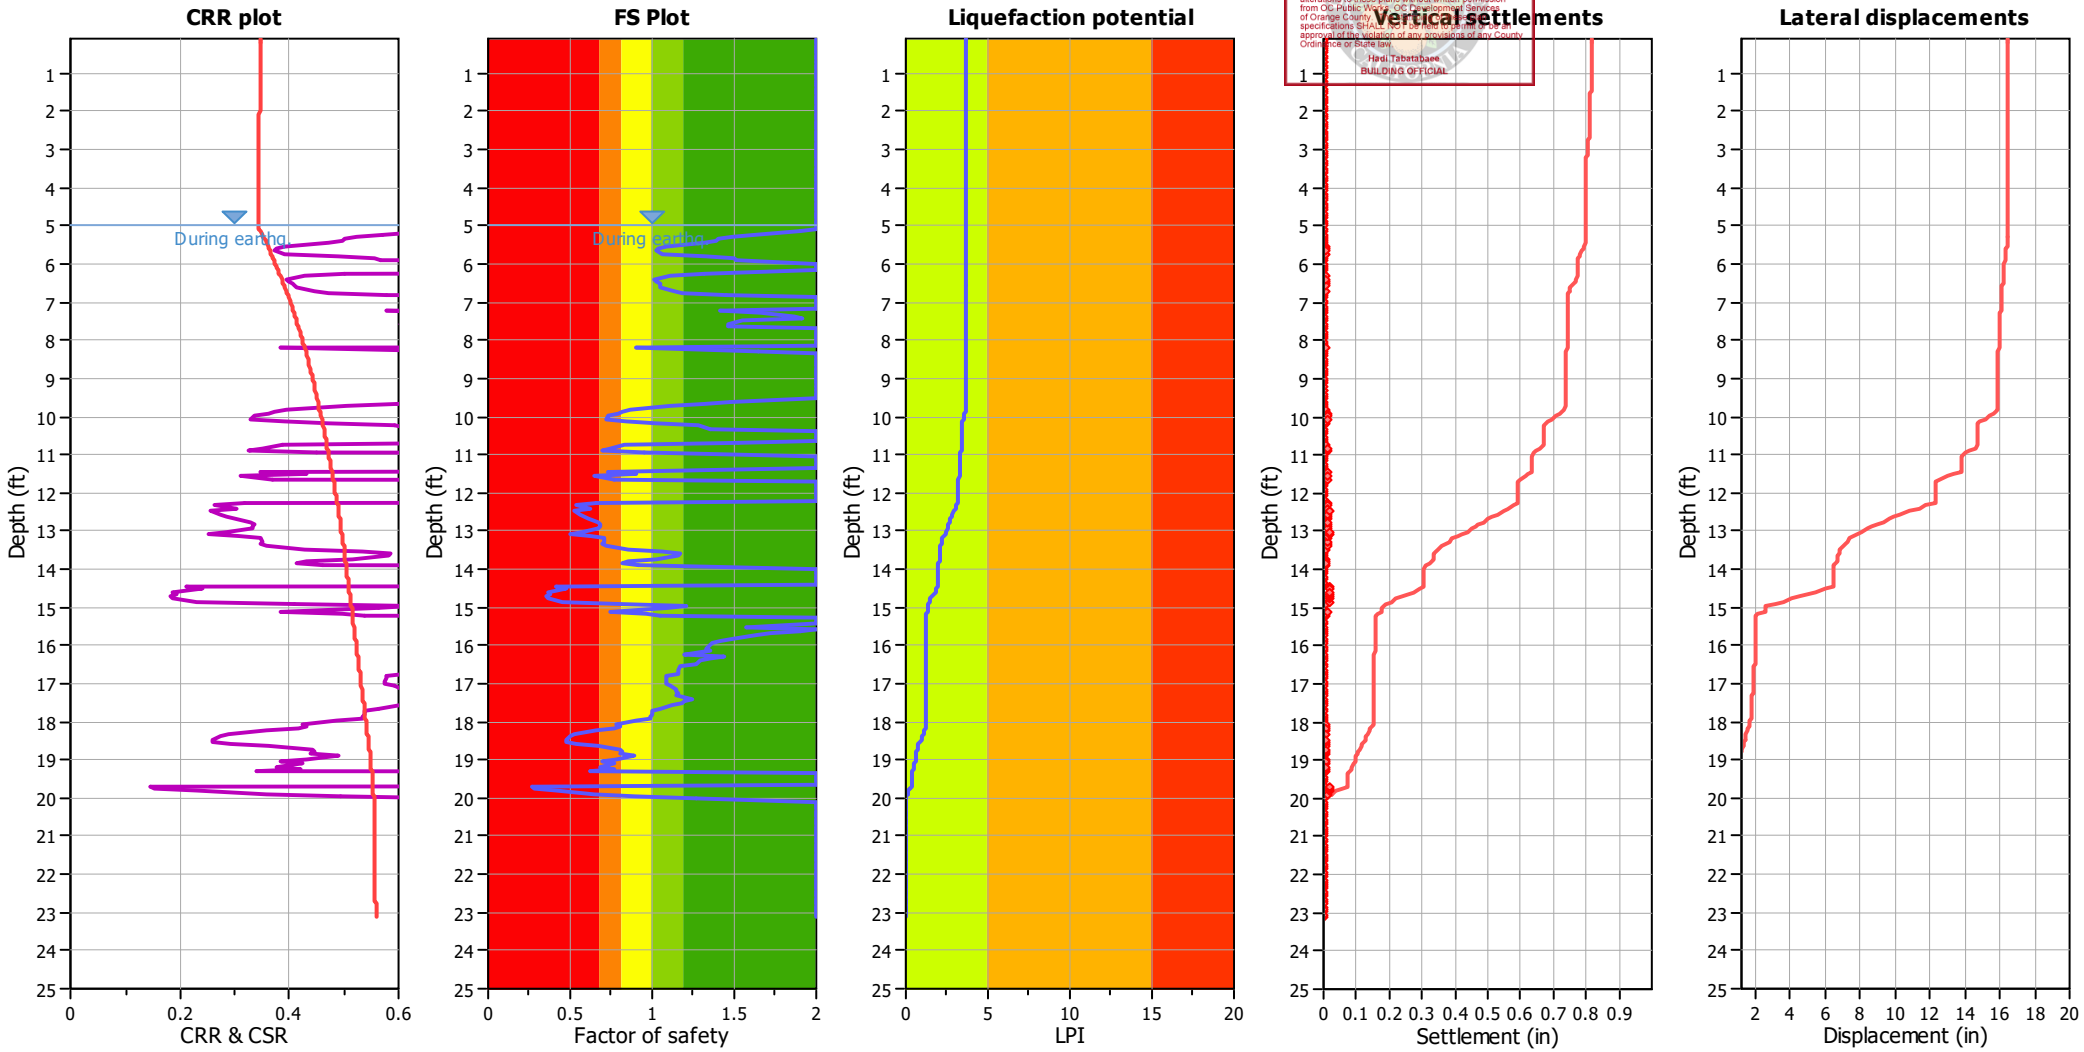

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hirdi Tabatabaee
BUILDING OFFICIAL

Check for strength loss plots (Robertson (2010))

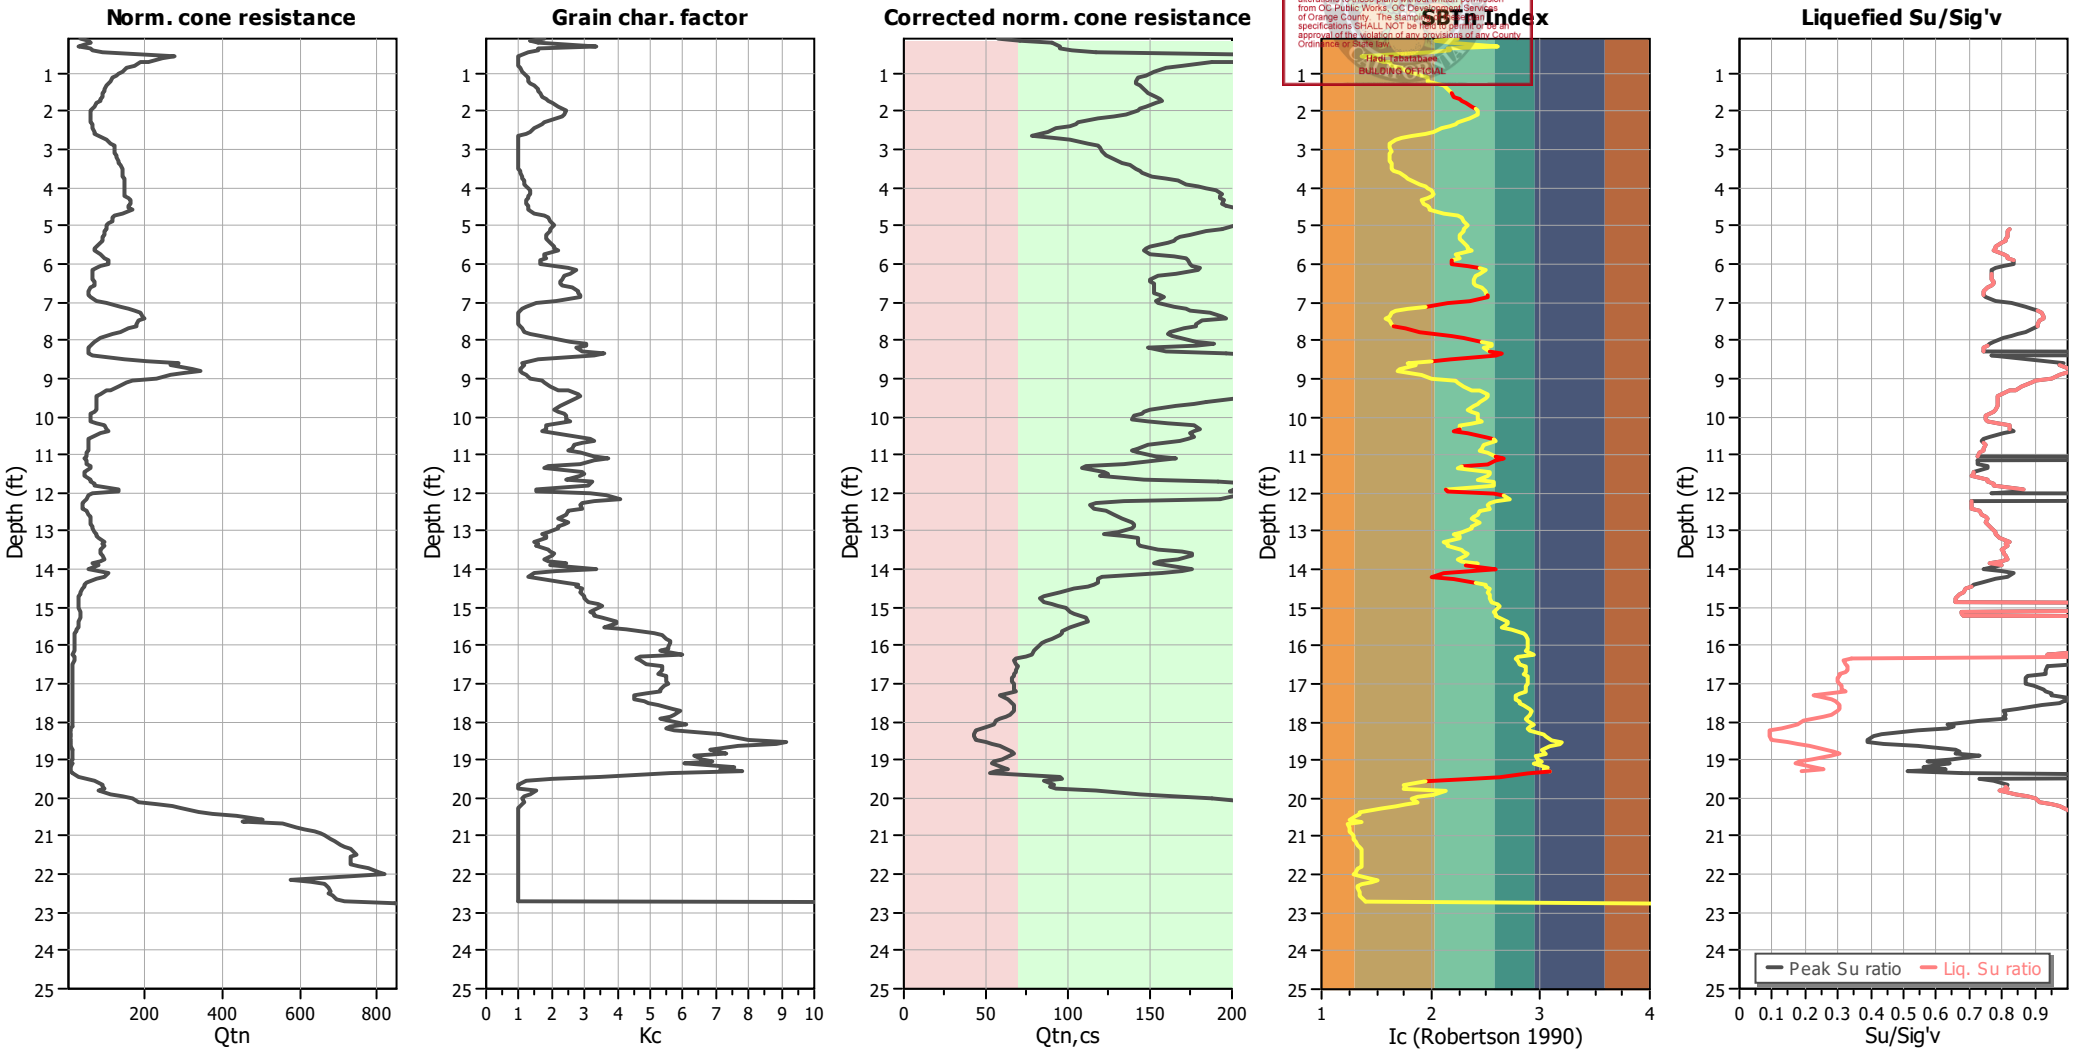

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0
County of Orange - OC Public Wo
OC Development Services
APPROVED
This set of plans and specifications must be kept on job at all times. It is unlawful to make any changes alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be a approval of the violation of any provisions of any Co Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 17-206-02 CPT-4A

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A	Limit depth applied:	No
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth:	N/A
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	MSF method:	Method based
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No		

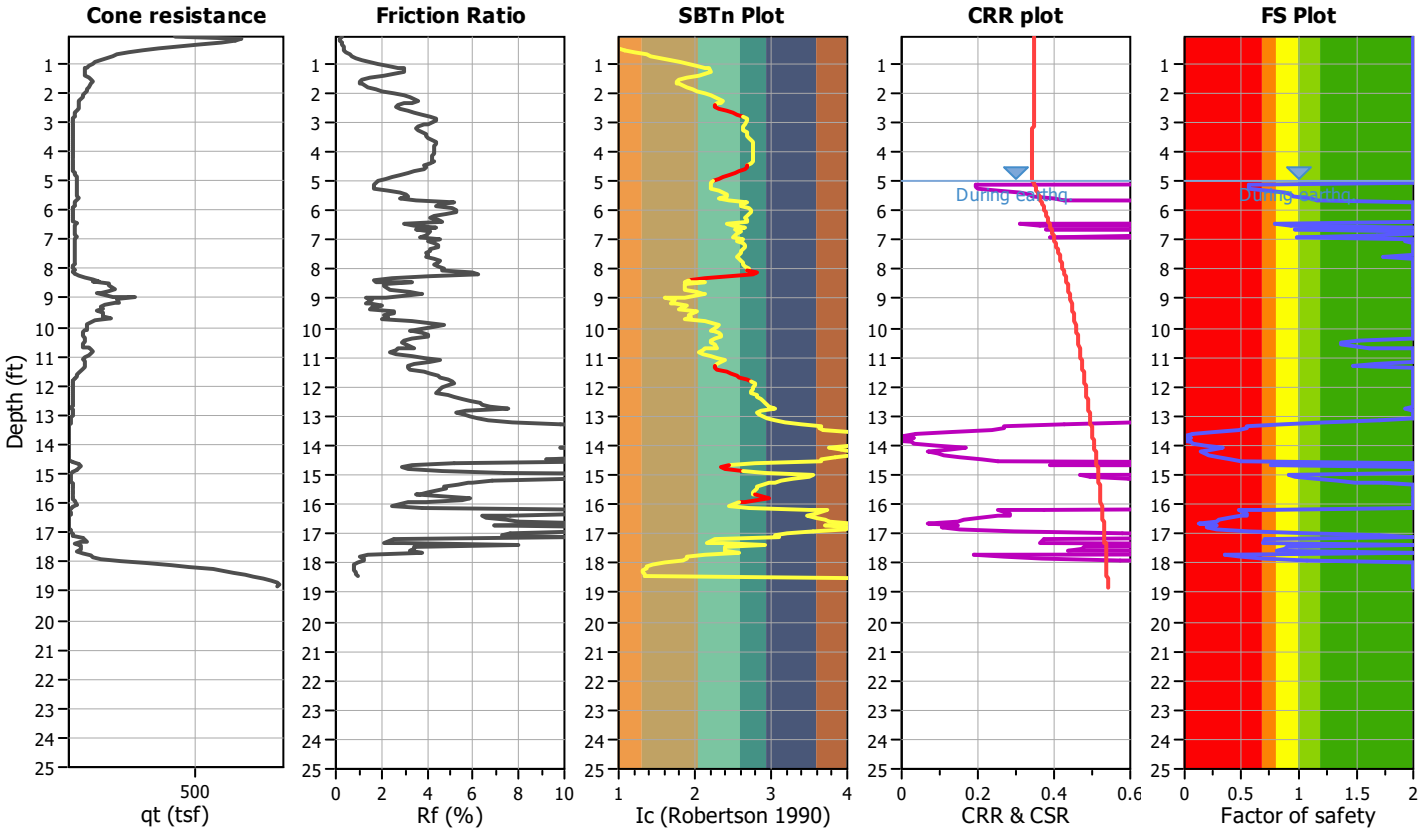

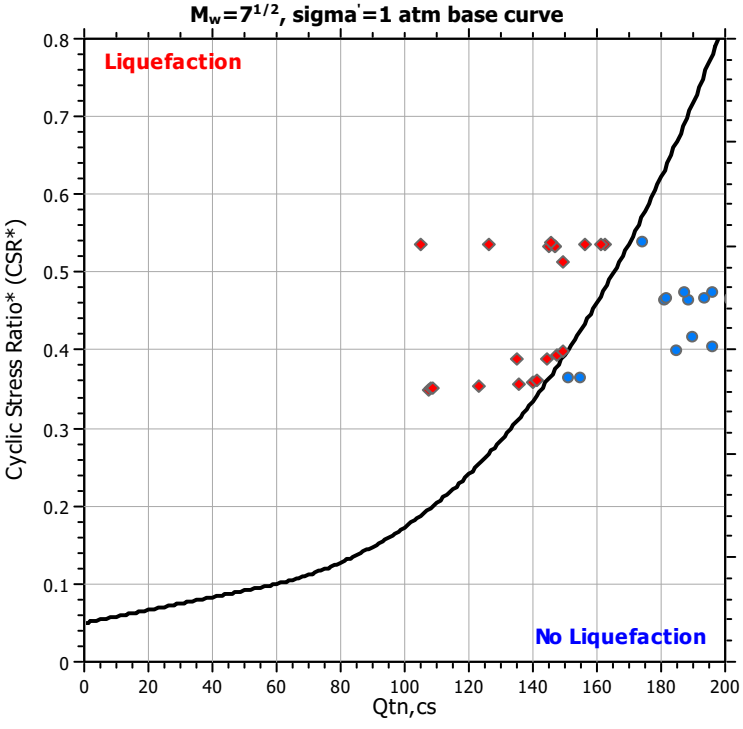

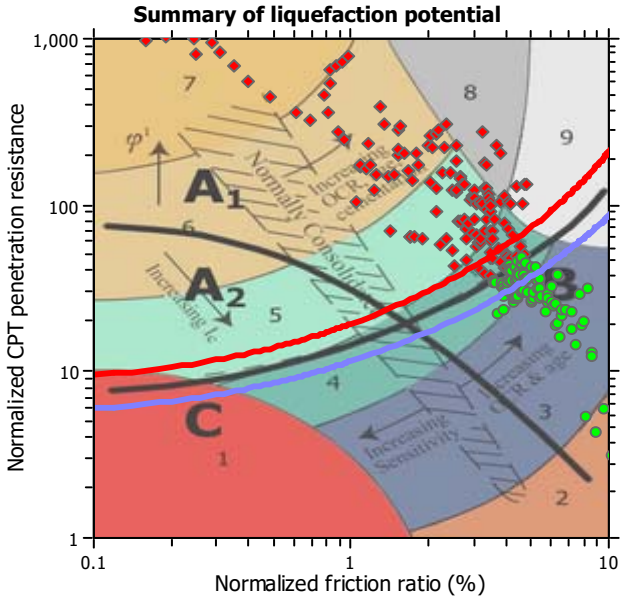

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The issuance of these plan specification is NOT to be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots

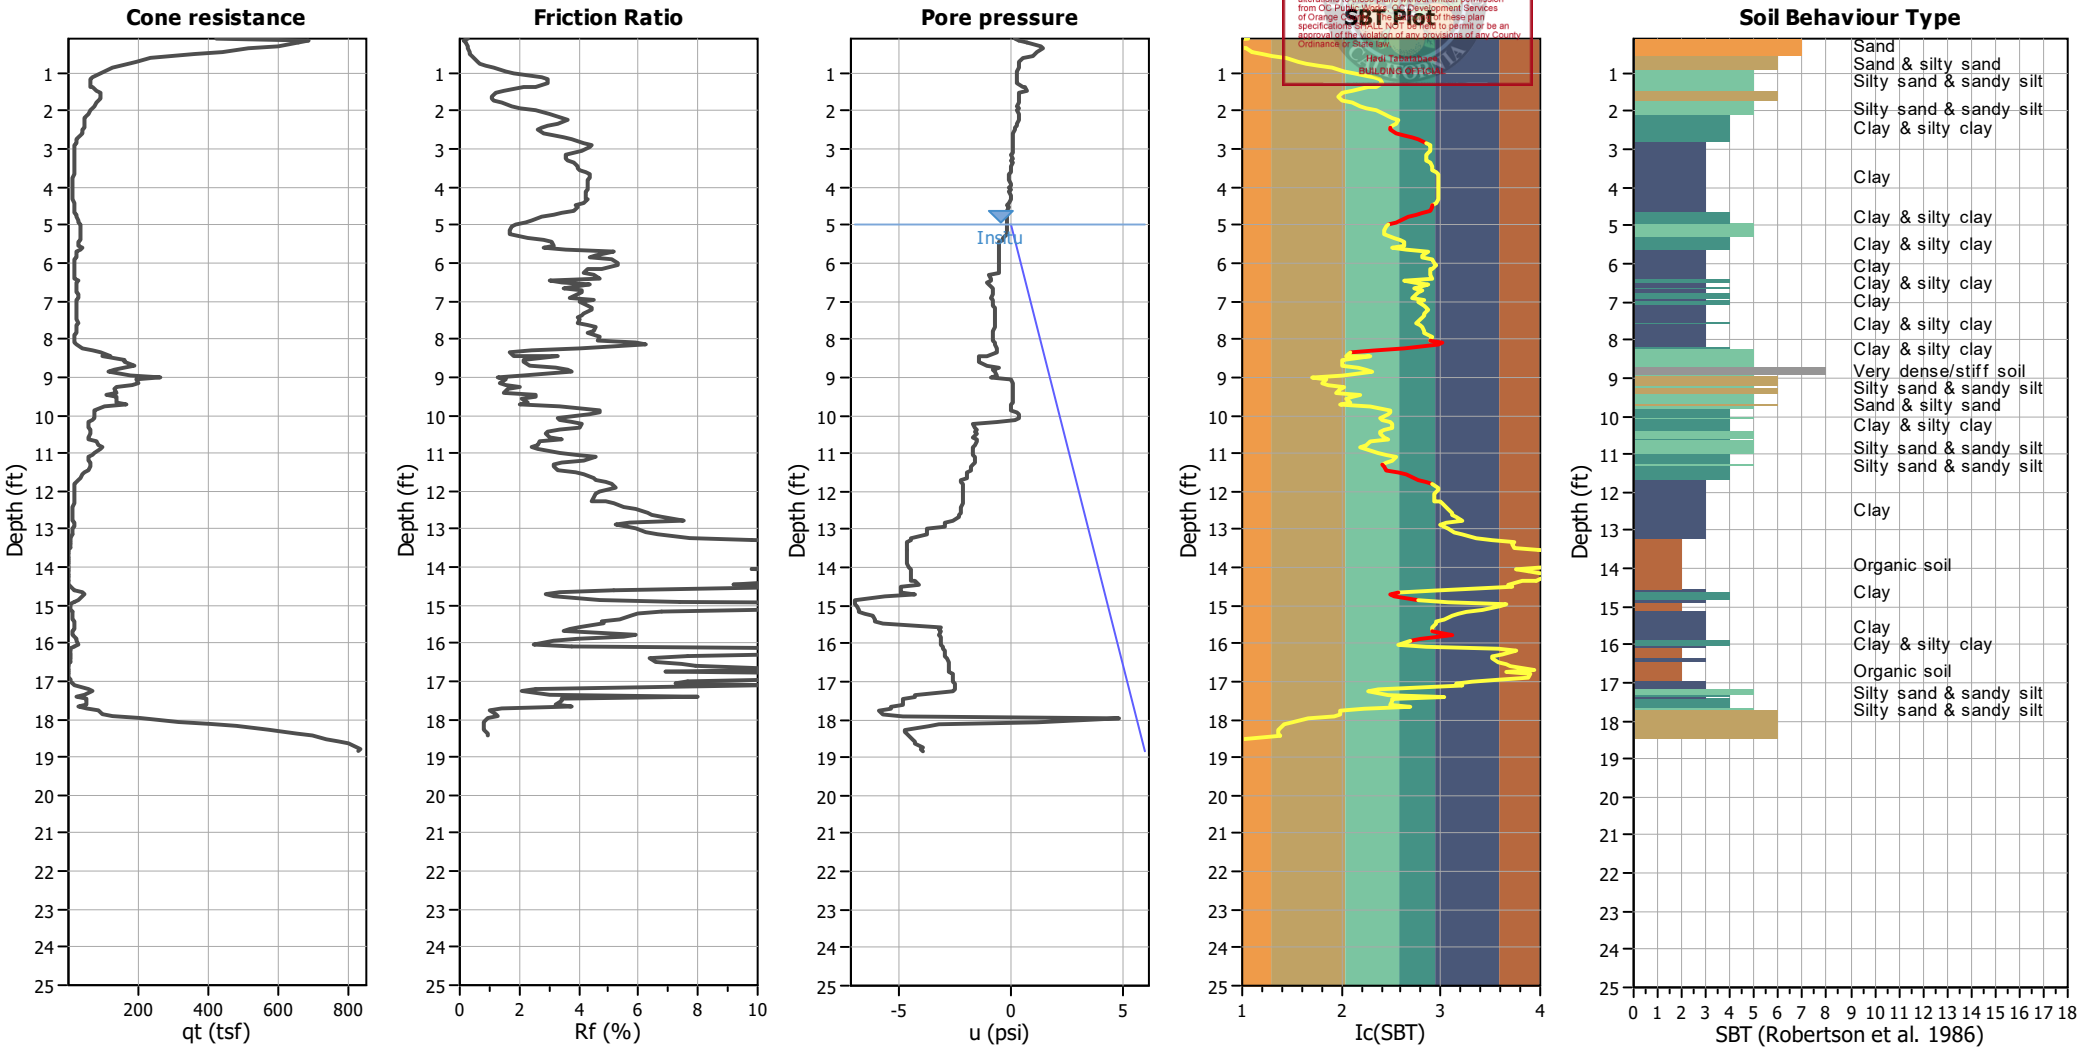

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots (normalized)

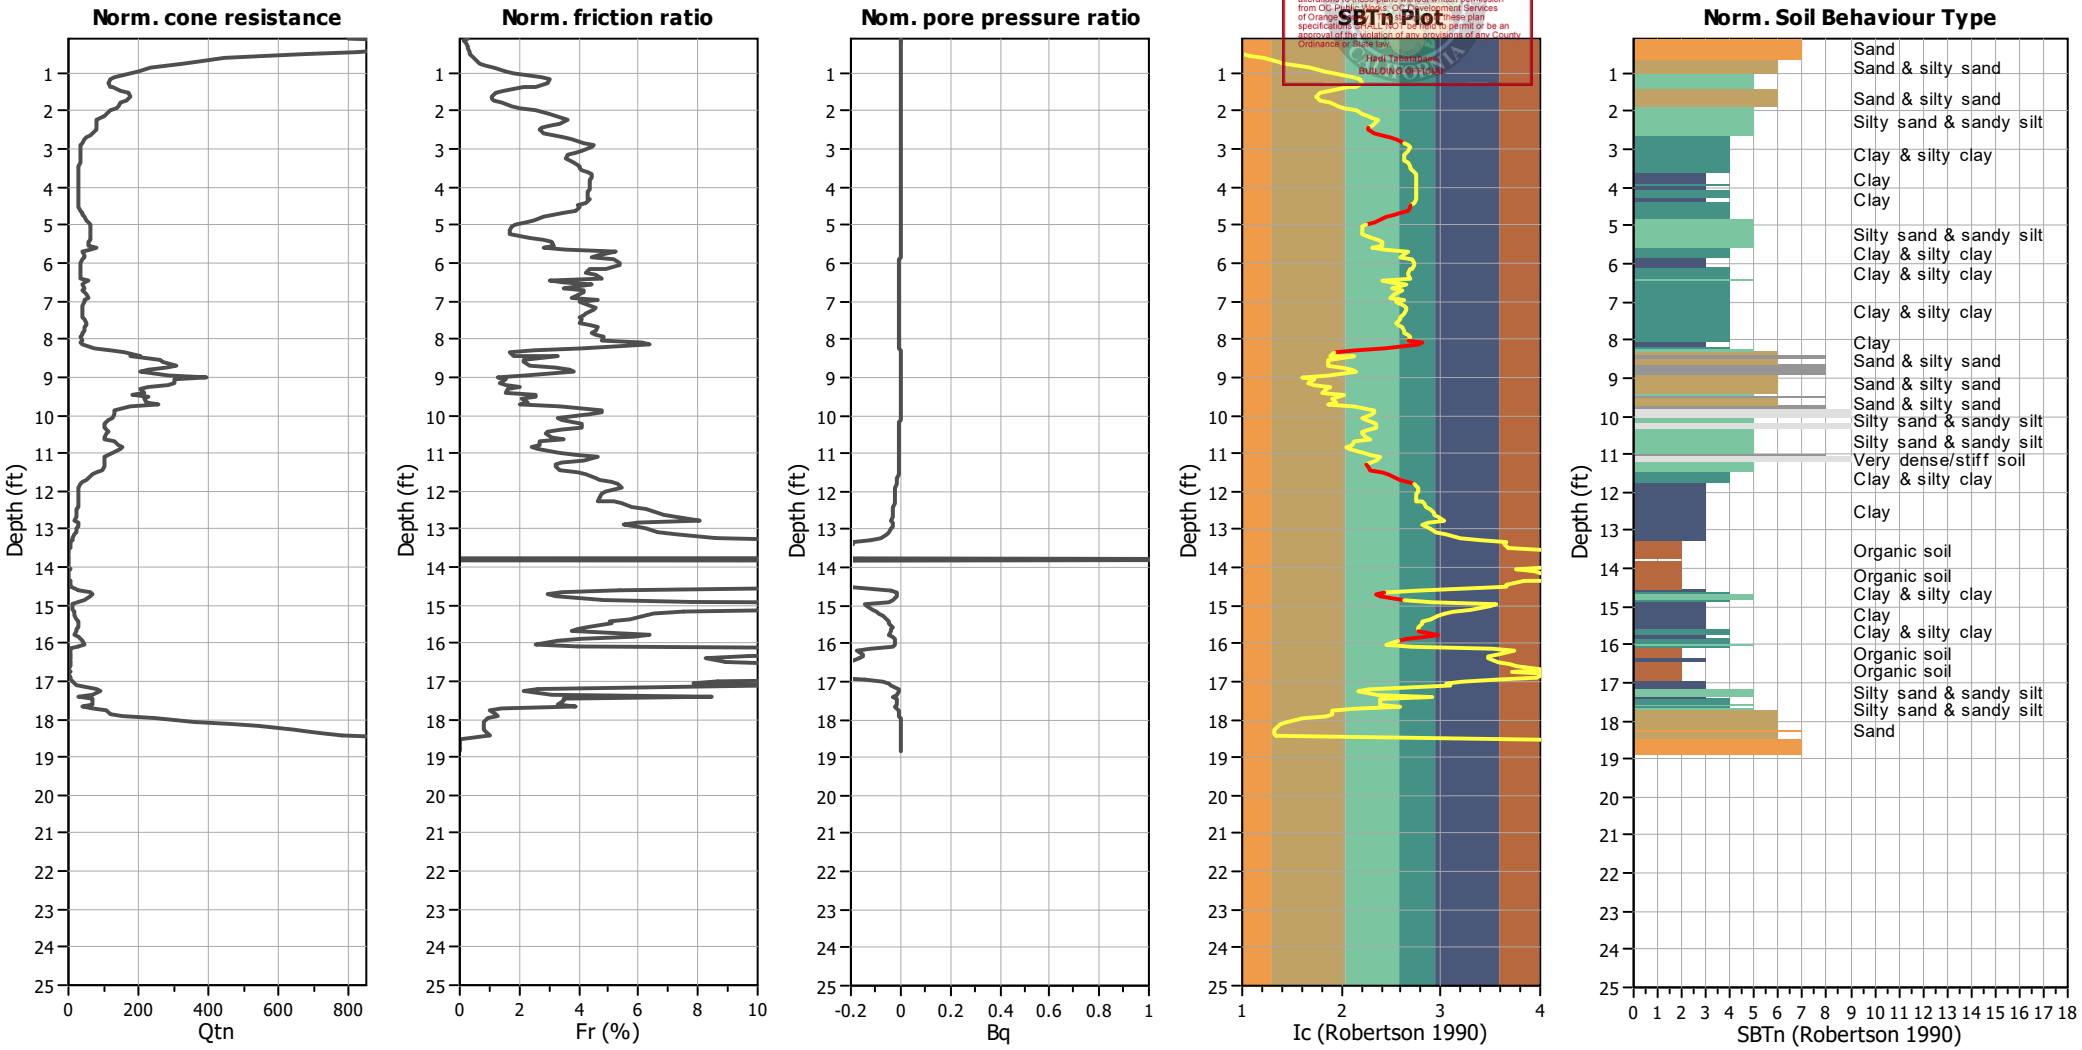

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. Approval of these plans and specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

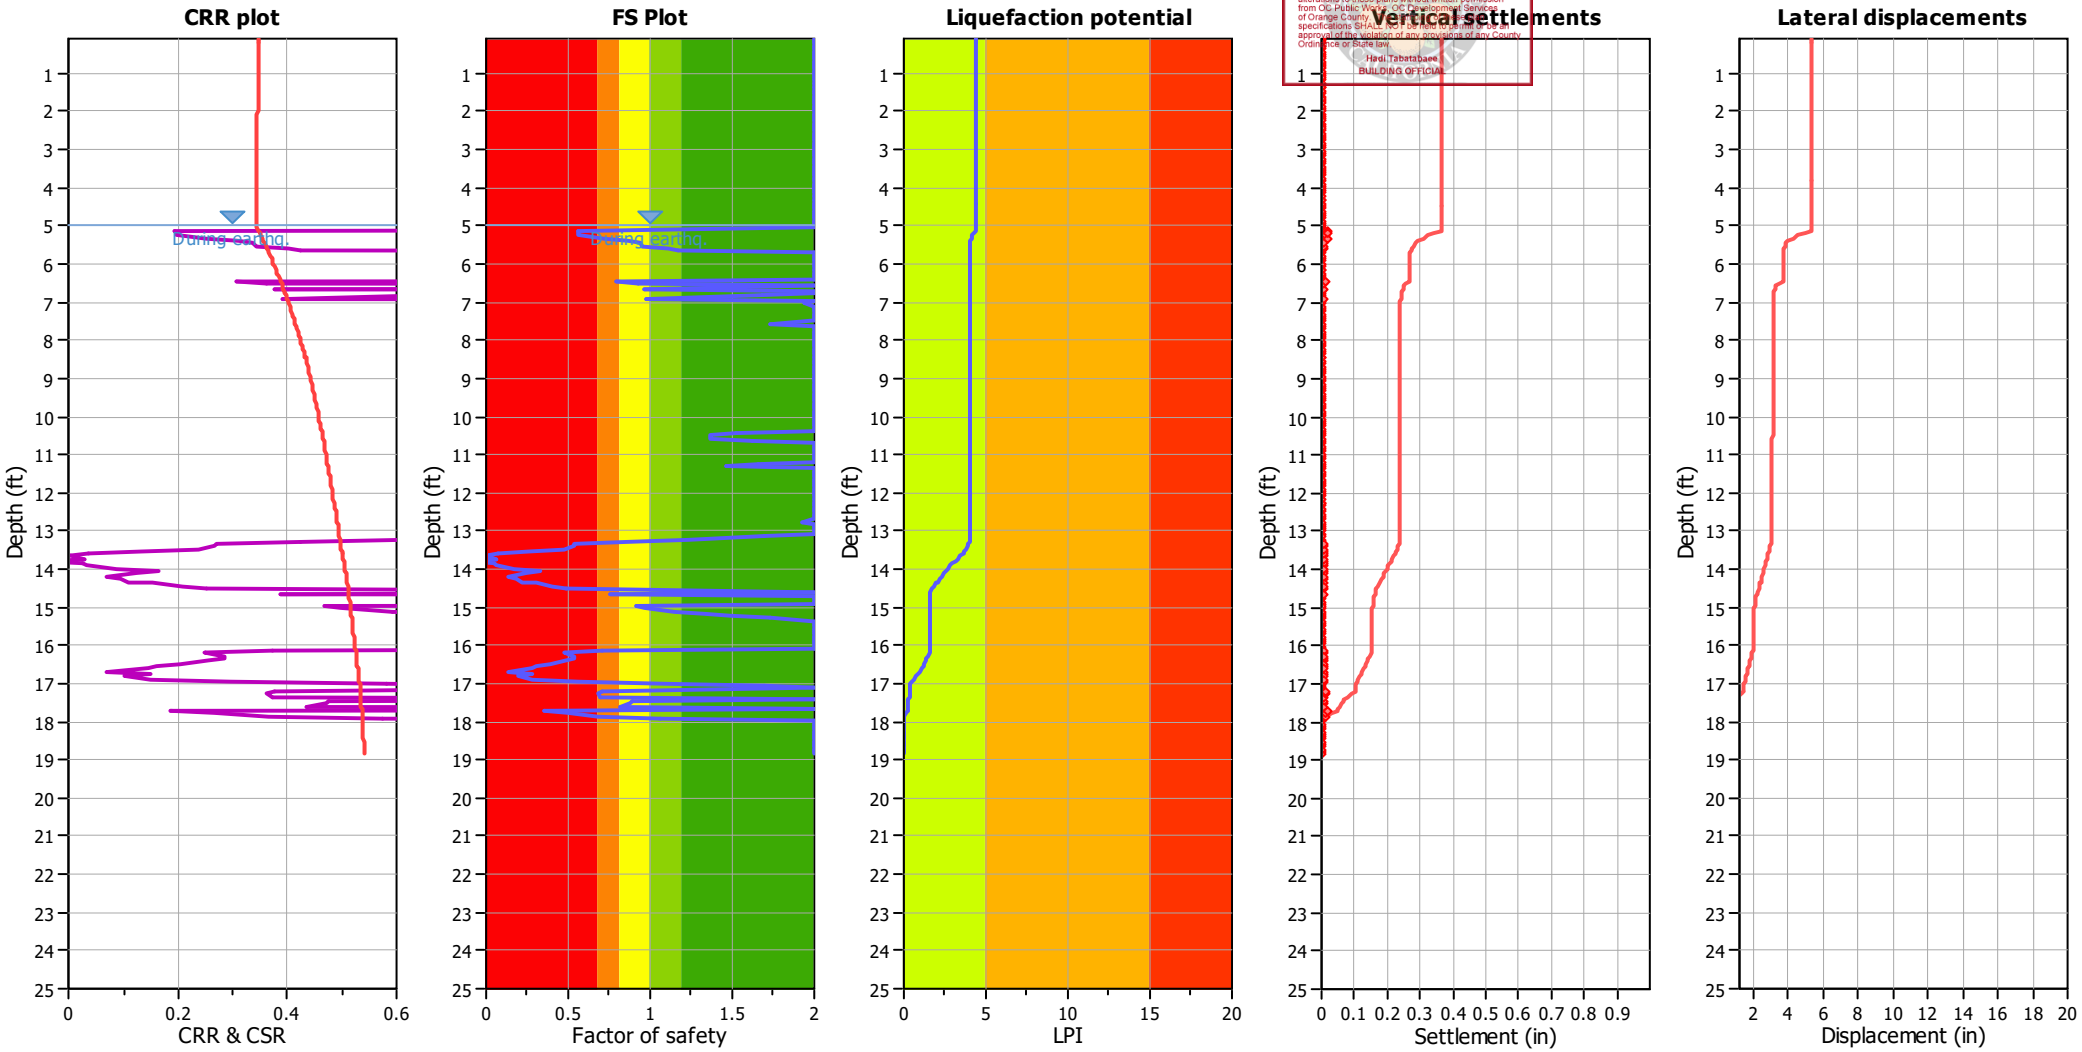

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Check for strength loss plots (Robertson (2010))

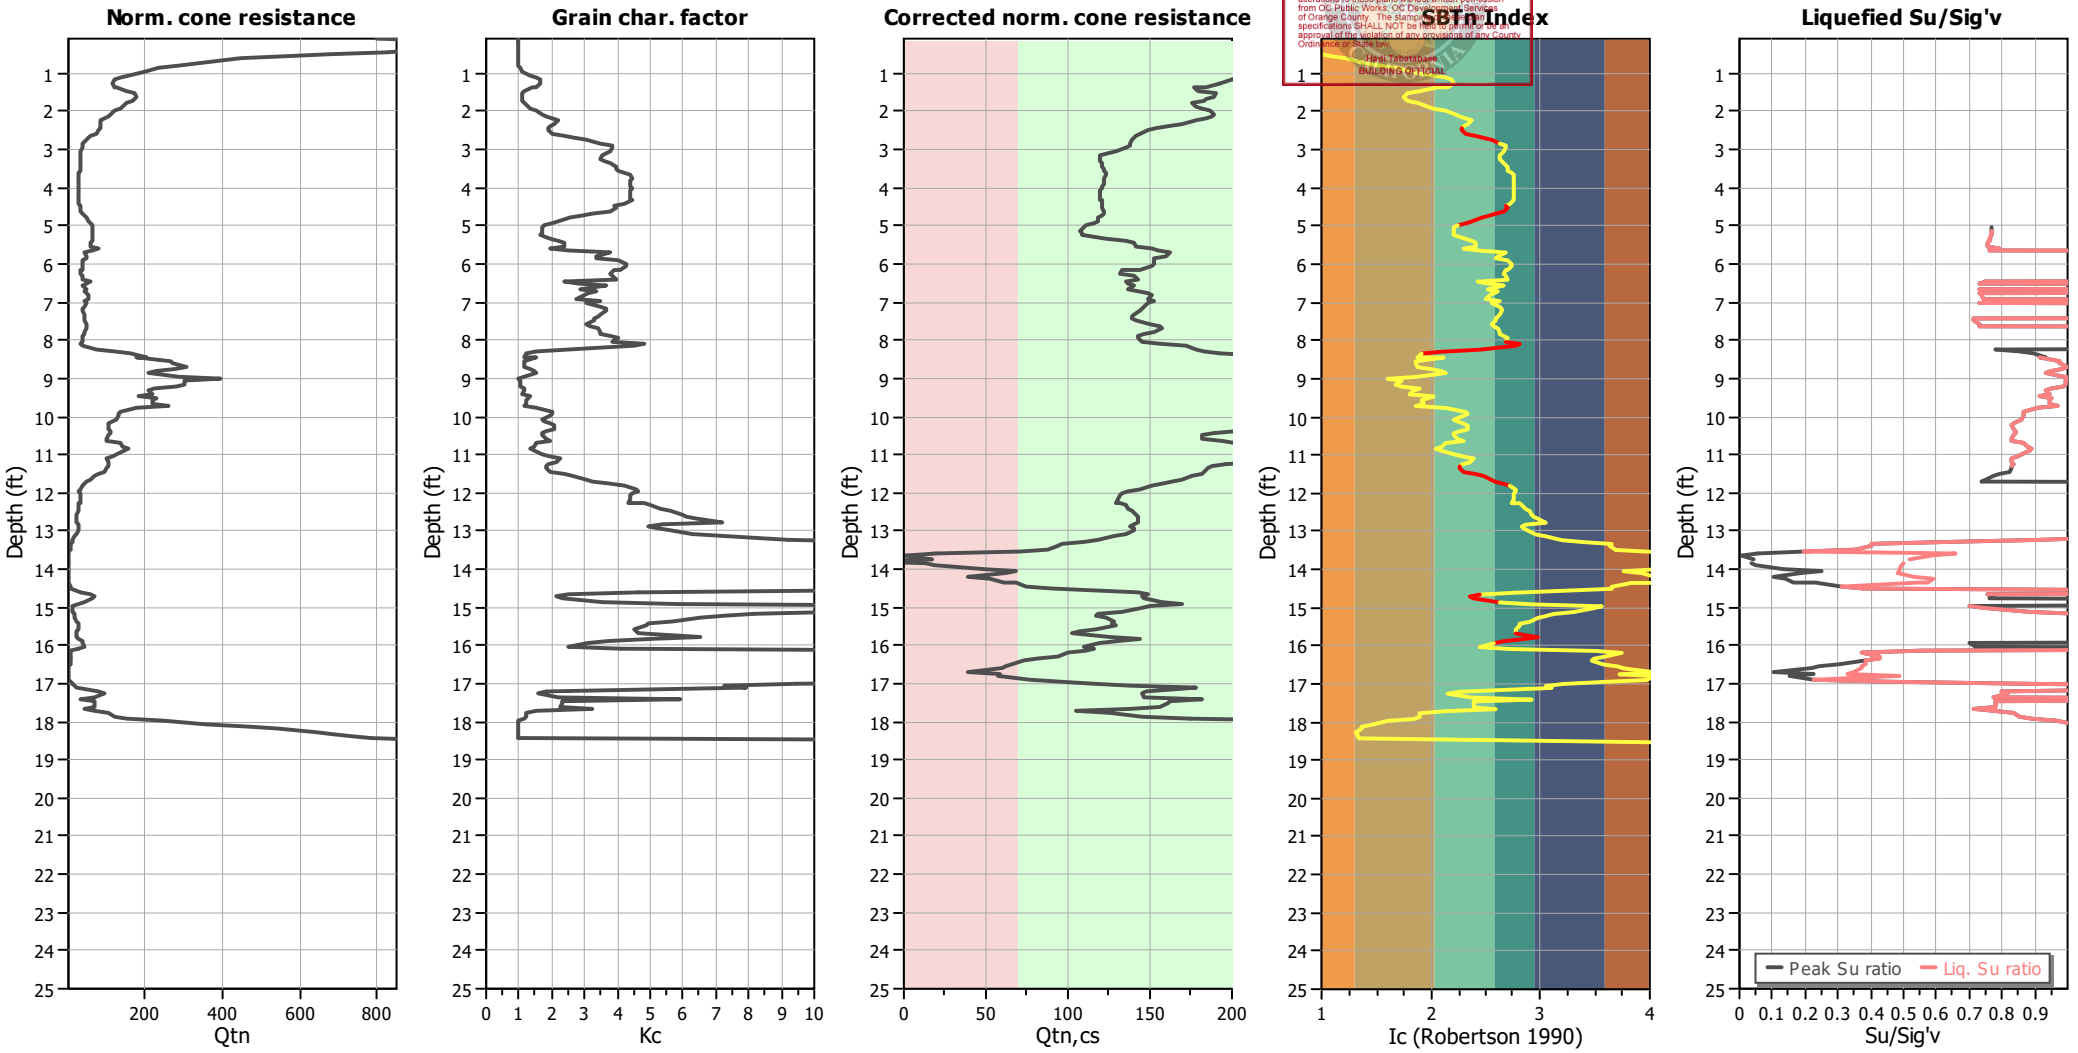

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/1
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works/ OC Development Services of Orange County. The stamping of these plans specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Jerry Tabatabaee
BUILDING OFFICIAL

GMU Geotechnical
23241 Arroyo Vista
Rancho Santa Margarita, CA 92688
http://www.gmugeo.com

LIQUEFACTION ANALYSIS REPORT

Project title : 11-161-00 **Location :**

CPT file : 17-206-02 CPT-5A

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	5.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	5.00 ft	Fill height:	N/A		
Points to test:	Based on Ic value	Average results interval:	1	Fill weight:	N/A	Limit depth applied:	No
Earthquake magnitude M_w:	6.90	Ic cut-off value:	2.60	Trans. detect. applied:	Yes	Limit depth:	N/A
Peak ground acceleration:	0.66	Unit weight calculation:	Based on SBT	K_σ applied:	No	MSF method:	Method based

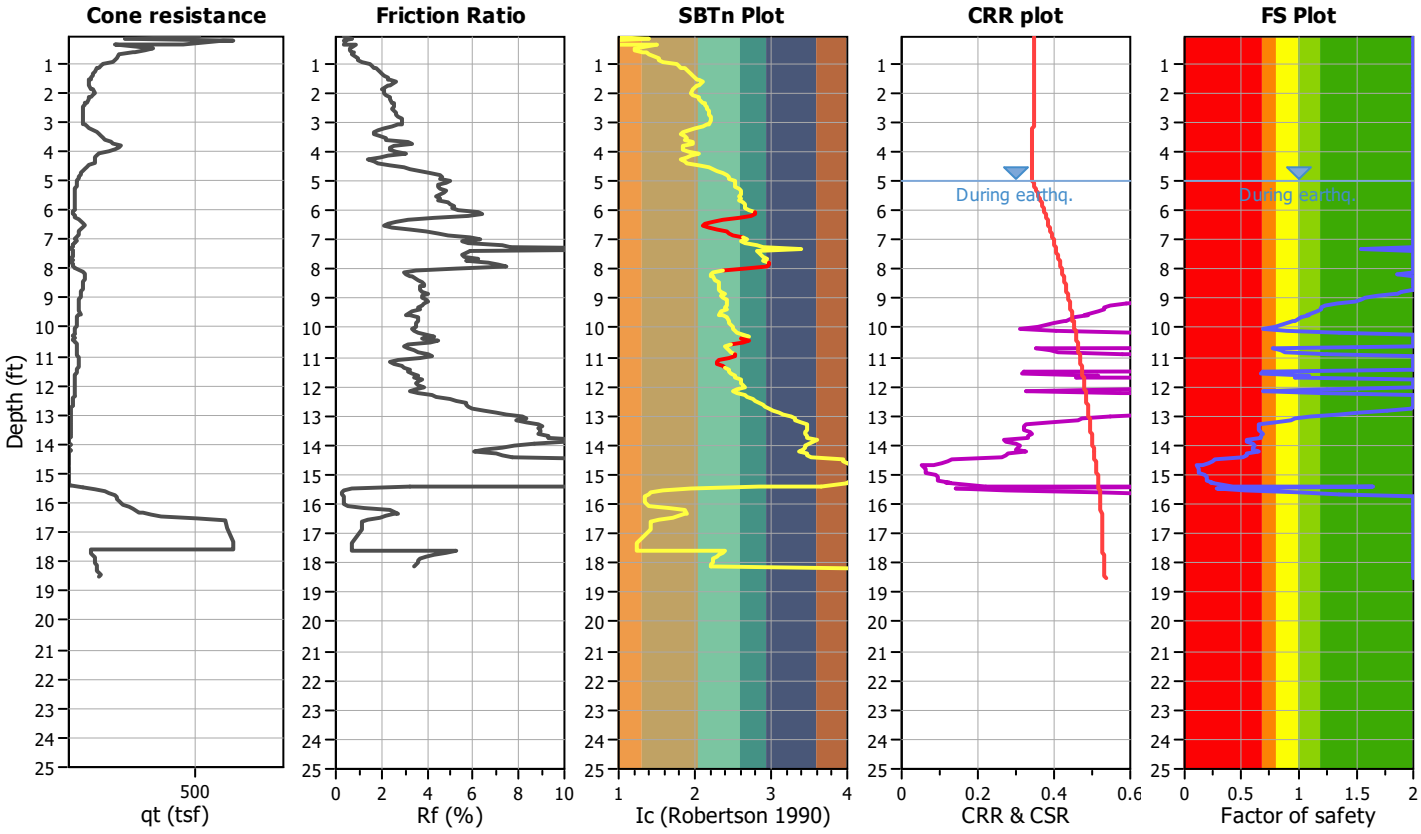

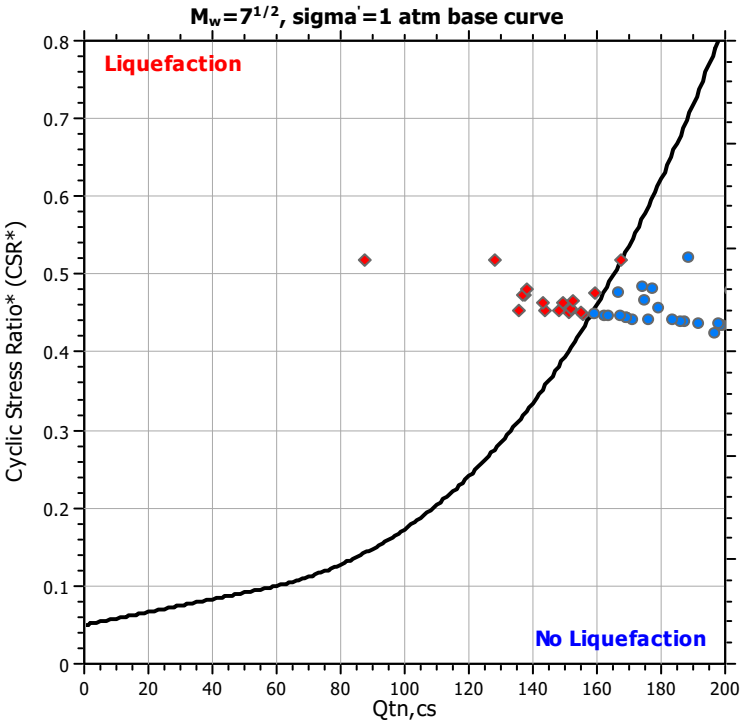

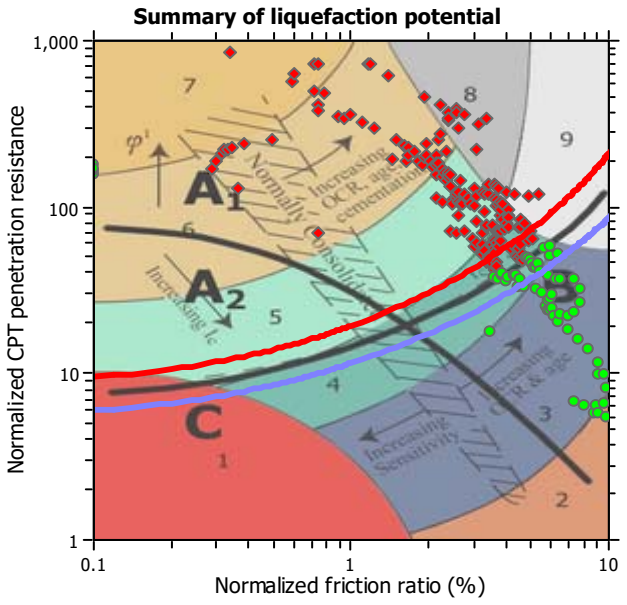

Zone A_1: Cyclic liquefaction likely depending on size and duration of cyclic loading
Zone A_2: Cyclic liquefaction and strength loss likely depending on loading and ground geometry
Zone B: Liquefaction and post-earthquake strength loss unlikely, check cyclic softening
Zone C: Cyclic liquefaction and strength loss possible depending on soil plasticity, brittleness/sensitivity, strain to peak undrained strength and ground geometry

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Onsite set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The issuance of these plan specification is SPACE NOT intended to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots

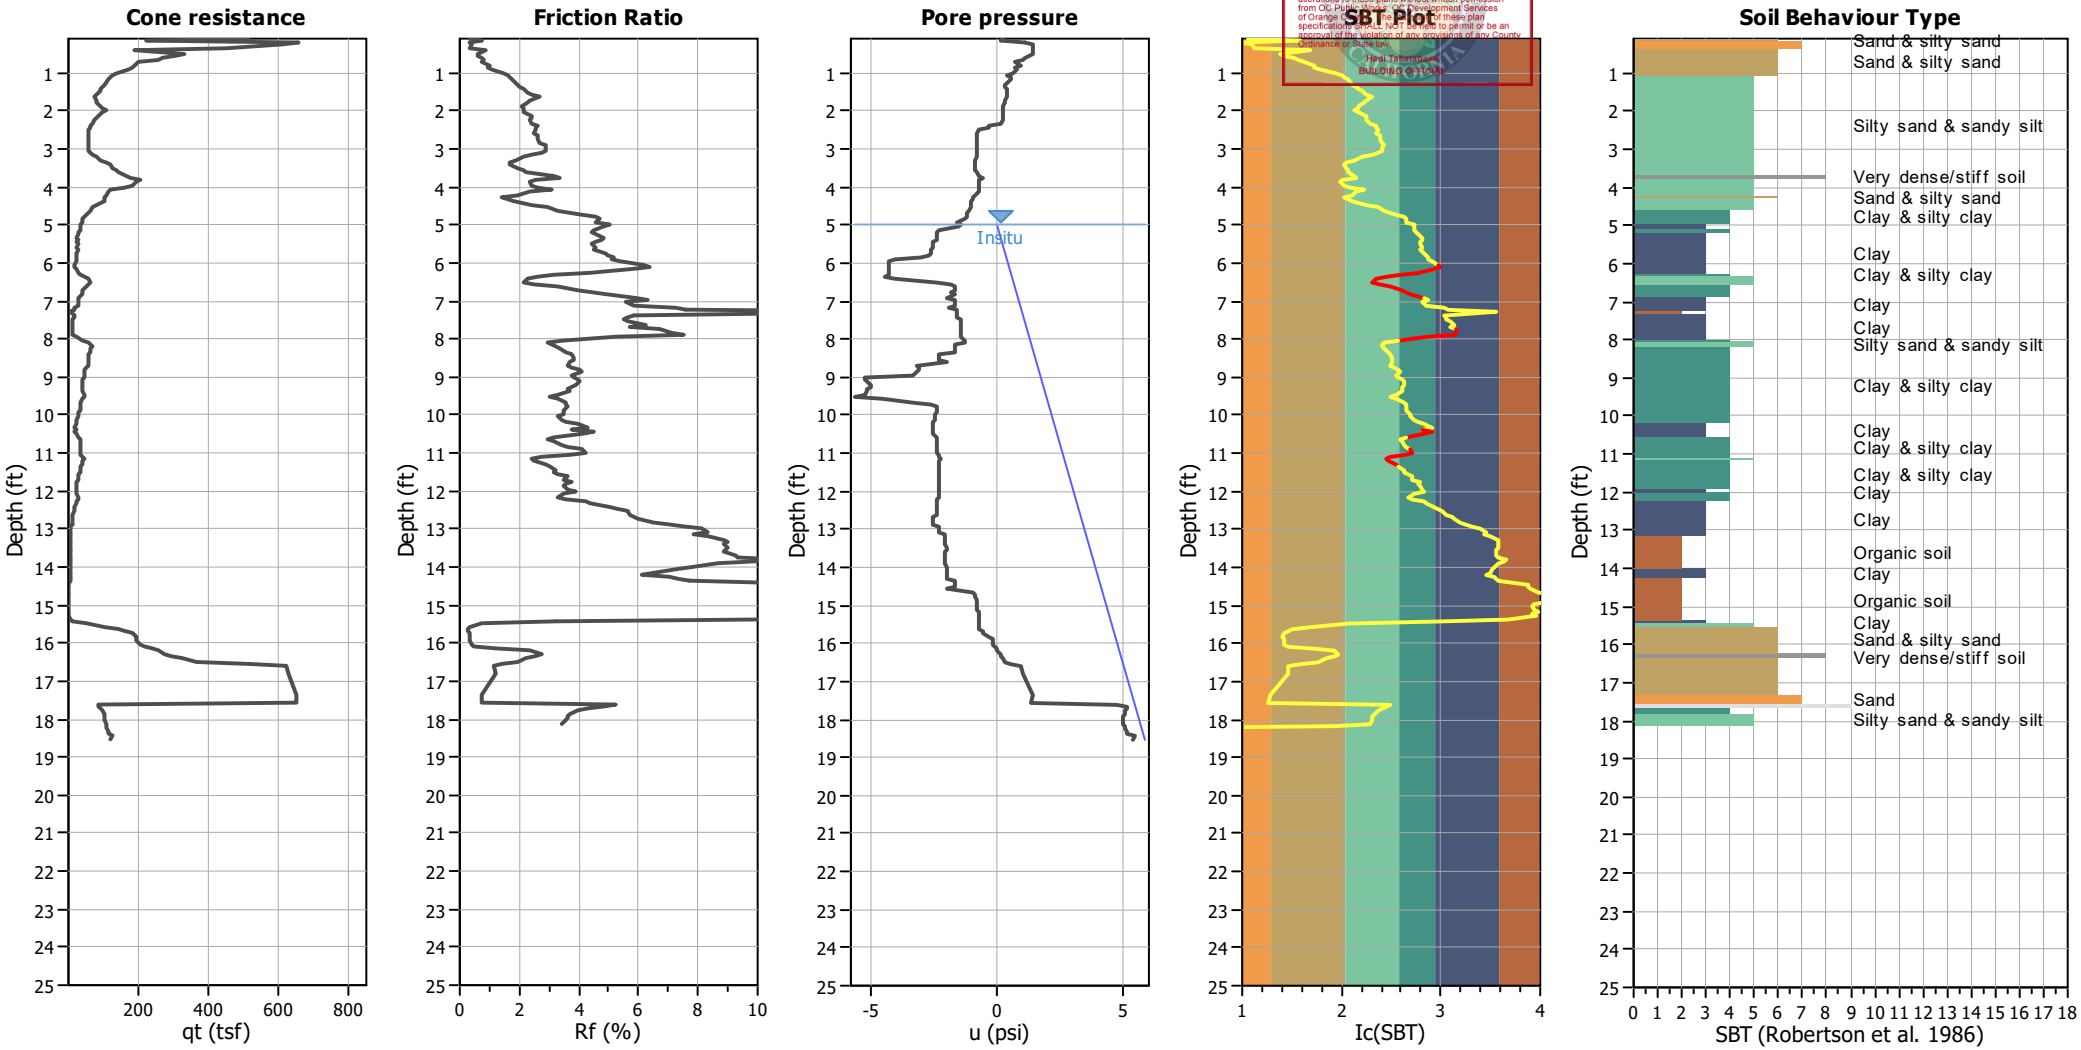

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

CPT basic interpretation plots (normalized)

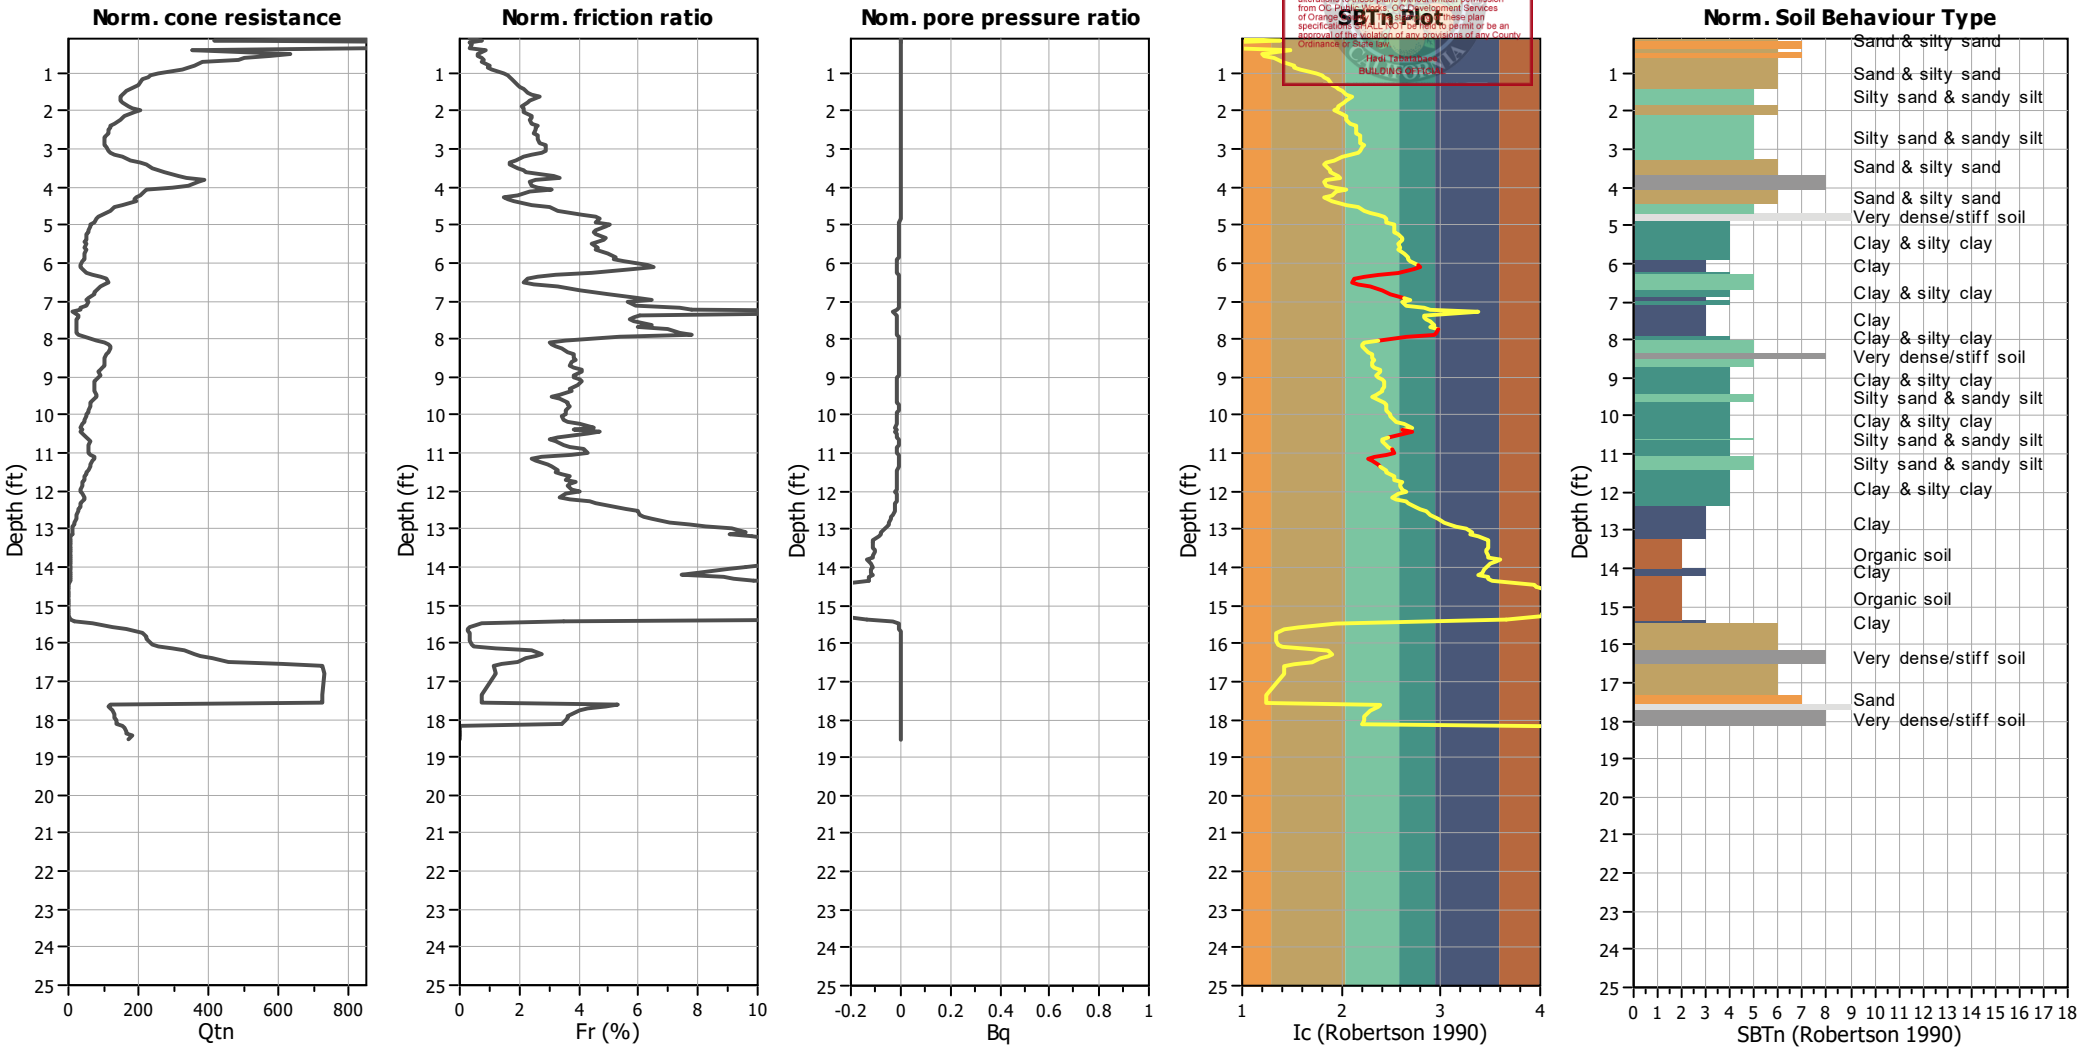

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained
2. Organic material
3. Clay to silty clay
4. Clayey silt to silty
5. Silty sand to sandy silt
6. Clean sand to silty sand
7. Gravely sand to sand
8. Very stiff sand to
9. Very stiff fine grained

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Hadi Tabatabaee
BUILDING OFFICIAL

Liquefaction analysis overall plots

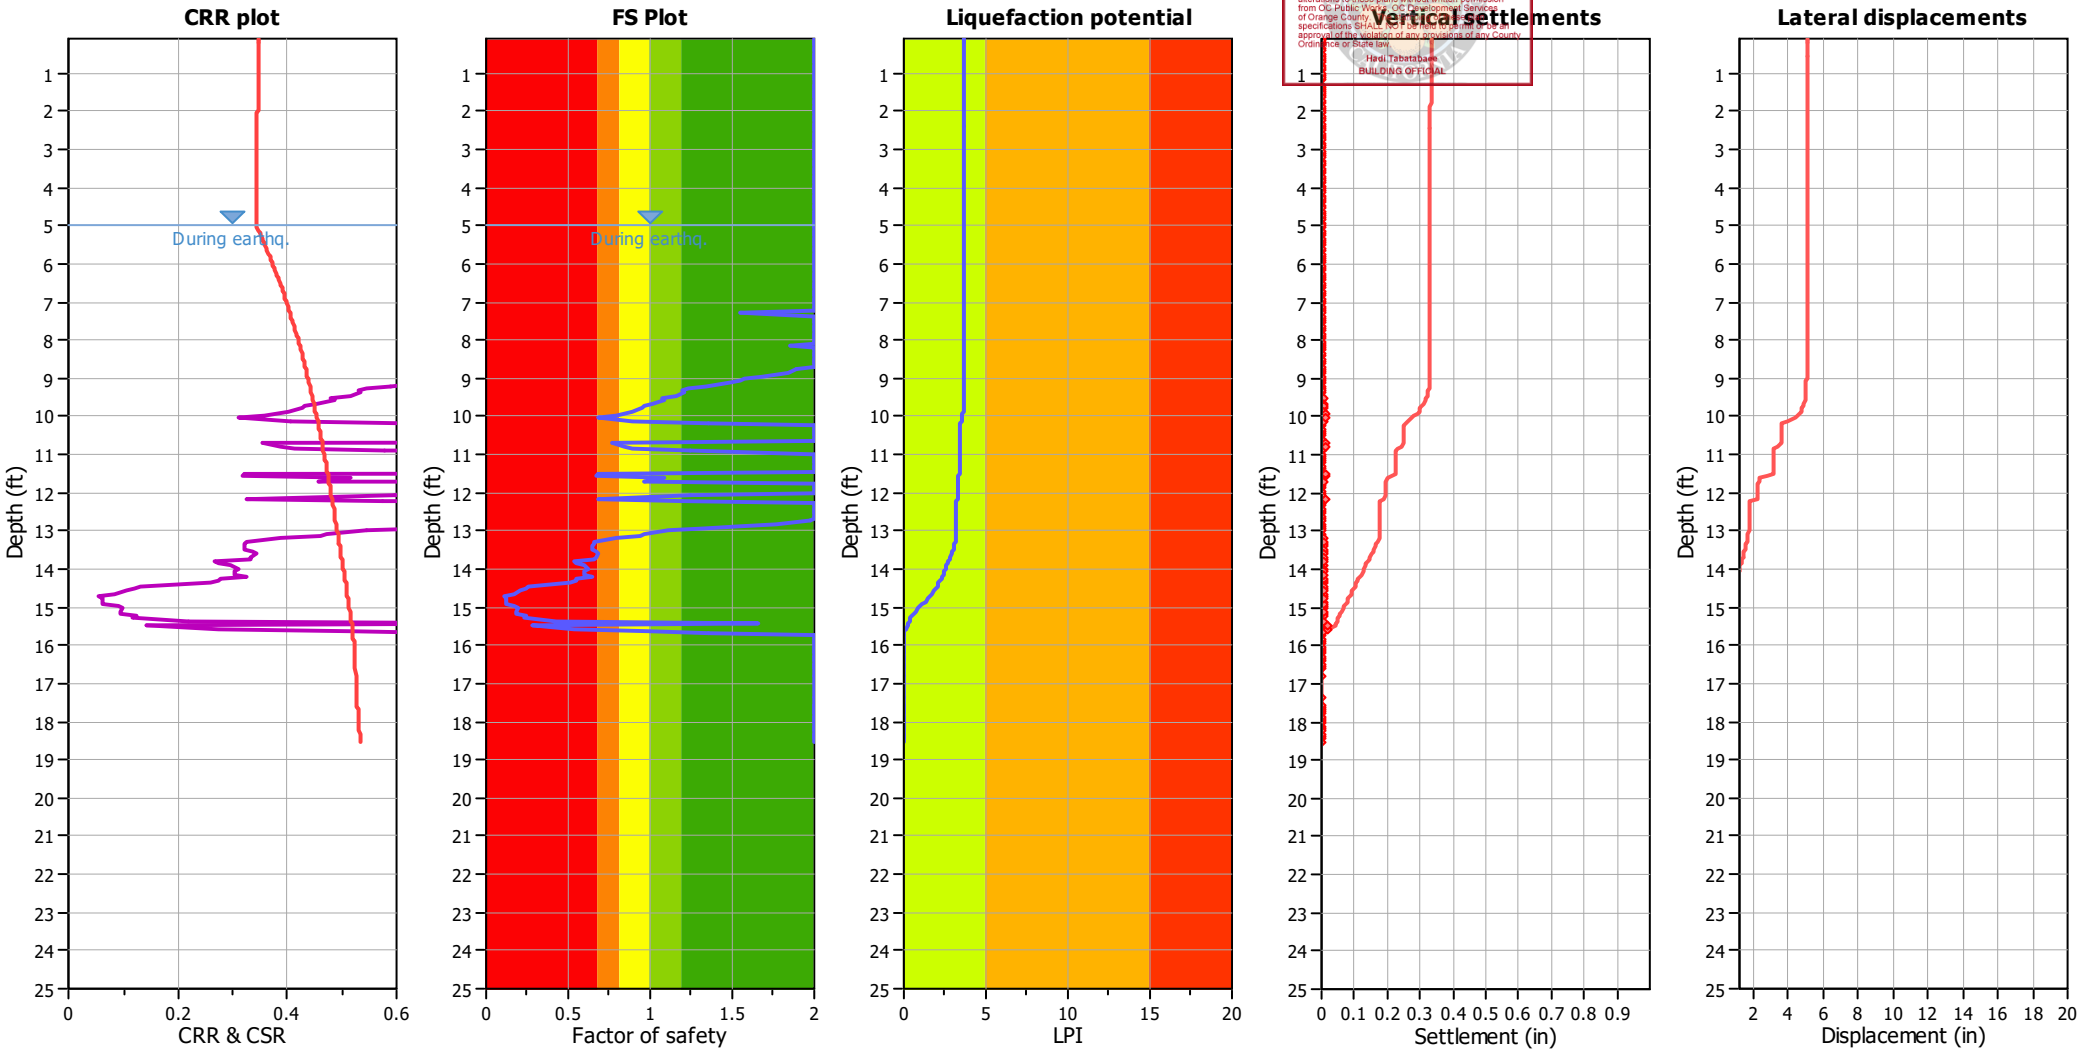

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
Jyoti Tabatabaee
BUILDING OFFICIAL

Check for strength loss plots (Robertson (2010))

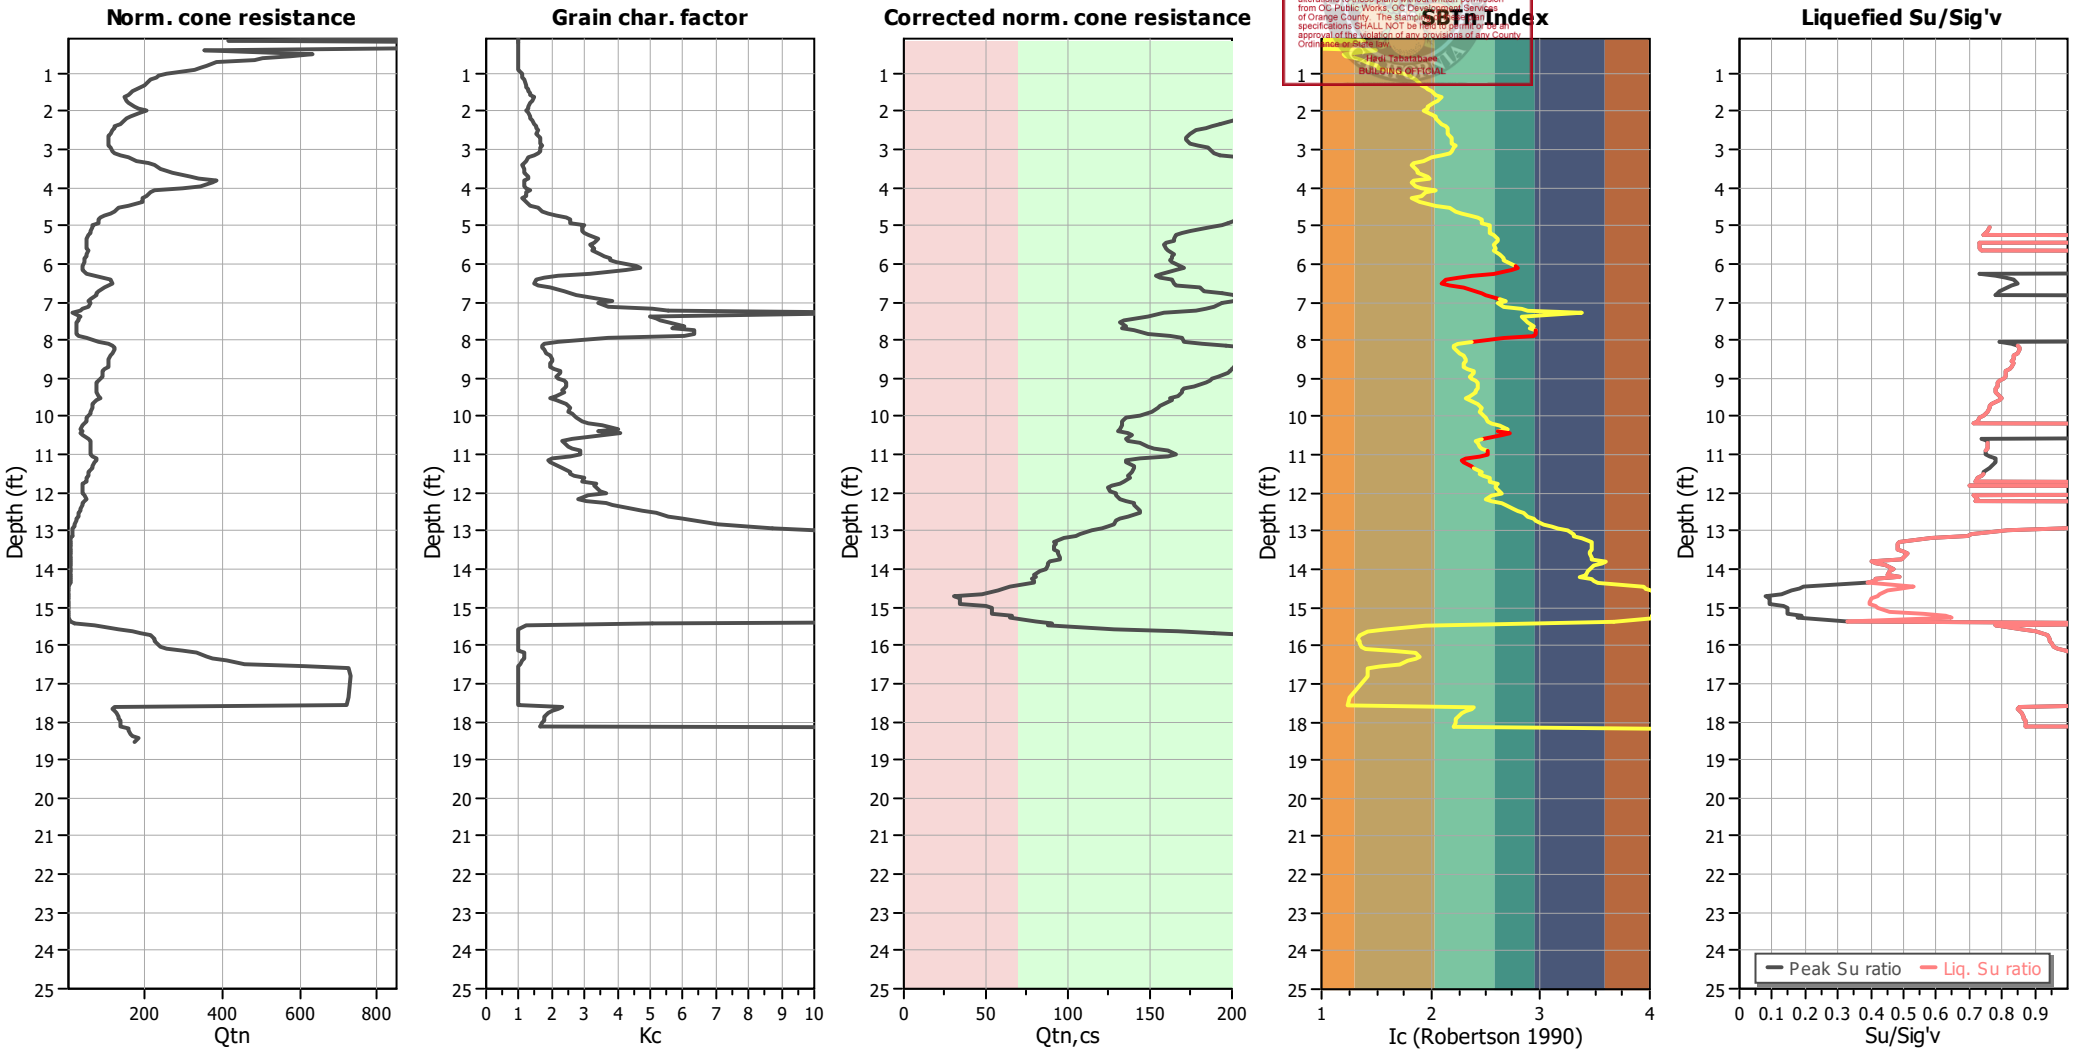

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	5.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	1	Transition detect. applied:	Yes
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_σ applied:	No
Earthquake magnitude M_w:	6.90	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.66	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	5.00 ft	Fill height:	N/A	Limit depth:	N/A

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX E

Lateral Spread Analysis

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

Project No. 17-206-02
Section A-A'
April 2021

Static Analysis, Run 1.1_s
Post Earthquake Condition
Horz Seismic Coef.: 0
Block Search

Name: Af/Qm (Peak)
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 395 psf
Phi': 31 °

Name: Af/Qm (Ultimate)
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 80 psf
Phi': 30 °

Name: Tc
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 695 psf
Phi': 34 °

Name: Liquefied 1
Model: SHANSEP
Unit Weight: 125 pcf
Tau/Sigma Ratio: 0.17

Name: Liquefied 2
Model: SHANSEP
Unit Weight: 125 pcf
Tau/Sigma Ratio: 0.1

Name: Liquefied 3
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.5

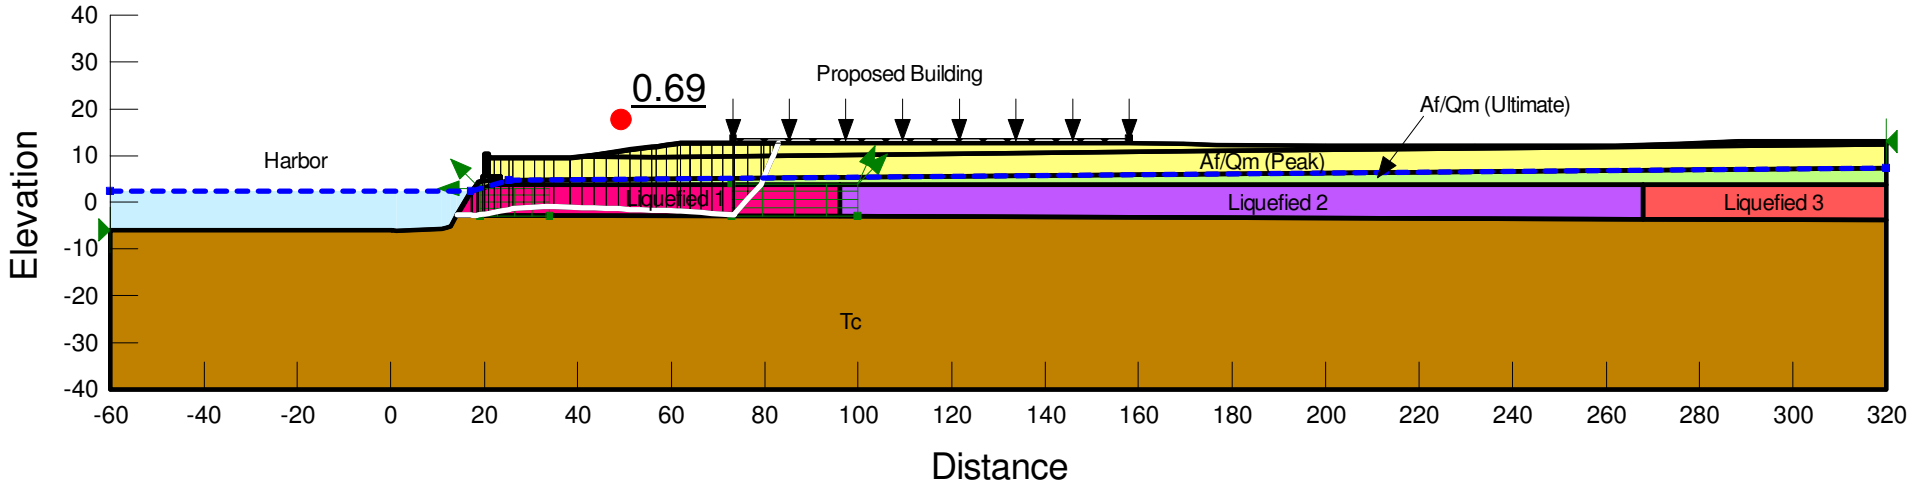

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project No. 17-206-02
Section A-A'
April 2021

Deformation Analysis, Run 1.1_ky
Post Earthquake Condition
Horz Seismic Coef.: 0.01
Block Search
Deformation > 90 inches

Name: Af/Qm (Peak)
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 395 psf
Phi': 31 °

Name: Af/Qm (Ultimate)
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 80 psf
Phi': 30 °

Name: Tc
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 695 psf
Phi': 34 °

Name: Liquefied 1
Model: SHANSEP
Unit Weight: 125 pcf
Tau/Sigma Ratio: 0.17

Name: Liquefied 2
Model: SHANSEP
Unit Weight: 125 pcf
Tau/Sigma Ratio: 0.1

Name: Liquefied 3
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.5

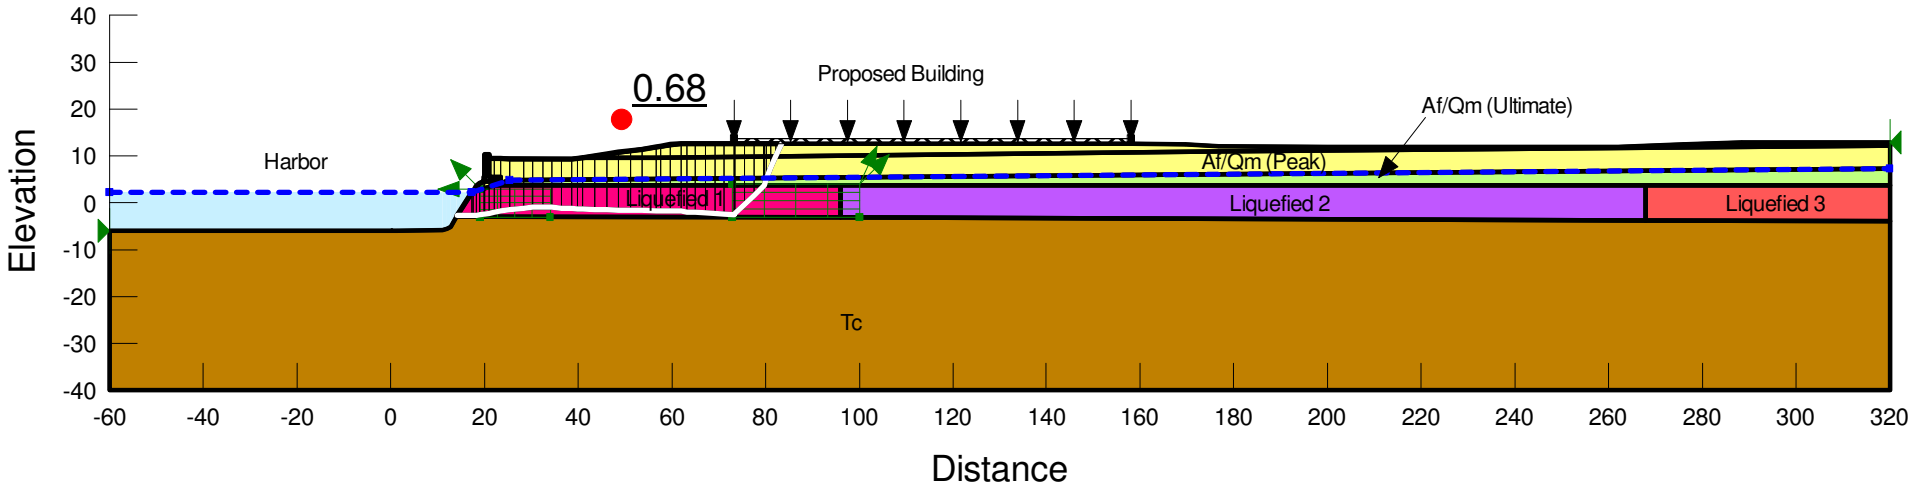

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Project No. 17-206-02 - Dana Point Harbor Revitalization - Buildings 1 through 12
Average Seismic Displacement
Block Search for ky
Liq Layer 1
MCE Event

Seismic Displacement (Bray and Travasarou) = 50% Probability of Exceedance (D2)	150.84	cm or	59.39	inch
1cm = 0.393701 in.				
Seismic Displacement (Rathje and Antonakos) = [kmax, k-velmax]	302.13	cm	118.95	inch
Average Displacement =	226.49	cm	89.17	inch

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DATA FOR SEISMIC SLOPE DISPLACEMENT ANALYSES

Project: 17-206-02 Dana Point Harbor - Section A-A' Liq1 (Based on 11-161-00 CPT-5)

INPUT:

Slide h (ft):	12.00
Slide Vs (ft/sec):	837.99
Depth to Rx (km):	0.01
Ave. Vs(30) (m/s):	360
Ave. Site Class:	C
Mean Magnitude:	6.80
Mean Dist. (km):	7.4
ky:	0.01

RESULTS:

Site Period, Ts (sec):	0.0573
1.5*Site Per. (sec):	0.0859
EQ Mean Period, Tm (sec):	0.472
Ts/Tm:	0.12
Estimated PGV (cm/sec):	91.37
Duration (D_5-D_{95}) (sec):	13.2
Sa(1.5Ts) Min $Vs_{(30)}$	0.0000
Sa(1.5Ts) Ave $Vs_{(30)}$	1.3856
Sa(1.5Ts) Max $Vs_{(30)}$	0.0000

5-Percent Damped Spectra

Period	Min. $Vs_{(30)}$	Ave. $Vs_{(30)}$	Max. $Vs_{(30)}$
0.01		0.6660	
0.1		1.5190	
0.2		1.5190	
0.3		1.5190	
0.5		1.3640	
1.0		0.6820	
2.0		0.34100	
3.0		0.22700	
4.0		0.17100	
5.0		0.13600	

Ts: 4h/Vs
Tm: Rathje et al. (2004)
PGV: Watson-Lamprey and Abrahamson (2006)
Duration: Bommer et al. (2009)

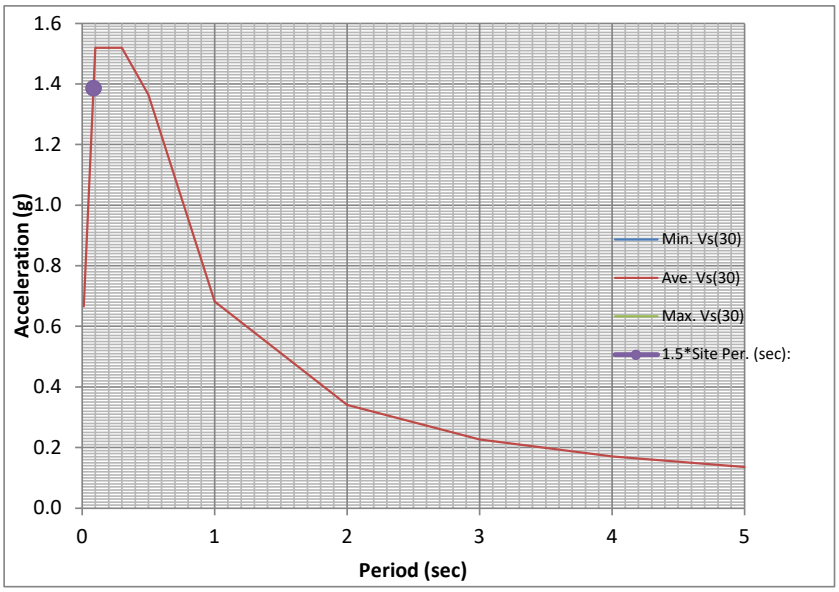

Slide Mass Area =	940
Lengh of Slide Mass =	80
Average Slide H (ft) =	11.75

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Simplified Procedure for Estimating Earthquake Induced Deviatoric Slope Displacements

by Jonathan D. Bray and Thaleia Travasarou

Journal of Geotechnical and Geonvironmental Engineering, ASCE, V. 133(4), pp. 381-392, April 2007

SEE NOTES BELOW FOR GUIDANCE IN THE USE OF SPREADSHEET

Input Parameters			
Yield Coefficient (ky)	0.01		Based on pseudostatic analysis
Initial Fundamental Period (Ts)	0.0573	seconds	1D: Ts=4H/Vs 2D: Ts=2.6H/Vs
Degraded Period (1.5Ts)	0.09	seconds	
Moment Magnitude (Mw)	6.8		
Spectral Acceleration (Sa(1.5Ts))	1.385552	g	

Additional Input Parameters		
Probability of Exceedance #1 (P1)	84	%
Probability of Exceedance #2 (P2)	50	%
Probability of Exceedance #3 (P3)	16	%
Displacement Threshold (d_threshold)	30	cm

Intermediate Calculated Parameters			
Non-Zero Seismic Displacement Est (D)	150.84	cm	eq. (5) or (6)
Standard Deviation of Non-Zero Seismic D	0.66		

Results			
Probability of Negligible Displ. (P(D=0))	0.00		eq. (3)
D1	78.2	cm	calc. using eq. (7)
D2	150.8	cm	calc. using eq. (7)
D3	290.8	cm	calc. using eq. (7)
P(D>d_threshold)	0.99		eq. (7)

Notes

1. Values highlighted in blue are input parameters, and results are presented in the table with the yellow heading.
2. Probability of Exceedance is the desired probability of exceeding a particular displacement value.
3. Displacements D1, D2, and D3 correspond to P1, P2, and P3, respectively.
   (e.g., the probability of exceeding displacement D1 is P1)
4. The 16%, 50%, and 84% percentile displacement values at selected ky values are shown to the right.
5. Calculated seismic displacements are due to deviatoric deformation only (add in volumetrically induced movement).
6. ky may range between 0.01 and 0.5, Ts between 0 and 2 s, Sa between 0.002 and 2.7 g, M between 4.5 and 9
7. Rigid slope is assumed for Ts < 0.05 s
8. When a value for D is not calculated, D is < 1cm
9. ky may be estimated using the simplified equations shown below.
10. Examples of how Ts is estimated are shown below.
11. Vs = weighted avg. shear wave velocity for the sliding mass, e.g., for 2 layers, Vs = [(h1)(Vs1) + (h2)(Vs2)]/(h1 + h2)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

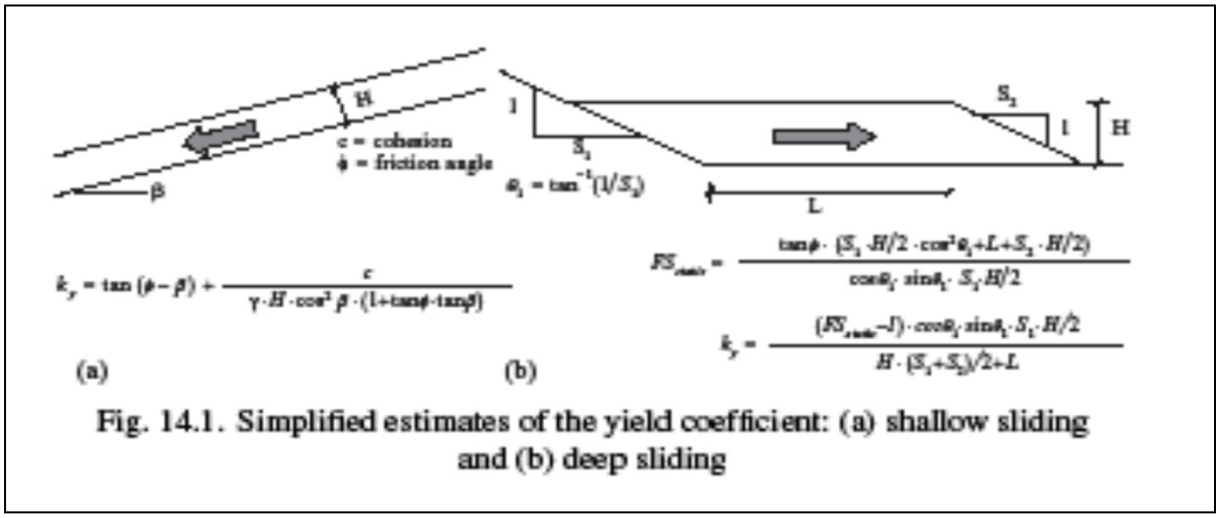

Fig. 14.1. Simplified estimates of the yield coefficient: (a) shallow sliding and (b) deep sliding

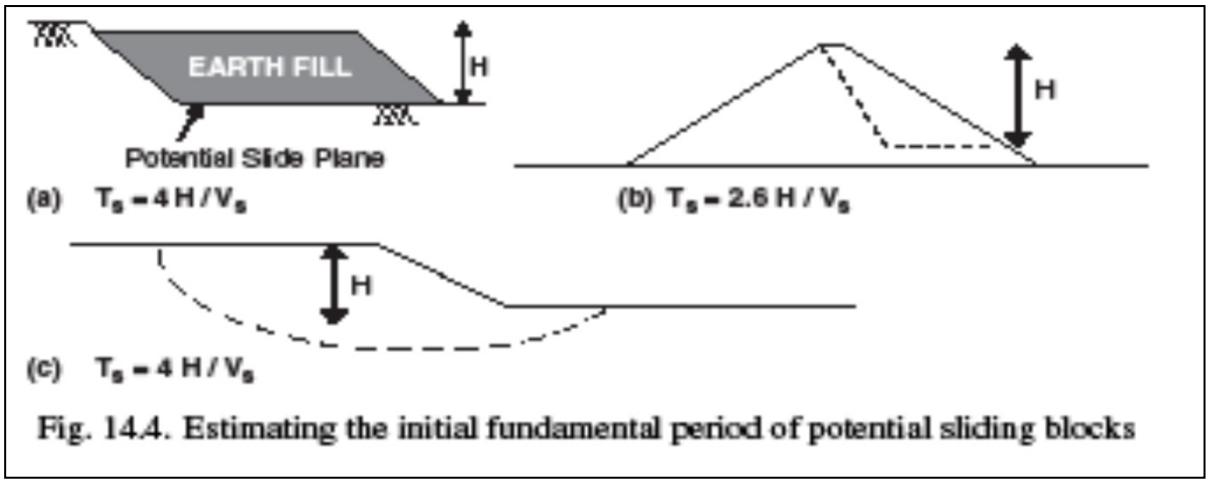

Fig. 14.4. Estimating the initial fundamental period of potential sliding blocks

Figures from Bray, J.D. (2007) “Chapter 14: Simplified Seismic Slope Displacement Procedures,” Earthquake Geotechnical Engineering, 4th Inter. Conf. on Earthquake Geotechnical Engineering - Invited Lectures, in Geotechnical, Geological, and Earthquake Engineering Series, Vol. 6, Pitilakis, Kyriazis D., Ed., Springer, Vol. 6, pp. 327-353.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Dependence on ky

ky	P(D="0")	D (cm)	Dmedian (cm)	D-84% (cm)	D-16% (cm)
0.020	0.00	172.2	172.2	331.9	89.3
0.05	0.00	125.5	125.5	241.9	65.1
0.07	0.00	97.1	97.1	187.2	50.4
0.1	0.00	68.1	68.1	131.3	35.3
0.15	0.00	41.1	41.1	79.2	21.3
0.2	0.00	26.9	26.9	51.8	13.9
0.3	0.00	13.4	13.4	25.9	7.0
0.4	0.01	7.7	7.6	14.8	3.9

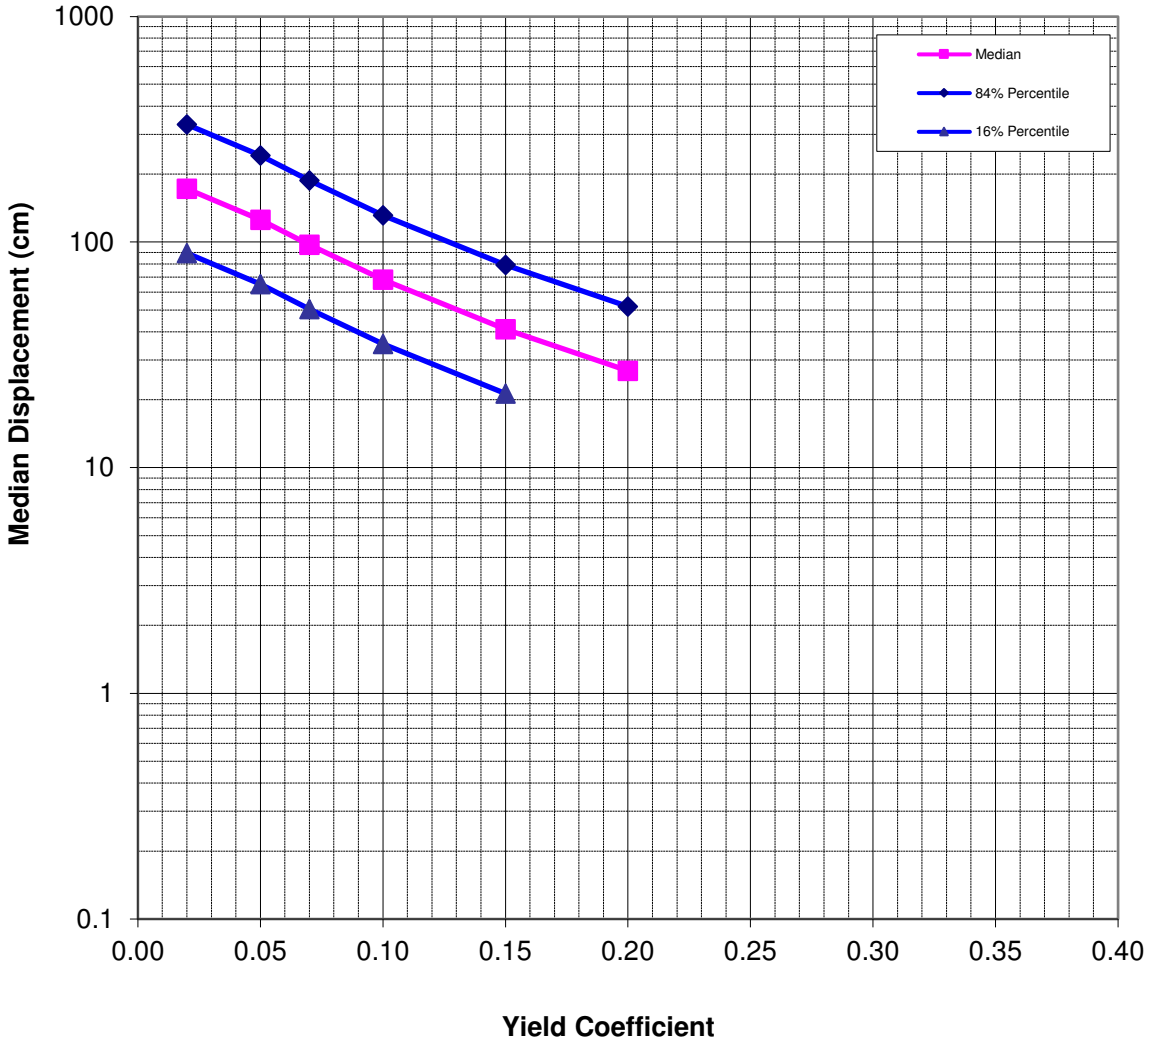

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Sliding displacement models from Rathje and Antonakos (2011)

Prediction of dynamic response and sliding displacement of a sliding mass during earthquake shaking

Inputs	
PGA (g)	0.666
PGV (cm/s)	91.37
k_y (g)	0.01
T_m (s)	0.47246
T_s (s)	0.05728
M	6.80
T_s/T_m	0.12124

Dynamic Response			
	median	-1σ	+1σ
kmax (g)	0.661	0.514	0.848
k-velmax (cm/s)	91.37	91.37	91.37

Displacement Given Median Dynamic Response					
Displacement Model			Sliding Displacements, D (cm)		
	μ_{lnD}	σ_{lnD}	median	-1σ	+1σ
[kmax, M]	5.43	0.699	228.84	113.76	460.30
[kmax, k-velmax]	5.71	0.404	302.13	201.66	452.67
			Sliding Displacements, D (in)		
	μ_{lnD}	σ_{lnD}	median	-1σ	+1σ
[kmax, M]	5.43	0.699	90.09	44.79	181.22
[kmax, k-velmax]	5.71	0.404	118.95	79.39	178.22

PGA Peak Ground Acceleration (g)
PGV Peak Ground Velocity (cm/s)
k_y Critical or Yield Acceleration (g)
T_m Mean Period of an Earthquake Motion (s)
T_s Site Period or the Natural Period of a Sliding Mass (s). For rigid sliding set T_s = 0 s
M Earthquake Magnitude
kmax maximum seismic coefficient (g)
k-velmax the maximum velocity of the seismic coefficient-time history (cm/s)
D Predicted Sliding Displacment (cm)

Reference: Rathje, E.M. and Antonakos, G. 2011. "A Unified Model for Predicting Earthquake-Induced Sliding Displacements of Rigid and Flexible Slopes," Engineering Geology, 122, 51-60, doi:10.1016/j.enggeo.2010.12.004.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

Project No. 17-206-02
Section A-A'
April 2021

Static Analysis, Run 2.1
Post Earthquake Condition
Horz Seismic Coef.: 0
Entry and Exit

Name: Af/Qm (Peak)
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 395 psf
Phi': 31 °

Name: Af/Qm (Ultimate)
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 80 psf
Phi': 30 °

Name: Tc
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 695 psf
Phi': 34 °

Name: Liquefied 1
Model: SHANSEP
Unit Weight: 125 pcf
Tau/Sigma Ratio: 0.17

Name: Liquefied 2
Model: SHANSEP
Unit Weight: 125 pcf
Tau/Sigma Ratio: 0.1

Name: Liquefied 3
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.5

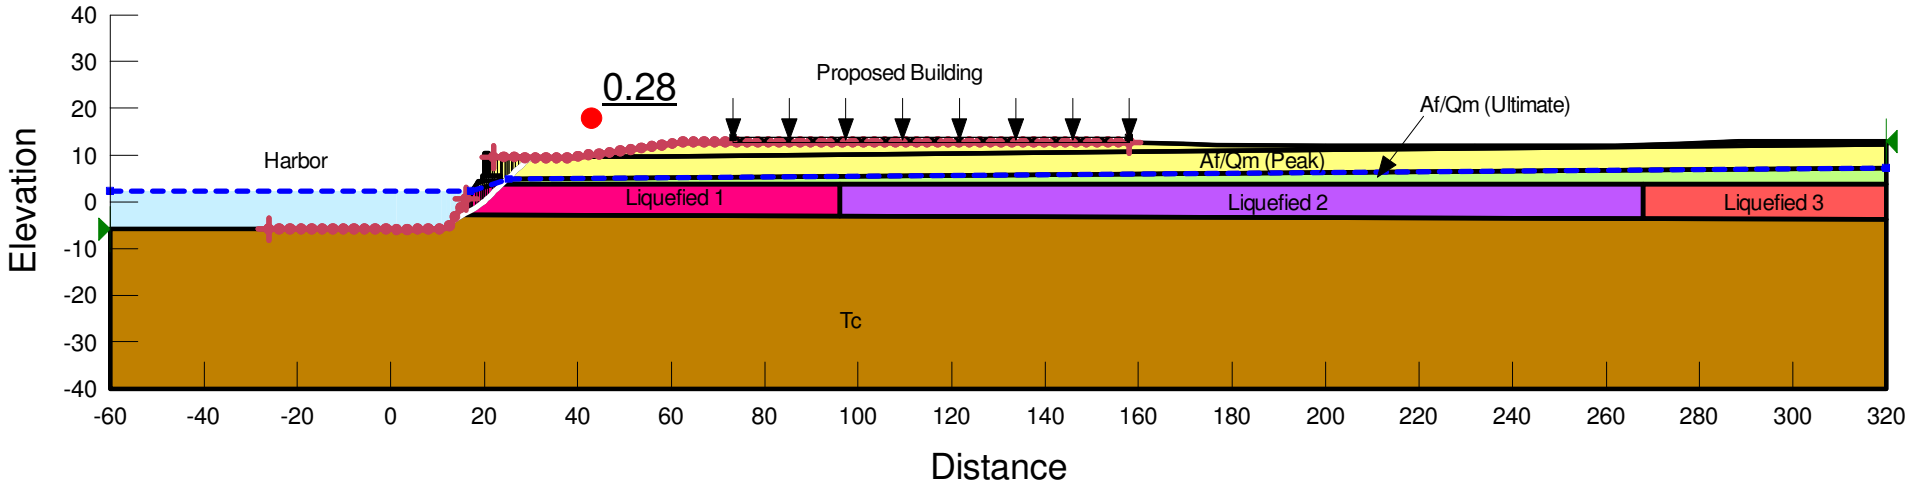

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project No. 17-206-02
Section A-A'
April 2021

Deformation Analysis, Run 2.1_ky
Post Earthquake Condition
Horz Seismic Coef.: 0.01
Entry and Exit
Deformation > 115 inches

Name: Af/Qm (Peak)
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 395 psf
Phi': 31 °

Name: Af/Qm (Ultimate)
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 80 psf
Phi': 30 °

Name: Tc
Model: Mohr-Coulomb
Unit Weight: 125 pcf
Cohesion': 695 psf
Phi': 34 °

Name: Liquefied 1
Model: SHANSEP
Unit Weight: 125 pcf
Tau/Sigma Ratio: 0.17

Name: Liquefied 2
Model: SHANSEP
Unit Weight: 125 pcf
Tau/Sigma Ratio: 0.1

Name: Liquefied 3
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.5

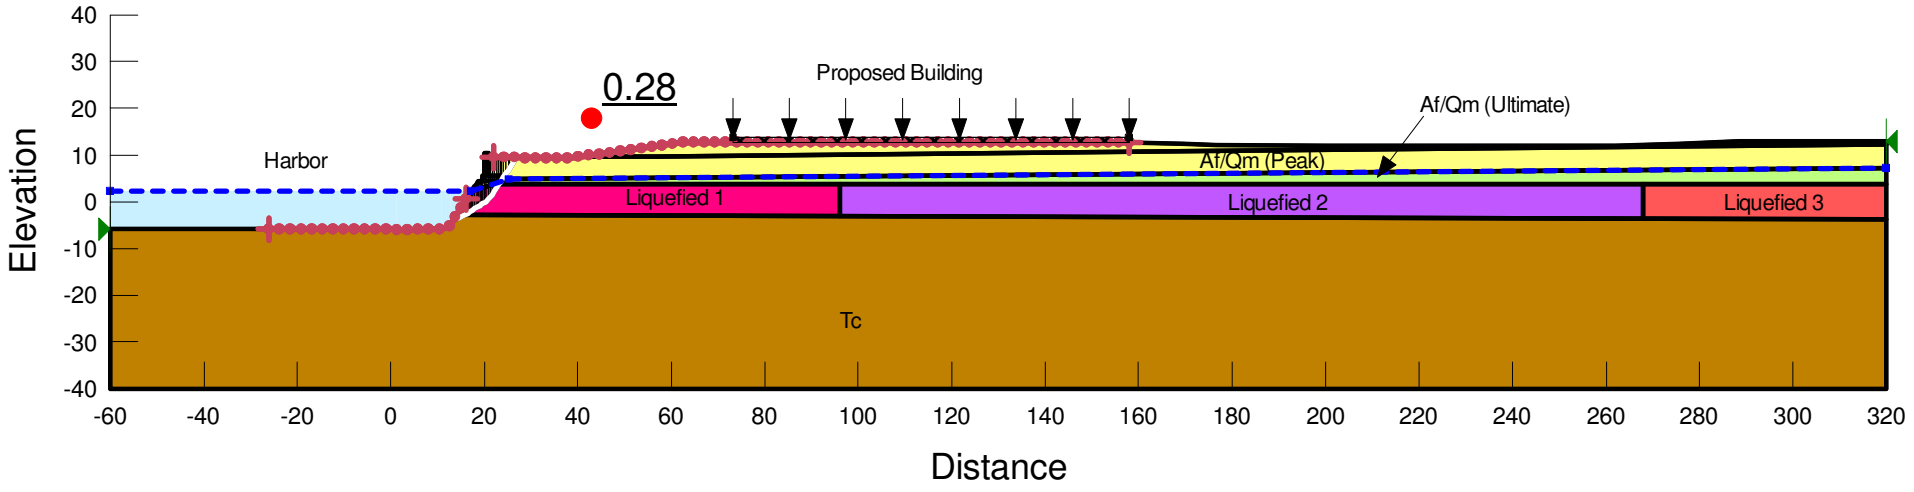

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Project No. 17-206-02 - Dana Point Harbor Revitalization - Buildings 1 through 12
Average Seismic Displacement
Block Search for ky
Liq Layer 1
MCE Event

Seismic Displacement (Bray and Travasarou) = 50% Probability of Exceedance (D2)	295.28 cm or	116.25 inch
1cm = 0.393701 in.		
Seismic Displacement (Rathje and Antonakos) = [kmax, k-velmax]	286.80 cm	112.91 inch
Average Displacement =	291.04 cm	114.58 inch

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DATA FOR SEISMIC SLOPE DISPLACEMENT ANALYSES

Project: 17-206-02 Dana Point Harbor - Section A-A' Liq1 (Based on 11-161-00 CPT-5)

INPUT:

Slide h (ft):	5.00
Slide Vs (ft/sec):	838
Depth to Rx (km):	0.01
Ave. Vs(30) (m/s):	360
Ave. Site Class:	C
Mean Magnitude:	6.80
Mean Dist. (km):	7.4
ky:	0.01

RESULTS:

Site Period, Ts (sec):	0.0239
1.5*Site Per. (sec):	0.0358
EQ Mean Period, Tm (sec):	0.472
Ts/Tm:	0.05
Estimated PGV (cm/sec):	91.37
Duration (D_5-D_{95}) (sec):	13.2
Sa(1.5Ts) Min $Vs_{(30)}$	0.0000
Sa(1.5Ts) Ave $Vs_{(30)}$	0.9105
Sa(1.5Ts) Max $Vs_{(30)}$	0.0000

5-Percent Damped Spectra

Period	Min. $Vs_{(30)}$	Ave. $Vs_{(30)}$	Max. $Vs_{(30)}$
0.01		0.6660	
0.1		1.5190	
0.2		1.5190	
0.3		1.5190	
0.5		1.3640	
1.0		0.6820	
2.0		0.34100	
3.0		0.22700	
4.0		0.17100	
5.0		0.13600	

Ts: 4h/Vs
Tm: Rathje et al. (2004)
PGV: Watson-Lamprey and Abrahamson (2006)
Duration: Bommer et al. (2009)

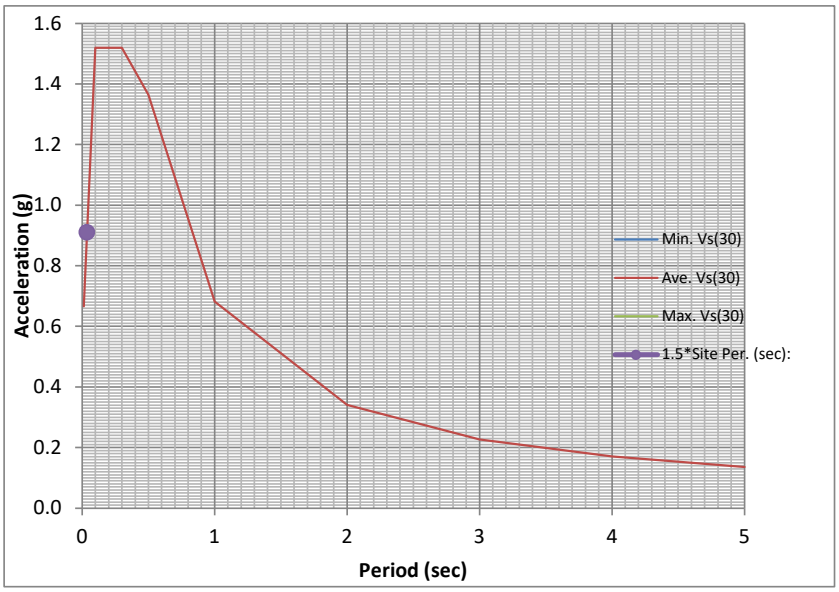

Slide Mass Area =	67
Lengh of Slide Mass =	15
Average Slide H (ft) =	4.47

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Simplified Procedure for Estimating Earthquake Induced Deviatoric Slope Displacements

by Jonathan D. Bray and Thaleia Travasarou

Journal of Geotechnical and Geonvironmental Engineering, ASCE, V. 133(4), pp. 381-392, April 2007

SEE NOTES BELOW FOR GUIDANCE IN THE USE OF SPREADSHEET

Input Parameters			
Yield Coefficient (ky)	0.01		Based on pseudostatic analysis
Initial Fundamental Period (Ts)	0.0239	seconds	1D: Ts=4H/Vs 2D: Ts=2.6H/Vs
Degraded Period (1.5Ts)	0.04	seconds	
Moment Magnitude (Mw)	6.8		
Spectral Acceleration (Sa(1.5Ts))	0.910526	g	

Additional Input Parameters		
Probability of Exceedance #1 (P1)	84	%
Probability of Exceedance #2 (P2)	50	%
Probability of Exceedance #3 (P3)	16	%
Displacement Threshold (d_threshold)	30	cm

Intermediate Calculated Parameters			
Non-Zero Seismic Displacement Est (D)	295.28	cm	eq. (5) or (6)
Standard Deviation of Non-Zero Seismic D	0.66		

Results			
Probability of Negligible Displ. (P(D=0))	0.00		eq. (3)
D1	153.2	cm	calc. using eq. (7)
D2	295.3	cm	calc. using eq. (7)
D3	569.2	cm	calc. using eq. (7)
P(D>d_threshold)	1.00		eq. (7)

Notes

1. Values highlighted in blue are input parameters, and results are presented in the table with the yellow heading.
2. Probability of Exceedance is the desired probability of exceeding a particular displacement value.
3. Displacements D1, D2, and D3 correspond to P1, P2, and P3, respectively.
   (e.g., the probability of exceeding displacement D1 is P1)
4. The 16%, 50%, and 84% percentile displacement values at selected ky values are shown to the right.
5. Calculated seismic displacements are due to deviatoric deformation only (add in volumetrically induced movement).
6. ky may range between 0.01 and 0.5, Ts between 0 and 2 s, Sa between 0.002 and 2.7 g, M between 4.5 and 9
7. Rigid slope is assumed for Ts < 0.05 s
8. When a value for D is not calculated, D is < 1cm
9. ky may be estimated using the simplified equations shown below.
10. Examples of how Ts is estimated are shown below.
11. Vs = weighted avg. shear wave velocity for the sliding mass, e.g., for 2 layers, Vs = [(h1)(Vs1) + (h2)(Vs2)]/(h1 + h2)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

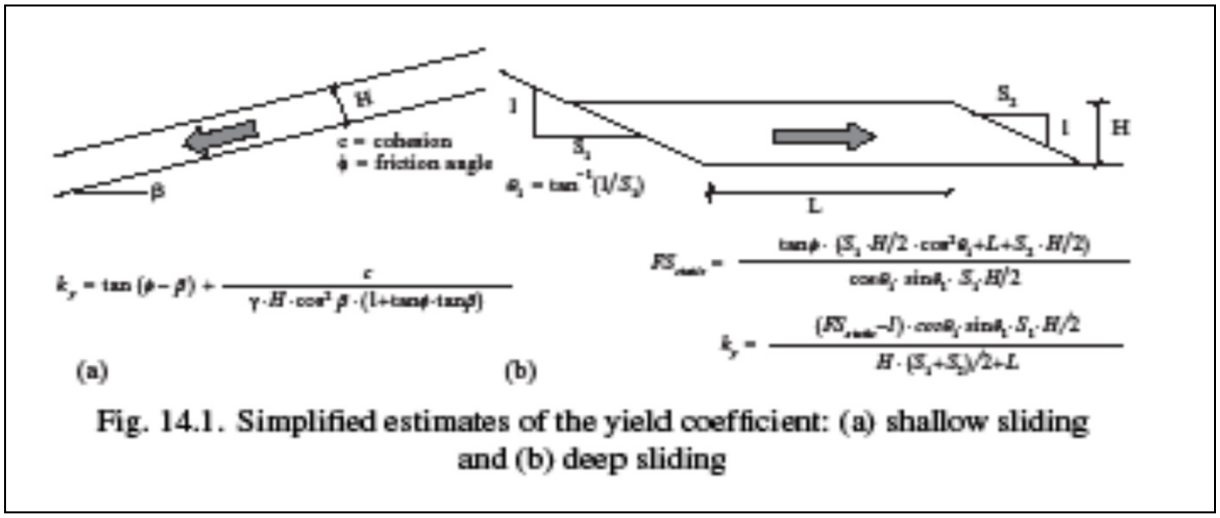

Fig. 14.1. Simplified estimates of the yield coefficient: (a) shallow sliding and (b) deep sliding

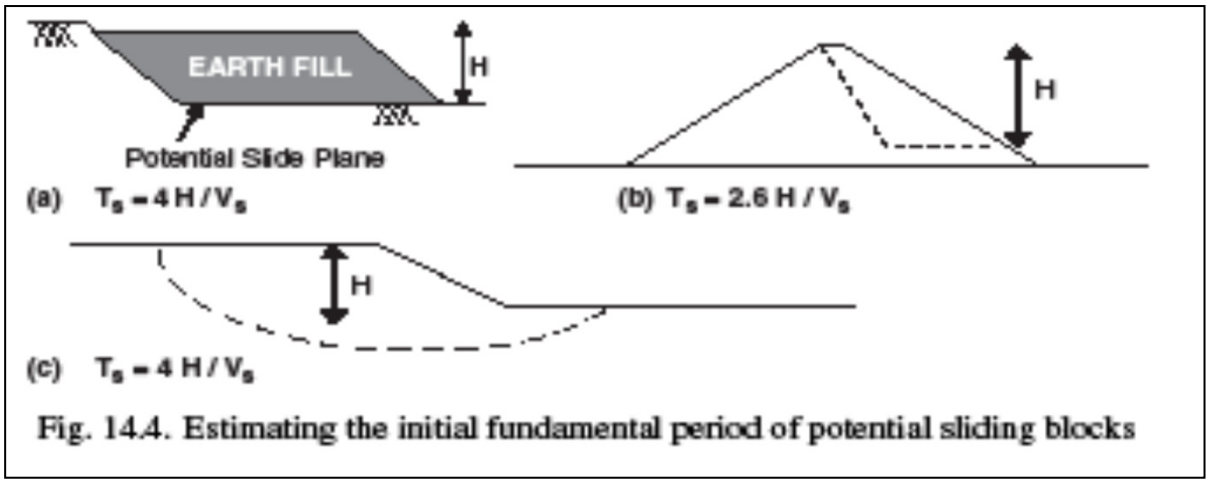

Fig. 14.4. Estimating the initial fundamental period of potential sliding blocks

Figures from Bray, J.D. (2007) “Chapter 14: Simplified Seismic Slope Displacement Procedures,” Earthquake Geotechnical Engineering, 4th Inter. Conf. on Earthquake Geotechnical Engineering - Invited Lectures, in Geotechnical, Geological, and Earthquake Engineering Series, Vol. 6, Pitilakis, Kyriazis D., Ed., Springer, Vol. 6, pp. 327-353.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Dependence on ky

ky	P(D="0")	D (cm)	Dmedian (cm)	D-84% (cm)	D-16% (cm)
0.020	0.00	285.9	285.9	551.0	148.3
0.05	0.00	167.6	167.6	323.1	86.9
0.07	0.00	119.7	119.7	230.8	62.1
0.1	0.00	77.2	77.2	148.8	40.0
0.15	0.00	42.3	42.3	81.5	21.9
0.2	0.00	25.8	25.8	49.7	13.4
0.3	0.04	11.7	11.4	22.2	5.6
0.4	0.19	6.3	5.1	11.0	<1

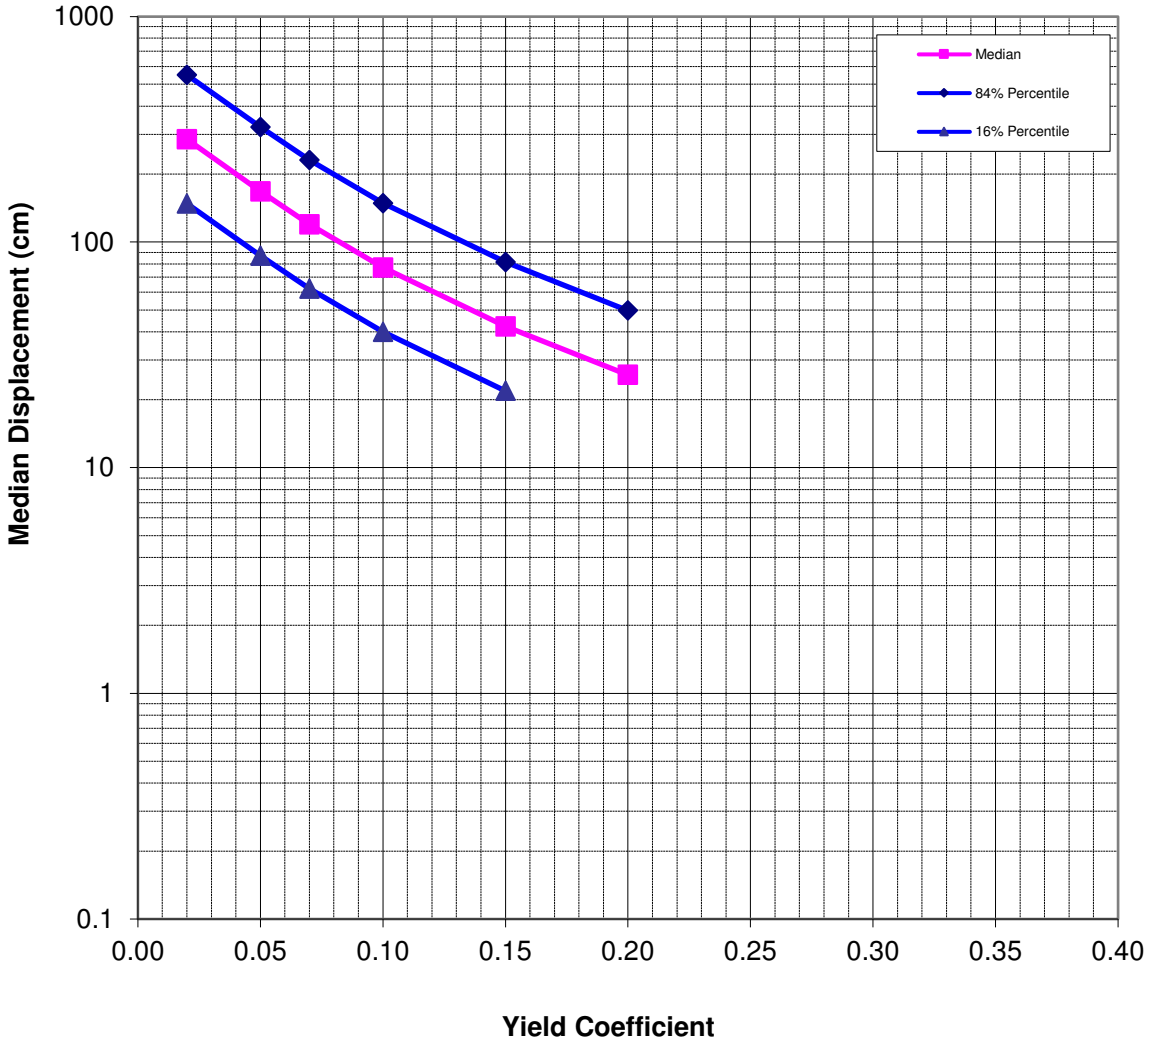

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Sliding displacement models from Rathje and Antonakos (2011)

Prediction of dynamic response and sliding displacement of a sliding mass during earthquake shaking

Inputs	
PGA (g)	0.666
PGV (cm/s)	91.37
k_y (g)	0.01
T_m (s)	0.47246
T_s (s)	0.02387
M	6.80
T_s/T_m	0.05052

Dynamic Response			
	median	-1σ	+1σ
kmax (g)	0.666	0.666	0.666
k-velmax (cm/s)	91.37	91.37	91.37

Displacement Given Median Dynamic Response					
Displacement Model			Sliding Displacements, D (cm)		
	μ_{lnD}	σ_{lnD}	median	-1σ	+1σ
[kmax, M]	5.32	0.699	204.30	101.57	410.94
[kmax, k-velmax]	5.66	0.404	286.80	191.43	429.69
			Sliding Displacements, D (in)		
	μ_{lnD}	σ_{lnD}	median	-1σ	+1σ
[kmax, M]	5.32	0.699	80.43	39.99	161.79
[kmax, k-velmax]	5.66	0.404	112.91	75.37	169.17

PGA Peak Ground Acceleration (g)
PGV Peak Ground Velocity (cm/s)
k_y Critical or Yield Acceleration (g)
T_m Mean Period of an Earthquake Motion (s)
T_s Site Period or the Natural Period of a Sliding Mass (s). For rigid sliding set T_s = 0 s
M Earthquake Magnitude
kmax maximum seismic coefficient (g)
k-velmax the maximum velocity of the seismic coefficient-time history (cm/s)
D Predicted Sliding Displacment (cm)

Reference: Rathje, E.M. and Antonakos, G. 2011. "A Unified Model for Predicting Earthquake-Induced Sliding Displacements of Rigid and Flexible Slopes," Engineering Geology, 122, 51-60, doi:10.1016/j.enggeo.2010.12.004.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project No. 17-206-02
Section C-C'
April 2021

Static Analysis, Run 1.1_s
Post-Earthquake Condition
Horz Seismic Coef.: 0
Slip Surface Option: Block

Name: Af/Qm (Peak)
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 395
Phi': 31

Name: Tc
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 695
Phi': 34

Name: Af/Qm (Ultimate)
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 80
Phi': 30

Name: Liquefied 1
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.25

Name: Liquefied 2
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.1

Name: Liquefied 3
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.35

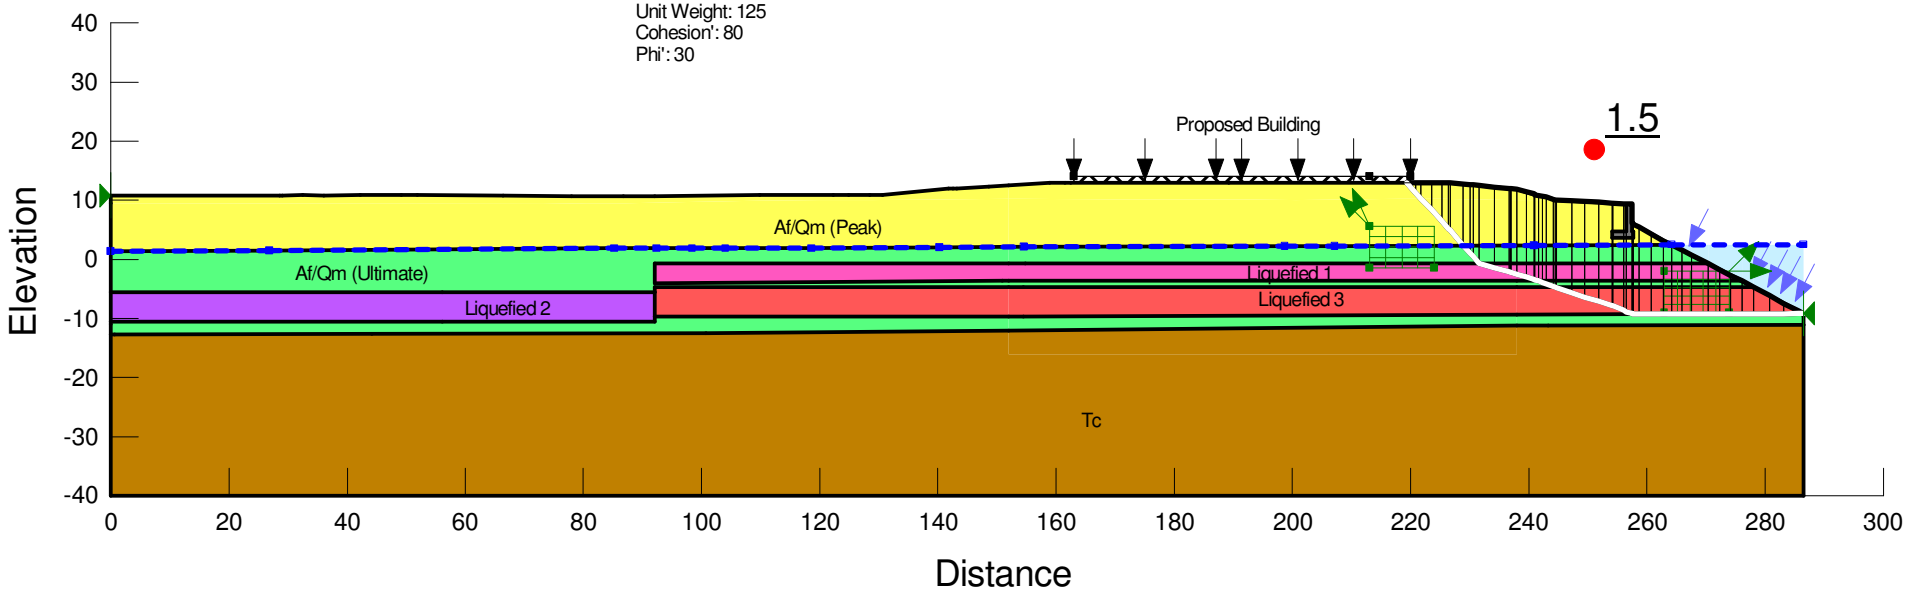

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project No. 17-206-02
Section C-C'
April 2021

Deformation Analysis, Run 1.1_ky
Post-Earthquake Condition
Horz Seismic Coef.: 0.1
Slip Surface Option: Block
Deformation = 39 inches

Name: Af/Qm (Peak)
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 395
Phi': 31

Name: Tc
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 695
Phi': 34

Name: Af/Qm (Ultimate)
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 80
Phi': 30

Name: Liquefied 1
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.25

Name: Liquefied 2
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.1

Name: Liquefied 3
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.35

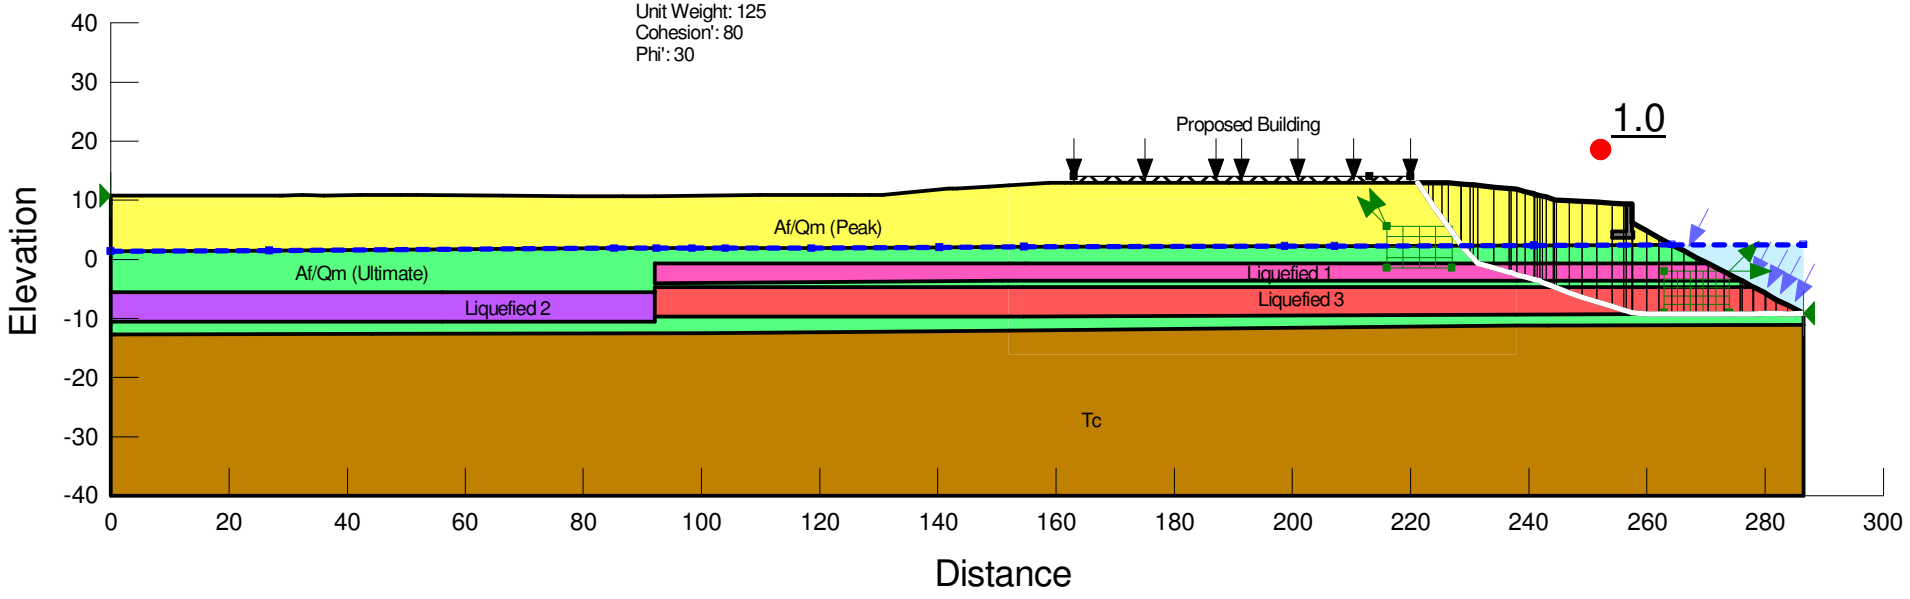

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Project No. 17-206-02 - Dana Point Harbor Revitalization - Buildings 1 through 12
Average Seismic Displacement
Section C-C'
Block Search for ky
Liq Layer 3
MCE Event

Seismic Displacement (Bray and Travasarou) = 50% Probability of Exceedance (D2)	80.32	cm or	31.62	inch
1cm = 0.393701 in.				
Seismic Displacement (Rathje and Antonakos) = [kmax, k-velmax]	116.41	cm	45.83	inch
Average Displacement =	98.37	cm	38.73	inch

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DATA FOR SEISMIC SLOPE DISPLACEMENT ANALYSES

Project: 17-206-02 Dana Point Harbor - Section C-C' Liq3

INPUT:

Slide h (ft):	15.00
Slide Vs (ft/sec):	837.99
Depth to Rx (km):	0.01
Ave. Vs(30) (m/s):	360
Ave. Site Class:	C
Mean Magnitude:	6.80
Mean Dist. (km):	7.4
ky:	0.10

RESULTS:

Site Period, Ts (sec):	0.0716
1.5*Site Per. (sec):	0.1074
EQ Mean Period, Tm (sec):	0.472
Ts/Tm:	0.15
Estimated PGV (cm/sec):	91.37
Duration (D_5-D_{95}) (sec):	13.2
Sa(1.5Ts) Min $Vs_{(30)}$	0.0000
Sa(1.5Ts) Ave $Vs_{(30)}$	1.5190
Sa(1.5Ts) Max $Vs_{(30)}$	0.0000

5-Percent Damped Spectra

Period	Min. $Vs_{(30)}$	Ave. $Vs_{(30)}$	Max. $Vs_{(30)}$
0.01		0.6660	
0.1		1.5190	
0.2		1.5190	
0.3		1.5190	
0.5		1.3640	
1.0		0.6820	
2.0		0.34100	
3.0		0.22700	
4.0		0.17100	
5.0		0.13600	

Ts: 4h/Vs
Tm: Rathje et al. (2004)
PGV: Watson-Lamprey and Abrahamson (2006)
Duration: Bommer et al. (2009)

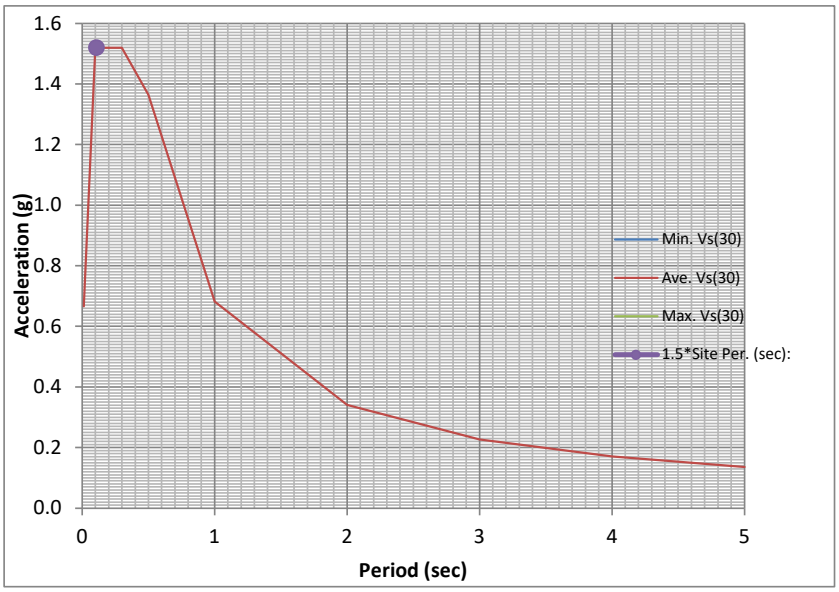

Slide Mass Area =	594
Lengh of Slide Mass =	40
Average Slide H (ft) =	14.85

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Simplified Procedure for Estimating Earthquake Induced Deviatoric Slope Displacements

by Jonathan D. Bray and Thaleia Travasarou

Journal of Geotechnical and Geonvironmental Engineering, ASCE, V. 133(4), pp. 381-392, April 2007

SEE NOTES BELOW FOR GUIDANCE IN THE USE OF SPREADSHEET

Input Parameters			
Yield Coefficient (ky)	0.1		Based on pseudostatic analysis
Initial Fundamental Period (Ts)	0.0716	seconds	1D: Ts=4H/Vs 2D: Ts=2.6H/Vs
Degraded Period (1.5Ts)	0.11	seconds	
Moment Magnitude (Mw)	6.8		
Spectral Acceleration (Sa(1.5Ts))	1.519	g	

Additional Input Parameters		
Probability of Exceedance #1 (P1)	84	%
Probability of Exceedance #2 (P2)	50	%
Probability of Exceedance #3 (P3)	16	%
Displacement Threshold (d_threshold)	30	cm

Intermediate Calculated Parameters			
Non-Zero Seismic Displacement Est (D)	80.32	cm	eq. (5) or (6)
Standard Deviation of Non-Zero Seismic D	0.66		

Results			
Probability of Negligible Displ. (P(D=0))	0.00		eq. (3)
D1	41.7	cm	calc. using eq. (7)
D2	80.3	cm	calc. using eq. (7)
D3	154.8	cm	calc. using eq. (7)
P(D>d_threshold)	0.93		eq. (7)

Notes

1. Values highlighted in blue are input parameters, and results are presented in the table with the yellow heading.
2. Probability of Exceedance is the desired probability of exceeding a particular displacement value.
3. Displacements D1, D2, and D3 correspond to P1, P2, and P3, respectively.
   (e.g., the probability of exceeding displacement D1 is P1)
4. The 16%, 50%, and 84% percentile displacement values at selected ky values are shown to the right.
5. Calculated seismic displacements are due to deviatoric deformation only (add in volumetrically induced movement).
6. ky may range between 0.01 and 0.5, Ts between 0 and 2 s, Sa between 0.002 and 2.7 g, M between 4.5 and 9
7. Rigid slope is assumed for Ts < 0.05 s
8. When a value for D is not calculated, D is < 1cm
9. ky may be estimated using the simplified equations shown below.
10. Examples of how Ts is estimated are shown below.
11. Vs = weighted avg. shear wave velocity for the sliding mass, e.g., for 2 layers, Vs = [(h1)(Vs1) + (h2)(Vs2)]/(h1 + h2)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

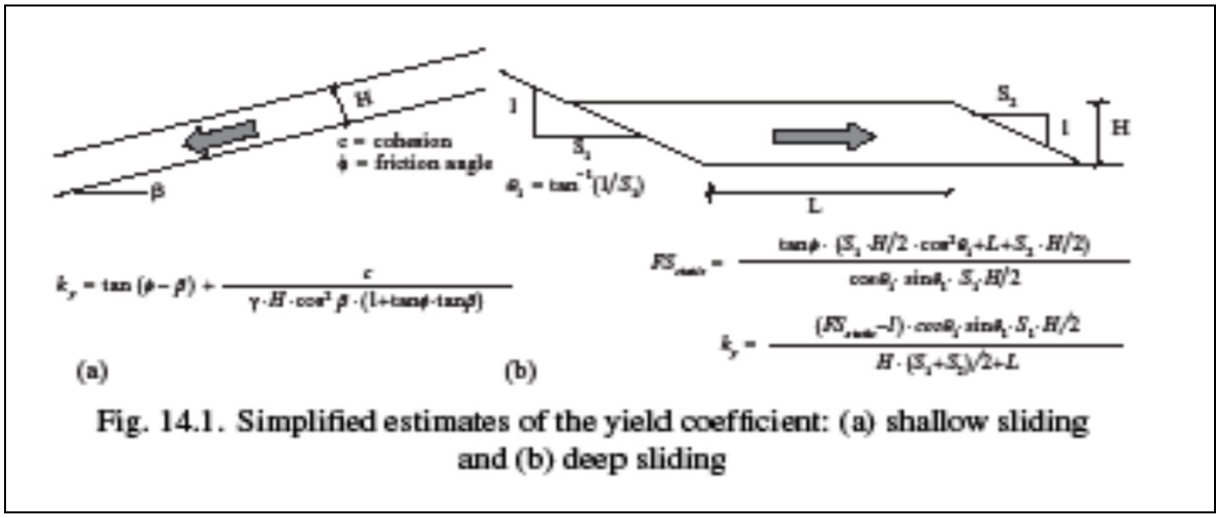

Fig. 14.1. Simplified estimates of the yield coefficient: (a) shallow sliding and (b) deep sliding

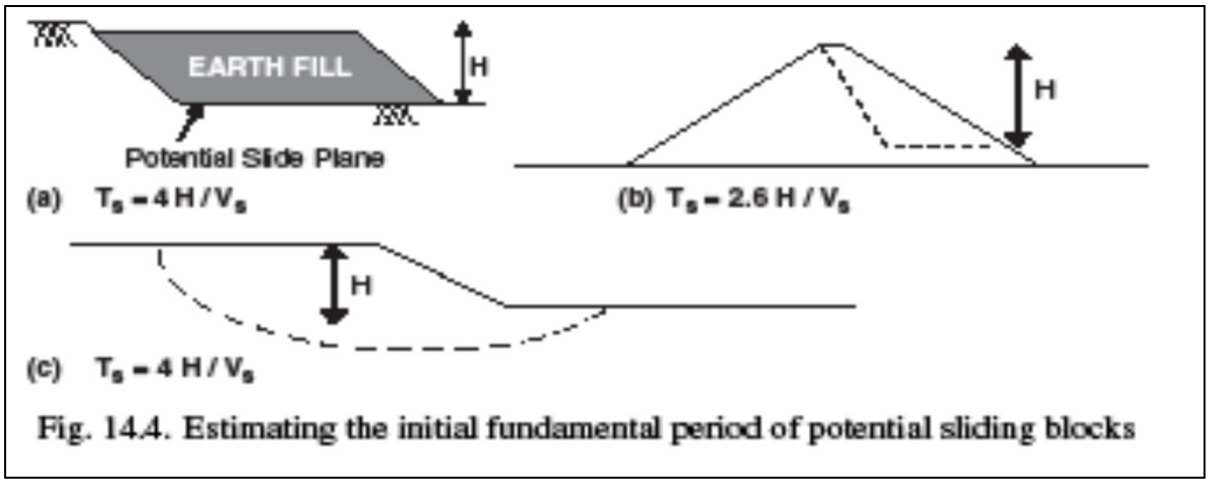

Fig. 14.4. Estimating the initial fundamental period of potential sliding blocks

Figures from Bray, J.D. (2007) “Chapter 14: Simplified Seismic Slope Displacement Procedures,” Earthquake Geotechnical Engineering, 4th Inter. Conf. on Earthquake Geotechnical Engineering - Invited Lectures, in Geotechnical, Geological, and Earthquake Engineering Series, Vol. 6, Pitilakis, Kyriazis D., Ed., Springer, Vol. 6, pp. 327-353.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

Dependence on ky

ky	P(D="0")	D (cm)	Dmedian (cm)	D-84% (cm)	D-16% (cm)
0.020	0.00	186.6	186.6	359.8	96.8
0.05	0.00	142.7	142.7	275.1	74.0
0.07	0.00	112.4	112.4	216.6	58.3
0.1	0.00	80.3	80.3	154.8	41.7
0.15	0.00	49.5	49.5	95.4	25.7
0.2	0.00	32.8	32.8	63.3	17.0
0.3	0.00	16.8	16.8	32.3	8.7
0.4	0.00	9.7	9.7	18.8	5.0

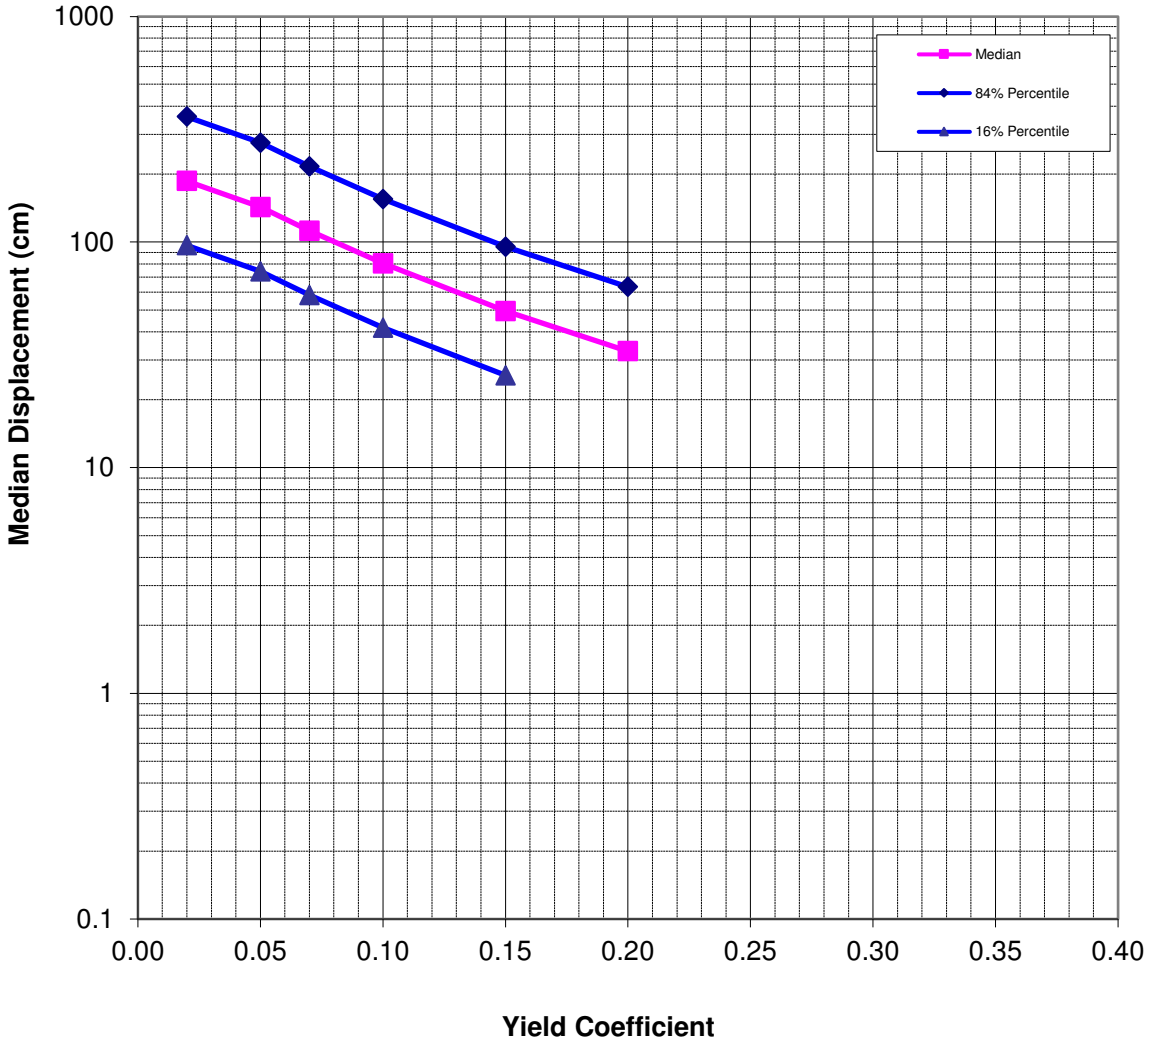

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Sliding displacement models from Rathje and Antonakos (2011)

Prediction of dynamic response and sliding displacement of a sliding mass during earthquake shaking

Inputs	
PGA (g)	0.666
PGV (cm/s)	91.37
k_y (g)	0.1
T_m (s)	0.47246
T_s (s)	0.0716
M	6.80
T_s/T_m	0.15155

Dynamic Response			
	median	-1σ	+1σ
kmax (g)	0.644	0.501	0.826
k-velmax (cm/s)	91.37	91.37	91.37

Displacement Given Median Dynamic Response					
Displacement Model			Sliding Displacements, D (cm)		
	μ_{lnD}	σ_{lnD}	median	-1σ	+1σ
[kmax, M]	4.46	0.744	86.26	40.99	181.53
[kmax, k-velmax]	4.76	0.444	116.41	74.67	181.50
			Sliding Displacements, D (in)		
	μ_{lnD}	σ_{lnD}	median	-1σ	+1σ
[kmax, M]	4.46	0.744	33.96	16.14	71.47
[kmax, k-velmax]	4.76	0.444	45.83	29.40	71.46

PGA Peak Ground Acceleration (g)
PGV Peak Ground Velocity (cm/s)
k_y Critical or Yield Acceleration (g)
T_m Mean Period of an Earthquake Motion (s)
T_s Site Period or the Natural Period of a Sliding Mass (s). For rigid sliding set T_s = 0 s
M Earthquake Magnitude
kmax maximum seismic coefficient (g)
k-velmax the maximum velocity of the seismic coefficient-time history (cm/s)
D Predicted Sliding Displacment (cm)

Reference: Rathje, E.M. and Antonakos, G. 2011. "A Unified Model for Predicting Earthquake-Induced Sliding Displacements of Rigid and Flexible Slopes," Engineering Geology, 122, 51-60, doi:10.1016/j.enggeo.2010.12.004.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project No. 17-206-02
Section C-C'
April 2021

Static Analysis, Run 2.1_s
Post-Earthquake Condition
Horz Seismic Coef.: 0
Slip Surface Option: Entry and Exit

Name: Af/Qm (Peak)
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 395
Phi': 31

Name: Tc
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 695
Phi': 34

Name: Af/Qm (Ultimate)
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 80
Phi': 30

Name: Liquefied 1
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.25

Name: Liquefied 2
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.1

Name: Liquefied 3
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.35

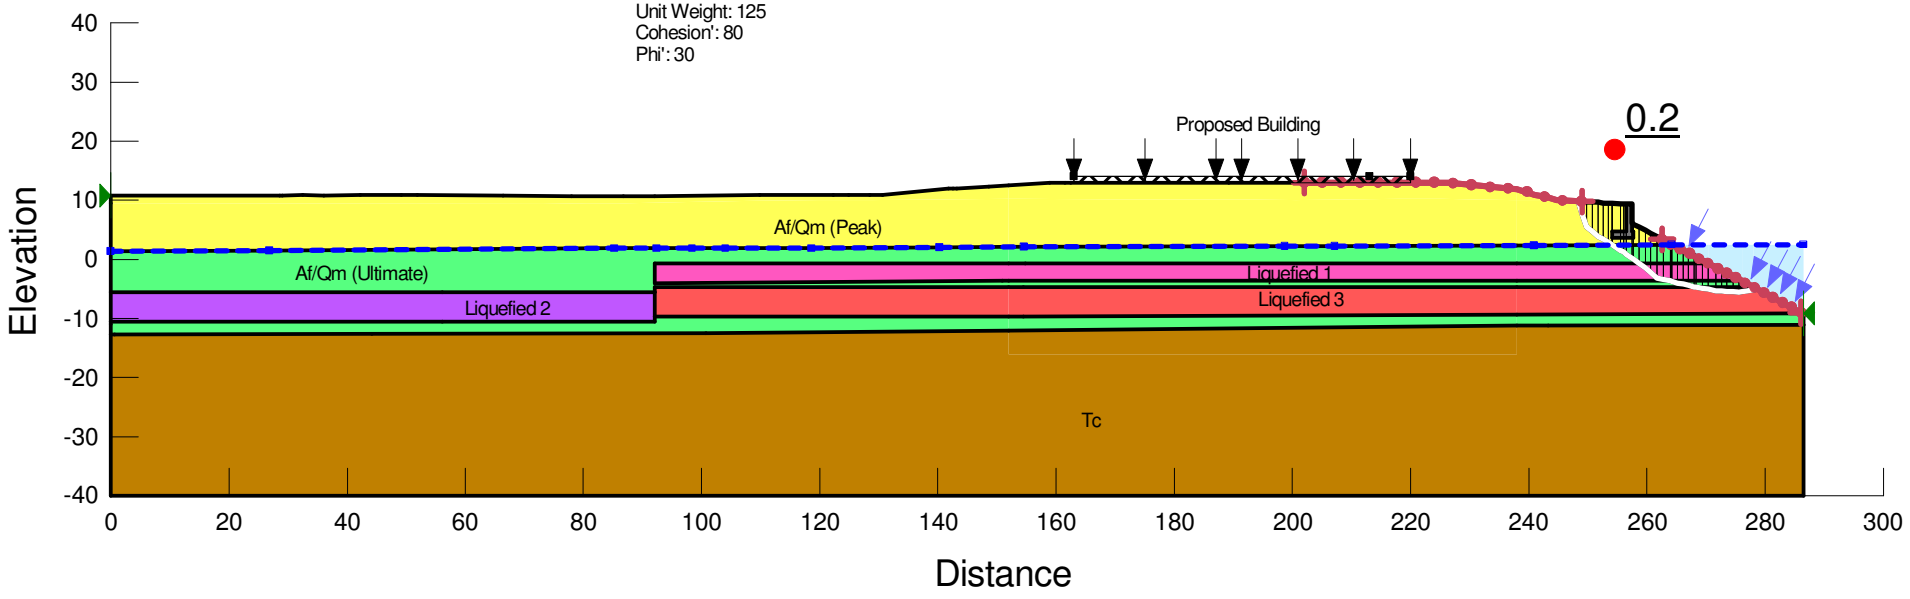

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Project No. 17-206-02
Section C-C'
April 2021

Deformation Analysis, Run 2.1_ky
Post-Earthquake Condition
Horz Seismic Coef.: 0.01
Slip Surface Option: Entry and Exit
Deformation > 115 inches

Name: Af/Qm (Peak)
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 395
Phi': 31

Name: Tc
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 695
Phi': 34

Name: Af/Qm (Ultimate)
Model: Mohr-Coulomb
Unit Weight: 125
Cohesion': 80
Phi': 30

Name: Liquefied 1
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.25

Name: Liquefied 2
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.1

Name: Liquefied 3
Model: SHANSEP
Unit Weight: 125
Tau/Sigma Ratio: 0.35

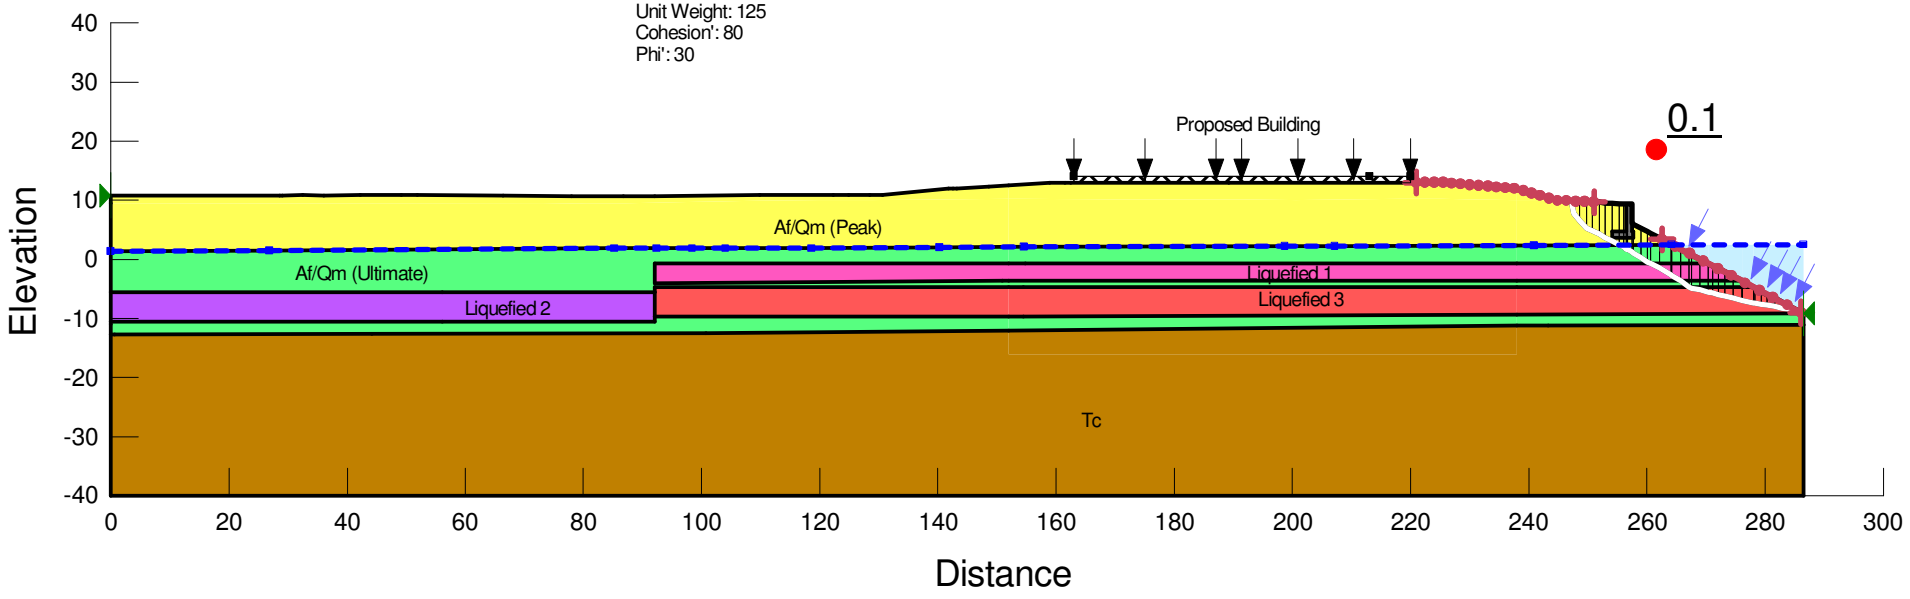

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

GMU Project No. 17-206-02 - Dana Point Harbor Revitalization - Buildings 1 through 12
Average Seismic Displacement
Section C-C'
Block Search for ky
MCE Event

Seismic Displacement (Bray and Travasarou) = 50% Probability of Exceedance (D2)	295.28 cm or	116.25 inch
1cm = 0.393701 in.		
Seismic Displacement (Rathje and Antonakos) = [kmax, k-velmax]	286.80 cm	112.91 inch
Average Displacement =	291.04 cm	114.58 inch

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

DATA FOR SEISMIC SLOPE DISPLACEMENT ANALYSES

Project: 17-206-02 Dana Point Harbor - Section C-C'

INPUT:

Slide h (ft):	5.00
Slide Vs (ft/sec):	837.99
Depth to Rx (km):	0.01
Ave. Vs(30) (m/s):	360
Ave. Site Class:	C
Mean Magnitude:	6.80
Mean Dist. (km):	7.4
ky:	0.01

RESULTS:

Site Period, Ts (sec):	0.0239
1.5*Site Per. (sec):	0.0358
EQ Mean Period, Tm (sec):	0.472
Ts/Tm:	0.05
Estimated PGV (cm/sec):	91.37
Duration (D_5-D_{95}) (sec):	13.2
Sa(1.5Ts) Min $Vs_{(30)}$	0.0000
Sa(1.5Ts) Ave $Vs_{(30)}$	0.9105
Sa(1.5Ts) Max $Vs_{(30)}$	0.0000

5-Percent Damped Spectra

Period	Min. $Vs_{(30)}$	Ave. $Vs_{(30)}$	Max. $Vs_{(30)}$
0.01		0.6660	
0.1		1.5190	
0.2		1.5190	
0.3		1.5190	
0.5		1.3640	
1.0		0.6820	
2.0		0.34100	
3.0		0.22700	
4.0		0.17100	
5.0		0.13600	

Ts: 4h/Vs
Tm: Rathje et al. (2004)
PGV: Watson-Lamprey and Abrahamson (2006)
Duration: Bommer et al. (2009)

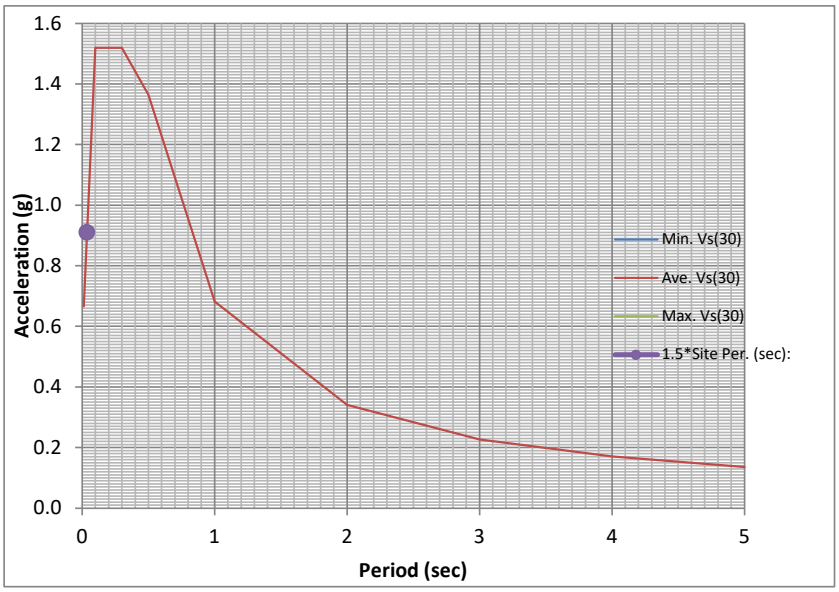

Slide Mass Area =	161
Lengh of Slide Mass =	30
Average Slide H (ft) =	5.37

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Simplified Procedure for Estimating Earthquake Induced Deviatoric Slope Displacements

by Jonathan D. Bray and Thaleia Travasarou

Journal of Geotechnical and Geonvironmental Engineering, ASCE, V. 133(4), pp. 381-392, April 2007

SEE NOTES BELOW FOR GUIDANCE IN THE USE OF SPREADSHEET

Input Parameters			
Yield Coefficient (ky)	0.01		Based on pseudostatic analysis
Initial Fundamental Period (Ts)	0.0239	seconds	1D: Ts=4H/Vs 2D: Ts=2.6H/Vs
Degraded Period (1.5Ts)	0.04	seconds	
Moment Magnitude (Mw)	6.8		
Spectral Acceleration (Sa(1.5Ts))	0.910526	g	

Additional Input Parameters		
Probability of Exceedance #1 (P1)	84	%
Probability of Exceedance #2 (P2)	50	%
Probability of Exceedance #3 (P3)	16	%
Displacement Threshold (d_threshold)	30	cm

Intermediate Calculated Parameters			
Non-Zero Seismic Displacement Est (D)	295.28	cm	eq. (5) or (6)
Standard Deviation of Non-Zero Seismic D	0.66		

Results			
Probability of Negligible Displ. (P(D=0))	0.00		eq. (3)
D1	153.2	cm	calc. using eq. (7)
D2	295.3	cm	calc. using eq. (7)
D3	569.2	cm	calc. using eq. (7)
P(D>d_threshold)	1.00		eq. (7)

Notes

1. Values highlighted in blue are input parameters, and results are presented in the table with the yellow heading.
2. Probability of Exceedance is the desired probability of exceeding a particular displacement value.
3. Displacements D1, D2, and D3 correspond to P1, P2, and P3, respectively.
   (e.g., the probability of exceeding displacement D1 is P1)
4. The 16%, 50%, and 84% percentile displacement values at selected ky values are shown to the right.
5. Calculated seismic displacements are due to deviatoric deformation only (add in volumetrically induced movement).
6. ky may range between 0.01 and 0.5, Ts between 0 and 2 s, Sa between 0.002 and 2.7 g, M between 4.5 and 9
7. Rigid slope is assumed for Ts < 0.05 s
8. When a value for D is not calculated, D is < 1cm
9. ky may be estimated using the simplified equations shown below.
10. Examples of how Ts is estimated are shown below.
11. Vs = weighted avg. shear wave velocity for the sliding mass, e.g., for 2 layers, Vs = [(h1)(Vs1) + (h2)(Vs2)]/(h1 + h2)

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

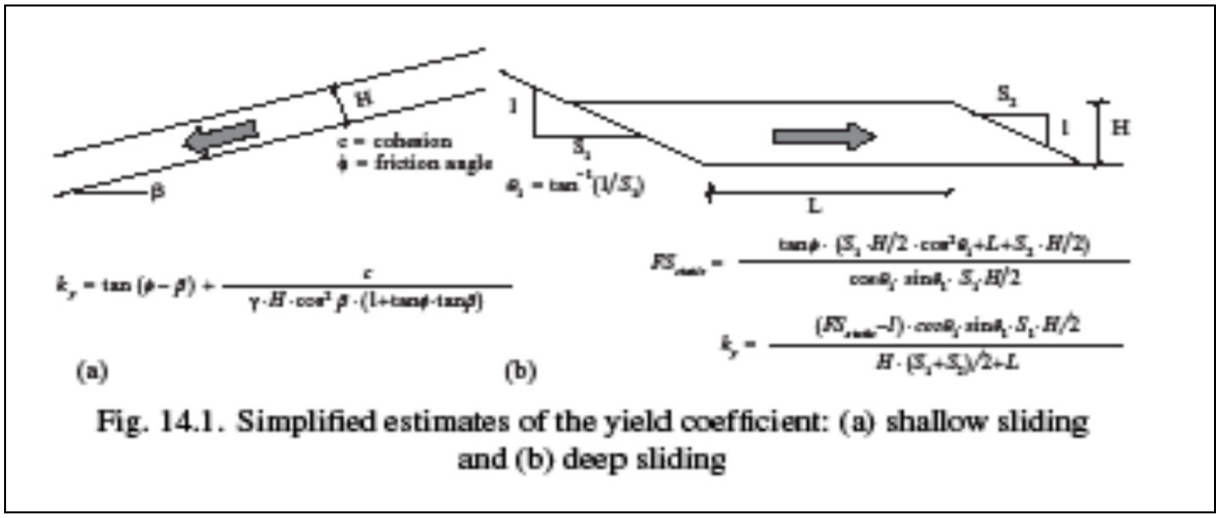

Fig. 14.1. Simplified estimates of the yield coefficient: (a) shallow sliding and (b) deep sliding

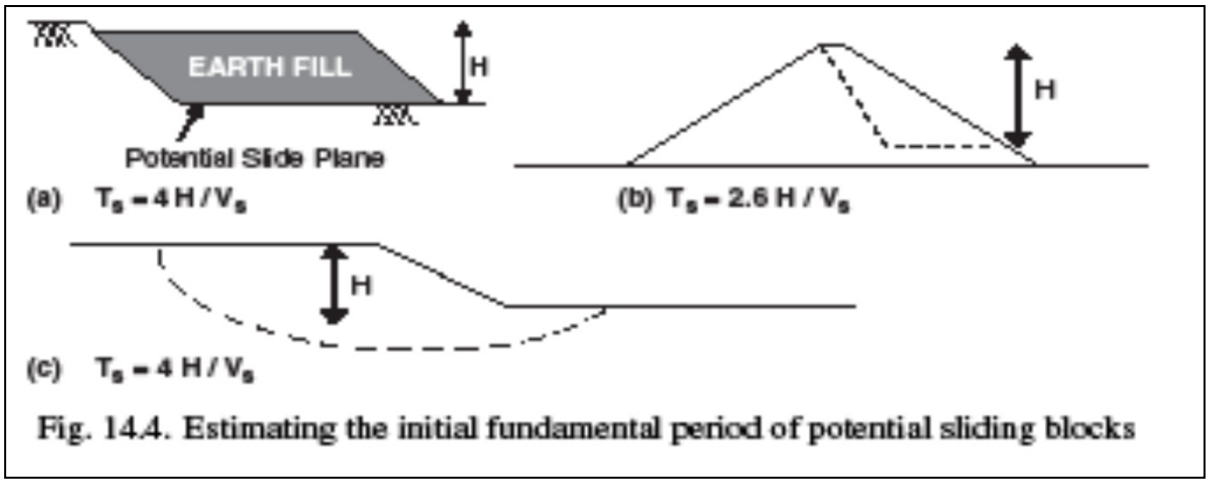

Fig. 14.4. Estimating the initial fundamental period of potential sliding blocks

Figures from Bray, J.D. (2007) “Chapter 14: Simplified Seismic Slope Displacement Procedures,” Earthquake Geotechnical Engineering, 4th Inter. Conf. on Earthquake Geotechnical Engineering - Invited Lectures, in Geotechnical, Geological, and Earthquake Engineering Series, Vol. 6, Pitilakis, Kyriazis D., Ed., Springer, Vol. 6, pp. 327-353.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Dependence on ky

ky	P(D="0")	D (cm)	Dmedian (cm)	D-84% (cm)	D-16% (cm)
0.020	0.00	285.9	285.9	551.0	148.3
0.05	0.00	167.6	167.6	323.1	86.9
0.07	0.00	119.7	119.7	230.8	62.1
0.1	0.00	77.2	77.2	148.8	40.0
0.15	0.00	42.3	42.3	81.5	21.9
0.2	0.00	25.8	25.8	49.7	13.4
0.3	0.04	11.7	11.4	22.2	5.6
0.4	0.19	6.3	5.1	11.0	<1

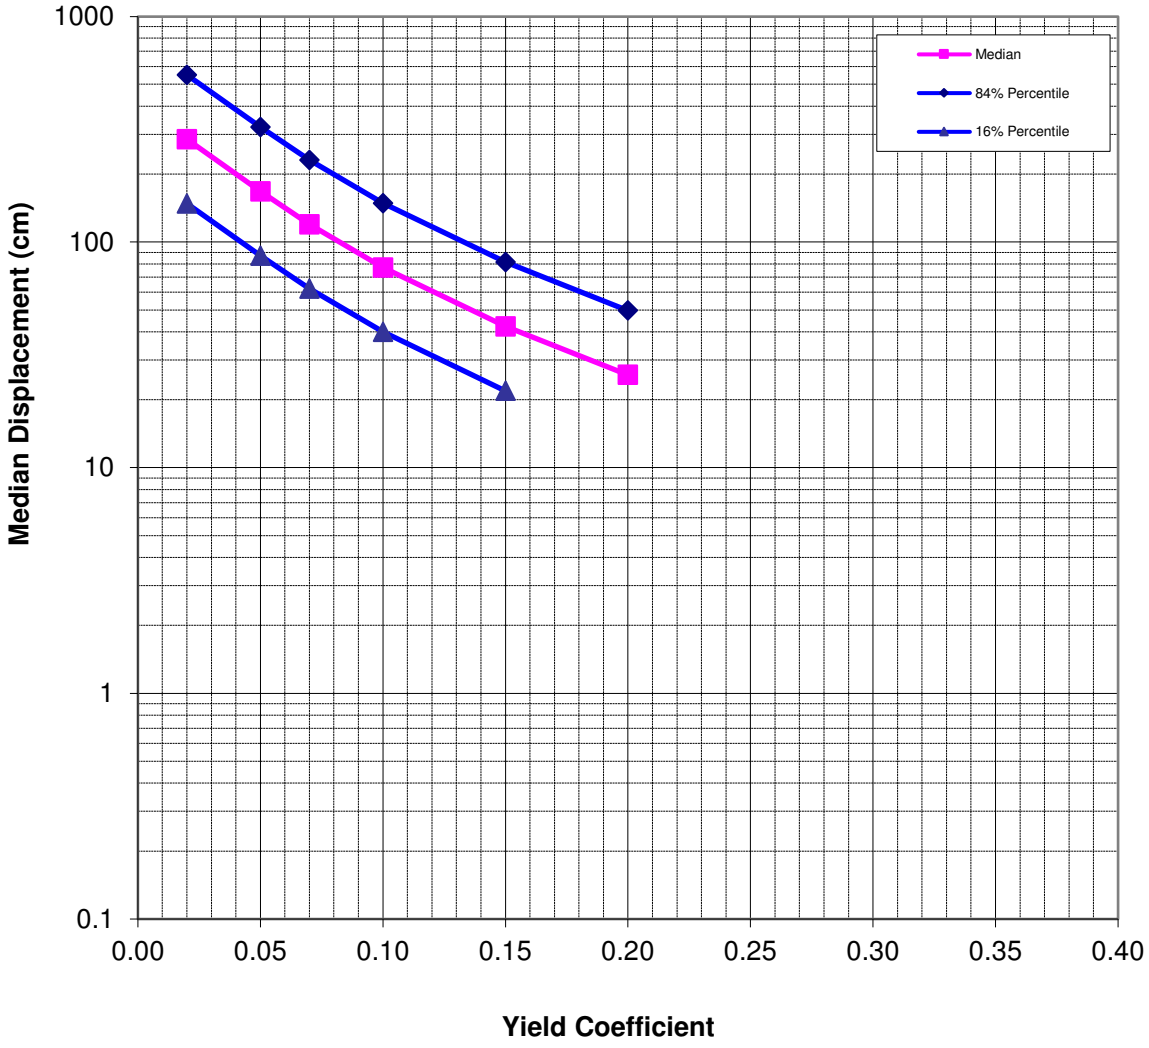

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
BUILDING OFFICIAL

Sliding displacement models from Rathje and Antonakos (2011)

Prediction of dynamic response and sliding displacement of a sliding mass during earthquake shaking

Inputs	
PGA (g)	0.666
PGV (cm/s)	91.37
k_y (g)	0.01
T_m (s)	0.47246
T_s (s)	0.02387
M	6.80
T_s/T_m	0.05052

Dynamic Response			
	median	-1σ	+1σ
kmax (g)	0.666	0.666	0.666
k-velmax (cm/s)	91.37	91.37	91.37

Displacement Given Median Dynamic Response					
Displacement Model			Sliding Displacements, D (cm)		
	μ_{lnD}	σ_{lnD}	median	-1σ	+1σ
[kmax, M]	5.32	0.699	204.30	101.57	410.94
[kmax, k-velmax]	5.66	0.404	286.80	191.43	429.69
			Sliding Displacements, D (in)		
	μ_{lnD}	σ_{lnD}	median	-1σ	+1σ
[kmax, M]	5.32	0.699	80.43	39.99	161.79
[kmax, k-velmax]	5.66	0.404	112.91	75.37	169.17

PGA Peak Ground Acceleration (g)
PGV Peak Ground Velocity (cm/s)
k_y Critical or Yield Acceleration (g)
T_m Mean Period of an Earthquake Motion (s)
T_s Site Period or the Natural Period of a Sliding Mass (s). For rigid sliding set T_s = 0 s
M Earthquake Magnitude
kmax maximum seismic coefficient (g)
k-velmax the maximum velocity of the seismic coefficient-time history (cm/s)
D Predicted Sliding Displacment (cm)

Reference: Rathje, E.M. and Antonakos, G. 2011. "A Unified Model for Predicting Earthquake-Induced Sliding Displacements of Rigid and Flexible Slopes," Engineering Geology, 122, 51-60, doi:10.1016/j.enggeo.2010.12.004.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX F

Flatwork/Hardscape Table

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243
County of Orange - OC Public Works
OC Development Services
APPROVED
This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes to these plans without written permission from OC Public Works' OC Development Services of Orange County. The stamping of these plans and specifications SHALL NOT be held to permit or be approval of the violation of any provisions of any County Ordinance or State law.
Hadi Tabatabaee
DATE

TABLE F - FLATWORK RECOMMENDATIONS
DANA POINT HARBOR – COMMERCIAL

Description	Subgrade Preparation	Minimum Concrete Thickness (Full)	Edge Thickness	Reinforcement	Joint Spacing (Maximum)	Cement Type	Sulfate Resistance
Isolated Concrete Sidewalks and Walkways [4]	1) 2% over optimum to 12" [1], 2) 4" of CAB or CMB compacted to a minimum of 95% relative compaction above moisture conditioned subgrade.	4 inches	Per Landscape Architect	1) No. 3 bars at 24" o.c. [2] if within 5' of top-of-slope conditions; otherwise not required, 2) where adjacent to curbs or structures and at cold joints/ expansion joints use dowels: No. 3 bars at 24" o.c. [5]	6 feet	II/V	(3)
Vehicular Concrete and Driveways	1) 2% over optimum to 12" [1], 2) 6" of CAB or CMB compacted to a minimum of 95% relative compaction above moisture conditioned subgrade.	8 inches	Per Landscape Architect	1) No. 3 bars at 24" o.c. [2] if within 5' of top-of-slope conditions; otherwise not required, 2) where adjacent to curbs or structures and at cold joints/ expansion joints use dowels: No. 3 bars at 24" o.c. [5]	6 feet	II/V	(3)
Concrete Interlocking Pavers (non-vehicular) [4,6]	1) 2% over optimum to 12"[1], 2) 13" of CAB or CMB compacted to a minimum of 95% relative compaction.	Not Required	Where adjacent to asphalt pavement and landscape areas - 4" of PCC over 4" of CAB or CMB compacted to a minimum of 95% relative compaction Min. 6" width	1) Thickened Edge: one No. 3 bar placed in long direction, 2) dowel into adjacent curbs or structures and across cold joints/ expansion joints w/No. 3 bars at 24" o.c. [5]	N/A	II/V	(3)
Concrete Interlocking Pavers (vehicular) [4, 6]	Subgrade: 2% over optimum to 12"[1] Parking Stall Access: 13 inches of CAB or CMB compacted to 95% relative compaction over Mirafi 600X or equivalent geotextile. Fire Access: 22 inches of CAB or CMB compacted to 95% over Mirafi 600X or equivalent.	Not Required	Where adjacent to asphalt pavements and landscape areas - 8" of PCC over 6" of CAB or CMB compacted to a minimum of 95% relative compaction Min. 6" width	1) Thickened Edge: one No. 3 bar placed in long direction, 2) dowel into adjacent curbs or structures and across cold joints/ expansion joints w/No. 3 bars at 24" o.c. [5]	N/A	II/V	(3)

(1) The moisture content of the subgrade must be verified by the geotechnical consultant prior to sand/rock placement.
(2) Reinforcement to be placed both ways and at or above the mid-point of the slab (i.e., a minimum of 2.0 to 2.5 inches above the prepared subgrade).
(3) Soils having moderate levels of sulfates as defined by CBC are expected. Concrete mix design shall be selected by the concrete designer. Concrete mix design is outside the geotechnical engineer's purview.
(4) Where concrete/ flatwork is adjacent a stucco surface, a ¼" to ½" foam separation/expansion joint should be used.
(5) If dowels are placed in cored holes, the core holes shall be placed at alternating in-plane angles (i.e., not cored straight into slab).
(6) Pavers to be installed per minimum manufacturers recommendations. *The minimum thickness of pavers should be 2 3/8" for pedestrian application and 3 1/8" for vehicular application, and should be installed per minimum manufacturer's recommendations, including min. 1" sand bedding. It is highly recommended that if vehicular pavers are to be constructed, they should maintain an aspect ratio of 3 to 1 or less (where the length of the paver is 3 times the thickness of the paver or less) in order to minimize edge cracking.*

General Note: Minor deviations to the above recommendations may be required at the discretion of the soils engineer or his representative.

Building&Safety: Ryan Rose 1/16/2025
Approval: Geotechnical Reports
Permits:
BNR21-0240/BNR21-0241/BNR21-0242/BNR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED

This set of plans and specifications must be kept on the job at all times. It is unlawful to make any changes or alterations to these plans without written permission from OC Public Works, OC Development Services of Orange County. The stamping of these plan specifications SHALL NOT be held to permit or be an approval of the violation of any provisions of any County Ordinance or State law.

Hadi Tabatabaee
BUILDING OFFICIAL

APPENDIX G

Advanced GeoSolutions (AGI) Mitigation Plans

Building&Safety: Ryan Rose 1/19/2020
Approved: Geotechnical Reports
Permits:
BWDV-2019050521-02413MWD1-02429MWD1-0243

County of Orange OC Public Works
OC Development Services
APPROVED
This approval is limited to the extent of the work described on the approved plans. Approval of this document does not authorize any violation of State or local laws. By issuing this approval, the County of Orange assumes no responsibility for any omissions or errors that may exist. Approval of this document does not relieve the applicant of responsibility to comply with all applicable laws, ordinances, regulations, and codes.
Troy Danielson
Inspection Services

DANA POINT HARBOR
COMMERCIAL COMPONENT
DEEP SOIL MIXING
DANA POINT, CALIFORNIA

SHEET INDEX

GI-1	COVER SHEET
GI-2	GENERAL NOTES AND DETAILS
GI-3	DEEP SOIL MIXING PLAN
GI-4.1	DEEP SOIL MIXING LAYOUT – BUILDING 1
GI-4.2	DEEP SOIL MIXING LAYOUT – BUILDING 6
GI-4.3	DEEP SOIL MIXING LAYOUT – BUILDING 7
GI-4.4	DEEP SOIL MIXING LAYOUT – BUILDING 8
GI-4.5	DEEP SOIL MIXING LAYOUT – BUILDING 9
GI-4.6	DEEP SOIL MIXING LAYOUT – BUILDING 10
GI-4.7	DEEP SOIL MIXING LAYOUT – BUILDING 11
GI-4.8	DEEP SOIL MIXING LAYOUT – BUILDING 12
GI-5	GEOTECHNICAL SECTIONS

GROUND IMPROVEMENT DESGINER:	ADVANCED GEOSOLUTIONS, INC.
CIVIL ENGINEER:	TAIT & ASSOCIATES, INC.
STRUCTURAL ENGINEER:	KPFF
GEOTECHNICAL ENGINEER:	GMU GEOTECHNICAL, INC.

VICINITY MAP

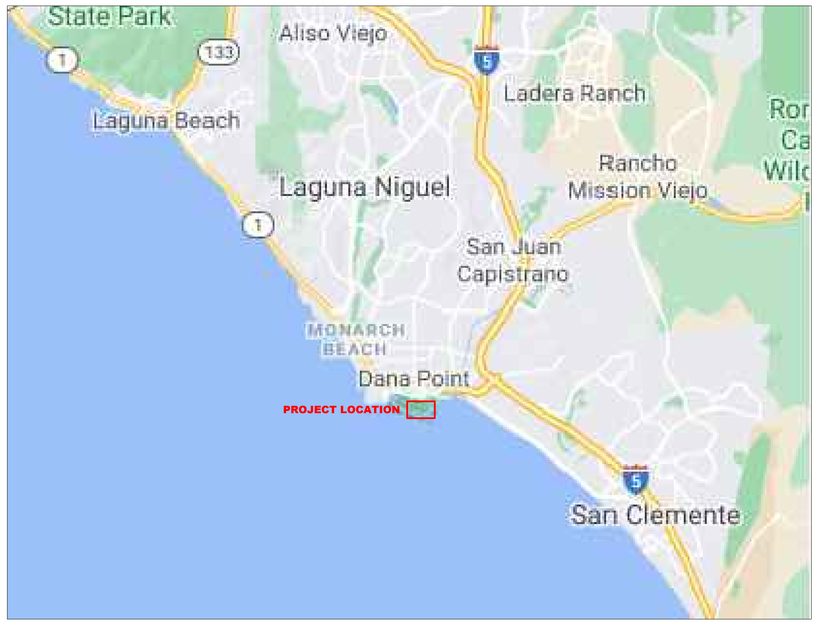

MAP DATA: GOOGLE 2020

LOCATION MAP

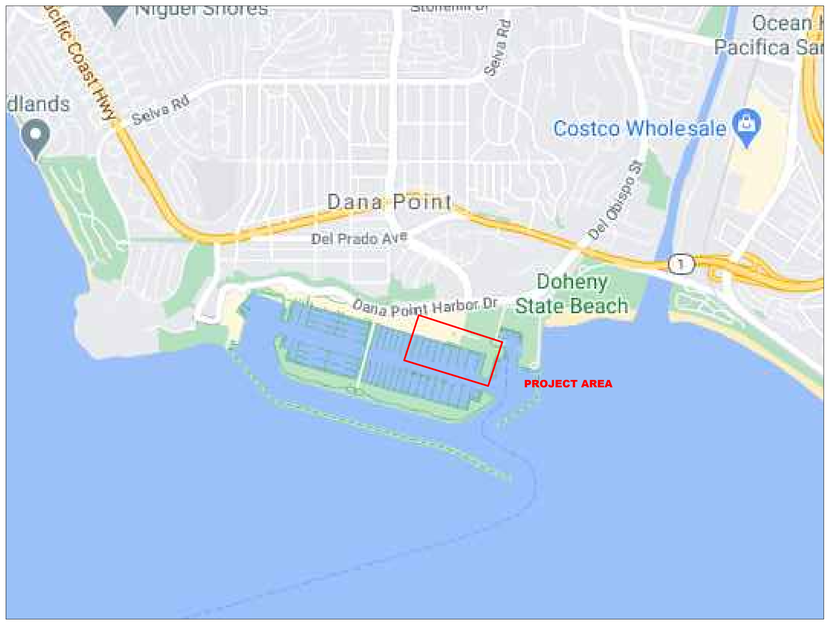

MAP DATA: GOOGLE 2020

AGI
ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TAIT C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

COVER SHEET

PROJECT NO.	–
DATE:	05/27/2021
SCALE:	AS SHOWN

SHEET NUMBER:

GI-1

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building Entity: Ryan Ross 1/18/2020
Approval: Geotechnical Reports
Permits:
SHA01-0248SHA01-0241SHA01-0242SHA01-0243

County of Orange - OC Public Works
OC Construction Services
APPROVED
Date: 1/18/2020
This approval is limited to the items listed on the approval letter and does not include any other work. By this approval the County of Orange does not authorize the violation of any law, ordinance, regulation or restriction which prohibits the use or occupancy of property for the purpose proposed. This approval does not prevent the County of Orange from requiring the correction of errors in the plans or from preventing operations being carried on thereunder when in violation of law or ordinance or in violation of the provisions of any permit granted.
Troy Donahue
Inspection Supervisor

PART 1 – GENERAL

1.1 SCOPE

A. DEEP SOILS MIXING (DSM) SHALL BE INSTALLED TO MITIGATE POTENTIAL FOR LATERAL SPREADING AND UNCERTAIN PERFORMANCE OF UNDOCUMENTED ARTIFICIAL FILL.

B. A LOAD TRANSFER PLATFORM (LTP) SHALL BE CONSTRUCTED THROUGHOUT ALL BUILDING FOOTPRINTS TO TRANSFER FLOOR SLAB LOADING TO UNDERLYING DSM COLUMNS AND PREVENT ADVERSE SETTLEMENT IN FLOOR SLAB AREAS THAT MAY RESULT FROM NEW LOADING APPLIED TO UNDERLYING UNDOCUMENTED ARTIFICIAL FILL.

C. THE DSM PLAN IS PREPARED IN ACCORDANCE WITH THE RECOMMENDATIONS OUTLINED IN THE GEOTECHNICAL REPORT PREPARED BY GMU DATED 5/27/2021.

D. THIS DESIGN IS BASED ON THE GEOTECHNICAL CHARACTERIZATION AND SOIL PARAMETERS PRESENTED IN THE REFERENCED GEOTECHNICAL REPORT, AS WELL AS LOAD REQUIREMENTS INDICATED ON THE STRUCTURAL DRAWINGS. THIS DESIGN WAS CONDUCTED IN A MANNER CONSISTENT WITH THE LEVEL OF CARE AND SKILL ORDINARILY EXERCISED BY MEMBERS OF THE GEOTECHNICAL ENGINEERING PROFESSION CURRENTLY PRACTICING UNDER SIMILAR CONDITIONS AND IN THE SAME LOCALITY. NO WARRANTY IS MADE NOR IMPLIED.

1.2 REFERENCES

A. GEOTECHNICAL INVESTIGATION REPORT, VOLUMES 1, 2, AND 3, DANA POINT HARBOR REVITALIZATION BUILDINGS 1 THROUGH 12, COMMERCIAL COMPONENT – REPORT NO. 17-206-02 PREPARED BY GMU DATED MAY 27, 2021.

B. ASTM C150 – SPECIFICATION FOR PORTLAND CEMENT

C. ASTM D1633 – STANDARD TEST METHODS FOR COMPRESSIVE STRENGTH OF MOLDED SOIL–CEMENT CYLINDERS

D. ASTM D4380 – DENSITY OF BENTONITE SLURRIES

F. FEDERAL HIGHWAY ADMINISTRATION DESIGN MANUAL: DEEP MIXING FOR EMBANKMENT, AND FOUNDATION SUPPORT, PUBLICATION NO. FHWA-HRT-13-046, OCTOBER 2013.

1.3 DEFINITIONS

A. DEEP SOIL MIXING (DSM) – A SOIL IMPROVEMENT TECHNIQUE USED TO CONSTRUCT IN SITU SOIL STRUCTURES OR TREAT SOILS IN PLACE, WITHOUT EXCAVATION OR DEWATERING. SOIL MIXING USES A LARGE, CRANE OR DRILL RIG – MOUNTED TURNTABLE TO INSERT A LARGE–DIAMETER (TYPICALLY 3– TO 8 –FOOT DIAMETER) TOOL INTO THE GROUND WHILE INJECTING AND MIXING A GROUT WITH THE SOIL. STABILIZED SOIL COLUMNS ARE CREATED THAT MAY BE JOINED TOGETHER BY OVERLAPPING TO FORM RETAINING WALLS OR FOUNDATION ELEMENTS, OR TO TREAT A LARGE BLOCK OF SOIL OR SLUDGE.

B. ASTM – ASTM INTERNATIONAL.

C. OWNER – THE OWNER AS REFERRED TO HEREIN IS DANA POINT HARBOR PARTNERS, LLC, C/O BURNHAM–WARD PROPERTIES.

D. ENGINEER – THE ENGINEER IS THE OWNER'S GEOTECHNICAL ENGINEER OF RECORD TO ACT ON ITS BEHALF IN THE EXECUTION OF THESE SPECIFICATIONS.

E. CONTRACTOR – REFERS TO THE GENERAL CONTRACTOR DIRECTLY CONTRACTED WITH THE OWNER AND SUBCONTRACTING THE DSM SCOPE TO THE DSM SUBCONTRACTOR.

F. DEEP SOIL MIXING SUBCONTRACTOR (DSM SUBCONTRACTOR) – AN INDIVIDUAL OR COMPANY WHO HAS HAD PROVEN AND SUCCESSFUL EXPERIENCE IN SOIL MIXING CONSTRUCTION.

G. GROUT – A STABLE COLLOIDAL SUSPENSION OF POWDERED CEMENT, BENTONITE, ADDITIVES AND/OR OTHER SIMILAR MATERIALS IN WATER. THE TERMS "GROUT" AND "SLURRY" ARE USED INTERCHANGEABLY IN THESE SPECIFICATIONS.

H. INJECTION RATIO – A VOLUMETRIC RATIO OF GROUT TO SOILS (E.G., 100 GALLONS/CUBIC YARD) TO BE MIXED IN A DSM COLUMN. THE GROUT INJECTION RATIO IS DETERMINED FOR EACH COLUMN BASED ON THE COLUMN DIMENSIONS, SOIL DENSITY, PATTERN OF TREATMENT, AND DESIRED APPLICATION RATE.

I. DSM COLUMN – ONE COMPLETED INSERTION, INJECTION AND MIXING OF THE SOIL WITH THE MIXING AUGER TO THE DESIGN DEPTH. THIS CREATES A COLUMN OF TREATED SOIL THE SAME DIAMETER AS THE MIXING AUGER. THE COLUMN MAY BE PRIMARY (THROUGH VIRGIN SOILS), SECONDARY (CONNECTING PRIMARY COLUMNS), TERTIARY, ETC.

J. WORKING PLATFORM – THE WORKING PLATFORM IS THE LEVELED AND STABLE SURFACE FROM WHICH THE DSM EQUIPMENT OPERATES.

K. MIXING AUGER/TOOL – THE SPECIAL TOOL THAT ATTACHES TO THE KELLY BAR AND IS INSERTED INTO THE GROUND TO MIX THE SOILS. THE TOOL MAY BE FITTED WITH PORTS FOR INJECTING GROUT, MIXING PADDLES, AUGER BLADES, ETC.

L. BLADE ROTATION NUMBER (BRN) – NUMBER OF BLADES X (RATE OF PENETRATION PLUS RATE OF WITHDRAWAL (IN REVOLUTIONS/METER). FOR EXAMPLE FOR 5 BLADES, RATE OF PENETRATION = 1 REVOLUTION/25 MM (40 REVOLUTIONS/M), AND RATE OF WITHDRAWAL = 1 REVOLUTION/20 MM (50 REVOLUTIONS/M), THE BRN = 5 X (40 + 50) = 450.

M. OBSTRUCTION – OBSTRUCTIONS ARE DEFINED AS MATERIALS CLASSIFIED AS UNDERGROUND UTILITIES, TREES (OR PARTS THEREOF), METAL, MAN–MADE OBJECTS, WOODEN/CONCRETE/STEEL OR ANY OTHER TYPE OF PILE OR DEEP FOUNDATION, OR NATURAL GROUND MATERIALS LARGER THAN A MAXIMUM COBBLE SIZE (8 INCHES MAXIMUM DIMENSION).

N. MIXING BLADE – A SINGLE MIXING BLADE SHALL CONSTITUTE A PAIR OF MIXING PADDLES ATTACHED TO THE SHAFT OF THE MIXING TOOL AT THE SAME ELEVATION. THE CUTTING PADDLES MAY ALSO BE CONSIDERED AS A MIXING BLADE.

O. DOSAGE – EXPRESSED AS THE MASS OF BINDER INTRODUCED PER VOLUME OF MIXED IN–SITU SOIL (E.G. KG/M^3).

1.4 SUBMITTALS

A. DSM WORK PLAN INCLUDING:

I. ASSIGNED NUMBER OF EACH COLUMN AS ID FOR INSTALLATION RECORD

II. NARRATIVE OF PLANNED MEANS AND METHODS TO EXECUTE THE INSTALLATION PER PLANS AND SPECIFICATIONS, INCLUDING SPECIFICATIONS OF THE GROUT BATCHING AND VERTICAL DRILL EQUIPMENT INTENDED FOR USE ON THE PROJECT.

III. NARRATIVE OF PLANNED MEANS AND METHODS TO EXECUTE THE QUALITY CONTROL REQUIREMENTS PER PLANS AND SPECIFICATIONS.

IV. PRELIMINARY SOIL MIX DESIGN INDICATING TYPE OF BINDER MATERIAL AND VOLUMETRIC PROPORTIONS FOR INITIAL TRIALS ON–SITE TO BE ADJUSTED BASED ON FIELD OBSERVATIONS AND EARLY STRENGTH RESULTS (SEE PART 3.2 TEST SECTION).

B. ACCURATE DAILY RECORDS OF THE WORK TO BE SUBMITTED BY CLOSE OF BUSINESS THE FOLLOWING DAY, INCLUDING:

I. COLUMN ID

II. DIAMETER

III. WORKING PAD ELEVATION

IV. MIXING DEPTH

V. START TIME

VI. TIME AT TIP ELEVATION

VII. FINISH TIME

VIII. MIXING DURATION

IX. GROUT MIX DETAILS (PERCENT WATER AND REAGENT BINDER)

X. GROUT INJECTION WITH DEPTH

XI. TOTAL INJECTED GROUT

XII. BLADE ROTATION NUMBER (BRN) WITH DEPTH

D. ANY PROPOSED CHANGE IN THE WORK PROCEDURES PLAN MADE NECESSARY BY CONDITIONS ENCOUNTERED DURING CONSTRUCTION FOR REVIEW AND APPROVAL BY THE ENGINEER.

E. MATERIAL CERTIFICATIONS FOR CEMENT BINDER TO BE USED IN THE PROJECT.

F. WEIGHTS: CERTIFICATES OF BATCH WEIGHTS FOR EACH TRUCK LOAD DELIVERED IF ON–SITE BATCH PLANT IS NOT USED.

G. ADMIXTURES/POZZOLANS/ADDITIVES SUBJECT TO THE APPROVAL OF THE ENGINEER, IF USED.

H. QC TEST RESULTS: SUBMIT ALL QC TEST RESULTS WITHIN 48 HOURS OF TESTING.

I. REPORT SUMMARIZING TEST SECTION RESULTS AND CALIBRATION OF DRILLING EFFORT CRITERIA FOR COLUMN DEPTH TERMINATION APPROVED BY THE ENGINEER.

J. AS–BUILT REPORT DOCUMENTING THE CONSTRUCTED LOCATIONS AND DIMENSIONS OF ALL DSM COLUMNS, COMPILATION OF ALL QUALITY CONTROL AND QUALITY ASSURANCE DATA COLLECTED FOR THE PROJECT, AND EXPLANATION OF ANY DEVIATION FROM THE PLANS AND SPECIFICATIONS PREVIOUSLY REVIEWED APPROVED TO THE SATISFACTION OF THE ENGINEER.

K. THE CONTRACTOR WILL SUBMIT A WORK PLAN DETAILING THE CONSTRUCTION AND QA/QC OF THE LTP, MEETING THE DESIGN REQUIREMENTS HEREIN AND IN THE GEOTECHNICAL REPORT.

1.5 ACCEPTANCE

A. ACCEPTANCE OF THE DSM WORK WILL BE BASED ON COMPLIANCE WITH THE STRENGTH AND GEOMETRY REQUIREMENTS OF THE PLANS AND SPECIFICATIONS AS VERIFIED BY THE ENGINEER'S QA TESTING. THE MATERIAL FORMED BY MIXING THE GROUT WITH THE IN SITU SOIL SHALL MEET A MINIMUM REQUIRED UNCONFINED COMPRESSIVE STRENGTH OF 150 POUNDS PER SQUARE INCH (PSI) AT 28 DAYS. TESTS WILL BE CONSIDERED PASSING IF THEY ARE AT LEAST 90% OF THE 150 PSI STRENGTH REQUIREMENT PROVIDED THAT NO MORE THAN 10% OF ALL TESTS FALL BELOW THE REQUIREMENT AND THE OVERALL AVERAGE STRENGTH EXCEEDS THE REQUIREMENT. IF THE UNCONFINED COMPRESSIVE STRENGTH RESULTS DO NOT MEET THAT CRITERIA, THE DSM SUBCONTRACTOR SHALL SUBMIT A MITIGATION PLAN FOR REVIEW AND APPROVAL BY THE ENGINEER.

PART 2 – PRODUCTS

2.1 MATERIALS

A. FRESH OR RECLAIMED WATER, FREE OF ANY DELETERIOUS SUBSTANCE THAT COULD ADVERSELY AFFECT THE GROUT PROPERTIES SHALL BE USED.

B. BINDER AGENT USED FOR THE PROJECT SHALL CONSIST OF PORTLAND CEMENT TYPE II/V CONFORMING TO ASTM DESIGNATION C150. THE CEMENT SHALL BE ADEQUATELY PROTECTED FROM MOISTURE AND CONTAMINATION WHILE IN TRANSIT AND STORAGE AT THE JOB SITE. RECLAIMED CEMENT OR CEMENT CONTAINING LUMPS OR DELETERIOUS MATTER SHALL NOT BE USED.

C. THE WATER AND CEMENT SHALL BE PREMIXED TO FORM A GROUT FOR INJECTION AND MIXING WITH THE IN–SITU SOIL. MATERIALS SHALL BE COMBINED IN PREDETERMINED WEIGHED PROPORTIONS WITH ITS QUALITY EVALUATED BY SPECIFIC GRAVITY MONITORED AT LEAST ONCE PER INSTALLATION BY MUD BALANCE.

D. THE DESIGN UNCONFINED COMPRESSIVE STRENGTH OF THE SOIL–CEMENT MATERIAL COMPRISING THE DSM COLUMNS IS 150 PSI AT 28 DAYS.

PART 3 – EXECUTION

3.1 EQUIPMENT

A. A PURPOSE BUILT HOLLOW STEM AND MIXING PADDLE TOOL ATTACHED TO A HIGH TORQUE ROTARY DRILL ON TRACKS SHALL BE USED TO ACCOMPLISH THE DSM. MIXING TOOLS OF 4– AND 6–FOOT–DIAMETER WILL BE IMPLEMENTED FOR THIS PROJECT. MIXING TOOLS SHALL CONSIST OF A MINIMUM OF FOUR (4) MIXING BLADES (4 PAIRS OF MIXING PADDLES).

B. CEMENT WILL BE STORED IN PURPOSE BUILT SILOS.

C. WATER SHALL BE MIXED WITH CEMENT IN A PURPOSE–BUILT WEIGH–BATCH MIXER TO PRODUCE SLURRY WITH A CONSISTENT SPECIFIC GRAVITY OR WATER:CEMENT RATIO FOR PROPER MIXING. JET VALVE MIXING OR OTHER CONTINUOUS MIXING METHODS WILL NOT BE ALLOWED.

D. GROUT SHALL BE DELIVERED TO THE MIXING RIG BY APPROPRIATELY SIZED POSITIVE DISPLACEMENT PUMPS. PROGRESSIVE CAVITY PUMPS SHALL NOT BE ALLOWED.

3.2 TEST SECTION

A. LOCATIONS: PRIOR TO INITIATING PRODUCTION WORK, DSM SUBCONTRACTOR SHALL INSTALL A MINIMUM OF TWO DSM COLUMNS WITH VARYING MIX DESIGN DOSAGE AT EACH OF THE SIX TEST SECTION LOCATIONS INDICATED ON THE PLANS.

B. EVALUATION GOALS: THE PURPOSE OF THE TEST SECTION IS TO EVALUATE THE FOLLOWING ITEMS PRIOR TO INITIATING PRODUCTION WORK. THE DSM SUBCONTRACTOR MAY PROCEED IMMEDIATELY TO PRODUCTION WHILE TEST SECTION EVALUATION RESULTS ARE PENDING BUT DOES SO AT ITS OWN RISK.

I. COLUMN DEPTH: COLUMN INSTALLATION DEPTHS FOR THE PROJECT ARE CONTROLLED BY THE DEPTH TO THE CAPISTRANO FORMATION CONTACT AS DESCRIBED IN SECTION 3.3.G. DURING TEST SECTION INSTALLATION ADJACENT TO EXISTING EXPLORATION DATA, DSM SUBCONTRACTOR SHALL MONITOR AND RECORD INDICATORS OF DRILLING EFFORT (E.G. ROTARY TORQUE APPLIED AND CROWD PRESSURE). DSM SUBCONTRACTOR SHALL PROPOSE A READILY IDENTIFIABLE METRIC SUBJECT TO THE ENGINEER'S APPROVAL FOR THE DRILL OPERATOR TO OBSERVE DURING INSTALLATION AS EVIDENCE OF ENCOUNTERING THE CAPISTRANO FORMATION.

II. MIX CONSISTENCY: DURING TEST SECTION MIXING THE DSM SUBCONTRACTOR AND ENGINEER SHALL OBSERVE

III. STRENGTH: A MINIMUM OF TWO WET–GRAB SAMPLES SHALL BE COLLECTED FROM EACH TEST SECTION COLUMN INSTALLED AT DEPTHS OF 1/3 AND 2/3 THE TOTAL INSTALLATION DEPTH. EACH SAMPLE COLLECTED SHALL BE CAST INTO CYLINDERS FOR UNCONFINED COMPRESSION STRENGTH TESTING AND EVALUATION AS DESCRIBED IN SECTION 3.4.B.

IV. LOAD TEST: DSM SUBCONTRACTOR SHALL CONDUCT A MINIMUM OF FOUR LOAD TESTS PER THE REQUIREMENTS OF THIS SPECIFICATION TO ASSESS THE 4–FOOT–DIAMETER DSM COLUMN GEOTECHNICAL CAPACITY ADJACENT TO EXPLORATORY TEST DATA. SEE PROPOSED LOAD TEST LOCATIONS ON SHEET GI–3.

3.3 CONSTRUCTION

A. INSTALL DSM COLUMNS AT THE LOCATIONS AND TO THE DEPTH INDICATED ON THE DSM PLAN.

B. HORIZONTAL ALIGNMENT: THE DSM COLUMNS SHALL BE CAREFULLY SURVEYED AND STAKED OUT PRIOR TO INSTALLATION. THE COLUMNS SHALL BE CONSTRUCTED WITHIN 4 INCHES OF THE LOCATIONS SHOWN ON THE DRAWINGS.

C. VERTICAL ALIGNMENT: VERTICAL ALIGNMENT OF THE AUGER STROKE WILL BE CONTROLLED BY THE EQUIPMENT OPERATOR. THE COLUMN VERTICALITY SHALL HAVE A TOLERANCE OF 1:50 MAXIMUM DEVIATION.

D. MIXING SHAFT SPEED: THE MIXING SHAFT SPEED (RPMS) SHALL BE ADJUSTED TO ACCOMMODATE AN ADEQUATE RATE OF MIXING SHAFT PENETRATION BASED ON THE DEGREE OF DRILLING DIFFICULTY. THE MIXING SHAFT SPEED CAN BE ADJUSTED ACCORDING TO DRILLING DIFFICULTY.

E. BOTTOM MIXING: THE BOTTOM OF THE COLUMNS SHALL BE DOUBLE MIXED BY RAISING THE MIXING SHAFTS FIVE FEET OFF THE BOTTOM AND THEN REINSERTING THEM FOR REMIXING.

F. GROUT TAKE: THE GROUT TAKE (OR INJECTION RATE) PER VERTICAL FOOT OF COLUMN WILL BE ADJUSTED TO THE REQUIREMENTS OF THE DESIGN MIX. APPROPRIATE DELIVERY PUMPS SHALL BE USED TO TRANSFER THE GROUT FROM THE MIX PLANT TO THE DSM RIG. A FLOW MONITORING DEVICE WILL BE INSTALLED IN THE GROUT LINE TO DETECT LINE BLOCKAGE AND ELECTRONICALLY RECORD INJECTION RATES AND VOLUMES VERSUS DEPTH AND TIME FOR QUALITY CONTROL MONITORING.

I. THE RATE OF APPLICATION MAY BE CONTROLLED AND MONITORED BY ADJUSTING THE PUMP OUTPUT TO THE PENETRATION RATE SO THAT A PRESET GROUT TAKE CAN BE ACHIEVED. TYPICALLY, THE APPLICATION RATE CAN BE SUCCESSFULLY CONTROLLED BY EXPERIENCED OPERATORS ONCE THE PATTERN OF OPERATION IS ESTABLISHED.

II. SOME VARIATIONS OF THE GROUT TAKE WILL OCCUR DUE TO FIELD CONDITIONS. HOWEVER, THE OVERALL APPLICATION RATE TO EACH STROKE CAN BE MONITORED, CALCULATED AND CONTROLLED. ADDITIONAL MIXING IS TO BE USED WHEN NECESSARY TO DISTRIBUTE THE GROUT THROUGH THE ENTIRE COLUMN. THE INJECTION OF GROUT TO EACH STROKE WILL BE MONITORED, CHECKED BY CALCULATION AND RECORDED.

G. COLUMN DEPTH:

I. BUTTRESS COLUMNS: COLUMNS INSTALLED FOR THE LATERAL SPREAD BUTTRESS SHALL BE INSTALLED TO A MINIMUM OF 4 FEET BEYOND THE CAPISTRANO FORMATION CONTACT AS IDENTIFIED BASED ON THE DRILLING EFFORT CALIBRATION PERFORMED DURING THE TEST SECTION WORK AND SUBJECT TO THE APPROVAL OF THE ENGINEER. PRACTICAL REFUSAL (AS DEFINED IN SECTION 3.3.H) ENCOUNTERED PRIOR TO ACHIEVING THE REQUIRED 4–FOOT EMBEDMENT INTO CAPISTRANO FORMATION MAY BE APPROVED BY THE ENGINEER ON A CASE–BY–CASE BASIS BUT THE DSM SUBCONTRACTOR SHALL BE PREPARED TO INITIATE PREDRILLING IF NEEDED TO ACHIEVE THE REQUIRED EMBEDMENT AT NO ADDITIONAL COST TO THE OWNER.

II. BUILDING SUPPORT COLUMNS: DSM COLUMNS INTENDED FOR SUPPORT OF THE RETAIL BUILDINGS SHALL BE INSTALLED TO A MINIMUM OF 1 FOOT BEYOND THE CAPISTRANO FORMATION CONTACT OR TO PRACTICAL REFUSAL. MEANS OF IDENTIFYING THE CAPISTRANO FORMATION CONTACT WILL BE BASED ON THE DRILLING EFFORT CALIBRATION PERFORMED DURING THE TEST SECTION WORK AND SUBJECT TO THE APPROVAL OF THE ENGINEER.

H. OBSTRUCTION/MIXING SHAFT PRACTICAL REFUSAL: IF OBSTRUCTIONS ARE ENCOUNTERED WHICH REDUCE THE RATE OF PENETRATION TO ONE FOOT PER MINUTE FOR TWO MINUTES UNDER FULL POWER, THE STROKE SHALL BE COMPLETED IN ACCORDANCE WITH THE SPECIFICATIONS AND REMEDIAL MEASURES WILL BE TAKEN. SUBCONTRACTOR SHALL NOTIFY CONTRACTOR TO INVESTIGATE, CONFIRM, AND REMOVE SAID OBSTRUCTIONS FROM THE SOIL MIXING AREA. ONCE CONTRACTOR REMOVES OBSTRUCTIONS AND BACKFILLS AND COMPACTS (IN LIFTS NOT TO EXCEED 3 FEET IN UNCOMPACTED THICKNESS) THE REMOVAL AREA WITH GRANULAR SAND OR SANDY GRAVEL MATERIAL, THE DSM SUBCONTRACTOR SHALL RETURN TO MIXING THE BACKFILLED AREAS AND REMAINING DSM COLUMNS PER PLANS AND SPECS. IF REMOVAL OF OBSTRUCTIONS BY CONTRACTOR DAMAGES A PREVIOUSLY INSTALLED DSM COLUMN, ASSOCIATED RE–INSTALLATION WORK SHALL BE COMPENSATED BY AS EXTRA AT THE CONTRACT UNIT PRICES. IF IT IS INFEASIBLE OR IMPRACTICAL TO CLEAR AN OBSTRUCTION FROM A DESIGN INSTALLATION LOCATION, CONTRACTOR MAY PROPOSE A MODIFICATION TO THE DESIGN PROVIDED THE ORIGINAL PERFORMANCE IS MAINTAINED SUBJECT TO THE REVIEW AND APPROVAL OF THE ENGINEER.

I. MIXING ENERGY: THE DSM SUBCONTRACTOR SHALL MIX EACH COLUMN WITH SUFFICIENT MIXING ENERGY THROUGHOUT TO PROPERLY PROCESS THE SOIL CEMENT PRODUCT. THE MIXING ENERGY SHALL BE DEMONSTRATED BY MEASURED AND RECORDED BRN REPORTED FOR EACH INSTALLATION AND THE MIXING ENERGY APPLIED SHALL MINIMALLY ACHIEVE THAT REQUIRED TO PRODUCE SATISFACTORY RESULTS DURING THE TEST SECTION.

J. NO EXCAVATION OR HEAVY GRADING BY CONTRACTOR SHALL PROCEED PRIOR TO 3 DAYS AFTER DSM COLUMN CONSTRUCTION UNLESS APPROVED BY THE DSM DESIGN ENGINEER.

K. UTILITY TRENCH: EXCAVATE THE COMPLETED DSM COLUMNS AS NECESSARY FOR UNDERGROUND UTILITIES. TRENCH BACKFILL WILL BE AS FOLLOW:

I. FOR TRENCHES CUT INTO BUTTRESS DSM AND ABOVE GWT: BACKFILL WILL NATIVE SOILS OR AS APPROVED BY THE ENGINEER.

II. FOR TRENCHES CUT INTO BUTTRESS DSM AND EXTEND BELOW GWT: BACKFILL WITH CEMENT SLURRY WITH COMPRESSIVE STRENGTH OF AT LEAST 300 PSI.

III. UTILITIES TRENCHES WILL AVOID CUTTING INTO THE DISCRETE 4' DIAMETER DSM COLUMNS SUPPORTING BUILDINGS AND SLABS.

L. MANAGEMENT OF SPOIL TO BE COORDINATED BETWEEN CONTRACTOR AND DSM SUBCONTRACTOR.

3.4 QUALITY CONTROL AND QUALITY ASSURANCE

A. PRIOR TO CONSTRUCTION, A PRELIMINARY MIX DESIGN SHALL BE GENERATED BY THE SUBCONTRACTOR. THE MIX DESIGN MAY BE OBTAINED BASED ON SITE SOILS AND LABORATORY TESTING, OR ALTERNATIVELY, BASED ON THE SUBCONTRACTORS DATABASE IN SIMILAR SOIL CONDITIONS AND STRENGTH REQUIREMENTS.

B. WET SAMPLING: THE DSM SUBCONTRACTOR SHALL OBTAIN WET BULK SAMPLES OF THE SOIL CEMENT MIX AND CAST IT IN CYLINDERS FOR SUBSEQUENT QUALITY CONTROL TESTING BY THE DSM SUBCONTRACTOR, AND QUALITY ASSURANCE TESTING AND ACCEPTANCE BY THE ENGINEER.

I. ONE SAMPLE WILL BE RETRIEVED PER WORK DAY PER RIG.

II. THE VOLUME OF SAMPLE RECOVERED DURING EACH SAMPLING SHALL BE SUFFICIENT TO CAST 6 SAMPLE CYLINDERS EACH MEASURING 3" DIAMETER BY 6" HIGH. A ½" SIEVE WILL BE USED TO SCREEN THE MATERIAL IN ORDER TO FACILITATE APPROPRIATE SCALING OF INCLUSIONS AND PROPER MODELING OF THE 3 INCH CYLINDERS.

III. OF THE 6 CYLINDERS CAST, 3 WILL BE PROVIDED TO THE ENGINEER FOR QUALITY ASSURANCE TESTING AND 3 WILL BE RETAINED BY THE DSM SUBCONTRACTOR FOR QUALITY CONTROL TESTING.

IV. TO AVOID DISTURBANCE, THE CYLINDERS ARE TO BE CURED ON SITE IN A COOLER WITH A SMALL AMOUNT OF WATER TO MAINTAIN A STABLE, COOL AND MOIST CURING ENVIRONMENT FOR 2 DAYS.

V. AFTER QUALITY ASSURANCE SAMPLES ARE RETRIEVED BY THE ENGINEER, ALL WET GRAB SAMPLES SHALL BE STORED IN A MOIST ROOM (NOT SUBMERGED) IN ACCORDANCE WITH ASTM C 192 UNTIL THE TEST DATE.

VI. THE QUALITY CONTROL SAMPLES WILL BE TESTED (BY THE DSM SUBCONTRACTOR) FOR UCS IN ACCORDANCE WITH ASTM D1633, AT 3–DAY, 7–DAY, AND 14–DAY AFTER CASTING. THE RESULTS WILL BE USED TO EXTRAPOLATE THE EXPECTED STRENGTH AT 28–DAYS.

VII. THE QUALITY ASSURANCE SAMPLES WILL BE TESTED (BY THE ENGINEER) FOR UCS IN ACCORDANCE WITH ASTM D1633, AT 7–DAY, 14–DAY, AND 28–DAY AFTER CASTING.

VII. WHEN TIME OR SCHEDULE DOES NOT PERMIT A 28–DAY CURING STRENGTH EVALUATION, THE FOLLOWING UCS AGING CORRELATION WILL BE TENTATIVELY APPLIED TO THIS JOB:

28 : 7 DAY, 1.57

VIII. THE ABOVE CORRELATION MAY BE ADJUSTED FOR SITE–SPECIFIC FINDINGS AS THE PROJECT DEVELOPS.

IX. THE DESIGN STRENGTH FOR THIS PROJECT AT 28–DAYS IS 150 PSI. SUBJECT TO THE APPROVAL OF THE ENGINEER, 7–DAY TEST RESULTS MAY BE ACCEPTED BASED ON THE CORRELATION ABOVE OR A REVISED CURING FACTOR BASED ON PROJECT–SPECIFIC STATISTICAL ANALYSIS OF AVAILABLE DATA.

C. LOAD TEST:

I. DSM SUBCONTRACTOR SHALL PERFORM A MINIMUM OF FOUR COMPRESSION LOAD TEST ON 4–FOOT–DIAMETER COLUMNS AT THE TEST SECTION LOCATION SPECIFIED FOR THE BUILDINGS ON THE DRAWINGS.

II. COMPRESSION LOAD TEST SHALL BE IN GENERAL ACCORDANCE WITH ASTM D1143. THE TEST COLUMN SHALL BE CONDUCTED TO AT LEAST 150% OF THE STATIC DESIGN LOAD.

III. LOAD TEST WILL NOT BE PERFORMED BEFORE THE COLUMN HAS ACHIEVED SUFFICIENT UNCONFINED COMPRESSIVE STRENGTH AS DEMONSTRATED BY LABORATORY TESTING ON WET GRAB SAMPLES.

D. OBSERVATION: A REPRESENTATIVE OF THE ENGINEER SHALL BE PRESENT FULL–TIME DURING ALL INSTALLATION WORK TO OBSERVE THE CONSTRUCTION OF THE DSM COLUMNS, SAMPLING, AND TESTING TO VERIFY THE DSM SUBCONTRACTOR PERFORMS THE WORK IN SUBSTANTIAL CONFORMANCE WITH THESE SPECIFICATIONS. THE ENGINEER SHALL MAINTAIN PARALLEL HAND RECORDS OF PERTINENT INSTALLATION DATA FOR COMPARISON WITH REPORTED INSTALLATION LOGS AND OBTAIN TEST SPECIMENS OF THE WET–SAMPLES COLLECTED FOR QUALITY ASSURANCE TESTING.

END OF SECTION

COMPRESSION TEST LOADING SCHEDULE		
DESIGN LOAD =	200	KIPS
PERCENT OF DL	LOAD VALUE	HOLD DURATION
(%)	(KIP)	(MIN)
5%	10	4
10%	20	4
15%	30	4
20%	40	4
25%	50	4
30%	60	4
35%	70	4
40%	80	4
45%	90	4
50%	100	4
55%	110	4
60%	120	4
65%	130	4
70%	140	4
75%	150	4
80%	160	4
85%	170	4
90%	180	4
95%	190	4
100%	200	4
105%	210	4
110%	220	4
115%	230	4
120%	240	4
125%	250	4
130%	260	4
135%	270	4
140%	280	4
145%	290	4
150%	300	4
125%	250	4
100%	200	4
75%	150	4
50%	100	4
25%	50	4
5%	10	4
0%	0	-

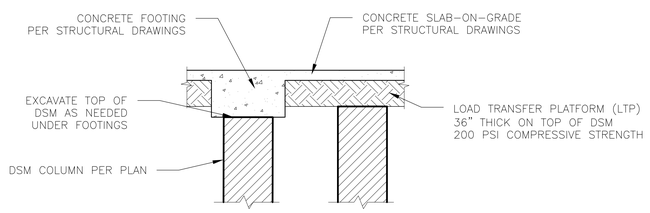

TYPICAL BUILDING SUPPORT DETAIL
SCALE: NTS

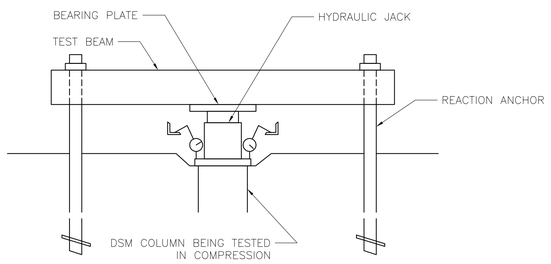

LOAD TEST SETUP
SCALE: NTS

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER
THOMAS TRAN
C 91763
CIVIL
STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

GENERAL NOTES AND DETAILS

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-2

S:\Leads\Dana Point Harbor (19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSH-B24BDMR21-02H1BMR21-02H2BMR21-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
Use of this plan is conditioned upon the acceptance of the County of Orange and its officers, agents and employees of any and all liability arising from the use of this plan. By using this plan or any part thereof, the user agrees to indemnify and hold harmless the County of Orange and its officers, agents and employees from any and all claims, actions, suits, or other proceedings arising out of the use of this plan or any part thereof.
Troy Tomlinson
Inspection Services

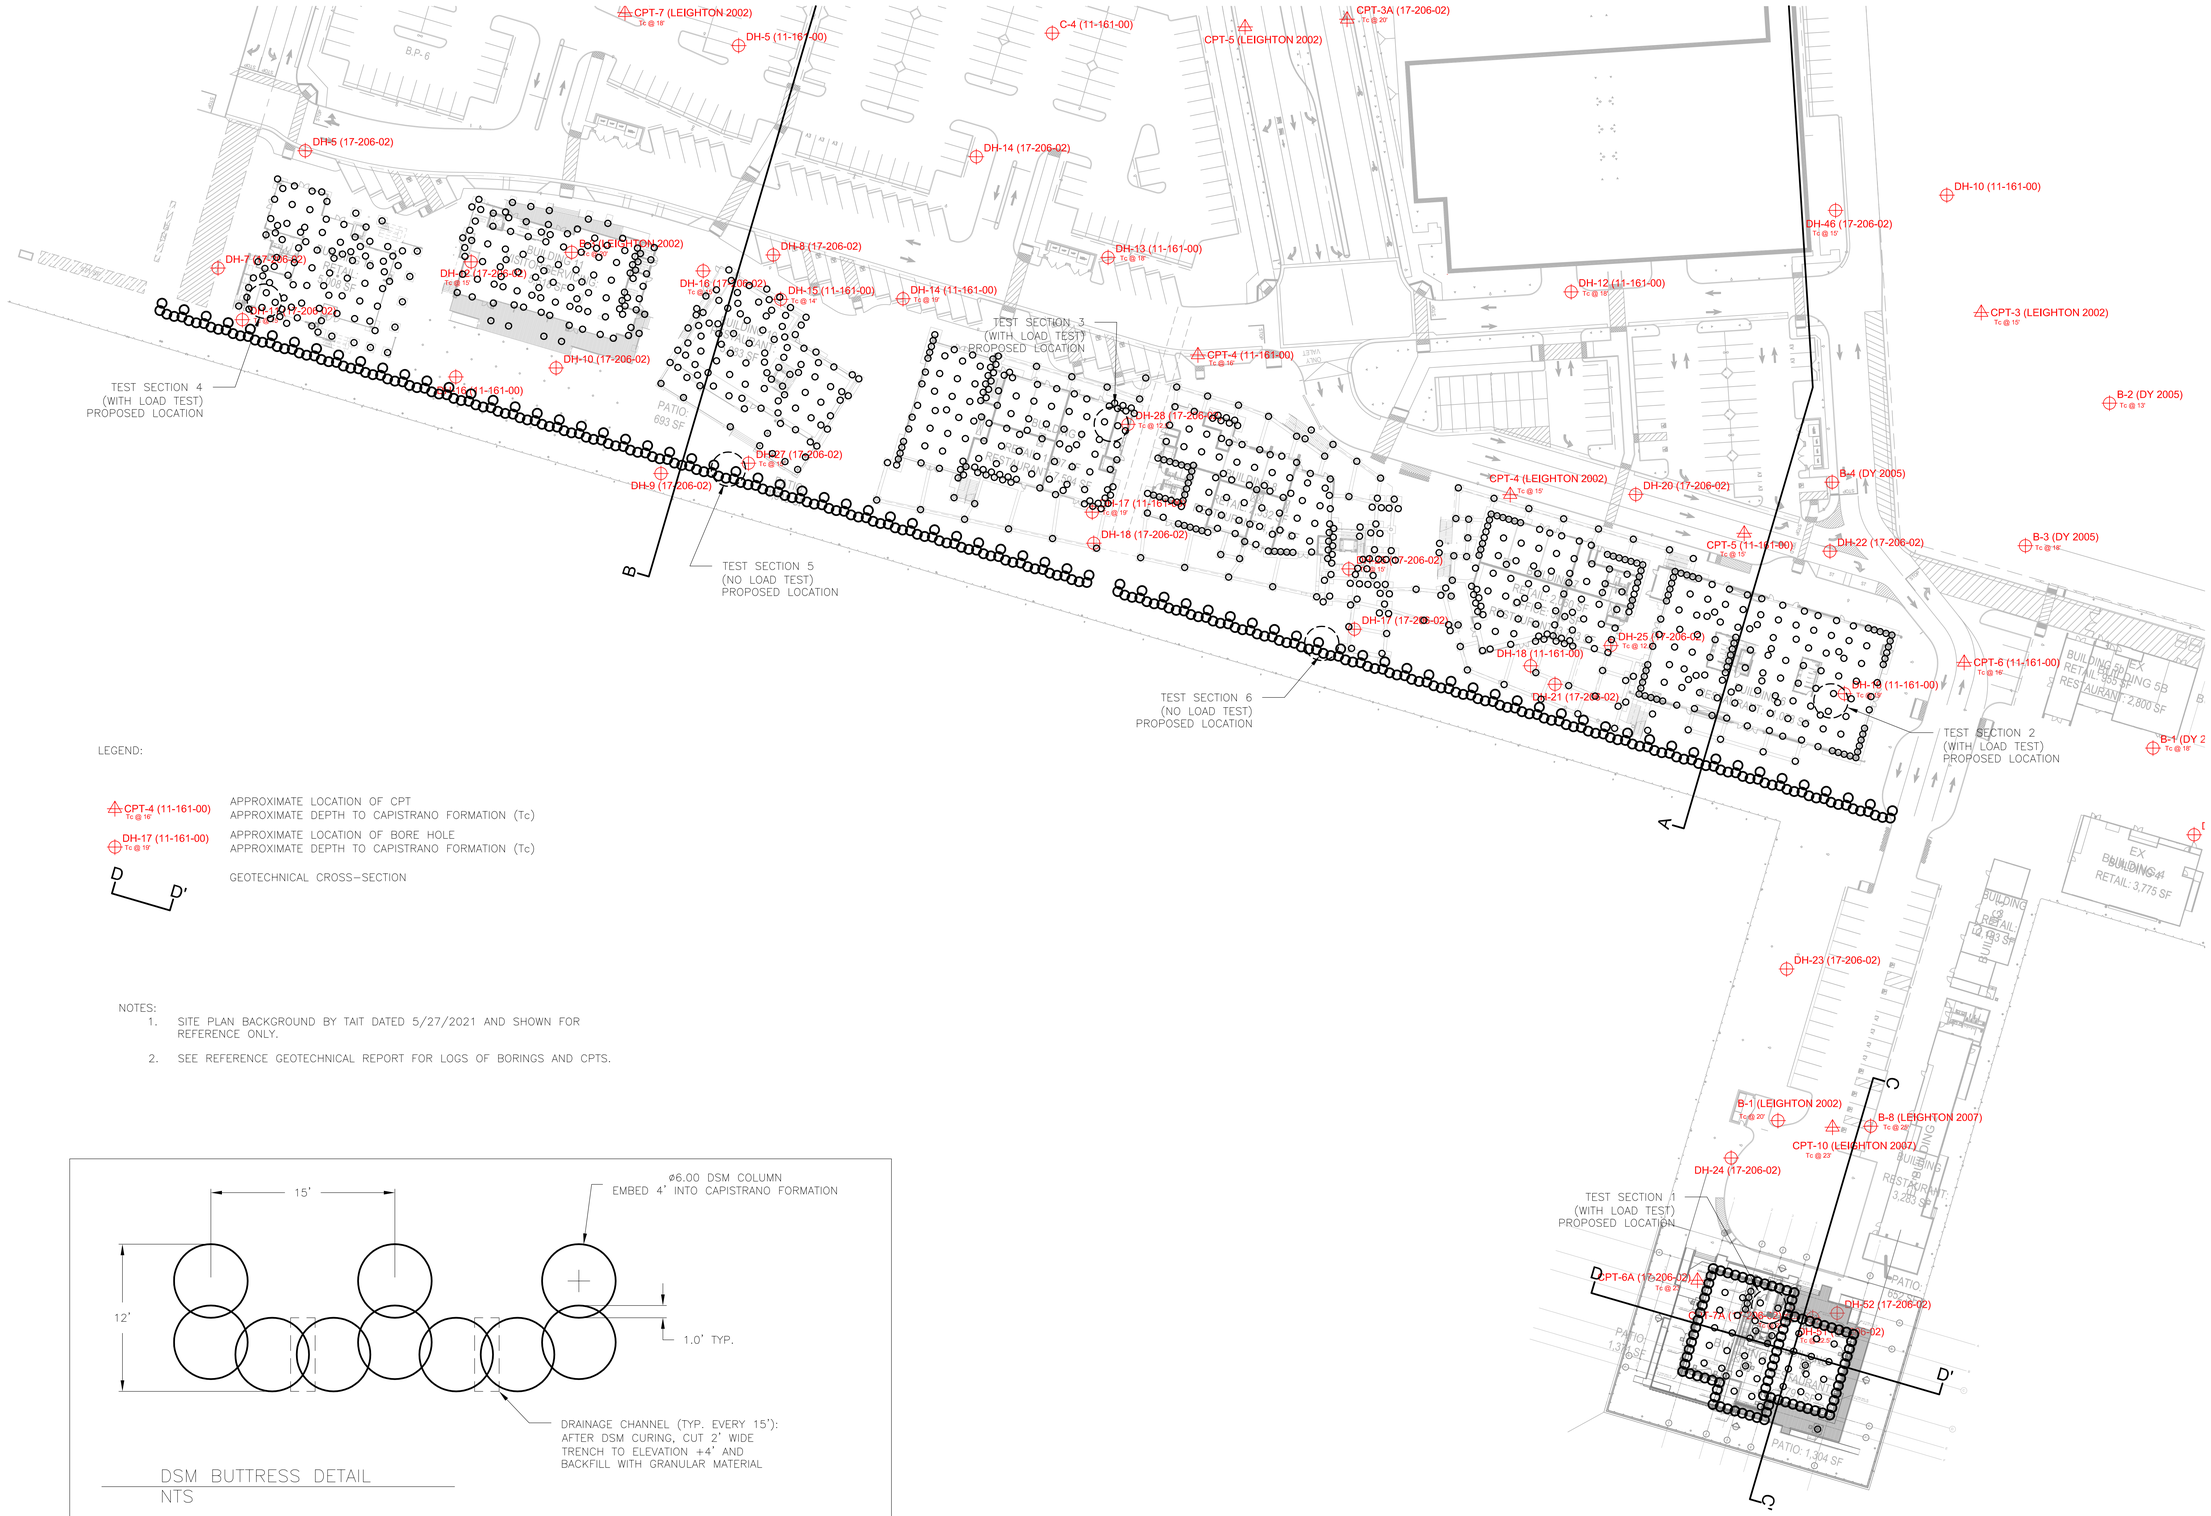

LEGEND:

CPT-4 (11-161-00) Tc @ 16' — APPROXIMATE LOCATION OF CPT
APPROXIMATE DEPTH TO CAPISTRANO FORMATION (Tc)

DH-17 (11-161-00) Tc @ 19' — APPROXIMATE LOCATION OF BORE HOLE
APPROXIMATE DEPTH TO CAPISTRANO FORMATION (Tc)

D D' — GEOTECHNICAL CROSS-SECTION

NOTES:
1. SITE PLAN BACKGROUND BY TAIT DATED 5/27/2021 AND SHOWN FOR REFERENCE ONLY.
2. SEE REFERENCE GEOTECHNICAL REPORT FOR LOGS OF BORINGS AND CPTS.

DSM BUTTRESS DETAIL
NTS

DSM PLAN
SCALE: 1" = 40'

N

0' 40' 80'
SCALE: 1"=40'

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:
GROUND IMPROVEMENT FOR
DANA POINT HARBOR COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:
DEEP SOIL MIXING PLAN

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-3

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSC-024839-R21-024139-BMSC-024839-R21-0240

County of Orange OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
This approval is conditioned upon all applicable laws and regulations being complied with during development whether or not they are set forth in this approval. By using this document the applicant accepts responsibility for all requirements of the approved plans and permit and is responsible for notifying his employees and subcontractors of them.
Jay Crittenden
714.667.8726

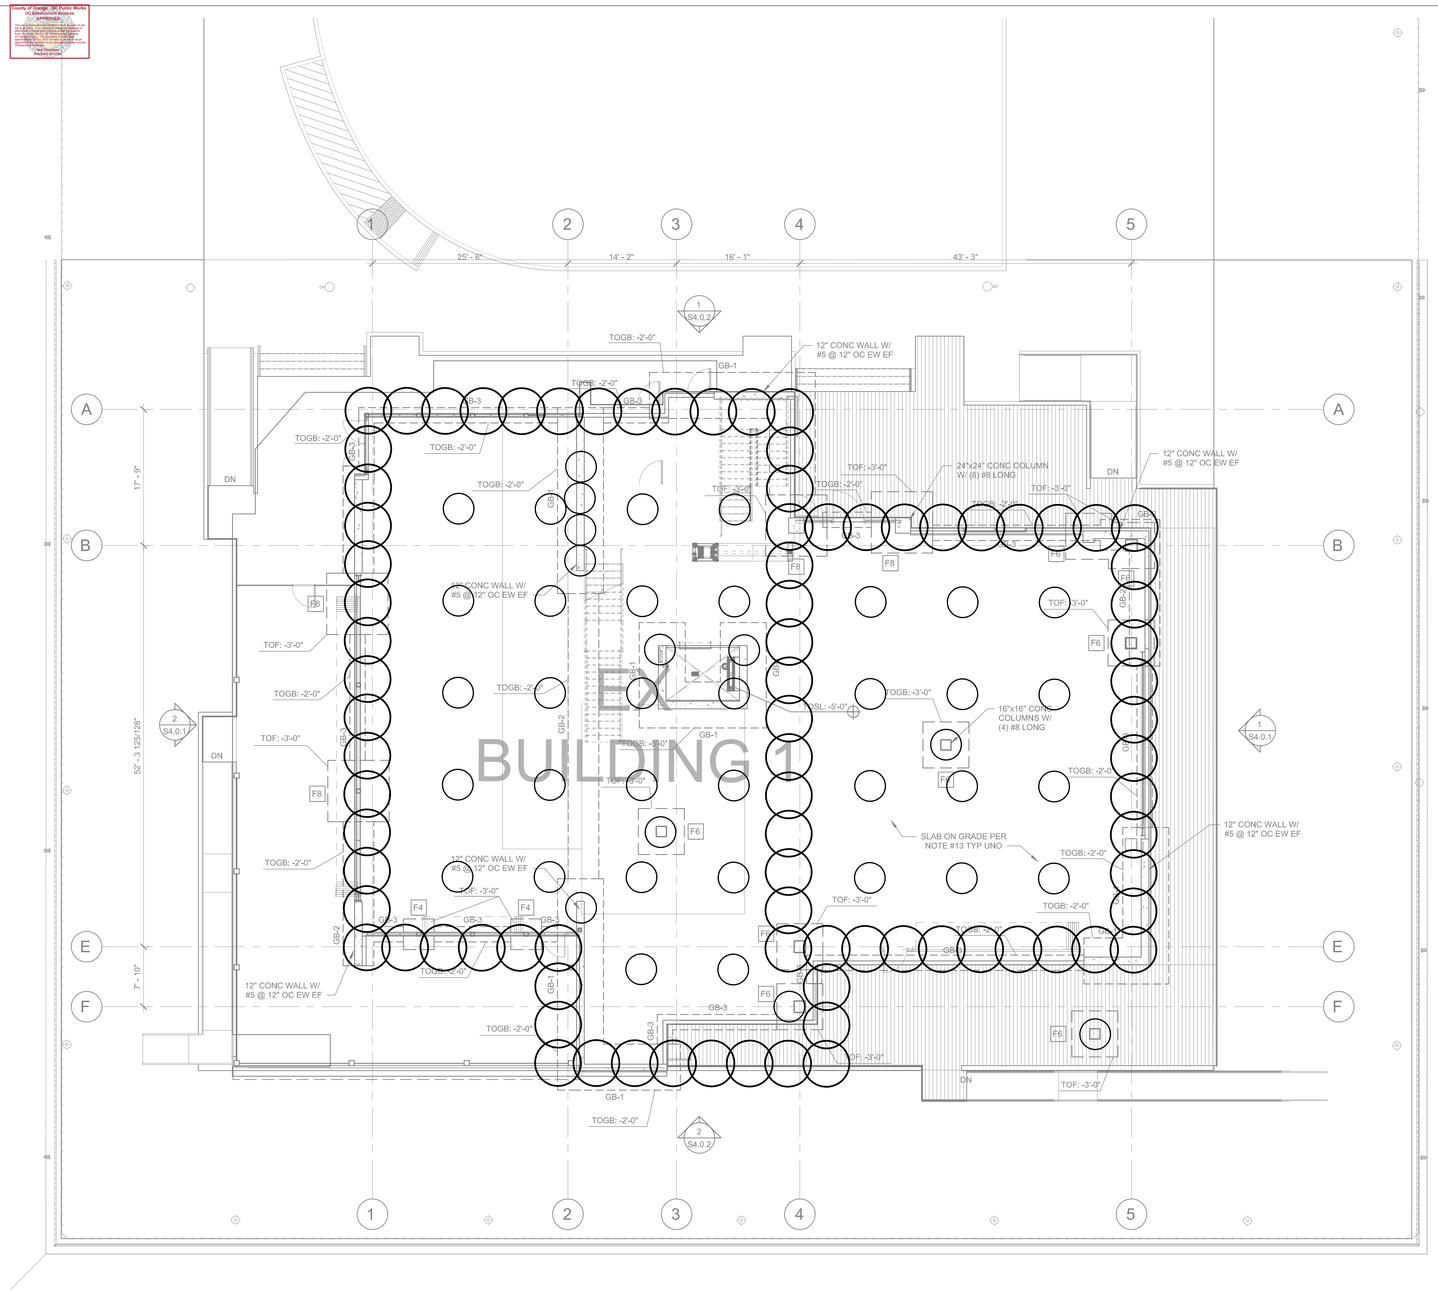

DSM COLUMN LAYOUT – BUILDING 1
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø BEARING ON CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 10/8/2020 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 1

PROJECT NO.	SHEET NUMBER:
–	GI-4.1
DATE: 05/27/2021	
SCALE: AS SHOWN	

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP: 0140BMEP-02H1BMEP-02H2BMEP-02H3

County of Orange - OC Public Works
OC Development/Environmental Services
APPROVED
This plan has been reviewed for conformance with the County of Orange Local Drainage Manual and the Model Water Quality Management Plan (WQMP). Approval does not relieve the owner, engineer, or agent of responsibility for errors, omissions, or variations from the requirements of the Local Drainage Manual or the approved WQMP. Approval does not authorize work within the County right-of-way.
By: Date:
PERMIT #:

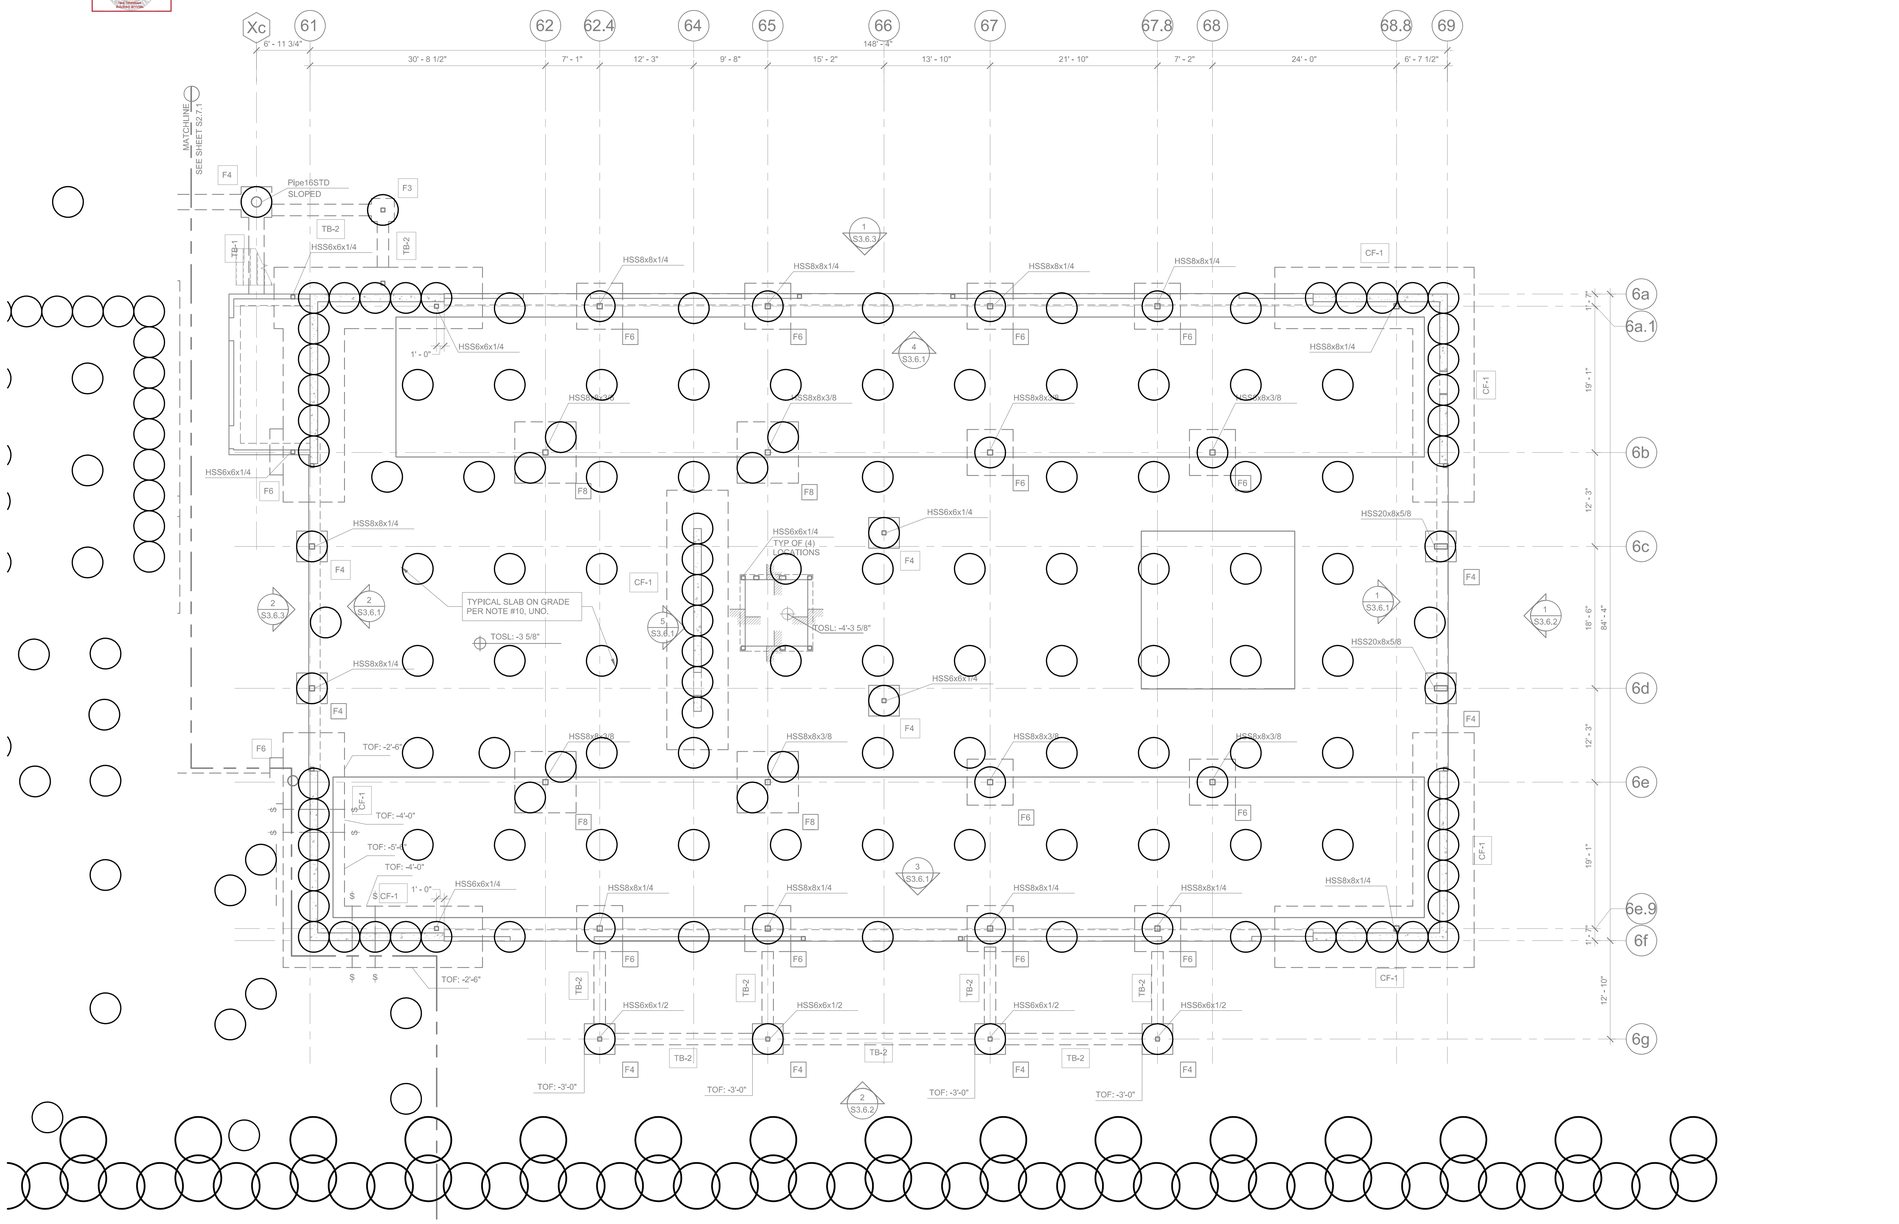

DSM COLUMN LAYOUT – BUILDING 6
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 STATE OF CALIFORNIA CIVIL

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 6

PROJECT NO. –

DATE: 05/27/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.2

S:\Leeds\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-1924BSWR21-02A1BMEP-1924BSWR21-02A2

County of Orange - OC Public Works
OC Development/Environmental Resources
APPROVED
Date: 1/19/2020
This approval is conditioned upon all applicable laws and regulations being complied with during the development of the project. Approval does not constitute building permit or authorization for construction. Other agency approval may be required.
Permit Authority: Land Development
By: Tim Dimmitt
Expires: 1/19/2021

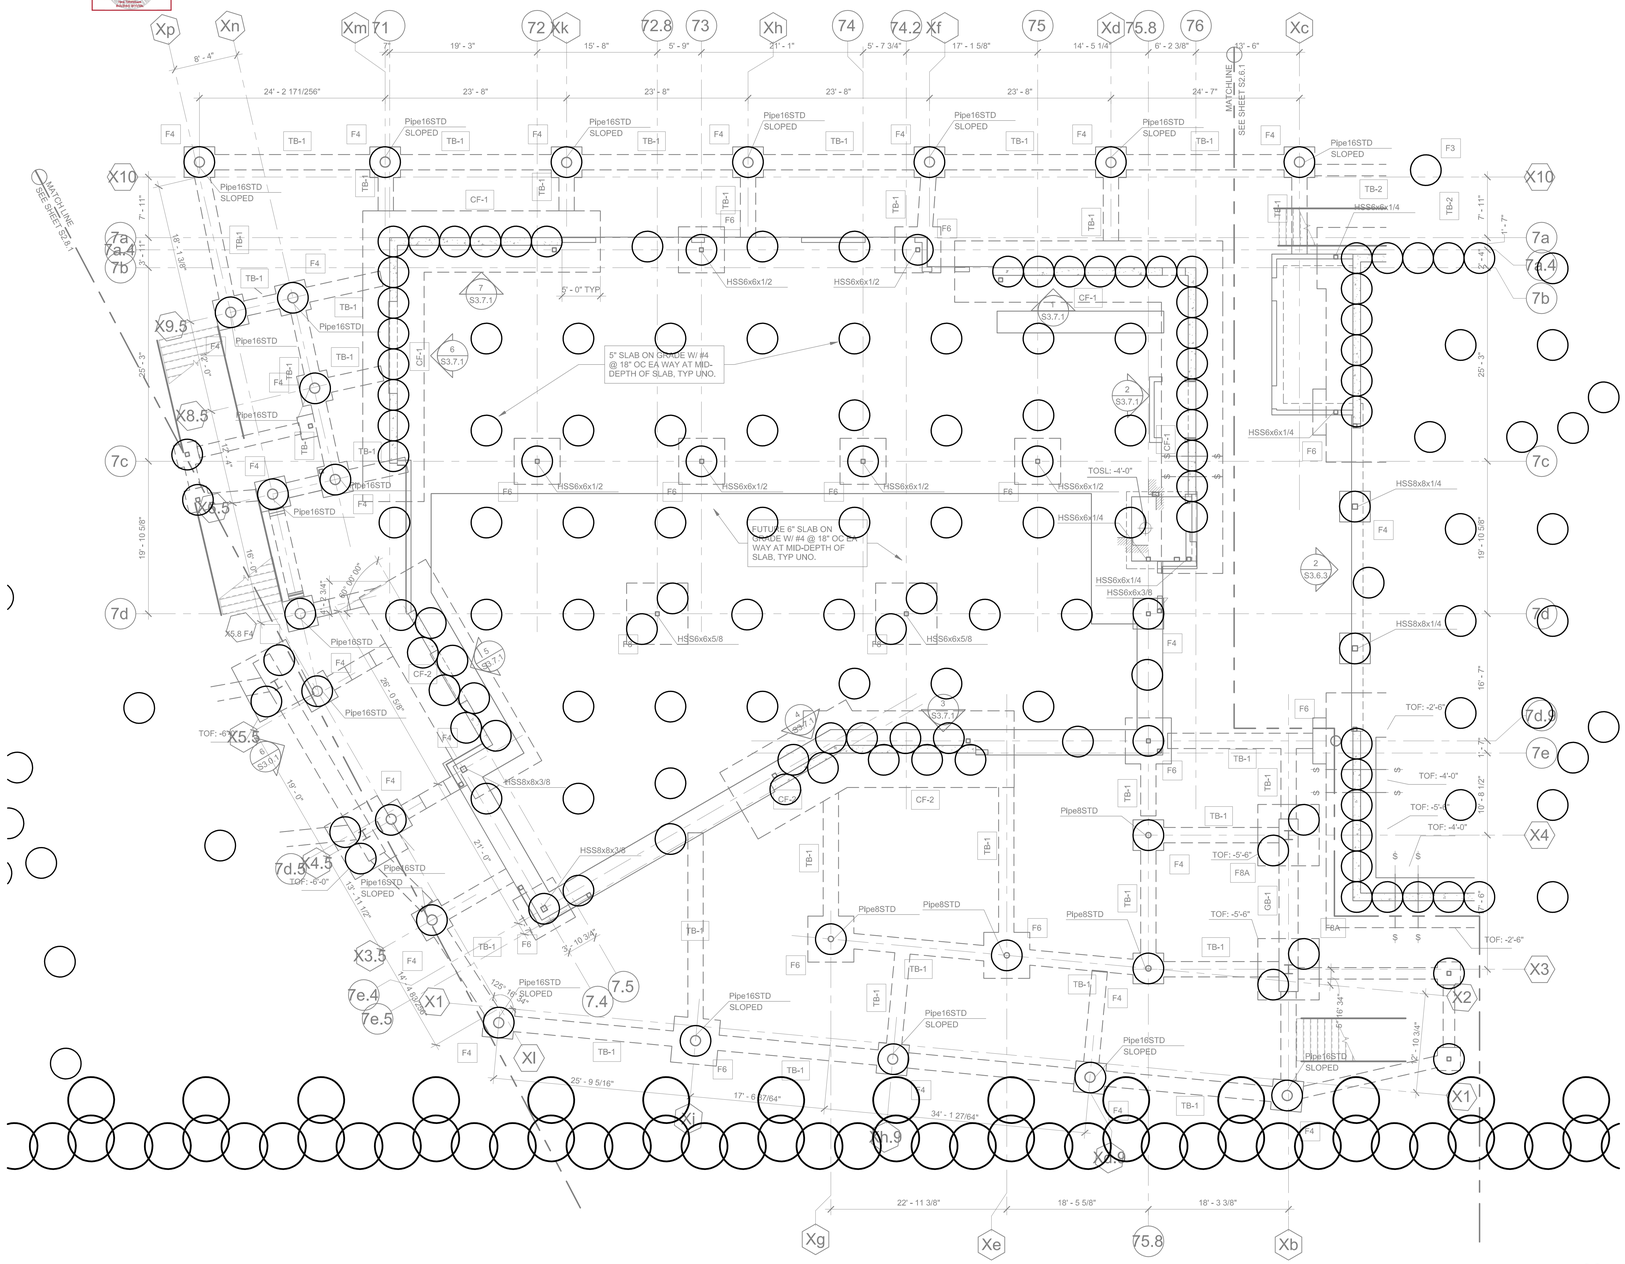

DSM COLUMN LAYOUT – BUILDING 7
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 7

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN

SHEET NUMBER: GI-4.3

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMSC-0240BSMS1-02412BMS1-02422BMS1-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
This approval is conditioned upon all applicable laws and regulations being complied with during all phases of construction. Issuance of this approval does not relieve the permittee of the responsibility of complying with all applicable laws and regulations. This approval shall not be valid unless the signature block is completed.
By: Tim Constantine
Building Official

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

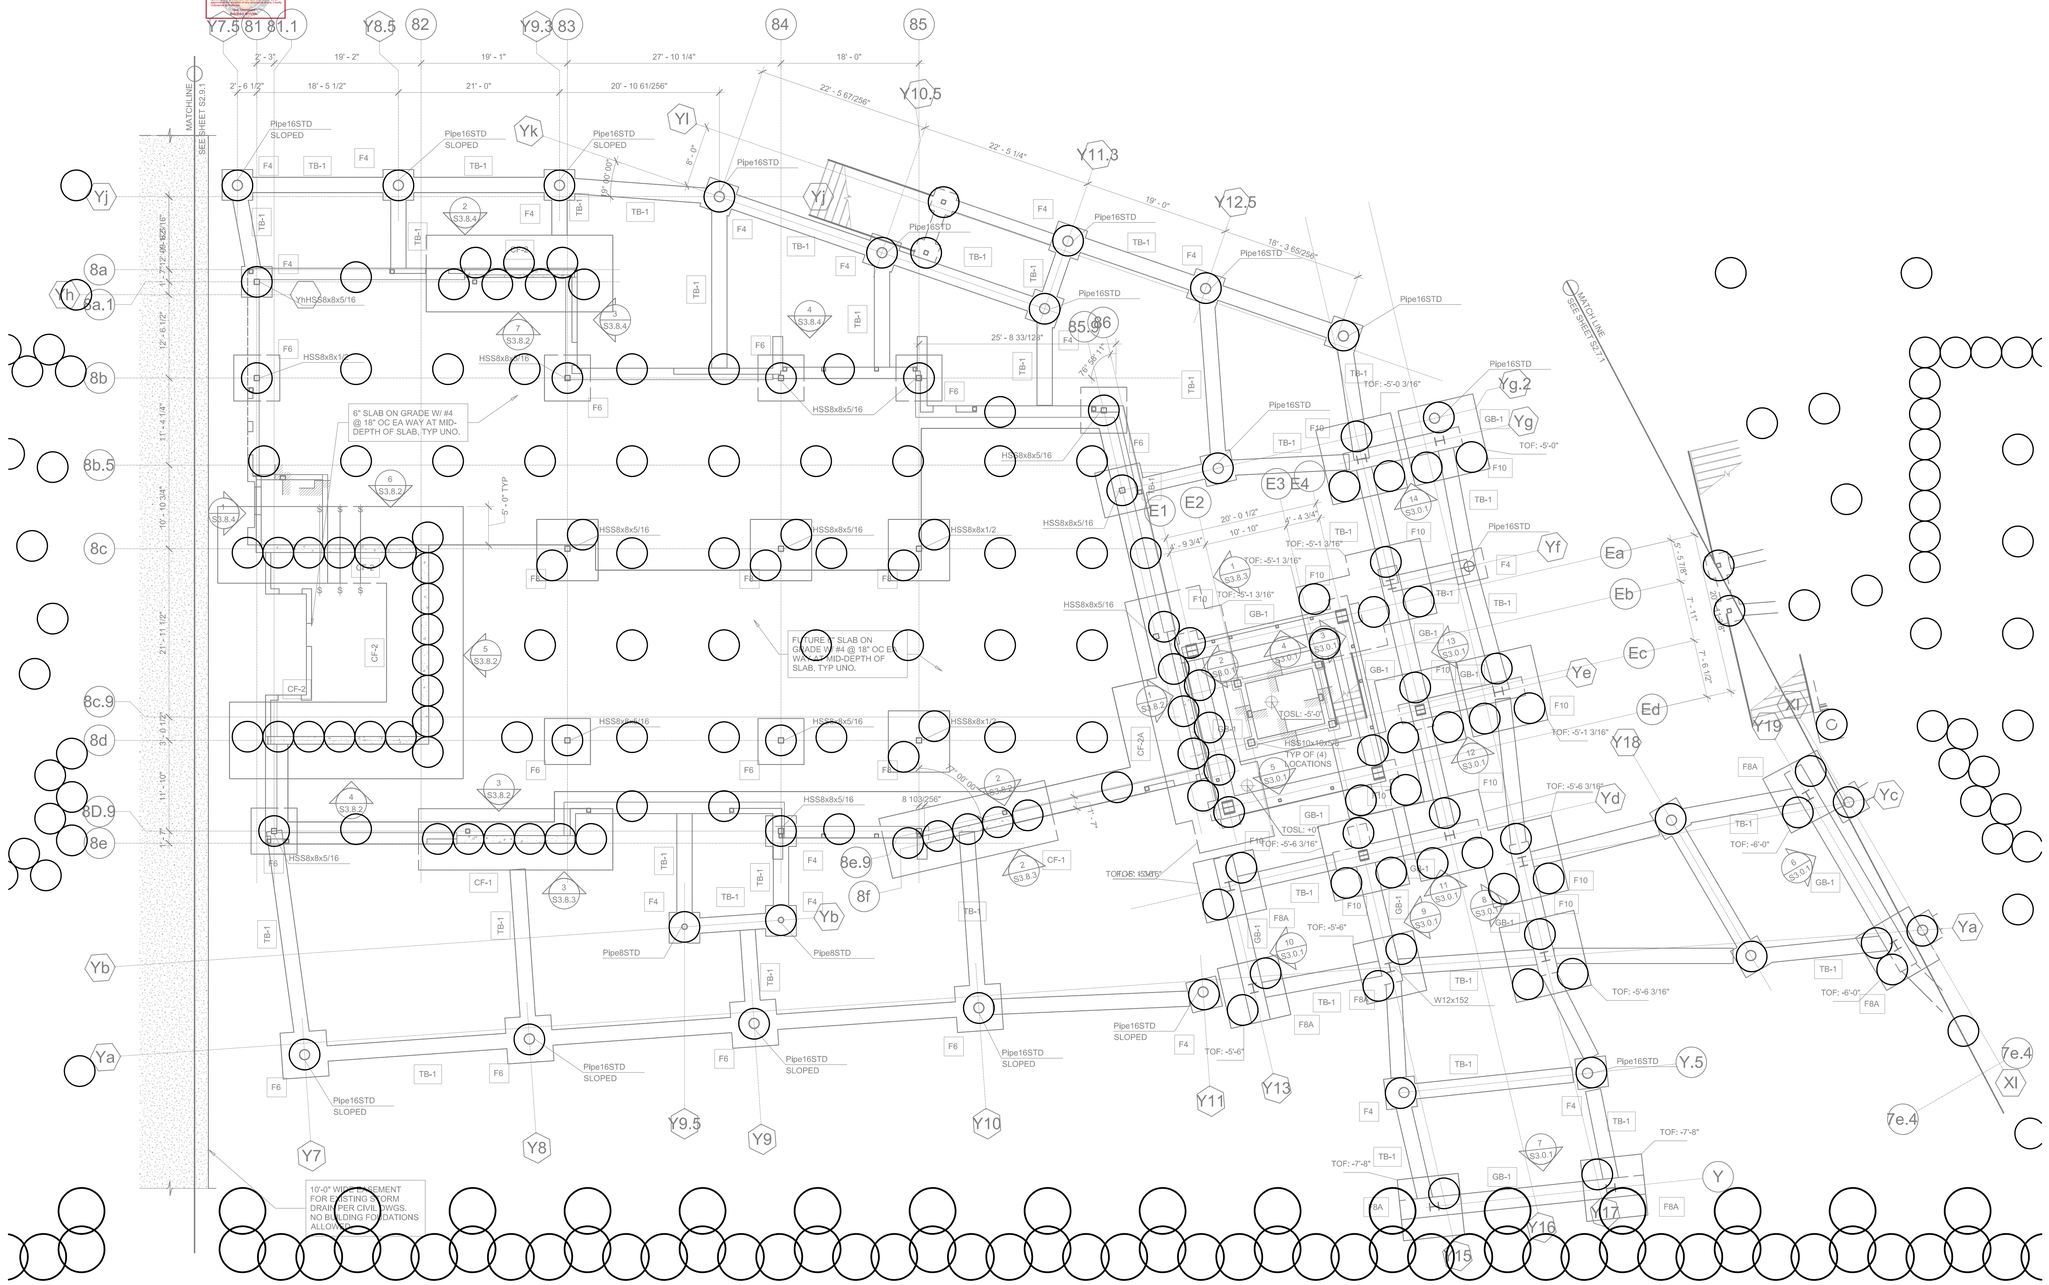

DSM COLUMN LAYOUT – BUILDING 8
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 8

PROJECT NO. –

DATE: 05/27/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.4

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-1924BSWR21-02412BMEP21-02423BMEP21-02431

County of Orange OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
This approval is valid only for the purpose and the use of which is requested. Approval of any work does not authorize violation of any law, regulation, ordinance or code of the County of Orange or any other agency. Approval of any work based on information provided by the applicant or his agent shall not prevent subsequent rejection of any work based on subsequently discovered information.
Reg. Geologist
PERMIT SYSTEM

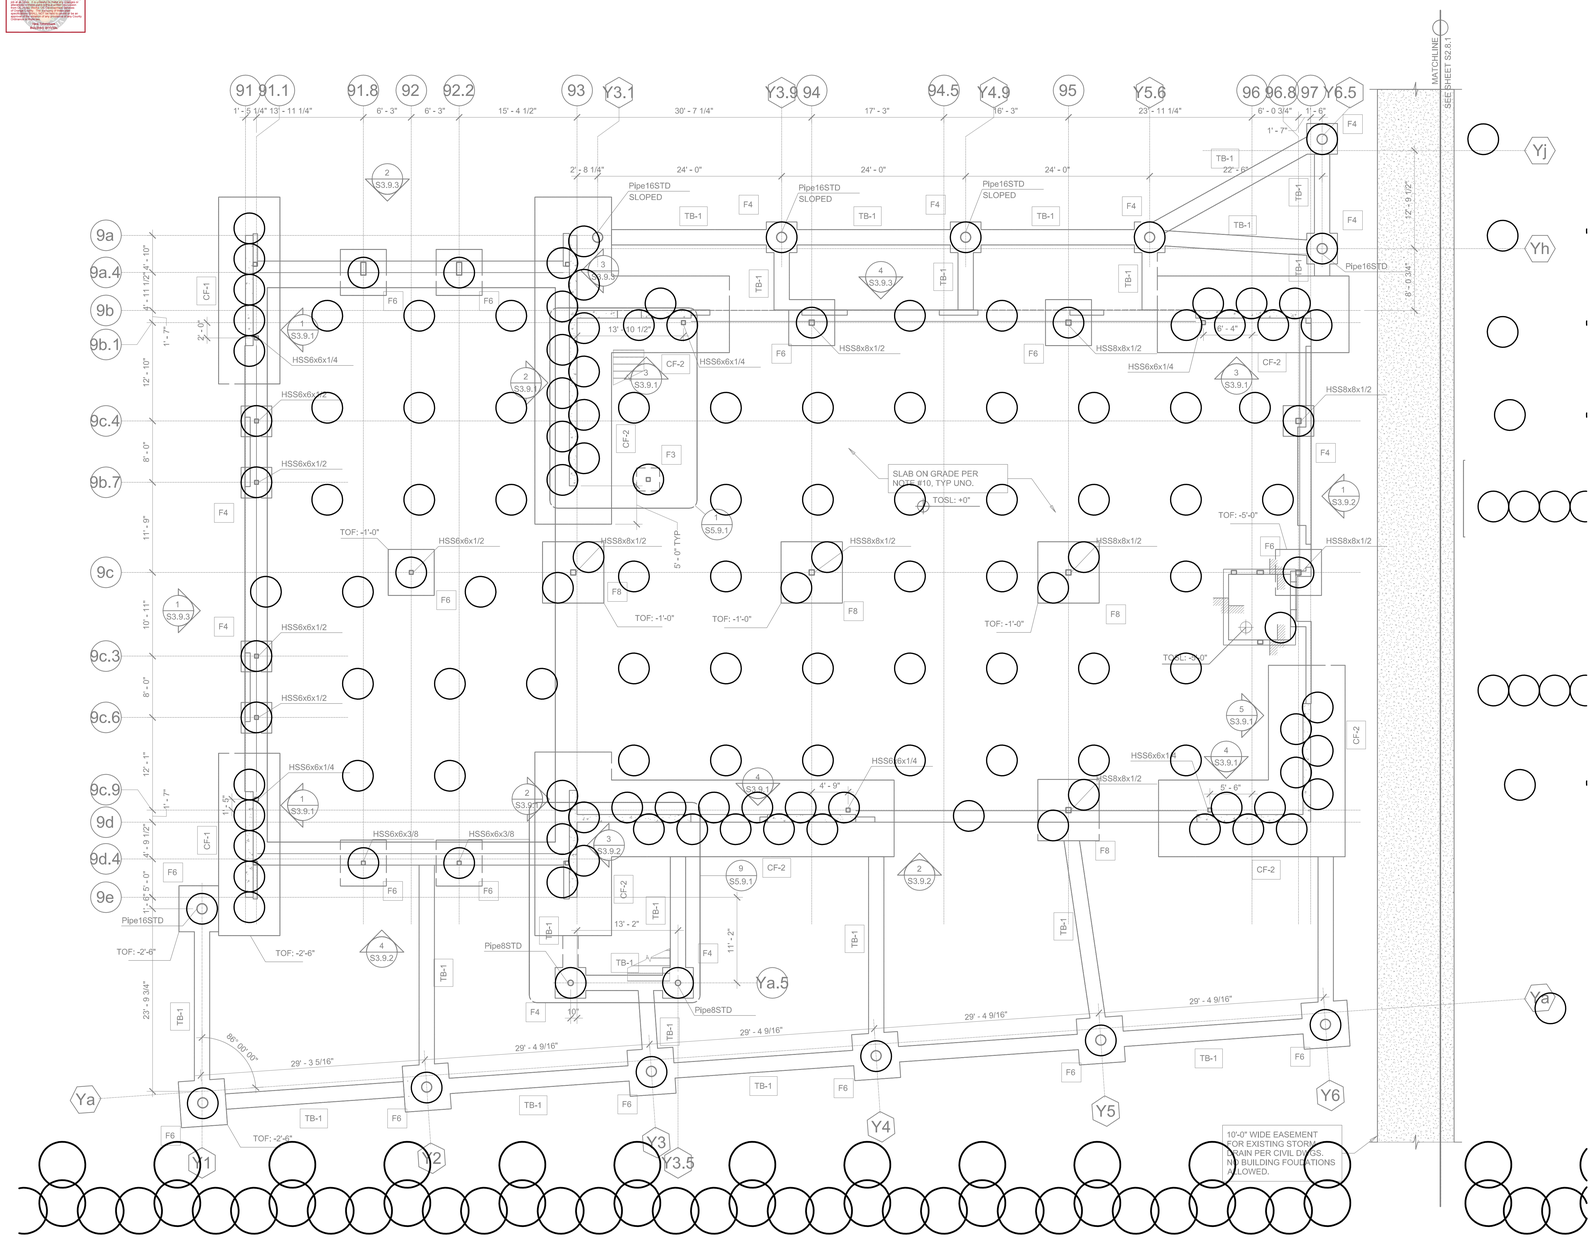

DSM COLUMN LAYOUT – BUILDING 9
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/9/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:
GROUND IMPROVEMENT FOR
DANA POINT HARBOR COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:
DEEP SOIL MIXING LAYOUT – BUILDING 9

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN
SHEET NUMBER: GI-4.5

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP-1E4B5B4B21-02A1B4B21-02A2B4B21-0243

County of Orange - OC Public Works
OC Development/Environmental
APPROVED
Your submittal has been reviewed and found to be in general conformance with applicable County codes and ordinances. Approval of this document does not authorize any violation of State or Federal laws. Approval does not constitute permission for any encroachment onto County right-of-way or easements. Approval is subject to any corrections required during construction.
Greg Donovan
PUBLIC WORKS

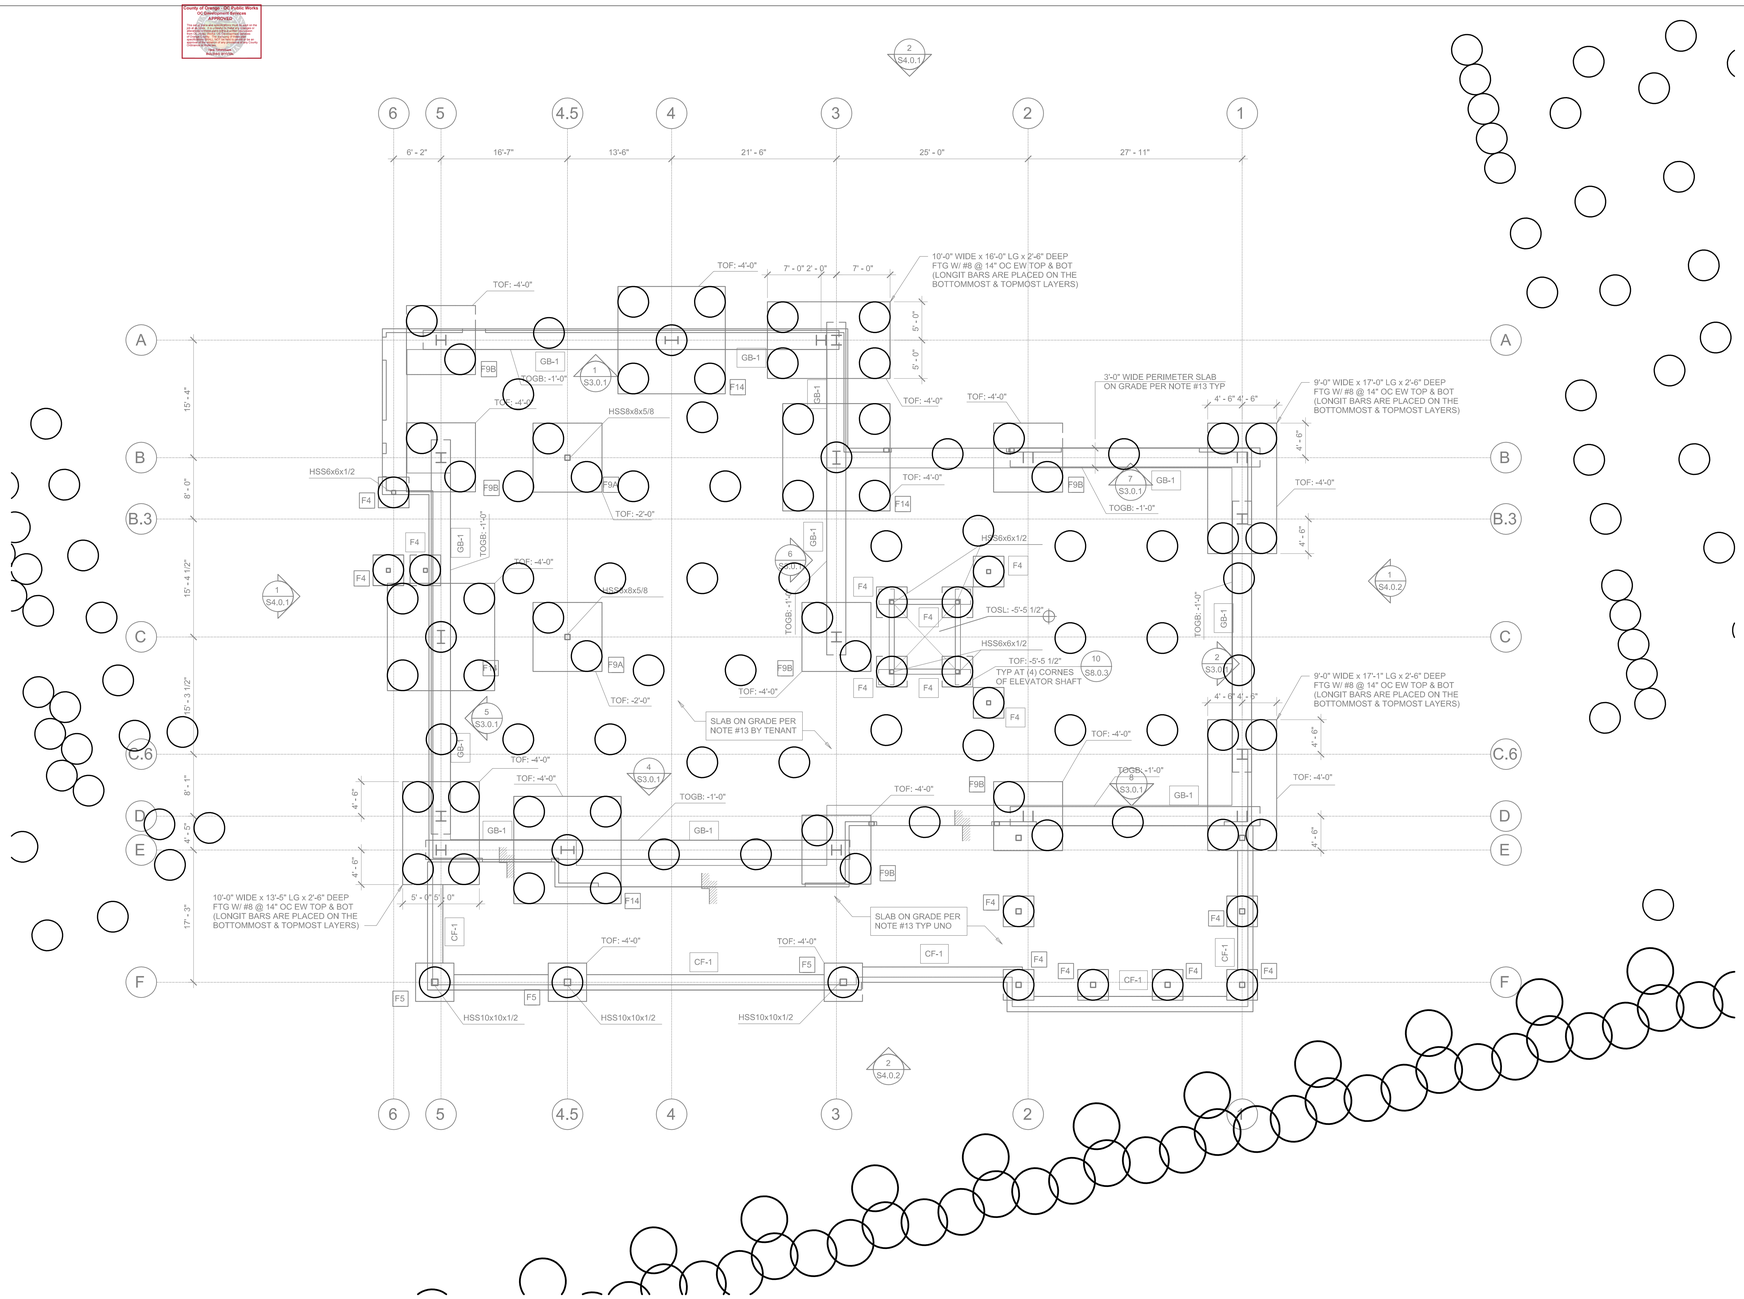

DSM COLUMN LAYOUT – BUILDING 10
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:

1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR COMMERCIAL COMPONENT DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT – BUILDING 10

PROJECT NO. –

DATE: 05/27/2021

SCALE: AS SHOWN

SHEET NUMBER: GI-4.6

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BMEP1-0248BMEP2-0241BMEP3-0242BMEP4-0243

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
Your plans are approved for construction as noted on the set of plans. It is your responsibility to obtain all necessary permits and clearances from all departments and agencies having jurisdiction over your project. Approval does not authorize violation of any code or regulation. Approval of revised plans must be obtained for changes made during construction.
Greg Immesoete
PERMIT INTERN

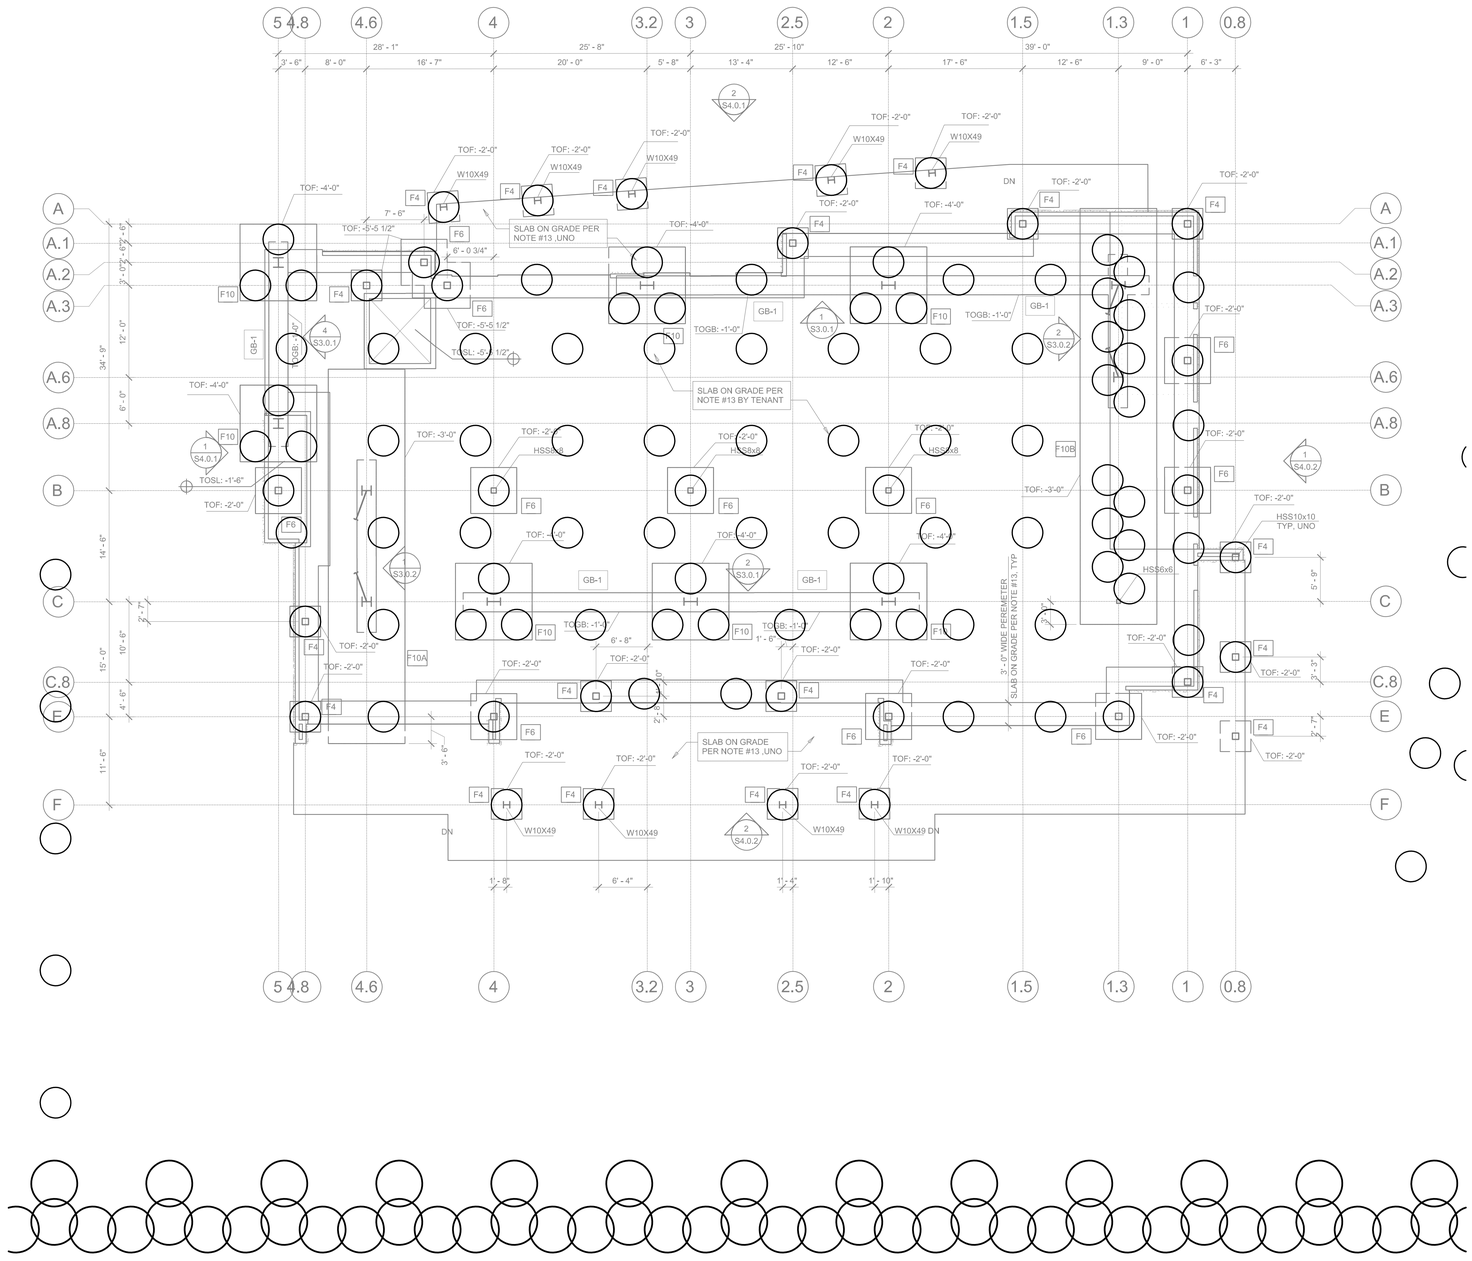

DSM COLUMN LAYOUT – BUILDING 11
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:

1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 11

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN

SHEET NUMBER: GI-4.7

S:\Leeds\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approved: Geotechnical Reports
Permits:
BMSV-S1409/BMSV-S31/BMSV-S34/BMSV-S343

County of Orange - OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
Your plans are approved for construction subject to all applicable conditions imposed by ordinance or law. By this approval the County of Orange does not assume responsibility for any omissions or errors that may exist. Approval of any construction work is conditioned upon full compliance with all County of Orange regulations.
Jay Crittenden
PUBLIC WORKS

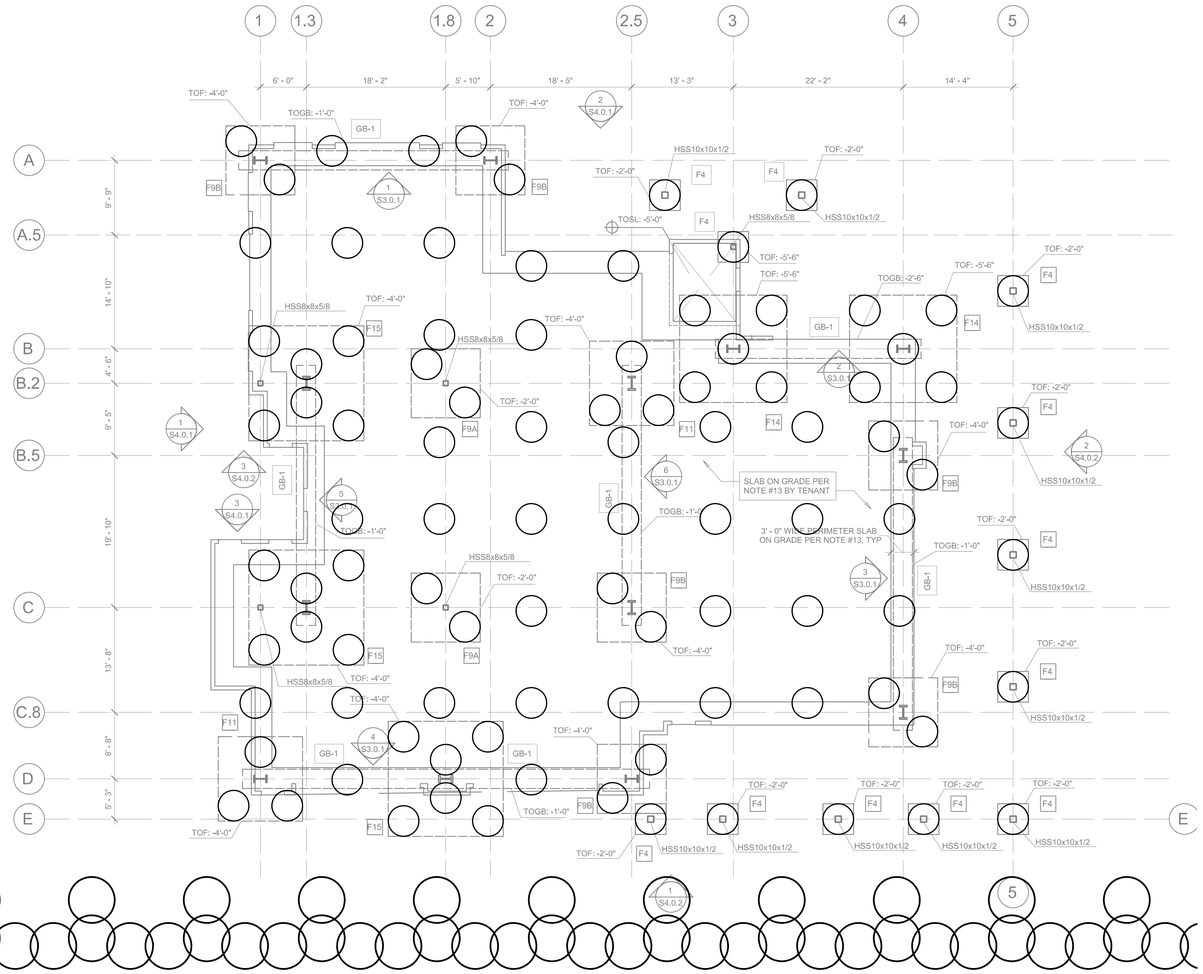

DSM COLUMN LAYOUT – BUILDING 12
SCALE: 1/8" = 1'

0' 8' 16'

LEGEND:

DSM COLUMN 6' ø EMBED 4' INTO CAPISTRANO FORMATION

DSM COLUMN 4' ø BEARING ON CAPISTRANO FORMATION

NOTES:
1. FOUNDATION PLAN PREPARED BY KPFF DATED 4/12/2021 AND SHOWN FOR REFERENCE ONLY. SEE LATEST STRUCTURAL PLANS FOR LOCATION AND DIMENSIONS OF FOOTINGS.

ADVANCED GEOSOLUTIONS Inc.

13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS

NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 CIVIL STATE OF CALIFORNIA

PROJECT:

GROUND IMPROVEMENT FOR

DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

DEEP SOIL MIXING LAYOUT
– BUILDING 12

PROJECT NO. –
DATE: 05/27/2021
SCALE: AS SHOWN

SHEET NUMBER:
GI-4.8

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg

Building&Safety: Ryan Rose 1/19/2020
Approval: Geotechnical Reports
Permits:
BWDI-GAMBWRG1-02413MRD1-02422MRV1-0243

County of Orange OC Public Works
OC Development Services
APPROVED
Date: 1/19/2020
These plans and specifications have been approved for use in the County of Orange unincorporated territory in accordance with the Building Code, Grading Code, Fire Code, or Subdivision Ordinance. Approval of these plans and specifications does not permit any violation of any section of the Building Code, Grading Code, Fire Code, or Subdivision Ordinance.
Troy Danielson
Inspection Services

A

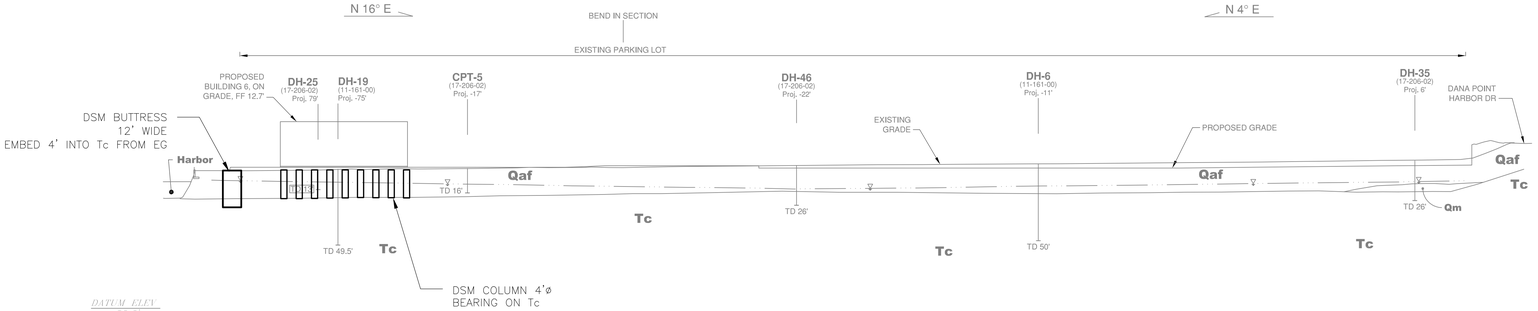

A'

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION A - A'
SCALE: 1" = 40'

B

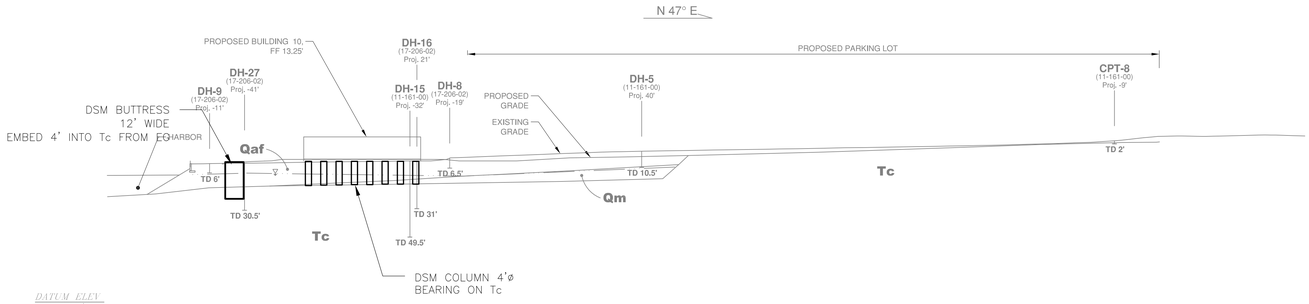

B'

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION B - B'
SCALE: 1" = 40'

C

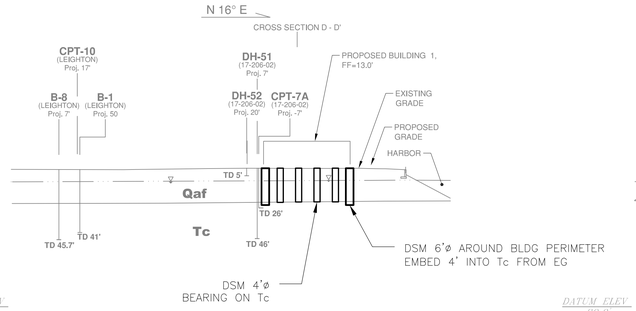

C'

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION C - C'
SCALE: 1" = 40'

D

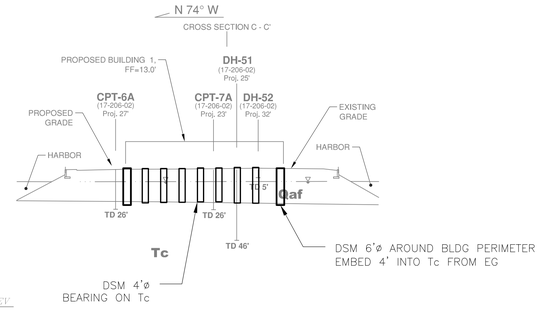

D'

DATUM ELEV.
-80.0'
GROUP 17-206-02
SECTION D - D'
SCALE: 1" = 40'

AGI
ADVANCED GEOSOLUTIONS Inc.
13 Orchard Rd, Suite 105
Lake Forest, CA 92630
Phone (310) 796-9000 | Fax (310) 796-9001
www.advgeosolutions.com

REVISIONS		
NO.	DATE	DESCRIPTION
–	–	–

REGISTERED PROFESSIONAL ENGINEER THOMAS TRAN C 91763 STATE OF CALIFORNIA CIVIL

PROJECT:

GROUND IMPROVEMENT FOR
DANA POINT HARBOR
COMMERCIAL COMPONENT
DANA POINT, CA

SHEET TITLE:

GEOTECHNICAL
SECTIONS

PROJECT NO.	SHEET NUMBER:
–	GI-5
DATE: 05/27/2021	
SCALE: AS SHOWN	

S:\Leads\Dana Point Harbor (L19-1748)\AGI Takeoff\AGI_Sheet_DSM.dwg